



240 Continental Drive, Suite 200
Newark, DE 19713
Tel: 302-738-7551
Fax: 302-454-5989

Addendum #04

198th Readiness Center - Major Capital Improvements
Delaware Army Reserve National Guard (DEARNG)
New Castle, Delaware
Tt Project No.: 200-76984-16005
DEARNG Contract # 01-2016

Addendum No. 04
to
Drawings and Project Manual

May 17, 2016

To: ALL BIDDERS

This ADDENDUM forms a part of the BIDDING AND CONTRACT DOCUMENTS and modifies the following documents:
Original DRAWINGS dated April 27, 2016,
PROJECT MANUAL dated April 27, 2016.
Acknowledge receipt of the ADDENDUM in the space provided on the FORM OF PROPOSAL

This ADDENDUM consists of one (1) page and attachments:

4.1 CHANGES TO PROJECT MANUAL

A. None

4.2 CHANGES TO DRAWINGS

A. **ADD** Sketch M/SK-02 indicating the gas line requirements in its entirety to the project.

4.3 CLARIFICATIONS/ REQUEST FOR INFORMATION (RFI'S)

A. Commonwealth Construction Company's email stated May 17, 2016:


1. Question: F-1 and F-2 are gas fired. There are no gas lines shown on the drawings. Is there a gas line in the Mechanical Room?

Response: Yes, there is a gas line in the Mechanical Room that needs to be connected to. Refer to further direction in this addendum.

ATTACHMENTS

M/SK-02

END OF ADDENDUM No. 04

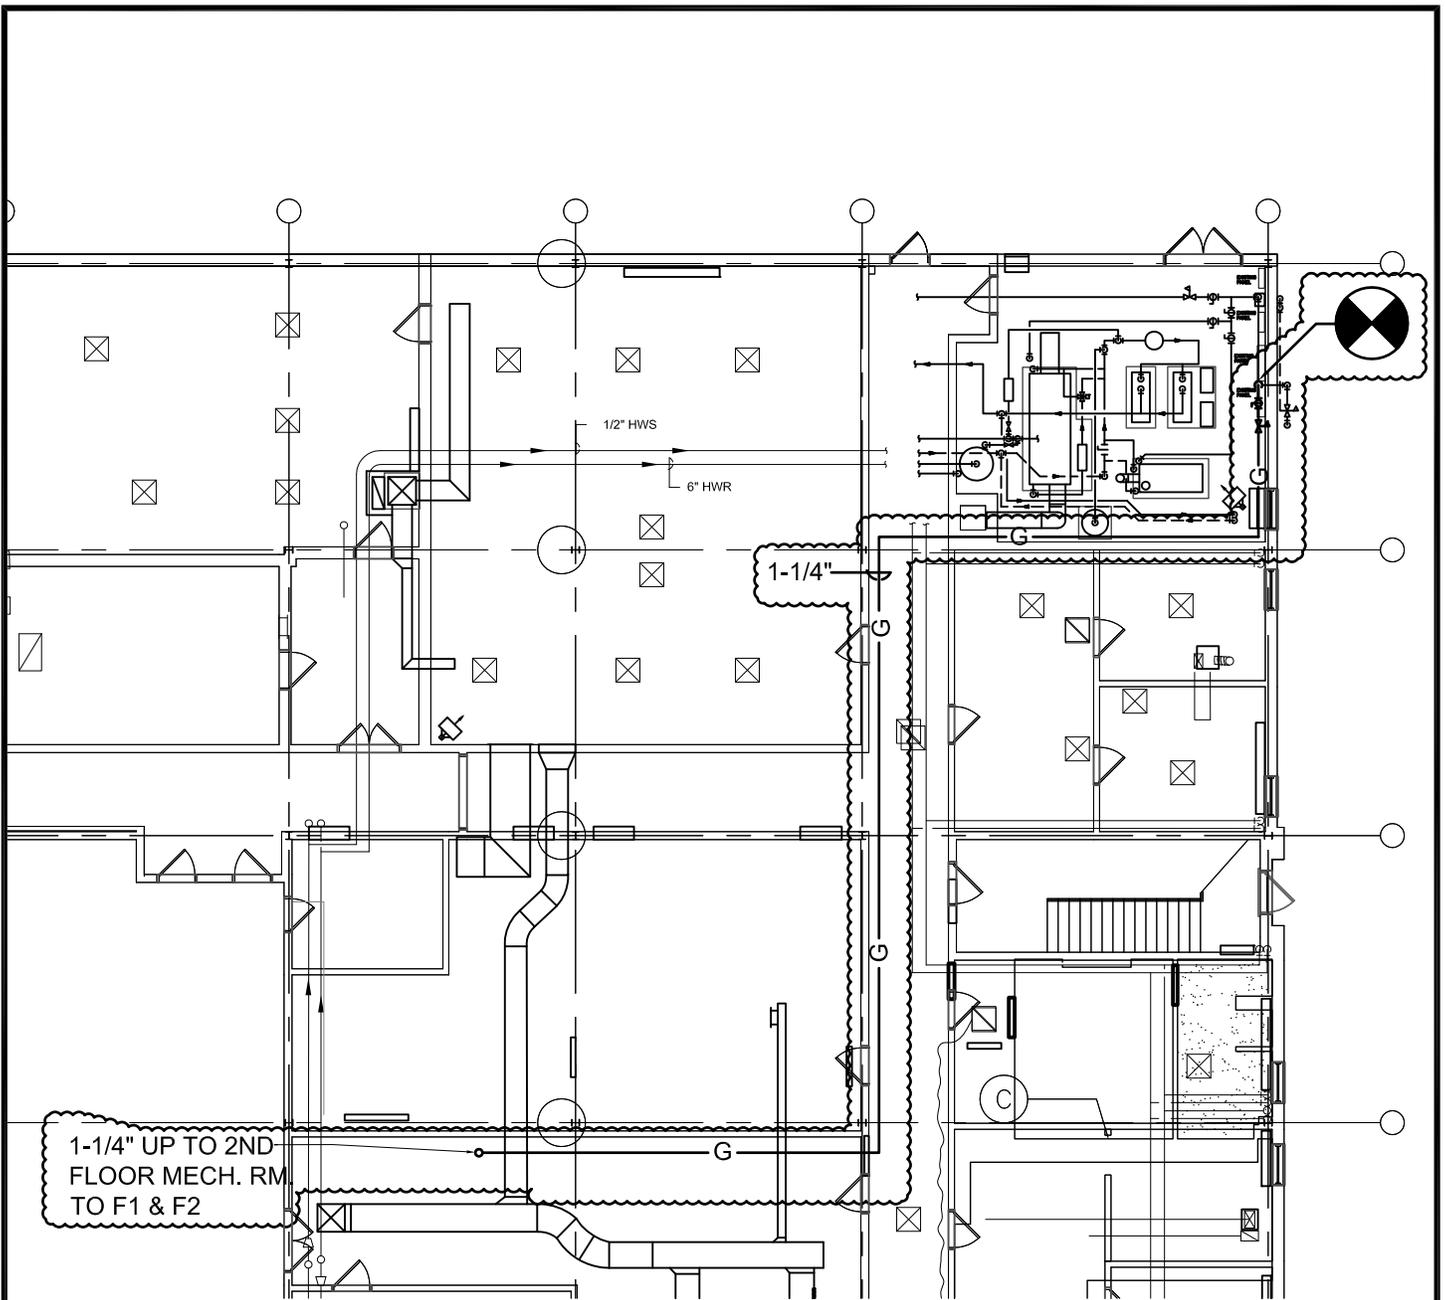

**PARTIAL GAS PIPING PLAN
UP TO 2ND FLOOR F1 & F2**

SCALE: 1/16"=1'-0"

REFERENCE SHEET M-101



TETRA TECH
ARCHITECTS & ENGINEERS

Tetra Tech Engineers, Architects & Landscape Architects, P.C.

Proj. No.:	
Date:	5-17-16
Rev.:	Date:
Drawn By:	JS

**PARTIAL GAS PIPING PLAN
UP TO 2ND FLOOR F1 & F2**

Drawing No.:
M/SK-02

DEARING & 198 READINESS CENTER MAJOR CAPS 200-76984-16005