



TETRA TECH
ARCHITECTS & ENGINEERS

240 Continental Drive, Suite 200
Newark, Delaware 19713
Tel. (302) 738-7551
Fax (302) 454-5989/5988

Addendum

Colonial School District
Wilmington, DE

Bid No.: 4-15-25

William Penn High School Security Entry Upgrades

Tt Project No. 16101-14002

Addendum No. 2
to
Drawings and Project Manual

February 17, 2015

To: ALL BIDDERS

This ADDENDUM forms a part of the BIDDING AND CONTRACT DOCUMENTS and modifies the following documents:
Original DRAWINGS dated February 3, 2015
PROJECT MANUAL dated February 3, 2015.

Acknowledge receipt of the ADDENDUM in the space provided on the FORM OF PROPOSAL

This ADDENDUM consists of two (2) pages not including the attachments:

1.0 CLARIFICATION

1.1 None at this time.

2.0 PROJECT MANUAL – NEW

2.1 Section 087100 Door Hardware, **ADD** in its entirety.

3.0 PROJECT MANUAL – MODIFICATIONS

3.1 Section 005010, Project Schedule and Sequence, **APPEND attached project schedule to specification.**

4.0 NEW DRAWINGS

4.1 None at this time

5.0 DRAWING MODIFICATIONS

- 5.1 Drawing A-101; In Room Finish Schedule, revise the following items for the room Vestibule C115 : change note in “COMMENTS” column to read as follows: “Provide tile at ramp, stair (new and existing) and adjacent surfaces to match existing tile in Vestibule - Provide Porcelain Stone tile (8” x 8” x 5/16”) by Crossville (manufacturer), tile series to be Cross-Colors Mingles, field tile color is Mica A900, accent color is Burgundy A790, accent pattern to match existing. Provide a third color in same series for stair treads (match existing color). Stair treads to have bullnose stairtread (4” x 8”). Finish on the three tiles is to be unpolished with cross-sheen. In the FLOOR FINISH and BASE FINISH columns, change the designation to PS-1. Under the ROOM FINISH KEY, at KEY designation PS-1, description to be PORCELAIN STONE TILE, TYPE 1.

ATTACHMENT LIST

1. Meeting Record
2. Pre-bid Meeting Sign-In Sheet
3. Plan Holder’s List (Bid Register)

END OF ADDENDUM No. 2



TETRA TECH

240 Continental Drive, Suite 200, Newark, Delaware 19713

PREBID MEETING SIGN-IN SHEET

TT PROJECT NO.: 200-16101-14002

DATE: February 3, 2015

WILLIAM PENN HIGH SCHOOL
SECURITY ENTRY UPGRADES

Name	Company	Physical Address	Telephone	Fax	e-mail
1 Kirk Waddie	Advantech.	4092 N. DuPont Hwy.	302-670-8565		Kirk.Waddie@advantech.com
2 C. W. W. W.	Food Construction	2316 Oak Rd, Smyrna	302-653-1616	302-653-1614	estimator2@foodconstruction.com
3 James June	Assurance Media	590 Century Blvd Wilmington	484-844-1225	302-866-244	June@assurancemedia.com
4 Tony Ventresca	Ventresca Bros, Inc.	2300 N. DuPont Hwy, New Castle, DE	302-658-6436	302-658-2360	Tony@ventresca-bros.com
5 BILL MICHELINIE	BCI	34 INDUSTRIAL BLDG. NEW CASTLE, DE 19720	302-325-2700	302-325-2733	bmichelinie@bcionline.com
6 Tom & Vicky Tek	TEK ELECTRONICS	865 BALLOON DR. MIDDLETOWN DE 19709	302-449-6947	610-345-1318	TK@TEKELC.COM
7 BIRN SMITH	BSS CONSTRUCTORS	381 E EVERGREEN ST WEST GROVE PA 19380	484-256-4986		bscdirector@bssconstructors.com
8					
9 Karen Gilbert					
10 Rick B.					
11 Tim S.					
12					
13					
14					

	Name	Company	Physical Address	Telephone	Fax	e-mail
15	Stacey Bush	Amber, Inc	112 Clinton St Duluth DE 19706	302 834-8069	-8081	Amber@aol.com
16	Mark W. Bernstein	HEATER SERVICES	113 SANDY DR NEWMARK	302 545-4994		MARK@EHEAT.HPE
17	WIMIE FITZSYMONS	SUPERIOR ELECTRIC SERVICES	36 GERMANY DRIVE WILM DE	302-658-5949		WIMIE@SUPERIORELECTRIC.SI
18	Vernon Reisinger	Donald Reisinger Inc	717 E Washington WILM, DE 19340	610-696-6124	610-2332	Polly.Jerlik@adco
19	Kevin Twilley	SOOND-N-SOUND	20444 PROPER DRIVE WILM, DE 19713	302-222-2159		Ktwilley@SOUNDNSECURE.A
20	Steven Schofield	PSX Inc	708 Terminal Way Kennett, PA 19348	(410) 444-8210 @ (302) 757-1428 @	(610) 444-9696	stevens.schofield @psxgroup.com
21	Fred Fisher	FIRST STATES ELECTRIC	25 King Ct New Castle DE	302 322-0140	302 322 1146	Fred@FirststatesElectric.com
22						
23						
24						
25						
26						
27						
28						
29						
30						
31						
32						



240 Continental Drive, Suite 200
 Newark, Delaware 19713
 Tel. (302) 738-7551
 Fax (302) 454-5989/5988

Pre-Bid Meeting Record

Meeting Date:	<u>2/3/2015</u>	
Publication Date:	<u>2/11/2015</u>	
Prepared By:	<u>Tim Skibicki</u>	
Attendees:	<u>See attached sign-in sheet</u>	
Additional Distribution:	_____	
Project Name.:	<u>W.P.H.S. Security</u>	Project No.:
Regarding:	<u>Upgrades Entry</u>	<u>16101-14002</u>
	<u>Pre Bid information</u>	

Item Number	Item
1	A pre-bid meeting was held for the William Penn H.S. Security Upgrades Entry Project (Bid # 4-15-25) at Colonial School District. The pre-bid meeting was mandatory and all present were asked to sign the pre-bid sign in sheet.
2	Prime Contractor Bidders must be Pre-Qualified with the State of Delaware under the "General Construction" or "Carpentry" trade classification to be eligible to bid on this project. Mechanical and Electrical Sub-Contractors must also be pre-qualified with the State of Delaware to bid this project.
3	Bids Due 2:00 p.m. local time on Thursday, February 19, 2015.
4	Sealed bids shall be delivered to: Colonial School District's Administration Building, 318 E. Basin Rd., New Castle, DE Post meeting note: The outer envelope should clearly indicate: "BID #4-15-25 William Penn High School Security Entry Upgrades - DO NOT OPEN"
5	Documents can be purchased at Tetra Tech's office, 240 Continental Drive, Suite 200, Newark, DE for a non refundable \$150 fee per set.
6	Only plan holders who purchased drawings from Tetra Tech will receive ADDENDA.
7	Please submit all questions to Tim Skibicki via email tim.skibicki@tetrattech.com or via fax @ 302.454.5989
8	Substitution requests (bidding only) must be submitted in writing as required by specifications.
9	A brief overview of the projects scope was given. Renovations to the William Penn High School Entry Lobby, Reception Area and Administrative offices as indicated in the construction documents. The area of construction will be vacated for the construction phase.
10	A construction partition shall be provided by the contractor; Provide 42 linear feet of temporary partition (8 feet high) to partition off one half of Vestibule C115A from the other half, partition will run up/ down the sheet and will transverse the existing stairs in the Vestibule. Partition is to be constructed with gypsum wallboard with joints taped on interior sides, and fire-retardant plywood on exterior side.
11	Project Schedule was reviewed - project includes liquidated damages for late completion. The project will be performed during the schools summer break. A project schedule is provided as an attachment to this addendum.
12	The Subcontractor's List was reviewed: No exceptions were taken to the subcontractor listing.
13	Submission of 10% secured bid deposit and 100% performance/ material labor bond is required with bid.
14	This is a state of Delaware, Department of Labor, Prevailing Wage project. The Wage Rate Determination Sheet is in the Front End of the Project Manual.
15	Permits are the responsibility of the Contractor.
16	A separate project is currently underway in the school to install security cameras and a card reader system.
17	A visit to the project area at WPHS was made available to those who wanted to attend after the pre-bid meeting.
18	The following will be contracted By Owner: a.Construction testing; soil compaction, concrete testing and steel weld testing. b.Telecomm except conduits, boxes, raceways and cabletrays.
	End of report

SECTION 087100 – DOOR HARDWARE

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes commercial door hardware for the following:
 - 1. Swinging doors.
 - 2. Other doors to the extent indicated.
- B. Door hardware includes, but is not necessarily limited to, the following:
 - 1. Mechanical door hardware.
 - 2. Electromechanical door hardware, power supplies, back-ups and surge protection.
 - 3. Cylinders specified for doors in other sections.
- C. Related Sections:
 - 1. Division 08 Section “Hollow Metal Doors and Frames”.
 - 2. Division 08 Section “Flush Wood Doors”.
- D. Codes and References: Comply with the version year adopted by the Authority Having Jurisdiction.
 - 1. ANSI A117.1 - Accessible and Usable Buildings and Facilities.
 - 2. ICC/IBC - International Building Code.
 - 3. NFPA 80 - Fire Doors and Windows.
 - 4. NFPA 101 - Life Safety Code.
 - 5. NFPA 105 - Installation of Smoke Door Assemblies.
 - 6. State Building Codes, Local Amendments.
- E. Standards: All hardware specified herein shall comply with the following industry standards:
 - 1. ANSI/BHMA Certified Product Standards - A156 Series
 - 2. UL10C – Positive Pressure Fire Tests of Door Assemblies

1.3 SUBMITTALS

- A. Product Data: Manufacturer's product data sheets including installation details, material descriptions, dimensions of individual components and profiles, operational descriptions and finishes.
- B. Door Hardware Schedule: Prepared by or under the supervision of supplier, detailing fabrication and assembly of door hardware, as well as procedures and diagrams. Coordinate the final Door Hardware Schedule with doors, frames, and related work to ensure proper size, thickness, hand, function, and finish of door hardware.
 - 1. Format: Comply with scheduling sequence and vertical format in DHI's "Sequence and Format for the Hardware Schedule."
 - 2. Organization: Organize the Door Hardware Schedule into door hardware sets indicating complete designations of every item required for each door or opening. Organize door hardware sets in same order as in the Door Hardware Sets at the end of Part 3. Submittals that do not follow the same format and order as the Door Hardware Sets will be rejected and subject to resubmission.
 - 3. Content: Include the following information:
 - a. Type, style, function, size, label, hand, and finish of each door hardware item.
 - b. Manufacturer of each item.
 - c. Fastenings and other pertinent information.
 - d. Location of door hardware set, cross-referenced to Drawings, both on floor plans and in door and frame schedule.
 - e. Explanation of abbreviations, symbols, and codes contained in schedule.
 - f. Mounting locations for door hardware.
 - g. Door and frame sizes and materials.
 - 4. Submittal Sequence: Submit the final Door Hardware Schedule at earliest possible date, particularly where approval of the Door Hardware Schedule must precede fabrication of other work that is critical in the Project construction schedule. Include Product Data, Samples, Shop Drawings of other work affected by door hardware, and other information essential to the coordinated review of the Door Hardware Schedule.
- C. Shop Drawings: Details of electrified access control hardware indicating the following:
 - 1. Wiring Diagrams: Upon receipt of approved schedules, submit detailed system wiring diagrams for power, signaling, monitoring, communication, and control of the access control system electrified hardware. Differentiate between manufacturer-installed and field-installed wiring. Include the following:
 - a. Elevation diagram of each unique access controlled opening showing location and interconnection of major system components with respect to their placement in the respective door openings.
 - b. Complete (risers, point-to-point) access control system block wiring diagrams.

2. Electrical Coordination: Coordinate with related Division 26 Electrical Sections the voltages and wiring details required at electrically controlled and operated hardware openings.
- D. Keying Schedule: Prepared under the supervision of the Owner, separate schedule detailing final keying instructions for locksets and cylinders in writing. Include keying system explanation, door numbers, key set symbols, hardware set numbers and special instructions. Owner to approve submitted keying schedule prior to the ordering of permanent cylinders.
- E. Operating and Maintenance Manuals: Provide manufacturers operating and maintenance manuals for each item comprising the complete door hardware installation in quantity as required in Division 01, Closeout Submittals. The manual to include the name, address, and contact information of the manufacturers providing the hardware and their nearest service representatives. The final copies delivered after completion of the installation test to include "as built" modifications made during installation, checkout, and acceptance.
- F. Warranties and Maintenance: Special warranties and maintenance agreements specified in this Section.

1.4 QUALITY ASSURANCE

- A. Manufacturers Qualifications: Engage qualified manufacturers with a minimum 5 years of documented experience in producing hardware and equipment similar to that indicated for this Project and that have a proven record of successful in-service performance.
- B. Installer Qualifications: Installers, trained by the primary product manufacturers, with a minimum 3 years documented experience installing both standard and electrified builders hardware similar in material, design, and extent to that indicated for this Project and whose work has resulted in construction with a record of successful in-service performance.
- C. Door Hardware Supplier Qualifications: Experienced commercial door hardware distributors with a minimum 5 years documented experience supplying both mechanical and electromechanical hardware installations comparable in material, design, and extent to that indicated for this Project. Supplier recognized as a factory direct distributor in good standing by the manufacturers of the primary materials with a warehousing facility in Project's vicinity. Supplier to have on staff a certified Architectural Hardware Consultant (AHC) available during the course of the Work to consult with Contractor, Architect, and Owner concerning both standard and electromechanical door hardware and keying.
 1. Scheduling Responsibility: Preparation of door hardware and keying schedules.
- D. Source Limitations: Obtain each type and variety of Door Hardware specified in this Section from a single source, qualified supplier unless otherwise indicated.
 1. Electrified modifications or enhancements made to a source manufacturer's product line by a secondary or third party source will not be accepted.

2. Provide electromechanical door hardware from the same manufacturer as mechanical door hardware, unless otherwise indicated.
- E. Regulatory Requirements: Comply with NFPA 70, NFPA 80, NFPA 101 and ANSI A117.1 requirements and guidelines as directed in the model building code including, but not limited to, the following:
1. NFPA 70 "National Electrical Code", including electrical components, devices, and accessories listed and labeled as defined in Article 100 by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.
 2. Where indicated to comply with accessibility requirements, comply with Americans with Disabilities Act (ADA), "Accessibility Guidelines for Buildings and Facilities (ADAAG)," ANSI A117.1 as follows:
 - a. Handles, Pulls, Latches, Locks, and other Operating Devices: Shape that is easy to grasp with one hand and does not require tight grasping, tight pinching, or twisting of the wrist.
 - b. Door Closers: Comply with the following maximum opening-force requirements indicated:
 - 1) Interior Hinged Doors: 5 lbf applied perpendicular to door.
 - 2) Fire Doors: Minimum opening force allowable by authorities having jurisdiction.
 - c. Thresholds: Not more than 1/2 inch high. Bevel raised thresholds with a slope of not more than 1:2.
 3. NFPA 101: Comply with the following for means of egress doors:
 - a. Latches, Locks, and Exit Devices: Not more than 15 lbf to release the latch. Locks shall not require the use of a key, tool, or special knowledge for operation.
 - b. Thresholds: Not more than 1/2 inch high.
 4. Fire-Rated Door Assemblies: Provide door hardware for assemblies complying with NFPA 80 that are listed and labeled by a testing and inspecting agency acceptable to authorities having jurisdiction, for fire ratings indicated, based on testing according to NFPA 252 (neutral pressure at 40" above sill) or UL-10C.
 - a. Test Pressure: Positive pressure labeling.
- F. Each unit to bear third party permanent label demonstrating compliance with the referenced standards.
- G. Keying Conference: Conduct conference to comply with requirements in Division 01 Section "Project Meetings." Keying conference to incorporate the following criteria into the final keying schedule document:

1. Function of building, purpose of each area and degree of security required.
 2. Plans for existing and future key system expansion.
 3. Requirements for key control storage and software.
 4. Installation of permanent keys, cylinder cores and software.
 5. Address and requirements for delivery of keys.
- H. Pre-Submittal Conference: Conduct coordination conference in compliance with requirements in Division 01 Section "Project Meetings" with attendance by representatives of Supplier(s), Installer(s), and Contractor(s) to review proper methods and the procedures for receiving, handling, and installing door hardware.
1. Prior to installation of door hardware, conduct a project specific training meeting to instruct the installing contractors' personnel on the proper installation and adjustment of their respective products. Product training to be attended by installers of door hardware (including electromechanical hardware) for aluminum, hollow metal and wood doors. Training will include the use of installation manuals, hardware schedules, templates and physical product samples as required.
 2. Inspect and discuss electrical roughing-in, power supply connections, and other preparatory work performed by other trades.
 3. Review sequence of operation narratives for each unique access controlled opening.
 4. Review and finalize construction schedule and verify availability of materials.
 5. Review the required inspecting, testing, commissioning, and demonstration procedures
- I. At completion of installation, provide written documentation that components were applied to manufacturer's instructions and recommendations and according to approved schedule.

1.5 DELIVERY, STORAGE, AND HANDLING

- A. Inventory door hardware on receipt and provide secure lock-up and shelving for door hardware delivered to Project site. Do not store electronic access control hardware, software or accessories at Project site without prior authorization.
- B. Tag each item or package separately with identification related to the final Door Hardware Schedule, and include basic installation instructions with each item or package.
- C. Deliver, as applicable, permanent keys, cylinders, cores, access control credentials, software and related accessories directly to Owner via registered mail or overnight package service. Instructions for delivery to the Owner shall be established at the "Keying Conference".

1.6 COORDINATION

- A. Templates: Obtain and distribute to the parties involved templates for doors, frames, and other work specified to be factory prepared for installing standard and electrified hardware. Check Shop Drawings of other work to confirm that adequate provisions are made for locating and installing hardware to comply with indicated requirements.

- B. Door Hardware and Electrical Connections: Coordinate the layout and installation of scheduled electrified door hardware and related access control equipment with required connections to source power junction boxes, low voltage power supplies, detection and monitoring hardware, and fire and detection alarm systems.
- C. Door and Frame Preparation: Related Division 08 Sections (Steel, Aluminum and Wood) doors and corresponding frames are to be prepared, reinforced and pre-wired (if applicable) to receive the installation of the specified electrified, monitoring, signaling and access control system hardware without additional in-field modifications.

1.7 WARRANTY

- A. General Warranty: Reference Division 01, General Requirements. Special warranties specified in this Article shall not deprive Owner of other rights Owner may have under other provisions of the Contract Documents and shall be in addition to, and run concurrent with, other warranties made by Contractor under requirements of the Contract Documents.
- B. Warranty Period: Written warranty, executed by manufacturer(s), agreeing to repair or replace components of standard and electrified door hardware that fails in materials or workmanship within specified warranty period after final acceptance by the Owner. Failures include, but are not limited to, the following:
 - 1. Structural failures including excessive deflection, cracking, or breakage.
 - 2. Faulty operation of the hardware.
 - 3. Deterioration of metals, metal finishes, and other materials beyond normal weathering.
 - 4. Electrical component defects and failures within the systems operation.
- C. Standard Warranty Period: One year from date of Substantial Completion, unless otherwise indicated.
- D. Special Warranty Periods:
 - 1. Ten years for mortise locks and latches.
 - 2. Twenty five years for manual surface door closers.
 - 3. Two years for electromechanical door hardware.

1.8 MAINTENANCE SERVICE

- A. Maintenance Tools and Instructions: Furnish a complete set of specialized tools and maintenance instructions as needed for Owner's continued adjustment, maintenance, and removal and replacement of door hardware.
- B. Continuing Service: Beginning at Substantial Completion, and running concurrent with the specified warranty period, provide continuous (6) months full maintenance including repair and replacement of worn or defective components, lubrication, cleaning, and adjusting as required for proper door opening operation. Provide parts and supplies as used in the manufacture and installation of original products.

PART 2 - PRODUCTS

2.1 SCHEDULED DOOR HARDWARE

- A. General: Provide door hardware for each door to comply with requirements in Door Hardware Sets and each referenced section that products are to be supplied under.
1. Designations: Requirements for quantity, item, size, finish or color, grade, function, and other distinctive qualities of each type of door hardware are indicated in the Door Hardware Sets at the end of Part 3. Products are identified by using door hardware designations, as follows:
 - a. Named Manufacturer's Products: Product designation and manufacturer are listed for each door hardware type required for the purpose of establishing requirements. Manufacturers' names are abbreviated in the Door Hardware Schedule.
 - B. Substitutions: Requests for substitution and product approval for inclusive mechanical and electromechanical door hardware in compliance with the specifications must be submitted in writing and in accordance with the procedures and time frames outlined in Division 01, Substitution Procedures. Approval of requests is at the discretion of the architect, owner, and their designated consultants.

2.2 HANGING DEVICES

- A. Hinges: ANSI/BHMA A156.1 certified butt hinges with number of hinge knuckles as specified in the Door Hardware Sets.
1. Quantity: Provide the following hinge quantity, unless otherwise indicated:
 - a. Two Hinges: For doors with heights up to 60 inches.
 - b. Three Hinges: For doors with heights 61 to 90 inches.
 - c. Four Hinges: For doors with heights 91 to 120 inches.
 - d. For doors with heights more than 120 inches, provide 4 hinges, plus 1 hinge for every 30 inches of door height greater than 120 inches.
 2. Hinge Size: Provide the following, unless otherwise indicated, with hinge widths sized for door thickness and clearances required:
 - a. Widths up to 3'0": 4-1/2" standard or heavy weight as specified.
 - b. Sizes from 3'1" to 4'0": 5" standard or heavy weight as specified.
 3. Hinge Weight and Base Material: Unless otherwise indicated, provide the following:
 - a. Exterior Doors: Heavy weight, non-ferrous, ball bearing or oil impregnated bearing hinges unless Hardware Sets indicate standard weight.

- b. Interior Doors: Standard weight, steel, ball bearing or oil impregnated bearing hinges unless Hardware Sets indicate heavy weight.
 - 4. Hinge Options: Comply with the following where indicated in the Hardware Sets or on Drawings:
 - a. Non-removable Pins: Provide set screw in hinge barrel that, when tightened into a groove in hinge pin, prevents removal of pin while door is closed; for the following applications:
 - 1) Out-swinging exterior doors.
 - 2) Out-swinging access controlled doors.
 - 3) Out-swinging lockable doors.
 - 5. Acceptable Manufacturers:
 - a. Hager Companies (HA).
 - b. McKinney Products (MK).
- B. Continuous Geared Hinges: ANSI/BHMA A156.26 certified continuous geared hinge with minimum 0.120-inch thick extruded 6060 T6 aluminum alloy hinge leaves and a minimum overall width of 4 inches. Hinges are non-handed, reversible and fabricated to template screw locations. Provide concealed flush mount (with or without inset), full surface, or half surface, in standard and heavy duty models, as specified in the Hardware Sets. Concealed continuous hinges to be U.L. listed for use on up to and including 90 minute rated door installations and U.L. listed for windstorm components where applicable. Factory cut hinges for door size and provide with removable service power transfer panel where indicated at electrified openings.
- 1. Acceptable Manufacturers:
 - a. McKinney Products (MK).
 - b. Pemko Manufacturing (PE).

2.3 POWER TRANSFER DEVICES

- A. Electrified Quick Connect Transfer Hinges: Provide electrified transfer hinges with Molex™ standardized plug connectors and sufficient number of concealed wires (up to 12) to accommodate the electrified functions specified in the Door Hardware Sets. Connectors plug directly to through-door wiring harnesses for connection to electric locking devices and power supplies. Wire nut connections are not acceptable.
 - 1. Acceptable Manufacturers:
 - a. Hager Companies (HA) - ETW-QC (# wires) Option.
 - b. McKinney Products (MK) - QC (# wires) Option.
- B. Electrified Quick Connect Continuous Geared Transfer Hinges: Provide electrified transfer continuous geared hinges with a 12" removable service panel cutout accessible without de-

mounting door from the frame. Furnish with Molex™ standardized plug connectors with sufficient number of concealed wires (up to 12) to accommodate the electrified functions specified in the Door Hardware Sets. Connectors plug directly to through-door wiring harnesses for connection to electric locking devices and power supplies. Wire nut connections are not acceptable.

1. Acceptable Manufacturers:
 - a. McKinney Products (MK) - SER-QC (# wires) Option.
 - b. Pemko Manufacturing (PE) - SER-QC (# wires) Option.

- C. Electric Door Hardware Cords: Provide electric transfer wiring harnesses with standardized plug connectors to accommodate up to twelve (12) wires. Connectors plug directly to through-door wiring harnesses for connection to electric locking devices and power supplies. Provide sufficient number of concealed wires to accommodate electric function of specified hardware. Provide a connector for through-door electronic locking devices and from hinge to junction box above the opening. Wire nut connections are not acceptable. Determine the length required for each electrified hardware component for the door type, size and construction, minimum of two per electrified opening.

1. Acceptable Manufacturers:
 - a. McKinney Products (MK) – QC-C Series.

Provide one each of the following tools as part of the base bid contract:

- a. McKinney Products (MK) - Electrical Connecting Kit: QC-R001.
- b. McKinney Products (MK) - Connector Hand Tool: QC-R003.

2.4 CYLINDERS AND KEYING

- A. General: Cylinder manufacturer to have minimum (10) years experience designing secured master key systems and have on record a published security keying system policy.
- B. Source Limitations: Obtain each type of keyed cylinder and keys from the same source manufacturer as locksets and exit devices, unless otherwise indicated.
- C. Cylinders: Original manufacturer cylinders complying with the following:
 1. Mortise Type: Threaded cylinders with rings and straight- or clover-type cam.
 2. Rim Type: Cylinders with back plate, flat-type vertical or horizontal tailpiece, and raised trim ring.
 3. Bored-Lock Type: Cylinders with tailpieces to suit locks.
 4. Mortise and rim cylinder collars to be solid and recessed to allow the cylinder face to be flush and be free spinning with matching finishes.
 5. Keyway: Match Facility Standard.

- D. Security Cylinders: ANSI/BHMA A156.5, Grade 1, patented security cylinders and keys able to be used together under the same facility master or grandmaster key system. Cylinders are to be factory keyed.
 - 1. Acceptable Manufacturers:
 - a. Sargent Manufacturing (SA) - Signature Series.
 - b. No Substitution – Facility Standard.
- E. Keying System: Each type of lock and cylinders to be factory keyed. Conduct specified "Keying Conference" to define and document keying system instructions and requirements. Furnish factory cut, nickel-silver large bow permanently inscribed with a visual key control number as directed by Owner. Incorporate decisions made in keying conference, and as follows:
 - 1. Existing System: Master key or grand master key locks to Owner's existing system.
- F. Key Quantity: Provide the following minimum number of keys:
 - 1. Per Owner's requirements.
- G. Construction Keying: Provide construction master keyed cylinders or temporary keyed construction cores where specified. Provide construction master keys in quantity as required by project Contractor. Replace construction cores with permanent cores. Furnish permanent cores for installation as directed under specified "Keying Conference".
- H. Key Control Software: Provide one network version of "Key Wizard" branded key management software package that includes one year of technical support and upgrades to software at no charge. Provide factory key system formatted for importing into "Key Wizard" software.

2.5 MECHANICAL LOCKS AND LATCHING DEVICES

- A. Mortise Locksets, Grade 1 (Heavy Duty): ANSI/BHMA A156.13, Series 1000, Operational Grade 1 certified mortise locksets furnished in the functions as specified in the Hardware Sets. Locksets to be manufactured with a corrosion resistant, stamped 12 gauge minimum formed steel case and be field-reversible for handing without disassembly of the lock body. Lockset trim (including knobs, levers, escutcheons, roses) to be the product of a single manufacturer. Furnish with standard 2 3/4" backset, 3/4" throw anti-friction stainless steel latchbolt, and a full 1" throw stainless steel bolt for deadbolt functions.
 - 1. Acceptable Manufacturers:
 - a. Sargent Manufacturing (SA) – 8200 Series.
 - b. No Substitution – Facility Standard.
- B. Lock Trim Design: As specified in Hardware Sets.

2.6 ELECTROMECHANICAL LOCKING DEVICES

- A. Electromechanical Mortise Locksets, Grade 1 (Heavy Duty): Subject to same compliance standards and requirements as mechanical mortise locksets, electrified locksets to be of type and design as specified below.
1. Electrified Lock Options: Where indicated in the Hardware Sets, provide electrified options including: outside door lock/unlock trim control, latchbolt and lock/unlock status monitoring, and request-to-exit signaling. Unless otherwise indicated, provide electrified locksets standard as fail secure.
 2. Energy Efficient Design: Provide lock bodies which have a holding current draw of 15mA maximum, and can operate on either 12 or 24 volts. Locks are to be field configurable for fail safe or fail secure operation.
 3. Acceptable Manufacturers:
 - a. Sargent Manufacturing (SA) - 8200 Series.
 - b. No Substitution – Facility Standard.

2.7 LOCK AND LATCH STRIKES

- A. Strikes: Provide manufacturer's standard strike with strike box for each latch or lock bolt, with curved lip extended to protect frame, finished to match door hardware set, unless otherwise indicated, and as follows:
1. Flat-Lip Strikes: For locks with three-piece antifriction latchbolts, as recommended by manufacturer.
 2. Extra-Long-Lip Strikes: For locks used on frames with applied wood casing trim.
 3. Aluminum-Frame Strike Box: Provide manufacturer's special strike box fabricated for aluminum framing.
- B. Standards: Comply with the following:
1. Strikes for Mortise Locks and Latches: BHMA A156.13.
 2. Strikes for Bored Locks and Latches: BHMA A156.2.
 3. Strikes for Auxiliary Deadlocks: BHMA A156.5.
 4. Dustproof Strikes: BHMA A156.16.

2.8 DOOR CLOSERS

- A. All door closers specified herein shall meet or exceed the following criteria:
1. General: Door closers to be from one manufacturer, matching in design and style, with the same type door preparations and templates regardless of application or spring size. Closers to be non-handed with full sized covers including installation and adjusting information on inside of cover.

2. Standards: Closers to comply with UL-10C and UBC 7-2 for Positive Pressure Fire Test and be U.L. listed for use of fire rated doors.
 3. Cycle Testing: Provide closers which have surpassed 15 million cycles in a test witnessed and verified by UL.
 4. Size of Units: Comply with manufacturer's written recommendations for sizing of door closers depending on size of door, exposure to weather, and anticipated frequency of use. Where closers are indicated for doors required to be accessible to the physically handicapped, provide units complying with ANSI ICC/A117.1.
 5. Closer Arms: Provide heavy duty, forged steel closer arms unless otherwise indicated in Hardware Sets.
 - a. Where closers are indicated to have mechanical dead-stop, provide heavy duty arms and brackets with an integral positive stop.
 - b. Where closers are indicated to have mechanical hold open, provide heavy duty units with an additional built-in mechanical holder assembly designed to hold open against normal wind and traffic conditions. Holder to be manually selectable to on-off position.
 - c. Where closers are indicated to have a cushion-type stop, provide heavy duty arms and brackets with spring stop mechanism to cushion door when opened to maximum degree.
 - d. Closers shall not be installed on exterior or corridor side of doors; where possible install closers on door for optimum aesthetics. Provide drop plates or other accessories as required for proper mounting.
 6. Closer Accessories: Provide door closer accessories including custom templates, special mounting brackets, spacers and drop plates, and through-bolt or security type fasteners as specified in the door Hardware Sets.
- B. Door Closers, Surface Mounted (Heavy Duty): ANSI/BHMA A156.4, Grade 1 surface mounted, heavy duty door closers with complete spring power adjustment, sizes 1 thru 6; and fully operational adjustable according to door size, frequency of use, and opening force. Closers to be rack and pinion type, one piece cast iron or aluminum alloy body construction, with adjustable backcheck and separate non-critical valves for closing sweep and latch speed control. Provide non-handed units standard.
1. Acceptable Manufacturers:
 - a. Corbin Russwin Hardware (RU) - DC8000 Series.
 - b. Sargent Manufacturing (SA) - 351 Series.
 - c. Norton Door Controls (NO) - 7500 Series.

2.9 DOOR STOPS AND HOLDERS

- A. General: Door stops and holders to be of type and design as specified below or in the Hardware Sets.

- B. Door Stops and Bumpers: ANSI/BHMA A156.16, Grade 1 certified door stops and wall bumpers. Provide wall bumpers, either convex or concave types with anchorage as indicated, unless floor or other types of door stops are specified in Hardware Sets. Do not mount floor stops where they will impede traffic. Where floor or wall bumpers are not appropriate, provide overhead type stops and holders.
 - 1. Acceptable Manufacturers:
 - a. Burns Manufacturing (BU).
 - b. Rockwood Manufacturing (RO).
 - c. Trimco (TC).

2.10 ARCHITECTURAL SEALS

- A. General: Thresholds, weatherstripping, and gasket seals to be of type and design as specified below or in the Hardware Sets. Provide continuous weatherstrip gasketing on exterior doors and provide smoke, light, or sound gasketing on interior doors where indicated. At exterior applications provide non-corrosive fasteners and elsewhere where indicated.
- B. Smoke Labeled Gasketing: Assemblies complying with NFPA 105 that are listed and labeled by a testing and inspecting agency acceptable to authorities having jurisdiction, for smoke control ratings indicated, based on testing according to UL 1784.
 - 1. Provide smoke labeled perimeter gasketing at all smoke labeled openings.
- C. Fire Labeled Gasketing: Assemblies complying with NFPA 80 that are listed and labeled by a testing and inspecting agency acceptable to authorities having jurisdiction, for fire ratings indicated, based on testing according to UL-10C.
 - 1. Provide intumescent seals as indicated to meet UL10C Standard for Positive Pressure Fire Tests of Door Assemblies, and UBC 7-2, Fire Tests of Door Assemblies.
- D. Sound-Rated Gasketing: Assemblies that are listed and labeled by a testing and inspecting agency, for sound ratings indicated, based on testing according to ASTM E 1408.
- E. Replaceable Seal Strips: Provide only those units where resilient or flexible seal strips are easily replaceable and readily available from stocks maintained by manufacturer.
- F. Acceptable Manufacturers:
 - 1. Pemko Manufacturing (PE).
 - 2. Reese Enterprises, Inc. (RS).
 - 3. Zero International (ZE).

2.11 ELECTRONIC ACCESSORIES

- A. Push-Button Switches: Industrial grade momentary or alternate contact, back-lighted push buttons with stainless-steel switch enclosures. 12/24 VDC bi-color illumination suitable for either flush or surface mounting.
 - 1. Acceptable Manufacturers:
 - a. Securitron (SU) - PB Series.
- B. Door Position Switches: Door position magnetic reed contact switches specifically designed for use in commercial door applications. On recessed models the contact and magnetic housing snap-lock into a 1" diameter hole. Surface mounted models include wide gap distance design complete with armored flex cabling. Provide SPDT, N/O switches with optional Rare Earth Magnet installation on steel doors with flush top channels.
 - 1. Acceptable Manufacturers:
 - a. Securitron (SU) - DPS Series.
- C. Power Supplies: Provide Nationally Recognized Testing Laboratory Listed 12VDC or 24VDC (field selectable) filtered and regulated power supplies. Include battery backup option with integral battery charging capability in addition to operating the DC load in event of line voltage failure. Provide the least number of units, at the appropriate amperage level, sufficient to exceed the required total draw for the specified electrified hardware and access control equipment.
 - 1. Acceptable Manufacturers:
 - a. Securitron (SU) - BPS Series.

2.12 FABRICATION

- A. Fasteners: Provide door hardware manufactured to comply with published templates generally prepared for machine, wood, and sheet metal screws. Provide screws according to manufacturers recognized installation standards for application intended.

2.13 FINISHES

- A. Standard: Designations used in the Hardware Sets and elsewhere indicate hardware finishes complying with ANSI/BHMA A156.18, including coordination with traditional U.S. finishes indicated by certain manufacturers for their products.
- B. Provide quality of finish, including thickness of plating or coating (if any), composition, hardness, and other qualities complying with manufacturer's standards, but in no case less than specified by referenced standards for the applicable units of hardware.

- C. Protect mechanical finishes on exposed surfaces from damage by applying a strippable, temporary protective covering before shipping.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine scheduled openings, with Installer present, for compliance with requirements for installation tolerances, labeled fire door assembly construction, wall and floor construction, and other conditions affecting performance.
- B. Notify architect of any discrepancies or conflicts between the door schedule, door types, drawings and scheduled hardware. Proceed only after such discrepancies or conflicts have been resolved in writing.

3.2 PREPARATION

- A. Hollow Metal Doors and Frames: Comply with ANSI/DHI A115 series.
- B. Wood Doors: Comply with ANSI/DHI A115-W series.

3.3 INSTALLATION

- A. Install each item of mechanical and electromechanical hardware and access control equipment to comply with manufacturer's written instructions and according to specifications.
 - 1. Installers are to be trained and certified by the manufacturer on the proper installation and adjustment of fire, life safety, and security products including: hanging devices; locking devices; closing devices; and seals.
- B. Mounting Heights: Mount door hardware units at heights indicated in following applicable publications, unless specifically indicated or required to comply with governing regulations:
 - 1. Standard Steel Doors and Frames: DHI's "Recommended Locations for Architectural Hardware for Standard Steel Doors and Frames."
 - 2. Wood Doors: DHI WDHS.3, "Recommended Locations for Architectural Hardware for Wood Flush Doors."
 - 3. Where indicated to comply with accessibility requirements, comply with ANSI A117.1 "Accessibility Guidelines for Buildings and Facilities."
 - 4. Provide blocking in drywall partitions where wall stops or other wall mounted hardware is located.
- C. Retrofitting: Install door hardware to comply with manufacturer's published templates and written instructions. Where cutting and fitting are required to install door hardware onto or into surfaces that are later to be painted or finished in another way, coordinate removal, storage, and reinstallation of surface protective trim units with finishing work specified in Division 9

Sections. Do not install surface-mounted items until finishes have been completed on substrates involved.

- D. Thresholds: Set thresholds for exterior and acoustical doors in full bed of sealant complying with requirements specified in Division 7 Section "Joint Sealants."
- E. Storage: Provide a secure lock up for hardware delivered to the project but not yet installed. Control the handling and installation of hardware items so that the completion of the work will not be delayed by hardware losses before and after installation.

3.4 FIELD QUALITY CONTROL

- A. Field Inspection: Supplier will perform a final inspection of installed door hardware and state in report whether work complies with or deviates from requirements, including whether door hardware is properly installed, operating and adjusted.

3.5 ADJUSTING

- A. Initial Adjustment: Adjust and check each operating item of door hardware and each door to ensure proper operation or function of every unit. Replace units that cannot be adjusted to operate as intended. Adjust door control devices to compensate for final operation of heating and ventilating equipment and to comply with referenced accessibility requirements.

3.6 CLEANING AND PROTECTION

- A. Protect all hardware stored on construction site in a covered and dry place. Protect exposed hardware installed on doors during the construction phase. Install any and all hardware at the latest possible time frame.
- B. Clean adjacent surfaces soiled by door hardware installation.
- C. Clean operating items as necessary to restore proper finish. Provide final protection and maintain conditions that ensure door hardware is without damage or deterioration at time of owner occupancy.

3.7 DEMONSTRATION

- A. Instruct Owner's maintenance personnel to adjust, operate, and maintain mechanical and electromechanical door hardware.

3.8 DOOR HARDWARE SCHEDULE

- A. The hardware sets represent the design intent and direction of the owner and architect. They are a guideline only and should not be considered a detailed hardware schedule. Discrepancies, conflicting hardware and missing items should be brought to the attention of the architect with

corrections made prior to the bidding process. Omitted items not included in a hardware set should be scheduled with the appropriate additional hardware required for proper application and functionality.

B. Manufacturer's Abbreviations:

1. MK - McKinney
2. SA - Sargent
3. NO - Norton
4. RO - Rockwood
5. PE - Pemko
6. SU - Securitron

Hardware Schedule

Set: 1.0

Doors: S98A-1

1 Continuous Hinge	MCK-12HD QC-12 X LAR	CL	MK
1 Fail Secure Electric Lock	10 RX SG 8271-24V LNL RA	US26D	SA
1 Door Closer	CLP7500	689	NO
1 Threshold	271A x LAR MSES25SS		PE
1 Sweep	18100CNB X LAR		PE
1 eLynx Frame Harness	QC-C1500P		MK
1 eLynx Door Harness	QC-C*** (Length / Type as Required)		MK
1 Card Reader	Provided by others	BLK	HD
1 Position Switch	DPS-M-BK		SU
1 Push Button	PB3N		SU
1 Power Supply	BPS (size & type as required)		SU

Notes:

Gasketing provided by aluminum door/frame supplier. Furnish all accessories required for a complete and proper installation of hardware components.

Electronic Operation: Free egress at all times. Valid credential at card reader (provided by others) or push button located at reception desk unlocks outside lever allowing entry. Integrated request to exit switch signals an authorized egress. Door position switch monitors door status. Fail Secure

Set: 2.0

Doors: S98A

1 Continuous Hinge	MCK-12HD x LAR	CL	MK
1 Classroom Security Lock	10 SG 8238 LNL RA	US26D	SA
1 Door Closer	CLP7500	689	NO

Notes:

Gasketing provided by aluminum door/frame supplier. Furnish all accessories required for a complete and proper installation of hardware components.

Set: 3.0

Doors: S98A-3

2 Hinge (heavy weight)	T4A3786	US26D	MK
1 Electric Hinge (heavy weight)	T4A3786-QC12	US26D	MK
1 Fail Secure Electric Lock	10 RX SG 8271-24V LNL RA	US26D	SA
1 Door Closer	7500	689	NO
1 Wall Stop	403 (or) 441CU	US26D	RO
3 Silencer	608		RO
1 eLynx Frame Harness	QC-C1500P		MK
1 eLynx Door Harness	QC-C*** (Length / Type as Required)		MK
1 Card Reader	Provided by others	BLK	HD
1 Position Switch	DPS-M-BK		SU
1 Push Button	PB3N		SU
1 Power Supply	BPS (size & type as required)		SU

Notes:

Electronic Operation: Free egress at all times. Valid credential at card reader (provided by others) or push button located at reception desk unlocks outside lever allowing entry. Integrated request to exit switch signals an authorized egress. Door position switch monitors door status. Fail Secure

Set: 4.0

Doors: S98H

3 Hinge	TA2714	US26D	MK
1 Passage Set	SG 8215 LNL	US26D	SA
1 Wall Stop	403 (or) 441CU	US26D	RO
3 Silencer	608		RO

Set: 5.0

Doors: S98A-2


3 Hinge	TA2714	US26D	MK
1 Classroom Security Lock	10 SG 8238 LNL RA	US26D	SA
1 Wall Stop	403 (or) 441CU	US26D	RO
3 Silencer	608		RO

END OF SECTION 087100

PROJECT SCHEDULE

WPHS Security Entry

February 11, 2015

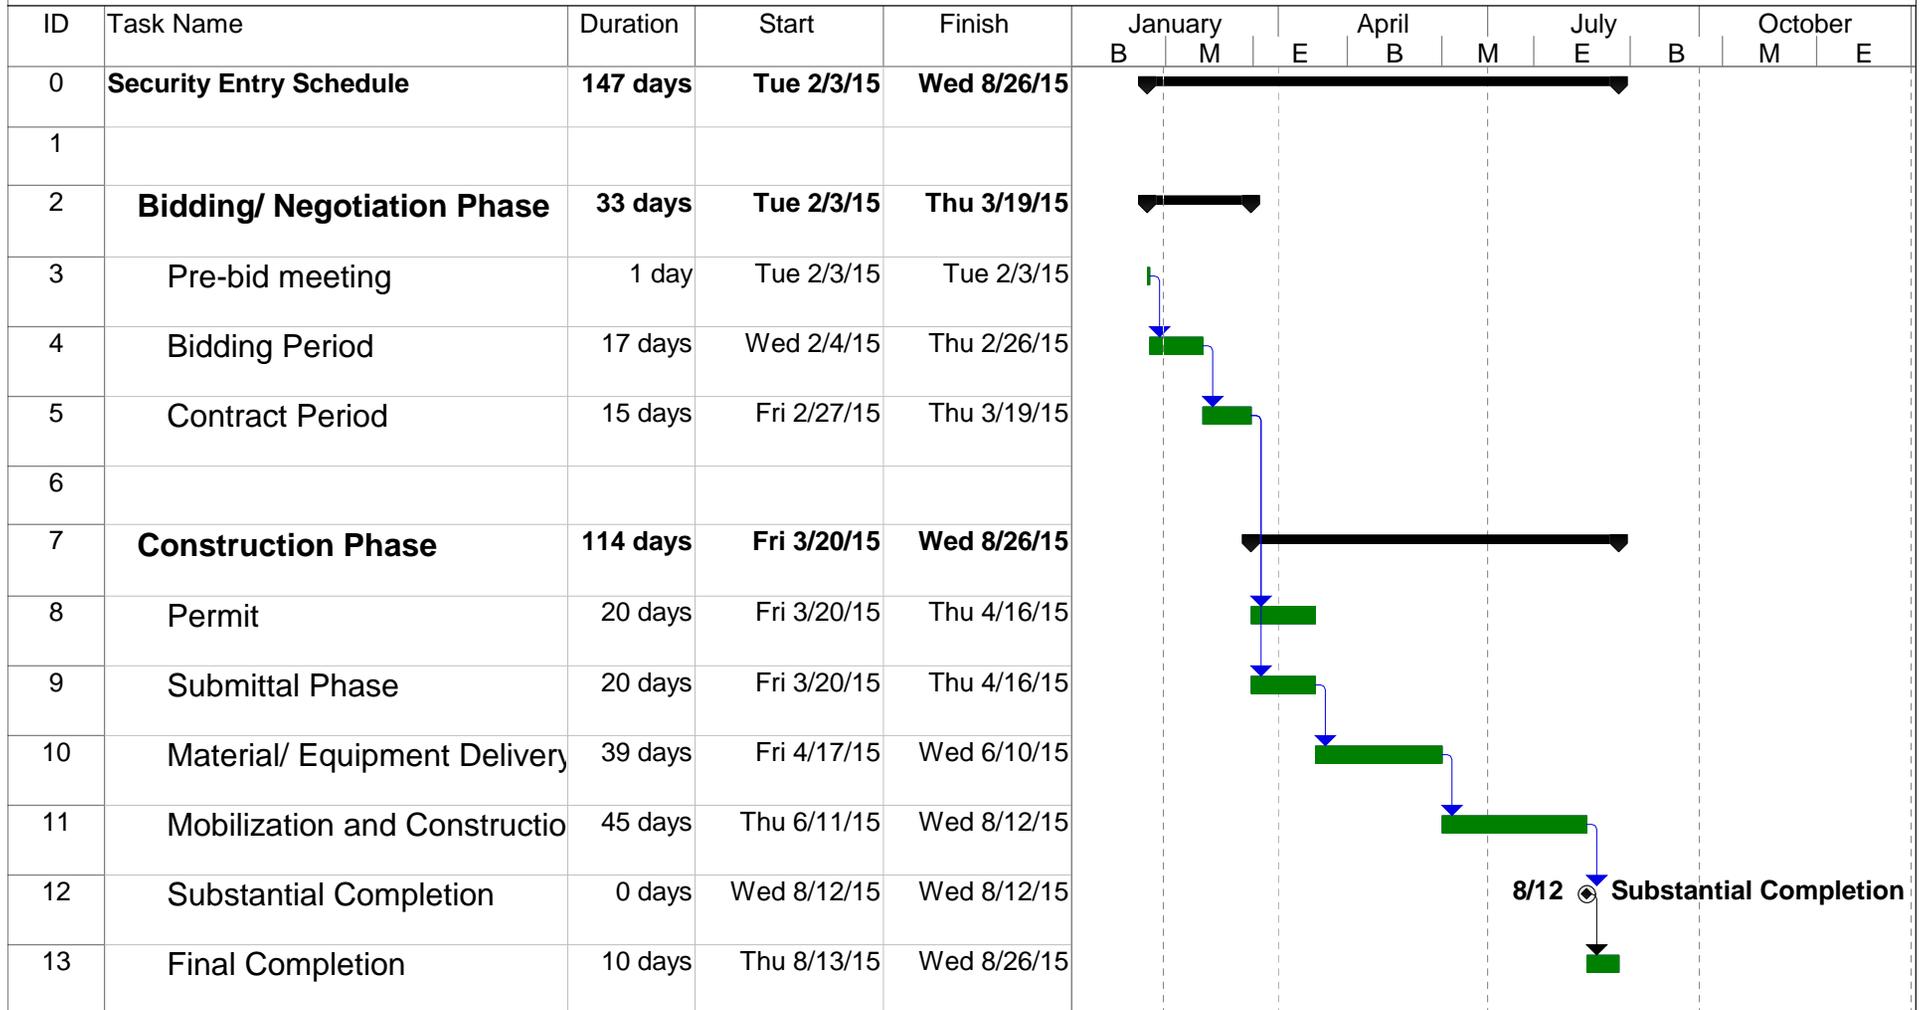

Summary		Inactive Task		Manual Summary Rollup	
Milestone		Inactive Milestone		Manual Summary	
Tetra Tech		Inactive Summary		Start-only	
DFM/ OMB		Manual Task		Finish-only	
Construction		Duration-only			