

GENERAL SHEET NOTES

- A. SEE SHEET S101 FOR STRUCTURAL NOTES RELATED TO FOUNDATIONS, CONCRETE, & STEEL.
- B. ALL EXPOSED STEEL FABRICATIONS ARE TO BE ARCHITECTURAL EXPOSED STRUCTURAL STEEL (AESS). SEE S101 FOR AESS REQUIREMENTS.
- C. PAINT ALL EXPOSED STEEL.
- D. ALL EXPOSED STAINLESS STEEL FABRICATIONS TO BE 0.125" THICK (MIN.), 316 ALLOY W/ FIN. 8 FINISH (U.O.M.). ALL STAINLESS STEEL EXPOSED SQUARE TUBE SHALL ADHERE TO ASTM A554.
- E. ALL SLOPED OVERHEAD GLAZING TO BE TYPE G1-1/2" CLEAR LAMINATED & TEMPERED W/ ACID ETCHING ON BOTTOM LITE. (U.O.M.)
- F. CONDUITS FOR SHELTER TO BE LOCATED AT COLUMN 2A (U.O.M.). ALL ELECTRICAL CONDUITS AND JUNCTION BOXES TO BE CONCEALED AND COORDINATED BY CONTRACTOR. PROVIDE WIRE RULL HOLES W/ COVER FOR ALL POWER, DATA, & SECURITY CONDUITS.

STRUCTURAL KEYNOTES

- S1. GALVANIZED STEEL 4x12 HSS.
- S2. GALVANIZED STEEL 4x12 HSS ROOF BEAM (PAINTED, CUSTOM COLOR).
- S3. GALVANIZED STEEL 4x8 HSS HIP RAFTERS (PAINTED, CUSTOM COLOR).
- S4. GALVANIZED STEEL 3x6 HSS COMMON RAFTERS (PAINTED, CUSTOM COLOR).
- S5. 4x4 HSS GALVANIZED COLUMN (PAINTED WHERE EXPOSED).
- S6. 2x2 HSS (STAINLESS STEEL, 316, SMOOTH FINISH).
- S7. 3x3 HSS (STAINLESS STEEL, 316, SMOOTH FINISH).
- S8. FOOTING AND FOUNDATIONS BY SITE CONTRACTOR.
- S9. NEW SIDEWALK BY SITE CONTRACTOR.

KEYNOTE SCHEDULE

- 1. GLAZING TYPE G2-1/2" CLEAR TEMPERED GLASS WITH DART ACID ETCH LOGO.
- 2. 1 1/2" Ø STAINLESS STEEL HANDRAIL. SEE DETAIL 7A104.
- 3. 8" Ø STAINLESS STEEL TWO-PIECE SURROUND.
- 4. CAST STONE TWO-PIECE SURROUND.
- 5. STAINLESS STEEL COLUMN CAP.
- 6. STAINLESS STEEL GLASS CLAMPS W/ TAMPER RESISTANT FASTENERS.
- 7. STAINLESS STEEL 2x48" LED LIGHT FIXTURE. BASIS OF DESIGN: ENVIROSEAL ES3 SERIES, KENALL MODEL ES3-48-2-2020-002-1-1P-PR-KO-TR PAINT: CUSTOM COLOR BY ARCHITECT.
- 8. BRD WIRE RIDGE BRACKET & NYLON COATED STAINLESS STEEL WIRE.
- 9. DIGITAL INFORMATION BOARD, DOUBLE SIDED, PROVIDED BY DART. INSTALLATION BY CONTRACTOR.
- 10. FIXED BUS SCHEDULE DISPLAY. BASIS OF DESIGN: METAL CO BACK (SEE 8A102 FOR DETAIL).
- 11. SNOW GUARD SYSTEM. OPT. 1: SNOW RAIL/FENCE SYSTEM W/ BRACKETS ATTACHED TO SLOPED GLAZING SYSTEM. OPT. 2: CLEAR POLYCARBONATE SNOW GUARDS ATTACHED WITH ADHESIVE, 2 ROWS AT 24" O.C. STAGGARD.
- 12. 3/16" x 7/8" FLUSH MOUNTED STAINLESS STEEL LETTERS (S15 ALLOY), 118S NEW ROMAN FONT, BRUSHED FINISH. PROVIDE SHOP DRAWINGS FOR EACH SHELTER.
- 13. ACM PANEL JOINT. ALIGN JOINTS WITH STRUCTURAL GRID.
- 14. PROVIDE EXPANSION JOINT BETWEEN CAST STONE BASE AND SIDEWALK. PROVIDE OPEN CELL WEEP VENT AT CAST STONE BASE.
- 15. ALUMINUM COMPOSITE PANELS (ACM), W/ ACM REVEAL STRIP AT JOINTS. CORNER PANELS TO BE PREFABRICATED & CONTINUOUSLY BEAMED. CUSTOM COLOR BY ARCHITECT.
- 16. NOT USED.
- 17. NOT USED.
- 18. PACK JOINT WITH GROUT. APPLY BACKER ROD & WATERPROOF SEALANT OVER FULL LENGTH OF JOINT.
- 19. STAINLESS STEEL BENCH. BASIS OF DESIGN: LANDSCAPE FORMAS, INC., PLEXUS STRAIGHT TWO UNIT GROUP W/ BACKS & OPT. ARM REST.
- 20. PROVIDE EXPANSION JOINT BETWEEN COLUMN AND SIDEWALK W/ TRAFFIC RATED SEALANT.
- 21. 1 1/2" Ø STAINLESS STEEL GUARDRAIL. SEE DETAIL 8A104.

Attachment

GENERAL SHEET NOTES


- A. SEE SHEET S101 FOR STRUCTURAL NOTES RELATED TO FOUNDATIONS, CONCRETE, & STEEL.
- B. ALL EXPOSED STEEL FABRICATIONS ARE TO BE ARCHITECTURAL EXPOSED STRUCTURAL STEEL (AESS). SEE S101 FOR AESS REQUIREMENTS.
- B. PAINT ALL EXPOSED STEEL.
- D. ALL EXPOSED STAINLESS STEEL FABRICATIONS TO BE 0.125" THICK (MIL) 316 ALLOY W/MS. IF FINISH (L10N). ALL STAINLESS STEEL EXPOSED SQUARE TUBE SHALL ADHERE TO ASTM A313.
- F. ALL SLOPED OVERHEAD GLAZING TO BE TYPE G1 - 1/2" CLEAR LAMINATED & TEMPERED W/ ACID ETCHING ON BOTTOM LITE (U.O.N).
- H. CONDUITS FOR SHELTER TO BE LOCATED AT COLUMN 2A (U.O.N). ALL ELECTRICAL CONDUITS AND JUNCTION BOXES TO BE CONCEALED AND COORDINATED BY CONTRACTOR. PROVIDE WIRE FULL HOLES W/ COVER FOR ALL POWER, DATA, & SECURITY CONDUITS.

STRUCTURAL KEYNOTES


- S1. GALVANIZED STEEL 4"x12" HSS.
- S2. GALVANIZED STEEL 4"x12" HSS RIDGE BEAM (PAINTED, CUSTOM COLOR).
- S3. GALVANIZED STEEL 4"x8" HSS HIP RAFTERS - (PAINTED, CUSTOM COLOR).
- S4. GALVANIZED STEEL 2"x6" HSS COMMON RAFTERS - (PAINTED, CUSTOM COLOR).
- S5. 4"x4" HSS GALVANIZED COLUMN (PAINTED WHERE EXPOSED).
- S6. 2"x2" HSS (STAINLESS STEEL, 316, SMOOTH FINISH).
- S7. 3"x3" HSS (STAINLESS STEEL, 316, SMOOTH FINISH).
- S8. FOOTING AND FOUNDATIONS BY SITE CONTRACTOR.
- S9. SIDEWALK BY SITE CONTRACTOR.

KEYNOTE SCHEDULE


- 1. GLAZING TYPE G2 - 1/2" CLEAR TEMPERED GLASS WITH DART ACID ETCH LOGO.
- 2. 1 1/2" Ø STAINLESS STEEL HANDRAIL. SEE DETAIL 7A104.
- 3. 8" Ø STAINLESS STEEL TWO-PIECE SURROUND.
- 4. CAST STONE TWO-PIECE SURROUND.
- 5. STAINLESS STEEL COLUMN CAP.
- 6. STAINLESS STEEL GLASS CLAMPS W/ TAMPER RESISTANT FASTENERS.
- 7. STAINLESS STEEL 3"x4" LED LIGHT FIXTURE. BASIS OF DESIGN: ENVIRONMENTAL EST SERIES, KENALL MODEL. ESH-48-126-SS-DC-1-FINISH-PART. PAINT: CUSTOM COLOR BY ARCHITECT.
- 8. BRD WIRE RIDGE BRACKET & NYLON COATED STAINLESS STEEL WIRE.
- 9. DIGITAL INFORMATION BOARD, DOUBLE SIDED, PROVIDED BY DART. INSTALLATION BY CONTRACTOR.
- 10. FIXED BUS SCHEDULE DISPLAY. BASIS OF DESIGN: METALCOBACH (SEE S8A102 FOR DETAIL).
- 11. SNOW GUARD SYSTEM. OPT. 1 SNOW RAIL/FENCE SYSTEM W/ BRACKETS ATTACHED TO SLOPED GLAZING SYSTEM. OPT. 2 CLEAR POLYCARBONATE SNOW GUARDS ATTACHED WITH ADHESIVE. 2 ROWS AT 24" O.C. STAGGARD.
- 12. 3/4" x 7/8" FLUSH MOUNTED STAINLESS STEEL LETTERS (316 ALLOY) - TIMES NEW ROMAN FONT, BRUSHED FINISH. PROVIDE SHOP DRAWINGS FOR EACH SHELTER.
- 13. ACM PANEL JOINT, ALIGN JOINTS WITH STRUCTURAL GRID.
- 14. PROVIDE EXPANSION JOINT BETWEEN CAST STONE BASE AND SIDEWALK. PROVIDE OPEN CELL WEEP VENT AT CAST STONE BASE.
- 15. ALUMINUM COMPOSITE PANELS (ACM) W/ ACM REVEAL STRIP AT JOINTS. CORNER PANELS TO BE PREFABRICATED & CONTINUOUSLY SEAMED. CUSTOM COLOR BY ARCHITECT.
- 16. NOT USED.
- 17. NOT USED.
- 18. PACK JOINT WITH GROUT, APPLY BACKER ROD & WATERPROOF SEALANT OVER FULL LENGTH OF JOINT.
- 19. STAINLESS STEEL BENCH. BASIS OF DESIGN: LANDSCAPE FORMS, INC., FLEXUS STRAIGHT TWO UNIT GROUP W/ BACKS & OPT. ARM REST.
- 20. PROVIDE EXPANSION JOINT BETWEEN COLUMN AND SIDEWALK W/ TRAFFIC RATED SEALANT.
- 21. 1 1/2" Ø STAINLESS STEEL GUARD RAIL. SEE DETAIL 8A104.

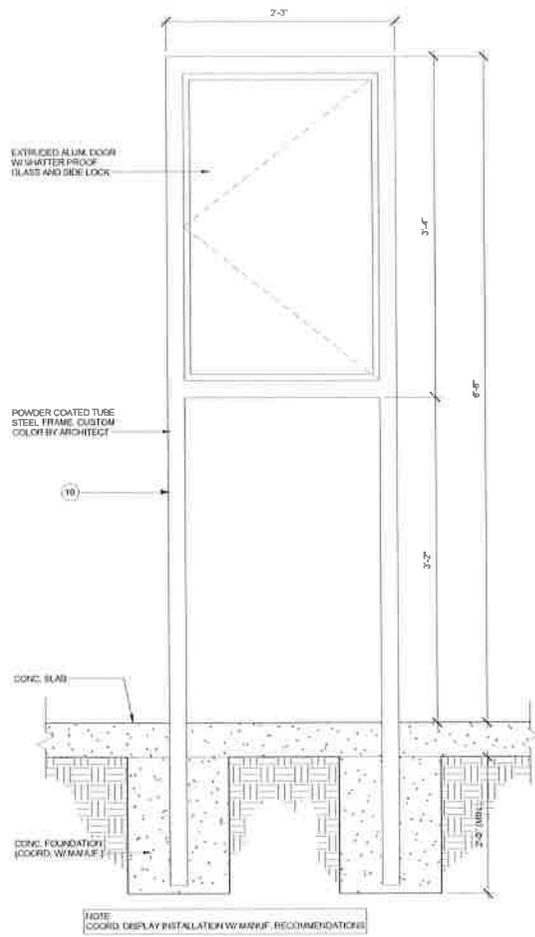


8 DETAIL - BUS SCHEDULE DISPLAY
Scale: 1 1/2" = 1'-0"

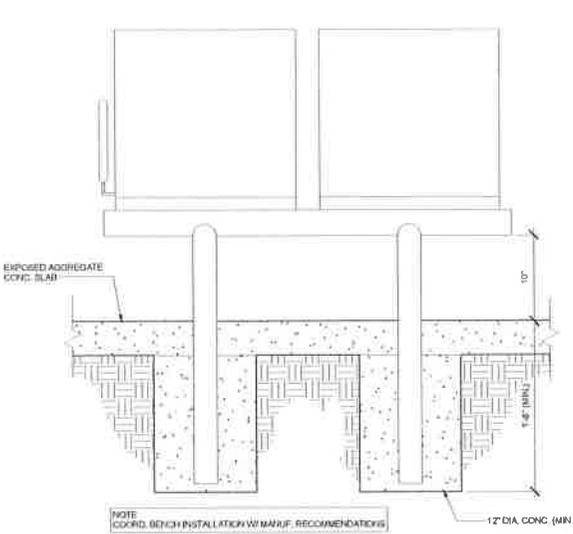


7 BASE DETAIL - BENCH
Scale: 1 1/2" = 1'-0"

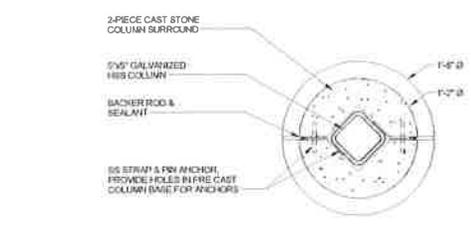


6 ENLARGED PLAN - PRECAST COLUMN
Scale: 1 1/2" = 1'-0"

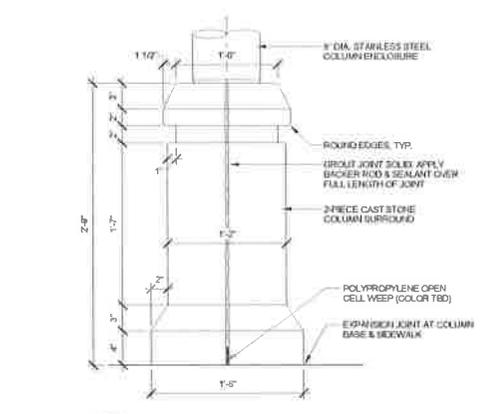


5 BASE DETAIL - PRECAST COLUMN
Scale: 1 1/2" = 1'-0"

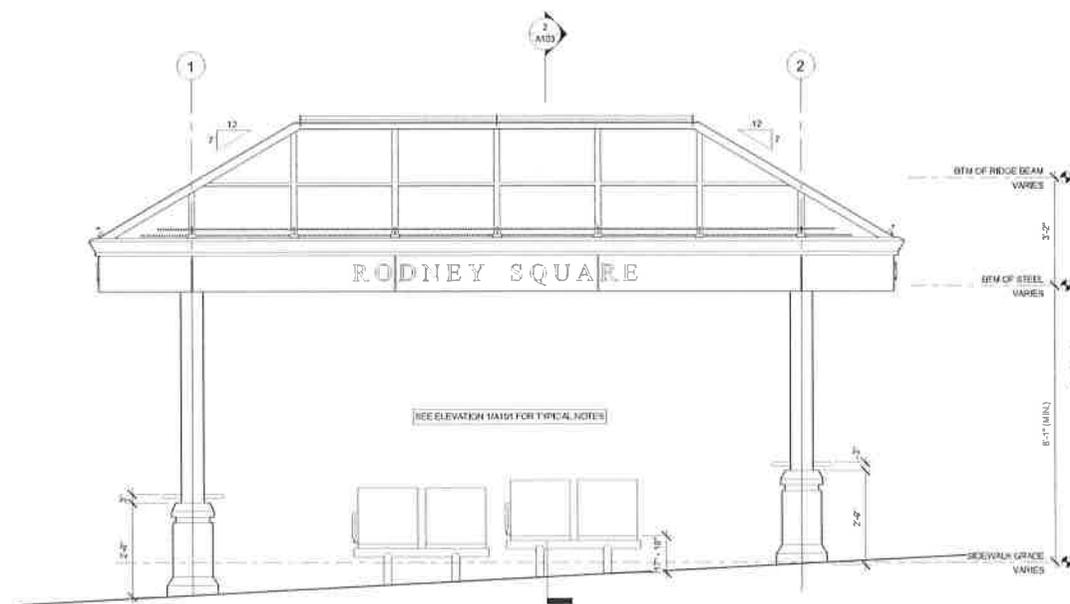

3 FRONT ELEVATION - TYP. AT 10TH & 11TH STREET
Scale: 1/2" = 1'-0"

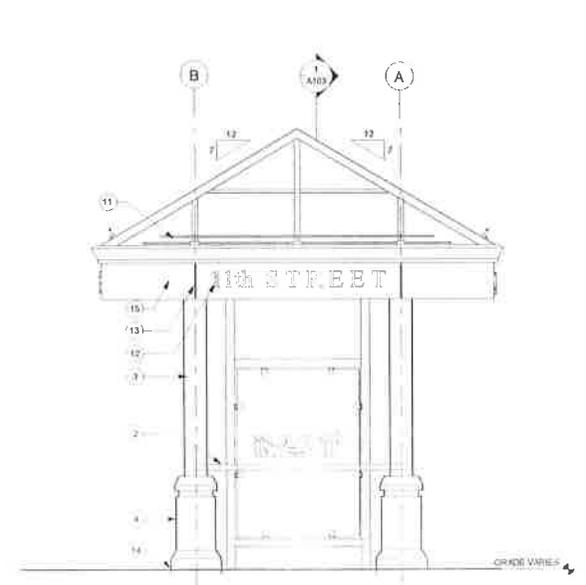

2 TYPICAL SIDE ELEVATION
Scale: 1/2" = 1'-0"

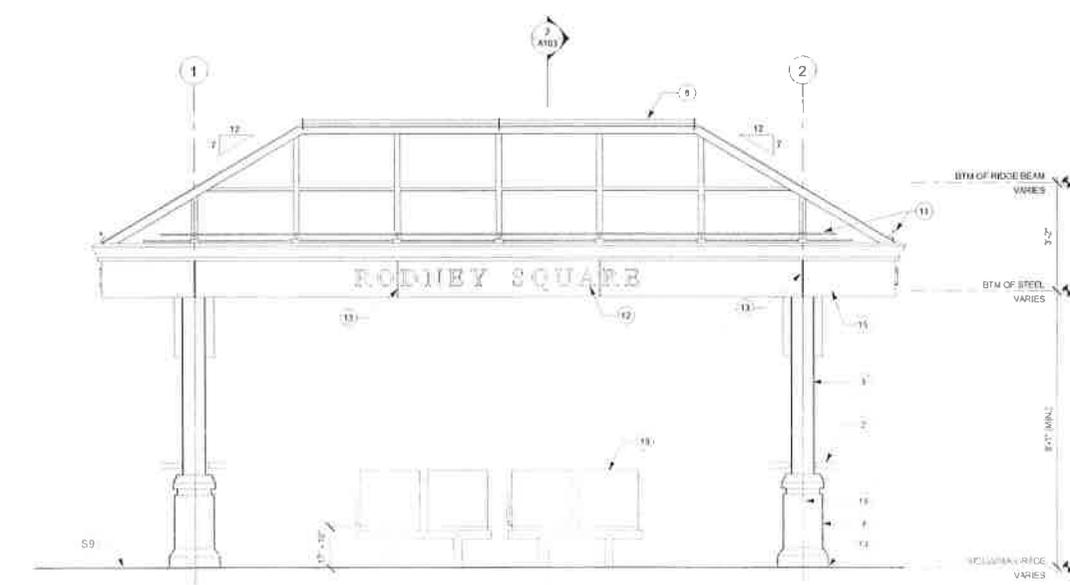

1 FRONT ELEVATION - TYP. AT KING STREET
Scale: 1/2" = 1'-0"