

**DELAWARE STATE UNIVERSITY
CONTRACT # PC-16-046**

**SPECIFICATIONS
FOR**

Student Health Center Air Handling Unit Replacement

IN

**East Dover Hundred - Kent County
Dover, Delaware**

**PREPARED
BY**

StudioJAED

**ISSUED FOR BID
12/22/2017**



TABLE OF CONTENTS

A. Specifications for this project are arranged in accordance with the Construction Specification Institute numbering system and format. Section numbering is discontinuous and all numbers not appearing in the Table of Contents are not used for this Project.

B. DOCUMENTS BOUND HERewith

DIVISION 00 – PROCUREMENT AND CONTRACT REQUIREMENTS

INTRODUCTORY INFORMATION

00 01 01 – PROJECT TITLE PAGE	1 page
00 01 10 – TABLE OF CONTENTS	2 pages
00 01 15 – LIST OF DRAWING SHEETS	1 page

PROCUREMENT REQUIREMENTS

00 11 16 – INVITATION TO BID	1 page
00 21 13 – INSTRUCTIONS TO BIDDERS	12 pages
00 41 13 – BID FORM	4 pages
00 43 13 – BID BOND	1 page
00 43 36 – PROPOSED SUBCONTRACTOR LIST	1 page
00 45 19 – NON-COLLUSION STATEMENT	1 page
00 46 00 – AFFIDAVIT OF EMPLOYEE DRUG TESTING PROGRAM	1 page

CONTRACTING REQUIREMENTS

00 52 13 – STANDARD FORM OF AGREEMENT BETWEEN OWNER AND CONTRACTOR	1 page
00 54 13 – SUPPLEMENT TO AGREEMENT BETWEEN OWNER & CONTRACTOR A101-2007	1 page
00 61 13.13 – PERFORMANCE BOND	2 pages
00 61 13.16 – PAYMENT BOND	2 pages
00 62 76 – SAMPLE APPLICATION AND CERTIFICATE FOR PAYMENT FORMS	1 page
00 72 13 – GENERAL CONDITIONS TO THE CONTRACT	1 page
00 72 14 – INDEMNIFICATION	1 page
00 73 13 – SUPPLEMENTARY GENERAL CONDITIONS	10 pages
00 73 46 – WAGE RATE REQUIREMENTS	1 page
00 81 13 – GENERAL REQUIREMENTS	13 pages
00 81 14 – EMPLOYEE DRUG TESTING REPORT FORMS	2 pages

END OF SECTION 00 01 10

LIST OF DRAWING SHEETS

COVER SHEET

GENERAL INFORMATION

G 1.0 PROJECT COVER SHEET

ARCHITECTURAL

A 3.1 ARCHITECTURAL SITE PLANS

MECHANICAL

M 8.0 MECHANICAL COVER SHEET & SCHEDULES

M 8.1 MECHANICAL DEMOLITION & RENOVATION PLANS

M 8.2 MECHANICAL CONTROLS SCHEMATIC

ELECTRICAL

E 9.0 ELECTRICAL COVER SHEET & SCHEDULES

E 9.1 ELECTRICAL PLANS

END OF SECTION 00 01 15

INVITATION TO BID

Sealed bids for Delaware State University Contract No. **PC-16-046 – Student Health Center Air Handling Unit Replacement** will be received by the Delaware State University, in the Office of Planning & Construction Room 101 in the Facilities Management Building, 1200 N. DuPont Highway, Dover, DE 19901-2277, until **3:00 pm** local time on **Wednesday, February 28, 2018**, at which time they will be publicly opened and read aloud in the Conference Room. Bidder bears the risk of late delivery. Any bids received after the stated time will be returned unopened.

Project involves

It is the intent of Delaware State University to select a qualified contractor to provide services related to the Air Handling Unit Replacement at the Student Health Center as defined in the bid documents.

A **MANDATORY** Pre-Bid Meeting will be held on **Tuesday, February 13, 2018**, at **10:00 am** at **The Facilities Management Building** for the purpose of establishing the listing of subcontractors and to answer questions. Representatives of each party to any Joint Venture must attend this meeting. **ATTENDANCE OF THIS MEETING IS A PREREQUISITE FOR BIDDING ON THIS CONTRACT.**

Sealed bids shall be addressed to the Delaware State University c/o the Office of Planning & Construction, Facilities Management Building, Room 101, Dover, DE 19901-2277, Attn: Zafar Chaudhry, Associate Vice President of Contract & Procurement. The outer envelope should clearly indicate: "**DSU CONTRACT NO. PC-16-046 – Student Health Center Air Handling Unit Replacement - SEALED BID - DO NOT OPEN.**"

Contract documents may be obtained or reviewed at the office of StudioJAED, 2500 Wrangle Hill Rd, Bear, DE 19701 upon receipt of \$500.00 per set/non-refundable, starting on the day of the mandatory pre-bid. Checks are to be made payable to StudioJAED. Alternatively, in consideration of our environment, and in alignment with the University's sustainability initiatives, bidders may request an electronic copy of the bidding documents by submitting a written request to constructionbid@desu.edu. Delaware State University will track all bidders and ensure plan holder receive all addenda.

Summary of Events and Dates:

2/13/2018	Mandatory Site Visit at the Facilities Management Building (10:00AM EST)
2/21/2018	Deadline for Questions (4:00PM EST)
2/26/2018	Posting of Answers to Contractor Questions (4:00PM EST)
2/26/2018	Final Date for Addendums
2/28/2018	Proposals Due (3:00 PM EST)
3/7/2018	Contractor Selection Date
3/17/2018	Anticipated Start of Construction Date (subject to change)
3/31/2018	Latest Date for Contract Award
5/30/18	Substantial Completion

Bidders will not be subject to discrimination on the basis of race, creed, color, sex, sexual orientation, gender identity or national origin in consideration of this award, and Minority Business Enterprises, Disadvantaged Business Enterprises, Women-Owned Business Enterprises and Veteran-Owned Business Enterprises will be afforded full opportunity to submit bids on this contract. Each bid must be accompanied by a bid security equivalent to ten percent of the bid amount and all additive alternates.

The successful bidder must post a performance bond and payment bond in a sum equal to 100 percent of the contract price upon execution of the contract. Delaware State University reserves the right to reject any or all bids and to waive any informalities therein. Delaware State University may extend the time and place for the opening of the bids from that described in the advertisement, with not less than two calendar days' notice by certified delivery, facsimile machine or other electronic means to those bidders receiving plans.

DRUG TESTING REQUIREMENTS FOR LARGE PUBLIC WORKS

Pursuant to 29 Del.C. §6908(a)(6), effective as of January 1, 2016, OMB has established regulations that require Contractors and Subcontractors to implement a program of mandatory drug testing for Employees who work on Large Public Works Contracts funded all or in part with public funds. The regulations establish the mechanism, standards and requirements of a Mandatory Drug Testing Program that will be incorporated by reference into all Large Public Works Contracts awarded pursuant to 29 Del.C. §6962. Final publication of the identified regulations can be found at the following: [4104 Regulations for the Drug Testing of Contractor and Subcontractor Employees Working on Large Public Works Projects](#)

END OF ADVERTISEMENT FOR BIDS

INSTRUCTIONS TO BIDDERS

TABLE OF ARTICLES

1. DEFINITIONS
2. BIDDER'S REPRESENTATION
3. BIDDING DOCUMENTS
4. BIDDING PROCEDURES
5. CONSIDERATION OF BIDS
6. POST-BID INFORMATION
7. PERFORMANCE BOND AND PAYMENT BOND
8. FORM OF AGREEMENT BETWEEN OWNER AND CONTRACTOR
9. LIQUIDATED DAMAGES

ARTICLE 1: GENERAL

1.1 DEFINITIONS

1.1.1 Whenever the following terms are used, their intent and meaning shall be interpreted as follows:

1.2 STATE: The State of Delaware.

1.3 BOARD: The Delaware State University Board of Trustees

1.4 UNIVERSITY: The Delaware State University

1.5 AGENCY: The Delaware State University

1.6 DESIGNATED OFFICIAL: The agent authorized to act for the Agency.

1.7 BIDDING DOCUMENTS: Bidding Documents include the Bidding Requirements and the proposed Contract Documents. The Bidding Requirements consist of the Advertisement for Bid, Invitation to Bid, Instructions to Bidders, Supplementary Instructions to Bidders (if any), General Conditions, Supplementary General Conditions, General Requirements, Special Provisions (if any), the Bid Form (including the Non-collusion Statement), and other sample bidding and contract forms. The proposed Contract Documents consist of the form of Agreement between the Owner and Contractor, as well as the Drawings, Specifications (Project Manual) and all Addenda issued prior to execution of the Contract.

1.8 CONTRACT DOCUMENTS: The Contract Documents consist of the, Instructions to Bidders, Supplementary Instructions to Bidders (if any), General Conditions, Supplementary General Conditions, General Requirements, Special Provisions (if any), the form of agreement between the Owner and the Contractor, Drawings (if any), Specifications (Project Manual), and all addenda.

1.9 AGREEMENT: The form of the Agreement shall be AIA Document A101, Standard Form of Agreement between Owner and Contractor where the basis of payment is a STIPULATED SUM. In the case of conflict between the instructions contained therein and the General Requirements herein, these General Requirements shall prevail.

1.10 GENERAL REQUIREMENTS (or CONDITIONS): General Requirements (or conditions) are instructions pertaining to the Bidding Documents and to contracts in general. They contain, in summary, requirements of laws of the State; policies of the Agency and instructions to bidders.

1.11 SPECIAL PROVISIONS: Special Provisions are specific conditions or requirements peculiar to the bidding documents and to the contract under consideration and are supplemental to the General Requirements. Should the Special Provisions conflict with the General Requirements, the Special Provisions shall prevail.

1.12 ADDENDA: Written or graphic instruments issued by the Owner/Architect prior to the execution of the contract which modify or interpret the Bidding Documents by additions, deletions, clarifications or corrections.

1.13 BIDDER OR VENDOR: A person or entity who formally submits a Bid for the material or Work contemplated, acting directly or through a duly authorized representative who meets the requirements set forth in the Bidding Documents.

1.14 SUB-BIDDER: A person or entity who submits a Bid to a Bidder for materials or labor, or both for a portion of the Work.

1.15 BID: A complete and properly executed proposal to do the Work for the sums stipulated therein, submitted in accordance with the Bidding Documents.

- 1.16 BASE BID: The sum stated in the Bid for which the Bidder offers to perform the Work described in the Bidding Documents as the base, to which Work may be added or from which Work may be deleted for sums stated in Alternate Bids (if any are required to be stated in the bid).
- 1.17 ALTERNATE BID (or ALTERNATE): An amount stated in the Bid, where applicable, to be added to or deducted from the amount of the Base Bid if the corresponding change in the Work, as described in the Bidding Documents is accepted.
- 1.18 UNIT PRICE: An amount stated in the Bid, where applicable, as a price per unit of measurement for materials, equipment or services or a portion of the Work as described in the Bidding Documents.
- 1.19 SURETY: The corporate body which is bound with and for the Contract, or which is liable, and which engages to be responsible for the Contractor's payments of all debts pertaining to and for his acceptable performance of the Work for which he has contracted.
- 1.20 BIDDER'S DEPOSIT: The security designated in the Bid to be furnished by the Bidder as a guaranty of good faith to enter into a contract with the Agency if the Work to be performed or the material or equipment to be furnished is awarded to him.
- 1.21 CONTRACT: The written agreement covering the furnishing and delivery of material or work to be performed.
- 1.22 CONTRACTOR: Any individual, firm or corporation with whom a contract is made by the Agency.
- 1.23 SUBCONTRACTOR: An individual, partnership or corporation which has a direct contract with a contractor to furnish labor and materials at the job site, or to perform construction labor and furnish material in connection with such labor at the job site.
- 1.24 CONTRACT BOND: The approved form of security furnished by the contractor and his surety as a guaranty of good faith on the part of the contractor to execute the work in accordance with the terms of the contract.
- 1.25 LIQUIDATED DAMAGES: An amount due and payable to the University by the Contractor for additional costs incurred by the University resulting from the Contractor's failure to complete within the Contract time.

ARTICLE 2: BIDDER'S REPRESENTATIONS

- 2.1 PRE-BID MEETING
 - 2.1.1 A pre-bid meeting for this project will be held at the time and place designated. Attendance at this meeting is a pre-requisite for submitting a Bid, unless this requirement is specifically waived elsewhere in the Bid Documents.
- 2.2 By submitting a Bid, the Bidder represents that:
 - 2.2.1 The Bidder has read and understands the Bidding Documents and that the Bid is made in accordance therewith.
 - 2.2.2 The Bidder has visited the site, become familiar with existing conditions under which the Work is to be performed, and has correlated the Bidder's his personal observations with the requirements of the proposed Contract Documents.
 - 2.2.3 The Bid is based upon the materials, equipment, and systems required by the Bidding Documents without exception.
- 2.3 JOINT VENTURE REQUIREMENTS

- 2.3.1 For Public Works Contracts, each Joint Venturer shall be qualified and capable to complete the Work with their own forces.
- 2.3.2 Included with the Bid submission, and as a requirement to bid, a copy of the executed Joint Venture Agreement shall be submitted and signed by all Joint Venturers involved.
- 2.3.3 All required Bid Bonds, Performance Bonds, Material and Labor Payment Bonds must be executed by both Joint Venturers and be placed in both of their names.
- 2.3.4 All required insurance certificates shall name both Joint Venturers.
- 2.3.5 Both Joint Venturers shall sign the Bid Form and shall submit a copy of a valid Delaware Business License with their Bid.
- 2.3.6 Both Joint Venturers shall include their Federal E.I. Number with the Bid.
- 2.3.7 In the event of a mandatory Pre-bid Meeting, each Joint Venturer shall have a representative in attendance.
- 2.3.8 Due to exceptional circumstances and for good cause shown, one or more of these provisions may be waived at the discretion of the State.

2.4 ASSIGNMENT OF ANTITRUST CLAIMS

- 2.4.1 As consideration for the award and execution by the Owner of this contract, the Contractor hereby grants, conveys, sells, assigns and transfers to the State of Delaware all of its right, title and interests in and to all known or unknown causes of action it presently has or may now or hereafter acquire under the antitrust laws of the United States and the State of Delaware, relating to the particular goods or services purchased or acquired by the Owner pursuant to this contract.

ARTICLE 3: BIDDING DOCUMENTS

3.1 COPIES OF BID DOCUMENTS

- 3.1.1 Bidders may obtain complete sets of the Bidding Documents from the Architectural/Engineering firm designated in the Advertisement or Invitation to Bid in the number and for the deposit sum, if any, stated therein.
- 3.1.2 Bidders shall use complete sets of Bidding Documents for preparation of Bids. The issuing Agency nor the Architect assumes no responsibility for errors or misinterpretations resulting from the use of incomplete sets of Bidding Documents.
- 3.1.3 Any errors, inconsistencies or omissions discovered shall be reported to the Architect immediately.
- 3.1.4 The Agency and Architect may make copies of the Bidding Documents available on the above terms for the purpose of obtaining Bids on the Work. No license or grant of use is conferred by issuance of copies of the Bidding Documents.

3.2 INTERPRETATION OR CORRECTION OF BIDDING DOCUMENTS

- 3.2.1 The Bidder shall carefully study and compare the Bidding Documents with each other, and with other work being bid concurrently or presently under construction to the extent that it relates to the Work for which the Bid is submitted, shall examine the site and local conditions, and shall report any errors, inconsistencies, or ambiguities discovered to the Architect.
- 3.2.2 Bidders or Sub-bidders requiring clarification or interpretation of the Bidding Documents shall make a written request to the Architect at least seven days prior to the date for receipt of Bids. Interpretations,

corrections and changes to the Bidding Documents will be made by written Addendum. Interpretations, corrections, or changes to the Bidding Documents made in any other manner shall not be binding.

3.2.3 The apparent silence of the specifications as to any detail, or the apparent omission from it of detailed description concerning any point, shall be regarded as meaning that only the best commercial practice is to prevail and only material and workmanship of the first quality are to be used. Proof of specification compliance will be the responsibility of the Bidder.

3.2.4 Unless otherwise provided in the Contract Documents, the Contractor shall provide and pay for all permits, labor, materials, equipment, tools, construction equipment and machinery, water, heat, utilities, transportation, and other facilities and services necessary for the proper execution and completion of the Work.

3.2.5 The Owner will bear the costs for all impact and user fees associated with the project.

3.3 SUBSTITUTIONS

3.3.1 The materials, products and equipment described in the Bidding Documents establish a standard of quality, required function, dimension, and appearance to be met by any proposed substitution. The specification of a particular manufacturer or model number is not intended to be proprietary in any way. Substitutions of products for those named will be considered, providing that the Vendor certifies that the function, quality, and performance characteristics of the material offered is equal or superior to that specified. It shall be the Bidder's responsibility to assure that the proposed substitution will not affect the intent of the design, and to make any installation modifications required to accommodate the substitution.

3.3.2 Requests for substitutions shall be made in writing to the Architect at least ten days prior to the date of the Bid Opening. Such requests shall include a complete description of the proposed substitution, drawings, performance and test data, explanation of required installation modifications due the substitution, and any other information necessary for an evaluation. The burden of proof of the merit of the proposed substitution is upon the proposer. The Architect's decision of approval or disapproval shall be final. The Architect is to notify Owner prior to any approvals.

3.3.3 If the Architect approves a substitution prior to the receipt of Bids, such approval shall be set forth in an Addendum. Approvals made in any other manner shall not be binding.

3.3.4 The Architect shall have no obligation to consider any substitutions after the Contract award.

3.4 ADDENDA

3.4.1 Addenda will be mailed or delivered to all who are known by the Architect to have received a complete set of the Bidding Documents.

3.4.2 Copies of Addenda will be made available for inspection wherever Bidding Documents are on file for that purpose.

3.4.3 No Addenda will be issued later than 4 days prior to the date for receipt of Bids except an Addendum withdrawing the request for Bids or one which extends the time or changes the location for the opening of bids.

3.4.4 Each bidder shall ascertain prior to submitting his Bid that they have received all Addenda issued, and shall acknowledge their receipt in their Bid in the appropriate space. Not acknowledging an issued Addenda could be grounds for determining a bid to be non-responsive.

ARTICLE 4: BIDDING PROCEDURES

4.1 PREPARATION OF BIDS

- 4.1.1 Submit the bids on the Bid Forms included with the Bidding Documents.
- 4.1.2 Submit the original Bid Form for each bid. Bid Forms may be removed from the project manual for this purpose.
- 4.1.3 Execute all blanks on the Bid Form in a non-erasable medium (typewriter or manually in ink).
- 4.1.4 Where so indicated by the makeup on the Bid Form, express sums in both words and figures, in case of discrepancy between the two, the written amount shall govern.
- 4.1.5 Interlineations, alterations or erasures must be initialed by the signer of the Bid.
- 4.1.6 BID ALL REQUESTED ALTERNATES AND UNIT PRICES, IF ANY. If there is no change in the Base Bid for an Alternate, enter "No Change". The Contractor is responsible for verifying that they have received all addenda issued during the bidding period. Work required by Addenda shall automatically become part of the Contract.
- 4.1.7 Make no additional stipulations on the Bid Form and do not qualify the Bid in any other manner.
- 4.1.8 Each copy of the Bid shall include the legal name of the Bidder and a statement whether the Bidder is a sole proprietor, a partnership, a corporation, or any legal entity, and each copy shall be signed by the person or persons legally authorized to bind the Bidder to a contract. A Bid by a corporation shall further give the state of incorporation and have the corporate seal affixed. A Bid submitted by an agent shall have a current Power of Attorney attached, certifying agent's authority to bind the Bidder.
- 4.1.9 Bidder shall complete the Non-Collusion Statement form included with the Bid Forms and include it with their Bid.
- 4.1.10 In the construction of all Public Works projects for the State of Delaware or any agency thereof, preference in employment of laborers, workers or mechanics shall be given to bona fide legal citizens of the State who have established citizenship by residence of at least 90 days in the State.
- 4.1.11 Each bidder shall include in their bid a copy of a valid Delaware Business License.'
- 4.1.12 Each bidder shall include signed Affidavit(s) for the Bidder and each listed Subcontractor certifying compliance with OMB Regulation 4104- "Regulations for the Drug Testing of Contractor and Subcontractor Employees Working on "Large Public Works Projects." "Large Public Works" is based upon the current threshold required for bidding Public Works as set by the Purchasing and Contracting Advisory Council.
- 4.2 BID SECURITY
- 4.2.1 All bids shall be accompanied by a deposit of either a good and sufficient bond to the agency for the benefit of the agency, with corporate surety authorized to do business in this State, the form of the bond and the surety to be approved by the agency, or a security of the bidder assigned to the agency, for a sum equal to at least 10% of the bid plus all add alternates, or in lieu of the bid bond a security deposit in the form of a certified check, bank treasurer's check, cashier's check, money order, or other prior approved secured deposit assigned to the State. The bid bond need not be for a specific sum, but may be stated to be for a sum equal to 10% of the bid plus all add alternates to which it relates and not to exceed a certain stated sum, if said sum is equal to at least 10% of the bid. The Bid Bond form used shall be the standard OMB form (attached).
- 4.2.2 The Agency has the right to retain the bid security of Bidders to whom an award is being considered until either a formal contract has been executed and bonds have been furnished or the specified time has elapsed so the Bids may be withdrawn or all Bids have been rejected.

4.2.3 In the event of any successful Bidder refusing or neglecting to execute a formal contract and bond within 20 days of the awarding of the contract, the bid bond or security deposited by the successful bidder shall be forfeited.

4.3 SUBCONTRACTOR LIST

4.3.1 As required by Delaware Code, Title 29, section 6962(d)(10)b, each Bidder shall submit with their Bid a completed List of Sub-Contractors included with the Bid Form. NAME ONLY ONE SUBCONTRACTOR FOR EACH TRADE. A Bid will be considered non-responsive unless the completed list is included.

4.3.2 Provide the Name and Address for each listed subcontractor. Addresses by City, Town or Locality, plus State, will be acceptable.

4.3.3 It is the responsibility of the Contractor to ensure that their Subcontractors are in compliance with the provisions of this law. Also, if a Contractor elects to list themselves as a Subcontractor for any category, they must specifically name themselves on the Bid Form and be able to document their capability to act as Subcontractor in that category in accordance with this law.

4.4 EQUALITY OF EMPLOYMENT OPPORTUNITY ON PUBLIC WORKS

4.4.1 During the performance of this contract, the contractor agrees as follows:

A. The Contractor will not discriminate against any employee or applicant for employment because of race, creed, sex, color, sexual orientation, gender identity or national origin. The Contractor will take affirmative action to ensure the applicants are employed, and that employees are treated during employment, without regard to their race, creed, sex, color, sexual orientation, gender identity or national origin. Such action shall include, but not be limited to, the following: Employment, upgrading, demotion or transfer; recruitment or recruitment advertising; layoff or termination; rates of pay or other forms of compensation; and selection for training, including apprenticeship. The Contractor agrees to post in conspicuous places available to employees and applicants for employment notices to be provided by the contracting agency setting forth this nondiscrimination clause.

B. The Contractor will, in all solicitations or advertisements for employees placed by or on behalf of the Contractor, state that all qualified applicants will receive consideration for employment without regard to race, creed, sex, color, sexual orientation, gender identity or national origin."

4.5 PREVAILING WAGE REQUIREMENT

4.5.1 Wage Provisions: In accordance with Delaware Code, Title 29, Section 6960, renovation projects whose total cost shall exceed \$45,000, and \$500,000 for new construction, the minimum wage rates for various classes of laborers and mechanics shall be as determined by the Department of Labor, Division of Industrial Affairs of the State of Delaware.

4.5.2 The prevailing wage shall be the wage paid to a majority of employees performing similar work as reported in the Department's annual prevailing wage survey or in the absence of a majority, the average paid to all employees reported.

4.5.3 The employer shall pay all mechanics and labors employed directly upon the site of work, unconditionally and not less often than once a week and without subsequent deduction or rebate on any account, the full amounts accrued at time of payment, computed at wage rates not less than those stated in the specifications, regardless of any contractual relationship which may be alleged to exist between the employer and such laborers and mechanics.

4.5.4 The scale of the wages to be paid shall be posted by the employer in a prominent and easily accessible place at the site of the work.

4.5.5 Every contract based upon these specifications shall contain a stipulation that sworn payroll information, as required by the Department of Labor, be furnished weekly. The Department of Labor shall keep and maintain the sworn payroll information for a period of 6 months from the last day of the work week covered by the payroll.

4.6 SUBMISSION OF BIDS

4.6.1 Enclose the Bid, the Bid Security, and any other documents required to be submitted with the Bid in a sealed opaque envelope. Address the envelope to the party receiving the Bids. Identify with the project name, project number, and the Bidder's name and address. If the Bid is sent by mail, enclose the sealed envelope in a separate mailing envelope with the notation "BID ENCLOSED" on the face thereof. The State is not responsible for the opening of bids prior to bid opening date and time that are not properly marked.

4.6.2 Deposit Bids at the designated location prior to the time and date for receipt of bids indicated in the Advertisement for Bids. Bids received after the time and date for receipt of bids will be marked "LATE BID" and returned.

4.6.3 Bidder assumes full responsibility for timely delivery at location designated for receipt of bids.

4.6.4 Oral, telephonic or telegraphic bids are invalid and will not receive consideration.

4.6.5 Withdrawn Bids may be resubmitted up to the date and time designated for the receipt of Bids, provided that they are then fully in compliance with these Instructions to Bidders.

4.7 MODIFICATION OR WITHDRAW OF BIDS

4.7.1 Prior to the closing date for receipt of Bids, a Bidder may withdraw a Bid by personal request and by showing proper identification to the Architect. A request for withdraw by letter or fax, if the Architect is notified in writing prior to receipt of fax, is acceptable. A fax directing a modification in the bid price will render the Bid informal, causing it to be ineligible for consideration of award. Telephone directives for modification of the bid price shall not be permitted and will have no bearing on the submitted proposal in any manner.

4.7.2 Bidders submitting Bids that are late shall be notified as soon as practicable and the bid shall be returned.

4.7.3 A Bid may not be modified, withdrawn or canceled by the Bidder during a thirty (30) day period following the time and date designated for the receipt and opening of Bids, and Bidder so agrees in submitting their Bid. Bids shall be binding for 30 days after the date of the Bid opening.

ARTICLE 5: CONSIDERATION OF BIDS

5.1 OPENING/REJECTION OF BIDS

5.1.1 Unless otherwise stated, Bids received on time will be publicly opened and will be read aloud. An abstract of the Bids will be made available to Bidders.

5.1.2 The Agency shall have the right to reject any and all Bids. A Bid not accompanied by a required Bid Security or by other data required by the Bidding Documents, or a Bid which is in any way incomplete or irregular is subject to rejection.

5.1.3 If the Bids are rejected, it will be done within thirty (30) calendar day of the Bid opening.

5.2 COMPARISON OF BIDS

5.2.1 After the Bids have been opened and read, the bid prices will be compared and the result of such comparisons will be made available to the public. Comparisons of the Bids may be based on the Base

Bid plus desired Alternates. The Agency shall have the right to accept Alternates in any order or combination.

- 5.2.2 The Agency reserves the right to waive technicalities, to reject any or all Bids, or any portion thereof, to advertise for new Bids, to proceed to do the Work otherwise, or to abandon the Work, if in the judgment of the Agency or its agent(s), it is in the best interest of the State.
- 5.2.3 An increase or decrease in the quantity for any item is not sufficient grounds for an increase or decrease in the Unit Price.
- 5.2.4 The prices quoted are to be those for which the material will be furnished F.O.B. Job Site and include all charges that may be imposed during the period of the Contract.
- 5.2.5 No qualifying letter or statements in or attached to the Bid, or separate discounts will be considered in determining the low Bid except as may be otherwise herein noted. Cash or separate discounts should be computed and incorporated into Unit Bid Price(s).

5.3 DISQUALIFICATION OF BIDDERS

- 5.3.1 An agency shall determine that each Bidder on any Public Works Contract is responsible before awarding the Contract. Factors to be considered in determining the responsibility of a Bidder include:
 - A. The Bidder's financial, physical, personnel or other resources including Subcontracts;
 - B. The Bidder's record of performance on past public or private construction projects, including, but not limited to, defaults and/or final adjudication or admission of violations of the Prevailing Wage Laws in Delaware or any other state;
 - C. The Bidder's written safety plan;
 - D. Whether the Bidder is qualified legally to contract with the State;
 - E. Whether the Bidder supplied all necessary information concerning its responsibility; and,
 - F. Any other specific criteria for a particular procurement, which an agency may establish; provided however, that, the criteria be set forth in the Invitation to Bid and is otherwise in conformity with State and/or Federal law.
- 5.3.2 If an agency determines that a Bidder is nonresponsive and/or nonresponsible, the determination shall be in writing and set forth the basis for the determination. A copy of the determination shall be sent to the affected Bidder within five (5) working days of said determination.
- 5.3.3 In addition, any one or more of the following causes may be considered as sufficient for the disqualification of a Bidder and the rejection of their Bid or Bids.
 - 5.3.3.1 More than one Bid for the same Contract from an individual, firm or corporation under the same or different names.
 - 5.3.3.2 Evidence of collusion among Bidders.
 - 5.3.3.3 Unsatisfactory performance record as evidenced by past experience.
 - 5.3.3.4 If the Unit Prices are obviously unbalanced either in excess or below reasonable cost analysis values.
 - 5.3.3.5 If there are any unauthorized additions, interlineation, conditional or alternate bids or irregularities of any kind which may tend to make the Bid incomplete, indefinite or ambiguous as to its meaning.

- 5.3.3.6 If the Bid is not accompanied by the required Bid Security and other data required by the Bidding Documents.
- 5.3.3.7 If any exceptions or qualifications of the Bid are noted on the Bid Form.
- 5.4 ACCEPTANCE OF BID AND AWARD OF CONTRACT
- 5.4.1 A formal Contract shall be executed with the successful Bidder within twenty (20) calendar days after the award of the Contract.
- 5.4.2 Per Section 6962(d)(13) a., Title 29, Delaware Code, "The contracting agency shall award any public works contract within thirty (30) days of the bid opening to the lowest responsive and responsible Bidder, unless the Agency elects to award on the basis of best value, in which case the election to award on the basis of best value shall be stated in the Invitation To Bid."
- 5.4.3 Each Bid on any Public Works Contract must be deemed responsive by the Agency to be considered for award. A responsive Bid shall conform in all material respects to the requirements and criteria set forth in the Contract Documents and specifications.
- 5.4.4 The Agency shall have the right to accept Alternates in any order or combination, and to determine the low Bidder on the basis of the sum of the Base Bid, plus accepted Alternates.
- 5.4.5 The successful Bidder shall execute a formal contract, submit the required Insurance Certificate, and furnish good and sufficient bonds, unless specifically waived in the General Requirements, in accordance with the General Requirement, within twenty (20) days of official notice of contract award. Bonds shall be for the benefit of the Agency with surety in the amount of 100% of the total contract award. Said Bonds shall be conditioned upon the faithful performance of the contract. Bonds shall remain in affect for period of one year after the date of substantial completion.
- 5.4.6 If the successful Bidder fails to execute the required Contract and Bond, as aforesaid, within twenty (20) calendar days after the date of official Notice of the Award of the Contract, their Bid guaranty shall immediately be taken and become the property of the State for the benefit of the Agency as liquidated damages, and not as a forfeiture or as a penalty. Award will then be made to the next lowest qualified Bidder of the Work or readvertised, as the Agency may decide.
- 5.4.7 Each bidder shall supply with its bid its taxpayer identification number (i.e., federal employer identification number or social security number) and a copy of its Delaware business license, and should the vendor be awarded a contract, such vendor shall provide to the agency the taxpayer identification license numbers of such subcontractors. Such numbers shall be provided on the later of the date on which such subcontractor is required to be identified or the time the contract is executed. The successful Bidder shall provide to the agency to which it is contracting, within 30 days of entering into such public works contract, copies of all Delaware Business licenses of subcontractors and/or independent contractors that will perform work for such public works contract. However, if a subcontractor or independent contractor is hired or contracted more than 20 days after the Bidder entered the public works contract the Delaware Business license of such subcontractor or independent contractor shall be provided to the agency within 10 days of being contracted or hired.
- 5.4.8 The Bid Security shall be returned to the successful Bidder upon the execution of the formal contract. The Bid Securities of unsuccessful bidders shall be returned within thirty (30) calendar days after the opening of the Bids.

ARTICLE 6: POST-BID INFORMATION

6.1 CONTRACTOR'S QUALIFICATION STATEMENT

- 6.1.1 Bidders to whom award of a Contract is under consideration shall, if requested by the Agency, submit a properly executed AIA Document A305, Contractor's Qualification Statement, unless such a statement has been previously required and submitted.

6.2 BUSINESS DESIGNATION FORM

6.2.1 Successful bidder shall be required to accurately complete an Office of Management and Budget Business Designation Form for Subcontractors.

ARTICLE 7: PERFORMANCE BOND AND PAYMENT BOND

7.1 BOND REQUIREMENTS

7.1.1 The cost of furnishing the required Bonds, that are stipulated in the Bidding Documents, shall be included in the Bid.

7.1.2 If the Bidder is required by the Agency to secure a bond from other than the Bidder's usual sources, changes in cost will be adjusted as provide in the Contract Documents.

7.1.3 The Performance and Payment Bond forms used shall be the standard OMB forms (attached).

7.2 TIME OF DELIVERY AND FORM OF BONDS

7.2.1 The bonds shall be dated on or after the date of the Contract.

7.2.2 The Bidder shall require the attorney-in-fact who executes the required bonds on behalf of the surety to affix a certified and current copy of the power of attorney.

ARTICLE 8: FORM OF AGREEMENT BETWEEN AGENCY AND CONTRACTOR

8.1 Unless otherwise required in the Bidding Documents, the Agreement for the Work will be written on AIA Document A101, Standard Form of Agreement Between Owner and Contractor Where the Basis of Payment is a Stipulated Sum.

ARTICLE 9: LIQUIDATED DAMAGES

9.1 Schedule of Liquidated Damages:

Schedule of Liquidated Damages		
Awarded Contract Value		Daily Charge
For Greater Than	Up to and Including	Calendar Day
\$0.00	\$25,000.00	\$290.00
\$25,000.00	\$50,000.00	\$300.00
\$50,000.00	\$100,000.00	\$400.00
\$100,000.00	\$500,000.00	\$630.00
\$500,000.00	\$1,000,000.00	\$820.00
\$1,000,000.00	\$2,000,000.00	\$1,000.00
\$2,000,000.00	\$5,000,000.00	\$1,060.00
\$5,000,000.00	\$10,000,000.00	\$1,180.00
\$10,000,000.00	\$15,000,000.00	\$1,870.00

\$15,000,000.00	\$20,000,000.00	\$3,130.00
\$20,000,000.00	Over	\$4,360.00

9.2

For each calendar day or work day that work remains uncompleted after the Contract time has expired or beyond the completion date established by the Contract, the sum specified in paragraph 9.1 of this document, will be deducted from any money due the Contractor. This sum shall not be considered and treated as a penalty but as liquidated damages due the University by reason of inconvenience to the public, added cost of engineering and supervision, and other extra expenditures of public funds due to the Contractor's failure to complete the work on time. Any adjustment of the Contract time for completion of the work granted by the University will be considered in the assessment of liquidated damages.

END OF SECTION 00 21 13



BID FORM

Project: PC-16-046 – Student Health Center Air Handling Unit Replacement

Location: Delaware State University
Student Health Center, Main Campus
1200 North DuPont Hwy
Dover, Delaware

For Bids Due: **Wednesday, February 28, 2018** at 3:00 pm local time

To: Delaware State University
Facilities Building,
Office 101
1200 N. DuPont Highway
Dover, DE 19901-2277
Attn: Zafar Chaudhrey
Associate Vice President

Name of Bidder: _____

Delaware Business License No.: _____ **Taxpayer ID No.:** _____
(A copy of Bidder’s Delaware Business License must be attached to this form.)

(Other License Nos.): _____

Phone No.: () _____ - _____ **Fax No.:** () _____ - _____

The undersigned, representing that he has read and understands the Bidding Documents and that this bid is made in accordance therewith, that he has visited the site and has familiarized himself with the local conditions under which the Work is to be performed, and that his bid is based upon the materials, systems and equipment described in the Bidding Documents without exception, hereby proposes and agrees to provide all labor, materials, plant, equipment, supplies, transport and other facilities required to execute the work described by the aforesaid documents for the lump sum itemized below:

\$ _____ (Written Out).

(\$ _____) (Figures).

[This price includes all allowances as documented within the project manual.]

A. ALTERNATES (Note: project is subject to prevailing wages)

- 1. Alternates: Alternate prices conform to applicable project specification section. Refer to the drawing specifications for a complete description of the following Alternates. An “ADD” or “DEDUCT” amount is indicated by the crossing out the part that does not apply.

a. **Alternate #1:** Net - ADD / DEDUCT
 • _____ (Figures).
 • _____ (Written Out).

b. **Alternate #2:** Net - ADD / DEDUCT
 • _____ (Figures).
 • _____ (Written Out).

c. **Alternate #3:** Net - ADD / DEDUCT
 • _____ (Figures).
 • _____ (Written Out).

B. UNIT PRICES

1. Unit prices conform to applicable project specification section. Refer to the specifications for a complete description of the following Unit Prices:

	<u>ADD</u>	<u>DEDUCT</u>
UNIT PRICE No. 1: _____ (BRIEF DESCRIPTION) _____	\$ _____	\$ _____
UNIT PRICE No. 2: _____ (BRIEF DESCRIPTION) _____	\$ _____	\$ _____
UNIT PRICE No. 3: _____ (BRIEF DESCRIPTION) _____	\$ _____	\$ _____

C. WORK SCHEDULE

1. We understand that this contract is governed by liquidated damages and that submission of this bid is acceptance of the proposed contract completion date. Our proposed detailed project schedule shows more fully the sequence of activities necessary to meet the specified schedule. The project schedule is a required attachment of a complete bid and failure to submit a viable schedule will be a justifiable reason to deem the bid as incomplete.
2. I/We can begin work _____ calendar days after notification of award and will require _____ calendar days thereafter to complete the work. Work on the project will begin _____ calendar days after Letter of Intent.
3. Alternative Work Hours

Work during “regular hours” at this site is being performed on a single shift, eight hours per day, 7:30 AM to 4:30 PM, and five days per week, Monday through Friday. To meet the schedule established on the basis of Item 1 above, our proposed work hours will be _____ hours per day, _____ AM to _____ PM, and _____ days per week, _____ through _____ the cost of which is reflected in our lump sum price. Our lump sum price also includes any mandatory off-hours work required per special conditions.

D. SITE SUPERINTENDANT

We propose to use _____ as our site superintendent. A resume of his/her qualifications is attached.

We understand that DSU reserves the right to interview him/her prior to contract award/prior to start of work and to reject him/her if not considered acceptable. If rejected, we will propose alternate personnel for the position who will be subject to the same review and acceptance procedure, at no increase in our lump sum proposal.

We also understand DSU reserves the right to reject our bid if we are unable to provide a site supervisor acceptable to DSU within thirty (30) calendar days after submission of this bid.

E. REMARKS

1. I/We acknowledge Addendums numbered _____ and the price(s) submitted include any cost/schedule impact they may have.
2. This bid shall remain valid and cannot be withdrawn for thirty (30) days from the date of opening of bids (60 days for School Districts and Department of Education), and the undersigned shall abide by the Bid Security forfeiture provisions. Bid Security is attached to this Bid.
3. The Owner shall have the right to reject any or all bids, and to waive any informality or irregularity in any bid received.
4. This bid is based upon work being accomplished by the Sub-Contractors named on the list attached to this bid.
5. Should I/We be awarded this contract, I/We pledge to achieve substantial completion of all the work within _____ calendar days of the Notice to Proceed.
6. Our Bid Price(s) are firm based on contract award within thirty (30) calendar days of the date of submittal of this bid.
7. I/We understand that we will not be compensated at a later date for claimed additional costs based on any information received during the bid period, but which is not identified in our proposal and subsequently accepted in writing by DSU.

The undersigned represents and warrants that he has complied and shall comply with all requirements of local, state, and national laws; that no legal requirement has been or shall be violated in making or accepting this bid, in awarding the contract to him or in the prosecution of the work required; that the bid is legal and firm; that he has not, directly or indirectly, entered into any agreement, participated in any collusion, or otherwise taken action in restraint of free competitive bidding.

Upon receipt of written notice of the acceptance of this Bid, the Bidder shall, within twenty (20) calendar days, execute the agreement in the required form and deliver the Contract Bonds, and Insurance Certificates, required by the Contract Documents.

I am / We are an Individual / a Partnership / a Corporation

By _____ Trading as _____
(Individual's / General Partner's / Corporate Name)

(State of Corporation)

Business Address: _____

Witness: _____ **By:** _____
(SEAL) (Authorized Signature)

(Title)
Date: _____

ATTACHMENTS

- Sub-Contractor List
- Non-Collusion Statement
- Bid Security
- Construction Schedule
- Resume of Site Superintendent
- (Others as Required by Project Manuals)

END OF SECTION 00 41 13

STATE OF DELAWARE
OFFICE OF MANAGEMENT AND BUDGET

BID BOND

TO ACCOMPANY PROPOSAL
(Not necessary if security is used)

KNOW ALL MEN BY THESE PRESENTS That: _____
_____ of _____ in the County of _____
and State of _____ as **Principal**, and _____
_____ of _____ in the County of _____ and State of _____
as **Surety**, legally authorized to do business in the State of Delaware (“**State**”), are held and firmly unto the **State**
in the sum of _____ Dollars (\$ _____),
or _____ percent not to exceed _____
_____ Dollars (\$ _____) of amount of bid on Contract No. _____, to be
paid to the **State** for the use and benefit of _____ (*insert State agency
name*) for which payment well and truly to be made, we do bind ourselves, our and each of our heirs, executors,
administrators, and successors, jointly and severally for and in the whole firmly by these presents.

NOW THE CONDITION OF THIS OBLIGATION IS SUCH That if the above bonded **Principal** who has
submitted to the _____ (*insert State agency name*) a certain proposal to
enter into this contract for the furnishing of certain material and/or services within the **State**, shall be awarded this
Contract, and if said **Principal** shall well and truly enter into and execute this Contract as may be required by the
terms of this Contract and approved by the _____ (*insert State
agency name*) this Contract to be entered into within twenty days after the date of official notice of the award
thereof in accordance with the terms of said proposal, then this obligation shall be void or else to be and remain in
full force and virtue.

Sealed with _____ seal and dated this _____ day of _____ in the year of our Lord two
thousand and _____ (20____).

SEALED, AND DELIVERED IN THE
Presence of

Name of Bidder (Organization)

Corporate
Seal

By:

Authorized Signature

Attest _____

Title

Name of Surety

Witness: _____

By:

Title

SUBCONTRACTOR LIST

In accordance with Title 29, Chapter 6962 (d)(10)b Delaware Code, the following sub-contractor listing must accompany the bid submittal. The name and address of the sub-contractor **must be listed for each category** where the bidder intends to use a sub-contractor to perform that category of work. In order to provide full disclosure and acceptance of the bid by the *Owner*, **it is required that bidders list themselves as being the sub-contractor for all categories where he/she is qualified and intends to perform such work.**

<u>Subcontractor Category</u>	<u>Subcontractor</u>	<u>Address (City & State)</u>	<u>Subcontractors tax payer ID # or Delaware Business license #</u>
1. <u>Mechanical</u>	_____	_____	_____
2. <u>Electrical</u>	_____	_____	_____
3. <u>Masonry</u>	_____	_____	_____
4. <u>Fencing</u>	_____	_____	_____
5. <u>Sheet Metal</u>	_____	_____	_____
6. <u>Finishes</u>	_____	_____	_____
7. <u>General Trades</u>	_____	_____	_____
8. <u>Landscaping</u>	_____	_____	_____
9. _____	_____	_____	_____

NON-COLLUSION STATEMENT

This is to certify that the undersigned bidder has neither directly nor indirectly, entered into any agreement, participated in any collusion or otherwise taken any action in restraint of free competitive bidding in connection with this proposal submitted this date *(to the Office of Management and Budget, Division of Facilities Management)*.

All the terms and conditions of *(Project or Contract Number)* have been thoroughly examined and are understood.

NAME OF BIDDER: _____

**AUTHORIZED REPRESENTATIVE
(TYPED):** _____

**AUTHORIZED REPRESENTATIVE
(SIGNATURE):** _____

TITLE: _____

ADDRESS OF BIDDER: _____

E-MAIL: _____

PHONE NUMBER: _____

Sworn to and Subscribed before me this _____ day of _____ 20_____.

My Commission expires _____. NOTARY PUBLIC _____.

THIS PAGE MUST BE SIGNED AND NOTARIZED FOR YOUR BID TO BE CONSIDERED.

AFFIDAVIT OF EMPLOYEE DRUG TESTING PROGRAM

OMB Regulation 4104 for the Drug Testing of Contractor and Subcontractor Employees Working on Large Public Works Projects requires that Contractors and Subcontractors implement a program of mandatory drug testing for Employees who work on Large Public Works Contracts funded all or in part with public funds.

For more information, please refer to the following link for the full regulation: <http://regulations.delaware.gov/register/september2015/final/19%20DE%20Reg%20207%2009-01-15.pdf>

All the terms and conditions of *OMB Regulation 4104* have been thoroughly examined and are understood. We hereby certify that we have in place or will implement during the entire term of the contract a Mandatory Drug Testing Program for our employees on the jobsite that complies with this regulation:

Contractor/Subcontractor Name: _____

Contractor/Subcontractor Address: _____

Authorized Representative (typed or printed): _____

Authorized Representative (signature): _____

Title: _____

Sworn to and Subscribed before me this _____ day of _____ 20_____.

My Commission expires _____. NOTARY PUBLIC _____.

AN AFFIDAVIT SHALL BE PROVIDED BY THE BIDDER AND ALL SUBCONTRACTORS IDENTIFIED IN ATTACHED SUBCONTRACTOR LIST. STATEMENT(S) MUST BE SIGNED AND NOTARIZED FOR YOUR BID TO BE CONSIDERED.

STANDARD FORM OF AGREEMENT BETWEEN OWNER AND CONTRACTOR A101-2007

The contract to be utilized on this project shall be the "Standard Form of Agreement Between Owner and Contractor" AIA Document A101-2007.

END OF SECTION 00 52 13

SUPPLEMENT TO AGREEMENT BETWEEN OWNER AND CONTRACTOR A101-2007

The following supplements modify the "Standard Form of Agreement Between Owner and Contractor," AIA Document A101-2007. Where a portion of the Standard Form of Agreement is modified or deleted by the following, the unaltered portions of the Standard Form of Agreement shall remain in effect.

ARTICLE 5: PAYMENTS

5.1 PROGRESS PAYMENTS

5.1.3 Delete paragraph 5.1.3 in its entirety and replace with the following:

“Provided that a valid Application for Payment is received by the Architect that meets all requirements of the Contract, payment shall be made by the Owner not later than 30 days after the Owner receives the valid Application for Payment.”

ARTICLE 8: MISCELLANEOUS PROVISIONS

8.2 Insert the following:

"Payments are due 30 days after receipt of a valid Application for Payment. After that 30 day period, interest may be charged at the rate of 1% per month not to exceed 12% per annum."

8.5 Delete paragraph 8.5 in its entirety and replace with the following:

“The Contractor’s representative shall not be changed without ten days written notice to the Owner.”

END OF SECTION 00 54 13

STATE OF DELAWARE
OFFICE OF MANAGEMENT AND BUDGET

PERFORMANCE BOND

Bond Number: _____

KNOW ALL PERSONS BY THESE PRESENTS, that we, _____, as principal (“**Principal**”), and _____, a _____ corporation, legally authorized to do business in the State of Delaware, as surety (“**Surety**”), are held and firmly bound unto the _____ (“**Owner**”) (*insert State agency name*), in the amount of _____ (\$_____), to be paid to **Owner**, for which payment well and truly to be made, we do bind ourselves, our and each and every of our heirs, executors, administrations, successors and assigns, jointly and severally, for and in the whole, firmly by these presents.

Sealed with our seals and dated this _____ day of _____, 20__.

NOW THE CONDITION OF THIS OBLIGATION IS SUCH, that if **Principal**, who has been awarded by **Owner** that certain contract known as Contract No. _____ dated the _____ day of _____, 20__ (the “Contract”), which Contract is incorporated herein by reference, shall well and truly provide and furnish all materials, appliances and tools and perform all the work required under and pursuant to the terms and conditions of the Contract and the Contract Documents (as defined in the Contract) or any changes or modifications thereto made as therein provided, shall make good and reimburse **Owner** sufficient funds to pay the costs of completing the Contract that **Owner** may sustain by reason of any failure or default on the part of **Principal**, and shall also indemnify and save harmless **Owner** from all costs, damages and expenses arising out of or by reason of the performance of the Contract and for as long as provided by the Contract; then this obligation shall be void, otherwise to be and remain in full force and effect.

Surety, for value received, hereby stipulates and agrees, if requested to do so by **Owner**, to fully perform and complete the work to be performed under the Contract pursuant to the terms, conditions and covenants thereof, if for any cause **Principal** fails or neglects to so fully perform and complete such work.

Surety, for value received, for itself and its successors and assigns, hereby stipulates and agrees that the obligation of **Surety** and its bond shall be in no way impaired or affected by any extension of time, modification, omission, addition or change in or to the Contract or the work to be performed thereunder, or by any payment thereunder before the time required therein, or by any waiver of any provisions thereof, or by any assignment, subletting or other transfer thereof or of any work to be performed or any monies due or to become due thereunder; and **Surety** hereby waives notice of any and all such extensions, modifications, omissions, additions, changes, payments, waivers, assignments, subcontracts and transfers and hereby expressly stipulates and agrees that any and all things done and omitted to be done by and in relation to assignees, subcontractors, and other transferees shall have the same effect as to **Surety** as though done or omitted to be done by or in relation to **Principal**.

Surety hereby stipulates and agrees that no modifications, omissions or additions in or to the terms of the Contract shall in any way whatsoever affect the obligation of **Surety** and its bond.

Any proceeding, legal or equitable, under this Bond may be brought in any court of competent jurisdiction in the State of Delaware. Notices to **Surety** or Contractor may be mailed or delivered to them at their respective addresses shown below.

IN WITNESS WHEREOF, **Principal** and **Surety** have hereunto set their hand and seals, and such of them as are corporations have caused their corporate seal to be hereto affixed and these presents to be signed by their duly authorized officers, the day and year first above written.

PRINCIPAL

Name: _____

Witness or Attest: Address: _____

Name:

(Corporate Seal)

By: _____ (SEAL)

Name:
Title:

SURETY

Name: _____

Witness or Attest: Address: _____

Name:

(Corporate Seal)

By: _____ (SEAL)

Name:
Title:

STATE OF DELAWARE
OFFICE OF MANAGEMENT AND BUDGET

PAYMENT BOND

Bond Number: _____

KNOW ALL PERSONS BY THESE PRESENTS, that we, _____, as principal (“**Principal**”), and _____, a _____ corporation, legally authorized to do business in the State of Delaware, as surety (“**Surety**”), are held and firmly bound unto the _____ (“**Owner**”) (*insert State agency name*), in the amount of _____ (\$_____), to be paid to **Owner**, for which payment well and truly to be made, we do bind ourselves, our and each and every of our heirs, executors, administrations, successors and assigns, jointly and severally, for and in the whole firmly by these presents.

Sealed with our seals and dated this _____ day of _____, 20__.

NOW THE CONDITION OF THIS OBLIGATION IS SUCH, that if **Principal**, who has been awarded by **Owner** that certain contract known as Contract No. _____ dated the _____ day of _____, 20__ (the “Contract”), which Contract is incorporated herein by reference, shall well and truly pay all and every person furnishing materials or performing labor or service in and about the performance of the work under the Contract, all and every sums of money due him, her, them or any of them, for all such materials, labor and service for which **Principal** is liable, shall make good and reimburse **Owner** sufficient funds to pay such costs in the completion of the Contract as **Owner** may sustain by reason of any failure or default on the part of **Principal**, and shall also indemnify and save harmless **Owner** from all costs, damages and expenses arising out of or by reason of the performance of the Contract and for as long as provided by the Contract; then this obligation shall be void, otherwise to be and remain in full force and effect.

Surety, for value received, for itself and its successors and assigns, hereby stipulates and agrees that the obligation of **Surety** and its bond shall be in no way impaired or affected by any extension of time, modification, omission, addition or change in or to the Contract or the work to be performed thereunder, or by any payment thereunder before the time required therein, or by any waiver of any provisions thereof, or by any assignment, subletting or other transfer thereof or of any work to be performed or any monies due or to become due thereunder; and **Surety** hereby waives notice of any and all such extensions, modifications, omissions, additions, changes, payments, waivers, assignments, subcontracts and transfers and hereby expressly stipulates and agrees that any and all things done and omitted to be done by and in relation to assignees, subcontractors, and other transferees shall have the same effect as to **Surety** as though done or omitted to be done by or in relation to **Principal**.

Surety hereby stipulates and agrees that no modifications, omission or additions in or to the terms of the Contract shall in any way whatsoever affect the obligation of **Surety** and its bond.

Any proceeding, legal or equitable, under this Bond may be brought in any court of competent jurisdiction in the State of Delaware. Notices to **Surety** or Contractor may be mailed or delivered to them at their respective addresses shown below.

IN WITNESS WHEREOF, **Principal** and **Surety** have hereunto set their hand and seals, and such of them as are corporations have caused their corporate seal to be hereto affixed and these presents to be signed by their duly authorized officers, the day and year first above written.

PRINCIPAL

Name: _____

Witness or Attest: Address: _____

Name:

(Corporate Seal)

By: _____ (SEAL)
Name:
Title:

SURETY

Name: _____

Witness or Attest: Address: _____

Name:

(Corporate Seal)

By: _____ (SEAL)
Name:
Title:

APPLICATION AND CERTIFICATION FOR PAYMENT

AIA DOCUMENT G702

PAGE ONE OF

PAGES

TO OWNER: PROJECT: New Office & Warehouse
 Owner
 0000 4th Street
 Las Vegas, Nv. 00000
 FROM CONTRACTOR: VIA ARCHITECT:
 XYZ ELECTRIC Arhitects
 000 Las Vegas BLVD. 000 Tropicana Blvd.
 Las Vegas, Nv. 00000 Las Vegas, Nv. 00000
 CONTRACT FOR: Elect. Systems VIA GENERAL CONTRACTOR: Burke And Associates

APPLICATION NO: 4
 PERIOD TO: 12/31/99
 PROJECT NOS: NV000
 CONTRACT DATE: 08/13/99

Distribution to:
 OWNER
 ARCHITECT
 CONTRACTOR
 GENERAL CONTRACTOR

CONTRACTOR'S APPLICATION FOR PAYMENT

Application is made for payment, as shown below, in connection with the Contract.
 Continuation Sheet, AIA Document G703, is attached.

The undersigned Contractor certifies that to the best of the Contractor's knowledge, information and belief the Work covered by this Application for Payment has been completed in accordance with the Contract Documents, that all amounts have been paid by the Contractor for Work for which previous Certificates for Payment were issued and payments received from the Owner, and that current payment shown herein is now due.

- 1. ORIGINAL CONTRACT SUM \$ 120,693.00
- 2. Net change by Change Orders \$ 832.16
- 3. CONTRACT SUM TO DATE (Line 1 ± 2) \$ 121,525.16
- 4. TOTAL COMPLETED & STORED TO DATE (Column G on G703) \$ 53,064.30
- 5. RETAINAGE:
 - a. % of Completed Work \$ 5,069.73
(Column D + E on G703)
 - b. % of Stored Material \$ 236.70
(Column F on G703)
 - Total Retainage (Lines 5a + 5b or Total in Column I of G703) \$ 5,306.43
- 6. TOTAL EARNED LESS RETAINAGE (Line 4 Less Line 5 Total) \$ 47,757.87
- 7. LESS PREVIOUS CERTIFICATES FOR PAYMENT (Line 6 from prior Certificate) \$ 21,970.80
- 8. CURRENT PAYMENT DUE \$ 25,787.07
- 9. BALANCE TO FINISH, INCLUDING RETAINAGE (Line 3 less Line 6) \$ 73,767.29

CONTRACTOR: XYZ ELECTRIC

By: _____ Date: 12/31/99
 President
 State of: _____ County of: _____
 day of _____
 Notary Public:
 My Commission expires: _____

ARCHITECT'S CERTIFICATE FOR PAYMENT

In accordance with the Contract Documents, on observation of the Work comprising this application, the Architect certifies to the Owner that to the best of the Architect's knowledge, information and belief the Work progressed as indicated, the amount of the Work in accordance with the Contract Documents, and the Contractor is entitled to receive the amount of \$ _____.

AMOUNT CERTIFIED \$ _____

(Attach explanation if amount certified differs from the amount applied. Initial all figures on this Application and on the Continuation Sheet that are changed to conform with the amount certified.)
 ARCHITECT: _____

By: _____ Date: _____

This Certificate is not negotiable. The AMOUNT CERTIFIED is payable only to the Contractor named herein. Issuance, payment and acceptance of payment are without prejudice to any rights of the Owner or Contractor under this Contract.

CHANGE ORDER SUMMARY	ADDITIONS	DEDUCTIONS
Total changes approved in previous months by Owner	\$0.00	
Total approved this Month	\$832.16	
TOTALS	\$832.16	\$0.00
NET CHANGES by Change Order	\$832.16	

GENERAL CONDITIONS

TO THE

CONTRACT

The General Conditions of this Contract are as stated in the American Institute of Architects Document AIA A201 (2007 Edition) entitled General Conditions of the Contract for Construction and is part of this project manual as if herein written in full.

END OF SECTION 00 72 13

00 72 14 INDEMNIFICATION

3.18.1 To the fullest extent permitted by law, the Contractor shall indemnify and hold harmless the Owner, Construction Manager, Architect, the Owner's, Construction manager's and Architect's consultants, and agents and employees of any of them from and against claims, damages, losses and expenses, including but not limited to attorney's fees, arising out of or resulting from performance of the Work, provided that such claim, damage, loss or expense is attributable to bodily injury, sickness, disease or death, or to injury to or destruction of tangible property (other than the Work itself) including loss or use resulting there from, but only to the extent caused in whole or in part by negligent acts or omissions of the Contractor, their Subcontractor, anyone directly or indirectly employed by them or anyone for whose acts they may be liable, regardless of whether or not such claim, damage, loss or expense is caused in part by a party indemnified hereunder. Such obligation shall not be construed to negate, abridge or reduce other rights or obligations of indemnity which would otherwise exist as to a party or person described in this Paragraph 3.18.

3.18.2 In claims against any person or entity indemnified under this paragraph 3.18 by an employee of the Contractor, their Subcontractor, anyone directly or indirectly employed by them or anyone for whose acts they may be liable, the indemnification obligation under this Paragraph 3.18 shall not be limited by a limitation on amount or type of damages, compensation or benefits payable by or for the Contractor or a Subcontractor under workers compensation acts, disability benefit acts or other employee benefit acts.

3.18.3 The obligations of the Contractor under this Paragraph 3.18 shall not extend to the liability of the Construction Manager, Architect, their consultants, and agents and employees of any of them arising out of (1) the preparation or approval of maps, drawings, opinions, reports, surveys, Change Orders, designs or specifications, or (2) the giving of or the failure to give directions or instructions by the Construction Manager, Architect, their consultants, and agents and employees of any of them, provided such giving or failure to give is the primary cause of the injury or damage.

SUPPLEMENTARY GENERAL CONDITIONS A201-2007

The following supplements modify the "General Conditions of the Contract for Construction," AIA Document A201-2007. Where a portion of the General Conditions is modified or deleted by the Supplementary Conditions, the unaltered portions of the General Conditions shall remain in effect.

TABLE OF ARTICLES

1. GENERAL PROVISIONS
2. OWNER
3. CONTRACTOR
4. ADMINISTRATION OF THE CONTRACT
5. SUBCONTRACTORS
6. CONSTRUCTION BY OWNER OR BY SEPARATE CONTRACTORS
7. CHANGES IN THE WORK
8. TIME
9. PAYMENTS AND COMPLETION
10. PROTECTION OF PERSONS AND PROPERTY
11. INSURANCE AND BONDS
12. UNCOVERING AND CORRECTION OF WORK
13. MISCELLANEOUS PROVISIONS
14. TERMINATION OR SUSPENSION OF THE CONTRACT

ARTICLE 1: GENERAL PROVISIONS

1.1 BASIC DEFINITIONS

1.1.1 THE CONTRACT DOCUMENTS

Delete the last sentence in its entirety and replace with the following:

“The Contract Documents also include Advertisement for Bid, Instructions to Bidder, sample forms, the Bid Form, the Contractor’s completed Bid and the Award Letter.”

Add the following Paragraph:

1.1.1.1 In the event of conflict or discrepancies among the Contract Documents, the Documents prepared by the State of Delaware, Division of Facilities Management shall take precedence over all other documents.

1.2 CORRELATION AND INTENT OF THE CONTRACT DOCUMENTS

Add the following Paragraphs:

1.2.4 In the case of an inconsistency between the Drawings and the Specifications, or within either document not clarified by addendum, the better quality or greater quantity of work shall be provided in accordance with the Architect’s interpretation.

1.2.5 The word “PROVIDE” as used in the Contract Documents shall mean “FURNISH AND INSTALL” and shall include, without limitation, all labor, materials, equipment, transportation, services and other items required to complete the Work.

1.2.6 The word “PRODUCT” as used in the Contract Documents means all materials, systems and equipment.

1.5 OWNERSHIP AND USE OF DRAWINGS, SPECIFICATIONS AND OTHER INSTRUMENTS OF SERVICE

Delete Paragraph 1.5.1 in its entirety and replace with the following:

“All pre-design studies, drawings, specifications and other documents, including those in electronic form, prepared by the Architect under this Agreement are, and shall remain, the property of the Owner whether the Project for which they are made is executed or not. Such documents may be used by the Owner to construct one or more like Projects without the approval of, or additional compensation to, the Architect. The Contractor, Subcontractors, Sub-subcontractors and Material or Equipment Suppliers are authorized to use and reproduce applicable portions of the Drawings, Specifications and other documents prepared by the Architect and the Architect’s consultants appropriate to and for use in the execution of their Work under the Contract Documents. They are not to be used by the Contractor or any Subcontractor, Sub-subcontractor or Material and Equipment Supplier on other Projects or for additions to this Project outside the scope of the Work without the specific written consent of the Owner, Architect and Architect’s consultants.

The Architect shall not be liable for injury or damage resulting from the re-use of drawings and specifications if the Architect is not involved in the re-use Project. Prior to re-use of construction documents for a Project in which the Architect is not also involved, the Owner will remove from such documents all identification of the original Architect, including name, address and professional seal or stamp.”

Delete Paragraph 1.5.2 in its entirety.

ARTICLE 2: OWNER

2.2 INFORMATION AND SERVICES REQUIRED OF THE OWNER

To Subparagraph 2.2.3 – Add the following sentence:

“The Contractor, at their expense shall bear the costs to accurately identify the location of all underground utilities in the area of their excavation and shall bear all cost for any repairs required, out of failure to accurately identify said utilities.”

Delete Subparagraph 2.2.5 in its entirety and substitute the following:

2.2.5 The Contractor shall be furnished free of charge up to five (5) sets of the Drawings and Project Manuals. Additional sets will be furnished at the cost of reproduction, postage and handling.

ARTICLE 3: CONTRACTOR

3.2 REVIEW OF CONTRACT DOCUMENTS AND FIELD CONDITIONS BY CONTRACTOR

Amend Paragraph 3.2.2 to state that any errors, inconsistencies or omissions discovered shall be reported to the Architect and Owner immediately.

Delete the third sentence in Paragraph 3.2.3.

3.3 SUPERVISION AND CONSTRUCTION PROCEDURES

Add the following Paragraphs:

3.3.2.1 The Contractor shall immediately remove from the Work, whenever requested to do so by the Owner, any person who is considered by the Owner or Architect to be incompetent or disposed to be so disorderly, or who for any reason is not satisfactory to the Owner, and that person shall not again be employed on the Work without the consent of the Owner or the Architect.

3.3.4 The Contractor must provide suitable storage facilities at the Site for the proper protection and safe storage of their materials. Consult the Owner and the Architect before storing any materials.

3.3.5 When any room is used as a shop, storeroom, office, etc., by the Contractor or Subcontractor(s) during the construction of the Work, the Contractor making use of these areas will be held responsible for any repairs, patching or cleaning arising from such use.

3.4 LABOR AND MATERIALS

Add the Following Paragraphs:

3.4.4 Before starting the Work, each Contractor shall carefully examine all preparatory Work that has been executed to receive their Work. Check carefully, by whatever means are required, to insure that its Work and adjacent, related Work, will finish to proper contours, planes and levels. Promptly notify the General Contractor/Construction Manager of any defects or imperfections in preparatory Work which will in any way affect satisfactory completion of its Work. Absence of such notification will be construed as an acceptance of preparatory Work and later claims of defects will not be recognized.

3.4.5 Under no circumstances shall the Contractor's Work proceed prior to preparatory Work proceed prior to preparatory Work having been completely cured, dried and/or otherwise made satisfactory to receive this Work. Responsibility for timely installation of all materials rests solely with the Contractor responsible for that Work, who shall maintain coordination at all times.

3.5 WARRANTY

Add the following Paragraphs:

3.5.1 The Contractor will guarantee all materials and workmanship against original defects, except injury from proper and usual wear when used for the purpose intended, for two years after Acceptance by the Owner, and will maintain all items in perfect condition during the period of guarantee.

3.5.2 Defects appearing during the period of guarantee will be made good by the Contractor at his expense upon demand of the Owner, it being required that all work will be in perfect condition when the period of guarantee will have elapsed.

3.5.3 In addition to the General Guarantee there are other guarantees required for certain items for different periods of time than the two years as above, and are particularly so stated in that part of the specifications referring to same. The said guarantees will commence at the same time as the General Guarantee.

3.5.4 If the Contractor fails to remedy any failure, defect or damage within a reasonable time after receipt of notice, the Owner will have the right to replace, repair, or otherwise remedy the failure, defect or damage at the Contractor's expense.

3.11 DOCUMENTS AND SAMPLES AT THE SITE

Add the following Paragraphs:

3.11.1 During the course of the Work, the Contractor shall maintain a record set of drawings on which the Contractor shall mark the actual physical location of all piping, valves, equipment, conduit, outlets, access panels, controls, actuators, including all appurtenances that will be concealed once construction is complete, etc., including all invert elevations.

3.11.2 At the completion of the project, the Contractor shall obtain a set of reproducible drawings from the Architect, and neatly transfer all information outlined in 3.11.1 to provide a complete record of the as-built conditions.

3.11.3 The Contractor shall provide two (2) prints of the as-built conditions, along with the reproducible drawings themselves, to the Owner and one (1) set to the Architect. In addition, attach one complete set to each of the Operating and Maintenance Instructions/Manuals.

3.17 In the second sentence of the paragraph, insert "indemnify" between "shall" and "hold".

ARTICLE 4: ADMINISTRATION OF THE CONTRACT

4.2 ADMINISTRATION OF THE CONTRACT

Delete the first sentence of Paragraph 4.2.7 and replace with the following:

The Architect will review and approve or take other appropriate action upon the Contractor's submittals such as Shop Drawings, Product Data and Samples for the purpose of checking for conformance with the Contract Documents.

Delete the second sentence of Paragraph 4.2.7 and replace with the following:

The Architect's action will be taken with such reasonable promptness as to cause no delay in the Work in the activities of the Owner, Contractor or separate Contractors, while allowing sufficient time in the Owner's professional judgment to permit adequate review.

Add the following Paragraph:

4.2.10.1 There will be no full-time project representative provided by the Owner or Architect on this project.

Add to Paragraph 4.2.13 "and in compliance with all local requirements." to the end of the sentence

ARTICLE 5: SUBCONTRACTORS

5.2 AWARD OF SUBCONTRACTS AND OTHER CONTRACTS FOR PORTIONS OF THE WORK

Delete Paragraph 5.2.3 in its entirety and replace with the following:

5.2.3 If the Owner or Architect has reasonable objection to a person or entity proposed by the Contractor, the Contractor shall propose another to whom the Owner or Architect has no reasonable objection, subject to the statutory requirements of 29 Delaware Code § 6962(d)(10)b.3 and 4.

ARTICLE 6: CONSTRUCTION BY OWNER OR BY SEPARATE CONTRACTORS

6.1 OWNER'S RIGHT TO PERFORM CONSTRUCTION AND TO AWARD SEPARATE CONTRACTS

Delete Paragraph 6.1.4 in its entirety.

6.2 MUTUAL RESPONSIBILITY

6.2.3 In the second sentence, strike the word "shall" and insert the word "may".

ARTICLE 7: CHANGES IN THE WORK

(SEE ARTICLE 7: CHANGES IN WORK IN THE GENERAL REQUIREMENTS)

ARTICLE 8: TIME

8.2 PROGRESS AND COMPLETION

Add the following Paragraphs:

8.2.1.1 Refer to Specification Section SUMMARY OF WORK for Contract time requirements.

8.2.4 If the Work falls behind the Progress Schedule as submitted by the Contractor, the Contractor shall employ additional labor and/or equipment necessary to bring the Work into compliance with the Progress Schedule at no additional cost to the Owner.

8.3 DELAYS AND EXTENSION OF TIME

8.3.1 Strike "arbitration" and insert "remedies at law or in equity".

Add the following Paragraph:

8.3.2.1 The Contractor shall update the status of the suspension, delay, or interruption of the Work with each Application for Payment. (The Contractor shall report the termination of such cause immediately upon the termination thereof.) Failure to comply with this procedure shall constitute a waiver for any claim for adjustment of time or price based upon said cause.

Delete Paragraph 8.3.3 in its entirety and replace with the following:

8.3.3 Except in the case of a suspension of the Work directed by the Owner, an extension of time under the provisions of Paragraph 8.3.1 shall be the Contractor's sole remedy in the progress of the Work and there shall be no payment or compensation to the Contractor for any expense or damage resulting from the delay.

Add the following Paragraph:

8.3.4 By permitting the Contractor to work after the expired time for completion of the project, the Owner does not waive their rights under the Contract.

ARTICLE 9: PAYMENTS AND COMPLETION

9.2 SCHEDULE OF VALUES

Add the following Paragraphs:

9.2.1 The Schedule of Values shall be submitted using AIA Document G702, Continuation Sheet to G703.

9.2.2 The Schedule of Values is to include a line item for Project Closeout Document Submittal. The value of this item is to be no less than 1% of the initial contract amount.

9.3 APPLICATIONS FOR PAYMENT

Add the following Paragraph:

9.3.1.3 Application for Payment shall be submitted on AIA Document G702 "Application and Certificate for Payment", supported by AIA Document G703 "Continuation Sheet". Said Applications shall be fully executed and notarized.

Add the following Paragraphs:

9.3.4 Until Closeout Documents have been received and outstanding items completed the Owner will pay 95% (ninety-five percent) of the amount due the Contractor on account of progress payments.

9.3.5 The Contractor shall provide a current and updated Progress Schedule to the Architect with each Application for Payment. Failure to provide Schedule will be just cause for rejection of Application for Payment.

9.5 DECISIONS TO WITHHOLD CERTIFICATION

Add the following to 9.5.1:

- .8 failure to provide a current Progress Schedule;
- .9 a lien or attachment is filed;
- .10 failure to comply with mandatory requirements for maintaining Record Documents.

9.6 PROGRESS PAYMENTS

Delete Paragraph 9.6.1 in its entirety and replace with the following:

- 9.6.1 After the Architect has approved and issued a Certificate for Payment, payment shall be made by the Owner within 30 days after Owner's receipt of the Certificate for Payment.

9.7 FAILURE OF PAYMENT

In first sentence, strike "seven" and insert "thirty (30)". Also strike "binding dispute resolution" and insert "remedies at law or in equity".

9.8 SUBSTANTIAL COMPLETION

To Subparagraph 9.8.3 - Add the following sentence:

"If the Architect is required to make more than 2 inspections of the same portion of work, the Contractor shall be responsible for all costs associated with subsequent inspections including but not limited to any Architect's fees."

- 9.8.5 In the second sentence, strike "shall" and insert "may".

ARTICLE 10: PROTECTION OF PERSONS AND PROPERTY

10.1 SAFETY PRECAUTIONS AND PROGRAMS

Add the following Paragraphs:

- 10.1.1.1 Each Contractor shall develop a safety program in accordance with the Occupational Safety and Health Act of 1970. A copy of said plan shall be furnished to the Owner and Architect prior to the commencement of that Contractor's Work.

- 10.1.2 Each Contractor shall appoint a Safety Representative. Safety Representatives shall be someone who is on site on a full time basis. If deemed necessary by the Owner or Architect, Contractor Safety meetings will be scheduled. The attendance of all Safety Representatives will be required. Minutes will be recorded of said meetings by the Contractor and will be distributed to all parties as well as posted in all job offices/trailers etc.

10.2 SAFETY OF PERSONS AND PROPERTY

Add the following Paragraph:

- 10.2.4.1 As required in the Hazardous Chemical Act of June 1984, all vendors supplying any material that may be defined as hazardous must provide Material Safety Data Sheets for those products. Any chemical product should be considered hazardous if it has a caution warning on the label relating to a potential physical or health hazard, if it is known to be present in the work place, and if employees may be exposed under normal conditions or in foreseeable emergency situations. Material Safety Data Sheets shall be provided directly to the Owner, along with the shipping slips that include those products.

10.3 HAZARDOUS MATERIALS

Delete Paragraph 10.3.3 in its entirety.

Delete Paragraph 10.3.6 in its entirety.

ARTICLE 11: INSURANCE AND BONDS

11.1 CONTRACTOR'S LIABILITY INSURANCE

11.1.4 Strike "the Owner" immediately following "(1)" and strike "and (2) the Owner as an additional insured for claims caused in whole or in part by the Contractor's negligent acts or omissions during the Contractor's completed operations."

11.2 OWNER'S LIABILITY INSURANCE

Delete Paragraph 11.2 in its entirety.

11.3 PROPERTY INSURANCE

Delete Paragraph 11.3 in its entirety and replace with the following:

11.3 The State will not provide Builder's All Risk Insurance for the Project. The Contractor and all Subcontractors shall provide property coverage for their tools and equipment, as necessary. Any mandatory deductible required by the Contractor's Insurance shall be the responsibility of the Contractor.

11.4 PERFORMANCE BOND AND PAYMENT BOND

11.4.1 Add the following sentence: "The bonds will conform to those forms approved by the Office of Management and Budget."

ARTICLE 12: UNCOVERING AND CORRECTION OF WORK

12.2.2 AFTER SUBSTANTIAL COMPLETION

Add the following Paragraph:

12.2.2.1.1 At any time during the progress of the Work, or in any case where the nature of the defects will be such that it is not expedient to have corrected, the Owner, at its option, will have the right to deduct such sum, or sums, of money from the amount of the Contract as it considers justified to adjust the difference in value between the defective work and that required under contract including any damage to the structure.

12.2.2.1 Strike "one" and insert "two".

12.2.2.2 Strike "one" and insert "two".

12.2.2.3 Strike "one" and insert "two".

12.2.5 In second sentence, strike "one" and insert "two".

ARTICLE 13: MISCELLANEOUS PROVISIONS

13.1 GOVERNING LAW

Strike "except that, if the parties have selected arbitration as the method of binding dispute resolution, the Federal Arbitration Act shall govern Section 15.4."

13.6 INTEREST

Strike "the date payment is due at such rate as the parties may agree upon in writing or, in the absence thereof, at the legal rate prevailing from time to time at the place where the Project is located." Insert "30 days of presentment of the authorized Certificate of Payment at the annual rate of 12% or 1% per month.

13.7 TIME LIMITS ON CLAIMS

Strike the last sentence.

Add the following Paragraph:

13.8 CONFLICTS WITH FEDERAL STATUTES OR REGULATIONS

13.8.1 If any provision, specifications or requirement of the Contract Documents conflict or is inconsistent with any statute, law or regulation of the government of the United State of America, the Contractor shall notify the Architect and Owner immediately upon discovery.

Add the following Paragraph:

13.9 CLOUD-BASED PROJECT MANAGEMENT SYSTEM

13.9.1 The Contractor is responsible for communicating to the Owner and the Architect using the University's Cloud-Based Project Management System for the duration of the contract. The Owner will administer the site and shall provide login credentials to the Contractor following contract award.

ARTICLE 14: TERMINATION OR SUSPENSION OF THE CONTRACT

14.4 TERMINATION BY THE OWNER FOR CONVENIENCE

Delete Paragraph 14.4.3 in its entirety and replace with the following:

14.4.3 In case of such termination for the Owner's convenience, the Contractor shall be entitled to receive payment for Work executed, and cost incurred by reason of such termination along with reasonable overhead.

ARTICLE 15: CLAIMS AND DISPUTES

15.1.2 Throughout the Paragraph strike "21" and insert "45".

15.1.6 CLAIMS FOR CONSEQUENTIAL DAMAGES

Delete Paragraph 15.1.6 in its entirety.

15.2 INITIAL DECISION

Delete Paragraph 15.2.5 in its entirety and replace with the following:

15.2.5 The Architect will approve or reject Claims by written decision, which shall state the reasons therefore and shall notify the parties of any change in the Contract Sum or

Contract Time or both. The approval or rejection of a Claim by the Architect shall be subject to mediation and other remedies at law or in equity.

Delete Paragraph 15.2.6 and its subparagraphs in their entirety.

15.3 MEDIATION

15.3.1 Strike "binding dispute resolution" and insert "any or all remedies at law or in equity".

15.3.2 In the first sentence, delete "administered by the American Arbitration Association in accordance with its Construction Industry Mediation Procedure in effect on the date of the Agreement," Strike "binding dispute resolution" and insert "remedies at law and in equity".

15.4 ARBITRATION

Delete Paragraph 15.4 and its sub-sections in its entirety.

END OF SECTION 00 73 13

GENERAL REQUIREMENTS

TABLE OF ARTICLES

1. GENERAL PROVISIONS
2. OWNER
3. CONTRACTOR
4. ADMINISTRATION OF THE CONTRACT
5. SUBCONTRACTORS
6. CONSTRUCTION BY OWNER OR BY SEPARATE CONTRACTORS
7. CHANGES IN THE WORK
8. TIME
9. PAYMENTS AND COMPLETION
10. PROTECTION OF PERSONS AND PROPERTY
11. INSURANCE AND BONDS
12. UNCOVERING AND CORRECTION OF WORK
13. MISCELLANEOUS PROVISIONS
14. TERMINATION OR SUSPENSION OF THE CONTRACT

ARTICLE 1: GENERAL

1.1 CONTRACT DOCUMENTS

1.1.1 The intent of the Contract Documents is to include all items necessary for the proper execution and completion of the Work by the Contractor. The Contract Documents are complementary and what is required by one shall be as binding as if required by all. Performance by the Contractor shall be required to an extent consistent with the Contract Documents and reasonably inferable from them as being necessary to produce the intended results.

1.1.2 Work including material purchases shall not begin until the Contractor is in receipt of a bonafide State of Delaware Purchase Order. Any work performed or material purchases prior to the issuance of the Purchase Order is done at the Contractor's own risk and cost.

1.2 EQUALITY OF EMPLOYMENT OPPORTUNITY ON PUBLIC WORKS

1.2.1 For Public Works Projects financed in whole or in part by state appropriation the Contractor agrees that during the performance of this contract:

1. The Contractor will not discriminate against any employee or applicant for employment because of race, creed, sex, color, sexual orientation, gender identity or national origin. The Contractor will take positive steps to ensure that applicants are employed and that employees are treated during employment without regard to their race, creed, sex, color, sexual orientation, gender identity or national origin. Such action shall include, but not be limited to, the following: employment, upgrading, demotion or transfer; recruitment or recruitment advertising; layoff or termination; rates of pay or other forms of compensation; and selection for training, including apprenticeship. The Contractor agrees to post in conspicuous places available to employees and applicants for employment notices to be provided by the contracting agency setting forth this nondiscrimination clause.
2. The Contractor will, in all solicitations or advertisements for employees placed by or on behalf of the Contractor, state that all qualified applicants will receive consideration for employment without regard to race, creed, sex, color, sexual orientation, gender identity or national origin."

ARTICLE 2: OWNER

(NO ADDITIONAL GENERAL REQUIREMENTS – SEE SUPPLEMENTARY GENERAL CONDITIONS)

ARTICLE 3: CONTRACTOR

3.1 Schedule of Values: The successful Bidder shall within twenty (20) days after receiving notice to proceed with the work, furnish to the Owner a complete schedule of values on the various items comprising the work.

3.2 Subcontracts: Upon approval of Subcontractors, the Contractor shall award their Subcontracts as soon as possible after the signing of their own contract and see that all material, their own and those of their Subcontractors, are promptly ordered so that the work will not be delayed by failure of materials to arrive on time.

3.3 Before commencing any work or construction, the General Contractor is to consult with the Owner as to matters in connection with access to the site and the allocation of Ground Areas for the various features of hauling, storage, etc.

- 3.4 The Contractor shall supervise and direct the Work, using the Contractor's best skill and attention. The Contractor shall be solely responsible for and have control over construction means, methods, techniques, sequences and procedures and for coordinating all portions of the Work under the Contract, unless the Contract Documents give other specific instructions.
- 3.5 The Contractor shall enforce strict discipline and good order among the Contractor's employees and other persons carrying out the Contract. The Contractor shall not permit employment of unfit persons or persons not skilled in tasks assigned to them.
- 3.6 The Contractor warrants to the Owner that materials and equipment furnished will be new and of good quality, unless otherwise permitted, and that the work will be free from defects and in conformance with the Contract Documents. Work not conforming to these requirements, including substitutions not properly approved, may be considered defective. If required by the Owner, the Contractor shall furnish evidence as to the kind and quality of materials and equipment provided.
- 3.7 Unless otherwise provided, the Contractor shall pay all sales, consumer, use and other similar taxes, and shall secure and pay for required permits, fees, licenses, and inspections necessary for proper execution of the Work.
- 3.8 The Contractor shall comply with and give notices required by laws, ordinances, rules, regulations, and lawful orders of public authorities bearing on performance of the Work. The Contractor shall promptly notify the Owner if the Drawings and Specifications are observed to be at variance therewith.
- 3.9 The Contractor shall be responsible to the Owner for the acts and omissions of the Contractor's employees, Subcontractors and their agents and employees, and other persons performing portions of the Work under contract with the Contractor.
- 3.10 The Contractor shall keep the premises and surrounding area free from accumulation of waste materials or rubbish caused by operations under the Contract. At completion of the Work the Contractor shall remove from and about the Project all waste materials, rubbish, the Contractor's tools, construction equipment, machinery and surplus materials. The Contractor shall be responsible for returning all damaged areas to their original conditions.
- 3.11 STATE LICENSE AND TAX REQUIREMENTS
- 3.11.1 Each Contractor and Subcontractor shall be licensed to do business in the State of Delaware and shall pay all fees and taxes due under State laws. In conformance with Section 2503, Chapter 25, Title 30, Delaware Code, "the Contractor shall furnish the Delaware Department of Finance within ten (10) days after entering into any contract with a contractor or subcontractor not a resident of this State, a statement of total value of such contract or contracts together with the names and addresses of the contracting parties."
- 3.12. The Contractor shall comply with all requirements set forth in Section 6962, Chapter 69, Title 29 of the Delaware Code.

ARTICLE 4: ADMINISTRATION OF THE CONTRACT

- 4.1 CONTRACT SURETY
- 4.1.1 PERFORMANCE BOND AND LABOR AND MATERIAL PAYMENT BOND
- 4.1.2 All bonds will be required as follows unless specifically waived elsewhere in the Bidding Documents.
- 4.1.3 Contents of Performance Bonds – The bond shall be in the form approved by the Office of Management and Budget. The bond shall be conditioned upon the faithful compliance and performance by the successful bidder of each and every term and condition of the contract and the

proposal, plans, specifications, and bid documents thereof. Each term and condition shall be met at the time and in the manner prescribed by the Contract, Bid documents and the specifications, including the payment in full to every person furnishing material or performing labor in the performance of the Contract, of all sums of money due the person for such labor and material. (The bond shall also contain the successful bidder's guarantee to indemnify and save harmless the State and the agency from all costs, damages and expenses growing out of or by reason of the Contract in accordance with the Contract.)

4.1.4 Invoking a Performance Bond – The agency may, when it considers that the interest of the State so require, cause judgement to be confessed upon the bond.

4.1.5 Within twenty (20) days after the date of notice of award of contract, the Bidder to whom the award is made shall furnish a Performance Bond and Labor and Material Payment Bond, each equal to the full amount of the Contract price to guarantee the faithful performance of all terms, covenants and conditions of the same. The bonds are to be issued by an acceptable Bonding Company licensed to do business in the State of Delaware and shall be issued in duplicate.

4.1.6 Performance and Payment Bonds shall be maintained in full force (warranty bond) for a period of two (2) years after the date of the Certificate for Final Payment. The Performance Bond shall guarantee the satisfactory completion of the Project and that the Contractor will make good any faults or defects in his work which may develop during the period of said guarantees as a result of improper or defective workmanship, material or apparatus, whether furnished by themselves or their Sub-Contractors. The Payment Bond shall guarantee that the Contractor shall pay in full all persons, firms or corporations who furnish labor or material or both labor and material for, or on account of, the work included herein. The bonds shall be paid for by this Contractor. The Owner shall have the right to demand that the proof parties signing the bonds are duly authorized to do so.

4.2 FAILURE TO COMPLY WITH CONTRACT

4.2.1 If any firm entering into a contract with the State, or Agency that neglects or refuses to perform or fails to comply with the terms thereof, the Agency which signed the Contract may terminate the Contract and proceed to award a new contract in accordance with this Chapter 69, Title 29 of the Delaware Code or may require the Surety on the Performance Bond to complete the Contract in accordance with the terms of the Performance Bond. Nothing herein shall preclude the Agency from pursuing additional remedies as otherwise provided by law.

4.3 CONTRACT INSURANCE AND CONTRACT LIABILITY

4.3.1 In addition to the bond requirements stated in the Bid Documents, each successful Bidder shall purchase adequate insurance for the performance of the Contract and, by submission of a Bid, agrees to indemnify and save harmless and to defend all legal or equitable actions brought against the State, any Agency, officer and/or employee of the State, for and from all claims of liability which is or may be the result of the successful Bidder's actions during the performance of the Contract.

4.3.2 The purchase or nonpurchase of such insurance or the involvement of the successful Bidder in any legal or equitable defense of any action brought against the successful Bidder based upon work performed pursuant to the Contract will not waive any defense which the State, its agencies and their respective officers, employees and agents might otherwise have against such claims, specifically including the defense of sovereign immunity, where applicable, and by the terms of this section, the State and all agencies, officers and employees thereof shall not be financially responsible for the consequences of work performed, pursuant to said contract.

4.4 RIGHT TO AUDIT RECORDS

- 4.4.1 The Owner shall have the right to audit the books and records of a Contractor or any Subcontractor under any Contract or Subcontract to the extent that the books and records relate to the performance of the Contract or Subcontract.
- 4.4.2 Said books and records shall be maintained by the Contractor for a period of seven (7) years from the date of final payment under the Prime Contract and by the Subcontractor for a period of seven (7) years from the date of final payment under the Subcontract.

ARTICLE 5: SUBCONTRACTORS

5.1 SUBCONTRACTING REQUIREMENTS

- 5.1.1 All contracts for the construction, reconstruction, alteration or repair of any public building (not a road, street or highway) shall be subject to the following provisions:
1. A contract shall be awarded only to a Bidder whose Bid is accompanied by a statement containing, for each Subcontractor category, the name and address (city or town and State only – street number and P.O. Box addresses not required) of the subcontractor whose services the Bidder intends to use in performing the Work and providing the material for such Subcontractor category.
 2. A Bid will not be accepted nor will an award of any Contract be made to any Bidder which, as the Prime Contractor, has listed itself as the Subcontractor for any Subcontractor unless:
 - A. It has been established to the satisfaction of the awarding Agency that the Bidder has customarily performed the specialty work of such Subcontractor category by artisans regularly employed by the Bidder's firm;
 - B. That the Bidder is duly licensed by the State to engage in such specialty work, if the State requires licenses; and
 - C. That the Bidder is recognized in the industry as a bona fide Subcontractor or Contractor in such specialty work and Subcontractor category.
- 5.1.2 The decision of the awarding Agency as to whether a Bidder who list itself as the Subcontractor for a Subcontractor category shall be final and binding upon all Bidders, and no action of any nature shall lie against any awarding agency or its employees or officers because of its decision in this regard.
- 5.1.3 After such a Contract has been awarded, the successful Bidder shall not substitute another Subcontractor for any Subcontractor whose name was set forth in the statement which accompanied the Bid without the written consent of the awarding Agency.
- 5.1.4 No Agency shall consent to any substitution of Subcontractors unless the Agency is satisfied that the Subcontractor whose name is on the Bidders accompanying statement:
- A. Is unqualified to perform the work required;
 - B. Has failed to execute a timely reasonable Subcontract;
 - C. Has defaulted in the performance on the portion of the work covered by the Subcontract; or
 - D. Is no longer engaged in such business.

5.1.5 Should a Bidder be awarded a contract, such successful Bidder shall provide to the agency the taxpayer identification license numbers of such subcontractors. Such numbers shall be provided on the later of the date on which such subcontractor is required to be identified or the time the contract is executed. The successful Bidder shall provide to the agency to which it is contracting, within 30 days of entering into such public works contract, copies of all Delaware Business licenses of subcontractors and/or independent contractors that will perform work for such public works contract. However, if a subcontractor or independent contractor is hired or contracted more than 20 days after the Bidder entered the public works contract the Delaware Business license of such subcontractor or independent contractor shall be provided to the agency within 10 days of being contracted or hired.

5.2 PENALTY FOR SUBSTITUTION OF SUBCONTRACTORS

5.2.1 Should the Contractor fail to utilize any or all of the Subcontractors in the Contractor's Bid statement in the performance of the Work on the public bidding, the Contractor shall be penalized in the amount of (project specific amount*). The Agency may determine to deduct payments of the penalty from the Contractor or have the amount paid directly to the Agency. Any penalty amount assessed against the Contractor may be remitted or refunded, in whole or in part, by the Agency awarding the Contract, only if it is established to the satisfaction of the Agency that the Subcontractor in question has defaulted or is no longer engaged in such business. No claim for the remission or refund of any penalty shall be granted unless an application is filed within one year after the liability of the successful Bidder accrues. All penalty amounts assessed and not refunded or remitted to the contractor shall be reverted to the State.

*one (1) percent of contract amount not to exceed \$10,000

5.3 ASBESTOS ABATEMENT

5.3.1 The selection of any Contractor to perform asbestos abatement for State-funded projects shall be approved by the Office of Management and Budget, Division of Facilities Management pursuant to Chapter 78 of Title 16.

5.4 STANDARDS OF CONSTRUCTION FOR THE PROTECTION OF THE PHYSICALLY HANDICAPPED

5.4.1 All Contracts shall conform with the standard established by the Delaware Architectural Accessibility Board unless otherwise exempted by the Board.

5.5 CONTRACT PERFORMANCE

5.5.1 Any firm entering into a Public Works Contract that neglects or refuses to perform or fails to comply with its terms, the Agency may terminate the Contract and proceed to award a new Contract or may require the Surety on the Performance Bond to complete the Contract in accordance with the terms of the Performance Bond.

ARTICLE 6: CONSTRUCTION BY OWNER OR SEPARATE CONTRACTORS

6.1 The Owner reserves the right to simultaneously perform other construction or operations related to the Project with the Owner's own forces, and to award separate contracts in connection with other portions of the Project or other Projects at the same site.

6.2 The Contractor shall afford the Owner and other Contractors reasonable opportunity for access and storage of materials and equipment, and for the performance of their activities, and shall connect and coordinate their activities with other forces as required by the Contract Documents.

ARTICLE 7: CHANGES IN THE WORK

- 7.1 The Owner, without invalidating the Contract, may order changes in the Work consisting of Additions, Deletions, Modifications or Substitutions, with the Contract Sum and Contract completion date being adjusted accordingly. Such changes in the Work shall be authorized by written Change Order signed by the Professional, as the duly authorized agent, the Contractor and the Owner.
- 7.2 The Contract Sum and Contract Completion Date shall be adjusted only by a fully executed Change Order.
- 7.3 The additional cost, or credit to the Owner resulting from a change in the Work shall be by mutual agreement of the Owner, Contractor and the Architect. In all cases, this cost or credit shall be based on the 'DPE' wages required and the "invoice price" of the materials/equipment needed.
- 7.3.1 "DPE" shall be defined to mean "direct personnel expense". Direct payroll expense includes direct salary plus customary fringe benefits (prevailing wage rates) and documented statutory costs such as workman's compensation insurance, Social Security/Medicare, and unemployment insurance (a maximum multiplier of 1.35 times DPE).
- 7.3.2 "Invoice price" of materials/equipment shall be defined to mean the actual cost of materials and/or equipment that is paid by the Contractor, (or subcontractor), to a material distributor, direct factory vendor, store, material provider, or equipment leasing entity. Rates for equipment that is leased and/or owned by the Contractor or subcontractor(s) shall not exceed those listed in the latest version of the "Means Building Construction Cost Data" publication.
- 7.3.3 In addition to the above, the General Contractor is allowed a fifteen percent (15%) markup for overhead and profit for additional work performed by the General Contractor's own forces. For additional subcontractor work, the Subcontractor is allowed a fifteen (15) percent overhead and profit on change order work above and beyond the direct costs stated previously. To this amount, the General Contractor will be allowed a mark-up not exceeding seven and one half percent (7.5%) on the subcontractors work. These mark-ups shall include all costs including, but not limited to: overhead, profit, bonds, insurance, supervision, etc. No markup is permitted on the work of the subcontractors subcontractor. No additional costs shall be allowed for changes related to the Contractor's onsite superintendent/staff, or project manager, unless a change in the work changes the project duration and is identified by the CPM schedule. There will be no other costs associated with the change order.

ARTICLE 8: TIME

- 8.1 Time limits, if any, are as stated in the Project Manual. By executing the Agreement, the Contractor confirms that the stipulated limits are reasonable, and that the Work will be completed within the anticipated time frame.
- 8.2 If progress of the Work is delayed at any time by changes ordered by the Owner, by labor disputes, fire, unusual delay in deliveries, abnormal adverse weather conditions, unavoidable casualties or other causes beyond the Contractor's control, the Contract Time shall be extended for such reasonable time as the Owner may determine.
- 8.3 Any extension of time beyond the date fixed for completion of the construction and acceptance of any part of the Work called for by the Contract, or the occupancy of the building by the Owner, in whole or in part, previous to the completion shall not be deemed a waiver by the Owner of his right to annul or terminate the Contract for abandonment or delay in the matter provided for, nor relieve the Contractor of full responsibility.
- 8.4 **SUSPENSION AND DEBARMENT**
- 8.4.1 Per Section 6962(d)(14), Title 29, Delaware Code, "Any Contractor who fails to perform a public works contract or complete a public works project within the time schedule established by the Agency in the

Invitation To Bid, may be subject to Suspension or Debarment for one or more of the following reasons: a) failure to supply the adequate labor supply ratio for the project; b) inadequate financial resources; or, c) poor performance on the Project.”

8.4.2 “Upon such failure for any of the above stated reasons, the Agency that contracted for the public works project may petition the Director of the Office of Management and Budget for Suspension or Debarment of the Contractor. The Agency shall send a copy of the petition to the Contractor within three (3) working days of filing with the Director. If the Director concludes that the petition has merit, the Director shall schedule and hold a hearing to determine whether to suspend the Contractor, debar the Contractor or deny the petition. The Agency shall have the burden of proving, by a preponderance of the evidence, that the Contractor failed to perform or complete the public works project within the time schedule established by the Agency and failed to do so for one or more of the following reasons: a) failure to supply the adequate labor supply ratio for the project; b) inadequate financial resources; or, c) poor performance on the project. Upon a finding in favor of the Agency, the Director may suspend a Contractor from Bidding on any project funded, in whole or in part, with public funds for up to 1 year for a first offense, up to 3 years for a second offense and permanently debar the Contractor for a third offense. The Director shall issue a written decision and shall send a copy to the Contractor and the Agency. Such decision may be appealed to the Superior Court within thirty (30) days for a review on the record.”

8.5 RETAINAGE

8.5.1 Per Section 6962(d)(5) a.3, Title 29, Delaware Code: The Agency may at the beginning of each public works project establish a time schedule for the completion of the project. If the project is delayed beyond the completion date due to the Contractor's failure to meet their responsibilities, the Agency may forfeit, at its discretion, all or part of the Contractor's retainage.

8.5.2 This forfeiture of retainage also applies to the timely completion of the punchlist. A punchlist will only be prepared upon the mutual agreement of the Owner, Architect and Contractor. Once the punchlist is prepared, all three parties will by mutual agreement, establish a schedule for its completion. Should completion of the punchlist be delayed beyond the established date due to the Contractor's failure to meet their responsibilities, the Agency may hold permanently, at its discretion, all or part of the Contractor's retainage.

ARTICLE 9: PAYMENTS AND COMPLETION

9.1 APPLICATION FOR PAYMENT

9.1.1 Applications for payment shall be made upon AIA Document G702. There will be a five percent (5%) retainage on all Contractor's monthly invoices until completion of the project. This retainage may become payable upon receipt of all required closeout documentation, provided all other requirements of the Contract Documents have been met.

9.1.2 A date will be fixed for the taking of the monthly account of work done. Upon receipt of Contractor's itemized application for payment, such application will be audited, modified, if found necessary, and approved for the amount. Statement shall be submitted to the Owner.

9.1.3 Section 6516, Title 29 of the Delaware Code annualized interest is not to exceed 12% per annum beginning thirty (30) days after the “presentment” (as opposed to the date) of the invoice.

9.2 PARTIAL PAYMENTS

9.2.1 Any public works Contract executed by any Agency may provide for partial payments at the option of the Owner with respect to materials placed along or upon the sites or stored at secured locations, which are suitable for use in the performance of the contract.

- 9.2.2 When approved by the agency, partial payment may include the values of tested and acceptable materials of a nonperishable or noncontaminative nature which have been produced or furnished for incorporation as a permanent part of the work yet to be completed, provided acceptable provisions have been made for storage.
- 9.2.2.1 Any allowance made for materials on hand will not exceed the delivered cost of the materials as verified by invoices furnished by the Contractor, nor will it exceed the contract bid price for the material complete in place.
- 9.2.3 If requested by the Agency, receipted bills from all Contractors, Subcontractors, and material, men, etc., for the previous payment must accompany each application for payment. Following such a request, no payment will be made until these receipted bills have been received by the Owner.
- 9.3 SUBSTANTIAL COMPLETION
- 9.3.1 When the building has been made suitable for occupancy, but still requires small items of miscellaneous work, the Owner will determine the date when the project has been substantially completed.
- 9.3.2 If, after the Work has been substantially completed, full completion thereof is materially delayed through no fault of the Contractor, and without terminating the Contract, the Owner may make payment of the balance due for the portion of the Work fully completed and accepted. Such payment shall be made under the terms and conditions governing final payment that it shall not constitute a waiver of claims.
- 9.3.3 On projects where commissioning is included, the commissioning work as defined in the specifications must be complete prior to the issuance of substantial completion.
- 9.4 FINAL PAYMENT
- 9.4.1 Final payment, including the five percent (5%) retainage if determined appropriate, shall be made within thirty (30) days after the Work is fully completed and the Contract fully performed and provided that the Contractor has submitted the following closeout documentation (in addition to any other documentation required elsewhere in the Contract Documents):
- 9.4.1.1 Evidence satisfactory to the Owner that all payrolls, material bills, and other indebtedness connected with the work have been paid,
- 9.4.1.2 An acceptable RELEASE OF LIENS,
- 9.4.1.3 Copies of all applicable warranties,
- 9.4.1.4 As-built drawings,
- 9.4.1.5 Operations and Maintenance Manuals,
- 9.4.1.6 Instruction Manuals,
- 9.4.1.7 Consent of Surety to final payment.
- 9.4.1.8 The Owner reserves the right to retain payments, or parts thereof, for its protection until the foregoing conditions have been complied with, defective work corrected and all unsatisfactory conditions remedied.

ARTICLE 10: PROTECTION OF PERSONS AND PROPERTY

- 10.1 The Contractor shall be responsible for initiating, maintaining, and supervising all safety precautions and programs in connection with the performance of the Contract. The Contractor shall take all reasonable precautions to prevent damage, injury or loss to: workers, persons nearby who may be affected, the Work, materials and equipment to be incorporated, and existing property at the site or adjacent thereto. The Contractor shall give notices and comply with applicable laws ordinances, rules regulations, and lawful orders of public authorities bearing on the safety of persons and property and their protection from injury, damage, or loss. The Contractor shall promptly remedy damage and loss to property at the site caused in whole or in part by the Contractor, a Subcontractor, or anyone directly or indirectly employed by any of them, or by anyone for whose acts they may be liable.
- 10.2 The Contractor shall notify the Owner in the event any existing hazardous material such as lead, PCBs, asbestos, etc. is encountered on the project. The Owner will arrange with a qualified specialist for the identification, testing, removal, handling and protection against exposure or environmental pollution, to comply with applicable regulation laws and ordinances. The Contractor and Architect will not be required to participate in or to perform this operation. Upon completion of this work, the Owner will notify the Contractor and Architect in writing the area has been cleared and approved by the authorities in order for the work to proceed. The Contractor shall attach documentation from the authorities of said approval.
- 10.3 As required in the Hazardous Chemical Information Act of June 1984, all vendors supplying any materials that may be defined as hazardous, must provide Material Safety Data Sheets for those products. Any chemical product should be considered hazardous if it has a warning caution on the label relating to a potential physical or health hazard, if it is known to be present in the work place, and if employees may be exposed under normal conditions or in any foreseeable emergency situation. Material Safety Data Sheets must be provided directly to the Owner along with the shipping slips that include those products.
- 10.4 The Contractor shall certify to the Owner that materials incorporated into the Work are free of all asbestos. This certification may be in the form of Material Safety Data Sheet (MSDS) provided by the product manufacturer for the materials used in construction, as specified or as provided by the Contractor.

ARTICLE 11: INSURANCE AND BONDS

- 11.1 The Contractor shall carry all insurance required by law, such as Unemployment Insurance, etc. The Contractor shall carry such insurance coverage as they desire on their own property such as a field office, storage sheds or other structures erected upon the project site that belong to them and for their own use. The Subcontractors involved with this project shall carry whatever insurance protection they consider necessary to cover the loss of any of their personal property, etc.
- 11.2 Upon being awarded the Contract, the Contractor shall obtain a minimum of two (2) copies of all required insurance certificates called for herein, and submit one (1) copy of each certificate, to the Owner, within 20 days of contract award.
- 11.3 Bodily Injury Liability and Property Damage Liability Insurance shall, in addition to the coverage included herein, include coverage for injury to or destruction of any property arising out of the collapse of or structural injury to any building or structure due to demolition work and evidence of these coverages shall be filed with and approved by the Owner.
- 11.4 The Contractor's Property Damage Liability Insurance shall, in addition to the coverage noted herein, include coverage on all real and personal property in their care, custody and control damaged in any way by the Contractor or their Subcontractors during the entire construction period on this project.
- 11.5 Builders Risk (including Standard Extended Coverage Insurance) on the existing building during the entire construction period, shall not be provided by the Contractor under this contract. The Owner shall insure the existing building and all of its contents and all this new alteration work under this

contract during entire construction period for the full insurable value of the entire work at the site. Note, however, that the Contractor and their Subcontractors shall be responsible for insuring building materials (installed and stored) and their tools and equipment whenever in use on the project, against fire damage, theft, vandalism, etc.

11.6 Certificates of the insurance company or companies stating the amount and type of coverage, terms of policies, etc., shall be furnished to the Owner, within 20 days of contract award.

11.7 The Contractor shall, at their own expense, (in addition to the above) carry the following forms of insurance:

11.7.1 Contractor's Contractual Liability Insurance

Minimum coverage to be:

Bodily Injury	\$500,000 \$1,000,000 \$2,000,000	for each person for each occurrence aggregate
Property Damage	\$1,000,000 \$2,000,000	for each occurrence aggregate

11.7.2 Contractor's Protective Liability Insurance

Minimum coverage to be:

Bodily Injury	\$500,000 \$1,000,000 \$2,000,000	for each person for each occurrence aggregate
Property Damage	\$500,000 \$500,000	for each occurrence aggregate

11.7.3 Automobile Liability Insurance

Minimum coverage to be:

Bodily Injury	\$1,000,000 \$1,000,000	for each person for each occurrence
Property Damage	\$500,000	per accident

11.7.4 Prime Contractor's and Subcontractors' policies shall include contingent and contractual liability coverage in the same minimum amounts as 11.7.1 above.

11.7.5 Workmen's Compensation (including Employer's Liability):

11.7.5.1 Minimum Limit on employer's liability to be as required by law.

11.7.5.2 Minimum Limit for all employees working at one site.

11.7.6 Certificates of Insurance must be filed with the Owner guaranteeing fifteen (15) days prior notice of cancellation, non-renewal, or any change in coverages and limits of liability shown as included on certificates.

11.7.7 Social Security Liability

- 11.7.7.1 With respect to all persons at any time employed by or on the payroll of the Contractor or performing any work for or on their behalf, or in connection with or arising out of the Contractor's business, the Contractor shall accept full and exclusive liability for the payment of any and all contributions or taxes or unemployment insurance, or old age retirement benefits, pensions or annuities now or hereafter imposed by the Government of the United States and the State or political subdivision thereof, whether the same be measured by wages, salaries or other remuneration paid to such persons or otherwise.
- 11.7.7.2 Upon request, the Contractor shall furnish Owner such information on payrolls or employment records as may be necessary to enable it to fully comply with the law imposing the aforesaid contributions or taxes.
- 11.7.7.3 If the Owner is required by law to and does pay any and/or all of the aforesaid contributions or taxes, the Contractor shall forthwith reimburse the Owner for the entire amount so paid by the Owner.

ARTICLE 12: UNCOVERING AND CORRECTION OF WORK

- 12.1 The Contractor shall promptly correct Work rejected by the Owner or failing to conform to the requirements of the Contract Documents, whether observed before or after Substantial Completion and whether or not fabricated, installed or completed, and shall correct any Work found to be not in accordance with the requirements of the Contract Documents within a period of two years from the date of Substantial Completion, or by terms of an applicable special warranty required by the Contract Documents. The provisions of this Article apply to work done by Subcontractors as well as to Work done by direct employees of the Contractor.
- 12.2 At any time during the progress of the work, or in any case where the nature of the defects shall be such that it is not expedient to have them corrected, the Owner, at their option, shall have the right to deduct such sum, or sums, of money from the amount of the contract as they consider justified to adjust the difference in value between the defective work and that required under contract including any damage to the structure.

ARTICLE 13: MISCELLANEOUS PROVISIONS

- 13.1 CUTTING AND PATCHING
 - 13.1.1 The Contractor shall be responsible for all cutting and patching. The Contractor shall coordinate the work of the various trades involved.
- 13.2 DIMENSIONS
 - 13.2.1 All dimensions shown shall be verified by the Contractor by actual measurements at the project site. Any discrepancies between the drawings and specifications and the existing conditions shall be referred to the Owner for adjustment before any work affected thereby has been performed.
- 13.3 LABORATORY TESTS
 - 13.3.1 Any specified laboratory tests of material and finished articles to be incorporated in the work shall be made by bureaus, laboratories or agencies approved by the Owner and reports of such tests shall be submitted to the Owner. The cost of the testing shall be paid for by the Contractor.
 - 13.3.2 The Contractor shall furnish all sample materials required for these tests and shall deliver same without charge to the testing laboratory or other designated agency when and where directed by the Owner.
- 13.4 ARCHAEOLOGICAL EVIDENCE
 - 13.4.1 Whenever, in the course of construction, any archaeological evidence is encountered on the surface or below the surface of the ground, the Contractor shall notify the authorities of the Delaware Archaeological Board and suspend work in the immediate area for a reasonable time to permit those

authorities, or persons designated by them, to examine the area and ensure the proper removal of the archaeological evidence for suitable preservation in the State Museum.

13.5 GLASS REPLACEMENT AND CLEANING

13.5.1 The General Contractor shall replace without expense to the Owner all glass broken during the construction of the project. If job conditions warrant, at completion of the job the General Contractor shall have all glass cleaned and polished.

13.6 WARRANTY

13.6.1 For a period of two (2) years from the date of substantial completion, as evidenced by the date of final acceptance of the work, the contractor warrants that work performed under this contract conforms to the contract requirements and is free of any defect of equipment, material or workmanship performed by the contractor or any of his subcontractors or suppliers. However, manufacturer's warranties and guarantees, if for a period longer than two (2) years, shall take precedence over the above warranties. The contractor shall remedy, at his own expense, any such failure to conform or any such defect. The protection of this warranty shall be included in the Contractor's Performance Bond.

ARTICLE 14: TERMINATION OF CONTRACT

14.1 If the Contractor defaults or persistently fails or neglects to carry out the Work in accordance with the Contract Documents or fails to perform a provision of the Contract, the Owner, after seven days written notice to the Contractor, may make good such deficiencies and may deduct the cost thereof from the payment then or thereafter due the Contractor. Alternatively, at the Owner's option, and the Owner may terminate the Contract and take possession of the site and of all materials, equipment, tools, and machinery thereon owned by the Contractor and may finish the Work by whatever method the Owner may deem expedient. If the costs of finishing the Work exceed any unpaid compensation due the Contractor, the Contractor shall pay the difference to the Owner.

14.2 "If the continuation of this Agreement is contingent upon the appropriation of adequate state, or federal funds, this Agreement may be terminated on the date beginning on the first fiscal year for which funds are not appropriated or at the exhaustion of the appropriation. The Owner may terminate this Agreement by providing written notice to the parties of such non-appropriation. All payment obligations of the Owner will cease upon the date of termination. Notwithstanding the foregoing, the Owner agrees that it will use its best efforts to obtain approval of necessary funds to continue the Agreement by taking appropriate action to request adequate funds to continue the Agreement."

END OF SECTION 00 81 13

EMPLOYEE DRUG TESTING REPORT FORM

Period Ending: _____

4104 Regulations for the Drug Testing of Contractor and Subcontractor Employees Working on Large Public Works Projects requires that Contractors and Subcontractors who work on Large Public Works Contracts funded all or in part with public funds submit Testing Report Forms to the Owner no less than quarterly.

Project Number: _____

Project Name: _____

Contractor/Subcontractor Name: _____

Contractor/Subcontractor Address: _____

Number of employees who worked on the jobsite during the report period: _____

Number of employees subject to random testing during the report period: _____

Number of Negative Results _____ Number of Positive Results _____

Action taken on employee(s) in response to a failed or positive random test:

Authorized Representative of Contractor/Subcontractor: _____
(typed or printed)

Authorized Representative of Contractor/Subcontractor: _____
(signature)

Date: _____

EMPLOYEE DRUG TESTING
REPORT OF POSITIVE RESULTS

4104 Regulations for the Drug Testing of Contractor and Subcontractor Employees Working on Large Public Works Projects requires that Contractors and Subcontractors who work on Large Public Works Contracts funded all or in part with public funds to notify the Owner in writing of a positive random drug test.

Project Number: _____

Project Name: _____

Contractor/Subcontractor Name: _____

Contractor/Subcontractor Address: _____

Name of employee with positive test result: _____

Last 4 digits of employee SSN: _____

Date test results received: _____

Action taken on employee in response to a positive test result:

Authorized Representative of Contractor/Subcontractor: _____
(typed or printed)

Authorized Representative of Contractor/Subcontractor: _____
(signature)

Date: _____

This form shall be sent by mail to the Owner within 24 hours of receipt of test results.

Enclose this test results form in a sealed envelope with the notation "Drug Testing Form – DO NOT OPEN" on the face thereof and place in a separate mailing envelope.

SECTION 00 01 10
TABLE OF CONTENTS

PROCUREMENT AND CONTRACTING REQUIREMENTS

1.01 DIVISION 00 -- PROCUREMENT AND CONTRACTING REQUIREMENTS

- A. 00 01 10 - Table of Contents
- B. 00 01 15 - List of Drawing Sheets

SPECIFICATIONS

2.01 DIVISION 01 -- GENERAL REQUIREMENTS

- A. 01 10 00 - Summary
- B. 01 20 00 - Price and Payment Procedures
- C. 01 30 00 - Administrative Requirements
- D. 01 40 00 - Quality Requirements
- E. 01 42 16 - Definitions
- F. 01 50 00 - Temporary Facilities and Controls
- G. 01 60 00 - Product Requirements
- H. 01 70 00 - Execution and Closeout Requirements
- I. 01 74 19 - Construction Waste Management and Disposal
- J. 01 79 00 - Demonstration and Training

2.02 DIVISION 02 -- EXISTING CONDITIONS

- A. 02 41 00 - Demolition

2.03 DIVISION 03 -- CONCRETE

- A. 03 30 00 - Cast-in-Place Concrete
- B. 03 35 23 - Exposed Aggregate Concrete Finishing

2.04 DIVISION 04 -- MASONRY

- A. 04 05 11 - Masonry Mortaring and Grouting
- B. 04 20 00 - Unit Masonry

2.05 DIVISION 05 -- METALS

- A. 05 50 00 - Metal Fabrications

2.06 DIVISION 06 -- WOOD, PLASTICS, AND COMPOSITES

- A. 06 10 00 - Rough Carpentry

2.07 DIVISION 07 -- THERMAL AND MOISTURE PROTECTION

- A. 07 84 00 - Firestopping
- B. 07 90 05 - Joint Sealers

2.08 DIVISION 09 -- FINISHES

- A. 09 21 16 - Gypsum Board Assemblies
- B. 09 51 00 - Acoustical Ceilings
- C. 09 90 00 - Painting and Coating

2.09 DIVISION 22 -- PLUMBING

- A. 22 10 05 - Plumbing Piping

2.10 DIVISION 23 -- HEATING, VENTILATING, AND AIR-CONDITIONING (HVAC)

- A. 23 05 53 - Identification for HVAC Piping and Equipment
- B. 23 05 93 - Testing, Adjusting, and Balancing for HVAC
- C. 23 07 13 - Duct Insulation
- D. 23 09 13 - Instrumentation and Control Devices for HVAC
- E. 23 09 23 - Direct-Digital Control System for HVAC
- F. 23 09 93 - Sequence of Operations for HVAC Controls
- G. 23 31 00 - HVAC Ducts and Casings
- H. 23 33 00 - Air Duct Accessories
- I. 23 74 13 - Packaged Outdoor Central-Station Air-Handling Units

2.11 DIVISION 26 -- ELECTRICAL

- A. 26 05 01 - Minor Electrical Demolition
- B. 26 05 19 - Low-Voltage Electrical Power Conductors and Cables
- C. 26 05 26 - Grounding and Bonding for Electrical Systems
- D. 26 05 29 - Hangers and Supports for Electrical Systems
- E. 26 05 34 - Conduit
- F. 26 05 37 - Boxes
- G. 26 05 53 - Identification for Electrical Systems
- H. 26 24 16 - Panelboards
- I. 26 27 17 - Equipment Wiring
- J. 26 27 26 - Wiring Devices
- K. 26 28 13 - Fuses
- L. 26 28 18 - Enclosed Switches

2.12 DIVISION 32 -- EXTERIOR IMPROVEMENTS

- A. 32 31 13 - Chain Link Fences and Gates

END OF TABLE OF CONTENTS

SECTION 00 01 15
LIST OF DRAWING SHEETS

G1.0 PROJECT COVER SHEET

A3.1 ARCHITECTURAL SITE PLANS

M8.0 MECHANICAL COVER SHEET & SCHEDULES

M8.1 MECHANICAL DEMOLITION AND RENOVATION PLANS

M8.2 MECHANICAL CONTROLS SCHEMATIC

E9.0 ELECTRICAL COVER SHEET & SCHEDULES

E9.1 ELECTRICAL PLANS

END OF SECTION

SECTION 01 10 00

SUMMARY

PART 1 GENERAL

1.01 PROJECT

- A. Project Name: Student Health Center AHU Replacement.
- B. Owner's Name: Delaware State University.
- C. Architect / Engineer's Name: Studio JAED
- D. The Project consists of:
 - 1. Demolition of existing HVAC System.
 - 2. Installation of new HVAC Equipment, Ductwork and Appurtenances.
 - 3. Selective demolition and installation of architectural features as required for completion of mechanical work, including patching and painting.
 - 4. Electrical modifications to support mechanical work.

1.02 CONTRACT DESCRIPTION

- A. Contract Type: A single prime contract based on a Stipulated Price as described in Division 00.

1.03 DESCRIPTION OF ALTERATIONS WORK

- A. Scope of demolition and removal work is shown on drawings and included in specifications.
- B. Scope of renovation work is shown on drawings and included in specifications.
- C. HVAC: Replace existing system with new construction.
- D. Electrical Power and Lighting: Alter existing system and add new construction, keeping existing in operation.
- E. Fire Alarm: Alter existing system and add new construction, keeping existing in operation.

1.04 WORK BY OWNER

- A. None.

1.05 OWNER OCCUPANCY

- A. Owner intends to continue to occupy portions of the existing building during the entire construction period.
- B. Cooperate with Owner to minimize conflict and to facilitate Owner's operations.
- C. Schedule the Work to accommodate Owner's occupancy.

1.06 CONTRACTOR USE OF SITE AND PREMISES

- A. Construction Operations: Limited to the building premises, and surrounding areas.
- B. This project will require electrical shutdowns to facilitate the installation of the new units. The work must be coordinated with the Owner's schedule, and work related to electrical shutdowns is to be performed during evening or weekend hours -- at owner's discretion.
- C. Provide access to and from site as required by law and by Owner:
 - 1. Emergency Building Exits During Construction: Keep all exits required by code open during construction period; provide temporary exit signs if exit routes are temporarily altered.
 - 2. Do not obstruct roadways, sidewalks, or other public ways without permit.
 - 3. Adhere to owner's guidelines regarding entrance and egress to the site as identified during the pre-bid meeting.
- D. Utility Outages and Shutdown:

1. Coordinate any interruption and/or shutdown of utilities with the owner at least 7 days in advance of the anticipated interruption and/or shutdown. Limit any interruptions/shutdowns to the absolute minimum amount of time.
2. The owner reserves the right to reschedule construction shutdowns with minimal warning to the contractor as required to respond to emergencies.

1.07 GENERAL STANDARDS

A. General Work Requirements:

1. Notify the owner in the event any existing hazardous materials, such as asbestos, pcb's, lead, etc., are encountered on the project. The owner will arrange with a qualified specialist for the identification, testing, removal, handling and protection against exposure or environmental pollution, to comply with applicable regulations, laws and ordinances.
2. Prior to submitting bid, the contractor shall visit the site and be thoroughly familiar with the existing conditions and proposed construction. Contractor shall include in their bid all material, labor, and all incidentals for a complete installation whether specifically indicated or not. All errors, discrepancies and missed items shall be brought to the attention of the engineer during the bidding process by the contractor. These items shall be included in the bid price. No extra cost will be allowed for any discrepancy which could have been noticed at the site visit by the contractor.
3. Perform work as required by applicable codes, regulations, and laws of local, state, and federal governments and other authorities with lawful jurisdiction. All work shall be in accordance with the latest edition of the national electric code.
4. Material and equipment shall be UL, NEMA, ANSI, IEEE, ADA & CMB approved for intended purpose. Material and installation shall meet requirements of national and local electrical code.
5. Provide all labor, materials, tools, equipment, coordination, additional design and all incidentals necessary to provide a complete and operable system as detailed on plans to the satisfaction of the engineer and the owner. Coordinate all work with the engineer before the start of work.
6. Prior to submitting bid, the contractor shall visit the site and be thoroughly familiar with the existing conditions and proposed construction. Contractor shall include in their bid all material, labor, and all incidentals for a complete installation whether specifically indicated or not. All errors, discrepancies and missed items shall be brought to the attention of the engineer during the bidding process by the contractor. These items shall be included in the bid price. No extra cost will be allowed for any discrepancy which could have been noticed at the site visit by the contractor.
7. Perform work as required by applicable codes, regulations, and laws of local, state, and federal governments and other authorities with lawful jurisdiction. All work shall be in accordance with the latest edition of the national electric code.
8. Material and equipment shall be ul, nema, ansi, ieee, ada & cmb approved for intended purpose. Material and installation shall meet requirements of national and local electrical code.
9. The contractor shall be responsible for all additional costs incurred as a result of substitutions or deviations from the basis of design shown on these drawings.
10. Give notices, file plans, obtain permits, and licenses, pay fees and back charges, and obtain necessary approvals from authorities that have jurisdiction.
11. Maintain record drawings on site. Record set must be complete and current and available for inspection when requisitions for payment are submitted.
12. Guarantee work in writing per specifications, repair or replace defective materials or installation at no cost to owner during the guarantee period. Correct damage caused in making necessary repairs and replacements under guarantee at no cost to owner. Submit guarantee to owner before final payment.

13. Coordinate all electrical items with existing field conditions. Locations shown are approximate and may require minor adjustment in the field to satisfy the design intent.
14. Damage to existing facilities and equipment shall be repaired or replaced immediately by the contractor at no additional expense to the owner.
15. The locations on these plans are approximate and require coordination with all other trades and verification of existing conditions. The contractor is responsible for field verification of all existing associated conditions. Contractor is responsible for obtaining all other trade's drawings and specifications and coordinating with all other trades during bidding and construction.
16. Contractor shall be responsible for maintaining continuity of all power, control, fire alarm, security systems, and communications functions to all areas affected by demolition and/or new construction.
17. Repair and patch any disturbed areas to match adjacent construction.
18. Disconnect and make safe any equipment to be removed by others. Coordinate removal of equipment with other trades prior to demolition.
19. In any area requiring the performance of any trade's work, this contractor shall carefully remove and store any or all electrical items in path of work, reinstalling, and reconnecting same as required, in accordance with the plans and/or as directed after completion of other trade's work in that area.
20. Prior to the start of demolition, contractor shall field verify all branch circuits and maintain those circuits that extend outside the scope of work.
21. After renovating existing electrical work, the contractor shall ensure that all remaining and new equipment will operate properly, including but not limited to backfeeding of existing power and lighting circuits. Refer to single line diagram.
22. All electrical work indicated to remain shall be suitably protected to prevent any damage.
23. Where electrical systems pass through renovated areas to serve other portions of the premises, systems shall be suitably protected to prevent damage or relocated and the systems restored to normal operation. Any outages in systems shall be coordinated with owner. Restore power to existing to remain equipment if interrupted by demolished circuits in the area.
24. Contractor shall submit for review, shop drawings for all equipment and materials used on the project. Submittals shall be reviewed by the architect before purchase of materials.
25. All wiring shall be copper, 600v, 75°/90° rated, flame-retardent, heat and moisture resistant.
26. Permanently label all new electrical equipment, including but not limited to, device designation and supply circuit designation. Update or replace panel directories to include new circuit information resulting from this project.
27. Provide temporary power and lighting for all trades as required to complete the project. All temporary and interim equipment shall be installed in accordance with all applicable codes and standards including, but not limited to NFPA 110 and NFPA 70.
28. Refer to specifications for additional information that is not shown on the drawings.
29. Openings in existing concrete walls and floors required for conduit installation shall be core drilled. Maximum core drill size shall be 5" in diameter. Core drill locations shall be spaced a minimum of 6" from each other measured from the outside edge of the core drill. All core drill openings shall be properly sealed according to their location and application.
30. All outages shall be kept to a minimum. All work that requires a sustained equipment outage shall be performed continuously around the clock until work is completed unless noted otherwise. Coordinate outages with owner representative.
31. Provide for each branch circuit and feeder circuit a dedicated equipment ground wire. For single phase branch circuits of 120 v/1ph or 277v/1 phase, provide dedicated hot, dedicated neutral and dedicated equipment ground wires. Sharing of neutral or equipment ground wires is not permitted. Wiring to all HVAC equipment or other trade equipment

shall be in conduit. All equipment and feeder wiring in boiler room/electrical room shall be in rigid conduit. Use of mc cable is limited to branch circuit wiring above recessed ceiling or concealed in wall. Wiring to outlets on table shall be provide in either EMT conduit or flexible metal conduit.

32. Provide identification labels for all branch circuits and feeders circuits at junction boxes, panelboards, troughs, and splice boxes.
33. Provide unspliced feeders from panelboard or switchboard to all equipment. Splicing is permitted for single phase circuits for lighting and outlets only.
34. All wiring devices located in the basement are to be surface mounted with circuit wiring routed in surface mounted conduit per specifications. All other wiring devices shall be recessed unless noted otherwise.
35. Electrical contractor shall provide and install (2) #14-3/4" from each vendor supplied duct smoke detector to FACP. Installation of detector by mechanical contractor. Electrical contractor shall provide all necessary electrical terminations. Each unit over 2000 CFM shall have one (1) smoke detector. In a multi-story building, each riser over 15,000 CFM shall include one smoke detector per floor in the riser.
36. All exposed wiring and cabling to be routed on existing walls or exterior walls shall be installed in surface mounted raceway, series 2400, manufactured by wiremold/legrand with dual channel configuration where necessary to facilitate installation of standard voltage and low voltage wiring and cabling.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION - NOT USED

END OF SECTION

SECTION 01 20 00
PRICE AND PAYMENT PROCEDURES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Procedures for preparation and submittal of applications for progress payments.
- B. Change procedures.

1.02 SCHEDULE OF VALUES

- A. Electronic media printout including equivalent information will be considered in lieu of standard form specified; submit sample to Architect for approval.
- B. Forms filled out by hand will not be accepted.

1.03 APPLICATIONS FOR PROGRESS PAYMENTS

- A. Payment Period: Submit at intervals stipulated in the Agreement.
- B. Electronic media printout including equivalent information will be considered in lieu of standard form specified; submit sample to Architect for approval.
- C. Forms filled out by hand will not be accepted.
- D. Execute certification by signature of authorized officer.
- E. Submit three copies of each Application for Payment.

1.04 MODIFICATION PROCEDURES

- A. For minor changes not involving an adjustment to the Contract Price or Contract Time, Architect will issue instructions directly to Contractor.
- B. No additional work is to be performed without written authorization.
- C. For other required changes, Architect will issue a document signed by Owner instructing Contractor to proceed with the change, for subsequent inclusion in a Change Order.
 - 1. The document will describe the required changes and will designate method of determining any change in Contract Price or Contract Time.
 - 2. Promptly execute the change.
- D. For changes for which advance pricing is desired, Architect will issue a document that includes a detailed description of a proposed change with supplementary or revised drawings and specifications, a change in Contract Time for executing the change with a stipulation of any overtime work required and the period of time during which the requested price will be considered valid. Contractor shall prepare and submit a fixed price quotation within 5 days.
- E. Computation of Change in Contract Amount: As specified in the Agreement and Conditions of the Contract.
- F. Execution of Change Orders: Architect will issue Change Orders for signatures of parties as provided in the Conditions of the Contract.
- G. After execution of Change Order, promptly revise Schedule of Values and Application for Payment forms to record each authorized Change Order as a separate line item and adjust the Contract Price.
- H. Promptly revise progress schedules to reflect any change in Contract Time, revise sub-schedules to adjust times for other items of work affected by the change, and resubmit.
- I. Promptly enter changes in Project Record Documents.

1.05 APPLICATION FOR FINAL PAYMENT

- A. Prepare Application for Final Payment as specified for progress payments, identifying total adjusted Contract Price, previous payments, and sum remaining due.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION - NOT USED

END OF SECTION

SECTION 01 30 00
ADMINISTRATIVE REQUIREMENTS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Preconstruction meeting.
- B. Site mobilization meeting.
- C. Progress meetings.
- D. Submittals for review, information, and project closeout.
- E. Submittal procedures.

PART 3 EXECUTION

2.01 PRECONSTRUCTION MEETING

- A. Owner will schedule a meeting after Notice of Award.
- B. Attendance Required:
 - 1. Owner.
 - 2. Architect.
 - 3. Contractor.
- C. Agenda:
 - 1. Execution of Owner-Contractor Agreement.
 - 2. Submission of executed bonds and insurance certificates.
 - 3. Distribution of Contract Documents.
 - 4. Submission of list of Subcontractors, list of Products, schedule of values, and progress schedule.
 - 5. Designation of personnel representing the parties to Contract, OMB and Architect.
 - 6. Procedures and processing of field decisions, submittals, substitutions, applications for payments, proposal request, Change Orders, and Contract closeout procedures.
 - 7. Scheduling.
- D. Record minutes and distribute copies within two days after meeting to participants, with two copies to Architect, Owner, participants, and those affected by decisions made.

2.02 SITE MOBILIZATION MEETING

- A. Owner will schedule a meeting at the Project site prior to Contractor occupancy.
- B. Attendance Required:
 - 1. Contractor.
 - 2. Owner.
 - 3. Architect.
 - 4. Contractor's Superintendent.
 - 5. Contractor's Project Manager.
 - 6. Major Subcontractors.
- C. Agenda:
 - 1. Use of premises by Owner and Contractor.
 - 2. Owner's requirements and occupancy prior to completion.
 - 3. Construction facilities and controls provided by Contractor and Owner.
 - 4. Security and housekeeping procedures.
 - 5. Schedules.
 - 6. Application for payment procedures.
 - 7. Procedures for maintaining record documents.
 - 8. Requirements for start-up of equipment.

- D. Record minutes and distribute copies within two days after meeting to participants, with two copies to Architect, Owner, participants, and those affected by decisions made.

2.03 PROGRESS MEETINGS

- A. Schedule and administer meetings throughout progress of the Work at maximum monthly intervals.
- B. Attendance Required: Job superintendent, major Subcontractors and suppliers, Owner, and Architect, as appropriate to agenda topics for each meeting.
- C. Agenda:
 - 1. Review minutes of previous meetings.
 - 2. Review of Work progress.
 - 3. Field observations, problems, and decisions.
 - 4. Identification of problems that impede, or will impede, planned progress.
 - 5. Review of submittals schedule and status of submittals.
 - 6. Maintenance of progress schedule.
 - 7. Corrective measures to regain projected schedules.
 - 8. Planned progress during succeeding work period.
 - 9. Maintenance of quality and work standards.
 - 10. Effect of proposed changes on progress schedule and coordination.
 - 11. Other business relating to Work.
- D. Record minutes and distribute copies within two days after meeting to participants, with two copies to Architect, Owner, participants, and those affected by decisions made.

2.04 CONSTRUCTION PROGRESS SCHEDULE

- A. Within 10 days after date of the Agreement, submit preliminary schedule defining planned operations for the first 60 days of Work, with a general outline for remainder of Work.

2.05 SUBMITTALS FOR REVIEW

- A. When the following are specified in individual sections, submit them for review:
 - 1. Product data.
 - 2. Shop drawings.
 - 3. Samples for selection.
 - 4. Samples for verification.
- B. Submit to Architect for review for the limited purpose of checking for conformance with information given and the design concept expressed in the contract documents.
- C. Samples will be reviewed only for aesthetic, color, or finish selection.
- D. After review, provide copies and distribute in accordance with SUBMITTAL PROCEDURES article below and for record documents purposes described in Section 01 78 00 - Closeout Submittals.

2.06 SUBMITTALS FOR INFORMATION

- A. When the following are specified in individual sections, submit them for information:
 - 1. Design data.
 - 2. Certificates.
 - 3. Test reports.
 - 4. Inspection reports.
 - 5. Manufacturer's instructions.
 - 6. Manufacturer's field reports.
 - 7. Other types indicated.

- B. Submit for Architect's knowledge as contract administrator or for Owner. No action will be taken.

2.07 SUBMITTALS FOR PROJECT CLOSEOUT

- A. When the following are specified in individual sections, submit them at project closeout:
 - 1. Project record documents.
 - 2. Operation and maintenance data.
 - 3. Warranties.
 - 4. Bonds.
 - 5. Other types as indicated.
- B. Submit for Owner's benefit during and after project completion.

2.08 NUMBER OF COPIES OF SUBMITTALS

- A. Documents for Review:
 - 1. Small Size Sheets, Not Larger Than 8-1/2 x 11 inches: Submit the number of copies that Contractor requires, plus two copies that will be retained by Architect.
- B. Documents for Information: Submit two copies.
- C. Samples: Submit the number specified in individual specification sections; one of which will be retained by Architect.
 - 1. After review, produce duplicates.
 - 2. Retained samples will not be returned to Contractor unless specifically so stated.

2.09 SUBMITTAL PROCEDURES

- A. Transmit each submittal with approved form.
- B. Sequentially number the transmittal form. Revise submittals with original number and a sequential alphabetic suffix.
- C. Identify Project, Contractor, Subcontractor or supplier; pertinent drawing and detail number, and specification section number, as appropriate on each copy.
- D. Apply Contractor's stamp, signed or initialed certifying that review, approval, verification of Products required, field dimensions, adjacent construction Work, and coordination of information is in accordance with the requirements of the Work and Contract Documents.
- E. Schedule submittals to expedite the Project, and coordinate submission of related items.
- F. For each submittal for review, allow 15 days excluding delivery time to and from the Contractor.
- G. Identify variations from Contract Documents and Product or system limitations that may be detrimental to successful performance of the completed Work.
- H. Provide space for Contractor and Architect review stamps.
- I. When revised for resubmission, identify all changes made since previous submission.
- J. Distribute reviewed submittals as appropriate. Instruct parties to promptly report any inability to comply with requirements.
- K. Submittals not requested will not be recognized or processed.

END OF SECTION

SECTION 01 40 00
QUALITY REQUIREMENTS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Control of installation.
- B. Tolerances.
- C. Testing and inspection services.
- D. Manufacturers' field services.

PART 3 EXECUTION

2.01 CONTROL OF INSTALLATION

- A. Monitor quality control over suppliers, manufacturers, products, services, site conditions, and workmanship, to produce Work of specified quality.
- B. Comply with manufacturers' instructions, including each step in sequence.
- C. Should manufacturers' instructions conflict with Contract Documents, request clarification from Architect before proceeding.
- D. Comply with specified standards as minimum quality for the Work except where more stringent tolerances, codes, or specified requirements indicate higher standards or more precise workmanship.
- E. Have Work performed by persons qualified to produce required and specified quality.
- F. Verify that field measurements are as indicated on shop drawings or as instructed by the manufacturer.
- G. Secure products in place with positive anchorage devices designed and sized to withstand stresses, vibration, physical distortion, and disfigurement.

2.02 TOLERANCES

- A. Monitor fabrication and installation tolerance control of products to produce acceptable Work. Do not permit tolerances to accumulate.
- B. Comply with manufacturers' tolerances. Should manufacturers' tolerances conflict with Contract Documents, request clarification from Architect before proceeding.
- C. Adjust products to appropriate dimensions; position before securing products in place.

2.03 TESTING AND INSPECTION

- A. See individual specification sections for testing required.
- B. Re-testing required because of non-conformance to specified requirements shall be performed by the same agency on instructions by Architect.
- C. Re-testing required because of non-conformance to specified requirements shall be paid for by Contractor.

2.04 MANUFACTURERS' FIELD SERVICES

- A. When specified in individual specification sections, require material or product suppliers or manufacturers to provide qualified staff personnel to observe site conditions, conditions of surfaces and installation, quality of workmanship, start-up of equipment, test, adjust and balance of equipment and operation as applicable, and to initiate instructions when necessary.
- B. Report observations and site decisions or instructions given to applicators or installers that are supplemental or contrary to manufacturers' written instructions.

2.05 DEFECT ASSESSMENT

- A. Replace Work or portions of the Work not conforming to specified requirements.
- B. If, in the opinion of Architect, it is not practical to remove and replace the Work, Architect will direct an appropriate remedy or adjust payment.

END OF SECTION

SECTION 01 42 16
DEFINITIONS

PART 1 GENERAL

1.01 SUMMARY

- A. Other definitions are included in individual specification sections.

1.02 DEFINITIONS

- A. Furnish: To supply, deliver, unload, and inspect for damage.
- B. Install: To unpack, assemble, erect, apply, place, finish, cure, protect, clean, start up, and make ready for use.
- C. Product: Material, machinery, components, equipment, fixtures, and systems forming the work result. Not materials or equipment used for preparation, fabrication, conveying, or erection and not incorporated into the work result. Products may be new, never before used, or re-used materials or equipment.
- D. Project Manual: The book-sized volume that includes the procurement requirements (if any), the contracting requirements, and the specifications.
- E. Provide: To furnish and install.
- F. Supply: Same as Furnish.

END OF SECTION

SECTION 01 50 00
TEMPORARY FACILITIES AND CONTROLS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Temporary sanitary facilities.
- B. Temporary Controls: Barriers, enclosures, and fencing.
- C. Security requirements.
- D. Vehicular access and parking.
- E. Waste removal facilities and services.

1.02 REFERENCE STANDARDS

- A. ASTM E84 - Standard Test Method for Surface Burning Characteristics of Building Materials.
- B. ASTM E90 - Standard Test Method for Laboratory Measurement of Airborne Sound Transmission Loss of Building Partitions and Elements.

1.03 TEMPORARY SANITARY FACILITIES

- A. Contractor to use designated Building Facilities.
- B. Maintain daily in clean and sanitary condition.

1.04 BARRIERS

- A. Provide barriers to prevent unauthorized entry to construction areas, to prevent access to areas that could be hazardous to workers or the public, to allow for owner's use of site and to protect existing facilities and adjacent properties from damage from construction operations and demolition.
- B. Provide barricades and covered walkways required by governing authorities for public rights-of-way and for public access to existing building.
- C. Protect non-owned vehicular traffic, stored materials, site, and structures from damage.
- D. Traffic Controls: Coordinate with the Owner and the City of Dover.

1.05 EXTERIOR ENCLOSURES

- A. Provide temporary insulated weather tight closure of exterior openings to accommodate acceptable working conditions and protection for Products, to allow for temporary heating and maintenance of required ambient temperatures identified in individual specification sections, and to prevent entry of unauthorized persons. Provide access doors with self-closing hardware and locks.

1.06 INTERIOR ENCLOSURES

- A. Provide temporary partitions and ceilings as indicated to separate work areas from Owner-occupied areas, to prevent penetration of dust and moisture into Owner-occupied areas, and to prevent damage to existing materials and equipment.
- B. Construction: Framing and reinforced polyethylene sheet materials with closed joints and sealed edges at intersections with existing surfaces:
 - 1. STC rating of 35 in accordance with ASTM E90.
 - 2. Maximum flame spread rating of 75 in accordance with ASTM E84.

1.07 SECURITY

- A. Provide security and facilities to protect Work, existing facilities, and Owner's operations from unauthorized entry, vandalism, or theft.
- B. Coordinate with Owner's security program.

1.08 VEHICULAR ACCESS AND PARKING

- A. Coordinate access and haul routes with governing authorities and Owner.
- B. Provide and maintain access to fire hydrants, free of obstructions.
- C. Parking is limited in this area. Parking will be coordinated by the contractor and will be off-site.
- D. Crane activities are to be coordinated in advance, and approved by the owner. Contractor to submit crane lift plan for approval.

1.09 WASTE REMOVAL

- A. Provide waste removal facilities and services as required to maintain the site in clean and orderly condition.
- B. Provide containers with lids. Remove trash from site daily.
- C. If materials to be recycled or re-used on the project must be stored on-site, provide suitable non-combustible containers; locate containers holding flammable material outside the structure unless otherwise approved by the authorities having jurisdiction.
- D. Open free-fall chutes are not permitted. Terminate closed chutes into appropriate containers with lids.

1.10 REMOVAL OF UTILITIES, FACILITIES, AND CONTROLS

- A. Remove temporary utilities, equipment, facilities, materials, prior to Substantial Completion inspection.
- B. Clean and repair damage caused by installation or use of temporary work.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION - NOT USED

END OF SECTION

SECTION 01 60 00
PRODUCT REQUIREMENTS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Transportation, handling, storage and protection.
- B. Product option requirements.
- C. Substitution limitations and procedures.
- D. Maintenance materials, including extra materials, spare parts, tools, and software.

1.02 SUBMITTALS

- A. Product Data Submittals: Submit manufacturer's standard published data. Mark each copy to identify applicable products, models, options, and other data. Supplement manufacturers' standard data to provide information specific to this Project.
- B. Shop Drawing Submittals: Prepared specifically for this Project; indicate utility and electrical characteristics, utility connection requirements, and location of utility outlets for service for functional equipment and appliances.
- C. Sample Submittals: Illustrate functional and aesthetic characteristics of the product, with integral parts and attachment devices. Coordinate sample submittals for interfacing work.
 - 1. For selection from standard finishes, submit samples of the full range of the manufacturer's standard colors, textures, and patterns.

PART 2 PRODUCTS

2.01 NEW PRODUCTS

- A. Provide new products unless specifically required or permitted by the Contract Documents.
- B. Where all other criteria are met, Contractor shall give preference to products that:
 - 1. If used on interior, have lower emissions, as defined in Section 01 61 16.
 - 2. If wet-applied, have lower VOC content, as defined in Section 01 61 16.
 - 3. Have a published GreenScreen Chemical Hazard Analysis.

2.02 PRODUCT OPTIONS

- A. Products Specified by Reference Standards or by Description Only: Use any product meeting those standards or description.
- B. Products Specified by Naming One or More Manufacturers: Use a product of one of the manufacturers named and meeting specifications, no options or substitutions allowed.
- C. Products Specified by Naming One or More Manufacturers with a Provision for Substitutions: Submit a request for substitution for any manufacturer not named.

2.03 MAINTENANCE MATERIALS

- A. Furnish extra materials, spare parts, tools, and software of types and in quantities specified in individual specification sections.
- B. Deliver to Project site; obtain receipt prior to final payment.

PART 3 EXECUTION

3.01 SUBSTITUTION PROCEDURES

- A. Instructions to Bidders specify time restrictions for submitting requests for substitutions during the bidding period. Comply with requirements specified in this section.
- B. Document each request with complete data substantiating compliance of proposed substitution with Contract Documents.

- C. A request for substitution constitutes a representation that the submitter:
 - 1. Has investigated proposed product and determined that it meets or exceeds the quality level of the specified product.
 - 2. Will provide the same warranty for the substitution as for the specified product.
 - 3. Will coordinate installation and make changes to other Work that may be required for the Work to be complete with no additional cost to Owner or the Architect.
 - 4. Waives claims for additional costs or time extension that may subsequently become apparent.
- D. Substitution Submittal Procedure:
 - 1. Submit three copies of request for substitution for consideration. Limit each request to one proposed substitution.
 - 2. Submit shop drawings, product data, and certified test results attesting to the proposed product equivalence. Burden of proof is on proposer.
 - 3. The Architect will notify Contractor in writing of decision to accept or reject request.

3.02 TRANSPORTATION AND HANDLING

- A. Package products for shipment in manner to prevent damage; for equipment, package to avoid loss of factory calibration.
- B. If special precautions are required, attach instructions prominently and legibly on outside of packaging.
- C. Coordinate schedule of product delivery to designated prepared areas in order to minimize site storage time and potential damage to stored materials.
- D. Transport and handle products in accordance with manufacturer's instructions.
- E. Transport materials in covered trucks to prevent contamination of product and littering of surrounding areas.
- F. Promptly inspect shipments to ensure that products comply with requirements, quantities are correct, and products are undamaged.
- G. Provide equipment and personnel to handle products by methods to prevent soiling, disfigurement, or damage.
- H. Arrange for the return of packing materials, such as wood pallets, where economically feasible.

3.03 STORAGE AND PROTECTION

- A. Designate receiving/storage areas for incoming products so that they are delivered according to installation schedule and placed convenient to work area in order to minimize waste due to excessive materials handling and misapplication.
- B. Store and protect products in accordance with manufacturers' instructions.
- C. Store with seals and labels intact and legible.
- D. Store sensitive products in weather tight, climate controlled, enclosures in an environment favorable to product.
- E. For exterior storage of fabricated products, place on sloped supports above ground.
- F. Protect products from damage or deterioration due to construction operations, weather, precipitation, humidity, temperature, sunlight and ultraviolet light, dirt, dust, and other contaminants.
- G. Comply with manufacturer's warranty conditions, if any.
- H. Cover products subject to deterioration with impervious sheet covering. Provide ventilation to prevent condensation and degradation of products.
- I. Prevent contact with material that may cause corrosion, discoloration, or staining.

- J. Provide equipment and personnel to store products by methods to prevent soiling, disfigurement, or damage.
- K. Arrange storage of products to permit access for inspection. Periodically inspect to verify products are undamaged and are maintained in acceptable condition.

END OF SECTION

SECTION 01 70 00
EXECUTION AND CLOSEOUT REQUIREMENTS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Examination, preparation, and general installation procedures.
- B. Requirements for alterations work, including selective demolition, except removal, disposal, and/or remediation of hazardous materials and toxic substances.
- C. Cutting and patching.
- D. Surveying for laying out the work.
- E. Cleaning and protection.
- F. Starting of systems and equipment.
- G. Demonstration and instruction of Owner personnel.
- H. Closeout procedures, including Contractor's Correction Punch List, except payment procedures.
- I. General requirements for maintenance service.

1.02 RELATED REQUIREMENTS

- A. Section 01 10 00 - Summary: Limitations on working in existing building; continued occupancy; work sequence; identification of salvaged and relocated materials.
- B. Section 01 30 00 - Administrative Requirements: Submittals procedures.
- C. Section 01 40 00 - Quality Requirements: Testing and inspection procedures.
- D. Section 07 84 00 - Firestopping.

1.03 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Survey work: Submit name, address, and telephone number of Surveyor before starting survey work.
 - 1. On request, submit documentation verifying accuracy of survey work.
 - 2. Submit a copy of site drawing signed by the Land Surveyor, that the elevations and locations of the work are in conformance with Contract Documents.
 - 3. Submit surveys and survey logs for the project record.
- C. Cutting and Patching: Submit written request in advance of cutting or alteration that affects:
 - 1. Structural integrity of any element of Project.
 - 2. Integrity of weather exposed or moisture resistant element.
 - 3. Efficiency, maintenance, or safety of any operational element.
 - 4. Visual qualities of sight exposed elements.
 - 5. Work of Owner or separate Contractor.

1.04 QUALIFICATIONS

- A. For survey work, employ a land surveyor registered in the State in which the Project is located and acceptable to Architect. Submit evidence of Surveyor's Errors and Omissions insurance coverage in the form of an Insurance Certificate.

1.05 PROJECT CONDITIONS

- A. Protect site from puddling or running water. Provide water barriers as required to protect site from soil erosion.
- B. Ventilate enclosed areas to assist cure of materials, to dissipate humidity, and to prevent accumulation of dust, fumes, vapors, or gases.

- C. Noise Control: Provide methods, means, and facilities to minimize noise produced by construction operations.
- D. Pest Control: Provide methods, means, and facilities to prevent pests and insects from damaging the work.
- E. Rodent Control: Provide methods, means, and facilities to prevent rodents from accessing or invading premises.

1.06 COORDINATION

- A. See Section 01 10 00 for occupancy-related requirements.
- B. Coordinate scheduling, submittals, and work of the various sections of the Project Manual to ensure efficient and orderly sequence of installation of interdependent construction elements, with provisions for accommodating items installed later.
- C. Notify affected utility companies and comply with their requirements.
- D. Verify that utility requirements and characteristics of new operating equipment are compatible with building utilities. Coordinate work of various sections having interdependent responsibilities for installing, connecting to, and placing in service, such equipment.
- E. Coordinate space requirements, supports, and installation of mechanical and electrical work that are indicated diagrammatically on Drawings. Follow routing shown for pipes, ducts, and conduit, as closely as practicable; place runs parallel with lines of building. Utilize spaces efficiently to maximize accessibility for other installations, for maintenance, and for repairs.
- F. In finished areas except as otherwise indicated, conceal pipes, ducts, and wiring within the construction. Coordinate locations of fixtures and outlets with finish elements.
- G. Coordinate completion and clean-up of work of separate sections.

PART 2 PRODUCTS

2.01 PATCHING MATERIALS

- A. New Materials: As specified in product sections; match existing products and work for patching and extending work.
- B. Type and Quality of Existing Products: Determine by inspecting and testing products where necessary, referring to existing work as a standard.
- C. Product Substitution: For any proposed change in materials, submit request for substitution described in Section 01 60 00.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that existing site conditions and substrate surfaces are acceptable for subsequent work. Start of work means acceptance of existing conditions.
- B. Verify that existing substrate is capable of structural support or attachment of new work being applied or attached.
- C. Examine and verify specific conditions described in individual specification sections.
- D. Take field measurements before confirming product orders or beginning fabrication, to minimize waste due to over-ordering or misfabrication.
- E. Verify that utility services are available, of the correct characteristics, and in the correct locations.
- F. Prior to Cutting: Examine existing conditions prior to commencing work, including elements subject to damage or movement during cutting and patching. After uncovering existing work, assess conditions affecting performance of work. Beginning of cutting or patching means acceptance of existing conditions.

3.02 LAYING OUT THE WORK

- A. Verify locations of survey control points prior to starting work.
- B. Promptly notify Architect of any discrepancies discovered.
- C. Protect survey control points prior to starting site work; preserve permanent reference points during construction.
- D. Promptly report to Architect the loss or destruction of any reference point or relocation required because of changes in grades or other reasons.
- E. Replace dislocated survey control points based on original survey control. Make no changes without prior written notice to Architect.
- F. Utilize recognized engineering survey practices.
- G. Establish elevations, lines and levels. Locate and lay out by instrumentation and similar appropriate means:
 - 1. Site improvements including pavements; stakes for grading, fill and topsoil placement; utility locations, slopes, and invert elevations.
 - 2. Grid or axis for structures.
 - 3. Building foundation, column locations, ground floor elevations.
- H. Periodically verify layouts by same means.
- I. Maintain a complete and accurate log of control and survey work as it progresses.

3.03 GENERAL INSTALLATION REQUIREMENTS

- A. Install products as specified in individual sections, in accordance with manufacturer's instructions and recommendations, and so as to avoid waste due to necessity for replacement.
- B. Make vertical elements plumb and horizontal elements level, unless otherwise indicated.
- C. Install equipment and fittings plumb and level, neatly aligned with adjacent vertical and horizontal lines, unless otherwise indicated.
- D. Make consistent texture on surfaces, with seamless transitions, unless otherwise indicated.
- E. Make neat transitions between different surfaces, maintaining texture and appearance.

3.04 ALTERATIONS

- A. Drawings showing existing construction and utilities are based on casual field observation and existing record documents only.
 - 1. Verify that construction and utility arrangements are as shown.
 - 2. Report discrepancies to Architect before disturbing existing installation.
 - 3. Beginning of alterations work constitutes acceptance of existing conditions.
- B. Remove existing work as indicated and as required to accomplish new work.
 - 1. Remove items indicated on drawings.
 - 2. Relocate items indicated on drawings.
 - 3. Where new surface finishes are to be applied to existing work, perform removals, patch, and prepare existing surfaces as required to receive new finish; remove existing finish if necessary for successful application of new finish.
 - 4. Where new surface finishes are not specified or indicated, patch holes and damaged surfaces to match adjacent finished surfaces as closely as possible.
- C. Services (Including but not limited to HVAC, Plumbing, Fire Protection, Electrical, and Telecommunications): Remove, relocate, and extend existing systems to accommodate new construction.
 - 1. Maintain existing active systems that are to remain in operation; maintain access to equipment and operational components; if necessary, modify installation to allow access or provide access panel.

2. Where existing systems or equipment are not active and Contract Documents require reactivation, put back into operational condition; repair supply, distribution, and equipment as required.
 3. Where existing active systems serve occupied facilities but are to be replaced with new services, maintain existing systems in service until new systems are complete and ready for service.
 - a. Disable existing systems only to make switchovers and connections; minimize duration of outages.
 - b. Provide temporary connections as required to maintain existing systems in service.
 4. Verify that abandoned services serve only abandoned facilities.
 5. Remove abandoned pipe, ducts, conduits, and equipment, including those above accessible ceilings; remove back to source of supply where possible, otherwise cap stub and tag with identification; patch holes left by removal using materials specified for new construction.
- D. Protect existing work to remain.
1. Prevent movement of structure; provide shoring and bracing if necessary.
 2. Perform cutting to accomplish removals neatly and as specified for cutting new work.
 3. Repair adjacent construction and finishes damaged during removal work.
- E. Adapt existing work to fit new work: Make as neat and smooth transition as possible.
- F. Patching: Where the existing surface is not indicated to be refinished, patch to match the surface finish that existed prior to cutting. Where the surface is indicated to be refinished, patch so that the substrate is ready for the new finish.
- G. Refinish existing surfaces as indicated:
1. Where rooms or spaces are indicated to be refinished, refinish all visible existing surfaces to remain to the specified condition for each material, with a neat transition to adjacent finishes.
 2. If mechanical or electrical work is exposed accidentally during the work, re-cover and refinish to match.
- H. Clean existing systems and equipment.
- I. Remove demolition debris and abandoned items from alterations areas and dispose of off-site; do not burn or bury.
- J. Do not begin new construction in alterations areas before demolition is complete.
- K. Comply with all other applicable requirements of this section.

3.05 CUTTING AND PATCHING

- A. Whenever possible, execute the work by methods that avoid cutting or patching.
- B. See Alterations article above for additional requirements.
- C. Perform whatever cutting and patching is necessary to:
 1. Complete the work.
 2. Fit products together to integrate with other work.
 3. Provide openings for penetration of mechanical, electrical, and other services.
 4. Match work that has been cut to adjacent work.
 5. Repair areas adjacent to cuts to required condition.
 6. Repair new work damaged by subsequent work.
 7. Remove samples of installed work for testing when requested.
 8. Remove and replace defective and non-conforming work.
- D. Execute work by methods that avoid damage to other work and that will provide appropriate surfaces to receive patching and finishing. In existing work, minimize damage and restore to original condition.

- E. Employ original installer to perform cutting for weather exposed and moisture resistant elements, and sight exposed surfaces.
- F. Cut rigid materials using masonry saw or core drill. Pneumatic tools not allowed without prior approval.
- G. Restore work with new products in accordance with requirements of Contract Documents.
- H. Fit work air tight to pipes, sleeves, ducts, conduit, and other penetrations through surfaces.
- I. At penetrations of fire rated walls, partitions, ceiling, or floor construction, completely seal voids with fire rated material in accordance with Section 07 84 00, to full thickness of the penetrated element.
- J. Patching:
 - 1. Finish patched surfaces to match finish that existed prior to patching. On continuous surfaces, refinish to nearest intersection or natural break. For an assembly, refinish entire unit.
 - 2. Match color, texture, and appearance.
 - 3. Repair patched surfaces that are damaged, lifted, discolored, or showing other imperfections due to patching work. If defects are due to condition of substrate, repair substrate prior to repairing finish.

3.06 PROGRESS CLEANING

- A. Maintain areas free of waste materials, debris, and rubbish. Maintain site in a clean and orderly condition.
- B. Remove debris and rubbish from pipe chases, plenums, attics, crawl spaces, and other closed or remote spaces, prior to enclosing the space.
- C. Broom and vacuum clean interior areas prior to start of surface finishing, and continue cleaning to eliminate dust.
- D. Collect and remove waste materials, debris, and trash/rubbish from site periodically and dispose off-site; do not burn or bury.

3.07 PROTECTION OF INSTALLED WORK

- A. Protect installed work from damage by construction operations.
- B. Provide special protection where specified in individual specification sections.
- C. Provide temporary and removable protection for installed products. Control activity in immediate work area to prevent damage.
- D. Remove protective coverings when no longer needed; reuse or recycle plastic coverings if possible.

3.08 SYSTEM STARTUP

- A. Coordinate schedule for start-up of various equipment and systems.
- B. Verify that each piece of equipment or system has been checked for proper lubrication, drive rotation, belt tension, control sequence, and for conditions that may cause damage.
- C. Verify tests, meter readings, and specified electrical characteristics agree with those required by the equipment or system manufacturer.
- D. Verify that wiring and support components for equipment are complete and tested.
- E. Execute start-up under supervision of applicable Contractor personnel and manufacturer's representative in accordance with manufacturers' instructions.
- F. Submit a written report that equipment or system has been properly installed and is functioning correctly.

3.09 DEMONSTRATION AND INSTRUCTION

- A. See Section 01 79 00 - Demonstration and Training.
- B. Utilize operation and maintenance manuals as basis for instruction. Review contents of manual with Owner personnel in detail to explain all aspects of operation and maintenance.
- C. Prepare and insert additional data in operations and maintenance manuals when need for additional data becomes apparent during instruction.

3.10 ADJUSTING

- A. Adjust operating products and equipment to ensure smooth and unhindered operation.
- B. Testing, adjusting, and balancing HVAC systems: See Section 23 05 93.

3.11 FINAL CLEANING

- A. Remove all labels that are not permanent. Do not paint or otherwise cover fire test labels or nameplates on mechanical and electrical equipment.
- B. Clean equipment and fixtures to a sanitary condition with cleaning materials appropriate to the surface and material being cleaned.
- C. Clean debris from roofs, gutters, downspouts, and drainage systems.
- D. Clean site; sweep paved areas, rake clean landscaped surfaces.
- E. Remove waste, surplus materials, trash/rubbish, and construction facilities from the site; dispose of in legal manner; do not burn or bury.

3.12 CLOSEOUT PROCEDURES

- A. Make submittals that are required by governing or other authorities.
- B. Notify Architect when work is considered ready for Architect's Substantial Completion inspection.
- C. Submit written certification containing Contractor's Correction Punch List, that Contract Documents have been reviewed, work has been inspected, and that work is complete in accordance with Contract Documents and ready for Architect's Substantial Completion inspection.
- D. Submit electronic documentation of as-built drawings, operation and maintenance manuals for all installed equipment and items, and all inspection certificates. See front end specifications for additional closeout requirements.
- E. Correct items of work listed in Final Correction Punch List and comply with requirements for access to Owner-occupied areas.
- F. Notify Architect when work is considered finally complete and ready for Architect's Substantial Completion final inspection.
- G. Complete items of work determined by Architect listed in executed Certificate of Substantial Completion.
- H. Provided completed documentation as follows:
 - 1. Consent to Surety of Final Payment
 - 2. Certificate of Substantial Completion
 - 3. Contractor Satisfaction of Debt and Claims
 - 4. Release of Liens for the Contractor, his Subcontractors, and his Suppliers

3.13 MAINTENANCE

- A. Provide service and maintenance of components indicated in specification sections.

- B. Maintenance Period: As indicated in specification sections or, if not indicated, not less than one year from the Date of Substantial Completion or the length of the specified warranty, whichever is longer.
- C. Examine system components at a frequency consistent with reliable operation. Clean, adjust, and lubricate as required.
- D. Include systematic examination, adjustment, and lubrication of components. Repair or replace parts whenever required. Use parts produced by the manufacturer of the original component.
- E. Maintenance service shall not be assigned or transferred to any agent or subcontractor without prior written consent of the Owner.

END OF SECTION

SECTION 01 74 19

CONSTRUCTION WASTE MANAGEMENT AND DISPOSAL

PART 1 GENERAL

1.01 WASTE MANAGEMENT REQUIREMENTS

- A. Owner requires that this project generate the least amount of trash and waste possible.
- B. Employ processes that ensure the generation of as little waste as possible due to error, poor planning, breakage, mishandling, contamination, or other factors.
- C. Minimize trash/waste disposal in landfills; reuse, salvage, or recycle as much waste as economically feasible.
- D. This project is dependent on diversion of 75 percent, by weight, of potential landfill trash/waste by recycling and/or salvage.
- E. Contractor shall submit periodic Waste Disposal Reports; all landfill disposal, incineration, recycling, salvage, and reuse must be reported regardless of to whom the cost or savings accrues; use the same units of measure on all reports.
- F. Contractor shall develop and follow a Waste Management Plan designed to implement these requirements.
- G. Methods of trash/waste disposal that are not acceptable are:
 - 1. Burning on the project site.
 - 2. Burying on the project site.
 - 3. Dumping or burying on other property, public or private.
 - 4. Other illegal dumping or burying.
- H. Regulatory Requirements: Contractor is responsible for knowing and complying with regulatory requirements, including but not limited to Federal, state and local requirements, pertaining to legal disposal of all construction and demolition waste materials.

1.02 RELATED REQUIREMENTS

- A. Section 01 10 00 - Summary: List of items to be salvaged from the existing building for relocation in project or for Owner.
- B. Section 01 30 00 - Administrative Requirements: Additional requirements for project meetings, reports, submittal procedures, and project documentation.
- C. Section 01 50 00 - Temporary Facilities and Controls: Additional requirements related to trash/waste collection and removal facilities and services.
- D. Section 01 60 00 - Product Requirements: Waste prevention requirements related to delivery, storage, and handling.
- E. Section 01 70 00 - Execution and Closeout Requirements: Trash/waste prevention procedures related to demolition, cutting and patching, installation, protection, and cleaning.

1.03 DEFINITIONS

- A. Clean: Untreated and unpainted; not contaminated with oils, solvents, caulk, or the like.
- B. Construction and Demolition Waste: Solid wastes typically including building materials, packaging, trash, debris, and rubble resulting from construction, remodeling, repair and demolition operations.
- C. Hazardous: Exhibiting the characteristics of hazardous substances, i.e., ignitibility, corrosivity, toxicity or reactivity.
- D. Nonhazardous: Exhibiting none of the characteristics of hazardous substances, i.e., ignitibility, corrosivity, toxicity, or reactivity.

- E. Nontoxic: Neither immediately poisonous to humans nor poisonous after a long period of exposure.
- F. Recyclable: The ability of a product or material to be recovered at the end of its life cycle and remanufactured into a new product for reuse by others.
- G. Recycle: To remove a waste material from the project site to another site for remanufacture into a new product for reuse by others.
- H. Recycling: The process of sorting, cleansing, treating and reconstituting solid waste and other discarded materials for the purpose of using the altered form. Recycling does not include burning, incinerating, or thermally destroying waste.
- I. Return: To give back reusable items or unused products to vendors for credit.
- J. Reuse: To reuse a construction waste material in some manner on the project site.
- K. Salvage: To remove a waste material from the project site to another site for resale or reuse by others.
- L. Sediment: Soil and other debris that has been eroded and transported by storm or well production run-off water.
- M. Source Separation: The act of keeping different types of waste materials separate beginning from the first time they become waste.
- N. Toxic: Poisonous to humans either immediately or after a long period of exposure.
- O. Trash: Any product or material unable to be reused, returned, recycled, or salvaged.
- P. Waste: Extra material or material that has reached the end of its useful life in its intended use. Waste includes salvageable, returnable, recyclable, and reusable material.

1.04 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Waste Management Plan: Include the following information:
 - 1. Analysis of the trash and waste projected to be generated during the entire project construction cycle, including types and quantities.
 - 2. Landfill Options: The name, address, and telephone number of the landfill(s) where trash/waste will be disposed of, the applicable landfill tipping fee(s), and the projected cost of disposing of all project trash/waste in the landfill(s).
- C. Waste Disposal Reports: Submit at specified intervals, with details of quantities of trash and waste, means of disposal or reuse, and costs; show both totals to date and since last report.
 - 1. Submit updated Report with each Application for Progress Payment; failure to submit Report will delay payment.
 - 2. Submit Report on a form acceptable to Owner.
 - 3. Landfill Disposal: Include the following information:
 - a. Identification of material.
 - b. Amount, in tons or cubic yards, of trash/waste material from the project disposed of in landfills.
 - c. State the identity of landfills, total amount of tipping fees paid to landfill, and total disposal cost.
 - d. Include manifests, weight tickets, receipts, and invoices as evidence of quantity and cost.
 - 4. Incinerator Disposal: Include the following information:
 - a. Identification of material.
 - b. Amount, in tons or cubic yards, of trash/waste material from the project delivered to incinerators.

- c. State the identity of incinerators, total amount of fees paid to incinerator, and total disposal cost.
 - d. Include manifests, weight tickets, receipts, and invoices as evidence of quantity and cost.
 5. Recycled and Salvaged Materials: Include the following information for each:
 - a. Identification of material, including those retrieved by installer for use on other projects.
 - b. Amount, in tons or cubic yards, date removed from the project site, and receiving party.
 - c. Transportation cost, amount paid or received for the material, and the net total cost or savings of salvage or recycling each material.
 - d. Include manifests, weight tickets, receipts, and invoices as evidence of quantity and cost.
 - e. Certification by receiving party that materials will not be disposed of in landfills or by incineration.
 6. Material Reused on Project: Include the following information for each:
 - a. Identification of material and how it was used in the project.
 - b. Amount, in tons or cubic yards.
 - c. Include weight tickets as evidence of quantity.
 7. Other Disposal Methods: Include information similar to that described above, as appropriate to disposal method.

PART 2 PRODUCTS

2.01 PRODUCT SUBSTITUTIONS

- A. See Section 01 60 00 - Product Requirements for substitution submission procedures.

PART 3 EXECUTION

3.01 WASTE MANAGEMENT PROCEDURES

- A. See Section 01 30 00 for additional requirements for project meetings, reports, submittal procedures, and project documentation.
- B. See Section 01 50 00 for additional requirements related to trash/waste collection and removal facilities and services.
- C. See Section 01 60 00 for waste prevention requirements related to delivery, storage, and handling.
- D. See Section 01 70 00 for trash/waste prevention procedures related to demolition, cutting and patching, installation, protection, and cleaning.

3.02 WASTE MANAGEMENT PLAN IMPLEMENTATION

- A. Communication: Distribute copies of the Waste Management Plan to job site foreman, each subcontractor, Owner, and Architect.
- B. Instruction: Provide on-site instruction of appropriate separation, handling, and recycling, salvage, reuse, and return methods to be used by all parties at the appropriate stages of the project.
- C. Meetings: Discuss trash/waste management goals and issues at project meetings.
 1. Pre-construction meeting.
 2. Regular job-site meetings.
- D. Facilities: Provide specific facilities for separation and storage of materials for recycling, salvage, reuse, return, and trash disposal, for use by all contractors and installers.
 1. Provide containers as required.
 2. Provide adequate space for pick-up and delivery and convenience to subcontractors.

3. Keep recycling and trash/waste bin areas neat and clean and clearly marked in order to avoid contamination of materials.
- E. Hazardous Wastes: Separate, store, and dispose of hazardous wastes according to applicable regulations.
- F. Recycling: Separate, store, protect, and handle at the site identified recyclable waste products in order to prevent contamination of materials and to maximize recyclability of identified materials. Arrange for timely pickups from the site or deliveries to recycling facility in order to prevent contamination of recyclable materials.
- G. Salvage: Set aside, sort, and protect products to be salvaged for reuse off-site.

END OF SECTION

SECTION 01 79 00
DEMONSTRATION AND TRAINING

PART 1 GENERAL

1.01 SUMMARY

- A. Demonstration of products and systems where indicated in specific specification sections.
- B. Training of Owner personnel in operation and maintenance is required for:
 - 1. HVAC systems and equipment.
 - 2. Electrical systems and equipment.

1.02 RELATED REQUIREMENTS

- A. Section 01 78 00 - Closeout Submittals: Operation and maintenance manuals.
- B. Section 01 91 13 - General Commissioning Requirements: Additional requirements applicable to demonstration and training.
- C. Other Specification Sections: Additional requirements for demonstration and training.

1.03 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Training Plan: Owner will designate personnel to be trained; tailor training to needs and skill-level of attendees.
 - 1. Submit to Architect for transmittal to Owner.
 - 2. Submit not less than four weeks prior to start of training.
 - 3. Revise and resubmit until acceptable.
 - 4. Provide an overall schedule showing all training sessions.
 - 5. Include at least the following for each training session:
 - a. Identification, date, time, and duration.
 - b. Description of products and/or systems to be covered.
 - c. Name of firm and person conducting training; include qualifications.
 - d. Intended audience, such as job description.
 - e. Objectives of training and suggested methods of ensuring adequate training.
 - f. Methods to be used, such as classroom lecture, live demonstrations, hands-on, etc.
 - g. Media to be used, such as slides, hand-outs, etc.
 - h. Training equipment required, such as projector, projection screen, etc., to be provided by Contractor.
- C. Training Manuals: Provide training manual for each attendee; allow for minimum of two attendees per training session.
 - 1. Include applicable portion of O&M manuals.
 - 2. Include copies of all hand-outs, slides, overheads, video presentations, etc., that are not included in O&M manuals.
 - 3. Provide one extra copy of each training manual to be included with operation and maintenance data.
- D. Training Reports:
 - 1. Identification of each training session, date, time, and duration.
 - 2. Sign-in sheet showing names and job titles of attendees.
 - 3. List of attendee questions and written answers given, including copies of and references to supporting documentation required for clarification; include answers to questions that could not be answered in original training session.

1.04 QUALITY ASSURANCE

- A. Instructor Qualifications: Familiar with design, operation, maintenance and troubleshooting of the relevant products and systems.
 - 1. Provide as instructors the most qualified trainer of those contractors and/or installers who actually supplied and installed the systems and equipment.
 - 2. Where a single person is not familiar with all aspects, provide specialists with necessary qualifications.

PART 3 EXECUTION

2.01 DEMONSTRATION - GENERAL

- A. Demonstrations conducted during system start-up do not qualify as demonstrations for the purposes of this section, unless approved in advance by Owner.
- B. Demonstration may be combined with Owner personnel training if applicable.
- C. Operating Equipment and Systems: Demonstrate operation in all modes, including start-up, shut-down, seasonal changeover, emergency conditions, and troubleshooting, and maintenance procedures, including scheduled and preventive maintenance.
 - 1. Perform demonstrations not less than two weeks prior to Substantial Completion.
 - 2. For equipment or systems requiring seasonal operation, perform demonstration for other season within six months.
- D. Non-Operating Products: Demonstrate cleaning, scheduled and preventive maintenance, and repair procedures.
 - 1. Perform demonstrations not less than two weeks prior to Substantial Completion.

2.02 TRAINING - GENERAL

- A. Conduct training on-site unless otherwise indicated.
- B. Owner will provide classroom and seating at no cost to Contractor.
- C. Provide training in minimum two hour segments, with minimum four hours total training unless longer training durations are required by individual specification sections.
- D. Training schedule will be subject to availability of Owner's personnel to be trained; re-schedule training sessions as required by Owner; once schedule has been approved by Owner failure to conduct sessions according to schedule will be cause for Owner to charge Contractor for personnel "show-up" time.
- E. Review of Facility Policy on Operation and Maintenance Data: During training discuss:
 - 1. The location of the O&M manuals and procedures for use and preservation; backup copies.
 - 2. Typical contents and organization of all manuals, including explanatory information, system narratives, and product specific information.
 - 3. Typical uses of the O&M manuals.
- F. Product- and System-Specific Training:
 - 1. Review the applicable O&M manuals.
 - 2. For systems, provide an overview of system operation, design parameters and constraints, and operational strategies.
 - 3. Review instructions for proper operation in all modes, including start-up, shut-down, seasonal changeover and emergency procedures, and for maintenance, including preventative maintenance.
 - 4. Provide hands-on training on all operational modes possible and preventive maintenance.
 - 5. Emphasize safe and proper operating requirements; discuss relevant health and safety issues and emergency procedures.
 - 6. Discuss common troubleshooting problems and solutions.

7. Discuss any peculiarities of equipment installation or operation.
 8. Discuss warranties and guarantees, including procedures necessary to avoid voiding coverage.
 9. Review recommended tools and spare parts inventory suggestions of manufacturers.
 10. Review spare parts and tools required to be furnished by Contractor.
 11. Review spare parts suppliers and sources and procurement procedures.
- G. Be prepared to answer questions raised by training attendees; if unable to answer during training session, provide written response within three days.

END OF SECTION

**SECTION 02 41 00
DEMOLITION**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Selective demolition of building elements for alteration purposes.

1.02 RELATED REQUIREMENTS

- A. Section 01 10 00 - Summary: Limitations on Contractor's use of site and premises.
- B. Section 01 50 00 - Temporary Facilities and Controls: Site fences, security, protective barriers, and waste removal.
- C. Section 01 70 00 - Execution and Closeout Requirements: Project conditions; protection of bench marks, survey control points, and existing construction to remain; reinstallation of removed products; temporary bracing and shoring.
- D. Section 01 74 19 - Construction Waste Management and Disposal: Limitations on disposal of removed materials; requirements for recycling.

1.03 REFERENCE STANDARDS

- A. 29 CFR 1926 - U.S. Occupational Safety and Health Standards.
- B. NFPA 241 - Standard for Safeguarding Construction, Alteration, and Demolition Operations.

PART 2 PRODUCTS -- NOT USED

PART 3 EXECUTION

3.01 SCOPE

- A. See drawings for demolition scope of work.
- B. Remove other items indicated, for salvage.
- C. Fill excavations, open pits, and holes in ground areas generated as result of removals, using specified fill; compact fill as specified in Section 31 22 00.

3.02 GENERAL PROCEDURES AND PROJECT CONDITIONS

- A. Comply with applicable codes and regulations for demolition operations and safety of adjacent structures and the public.
 - 1. Obtain required permits.
 - 2. Take precautions to prevent catastrophic or uncontrolled collapse of structures to be removed; do not allow worker or public access within range of potential collapse of unstable structures.
 - 3. Provide, erect, and maintain temporary barriers and security devices.
 - 4. Use physical barriers to prevent access to areas that could be hazardous to workers or the public.
 - 5. Conduct operations to minimize effects on and interference with adjacent structures and occupants.
 - 6. Do not close or obstruct roadways or sidewalks without permit.
 - 7. Conduct operations to minimize obstruction of public and private entrances and exits; do not obstruct required exits at any time; protect persons using entrances and exits from removal operations.
- B. Do not begin removal until receipt of notification to proceed from Owner.
- C. Do not begin removal until built elements to be salvaged or relocated have been removed.
- D. Do not begin removal until vegetation to be relocated has been removed and specified measures have been taken to protect vegetation to remain.

- E. Protect existing structures and other elements that are not to be removed.
 - 1. Provide bracing and shoring.
 - 2. Prevent movement or settlement of adjacent structures.
 - 3. Stop work immediately if adjacent structures appear to be in danger.
- F. Minimize production of dust due to demolition operations; do not use water if that will result in ice, flooding, sedimentation of public waterways or storm sewers, or other pollution.
- G. If hazardous materials are discovered during removal operations, stop work and notify Architect and Owner; hazardous materials include regulated asbestos containing materials, lead, PCB's, and mercury.

3.03 EXISTING UTILITIES

- A. Coordinate work with utility companies; notify before starting work and comply with their requirements; obtain required permits.
- B. Protect existing utilities to remain from damage.
- C. Do not disrupt public utilities without permit from authority having jurisdiction.
- D. Do not close, shut off, or disrupt existing life safety systems that are in use without at least 7 days prior written notification to Owner.
- E. Do not close, shut off, or disrupt existing utility branches or take-offs that are in use without at least 7 days prior written notification to Owner.
- F. Locate and mark utilities to remain; mark using highly visible tags or flags, with identification of utility type; protect from damage due to subsequent construction, using substantial barricades if necessary.
- G. Prepare building demolition areas by disconnecting and capping utilities outside the demolition zone; identify and mark utilities to be subsequently reconnected, in same manner as other utilities to remain.

3.04 SELECTIVE DEMOLITION FOR ALTERATIONS

- A. Drawings showing existing construction and utilities are based on casual field observation and existing record documents only.
 - 1. Verify that construction and utility arrangements are as shown.
 - 2. Report discrepancies to Architect before disturbing existing installation.
 - 3. Beginning of demolition work constitutes acceptance of existing conditions that would be apparent upon examination prior to starting demolition.
- B. Maintain weatherproof exterior building enclosure except for interruptions required for replacement or modifications; take care to prevent water and humidity damage.
- C. Remove existing work as indicated and as required to accomplish new work.
 - 1. Remove rotted wood, corroded metals, and deteriorated masonry and concrete; replace with new construction specified.
 - 2. Remove items indicated on drawings.
- D. Services (Including but not limited to HVAC, Plumbing, Electrical, and Telecommunications): Remove existing systems and equipment as indicated.
 - 1. Maintain existing active systems that are to remain in operation; maintain access to equipment and operational components.
 - 2. Where existing active systems serve occupied facilities but are to be replaced with new services, maintain existing systems in service until new systems are complete and ready for service.
 - 3. Verify that abandoned services serve only abandoned facilities before removal.

4. Remove abandoned pipe, ducts, conduits, and equipment, including those above accessible ceilings; remove back to source of supply where possible, otherwise cap stub and tag with identification.
- E. Protect existing work to remain.
 1. Prevent movement of structure; provide shoring and bracing if necessary.
 2. Perform cutting to accomplish removals neatly and as specified for cutting new work.
 3. Repair adjacent construction and finishes damaged during removal work.
 4. Patch as specified for patching new work.

3.05 DEBRIS AND WASTE REMOVAL

- A. Remove debris, junk, and trash from site.
- B. Remove from site all materials not to be reused on site; .
- C. Leave site in clean condition, ready for subsequent work.
- D. Clean up spillage and wind-blown debris from public and private lands.

END OF SECTION

SECTION 03 30 00
CAST-IN-PLACE CONCRETE

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Concrete formwork.
- B. Concrete slabs on grade
- C. Concrete building frame members.
- D. Concrete reinforcement.
- E. Concrete curing.

1.02 RELATED REQUIREMENTS

- A. Section - Joint Sealers: Sealants for saw cut joints and isolation joints in slabs.

1.03 REFERENCE STANDARDS

- A. ACI 117 - Standard Specifications for Tolerances for Concrete Construction and Materials.
- B. ACI 304R - Guide for Measuring, Mixing, Transporting, and Placing Concrete.
- C. ACI 305R - Hot Weather Concreting.
- D. ACI 306R - Cold Weather Concreting.
- E. ACI 308R - Guide to Curing Concrete.
- F. ASTM A767/A767M - Standard Specification for Zinc-Coated (Galvanized) Steel Bars for Concrete Reinforcement.
- G. ASTM A775/A775M - Standard Specification for Epoxy-Coated Steel Reinforcing Bars.
- H. ASTM A884/A884M - Standard Specification for Epoxy-Coated Steel Wire and Welded Wire Reinforcement.
- I. ASTM A1064/A1064M - Standard Specification for Carbon-Steel Wire and Welded Wire Reinforcement, Plain and Deformed, for Concrete.
- J. ASTM C33/C33M - Standard Specification for Concrete Aggregates.
- K. ASTM C94/C94M - Standard Specification for Ready-Mixed Concrete.
- L. ASTM C171 - Standard Specification for Sheet Materials for Curing Concrete.
- M. ASTM C173/C173M - Standard Test Method for Air Content of Freshly Mixed Concrete by the Volumetric Method.
- N. ASTM C260/C260M - Standard Specification for Air-Entraining Admixtures for Concrete.
- O. ASTM C330/C330M - Standard Specification for Lightweight Aggregates for Structural Concrete.
- P. ASTM C618 - Standard Specification for Coal Fly Ash and Raw or Calcined Natural Pozzolan for Use in Concrete.
- Q. ASTM C685/C685M - Standard Specification for Concrete Made by Volumetric Batching and Continuous Mixing.
- R. ASTM C1059/C1059M - Standard Specification for Latex Agents for Bonding Fresh to Hardened Concrete.
- S. ASTM C1107/C1107M - Standard Specification for Packaged Dry, Hydraulic-Cement Grout (Nonshrink).
- T. ASTM C1240 - Standard Specification for Silica Fume Used in Cementitious Mixtures.

- U. ASTM D994/D994M - Standard Specification for Preformed Expansion Joint Filler for Concrete (Bituminous Type).
- V. ASTM D1751 - Standard Specification for Preformed Expansion Joint Filler for Concrete Paving and Structural Construction (Nonextruding and Resilient Bituminous Types).
- W. ASTM D1752 - Standard Specification for Preformed Sponge Rubber Cork and Recycled PVC Expansion Joint Fillers for Concrete Paving and Structural Construction.
- X. ASTM D2103 - Standard Specification for Polyethylene Film and Sheeting.
- Y. ASTM D3963/D3963M - Standard Specification for Fabrication and Jobsite Handling of Epoxy-Coated Reinforcing Steel Bars.
- Z. ASTM E1643 - Standard Practice for Selection, Design, Installation and Inspection of Water Vapor Retarders Used in Contact with Earth or Granular Fill Under Concrete Slabs.
- AA. ASTM E1745 - Standard Specification for Plastic Water Vapor Retarders Used in Contact with Soil or Granular Fill under Concrete Slabs.
- AB. ASTM E1993/E1993M - Standard Specification for Bituminous Water Vapor Retarders Used in Contact with Soil or Granular Fill Under Concrete Slabs.
- AC. COE CRD-C 48 - Method of Test for Water Permeability of Concrete.
- AD. NSF 61 - Drinking Water System Components - Health Effects.
- AE. NSF 372 - Drinking Water System Components - Lead Content.

1.04 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Submit manufacturers' data on manufactured products showing compliance with specified requirements and installation instructions.
- C. Mix Design: Submit proposed concrete mix design.

1.05 QUALITY ASSURANCE

- A. Perform work of this section in accordance with ACI 301 and ACI 318.
- B. Follow recommendations of ACI 305R when concreting during hot weather.
- C. Follow recommendations of ACI 306R when concreting during cold weather.
- D. For slabs required to include moisture vapor reduction admixture (MVRA), do not proceed with placement unless manufacturer's representative is present for every day of placement.

1.06 WARRANTY

- A. See Section 01 78 00 - Closeout Submittals, for additional warranty requirements.

PART 2 PRODUCTS

2.01 FORMWORK

- A. Formwork Design and Construction: Comply with guidelines of ACI 347 to provide formwork that will produce concrete complying with tolerances of ACI 117.
- B. Form Materials: Contractor's choice of standard products with sufficient strength to withstand hydrostatic head without distortion in excess of permitted tolerances.
 - 1. Form Facing for Exposed Finish Concrete: Contractor's choice of materials that will provide smooth, stain-free final appearance.
 - 2. Earth Cuts: Do not use earth cuts as forms for vertical surfaces. Natural rock formations that maintain a stable vertical edge may be used as side forms.
 - 3. Form Coating: Release agent that will not adversely affect concrete or interfere with application of coatings.

4. Form Ties: Cone snap type that will leave no metal within 1-1/2 inches of concrete surface.

2.02 REINFORCEMENT

- A. Reinforcing Steel: ASTM A615/A615M Grade 60 (420).
 1. Type: Deformed billet-steel bars.
 2. Finish: Unfinished, unless otherwise indicated.
 3. Finish: Galvanized in accordance with ASTM A767/A767M, Class I, unless otherwise indicated.
 4. Finish: Epoxy coated in accordance with ASTM A775/A775M, unless otherwise indicated.
- B. Steel Welded Wire Reinforcement: ASTM A1064/A1064M, plain type.
 1. Form: Coiled Rolls.
 2. Mesh Size: 6 x 12.
 3. Wire Gage: W 4 x W 4.
- C. Reinforcement Accessories:
 1. Tie Wire: Annealed, minimum 16 gage.
 2. Chairs, Bolsters, Bar Supports, Spacers: Sized and shaped for adequate support of reinforcement during concrete placement.
 3. Provide stainless steel, galvanized, plastic, or plastic coated steel components for placement within 1-1/2 inches of weathering surfaces.

2.03 CONCRETE MATERIALS

- A. Cement: ASTM C150, Type I - Normal Portland type.
 1. Acquire all cement for entire project from same source.
- B. Fine and Coarse Aggregates: ASTM C 33.
 1. Acquire all aggregates for entire project from same source.
- C. Lightweight Aggregate: ASTM C330/C330M.
- D. Fly Ash: ASTM C618, Class C or F.
- E. Calcined Pozzolan: ASTM C618, Class N.
- F. Silica Fume: ASTM C1240, proportioned in accordance with ACI 211.1.
- G. Water: Clean and not detrimental to concrete.

2.04 ADMIXTURES

- A. Do not use chemicals that will result in soluble chloride ions in excess of 0.1 percent by weight of cement.
- B. Waterproofing Admixture: Admixture formulated to reduce permeability to liquid water, with no adverse effect on concrete properties.
 1. Permeability of Cured Concrete: No measurable leakage when tested in accordance with COE CRD-C 48 at 350 feet of head; provide test reports.
 2. Potable Water Contact Approval: NSF certification for use on structures holding potable water, based on testing in accordance with NSF 61 and NSF 372.

2.05 CONCRETE MIX DESIGN

- A. Proportioning Normal Weight Concrete: Comply with ACI 211.1 recommendations.
- B. Admixtures: Add acceptable admixtures as recommended in ACI 211.1 and at rates recommended or required by manufacturer.
- C. Normal Weight Concrete:
 1. Compressive Strength, when tested in accordance with ASTM C39/C39M at 28 days: 4,000 pounds per square inch.

- D. Structural Lightweight Concrete:
 - 1. Compressive Strength, when tested in accordance with ASTM C39/C39M at 28 days: 4,000 pounds per square inch.

2.06 MIXING

- A. On Project Site: Mix in drum type batch mixer, complying with ASTM C685. Mix each batch not less than 1-1/2 minutes and not more than 5 minutes.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify lines, levels, and dimensions before proceeding with work of this section.

3.02 PREPARATION

- A. Formwork: Comply with requirements of ACI 301. Design and fabricate forms to support all applied loads until concrete is cured, and for easy removal without damage to concrete.
- B. Where new concrete is to be bonded to previously placed concrete, prepare existing surface by cleaning with steel brush and applying bonding agent in accordance with manufacturer's instructions.
- C. Where new concrete with integral waterproofing is to be bonded to previously placed concrete, prepare surfaces to be treated in accordance with waterproofing manufacturer's instructions. Saturate cold joint surface with clean water, and remove excess water before application of coat of waterproofing admixture slurry. Apply slurry coat uniformly with semi-stiff bristle brush at rate recommended by waterproofing manufacturer.

3.03 INSTALLING REINFORCEMENT AND OTHER EMBEDDED ITEMS

- A. Fabricate and handle epoxy-coated reinforcing in accordance with ASTM D3963/D3963M.
- B. Comply with requirements of ACI 301. Clean reinforcement of loose rust and mill scale, and accurately position, support, and secure in place to achieve not less than minimum concrete coverage required for protection.
- C. Install welded wire reinforcement in maximum possible lengths, and offset end laps in both directions. Splice laps with tie wire.

3.04 PLACING CONCRETE

- A. Place concrete in accordance with ACI 304R.

3.05 CONCRETE FINISHING

3.06 CURING AND PROTECTION

- A. Comply with requirements of ACI 308R. Immediately after placement, protect concrete from premature drying, excessively hot or cold temperatures, and mechanical injury.
- B. Maintain concrete with minimal moisture loss at relatively constant temperature for period necessary for hydration of cement and hardening of concrete.

3.07 FIELD QUALITY CONTROL

- A. An independent testing agency will perform field quality control tests, as specified in Section 01 40 00.
- B. Provide free access to concrete operations at project site and cooperate with appointed firm.
- C. Take one additional test cylinder during cold weather concreting, cured on job site under same conditions as concrete it represents.

3.08 DEFECTIVE CONCRETE

- A. Repair or replacement of defective concrete will be determined by the Architect. The cost of additional testing shall be borne by Contractor when defective concrete is identified.

3.09 PROTECTION

- A. Do not permit traffic over unprotected concrete floor surface until fully cured.

END OF SECTION

SECTION 03 35 23
EXPOSED AGGREGATE CONCRETE FINISHING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Exposed aggregate concrete finish on cast-in-place concrete work specified in Section 03 30 00.

1.02 RELATED REQUIREMENTS

- A. Section 03 30 00 - Cast-in-Place Concrete.

1.03 REFERENCE STANDARDS

- A. ACI 301 - Specifications for Structural Concrete.
- B. ACI 303R - Guide to Cast-in-Place Architectural Concrete Practice.
- C. ACI 308R - Guide to Curing Concrete.

1.04 QUALITY ASSURANCE

- A. Perform Work in accordance with ACI 301 and ACI 303R.

PART 2 PRODUCTS

2.01 CONCRETE MATERIALS

- A. Cement, Water, Admixtures: Specified in Section 03 30 00.

2.02 ACCESSORY MATERIALS

- A. Surface Retarder for Horizontal Surfaces: Spray-on liquid that retards surface set.
- B. Surface Retarder for Formed Surfaces: Form release agent that retards surface set.
- C. High Gloss Clear Sealer: Non-yellowing, transparent combination curing compound and sealer complying with ASTM C1315 Type I Class A.
 - 1. Composition: Acrylic.
 - 2. Vehicle: Solvent-based.

2.03 CONCRETE MIX

- A. Concrete mix design is specified in Section 03 30 00.

2.04 SOURCE QUALITY CONTROL

- A. Test samples in accordance with ACI 301.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that items to be cast into concrete are placed securely and will not impede placing concrete.
- B. Notify Architect minimum 24 hours prior to commencement of concreting operations.

3.02 PREPARATION

- A. Clean formwork surfaces.
- B. Apply surface retarder to formwork in accordance with manufacturer's instructions.
- C. Clean previously placed concrete with steel brush and apply bonding agent in accordance with manufacturer's instructions.

3.03 PLACING CONCRETE

- A. Place concrete in accordance with Section 03 30 00.

3.04 AGGREGATE EXPOSURE

- A. Immediately after removal of formwork, wash retarded concrete surfaces with water and scrub with stiff bristle brush exposing aggregate to match accepted sample panel.

3.05 CURING

- A. Cure concrete floor surfaces as specified in 03 30 00.

3.06 CLEANING

- A. When desired finish is achieved, wash and rinse exposed aggregate surfaces.

3.07 DEFECTIVE CONCRETE

- A. Patch, cure, and finish imperfections to match adjacent areas.
- B. Modify or replace concrete not conforming to line, detail, and elevations indicated and appearance requirements.

3.08 PROTECTION

- A. Protect concrete from premature drying or staining, excessively hot or cold temperatures, or mechanical injury.

END OF SECTION

SECTION 04 05 11
MASONRY MORTARING AND GROUTING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Mortar for unit masonry.
- B. Grout for masonry.
- C. Mortar for cast stone masonry.

1.02 RELATED REQUIREMENTS

- A. Section 04 20 00 - Unit Masonry: Installation of mortar and grout.
- B. Section 04 72 00 - Cast Stone Masonry
- C. See Structural Drawings for additional Project Specifications. If Conflicting Project Specifications arise, the Project Specifications on the Structural Drawings govern.

1.03 REFERENCE STANDARDS

- A. ACI 530/530.1/ERTA - Building Code Requirements and Specification for Masonry Structures and Related Commentaries.
- B. ACI 530.1/ASCE 6/TMS 602 - Specification for Masonry Structures; American Concrete Institute International.
- C. ASTM C5 - Standard Specification for Quicklime for Structural Purposes.
- D. ASTM C94/C94M - Standard Specification for Ready-Mixed Concrete.
- E. ASTM C144 - Standard Specification for Aggregate for Masonry Mortar.
- F. ASTM C150/C150M - Standard Specification for Portland Cement.
- G. ASTM C207 - Standard Specification for Hydrated Lime for Masonry Purposes.
- H. ASTM C270 - Standard Specification for Mortar for Unit Masonry.
- I. ASTM C404 - Standard Specification for Aggregates for Masonry Grout.
- J. ASTM C476 - Standard Specification for Grout for Masonry.
- K. ASTM C780 - Standard Test Method for Preconstruction and Construction Evaluation of Mortars for Plain and Reinforced Unit Masonry.
- L. ASTM C1019 - Standard Test Method for Sampling and Testing Grout.
- M. ASTM C1072 - Standard Test Method for Measurement of Masonry Flexural Bond Strength.
- N. ASTM C1314 - Standard Test Method for Compressive Strength of Masonry Prisms.
- O. ASTM E518/E518M - Standard Test Methods for Flexural Bond Strength of Masonry.
- P. IMIAWC (CW) - Recommended Practices & Guide Specifications for Cold Weather Masonry Construction; International Masonry Industry All-Weather Council; 1993.
- Q. IMIAWC (HW) - Recommended Practices & Guide Specifications for Hot Weather Masonry Construction; International Masonry Industry All-Weather Council; current edition.

1.04 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Include design mix based on the Proportion specification of ASTM C 270 is to be used.
- C. Manufacturer's Certificate: Certify that products meet or exceed specified requirements.

1.05 QUALITY ASSURANCE

- A. Comply with provisions of ACI 530/530.1/ERTA, except where exceeded by requirements of the contract documents.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. Maintain packaged materials clean, dry, and protected against dampness, freezing, and foreign matter.

1.07 FIELD CONDITIONS

- A. Maintain materials and surrounding air temperature to minimum 40 degrees F prior to, during, and 48 hours after completion of masonry work.
- B. Maintain materials and surrounding air temperature to maximum 90 degrees F prior to, during, and 48 hours after completion of masonry work.

PART 2 PRODUCTS

2.01 MORTAR AND GROUT APPLICATIONS

- A. At Contractor's option, mortar and grout may be field-mixed from packaged dry materials, made from factory premixed dry materials with addition of water only, or ready-mixed.
- B. Mortar Mix Designs: ASTM C270, Property Specification.

2.02 MATERIALS

- A. Packaged Dry Material for Mortar for Unit Masonry: Premixed Portland cement, hydrated lime, and sand; complying with ASTM C387/C387M and capable of producing mortar of the specified strength in accordance with ASTM C270 with the addition of water only.
 - 1. Color: Mineral pigments added as required to produce approved color sample.
 - 2. Products:
 - a. Amerimix, an Oldcastle brand; AMX 400: www.amerimix.com.
 - b. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Masonry Cement: ASTM C91.
 - 1. Type: Type N.
 - 2. Colored Mortar: Premixed cement as required to match Architect's color sample.
 - 3. Manufacturers:
 - a. Solomon Colors; Solomon Colors Concentrated A, H, and X Series: www.solomoncolors.com.
 - b. Substitutions: See Section 01 60 00 - Product Requirements.
- C. Portland Cement: ASTM C 150, Type I - Normal; color as required to produce approved color sample. Color must match existing building mortar color.
- D. Hydrated Lime: ASTM C207, Type S.
- E. Quicklime: ASTM C5, non-hydraulic type.
- F. Mortar Aggregate: ASTM C144.
- G. Grout Aggregate: ASTM C404.
- H. Pigments for Colored Mortar: Pure, concentrated mineral pigments specifically intended for mixing into mortar and complying with ASTM C979/C979M.
 - 1. Color(s): As selected by Architect from manufacturer's full range, to match existing mortar.
 - 2. Manufacturers:
 - a. Davis Colors
 - b. Lambert Corporation
 - c. Solomon Colors

d. Substitutions: See Section 01 60 00 - Product Requirements.

I. Water: Clean and potable.

2.03 MORTAR MIXES

- A. Mortar for Unit Masonry: ASTM C270, Property Specification.
 - 1. Exterior, non-loadbearing masonry: Type N.
 - 2. Interior, non-loadbearing masonry: Type N.

2.04 MORTAR MIXING

- A. Thoroughly mix mortar ingredients using mechanical batch mixer, in accordance with ASTM C270 and in quantities needed for immediate use.
- B. Maintain sand uniformly damp immediately before the mixing process.
- C. Colored Mortar: Proportion selected pigments and other ingredients to match Architect's sample, without exceeding manufacturer's recommended pigment-to-cement ratio; mix in accordance with manufacturer's instructions, uniform in coloration.
- D. Do not use anti-freeze compounds to lower the freezing point of mortar.
- E. If water is lost by evaporation, re-temper only within two hours of mixing.
- F. Use mortar within two hours after mixing at temperatures of 90 degrees F, or two-and-one-half hours at temperatures under 40 degrees F.

PART 3 EXECUTION

3.01 PREPARATION

- A. Apply bonding agent to existing Masonry surfaces.
- B. Plug clean-out holes for grouted masonry with Brick or block masonry units. Brace masonry to resist wet grout pressure.

3.02 INSTALLATION

- A. Install mortar and grout to requirements of section(s) in which masonry is specified.
- B. Work grout into masonry cores and cavities to eliminate voids.
- C. Do not install grout in lifts greater than 16 inches without consolidating grout by rodding.
- D. Do not displace reinforcement while placing grout.
- E. Remove excess mortar from grout spaces.

END OF SECTION

SECTION 04 20 00
UNIT MASONRY

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Clay Facing Brick.
- B. Accessories.

1.02 RELATED REQUIREMENTS

- A. Section 04 05 11 - Masonry Mortaring and Grouting.
- B. Section - Joint Sealers: Backing rod and sealant at control and expansion joints.

1.03 REFERENCE STANDARDS

- A. ACI 530/530.1/ERTA - Building Code Requirements and Specification for Masonry Structures and Related Commentaries.
- B. ACI 530.1/ASCE 6/TMS 602 - Specification For Masonry Structures; American Concrete Institute International.
- C. ASTM C62 - Standard Specification for Building Brick (Solid Masonry Units Made From Clay or Shale).
- D. ASTM C67 - Standard Test Methods for Sampling and Testing Brick and Structural Clay Tile.
- E. ASTM C144 - Standard Specification for Aggregate for Masonry Mortar.
- F. ASTM C150/C150M - Standard Specification for Portland Cement.
- G. ASTM C207 - Standard Specification for Hydrated Lime for Masonry Purposes.
- H. ASTM C216 - Standard Specification for Facing Brick (Solid Masonry Units Made From Clay or Shale).
- I. ASTM C270 - Standard Specification for Mortar for Unit Masonry.
- J. ASTM C404 - Standard Specification for Aggregates for Masonry Grout.
- K. ASTM C476 - Standard Specification for Grout for Masonry.
- L. ASTM C652 - Standard Specification for Hollow Brick (Hollow Masonry Units Made From Clay or Shale).
- M. ASTM C744 - Standard Specification for Prefaced Concrete and Calcium Silicate Masonry Units.
- N. ASTM C780 - Standard Test Method for Preconstruction and Construction Evaluation of Mortars for Plain and Reinforced Unit Masonry.
- O. IMIABC (CW) - Recommended Practices & Guide Specifications for Cold Weather Masonry Construction; International Masonry Industry All-Weather Council; 1993.
- P. IMIABC (HW) - Recommended Practices & Guide Specifications for Hot Weather Masonry Construction; International Masonry Industry All-Weather Council; current edition.
- Q. UL (FRD) - Fire Resistance Directory.

1.04 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide data for masonry units, mortar, and masonry accessories.
- C. Samples: Submit four samples of concrete block units to illustrate color, texture, and extremes of color range.
- D. Manufacturer's Certificate: Certify that masonry units meet or exceed specified requirements.

1.05 QUALITY ASSURANCE

- A. Comply with provisions of ACI 530/530.1/ERTA, except where exceeded by requirements of the contract documents.
 - 1. Maintain one copy of each document on project site.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. Deliver, handle, and store masonry units by means that will prevent mechanical damage and contamination by other materials.

1.07 ENVIRONMENTAL REQUIREMENTS

- A. Maintain materials and surrounding air temperature to minimum 40 degrees F prior to, during, and 48 hours after completion of masonry work.
- B. Maintain materials and surrounding air temperature to maximum 90 degrees F prior to, during, and 48 hours after completion of masonry work.

PART 2 PRODUCTS

2.01 BRICK UNITS

- A. Manufacturers:
 - 1. Belden Brick Company: www.boralbricks.com.
 - 2. Endicott Clay Products Co; _____: www.endicott.com.
 - 3. General Shale Brick; _____: www.generalshale.com.
 - 4. Glen Gery Brick . www.glengerybrick.com
 - 5. Substitutions: See section 01 60 00 - Product Requirements.
- B. Facing Brick: ASTM C216, Type FBX, Grade SW.
 - 1. Type, color and texture: to match existing brick.
 - 2. Actual size: to match existing brick.
 - 3. Compressive strength: Min. 2,500 p.s.i.; 5 brick average = 3,000 p.s.i, measured in accordance with ASTM C 67.

2.02 MORTAR AND GROUT MATERIALS

- A. Mortar and Grout: As specified in Section 04 05 11.

2.03 REINFORCEMENT AND ANCHORAGE

- A. Manufacturers of Joint Reinforcement and Anchors:
 - 1. Dur-O-Wal: www.dur-o-wal.com.
 - 2. Hohmann & Barnard, Inc: www.h-b.com.
 - 3. WIRE-BOND: www.wirebond.com.
 - 4. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Single Wythe Joint Reinforcement: Truss or Ladder type; ASTM A 82/A 82M steel wire, hot dip galvanized after fabrication to ASTM A 153/A 153M, Class B-2; 0.1483 inch side rods with 0.1483 inch cross rods; width as required to provide not more than 1 inch and not less than 1/2 inch of mortar coverage on each exposure.
- C. Strap Anchors: Bent steel shapes configured as required for specific situations, 2 in width, 0.1875 in thick, lengths as required to provide not more than 1 inch and not less than 1/2 inch of mortar coverage from masonry face, corrugated for embedment in masonry joint, hot dip galvanized to ASTM A 153/A 153M, Class B-2 or stainless steel.
- D. Flexible Anchors: 2-piece anchors that permit differential movement between masonry and building frame, sized to provide not more than 1 inch and not less than 1/2 inch of mortar coverage from masonry face.
 - 1. Steel frame: Crimped wire anchors for welding to frame, 0.25 inch thick, with trapezoidal wire ties 0.1875 inch thick, hot dip galvanized to ASTM A 153/A 153M, Class B-2.

- E. Two-Piece Wall Ties: Formed steel wire, 0.1875 inch thick, adjustable, eye and pintle type, hot dip galvanized to ASTM A 153/A 153M, Class B-2, sized to provide not more than 1 inch and not less than 1/2 inch of mortar coverage from masonry face and to allow vertical adjustment of up to 1-1/4 in.

2.04 FLASHINGS

- A. Rubberized Asphalt Flashing: Self-adhering polymer modified asphalt sheet; 40 mils (0.040 inch) minimum total thickness; with cross laminated polyethylene top and bottom surfaces.

2.05 ACCESSORIES

- A. Drip Edge: Stainless steel; compatible with membrane and adhesives.
- B. Weeps: Polyethylene tubing.
- C. Cleaning Solution: Non-acidic, not harmful to masonry work or adjacent materials.

2.06 MORTAR AND GROUT MIXES

- A. Mortar and Grout mixes as specified in Section 04 05 11.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field conditions are acceptable and are ready to receive masonry.
- B. Verify that related items provided under other sections are properly sized and located.
- C. Verify that built-in items are in proper location, and ready for roughing into masonry work.

3.02 PREPARATION

- A. Direct and coordinate placement of items supplied for installation under other sections.
- B. Provide temporary bracing during installation of masonry work. Maintain in place until building structure provides permanent bracing.

3.03 PLACING AND BONDING

- A. Lay solid masonry units in full bed of mortar, with full head joints, uniformly jointed with other work.
- B. Lay hollow masonry units with face shell bedding on head and bed joints.
- C. Buttering corners of joints or excessive furrowing of mortar joints is not permitted.
- D. Remove excess mortar and mortar smears as work progresses.
- E. Interlock intersections and external corners.
- F. Do not shift or tap masonry units after mortar has achieved initial set. Where adjustment must be made, remove mortar and replace.
- G. Set reglets as shown on plans.
- H. Perform job site cutting of masonry units with proper tools to provide straight, clean, unchipped edges. Prevent broken masonry unit corners or edges.
- I. Cut mortar joints flush where wall tile is scheduled, cement parging is required, or resilient base is scheduled. Block exposed cavity space with raiseable steel guard of correct width.
- J. Isolate masonry partitions from vertical structural framing members with a control joint as indicated.
- K. Isolate top joint of masonry partitions from horizontal structural framing members and slabs or decks with compressible joint filler.

3.04 WEEPS

- A. Install weeps in veneer walls at 24 inches on center horizontally above opening, above through-wall flashing, above shelf angles and lintels, at bottom of walls, and as shown on drawings.

3.05 REINFORCEMENT AND ANCHORAGE - GENERAL

- A. Fasten anchors to structural framing and embed in masonry joints as masonry is laid. Unless otherwise indicated on drawings or closer spacing is indicated under specific wall type, space anchors at maximum of 16 inches horizontally and 16 inches vertically.

3.06 LINTELS

- A. Install loose steel lintels over openings, where shown on drawings.
- B. Maintain minimum 4 inch bearing on each side of opening.

3.07 TOLERANCES

- A. Maximum Variation From Unit to Adjacent Unit: 1/16 inch.
- B. Maximum Variation from Plane of Wall: 1/4 inch in 10 ft.
- C. Maximum Variation from Plumb: 1/4 inch per story non-cumulative; 1/2 inch in two stories or more.
- D. Maximum Variation from Level Coursing: 1/8 inch in 3 ft and 1/4 inch in 20ft.
- E. Maximum Variation of Mortar Joint Thickness: Head joint, minus 1/4 inch, plus 3/8 inch.
- F. Maximum Variation from Cross Sectional Thickness of Walls: 1/4 inch.

3.08 CLEANING

- A. Remove excess mortar and mortar droppings.
- B. Replace defective mortar. Match adjacent work.
- C. Clean soiled surfaces with cleaning solution.
- D. Use non-metallic tools in cleaning operations.

3.09 PROTECTION

- A. Without damaging completed work, provide protective boards at exposed external corners that are subject to damage by construction activities.

END OF SECTION

SECTION 05 50 00
METAL FABRICATIONS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Shop fabricated steel items.

1.02 RELATED REQUIREMENTS

- A. Section 04 20 00 - Unit Masonry: Placement of metal fabrications in masonry.

PART 2 PRODUCTS

2.01 MATERIALS - STEEL

- A. Steel Sections: ASTM A36/A36M.
- B. Touch-Up Primer for Galvanized Surfaces: SSPC-Paint 20, Type I - Inorganic, complying with VOC limitations of authorities having jurisdiction.

2.02 FABRICATED ITEMS

- A. Lintels: As detailed; galvanized finish.

2.03 FINISHES - STEEL

- A. Clean surfaces of rust, scale, grease, and foreign matter prior to finishing.
- B. Galvanizing of Non-structural Items: Galvanize after fabrication to ASTM A123/A123M requirements.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field conditions are acceptable and are ready to receive work.

3.02 INSTALLATION

- A. Install items plumb and level, accurately fitted, free from distortion or defects.

END OF SECTION

SECTION 06 10 00
ROUGH CARPENTRY

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Structural dimension lumber framing.

1.02 RELATED REQUIREMENTS

- A. Section 09 21 16 - Gypsum Board Assemblies: Gypsum-based sheathing.

1.03 REFERENCE STANDARDS

- A. AWC (WFCM) - Wood Frame Construction Manual for One- and Two-Family Dwellings.
- B. ASTM A153/A153M - Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware.
- C. ASTM A653/A653M - Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process.
- D. ASTM D2898 - Standard Test Methods for Accelerated Weathering of Fire-Retardant-Treated Wood for Fire Testing.
- E. ASTM E84 - Standard Test Method for Surface Burning Characteristics of Building Materials.
- F. AWPA C2 - Lumber, Timber, Bridge Ties and Mine Ties -- Preservative Treatment by Pressure Processes; American Wood Protection Association.
- G. AWPA C20 - Structural Lumber -- Fire Retardant Treatment by Pressure Processes; American Wood-Protection Association.
- H. AWPA U1 - Use Category System: User Specification for Treated Wood.
- I. ICC-ES AC38 - Acceptance Criteria for Water-Resistive Barriers; ICC Evaluation Service, Inc.
- J. PS 20 - American Softwood Lumber Standard.
- K. SPIB (GR) - Grading Rules.

1.04 QUALITY ASSURANCE

- A. Lumber: Comply with PS 20 and approved grading rules and inspection agencies.
 - 1. Lumber of other species or grades, or graded by other agencies, is acceptable provided structural and appearance characteristics are equivalent to or better than products specified.
- B. Fire-Retardant Treated Wood: Mark each piece of wood with producer's stamp indicating compliance with specified requirements.
- C. Preservative-Treated Wood: Provide lumber and plywood marked or stamped by an ALSC-accredited testing agency, certifying level and type of treatment in accordance with AWPA standards.

1.05 DELIVERY, STORAGE, AND HANDLING

- A. General: Cover wood products to protect against moisture. Support stacked products to prevent deformation and to allow air circulation.
- B. Fire Retardant Treated Wood: Prevent exposure to precipitation during shipping, storage, or installation.

PART 2 PRODUCTS

2.01 DIMENSION LUMBER FOR CONCEALED APPLICATIONS

- A. Grading Agency: Southern Pine Inspection Bureau, Inc. (SPIB).
- B. Sizes: Nominal sizes as indicated on drawings, S4S.

- C. Moisture Content: S-dry or MC19.
- D. Stud Framing (2 by 2 through 2 by 6):
 - 1. Species: Douglas Fir-Larch.
 - 2. Grade: No. 2.
- E. Miscellaneous Framing, Blocking, Nailers, Grounds, and Furring:
 - 1. Lumber: S4S No. 2 or Standard Grade.
 - 2. Boards: Standard or No. 3.
- F. Miscellaneous Blocking, Furring, Nailers, and Curbs:
 - 1. Lumber: S4S, No. 1 or Construction Grade.
 - 2. Boards: Standard.

2.02 ACCESSORIES

- A. Fasteners and Anchors:
 - 1. Metal and Finish: Hot-dipped galvanized steel per ASTM A 153/A 153M; or Stainless Steel for high humidity and preservative-treated wood locations, unfinished steel elsewhere.

PART 3 EXECUTION

3.01 INSTALLATION - GENERAL

- A. Select material sizes to minimize waste.
- B. Reuse scrap to the greatest extent possible; clearly separate scrap for use on site as accessory components, including: shims, bracing, and blocking.
- C. Where treated wood is used on interior, provide temporary ventilation during and immediately after installation sufficient to remove indoor air contaminants.

3.02 FRAMING INSTALLATION

- A. Select material sizes to minimize waste.
- B. Reuse scrap to the greatest extent possible; clearly separate scrap for use on site as accessory components, including: shims, bracing, and blocking.
- C. Set structural members level, plumb, and true to line. Discard pieces with defects that would lower required strength or result in unacceptable appearance of exposed members.
- D. Make provisions for temporary construction loads, and provide temporary bracing sufficient to maintain structure in true alignment and safe condition until completion of erection and installation of permanent bracing.
- E. Install structural members full length without splices unless otherwise specifically detailed.
- F. Comply with member sizes, spacing, and configurations indicated, and fastener size and spacing indicated, but not less than required by applicable codes and AFPA Wood Frame Construction Manual.

3.03 BLOCKING, NAILERS, AND SUPPORTS

- A. Provide framing and blocking members as indicated or as required to support finishes, fixtures, specialty items, and trim.

3.04 TOLERANCES

- A. Framing Members: 1/4 inch from true position, maximum.
- B. Surface Flatness of Floor: 1/8 inch in 10 feet maximum, and 1/4 inch in 30 feet maximum.
- C. Variation from Plane (Other than Floors): 1/4 inch in 10 feet maximum, and 1/4 inch in 30 feet maximum.

3.05 CLEANING

- A. Waste Disposal: Comply with the requirements of Section 01 77 00.
 - 1. Comply with applicable regulations.
 - 2. Do not burn scrap on project site.
 - 3. Do not burn scraps that have been pressure treated.
 - 4. Do not send materials treated with pentachlorophenol, CCA, or ACA to co-generation facilities or “waste-to-energy” facilities.
- B. Do not leave any wood, shavings, sawdust, etc. on the ground or buried in fill.
- C. Prevent sawdust and wood shavings from entering the storm drainage system.

END OF SECTION

SECTION 07 84 00
FIRESTOPPING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Firestopping systems.
- B. Firestopping of all joints and penetrations in fire-resistance rated and smoke-resistant assemblies, whether indicated on drawings or not, and other openings indicated.

1.02 RELATED REQUIREMENTS

- A. Section 09 21 16 - Gypsum Board Assemblies: Gypsum wallboard fireproofing.

1.03 REFERENCE STANDARDS

- A. ASTM E119 - Standard Test Methods for Fire Tests of Building Construction and Materials.
- B. ASTM E814 - Standard Test Method for Fire Tests of Through-Penetration Fire Stops.
- C. ASTM E1966 - Standard Test Method for Fire Resistive Joint Systems.
- D. ASTM E2837 - Standard Test Method for Determining the Fire Resistance of Continuity Head-of-Wall Joint Systems Installed Between Rated Wall Assemblies and Nonrated Horizontal Assemblies.
- E. ITS (DIR) - Directory of Listed Products.
- F. FM 4991 - Approval Standard for Firestop Contractors.
- G. FM P7825 - Approval Guide; Factory Mutual Research Corporation.
- H. SCAQMD 1168 - South Coast Air Quality Management District Rule No.1168.
- I. UL 2079 - Standard for Tests for Fire Resistance of Building Joint Systems.
- J. UL (FRD) - Fire Resistance Directory.

1.04 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Schedule of Firestopping: List each type of penetration, fire rating of the penetrated assembly, and firestopping test or design number.
- C. Product Data: Provide data on product characteristics, performance ratings, and limitations.
- D. Manufacturer's Installation Instructions: Indicate preparation and installation instructions.
- E. Manufacturer's Certificate: Certify that products meet or exceed specified requirements.
- F. Certificate from authority having jurisdiction indicating approval of materials used.
- G. Installer Qualification: Submit qualification statements for installing mechanics.

1.05 QUALITY ASSURANCE

- A. Fire Testing: Provide firestopping assemblies of designs that provide the scheduled fire ratings when tested in accordance with methods indicated.
 - 1. Listing in the current-year classification or certification books of UL, FM, or ITS (Warnock Hersey) will be considered as constituting an acceptable test report.
 - 2. Valid evaluation report published by ICC Evaluation Service, Inc. (ICC-ES) at www.icc-es.org will be considered as constituting an acceptable test report.
 - 3. Submission of actual test reports is required for assemblies for which none of the above substantiation exists.
- B. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum ten years documented experience.

- C. Installer Qualifications: Company specializing in performing the work of this section and:
 - 1. Approved by Factory Mutual Research under FM Standard 4991, Approval of Firestop Contractors, or meeting any two of the following requirements:
 - 2. With minimum 5 years documented experience installing work of this type.
 - 3. Able to show at least 3 satisfactorily completed projects of comparable size and type.
 - 4. Licensed by authority having jurisdiction.
 - 5. Approved by firestopping manufacturer.
- D. Installing Mechanic's Qualifications: Trained by firestopping manufacturer and able to provide evidence thereof.

1.06 FIELD CONDITIONS

- A. Comply with firestopping manufacturer's recommendations for temperature and conditions during and after installation. Maintain minimum temperature before, during, and for 3 days after installation of materials.
- B. Provide ventilation in areas where solvent-cured materials are being installed.

PART 2 PRODUCTS

2.01 FIRESTOPPING - GENERAL REQUIREMENTS

- A. Manufacturers:
 - 1. A/D Fire Protection Systems Inc: www.adfire.com.
 - 2. 3M Fire Protection Products: www.3m.com/firestop.
 - 3. Hilti, Inc: www.us.hilti.com.
 - 4. Nelson FireStop Products: www.nelsonfirestop.com.
- B. Firestopping Materials with Volatile Content: Provide only products having lower volatile organic compound (VOC) content than required by South Coast Air Quality Management District Rule No.1168.
- C. Primers, Sleeves, Forms, Insulation, Packing, Stuffing, and Accessories: Type required for tested assembly design.

2.02 FIRESTOPPING ASSEMBLY REQUIREMENTS

- A. Head-of-Wall Firestopping at Joints Between Non-Rated Floor and Fire-Rated Wall: Use any system that has been tested according to ASTM E2837 to have fire resistance F Rating equal to required fire rating of floor or wall, whichever is greater.
 - 1. Movement: In addition, provide systems that have been tested to show movement capability as indicated.
- B. Floor-to-Floor, Wall-to-Wall, and Wall-to-Floor Joints, Except Perimeter, Where Both Are Fire-Rated: Use any system that has been tested according to ASTM E1966 or UL 2079 to have fire resistance F Rating equal to required fire rating of the assembly in which the joint occurs.
 - 1. Movement: In addition, provide systems that have been tested to show movement capability as indicated.
 - 2. Air Leakage: In addition, provide systems that have been tested to show L Rating as indicated.
 - 3. Watertightness: In addition, provide systems that have been tested to show W Rating as indicated.
 - 4. Listing by UL, FM, or Intertek in their certification directory will be considered evidence of successful testing.
- C. Through Penetration Firestopping: Use any system that has been tested according to ASTM E814 to have fire resistance F Rating equal to required fire rating of penetrated assembly.

1. Temperature Rise: In addition, provide systems that have been tested to show T Rating as indicated.
2. Air Leakage: In addition, provide systems that have been tested to show L Rating as indicated.
3. Listing by UL, FM, or Intertek in their certification directory will be considered evidence of successful testing.

2.03 FIRESTOPPING FOR FLOOR-TO-FLOOR, WALL-TO-FLOOR, AND WALL-TO-WALL JOINTS

- A. Concrete and Concrete Masonry Walls and Floors:
 1. Top of Wall Joints at Concrete/Concrete Masonry Wall to Concrete Over Metal Deck Floor:
 - a. 2 Hour Construction: UL System HW-D-0181; Hilti CFS-SP WB Firestop Joint Spray and CP 672.
 - b. 2 Hour Construction: UL System HW-D-1037; Hilti CFS-SP WB Firestop Joint Spray and CP 672.
 2. Concrete/Concrete Masonry Wall to Wall Joints:
 - a. 2 Hour Construction: UL System WW-D-0017; Hilti CFS-SP WB Firestop Joint Spray and CP 672.
 - b. 2 Hour Construction: UL System WW-D-0032; Hilti CP 606 Flexible Firestop Sealant.
- B. Gypsum Board Walls:
 1. Wall to Wall Joints:
 - a. 2 Hour Construction: UL System WW-D-0067; Hilti CP 606 Flexible Firestop Sealant.
 - b. 1 Hour Construction: UL System WW-D-0067; Hilti CP 606 Flexible Firestop Sealant.

2.04 FIRESTOPPING PENETRATIONS THROUGH CONCRETE AND CONCRETE MASONRY CONSTRUCTION

- A. Blank Openings:
 1. In Walls:
 - a. 2 Hour Construction: UL System C-AJ-0090; Hilti FS-ONE Intumescent Firestop Sealant.
- B. Penetrations Through Walls By:
 1. Multiple Penetrations in Large Openings:
 - a. 2 Hour Construction: UL System C-AJ-8143; Hilti FS-ONE Intumescent Firestop Sealant.
 2. Uninsulated Metallic Pipe, Conduit, and Tubing:
 - a. 2 Hour Construction: UL System C-AJ-1421; Hilti FS-ONE Intumescent Firestop Sealant or CP 604 Self-Leveling Firestop Sealant.
 - b. 2 Hour Construction: UL System C-AJ-1498; Hilti CP 680-P/M Cast-In Device.
 3. Uninsulated Non-Metallic Pipe, Conduit, and Tubing:
 - a. 2 Hour Construction: UL System C-AJ-2109; Hilti CP 643N/644 Firestop Collar.
 - b. 2 Hour Construction: UL System C-BJ-2021; Hilti CP 643N Firestop Collar.
 4. Electrical Cables Not In Conduit:
 - a. 2 Hour Construction: UL System C-AJ-3216; Hilti CP 658 Firestop Plug.
 - b. 2 Hour Construction: UL System W-J-3198; Hilti CFS-SL RK Retrofit Sleeve Kit for existing cables.
 - c. 2 Hour Construction: UL System W-J-3199; Hilti CFS-SL SK Firestop Sleeve Kit.
 5. Insulated Pipes:
 - a. 2 Hour Construction: UL System C-AJ-5048; Hilti FS-ONE Intumescent Firestop Sealant, CP 606 Flexible Firestop Sealant, CP 601S Elastomeric Firestop Sealant, or CP 604 Self-Leveling Firestop Sealant.
- C. Penetrations Through Walls By:

1. Uninsulated Metallic Pipe, Conduit, and Tubing:
 - a. 2 Hour Construction: UL System W-J-1067; Hilti FS-ONE Intumescent Firestop Sealant.
2. Electrical Cables Not In Conduit:
 - a. 2 Hour Construction: UL System W-J-3060; Hilti FS-ONE Intumescent Firestop Sealant, CP 606 Flexible Firestop Sealant, CD 601S Elastomeric Firestop Sealant, or CP 618 Firestop Putty Stick.
 - b. 2 Hour Construction: UL System W-J-3143; Hilti CP 658T Firestop Plug.
3. Insulated Pipes:
 - a. 2 Hour Construction: UL System W-J-5041; Hilti FS-ONE Intumescent Firestop Sealant.
 - b. 2 Hour Construction: UL System W-J-5042; Hilti FS-ONE Intumescent Firestop Sealant.
 - c. 2 Hour Construction: UL System W-J-5028; Hilti FS-ONE Intumescent Firestop Sealant.
4. HVAC Ducts, Uninsulated:
 - a. 2 Hour Construction: UL System W-J-7109; Hilti FS-ONE Intumescent Firestop Sealant or CP 606 Flexible Firestop Sealant.
5. HVAC Ducts, Insulated:
 - a. 2 Hour Construction: UL System W-J-7112; Hilti FS-ONE Intumescent Firestop Sealant.

2.05 FIRESTOPPING PENETRATIONS THROUGH GYPSUM BOARD WALLS

- A. Blank Openings:
 1. 2 Hour Construction: UL System W-L-3334; Hilti CP 653 Speed Sleeve.
- B. Penetrations By:
 1. Multiple Penetrations in Large Openings:
 - a. 2 Hour Construction: UL System W-L-1389; Hilti FS-ONE Intumescent Firestop Sealant.
 - b. 2 Hour Construction: UL System W-L-1408; Hilti FS-ONE Intumescent Firestop Sealant.
 - c. 2 Hour Construction: UL System W-L-8071; Hilti FS-ONE Intumescent Firestop Sealant.
 - d. 2 Hour Construction: UL System W-L-8079; Hilti FS-ONE Intumescent Firestop Sealant.
 - e. 2 Hour Construction: UL System W-L-8087; Hilti FS 657 Fire Block.
 2. Uninsulated Metallic Pipe, Conduit, and Tubing:
 - a. 2 Hour Construction: UL System W-L-1054; Hilti FS-ONE Intumescent Firestop Sealant.
 - b. 2 Hour Construction: UL System W-L-1164; Hilti FS-ONE Intumescent Firestop Sealant.
 - c. 2 Hour Construction: UL System W-L-1206; Hilti FS-ONE Intumescent Firestop Sealant.
 3. Uninsulated Non-Metallic Pipe, Conduit, and Tubing:
 - a. 2 Hour Construction: UL System W-L-2078; Hilti CP 643N/644 Firestop Collar.
 - b. 2 Hour Construction: UL System W-L-2411; Hilti CP 648-E Firestop Wrap Strip.
 - c. 2 Hour Construction: UL System W-L-2128; Hilti FS-ONE Intumescent Firestop Sealant.
 4. Electrical Cables Not In Conduit:
 - a. 2 Hour Construction: UL System W-L-3065; Hilti FS-ONE Intumescent Firestop Sealant, CP 606 Flexible Firestop Sealant, CD 601S Elastomeric Firestop Sealant, or CP 618 Firestop Putty Stick.

- b. 2 Hour Construction: UL System W-L-3334; Hilti CP 653 Speed Sleeve.
 - c. 2 Hour Construction: UL System W-L-3393; Hilti CFS-SL RK Retrofit Sleeve Kit for existing cables.
 - d. 2 Hour Construction: UL System W-L-3394; Hilti CFS-SL SK Firestop Sleeve Kit.
 - e. 2 Hour Construction: UL System W-L-3395; Hilti CP653 Speed Sleeve.
5. Insulated Pipes:
- a. 2 Hour Construction: UL System W-L-5028; Hilti FS-ONE Intumescent Firestop Sealant.
 - b. 2 Hour Construction: UL System W-L-5029; Hilti FS-ONE Intumescent Firestop Sealant.
 - c. 2 Hour Construction: UL System W-L-5096; Hilti FS-ONE Intumescent Firestop Sealant.
 - d. 2 Hour Construction: UL System W-L-5257; Hilti FS-ONE Intumescent Firestop Sealant, CP 606 Flexible Firestop Sealant, or CP 601S Elastomeric Firestop Sealant.
 - e. 2 Hour Construction: UL System W-L-5244; Hilti CP 648-E Firestop Wrap Strip.

2.06 FIRESTOPPING SYSTEMS

- A. Firestopping: Any material meeting requirements. Foam, caulk, putty or manufactured device.
 - 1. Fire Ratings: Use any system listed by UL, FM, or ITS (Warnock Hersey) or that has F Rating equal to fire rating of penetrated assembly and minimum T Rating of 0 and that meets all other specified requirements.
 - 2. Fire Ratings: See Drawings for required systems and ratings.
- B. Firestopping at Uninsulated Metallic Pipe and Conduit Penetrations, of diameter 4 inches or less: Any material meeting requirements. Foam, caulk, putty or manufactured device.
- C. Firestopping at Cable Tray Penetrations: Any material meeting requirements. Foam, caulk, putty or manufactured device.
- D. Firestopping at Cable Penetrations, not in Conduit or Cable Tray: Any material meeting requirements. Foam, caulk, putty or manufactured device.
- E. Firestopping at Control and Expansion Joints (without Penetrations): Any material meeting requirements and caulk.

2.07 MATERIALS

- A. Firestopping Sealants: Provide only products having lower volatile organic compound (VOC) content than required by South Coast Air Quality Management District Rule No.1168.
- B. Elastomeric Silicone Firestopping: Single component silicone elastomeric compound and compatible silicone sealant.
- C. Foam Firestopping: Single component silicone foam compound.
- D. Fibered Compound Firestopping: Formulated compound mixed with incombustible non-asbestos fibers.
- E. Fiber Firestopping: Mineral fiber insulation used in conjunction with elastomeric surface sealer forming airtight bond to opening.
- F. Primers, Sleeves, Forms, Insulation, Packing, Stuffing, and Accessories: Type required for tested assembly design.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify openings are ready to receive the work of this section.

3.02 PREPARATION

- A. Clean substrate surfaces of dirt, dust, grease, oil, loose material, or other matter that could adversely affect bond of firestopping material.
- B. Remove incompatible materials that could adversely affect bond.
- C. Install backing materials to arrest liquid material leakage.

3.03 INSTALLATION

- A. Install materials in manner described in fire test report and in accordance with manufacturer's instructions, completely closing openings.
- B. Do not cover installed firestopping until inspected by authority having jurisdiction.
- C. Install labeling required by code.

CLEANING

4.01 CLEAN ADJACENT SURFACES OF FIRESTOPPING MATERIALS.

4.02 PROTECTION

- A. Clean adjacent surfaces of firestopping materials.
- B. Protect adjacent surfaces from damage by material installation.

END OF SECTION

SECTION 07 90 05
JOINT SEALERS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Sealants and joint backer rods.
- B. Precompressed foam sealers.
- C. Accessories.

1.02 RELATED REQUIREMENTS

- A. Section 07 84 00 - Firestopping: Firestopping sealants.

1.03 REFERENCE STANDARDS

- A. ASTM C834 - Standard Specification for Latex Sealants.
- B. ASTM C919 - Standard Practice for Use of Sealants in Acoustical Applications.
- C. ASTM C920 - Standard Specification for Elastomeric Joint Sealants.
- D. ASTM C1193 - Standard Guide for Use of Joint Sealants.
- E. ASTM D1056 - Standard Specification for Flexible Cellular Materials--Sponge or Expanded Rubber.
- F. ASTM D1667 - Standard Specification for Flexible Cellular Materials--Poly(Vinyl Chloride) Foam (Closed-Cell).
- G. SCAQMD 1168 - South Coast Air Quality Management District Rule No.1168.

1.04 SUBMITTALS

- A. See Section 01 33 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide data indicating sealant chemical characteristics, performance criteria, substrate preparation, limitations, and color availability.
- C. Samples: Submit two samples, 2 x 1/2 in size illustrating sealant colors for selection.
- D. Manufacturer's Installation Instructions: Indicate special procedures, surface preparation, and perimeter conditions requiring special attention.

1.05 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing the Products specified in this section with minimum 10 years documented experience.
- B. Applicator Qualifications: Company specializing in performing the work of this section with minimum three years documented experience and approved by manufacturer.

1.06 FIELD CONDITIONS

- A. Maintain temperature and humidity recommended by the sealant manufacturer during and after installation.

1.07 COORDINATION

- A. Coordinate the work with all sections referencing this section.

1.08 WARRANTY

- A. See Section 01 77 00 - Closeout Submittals, for additional warranty requirements.
- B. Warranty: Include coverage for installed sealants and accessories which fail to achieve airtight seal, exhibit loss of adhesion or cohesion, or do not cure.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Polyurethane Sealants:
 - 1. Pecora Corporation: www.pecora.com.
 - 2. Bostik, Inc www.bostik-us.com
 - 3. BASF Construction Chemicals-Building Systems: www.chemrex.com.
 - 4. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Acrylic Sealants (ASTM C920):
 - 1. Pecora Corporation; www.pecora.com.
 - 2. Tremco, Inc www.tremcosealants.com.
 - 3. Bostik, Inc. www.bostik-us.com.
- C. Preformed Compressible Foam Sealers and backer rods:
 - 1. Sandell Manufacturing Company, Inc: www.sandellmfg.com.
 - 2. Emseal Joint Systems, Ltd.
 - 3. Dayton Superior Corporation: www.daytonsuperior.com.
 - 4. Substitutions: See Section 01 60 00 - Product Requirements.
 - 5. Substitutions: See Section 01 60 00 - Product Requirements.

2.02 SEALANTS

- A. Sealants and Primers - General: Provide only products having lower volatile organic compound (VOC) content than required by South Coast Air Quality Management District Rule No.1168.
- B. Type ___ - General Purpose Exterior Sealant: Polyurethane; ASTM C920, Grade NS, Class 25 minimum; Uses M, G, and A; single component.
 - 1. Color: Standard colors matching finished surfaces.
 - 2. Product: Dynatrol II manufactured by Pecora.
 - 3. Applications: Use for:
 - a. Control, expansion, and soft joints in masonry.
 - b. Joints between concrete and other materials.
 - c. Joints between metal frames and other materials.
 - d. Concealed sealant beads in roofings sheet metal work.
 - e. Other exterior joints for which no other sealant is indicated.
- C. Type 2 - General Purpose Interior Sealant: Acrylic emulsion latex; ASTM C 834, Type OP, Grade NF single component, paintable.
 - 1. Color: Standard colors matching finished surfaces.
 - 2. Product: AC-20 + Silicone manufactured by Pecora.
 - 3. Applications: Use for:
 - a. Interior wall and ceiling control joints.
 - b. Joints between door and window frames and wall surfaces.
 - c. Other interior joints for which no other type of sealant is indicated.
- D. Type 3 - Exterior Expansion Joint Sealer: ASTM D 2628, hollow neoprene (polychloroprene) compression gasket.
 - 1. Black color.
 - 2. Size and Shape: . As indicated by drawings.
 - 3. Product: Poly seal manufactured by sandell mfg.
 - 4. Applications: Use for:
 - a. Exterior wall expansion joints.
- E. Type 4 - Acoustical Sealant: acrylic sealant; ASTM C 920, Grade NS, Class 12-1/2, Uses M and A; single component, solvent release curing, non-skinning.
 - 1. Product: AIS-919 manufactured by Pecora.

2. Applications: Use for concealed locations only:
 - a. Where shown on plans.
- F. Type 5 - Concrete Paving Joint Sealant: Polyurethane, self-leveling; ASTM C920, Class 25, Uses T, I, M and A; single component.
 1. Color: Gray.
 2. Product: Dynatred manufactured by Pecora.
 3. Applications: Use for:
 - a. Joints in sidewalks and vehicular paving.
 - b. Where shown on plans.
- G. Type 6 - Exterior Metal Lap Joint Sealant: Butyl or polyisobutylene, nondrying, nonskinning, noncuring.

2.03 ACCESSORIES

- A. Primer: Non-staining type, recommended by sealant manufacturer to suit application.
- B. Joint Cleaner: Non-corrosive and non-staining type, recommended by sealant manufacturer; compatible with joint forming materials.
- C. Joint Backing: Round foam rod compatible with sealant; ASTM D 1667, closed cell PVC; oversized 30 to 50 percent larger than joint width.
- D. Bond Breaker: Pressure sensitive tape recommended by sealant manufacturer to suit application.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that substrate surfaces are ready to receive work.
- B. Verify that joint backing and release tapes are compatible with sealant.

3.02 PREPARATION

- A. Remove loose materials and foreign matter that could impair adhesion of sealant.
- B. Clean and prime joints in accordance with manufacturer's instructions.
- C. Perform preparation in accordance with manufacturer's instructions and ASTM C1193.
- D. Protect elements surrounding the work of this section from damage or disfigurement.

3.03 INSTALLATION

- A. Perform work in accordance with sealant manufacturer's requirements for preparation of surfaces and material installation instructions.
- B. Perform installation in accordance with ASTM C1193.
- C. Perform acoustical sealant application work in accordance with ASTM C919.
- D. Measure joint dimensions and size joint backers to achieve width-to-depth ratio, neck dimension, and surface bond area as recommended by manufacturer, except where specific dimensions are indicated.
- E. Measure joint dimensions and size joint backers to achieve the following, unless otherwise indicated:
 1. Width/depth ratio of 2:1.
 2. Neck dimension no greater than 1/3 of the joint width.
 3. Surface bond area on each side not less than 75 percent of joint width.
- F. Install bond breaker where joint backing is not used.
- G. Install sealant free of air pockets, foreign embedded matter, ridges, and sags.

- H. Apply sealant within recommended application temperature ranges. Consult manufacturer when sealant cannot be applied within these temperature ranges.
- I. Tool joints concave.
- J. Precompressed Foam Sealant: Do not stretch; avoid joints except at corners, ends, and intersections; install with face 1/8 to 1/4 inch below adjoining surface.
- K. Compression Gaskets: Avoid joints except at ends, corners, and intersections; seal all joints with adhesive; install with face 1/8 to 1/4 inch below adjoining surface.

3.04 CLEANING

- A. Clean adjacent soiled surfaces.

3.05 PROTECTION

- A. Protect sealants until cured.

3.06 SCHEDULE

- A. Exterior Joints for Which No Other Sealant Type is Indicated: Type 1; colors as selected.
- B. Control, Expansion, and Soft Joints in Masonry, and Between Masonry and Adjacent Work: Type 1.
- C. Lap Joints in Exterior Sheet Metal Work: Type 1 or 6 .
- D. Butt Joints in Exterior Metal Work and Siding: Type 1.
- E. Joints Between Exterior Metal Frames and Adjacent Work (except masonry): Type 1.
- F. Interior Joints for Which No Other Sealant is Indicated: Type 2; colors as shown on the drawings.
- G. Joints Between Plumbing Fixtures and Walls and Floors, and Between Countertops and Walls: Type 2.
- H. In STC-Rated Walls, Between Metal Stud Track/Runner and Adjacent Construction and Between Outlet Boxes and Gypsum Board: Type 4.

END OF SECTION

SECTION 09 21 16
GYP SUM BOARD ASSEMBLIES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Gypsum wallboard.
- B. Joint treatment and accessories.

1.02 RELATED REQUIREMENTS

- A. Section 06 10 00 - Rough Carpentry: Building Framing and Wood blocking .

1.03 REFERENCE STANDARDS

- A. ASTM C475/C475M - Standard Specification for Joint Compound and Joint Tape for Finishing Gypsum Board.
- B. ASTM C514 - Standard Specification for Nails for the Application of Gypsum Board.
- C. ASTM C840 - Standard Specification for Application and Finishing of Gypsum Board.
- D. ASTM C1047 - Standard Specification for Accessories For Gypsum Wallboard and Gypsum Veneer Base.
- E. ASTM C1396/C1396M - Standard Specification for Gypsum Board.
- F. ASTM D3273 - Standard Test Method for Resistance to Growth of Mold on the Surface of Interior Coatings in an Environmental Chamber.
- G. ASTM E84 - Standard Test Method for Surface Burning Characteristics of Building Materials.
- H. ASTM E90 - Standard Test Method for Laboratory Measurement of Airborne Sound Transmission Loss of Building Partitions and Elements.
- I. ASTM E413 - Classification for Rating Sound Insulation.
- J. GA-214 - Recommended Levels of Gypsum Board Finish; Gypsum Association.
- K. GA-216 - Application and Finishing of Gypsum Board.

1.04 QUALITY ASSURANCE

- A. Perform in accordance with ASTM C 840. Comply with requirements of GA-600 for fire-rated assemblies.

PART 2 PRODUCTS

2.01 GYP SUM BOARD ASSEMBLIES

- A. Provide completed assemblies per drawings.

2.02 BOARD MATERIALS

- A. Manufacturers - Gypsum-Based Board:
 - 1. CertainTeed Corporation; ____: www.certainteed.com.
 - 2. Georgia-Pacific Gypsum; ____: www.gpgypsum.com.
 - 3. National Gypsum Company; ____: www.nationalgypsum.com.
 - 4. USG Corporation; ____: www.usg.com.
 - 5. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Gypsum Wallboard: ASTM C 1396/C 1396M. Sizes to minimize joints in place; ends square cut.
 - 1. Regular Type:
 - a. Application: Use for vertical surfaces and ceilings, unless otherwise indicated.
 - b. Thickness: Match existing.
 - c. Edges: Tapered and featured.

2.03 ACCESSORIES

- A. Finishing Accessories: ASTM C1047, rigid plastic, unless otherwise indicated.
 - 1. Types: As detailed or required for finished appearance.
 - 2. Special Shapes: In addition to conventional cornerbead and control joints, provide U-bead at exposed panel edges.
- B. Joint Materials: ASTM C475 and as recommended by gypsum board manufacturer for project conditions.
 - 1. Tape: 2 inch wide, coated glass fiber tape for joints and corners, except as otherwise indicated.
 - 2. Tape: 2 inch wide, creased paper tape for joints and corners, except as otherwise indicated.
 - 3. Ready-mixed vinyl-based joint compound.
 - 4. Powder-type vinyl-based joint compound.
 - 5. Chemical hardening type compound.
- C. Nails for Attachment to Wood Members: ASTM C514.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that project conditions are appropriate for work of this section to commence.

3.02 BOARD INSTALLATION

- A. Comply with ASTM C 840 and manufacturer's instructions. Install to minimize butt end joints, especially in highly visible locations.
- B. Single-Layer Non-Rated: Install gypsum board in most economical direction, with ends and edges occurring over firm bearing.
 - 1. Exception: Tapered edges to receive joint treatment at right angles to framing.
- C. Installation on Wood Framing: For non-rated assemblies, install as follows:
 - 1. Single-Layer Applications: Single-nailing.

3.03 INSTALLATION OF TRIM AND ACCESSORIES

- A. Corner Beads: Install at external corners, using longest practical lengths.
- B. Edge Trim: Install at locations where gypsum board abuts dissimilar materials and as indicated.

3.04 JOINT TREATMENT

- A. Paper Faced Gypsum Board: Use paper joint tape, bedded with ready-mixed vinyl-based; or powder-type vinyl-based; or chemical hardening type joint compound and finished with ready-mixed vinyl-based; or powder-type vinyl-based; or chemical hardening type joint compound.
- B. Finish gypsum board in accordance with levels defined in ASTM C840, as follows:
 - 1. Level 4: Walls and ceilings to receive paint finish or wall coverings, unless otherwise indicated.
- C. Tape, fill, and sand exposed joints, edges, and corners to produce smooth surface ready to receive finishes.
 - 1. Feather coats of joint compound so that camber is maximum 1/32 inch.
 - 2. Taping, filling, and sanding is not required at surfaces behind adhesive applied ceramic tile and fixed cabinetry.
 - 3. Taping, filling and sanding is not required at base layer of double layer applications.

3.05 TOLERANCES

- A. Maximum Variation of Finished Gypsum Board Surface from True Flatness: 1/8 inch in 10 feet in any direction.

3.06 FINISH LEVEL SCHEDULE (SEE 1.03 REFERENCES FOR DEFINITION)

- A. Level 1: Above finished ceilings concealed from view.
- B. Level 4: Walls and ceilings scheduled to receive flat paint finish.

END OF SECTION

SECTION 09 51 00
ACOUSTICAL CEILINGS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Acoustical units.
- B. Support hangers, channels, and wires.

1.02 REFERENCE STANDARDS

- A. ASTM C635/C635M - Standard Specification for the Manufacture, Performance, and Testing of Metal Suspension Systems for Acoustical Tile and Lay-in Panel Ceilings.

1.03 SUBMITTALS

- A. See Section 01 30 00 - General Conditions, for submittal procedures.
- B. Product Data: Provide data on acoustical units.
- C. Samples: Submit two samples 4x4 inch in size illustrating material and finish of acoustical units.

1.04 FIELD CONDITIONS

- A. Maintain uniform temperature of minimum 60 degrees F, and maximum humidity of 40 percent prior to, during, and after acoustical unit installation.

1.05 PROJECT CONDITIONS

- A. Sequence work to ensure acoustical ceilings are not installed until building is enclosed, sufficient heat is provided, dust generating activities have terminated, and overhead work is completed, tested, and approved.
- B. Install acoustical units after interior wet work is dry.

PART 2 PRODUCTS

2.01 ACOUSTICAL UNITS

- A. Manufacturers:
 - 1. Armstrong World Industries, Inc: www.armstrong.com.
 - 2. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Acoustical Units - General: ASTM E1264, Class A.
- C. Acoustical Tile Type A: Painted mineral fiber, ASTM E1264 Type III, with the following characteristics:
 - 1. Size: 24 x 48 inches.
 - 2. Thickness: 5/8 inches.
 - 3. Edge: Square.
 - 4. Surface Color: White.
 - 5. Surface Pattern: Fine Fissured, match existing..
 - 6. Product: Armstrong

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify existing conditions before starting work.

3.02 INSTALLATION - ACOUSTICAL UNITS

- A. Install acoustical units in accordance with manufacturer's instructions.
- B. Fit acoustical units in place, free from damaged edges or other defects detrimental to appearance and function.

- C. Fit border trim neatly against abutting surfaces.
- D. Install units after above-ceiling work is complete.
- E. Install acoustical units level, in uniform plane, and free from twist, warp, and dents.
- F. Cutting Acoustical Units:
 - 1. Cut to fit irregular grid and perimeter edge trim.
 - 2. Make field cut edges of same profile as factory edges.
 - 3. Double cut and field paint exposed reveal edges.
- G. Where round obstructions and bullnose corners occur, provide preformed closures to match perimeter molding.

END OF SECTION

SECTION 09 90 00
PAINTING AND COATING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Surface preparation.
- B. Field application of paints and other coatings.
- C. Scope: Prepare and paint all interior new work and patching and all exterior lintels.

1.02 REFERENCE STANDARDS

- A. 40 CFR 59, Subpart D - National Volatile Organic Compound Emission Standards for Architectural Coatings; U.S. Environmental Protection Agency.
- B. ASTM D16 - Standard Terminology for Paint, Related Coatings, Materials, and Applications.
- C. NACE (IMP) - Industrial Maintenance Painting; NACE International; Edition date unknown.
- D. SSPC (PM1) - Good Painting Practice: SSPC Painting Manual, Vol. 1; Society for Protective Coatings.

1.03 DEFINITIONS

- A. Conform to ASTM D 16 for interpretation of terms used in this section.

1.04 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide data on all finishing products and special coatings, including VOC content.
- C. Samples: Submit two paper chip samples, 1 X 1 inch in size illustrating range of colors and textures available for each surface finishing product scheduled.
- D. Samples: Submit two painted samples, illustrating selected colors and textures for each color and system selected with specified coats cascaded. Submit on aluminum sheet, 6 x 6 inch in size.
- E. Certification: By manufacturer that all paints and coatings comply with VOC limits specified.
- F. Certification: By manufacturer that all paints and coatings do not contain any of the prohibited chemicals specified; GreenSeal GS-11 certification is not required but if provided shall constitute acceptable certification.
- G. Manufacturer's Instructions: Indicate special surface preparation procedures.
- H. Maintenance Data: Submit data on cleaning, touch-up, and repair of painted and coated surfaces.

1.05 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing the products specified, with minimum 5 years documented experience.
- B. Applicator Qualifications: Company specializing in performing the type of work specified with minimum 5 years experience.

1.06 REGULATORY REQUIREMENTS

- A. Conform to applicable code for flame and smoke rating requirements for products and finishes.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. Deliver products to site in sealed and labeled containers; inspect to verify acceptability.

- B. Container Label: Include manufacturer's name, type of paint, brand name, lot number, brand code, coverage, surface preparation, drying time, cleanup requirements, color designation, and instructions for mixing and reducing.
- C. Paint Materials: Store at minimum ambient temperature of 45 degrees F and a maximum of 90 degrees F, in ventilated area, and as required by manufacturer's instructions.

1.08 FIELD CONDITIONS

- A. Do not apply materials when surface and ambient temperatures are outside the temperature ranges required by the paint product manufacturer.
- B. Follow manufacturer's recommended procedures for producing best results, including testing of substrates, moisture in substrates, and humidity and temperature limitations.
- C. Minimum Application Temperatures for Latex Paints: 45 degrees F for interiors; 50 degrees F for exterior; unless required otherwise by manufacturer's instructions.
- D. Minimum Application Temperature for Varnish Finishes: 65 degrees F for interior or exterior, unless required otherwise by manufacturer's instructions.
- E. Provide lighting level of 80 ft candles measured mid-height at substrate surface.

1.09 EXTRA MATERIALS

- A. See Section 01 60 00 - Product Requirements, for additional provisions.
- B. Supply 1 gallon of each color; store where directed.
- C. Label each container with color, type, texture, and room locations in addition to the manufacturer's label.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Provide all paint and coating products used in any individual system from the same manufacturer; no exceptions.
- B. Paints:
 - 1. Duron, Inc: www.duron.com.
 - 2. Sherwin Williams: www.sherwin-williams.com
 - 3. Benjamin Moore & Co: www.benjaminmoore.com.
- C. Field-Catalyzed Coatings:
- D. Substitutions: See Section 01 60 00 - Product Requirements.

2.02 PAINTS AND COATINGS - GENERAL

- A. Paints and Coatings: Ready mixed, unless intended to be a field-catalyzed coating.
 - 1. Provide paints and coatings of a soft paste consistency, capable of being readily and uniformly dispersed to a homogeneous coating, with good flow and brushing properties, and capable of drying or curing free of streaks or sags.
 - 2. For opaque finishes, tint each coat including primer coat and intermediate coats, one-half shade lighter than succeeding coat, with final finish coat as base color.
 - 3. Supply each coating material in quantity required to complete entire project's work from a single production run.
 - 4. Do not reduce, thin, or dilute coatings or add materials to coatings unless such procedure is specifically described in manufacturer's product instructions.
- B. Primers: As follows unless other primer is required or recommended by manufacturer of top coats; where the manufacturer offers options on primers for a particular substrate, use primer categorized as "best" by the manufacturer.
- C. Chemical Content: The following compounds are prohibited:

1. Aromatic Compounds: In excess of 1.0 percent by weight of total aromatic compounds (hydrocarbon compounds containing one or more benzene rings).
2. Acrolein, acrylonitrile, antimony, benzene, butyl benzyl phthalate, cadmium, di (2-ethylhexyl) phthalate, di-n-butyl phthalate, di-n-octyl phthalate, 1,2-dichlorobenzene, diethyl phthalate, dimethyl phthalate, ethylbenzene, formaldehyde, hexavalent chromium, isophorone, lead, mercury, methyl ethyl ketone, methyl isobutyl ketone, methylene chloride, naphthalene, toluene (methylbenzene), 1,1,1-trichloroethane, vinyl chloride.

2.03 PAINT SYSTEMS - INTERIOR

- A. Paint WI-OP-3L - Wood, Opaque, Latex, 3 Coat:
 1. One coat of latex primer sealer.
- B. Paint CI-OP-3L - Concrete/Masonry, Opaque, Latex, 3 Coat:
 1. One coat of block filler.
 2. Egg Shell: Two coats of latex enamel.
- C. Paint MI-OP-2L - Ferrous Metals, Primed, Latex, 2 Coat:
 1. Touch-up with latex primer or manufacturer recommended.
 2. Flat: Two coats of latex enamel.
- D. Paint GI-OP-3L - Gypsum Board/Plaster, Latex, 3 Coat:
 1. One coat of alkyd or latex primer sealer.
 2. Eggshell: Two coats of latex enamel.

2.04 ACCESSORY MATERIALS

- A. Accessory Materials: Provide all primers, sealers, cleaning agents, cleaning cloths, sanding materials, and clean-up materials required to achieve the finishes specified whether specifically indicated or not; commercial quality.
- B. Patching Material: Latex filler.
- C. Fastener Head Cover Material: Latex filler.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that surfaces are ready to receive work as instructed by the product manufacturer.
- B. Examine surfaces scheduled to be finished prior to commencement of work. Report any condition that may potentially affect proper application.
- C. Test shop-applied primer for compatibility with subsequent cover materials.
- D. Measure moisture content of surfaces using an electronic moisture meter. Do not apply finishes unless moisture content of surfaces are below the following maximums:
 1. Gypsum Wallboard: 12 percent.
 2. Plaster and Stucco: 12 percent.
 3. Masonry, Concrete, and Concrete Unit Masonry: 12 percent.
 4. Interior Wood: 15 percent, measured in accordance with ASTM D4442.
 5. Exterior Wood: 15 percent, measured in accordance with ASTM D4442.
 6. Concrete Floors and Traffic Surfaces: 8 percent.

3.02 PREPARATION

- A. Clean surfaces thoroughly and correct defects prior to coating application.
- B. Prepare surfaces using the methods recommended by the manufacturer for achieving the best result for the substrate under the project conditions.
- C. Remove or mask surface appurtenances, including electrical plates, hardware, light fixture trim, escutcheons, and fittings, prior to preparing surfaces or finishing.

- D. Surfaces: Correct defects and clean surfaces which affect work of this section. Remove or repair existing coatings that exhibit surface defects.
- E. Marks: Seal with shellac or stain blocker those which may bleed through surface finishes.
- F. Remove mildew from impervious surfaces by scrubbing with solution of tetra-sodium phosphate and bleach. Rinse with clean water and allow surface to dry.
- G. Concrete and Unit Masonry Surfaces to be Painted: Remove dirt, loose mortar, scale, salt or alkali powder, and other foreign matter. Remove oil and grease with a solution of tri-sodium phosphate; rinse well and allow to dry. Remove stains caused by weathering of corroding metals with a solution of sodium metasilicate after thoroughly wetting with water. Allow to dry.
- H. Gypsum Board Surfaces to be Painted: Fill minor defects with filler compound. Spot prime defects after repair.
- I. Galvanized Surfaces to be Painted: Remove surface contamination and oils and wash with solvent. Apply coat of etching primer.
- J. Corroded Steel and Iron Surfaces to be Painted: Prepare using at least SSPC-SP 2 (hand tool cleaning) or SSPC-SP 3 (power tool cleaning) followed by SSPC-SP 1 (solvent cleaning).
- K. Uncorroded Uncoated Steel and Iron Surfaces to be Painted: Remove grease, mill scale, weld splatter, dirt, and rust. Where heavy coatings of scale are evident, remove by power tool wire brushing or sandblasting; clean by washing with solvent. Apply a treatment of phosphoric acid solution, ensuring weld joints, bolts, and nuts are similarly cleaned. Prime paint entire surface; spot prime after repairs.
- L. Interior Wood Surfaces to Receive Opaque Finish: Wipe off dust and grit prior to priming. Seal knots, pitch streaks, and sappy sections with sealer. Fill nail holes and cracks after primer has dried; sand between coats. Back prime concealed surfaces before installation.

3.03 APPLICATION

- A. Exterior Wood to Receive Opaque Finish: If final painting must be delayed more than 2 weeks after installation of woodwork, apply primer within 2 weeks and final coating within 4 weeks.
- B. Apply products in accordance with manufacturer's instructions.
- C. Where adjacent sealant is to be painted, do not apply finish coats until sealant is applied.
- D. Do not apply finishes to surfaces that are not dry. Allow applied coats to dry before next coat is applied.
- E. Apply each coat to uniform appearance.
- F. Dark Colors and Deep Clear Colors: Regardless of number of coats specified, apply as many coats as necessary for complete hide.
- G. Sand wood and metal surfaces lightly between coats to achieve required finish.
- H. Vacuum clean surfaces of loose particles. Use tack cloth to remove dust and particles just prior to applying next coat.
- I. Reinstall electrical cover plates, hardware, light fixture trim, escutcheons, and fittings removed prior to finishing.

3.04 FIELD QUALITY CONTROL

- A. See Section 01 40 00 - Quality Requirements, for general requirements for field inspection.

3.05 CLEANING

- A. Collect waste material that could constitute a fire hazard, place in closed metal containers, and remove daily from site.

3.06 PROTECTION

- A. Protect finished coatings until completion of project.
- B. Touch-up damaged coatings after Substantial Completion.

END OF SECTION

SECTION 22 10 05
PLUMBING PIPING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Pipe, pipe fittings, valves, and connections for piping systems.
 - 1. Gas.

1.02 RELATED REQUIREMENTS

- A. Section - Trenching.
- B. Section 07 84 00 - Firestopping.
- C. Section 09 90 00 - Painting and Coating.221005
- D. Section 22 05 16 - Expansion Fittings and Loops for Plumbing Piping.
- E. Section 22 05 53 - Identification for Plumbing Piping and Equipment.

1.03 REFERENCE STANDARDS

- A. ANSI Z21.22 - American National Standard for Relief Valves and Automatic Gas Shutoff Devices for Hot Water Supply Systems.
- B. ASME B16.1 - Gray Iron Pipe Flanges and Flanged Fittings: Classes 25, 125, and 250.
- C. ASME B16.3 - Malleable Iron Threaded Fittings: Classes 150 and 300.
- D. ASME B16.4 - Gray Iron Threaded Fittings: Classes 125 and 250.
- E. ASME B16.18 - Cast Copper Alloy Solder Joint Pressure Fittings.
- F. ASME B16.22 - Wrought Copper and Copper Alloy Solder-Joint Pressure Fittings.
- G. ASME B16.23 - Cast Copper Alloy Solder Joint Drainage Fittings - DWV.
- H. ASME B16.26 - Cast Copper Alloy Fittings for Flared Copper Tubes.
- I. ASME B16.29 - Wrought Copper and Wrought Copper Alloy Solder Joint Drainage Fittings - DWV.
- J. ASME B31.1 - Power Piping.
- K. ASME B31.2 - Fuel Gas Piping; The American Society of Mechanical Engineers.
- L. ASME B31.9 - Building Services Piping.
- M. ASME BPVC-IV - Boiler and Pressure Vessel Code, Section IV - Rules for Construction of Heating Boilers.
- N. ASME BPVC-IX - Boiler and Pressure Vessel Code, Section IX - Welding, Brazing, and Fusing Qualifications.
- O. ASTM A47/A47M - Standard Specification for Ferritic Malleable Iron Castings.
- P. ASTM A53/A53M - Standard Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless.
- Q. ASTM A74 - Standard Specification for Cast Iron Soil Pipe and Fittings.
- R. ASTM A234/A234M - Standard Specification for Piping Fittings of Wrought Carbon Steel and Alloy Steel for Moderate and High Temperature Service.
- S. ASTM B32 - Standard Specification for Solder Metal.
- T. ASTM B42 - Standard Specification for Seamless Copper Pipe, Standard Sizes.
- U. ASTM B43 - Standard Specification for Seamless Red Brass Pipe, Standard Sizes.
- V. ASTM B68/B68M - Standard Specification for Seamless Copper Tube, Bright Annealed.

- W. ASTM B68M - Standard Specification for Seamless Copper Tube, Bright Annealed (Metric).
- X. ASTM B75/B75M - Standard Specification for Seamless Copper Tube.
- Y. ASTM B75M - Standard Specification for Seamless Copper Tube (Metric).
- Z. ASTM B88 - Standard Specification for Seamless Copper Water Tube.
- AA. ASTM B88M - Standard Specification for Seamless Copper Water Tube (Metric).
- AB. ASTM B280 - Standard Specification for Seamless Copper Tube for Air Conditioning and Refrigeration Field Service.
- AC. ASTM B302 - Standard Specification for Threadless Copper Pipe, Standard Sizes.
- AD. ASTM B306 - Standard Specification for Copper Drainage Tube (DWV).
- AE. ASTM C4 - Standard Specification for Clay Drain Tile and Perforated Clay Drain Tile.
- AF. ASTM C14 - Standard Specification for Nonreinforced Concrete Sewer, Storm Drain, and Culvert Pipe.
- AG. ASTM C14M - Standard Specification for Nonreinforced Concrete Sewer, Storm Drain, and Culvert Pipe (Metric).
- AH. ASTM C76 - Standard Specification for Reinforced Concrete Culvert, Storm Drain, and Sewer Pipe.
- AI. ASTM C76M - Standard Specification for Reinforced Concrete Culvert, Storm Drain, and Sewer Pipe (Metric).
- AJ. ASTM C425 - Standard Specification for Compression Joints for Vitrified Clay Pipe and Fittings.
- AK. ASTM C443 - Standard Specification for Joints for Concrete Pipe and Manholes, Using Rubber Gaskets.
- AL. ASTM C443M - Standard Specification for Joints for Concrete Pipe and Manholes, Using Rubber Gaskets (Metric).
- AM. ASTM C564 - Standard Specification for Rubber Gaskets for Cast Iron Soil Pipe and Fittings.
- AN. ASTM C700 - Standard Specification for Vitrified Clay Pipe, Extra Strength, Standard Strength, and Perforated.
- AO. ASTM C1053 - Standard Specification for Borosilicate Glass Pipe and Fittings for Drain, Waste, and Vent (DWV) Applications.
- AP. ASTM D1785 - Standard Specification for Poly(Vinyl Chloride) (PVC) Plastic Pipe, Schedules 40, 80, and 120.
- AQ. ASTM D2235 - Standard Specification for Solvent Cement for Acrylonitrile-Butadiene-Styrene (ABS) Plastic Pipe and Fittings.
- AR. ASTM D2239 - Standard Specification for Polyethylene (PE) Plastic Pipe (SIDR-PR) Based on Controlled Inside Diameter.
- AS. ASTM D2241 - Standard Specification for Poly (Vinyl Chloride) (PVC) Pressure-Rated Pipe (SDR Series).
- AT. ASTM D2447 - Standard Specification for Polyethylene (PE) Plastic Pipe, Schedules 40 and 80, Based on Outside Diameter; 2003.
- AU. ASTM D2466 - Standard Specification for Poly(Vinyl Chloride) (PVC) Plastic Pipe Fittings, Schedule 40.
- AV. ASTM D2513 - Standard Specification for Polyethylene (PE) Gas Pressure Pipe, Tubing, and Fittings.
- AW. ASTM D2564 - Standard Specification for Solvent Cements for Poly(Vinyl Chloride) (PVC) Plastic Piping Systems.

- AX. ASTM D2609 - Standard Specification for Plastic Insert Fittings for Polyethylene (PE) Plastic Pipe.
- AY. ASTM D2661 - Standard Specification for Acrylonitrile-Butadiene-Styrene (ABS) Schedule 40 Plastic Drain, Waste, and Vent Pipe and Fittings.
- AZ. ASTM D2665 - Standard Specification for Poly(Vinyl Chloride) (PVC) Plastic Drain, Waste, and Vent Pipe and Fittings.
- BA. ASTM D2680 - Standard Specification for Acrylonitrile-Butadiene-Styrene (ABS) and Poly(Vinyl Chloride) (PVC) Composite Sewer Piping.
- BB. ASTM D2683 - Standard Specification for Socket-Type Polyethylene Fittings for Outside Diameter-Controlled Polyethylene Pipe and Tubing.
- BC. ASTM D2729 - Standard Specification for Poly(Vinyl Chloride) (PVC) Sewer Pipe and Fittings.
- BD. ASTM D2751 - Standard Specification for Acrylonitrile-Butadiene-Styrene (ABS) Sewer Pipe and Fittings.
- BE. ASTM D2846/D2846M - Standard Specification for Chlorinated Poly(Vinyl Chloride) (CPVC) Plastic Hot- and Cold-Water Distribution Systems.
- BF. ASTM D2855 - Standard Practice for Making Solvent-Cemented Joints with Poly(Vinyl Chloride) (PVC) Pipe and Fittings.
- BG. ASTM D2996 - Standard Specification for Filament-Wound "Fiberglass" (Glass-Fiber-Reinforced Thermosetting-Resin) Pipe.
- BH. ASTM D2997 - Standard Specification for Centrifugally Cast "Fiberglass" (Glass-Fiber-Reinforced Thermosetting-Resin) Pipe.
- BI. ASTM D3034 - Standard Specification for Type PSM Poly(Vinyl Chloride) (PVC) Sewer Pipe and Fittings.
- BJ. ASTM D3262 - Standard Specification for "Fiberglass" (Glass-Fiber-Reinforced Thermosetting-Resin) Sewer Pipe.
- BK. ASTM D3517 - Standard Specification for "Fiberglass" (Glass-Fiber-Reinforced Thermosetting-Resin) Pressure Pipe.
- BL. ASTM D3754 - Standard Specification for "Fiberglass" (Glass-Fiber-Reinforced Thermosetting-Resin) Sewer and Industrial Pressure Pipe.
- BM. ASTM D3840 - Standard Specification for "Fiberglass" (Glass-Fiber-Reinforced Thermosetting-Resin) Pipe Fittings for Nonpressure Applications.
- BN. ASTM F437 - Standard Specification for Threaded Chlorinated Poly(Vinyl Chloride) (CPVC) Plastic Pipe Fittings, Schedule 80.
- BO. ASTM F438 - Standard Specification for Socket-Type Chlorinated Poly(Vinyl Chloride) (CPVC) Plastic Pipe Fittings, Schedule 40.
- BP. ASTM F439 - Standard Specification for Chlorinated Poly(Vinyl Chloride) (CPVC) Plastic Pipe Fittings, Schedule 80.
- BQ. ASTM F441/F441M - Standard Specification for Chlorinated Poly(Vinyl Chloride) (CPVC) Plastic Pipe, Schedules 40 and 80.
- BR. ASTM F442/F442M - Standard Specification for Chlorinated Poly(Vinyl Chloride) (CPVC) Plastic Pipe (SDR-PR).
- BS. ASTM F477 - Standard Specification for Elastomeric Seals (Gaskets) for Joining Plastic Pipe.
- BT. ASTM F493 - Standard Specification for Solvent Cements for Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic Pipe and Fittings.

- BU. ASTM F628 - Standard Specification for Acrylonitrile-Butadiene-Styrene (ABS) Schedule 40 Plastic Drain, Waste, and Vent Pipe With a Cellular Core.
- BV. ASTM F679 - Standard Specification for Poly(Vinyl Chloride) (PVC) Large-Diameter Plastic Gravity Sewer Pipe and Fittings.
- BW. ASTM F708 - Standard Practice for Design and Installation of Rigid Pipe Hangers.
- BX. ASTM F1281 - Standard Specification for Crosslinked Polyethylene/Aluminum/Crosslinked Polyethylene (PEX-AL-PEX) Pressure Pipe.
- BY. ASTM F1282 - Standard Specification for Polyethylene/Aluminum/Polyethylene (PE-AL-PE) Composite Pressure Pipe.
- BZ. AWS A5.8M/A5.8 - Specification for Filler Metals for Brazing and Braze Welding.
- CA. AWWA C105/A21.5 - Polyethylene Encasement for Ductile-Iron Pipe Systems.
- CB. AWWA C110/A21.10 - Ductile-Iron and Gray-Iron Fittings.
- CC. AWWA C111/A21.11 - Rubber-Gasket Joints for Ductile-Iron Pressure Pipe and Fittings.
- CD. AWWA C151/A21.51 - Ductile-Iron Pipe, Centrifugally Cast.
- CE. AWWA C651 - Disinfecting Water Mains.
- CF. AWWA C900 - Polyvinyl Chloride (PVC) Pressure Pipe, 4 In. Through 12 In. (100 mm Through 300 mm), for Water Transmission and Distribution.
- CG. AWWA C901 - Polyethylene (PE) Pressure Pipe and Tubing, 1/2 In. (13 mm) Through 3 In. (76 mm), for Water Service.
- CH. AWWA C950 - Fiberglass Pressure Pipe.
- CI. CISPI 301 - Standard Specification for Hubless Cast Iron Soil Pipe and Fittings for Sanitary and Storm Drain, Waste and Vent Piping Applications.
- CJ. CISPI 310 - Specification for Coupling for Use in Connection with Hubless Cast Iron Soil Pipe and Fittings for Sanitary and Storm Drain, Waste, and Vent Piping Applications.
- CK. MSS SP-58 - Pipe Hangers and Supports - Materials, Design, Manufacture, Selection, Application, and Installation.
- CL. MSS SP-67 - Butterfly Valves.
- CM. MSS SP-69 - Pipe Hangers and Supports - Selection and Application; Manufacturers Standardization Society of the Valve and Fittings Industry, Inc..
- CN. MSS SP-70 - Cast Iron Gate Valves, Flanged and Threaded Ends.
- CO. MSS SP-71 - Cast Iron Swing Check Valves, Flanged and Threaded Ends.
- CP. MSS SP-78 - Cast Iron Plug Valves, Flanged and Threaded Ends.
- CQ. MSS SP-80 - Bronze Gate, Globe, Angle and Check Valves.
- CR. MSS SP-85 - Cast Iron Globe & Angle Valves, Flanged and Threaded Ends.
- CS. MSS SP-89 - Pipe Hangers and Supports - Fabrication and Installation Practices; Manufacturers Standardization Society of the Valve and Fittings Industry, Inc..
- CT. MSS SP-110 - Ball Valves Threaded, Socket-Welding, Solder Joint, Grooved and Flared Ends.
- CU. NFPA 54 - National Fuel Gas Code; National Fire Protection Association.
- CV. NFPA 58 - Liquefied Petroleum Gas Code; National Fire Protection Association.

1.04 SUBMITTALS

- A. Product Data: Provide data on pipe materials, pipe fittings, valves, and accessories. Provide manufacturers catalog information. Indicate valve data and ratings.

- B. Project Record Documents: Record actual locations of valves.

1.05 QUALITY ASSURANCE

- A. Perform Work in accordance with local standards.
 - 1. Maintain one copy on project site.
- B. Valves: Manufacturer's name and pressure rating marked on valve body.
- C. Welding Materials and Procedures: Conform to ASME (BPV IX) and applicable state labor regulations.
- D. Welder Qualifications: Certified in accordance with ASME (BPV IX).
- E. Identify pipe with marking including size, ASTM material classification, ASTM specification, potable water certification, water pressure rating.

1.06 REGULATORY REQUIREMENTS

- A. Perform Work in accordance with local plumbing code.
- B. Conform to applicable code for installation of backflow prevention devices.
- C. Provide certificate of compliance from authority having jurisdiction indicating approval of installation of backflow prevention devices.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. Accept valves on site in shipping containers with labeling in place. Inspect for damage.
- B. Provide temporary protective coating on cast iron and steel valves.
- C. Provide temporary end caps and closures on piping and fittings. Maintain in place until installation.
- D. Protect piping systems from entry of foreign materials by temporary covers, completing sections of the work, and isolating parts of completed system.

1.08 FIELD CONDITIONS

- A. Do not install underground piping when bedding is wet or frozen.

1.09 EXTRA MATERIALS

- A. Provide two repacking kits for each size valve.

PART 2 PRODUCTS

2.01 NATURAL GAS PIPING, BURIED BEYOND 5 FEET OF BUILDING

- A. Steel Pipe: ASTM A53/A53M Schedule 40 black.
 - 1. Fittings: ASTM A234/A234M, wrought steel welding type, with AWWA C105/A21.5 polyethylene jacket or double layer, half-lapped 10 mil polyethylene tape.
 - 2. Joints: ASME B31.1, welded.

2.02 NATURAL GAS PIPING, BURIED WITHIN 5 FEET OF BUILDING

- A. Steel Pipe: ASTM A53/A53M Schedule 40 black.
 - 1. Fittings: ASTM A234/A234M, wrought steel welding type.
 - 2. Joints: ASME B31.1 or ASME B31.9, welded.
 - 3. Jacket: AWWA C105/A21.5 polyethylene jacket or double layer, half-lapped 10 mil polyethylene tape.

2.03 NATURAL GAS PIPING, ABOVE GRADE

- A. Steel Pipe: ASTM A53/A53M Schedule 40 black.
 - 1. Fittings: ASME B16.3, malleable iron, or ASTM A234/A234M, wrought steel welding type.
 - 2. Joints: NFPA 54, threaded or welded to ASME B31.1 or ASME B31.9.

2.04 FLANGES, UNIONS, AND COUPLINGS

- A. Unions for Pipe Sizes 3 Inches and Under:
 - 1. Ferrous pipe: Class 150 malleable iron threaded unions.
 - 2. Copper tube and pipe: Class 150 bronze unions with soldered joints.
- B. Flanges for Pipe Size Over 1 Inch:
 - 1. Ferrous pipe: Class 150 malleable iron threaded or forged steel slip-on flanges; preformed neoprene gaskets.
 - 2. Copper tube and pipe: Class 150 slip-on bronze flanges; preformed neoprene gaskets.
- C. Grooved and Shouldered Pipe End Couplings:
 - 1. Housing: Malleable iron clamps to engage and lock, designed to permit some angular deflection, contraction, and expansion; steel bolts, nuts, and washers; galvanized for galvanized pipe.
 - 2. Sealing gasket: "C" shape composition sealing gasket.
- D. Dielectric Connections: Union with galvanized or plated steel threaded end, copper solder end, water impervious isolation barrier.

2.05 PIPE HANGERS AND SUPPORTS

- A. Provide hangers and supports that comply with MSS SP-58.
 - 1. If type of hanger or support for a particular situation is not indicated, select appropriate type using MSS SP-58 recommendations.
 - 2. Overhead Supports: Individual steel rod hangers attached to structure or to trapeze hangers.
 - 3. Trapeze Hangers: Welded steel channel frames attached to structure.
 - 4. Vertical Pipe Support: Steel riser clamp.

2.06 BALL VALVES

- A. Manufacturers:
 - 1. Conbraco Industries: www.conbraco.com.
 - 2. Nibco, Inc: www.nibco.com.
 - 3. Milwaukee Valve Company: www.milwaukeevalve.com.
- B. Construction, 4 Inches and Smaller: MSS SP-110, Class 150, 400 psi CWP, bronze, two piece body, chrome plated brass ball, regular port, teflon seats and stuffing box ring, blow-out proof stem, lever handle with balancing stops, solder ends with union.

2.07 PLUG VALVES

- A. Manufacturers:
 - 1. Conbraco Industries: www.conbraco.com.
 - 2. Nibco, Inc: www.nibco.com.
 - 3. Milwaukee Valve Company: www.milwaukeevalve.com.
- B. Construction 2-1/2 Inches and Larger: MSS SP-78, 175 psi CWP, cast iron body and plug, pressure lubricated, teflon or Buna N packing, flanged or grooved ends. Provide lever operator with set screw.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that excavations are to required grade, dry, and not over-excavated.

3.02 PREPARATION

- A. Ream pipe and tube ends. Remove burrs. Bevel plain end ferrous pipe.
- B. Remove scale and dirt, on inside and outside, before assembly.

- C. Prepare piping connections to equipment with flanges or unions.

3.03 INSTALLATION

- A. New and existing exterior gas piping is to be painted standard ANSI yellow.
- B. Install in accordance with manufacturer's instructions.
- C. Provide non-conducting dielectric connections wherever jointing dissimilar metals.
- D. Route piping in orderly manner and maintain gradient. Route parallel and perpendicular to walls.
- E. Install piping to maintain headroom, conserve space, and not interfere with use of space.
- F. Group piping whenever practical at common elevations.
- G. Install piping to allow for expansion and contraction without stressing pipe, joints, or connected equipment. Refer to Section 22 05 16.
- H. Provide clearance in hangers and from structure and other equipment for installation of insulation and access to valves and fittings. Refer to Section 22 07 19.
- I. Provide access where valves and fittings are not exposed. Coordinate size and location of access doors with Section 08 31 00.
- J. Establish elevations of buried piping outside the building to ensure not less than 3 ft of cover.
- K. Install vent piping penetrating roofed areas to maintain integrity of roof assembly .
- L. Where pipe support members are welded to structural building framing, scrape, brush clean, and apply one coat of zinc rich primer to welding.
- M. Provide support for utility meters in accordance with requirements of utility companies.
- N. Prepare exposed, unfinished pipe, fittings, supports, and accessories ready for finish painting. Refer to Section 09 90 00.
- O. Excavate in accordance with Section 31 23 16.
- P. Backfill in accordance with Section 31 23 23.
- Q. Install bell and spigot pipe with bell end upstream.
- R. Install valves with stems upright or horizontal, not inverted.
- S. Pipe vents from gas pressure reducing valves to outdoors and terminate in weather proof hood.
- T. Install water piping to ASME B31.9.
- U. Install fuel oil piping to ASME B31.9.
- V. PVC Pipe: Make solvent-welded joints in accordance with ASTM D2855.
- W. Sleeve pipes passing through partitions, walls and floors.
- X. In all kitchen/cooking areas, any piping that is run exposed along walls shall maintain at least a 1" gap to the walls to allow for cleaning per codes.
- Y. Inserts:
 - 1. Provide inserts for placement in concrete formwork.
 - 2. Provide inserts for suspending hangers from reinforced concrete slabs and sides of reinforced concrete beams.
 - 3. Provide hooked rod to concrete reinforcement section for inserts carrying pipe over 4 inches.
 - 4. Where concrete slabs form finished ceiling, locate inserts flush with slab surface.
 - 5. Where inserts are omitted, drill through concrete slab from below and provide through-bolt with recessed square steel plate and nut flush with top of slab.
- Z. Pipe Hangers and Supports:

1. Install in accordance with ASME B31.9.
2. Support horizontal piping as scheduled.
3. Install hangers to provide minimum 1/2 inch space between finished covering and adjacent work.
4. Place hangers within 12 inches of each horizontal elbow.
5. Use hangers with 1-1/2 inch minimum vertical adjustment. Design hangers for pipe movement without disengagement of supported pipe.
6. Support vertical piping at every floor. Support riser piping independently of connected horizontal piping.
7. Where several pipes can be installed in parallel and at same elevation, provide multiple or trapeze hangers.
8. Provide copper plated hangers and supports for copper piping.
9. Prime coat exposed steel hangers and supports. Refer to Section 09 90 00. Hangers and supports located in crawl spaces, pipe shafts, and suspended ceiling spaces are not considered exposed.
10. Provide hangers adjacent to motor driven equipment with vibration isolation; refer to Section 22 05 48.
11. Support cast iron drainage piping at every joint.

3.04 APPLICATION

- A. Install unions downstream of valves and at equipment or apparatus connections.
- B. Provide plug valves in natural gas systems for shut-off service.
- C. Provide flow controls in water recirculating systems where indicated.

3.05 SCHEDULES

- A. Pipe Hanger Spacing:
 1. Metal Piping:
 - a. Pipe size: 1/2 inches to 1-1/4 inches:
 - 1) Maximum hanger spacing: 6.5 ft.
 - 2) Hanger rod diameter: 3/8 inches.
 - b. Pipe size: 1-1/2 inches to 2 inches:
 - 1) Maximum hanger spacing: 10 ft.
 - 2) Hanger rod diameter: 3/8 inch.
 - c. Pipe size: 2-1/2 inches to 3 inches:
 - 1) Maximum hanger spacing: 10 ft.
 - 2) Hanger rod diameter: 1/2 inch.
 - d. Pipe size: 4 inches to 6 inches:
 - 1) Maximum hanger spacing: 10 ft.
 - 2) Hanger rod diameter: 5/8 inch.
 - e. Pipe size: 8 inches to 12 inches:
 - 1) Maximum hanger spacing: 14 ft.
 - 2) Hanger rod diameter: 7/8 inch.
 - f. Pipe size: 14 inches and Over:
 - 1) Maximum hanger spacing: 20 ft.
 - 2) Hanger rod diameter: 1 inch.
 2. Plastic Piping:
 - a. Pipe Size 1" to 6":
 - 1) Maximum hanger spacing: 6 ft.
 - 2) Hanger rod diameter: 3/8 inch.
 - b. Pipe Size 8" and Over:
 - 1) Maximum hanger spacing: 6 ft.

- 2) Hanger rod diameter: 7/8 inch.

END OF SECTION

SECTION 23 05 53
IDENTIFICATION FOR HVAC PIPING AND EQUIPMENT

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Nameplates.
- B. Tags.
- C. Stencils.
- D. Pipe Markers.

1.02 RELATED REQUIREMENTS

- A. Section 09 90 00 - Painting and Coating: Identification painting.

1.03 REFERENCE STANDARDS

- A. ASME A13.1 - Scheme for the Identification of Piping Systems.

1.04 SUBMITTALS

- A. See Section 01 33 00 - Administrative Requirements, for submittal procedures.
- B. List: Submit list of wording, symbols, letter size, and color coding for mechanical identification.
- C. Chart and Schedule: Submit valve chart and schedule, including valve tag number, location, function, and valve manufacturer's name and model number.
- D. Product Data: Provide manufacturers catalog literature for each product required.
- E. Samples: Submit two labels, tags and pipe markers.
- F. Manufacturer's Installation Instructions: Indicate special procedures, and installation.
- G. Project Record Documents: Record actual locations of tagged valves.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Brady Corporation: www.bradycorp.com.
- B. Champion America, Inc: www.Champion-America.com.
- C. Seton Identification Products: www.seton.com/aec.
- D. Substitutions: See Section 01 60 00 - Product Requirements.

2.02 NAMEPLATES

- A. Description: Laminated three-layer plastic with engraved letters.
 - 1. Letter Color: White.
 - 2. Letter Height: 1/4 inch.
 - 3. Background Color: Green.

2.03 TAGS

- A. Plastic Tags: Laminated three-layer plastic with engraved white letters on green contrasting background color. Tag size minimum 1-1/2 inch diameter.
- B. Metal Tags: Brass with stamped letters; tag size minimum 1-1/2 inch diameter with smooth edges.
- C. Valve Tag Chart: Typewritten letter size list in anodized aluminum frame.

2.04 STENCILS

- A. Stencils: With clean cut symbols and letters of following size:

1. 3/4 to 1-1/4 inch Outside Diameter of Insulation or Pipe: 8 inch long color field, 1/2 inch high letters.
 2. 1-1/2 to 2 inch Outside Diameter of Insulation or Pipe: 8 inch long color field, 3/4 inch high letters.
 3. 2-1/2 to 6 inch Outside Diameter of Insulation or Pipe: 12 inch long color field, 1-1/4 inch high letters.
 4. 8 to 10 inch Outside Diameter of Insulation or Pipe: 24 inch long color field, 2-1/2 inch high letters.
 5. Over 10 inch Outside Diameter of Insulation or Pipe: 32 inch long color field, 3-1/2 inch high letters.
 6. Ductwork and Equipment: 2-1/2 inch high letters.
- B. Stencil Paint: As specified in Section 09 90 00, semi-gloss enamel, colors conforming to ASME A13.1.

2.05 PIPE MARKERS

- A. Color: Conform to ASME A13.1.
- B. Plastic Pipe Markers: Factory fabricated, flexible, semi-rigid plastic, preformed to fit around pipe or pipe covering; minimum information indicating flow direction arrow and identification of fluid being conveyed.
- C. Plastic Tape Pipe Markers: Flexible, vinyl film tape with pressure sensitive adhesive backing and printed markings.
- D. Underground Plastic Pipe Markers: Bright colored continuously printed plastic ribbon tape, minimum 6 inches wide by 4 mil thick, manufactured for direct burial service.

2.06 CEILING TACKS

- A. Description: Steel with 3/4 inch diameter color coded head.
- B. Color code as follows:
 1. HVAC Equipment: Yellow.
 2. Fire Dampers and Smoke Dampers: Red.
 3. Heating/Cooling Valves: Blue.

PART 3 EXECUTION

3.01 PREPARATION

- A. Degrease and clean surfaces to receive adhesive for identification materials.
- B. Prepare surfaces in accordance with Section 09 90 00 for stencil painting.

3.02 INSTALLATION

- A. Install nameplates with corrosive-resistant mechanical fasteners, or adhesive. Apply with sufficient adhesive to ensure permanent adhesion and seal with clear lacquer.
- B. Install tags with corrosion resistant chain.
- C. Apply stencil painting in accordance with Section 09 90 00.
- D. Install plastic pipe markers in accordance with manufacturer's instructions.
- E. Install plastic tape pipe markers complete around pipe in accordance with manufacturer's instructions.
- F. Install underground plastic pipe markers 6 to 8 inches below finished grade, directly above buried pipe.
- G. Identify air handling units, pumps, heat transfer equipment, tanks, and water treatment devices with plastic nameplates. Small devices, such as in-line pumps, may be identified with tags.
- H. Identify control panels and major control components outside panels with plastic nameplates.

- I. Identify thermostats relating to terminal boxes or valves with nameplates.
- J. Identify valves in main and branch piping with tags.
- K. Identify air terminal units and radiator valves with numbered tags.
- L. Tag automatic controls, instruments, and relays. Key to control schematic.
- M. Identify piping, concealed or exposed, with plastic pipe markers. Use tags on piping 3/4 inch diameter and smaller. Identify service, flow direction, and pressure. Install in clear view and align with axis of piping. Locate identification not to exceed 20 feet on straight runs including risers and drops, adjacent to each valve and Tee, at each side of penetration of structure or enclosure, and at each obstruction.
- N. Identify ductwork with plastic nameplates or stencilled painting. Identify with air handling unit identification number and area served. Locate identification at air handling unit, at each side of penetration of structure or enclosure, and at each obstruction.
- O. Locate ceiling tacks to locate valves or dampers above lay-in panel ceilings. Locate in corner of panel closest to equipment.

3.03 UNIT TAG SCHEDULE

- A. Equipment Type: Variable - Air Volume Units (VAV)
 - 1. Identification: Tag (VAV-X) where X = VAV number. Include Flow Rates (GPM and Max/Min CFM)
 - 2. Background:
 - a. Size: As needed to contain information
 - b. Color: Yellow
 - 3. Lettering:
 - a. Size: 1/4 inch high
 - b. Color: Black
 - 4. Placement: As directed by Architect/Engineer
- B. Equipment Type: Rooftop Mounted Air Handling Unit (RTU)
 - 1. Identification: Tag (RTU-X) where X = Unit number. Include manufacturer, model number, serial number, date of manufacturer start-up, date of manufacture, refrigerant type (if applicable), voltage, frequency, phase
 - 2. Background:
 - a. Size: As needed to contain information
 - b. Color: Yellow
 - 3. Lettering:
 - a. Size: 1/4 inch high
 - b. Color: Black
 - 4. Placement: As directed by Architect/Engineer
- C. Equipment Type: Pumps (P)
 - 1. Identification: Tag (P-X) where X = Pump number. Include manufacturer, model number, serial number, date of manufacturer start-up, date of manufacture, voltage, frequency, phase, GPM, Design Head Pressure (FT H2O)
 - 2. Background:
 - a. Size: As needed to contain information
 - b. Color: Yellow
 - 3. Lettering:
 - a. Size: 1/4 inch high
 - b. Color: White
 - 4. Placement: As directed by Architect/Engineer

END OF SECTION

SECTION 23 05 93
TESTING, ADJUSTING, AND BALANCING FOR HVAC

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Testing, adjustment, and balancing of air systems.
- B. Measurement of final operating condition of HVAC systems.

1.02 RELATED REQUIREMENTS

- A. Section 23 08 00 - Commissioning of HVAC.

1.03 REFERENCE STANDARDS

- A. AABC MN-1 - AABC National Standards for Total System Balance; Associated Air Balance Council.
- B. ASHRAE Std 111 - Measurement, Testing, Adjusting, and Balancing of Building HVAC Systems.
- C. NEBB (TAB) - Procedural Standards for Testing Adjusting and Balancing of Environmental Systems.
- D. SMACNA (TAB) - HVAC Systems Testing, Adjusting and Balancing.

1.04 SUBMITTALS

- A. See Section 01 33 00 - Administrative Requirements, for submittal procedures.
- B. Installer Qualifications: Submit name of adjusting and balancing agency and TAB supervisor for approval within 30 days after award of Contract.
- C. TAB Plan: Submit a written plan indicating the testing, adjusting, and balancing standard to be followed and the specific approach for each system and component.
 - 1. Submit to the Commissioning Authority.
 - 2. Submit six weeks prior to starting the testing, adjusting, and balancing work.
 - 3. Include certification that the plan developer has reviewed the contract documents, the equipment and systems, and the control system with the Architect and other installers to sufficiently understand the design intent for each system.
 - 4. Include at least the following in the plan:
 - a. Preface: An explanation of the intended use of the control system.
 - b. List of all air flow, water flow, sound level, system capacity and efficiency measurements to be performed and a description of specific test procedures, parameters, formulas to be used.
 - c. Copy of field checkout sheets and logs to be used, listing each piece of equipment to be tested, adjusted and balanced with the data cells to be gathered for each.
 - d. Identification and types of measurement instruments to be used and their most recent calibration date.
 - e. Discussion of what notations and markings will be made on the duct and piping drawings during the process.
 - f. Final test report forms to be used.
 - g. Detailed step-by-step procedures for TAB work for each system and issue, including:
 - 1) Terminal flow calibration (for each terminal type).
 - 2) Diffuser proportioning.
 - 3) Branch/submain proportioning.
 - 4) Total flow calculations.
 - 5) Rechecking.
 - 6) Diversity issues.
 - h. Expected problems and solutions, etc.

Studio JAED Architects & Engineers

TESTING, ADJUSTING, AND
BALANCING FOR HVAC

- i. Criteria for using air flow straighteners or relocating flow stations and sensors; analogous explanations for the water side.
 - j. Details of how TOTAL flow will be determined; for example:
 - 1) Air: Sum of terminal flows via control system calibrated readings or via hood readings of all terminals, supply (SA) and return air (RA) pitot traverse, SA or RA flow stations.
 - 2) Water: Pump curves, circuit setter, flow station, ultrasonic, etc.
 - k. Specific procedures that will ensure that both air and water side are operating at the lowest possible pressures and methods to verify this.
 - l. Confirmation of understanding of the outside air ventilation criteria under all conditions.
 - m. Method of verifying and setting minimum outside air flow rate will be verified and set and for what level (total building, zone, etc.).
 - n. Method of checking building static and exhaust fan and/or relief damper capacity.
 - o. Proposed selection points for sound measurements and sound measurement methods.
 - p. Methods for making coil or other system plant capacity measurements, if specified.
 - q. Time schedule for TAB work to be done in phases (by floor, etc.).
 - r. Description of TAB work for areas to be built out later, if any.
 - s. Time schedule for deferred or seasonal TAB work, if specified.
 - t. False loading of systems to complete TAB work, if specified.
 - u. Exhaust fan balancing and capacity verifications, including any required room pressure differentials.
 - v. Interstitial cavity differential pressure measurements and calculations, if specified.
 - w. Procedures for field technician logs of discrepancies, deficient or uncompleted work by others, contract interpretation requests and lists of completed tests (scope and frequency).
 - x. Procedures for formal progress reports, including scope and frequency.
 - y. Procedures for formal deficiency reports, including scope, frequency and distribution.
- D. Field Logs: Submit at least twice a week to Studio JAED; Commissioning Authority and HVAC Controls Contractor.
- E. Control System Coordination Reports: Communicate in writing to the controls installer all setpoint and parameter changes made or problems and discrepancies identified during TAB that affect, or could affect, the control system setup and operation.
- F. Progress Reports.
- G. Final Report: Indicate deficiencies in systems that would prevent proper testing, adjusting, and balancing of systems and equipment to achieve specified performance.
- 1. Submit to the Commissioning Authority; Studio JAED and HVAC Controls Contractor within two weeks after completion of testing, adjusting, and balancing.
 - 2. Revise TAB plan to reflect actual procedures and submit as part of final report.
 - 3. Submit draft copies of report for review prior to final acceptance of Project. Provide final copies for Architect and for inclusion in operating and maintenance manuals.
 - 4. Provide reports in hard cover letter size 3-ring binder manuals, complete with index page and indexing tabs, with cover identification at front and side. Include set of reduced drawings with air outlets and equipment identified to correspond with data sheets, and indicating thermostat locations.
 - 5. Include actual instrument list, with manufacturer name, serial number, and date of calibration.
 - 6. Form of Test Reports: Where the TAB standard being followed recommends a report format use that; otherwise, follow ASHRAE Std 111.
 - 7. Units of Measure: Report data in I-P (inch-pound) units only.

8. Include the following on the title page of each report:
 - a. Name of Testing, Adjusting, and Balancing Agency.
 - b. Address of Testing, Adjusting, and Balancing Agency.
 - c. Telephone number of Testing, Adjusting, and Balancing Agency.
 - d. Project name.
 - e. Project location.
 - f. Project Engineer.
 - g. Project altitude.
 - h. Report date.
- H. Project Record Documents: Record actual locations of flow measuring stations and balancing valves and rough setting.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION

3.01 GENERAL REQUIREMENTS

- A. Perform total system balance in accordance with one of the following:
 1. AABC MN-1, AABC National Standards for Total System Balance.
 2. NEBB Procedural Standards for Testing Adjusting Balancing of Environmental Systems.
 3. SMACNA (TAB).
 4. Maintain at least one copy of the standard to be used at project site at all times.
- B. Begin work after completion of systems to be tested, adjusted, or balanced and complete work prior to Substantial Completion of the project.
- C. Where HVAC systems and/or components interface with life safety systems, including fire and smoke detection, alarm, and control, coordinate scheduling and testing and inspection procedures with the authorities having jurisdiction.
- D. TAB Agency Qualifications:
 1. Company specializing in the testing, adjusting, and balancing of systems specified in this section.
 2. Having minimum of three years documented experience.
 3. Certified by one of the following:
 - a. AABC, Associated Air Balance Council: www.aabchq.com; upon completion submit AABC National Performance Guaranty.
 - b. NEBB, National Environmental Balancing Bureau: www.nebb.org.
 - c. TABB, The Testing, Adjusting, and Balancing Bureau of National Energy Management Institute: www.tabbcertified.org.
- E. TAB Supervisor Qualifications: Professional Engineer licensed in the State in which the Project is located.

3.02 EXAMINATION

- A. Verify that systems are complete and operable before commencing work. Ensure the following conditions:
 1. Systems are started and operating in a safe and normal condition.
 2. Temperature control systems are installed complete and operable.
 3. Proper thermal overload protection is in place for electrical equipment.
 4. Final filters are clean and in place. If required, install temporary media in addition to final filters.
 5. Duct systems are clean of debris.
 6. Fans are rotating correctly.
 7. Fire and volume dampers are in place and open.
 8. Air coil fins are cleaned and combed.

9. Access doors are closed and duct end caps are in place.
 10. Air outlets are installed and connected.
 11. Duct system leakage is minimized.
 12. Hydronic systems are flushed, filled, and vented.
 13. Pumps are rotating correctly.
 14. Proper strainer baskets are clean and in place.
 15. Service and balance valves are open.
- B. Submit field reports. Report defects and deficiencies that will or could prevent proper system balance.
- C. Beginning of work means acceptance of existing conditions.

3.03 PREPARATION

- A. Hold a pre-balancing meeting at least one week prior to starting TAB work.
1. Require attendance by all installers whose work will be tested, adjusted, or balanced.
- B. Provide instruments required for testing, adjusting, and balancing operations. Make instruments available to Architect to facilitate spot checks during testing.
- C. Provide additional balancing devices as required.

3.04 ADJUSTMENT TOLERANCES

- A. Air Handling Systems: Adjust to within plus or minus 5 percent of design for supply systems and plus or minus 5 percent of design for return and exhaust systems.
- B. Air Outlets and Inlets: Adjust total to within plus 5 percent and minus 5 percent of design to space. Adjust outlets and inlets in space to within plus or minus 5 percent of design.
- C. Hydronic Systems: Adjust to within plus or minus 10 percent of design.

3.05 RECORDING AND ADJUSTING

- A. Field Logs: Maintain written logs including:
1. Running log of events and issues.
 2. Discrepancies, deficient or uncompleted work by others.
 3. Contract interpretation requests.
 4. Lists of completed tests.
- B. Ensure recorded data represents actual measured or observed conditions.
- C. Permanently mark settings of valves, dampers, and other adjustment devices allowing settings to be restored. Set and lock memory stops.
- D. Mark on the drawings the locations where traverse and other critical measurements were taken and cross reference the location in the final report.
- E. After adjustment, take measurements to verify balance has not been disrupted or that such disruption has been rectified.
- F. Leave systems in proper working order, replacing belt guards, closing access doors, closing doors to electrical switch boxes, and restoring thermostats to specified settings.
- G. At final inspection, recheck random selections of data recorded in report. Recheck points or areas as selected and witnessed by the Owner.
- H. Check and adjust systems approximately six months after final acceptance and submit report.

3.06 AIR SYSTEM PROCEDURE

- A. Adjust air handling and distribution systems to provide required or design supply, return, and exhaust air quantities at site altitude.
- B. Make air quantity measurements in ducts by Pitot tube traverse of entire cross sectional area of duct.

- C. Measure air quantities at air inlets and outlets.
- D. Adjust distribution system to obtain uniform space temperatures free from objectionable drafts and noise.
- E. Use volume control devices to regulate air quantities only to extend that adjustments do not create objectionable air motion or sound levels. Effect volume control by duct internal devices such as dampers and splitters.
- F. Vary total system air quantities by adjustment of fan speeds. Provide drive changes required. Vary branch air quantities by damper regulation.
- G. Provide system schematic with required and actual air quantities recorded at each outlet or inlet.
- H. Measure static air pressure conditions on air supply units, including filter and coil pressure drops, and total pressure across the fan. Make allowances for 50 percent loading of filters.
- I. Adjust outside air automatic dampers, outside air, return air, and exhaust dampers for design conditions.
- J. Measure temperature conditions across outside air, return air, and exhaust dampers to check leakage.
- K. Where modulating dampers are provided, take measurements and balance at extreme conditions. Balance variable volume systems at maximum air flow rate, full cooling, and at minimum air flow rate, full heating.
- L. Measure building static pressure and adjust supply, return, and exhaust air systems to provide required relationship between each to maintain approximately 0.05 inches positive static pressure near the building entries.
- M. Check multi-zone units for motorized damper leakage. Adjust air quantities with mixing dampers set first for cooling, then heating, then modulating.
- N. For variable air volume system powered units set volume controller to air flow setting indicated. Confirm connections properly made and confirm proper operation for automatic variable air volume temperature control.
- O. On fan powered VAV boxes, adjust air flow switches for proper operation.

3.07 SCOPE

- A. Test, adjust, and balance the following:
 - 1. Packaged Roof Top Heating/Cooling Units
 - 2. Air Coils
 - 3. Fans

3.08 MINIMUM DATA TO BE REPORTED

- A. Electric Motors:
 - 1. Manufacturer
 - 2. Model/Frame
 - 3. HP/BHP
 - 4. Phase, voltage, amperage; nameplate, actual, no load
 - 5. RPM
 - 6. Service factor
 - 7. Starter size, rating, heater elements
 - 8. Sheave Make/Size/Bore
- B. V-Belt Drives:
 - 1. Identification/location
 - 2. Required driven RPM
 - 3. Driven sheave, diameter and RPM

4. Belt, size and quantity
 5. Motor sheave diameter and RPM
 6. Center to center distance, maximum, minimum, and actual
- C. Air Cooled Condensers:
1. Identification/number.
 2. Location.
 3. Manufacturer.
 4. Model number.
 5. Serial number.
 6. Entering DB air temperature, design and actual.
 7. Leaving DB air temperature, design and actual.
 8. Number of compressors.
- D. Cooling Coils:
1. Identification/number
 2. Location
 3. Service
 4. Manufacturer
 5. Air flow, design and actual
 6. Entering air DB temperature, design and actual
 7. Entering air WB temperature, design and actual
 8. Leaving air DB temperature, design and actual
 9. Leaving air WB temperature, design and actual
 10. Saturated suction temperature, design and actual
 11. Air pressure drop, design and actual
- E. Heating Coils:
1. Identification/number
 2. Location
 3. Service
 4. Manufacturer
 5. Air flow, design and actual
 6. Entering air temperature, design and actual
 7. Leaving air temperature, design and actual
 8. Air pressure drop, design and actual
- F. Air Moving Equipment:
1. Location
 2. Manufacturer
 3. Model number
 4. Serial number
 5. Arrangement/Class/Discharge
 6. Air flow, specified and actual
 7. Return air flow, specified and actual
 8. Outside air flow, specified and actual
 9. Total static pressure (total external), specified and actual
 10. Inlet pressure
 11. Discharge pressure
 12. Sheave Make/Size/Bore
 13. Number of Belts/Make/Size
 14. Fan RPM
- G. Return Air/Outside Air:

1. Identification/location
 2. Design air flow
 3. Actual air flow
 4. Design return air flow
 5. Actual return air flow
 6. Design outside air flow
 7. Actual outside air flow
 8. Return air temperature
 9. Outside air temperature
 10. Required mixed air temperature
 11. Actual mixed air temperature
 12. Design outside/return air ratio
 13. Actual outside/return air ratio
- H. Duct Traverses:
1. System zone/branch
 2. Duct size
 3. Area
 4. Design velocity
 5. Design air flow
 6. Test velocity
 7. Test air flow
 8. Duct static pressure
 9. Air temperature
 10. Air correction factor
- I. Air Monitoring Stations:
1. Identification/location
 2. System
 3. Size
 4. Area
 5. Design velocity
 6. Design air flow
 7. Test velocity
 8. Test air flow
- J. Flow Measuring Stations:
1. Identification/number
 2. Location
 3. Size
 4. Manufacturer
 5. Model number
 6. Serial number
 7. Design Flow rate
 8. Design pressure drop
 9. Actual/final pressure drop
 10. Actual/final flow rate
 11. Station calibrated setting

END OF SECTION

SECTION 23 07 13
DUCT INSULATION

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Duct insulation.
- B. Insulation jackets.

1.02 RELATED REQUIREMENTS

- A. Section 09 90 00 - Painting and Coating: Painting insulation jackets.
- B. Section 23 05 53 - Identification for HVAC Piping and Equipment.
- C. Section 23 31 00 - HVAC Ducts and Casings: Glass fiber ducts.

1.03 REFERENCE STANDARDS

- A. ASTM B209 - Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate.
- B. ASTM B209M - Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate [Metric].
- C. ASTM C518 - Standard Test Method for Steady-State Thermal Transmission Properties by Means of the Heat Flow Meter Apparatus.
- D. ASTM C553 - Standard Specification for Mineral Fiber Blanket Thermal Insulation for Commercial and Industrial Applications.
- E. ASTM C612 - Standard Specification for Mineral Fiber Block and Board Thermal Insulation.
- F. ASTM C1071 - Standard Specification for Fibrous Glass Duct Lining Insulation (Thermal and Sound Absorbing Material).
- G. ASTM E84 - Standard Test Method for Surface Burning Characteristics of Building Materials.
- H. ASTM E96/E96M - Standard Test Methods for Water Vapor Transmission of Materials.
- I. ASTM G21 - Standard Practice for Determining Resistance of Synthetic Polymeric Materials to Fungi.
- J. NFPA 255 - Standard Method of Test of Surface Burning Characteristics of Building Materials; National Fire Protection Association.
- K. SMACNA (DCS) - HVAC Duct Construction Standards Metal and Flexible.
- L. UL 723 - Standard for Test for Surface Burning Characteristics of Building Materials.

1.04 SUBMITTALS

- A. Product Data: Provide product description, thermal characteristics, list of materials and thickness for each service, and locations.
- B. Manufacturer's Instructions: Indicate installation procedures necessary to ensure acceptable workmanship and that installation standards will be achieved.

1.05 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing products of the type specified in this section with not less than three years of documented experience.
- B. Applicator Qualifications: Company specializing in performing the type of work specified in this section, with minimum three years of experience and approved by manufacturer.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. Accept materials on site in original factory packaging, labelled with manufacturer's identification, including product density and thickness.

- B. Protect insulation from weather and construction traffic, dirt, water, chemical, and mechanical damage, by storing in original wrapping.

1.07 FIELD CONDITIONS

- A. Maintain ambient temperatures and conditions required by manufacturers of adhesives, mastics, and insulation cements.
- B. Maintain temperature during and after installation for minimum period of 24 hours.

PART 2 PRODUCTS

2.01 REQUIREMENTS FOR ALL PRODUCTS OF THIS SECTION

- A. Surface Burning Characteristics: Flame spread/Smoke developed index of 25/50, maximum, when tested in accordance with ASTM E84, NFPA 255, or UL 723.

2.02 GLASS FIBER, FLEXIBLE

- A. Manufacturer:
 - 1. Knauf Insulation: www.knaufusa.com.
 - 2. Johns Manville Corporation: www.jm.com.
 - 3. Owens Corning Corporation; _____: www.ocbuildingspec.com.
 - 4. CertainTeed Corporation: www.certainteed.com.
 - 5. Substitutions: See Gilbane Building Company.
- B. Insulation: ASTM C553; flexible, noncombustible blanket.
 - 1. 'K' value: 0.36 at 75 degrees F, when tested in accordance with ASTM C518.
 - 2. Maximum Service Temperature: 450 degrees F.
 - 3. Maximum Water Vapor Sorption: 5.0 percent by weight.
- C. Vapor Barrier Jacket:
 - 1. Moisture Vapor Permeability: 0.02 perm inch, when tested in accordance with ASTM E96/E96M.
 - 2. Secure with pressure sensitive tape.
- D. Vapor Barrier Tape:
 - 1. Kraft paper reinforced with glass fiber yarn and bonded to aluminized film, with pressure sensitive rubber based adhesive.
- E. Outdoor Vapor Barrier Mastic:
 - 1. Vinyl emulsion type acrylic or mastic, compatible with insulation, black color.
- F. Tie Wire: Annealed steel, 16 gage, 0.0508 inch diameter.

2.03 GLASS FIBER, RIGID

- A. Manufacturer:
 - 1. Knauf Insulation: www.knaufusa.com.
 - 2. Johns Manville Corporation: www.jm.com.
 - 3. Owens Corning Corp: www.owenscorning.com.
 - 4. CertainTeed Corporation: www.certainteed.com.
 - 5. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Insulation: ASTM C612; rigid, noncombustible blanket.
 - 1. 'K' value: 0.24 at 75 degrees F, when tested in accordance with ASTM C518.
 - 2. Maximum service temperature: 450 degrees F.
 - 3. Maximum Water Vapor Sorption: 5.0 percent.
 - 4. Maximum Density: 8.0 lb/cu ft.
- C. Vapor Barrier Jacket:
 - 1. Moisture Vapor Permeability: 0.02 perm inch, when tested in accordance with ASTM E96/E96M.

2. Secure with pressure sensitive tape.
- D. Vapor Barrier Tape:
 1. Kraft paper reinforced with glass fiber yarn and bonded to aluminized film, with pressure sensitive rubber based adhesive.
- E. Indoor Vapor Barrier Finish:
 1. Cloth: Untreated; 9 oz/sq yd weight, glass fabric.
 2. Vinyl emulsion type acrylic, compatible with insulation, black color.

2.04 JACKETS

- A. Canvas Jacket: UL listed 6 oz/sq yd plain weave cotton fabric treated with dilute fire retardant lagging adhesive.
 1. Lagging Adhesive:
 - a. Compatible with insulation.
- B. Mineral Fiber (Outdoor) Jacket: Asphalt impregnated and coated sheet, 50 lb/square.
- C. Aluminum Jacket: ASTM B209 (ASTM B209M).
 1. Thickness: 0.016 inch sheet.
 2. Finish: Smooth.
 3. Joining: Longitudinal slip joints and 2 inch laps.
 4. Fittings: 0.016 inch thick die shaped fitting covers with factory attached protective liner.
 5. Metal Jacket Bands: 3/8 inch wide; 0.015 inch thick aluminum.
 6. Metal Jacket Bands: 3/8 inch wide; 0.010 inch thick stainless steel.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that ducts have been tested before applying insulation materials.
- B. Verify that surfaces are clean, foreign material removed, and dry.

3.02 INSTALLATION

- A. Install in accordance with manufacturer's instructions.
- B. Install in accordance with NAIMA National Insulation Standards.
- C. Insulated ducts conveying air below ambient temperature:
 1. Provide insulation with vapor barrier jackets.
 2. Finish with tape and vapor barrier jacket.
 3. Continue insulation through walls, sleeves, hangers, and other duct penetrations.
 4. Insulate entire system including fittings, joints, flanges, fire dampers, flexible connections, and expansion joints.
- D. Insulated ducts conveying air above ambient temperature:
 1. Provide with or without standard vapor barrier jacket.
 2. Insulate fittings and joints. Where service access is required, bevel and seal ends of insulation.
- E. Ducts Exposed in Mechanical Equipment Rooms or Finished Spaces : Finish with aluminum jacket.
- F. Exterior Applications: Provide insulation with vapor barrier jacket. Cover with with calked aluminum jacket with seams located on bottom side of horizontal duct section. Provide tapered caps on horizontal ducts to shed water.
- G. External Duct Insulation Application:
 1. Secure insulation with vapor barrier with wires and seal jacket joints with vapor barrier adhesive or tape to match jacket.
 2. Secure insulation without vapor barrier with staples, tape, or wires.

3. Install without sag on underside of duct. Use adhesive or mechanical fasteners where necessary to prevent sagging. Lift duct off trapeze hangers and insert spacers.
4. Seal vapor barrier penetrations by mechanical fasteners with vapor barrier adhesive.
5. Stop and point insulation around access doors and damper operators to allow operation without disturbing wrapping.

3.03 SCHEDULES

A. INDOOR DUCT AND PLENUM APPLICATION SCHEDULE

1. Service: Rectangular, supply-air ducts, exposed.
 - a. Material: Mineral-fiber board.
 - b. Thickness: 2 inches, Minimum R-6.
 - c. Jacket: Aluminum.
 - d. Vapor Retarder Required: Yes.
2. Service: Rectangular, return-air ducts, exposed.
 - a. Material: Mineral-fiber board.
 - b. Thickness: 2 inches, Minimum R-6.
 - c. Jacket: Aluminum.
 - d. Vapor Retarder Required: No.

B. OUTDOOR DUCT AND PLENUM APPLICATION SCHEDULE

1. Service: Rectangular, supply-air ducts.
 - a. Material: Mineral-fiber board.
 - b. Thickness: 3 inches, Minimum R-8.
 - c. Field-Applied Jacket: Aluminum
 - 1) Aluminum Thickness: 0.032 inch
 - d. Vapor Retarder Required: Yes.
2. Service: Rectangular, return-air ducts.
 - a. Material: Mineral-fiber board.
 - b. Thickness: 3 inches, Minimum R-8.
 - c. Field-Applied Jacket: Aluminum
 - 1) Aluminum Thickness: 0.032 inch
 - d. Vapor Retarder Required: Yes.

END OF SECTION

SECTION 23 09 13

INSTRUMENTATION AND CONTROL DEVICES FOR HVAC

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. input / Output Sensors
- B. Automatic dampers.
- C. Damper operators.
- D. Time clocks.
- E. Miscellaneous accessories.

1.02 RELATED REQUIREMENTS

- A. Section 23 05 48 - Vibration and Seismic Con. for HVAC and Plumb, Piping and Equip..
- B. Section 23 05 19 - Meters and Gages for HVAC Piping.
- C. Section 23 21 13 - Hydronic Piping.
- D. Section 23 33 00 - Air Duct Accessories.
- E. Section 26 27 17 - Equipment Wiring: Electrical characteristics and wiring connections.
- F. Section 23 09 23 - Direct-Digital Control System for HVAC.
- G. Section 23 09 93 - Sequence of Operations for HVAC Controls.
- H. Section 26 27 26 - Wiring Devices.
- I. Section 26 27 17 - Equipment Wiring.

1.03 REFERENCE STANDARDS

- A. AMCA 500-D - Laboratory Methods of Testing Dampers for Rating.
- B. ASME B16.22 - Wrought Copper and Copper Alloy Solder-Joint Pressure Fittings.
- C. ASTM B32 - Standard Specification for Solder Metal.
- D. ASTM B88 - Standard Specification for Seamless Copper Water Tube.
- E. ASTM B819 - Standard Specification for Seamless Copper Tube for Medical Gas Systems.
- F. ASTM D1693 - Standard Test Method for Environmental Stress-Cracking of Ethylene Plastics.
- G. NEMA DC 3 - Residential Controls - Electrical Wall-Mounted Room Thermostats.
- H. NEMA 250 - Enclosures for Electrical Equipment (1000 Volts Maximum); National Electrical Manufacturers Association.
- I. NFPA 90A - Standard for the Installation of Air-Conditioning and Ventilating Systems.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Preinstallation Meeting: Conduct a preinstallation meeting one week before starting work of this section; require attendance by all affected installers.

1.05 SUBMITTALS

- A. See Section 01 33 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide description and engineering data for each control system component. Include sizing as requested. Provide data for each system component and software module.
- C. Shop Drawings: Indicate complete operating data, system drawings, wiring diagrams, and written detailed operational description of sequences. Submit schedule of valves indicating size, flow, and pressure drop for each valve. For automatic dampers indicate arrangement, velocities, and static pressure drops for each system.

- D. Manufacturer's Instructions: Provide for all manufactured components.
- E. Project Record Documents: Record actual locations of control components, including panels, thermostats, and sensors. Accurately record actual location of control components, including panels, thermostats, and sensors.
 - 1. Revise shop drawings to reflect actual installation and operating sequences.
- F. Operation and Maintenance Data: Include inspection period, cleaning methods, recommended cleaning materials, and calibration tolerances.
- G. Warranty: Submit manufacturers warranty and ensure forms have been filled out in Owner s name and registered with manufacturer.
- H. Maintenance Materials:
 - 1. See Section 01 60 00 - Product Requirements, for additional provisions.

1.06 QUALITY ASSURANCE

- A. Designer Qualifications: Design system under direct supervision of a Professional Engineer experienced in design of this work and licensed at the State in which the Project is located.
- B. Manufacturer Qualifications: Company specializing in manufacturing the Products specified in this section with minimum three years documented experience.
- C. Installer Qualifications: Company specializing in performing the work of this section with minimum 3 years experience approved by manufacturer.
- D. Products Requiring Electrical Connection: Listed and classified by Underwriters Laboratories Inc., as suitable for the purpose specified and indicated.

1.07 PRE-INSTALLATION MEETING

- A. Convene one week before starting work of this section.

1.08 WARRANTY

- A. See Section 01 78 13 - Closeout Submittals, for additional warranty requirements.
- B. Correct defective Work within a 1 year period after Substantial Completion.

1.09 MAINTENANCE SERVICE

- A. Provide service and maintenance of control system for one year from Date of Substantial Completion.
- B. Provide complete service of controls systems, including call backs. Make minimum of 5 complete normal inspections of approximately 4 hours duration in addition to normal service calls to inspect, calibrate, and adjust controls, and submit written reports.

1.10 EXTRA MATERIALS

- A. See Section 01 60 00 - Product Requirements, for additional provisions.
- B. Provide two of each type of thermostat and exposed sensor.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Johnson Controls.
- B. Substitutions: Not permitted.

2.02 EQUIPMENT - GENERAL

- A. Products Requiring Electrical Connection: Listed and classified by Underwriters Laboratories Inc., as suitable for the purpose specified and indicated.

2.03 CONTROL PANELS

- A. Unitized cabinet type for each system under automatic control with relays and controls mounted in cabinet and temperature indicators, pressure gages, pilot lights, push buttons and switches flush on cabinet panel face.
- B. NEMA 250, general purpose utility enclosures with enamelled finished face panel.
- C. Provide common keying for all panels.

2.04 DAMPERS

- A. Performance: Test in accordance with AMCA 500-D.
- B. Frames: Extruded aluminum; welded or riveted with corner reinforcement, minimum 12 gage.
- C. Blades: Extruded aluminum; maximum blade size 8 inches wide, 48 inches long, minimum 22 gage, attached to minimum 1/2 inch shafts with set screws.
- D. Blade Seals: Synthetic elastomeric or Neoprene mechanically attached, field replaceable.
- E. Jamb Seals: Spring stainless steel.
- F. Shaft Bearings: Oil impregnated sintered bronze.
- G. Linkage Bearings: Oil impregnated sintered bronze or graphite impregnated nylon.
- H. Leakage: Less than one percent based on approach velocity of 2000 ft/min and 4 inches wg.
- I. Maximum Pressure Differential: 6 inches wg.
- J. Temperature Limits: -40 to 200 degrees F.
- K. Product:
 - 1. Ruskin
 - 2. Substitutions: See Section 01 60 00 - Product Requirements.

2.05 DAMPER OPERATORS

- A. General: Provide smooth proportional control with sufficient power for air velocities 20 percent greater than maximum design velocity and to provide tight seal against maximum system pressures. Provide spring return for two position control and for fail safe operation.
 - 1. Provide sufficient number of operators to achieve unrestricted movement throughout damper range.
 - 2. Provide one operator for maximum 36 sq ft damper section.
- B. Pilot Positioners: Starting point adjustable from 2 to 12 psig and operating span adjustable from 5 to 13 psig.
- C. Electric Operators:
 - 1. Spring return, adjustable stroke motor having oil immersed gear train, with auxiliary end switch and minimum position potentiometer.
- D. Inlet Vane Operators:
 - 1. High pressure with pilot positioners and sufficient force to move vanes when fan is started with vanes in closed position. Return vane operator to closed position on fan shutdown.

2.06 INPUT/OUTPUT SENSORS

- A. Temperature Sensors:
 - 1. Resistance temperature detectors with resistance tolerance of plus or minus 0.1 percent at 70 degrees F, interchangeability less than plus or minus 0.2 percent, time constant of 13 seconds maximum for fluids and 200 seconds maximum for air.
 - 2. Measuring current maximum 5 mA with maximum self-heat of 0.031 degrees F/mW in fluids and 0.014 degrees F/mW in air.
 - 3. Provide 3 lead wires and shield for input bridge circuit.

4. Use insertion elements in ducts not affected by temperature stratification or smaller than one square meter. Use averaging elements where larger or prone to stratification sensor length 8 feet or 16 feet as required.
 5. Insertion elements for liquids shall be with brass socket with minimum insertion length of 2-1/2 inches.
 6. Room sensors: Johnson 9100 series or equal.
 7. Outside air sensors: Watertight inlet fitting, shielded from direct rays of sun.
- B. Humidity Sensors:
1. Wall Mounted Sensor: Voltage type encased in a plastic housing.
 - a. Input Power, Voltage Type: Class 2; 12-24 VDC/24 VAC.
 - b. Input Power, mA Type: Class 2; Loop powered 12-30 VDC, 30 mA observed polarity.
 - c. Output Voltage type: 0-10 V.
 - d. Output mA type: 24-20 mA, 2-wire, not polarity sensitive.
 - e. Humidity:
 - 1) HS Element: Digitally profiled thin-film capacitive.
 - 2) Accuracy 2 percent at 10 to 80 percent relative humidity at 77 degrees F.
 - (a) Plus/minus 1 percent at 20-40 percent RH in mA output mode; (multi-point calibration, NIST traceable).
 - 3) Scaling: 0-100 percent RH.
 - f. Hysteresis: 1.5 percent typical.
 - g. Linearity: Included in accuracy specification.
 - h. Reset Rate: 24 hours.
 - i. Stability: Plus/minus 1 percent @ 68 degrees F (20 degrees C) annually, for two years.
 - j. Temperature:
 - 1) Temperature Transmitter Output: Digital, 4-20mA (clipped & capped) or 0-5V/0-10V output.
 - k. Operating Environment:
 - 1) Operating Humidity Range: 0 to 100 percent RH noncondensing.
 - 2) Operating Temperature Range: 50 degrees F to 95 degrees F.
 2. Elements: Accurate within 5 percent full range with linear output.
 3. Room Sensors: With locking cover, span of 30 to 80 percent relative humidity.
 4. Duct and Outside Air Sensors: With element guard and mounting plate, range of 0 - 100 percent relative humidity.
- C. Equipment Operation Sensors:
1. Status Inputs for Fans: Differential pressure switch with adjustable range of 0 to 5 inches wg.
 2. Status Inputs for Pumps: Differential pressure switch piped across pump with adjustable pressure differential range of 8 to 60 psi.
 3. Status Inputs for Electric Motors: Current sensing relay with current transformers, adjustable and set to 175 percent of rated motor current.
- D. Damper Position Indication: Potentiometer mounted in enclosure with adjustable crank arm assembly connected to damper to transmit 0 - 100 percent damper travel.

2.07 TRANSMITTERS

- A. Building Static Pressure Transmitter:
1. One pipe, differential type with temperature compensation, scale range 0.01 to 6.0 inch wg positive or negative, and sensitivity of 0.0005 inch wg. Transmit electronic signal to receiver with matching scale range.
- B. Pressure Transmitters:

1. One pipe direct acting for gas, liquid, or steam service, range suitable for system, proportional electronic output.
- C. Temperature Transmitters:
 1. One pipe, directly proportional output signal to measured variable, linearity within plus or minus 1/2 percent of range for 200 degree F span and plus or minus 1 percent for 50 degree F span, with 200 degrees F temperature range, compensated bulb, averaging capillary, or rod and tube operation on 20 psig input pressure and 3 to 15 psig output.
- D. Humidity Transmitters:
 1. One pipe, directly proportioned output signal to measured variable, linearity within plus or minus 1 percent for 70 percent relative humidity span, capable of withstanding 95 percent relative humidity without loss of calibration.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify existing conditions before starting work.
- B. Verify that systems are ready to receive work.
- C. Beginning of installation means installer accepts existing conditions.
- D. Sequence work to ensure installation of components is complementary to installation of similar components in other systems.
- E. Coordinate installation of system components with installation of mechanical systems equipment such as air handling units and air terminal units.
- F. Ensure installation of components is complementary to installation of similar components.
- G. Coordinate installation of system components with installation of mechanical systems equipment such as air handling units and air terminal units.

3.02 INSTALLATION

- A. Install in accordance with manufacturer's instructions.
- B. Check and verify location of thermostats, humidistats, and exposed control sensors with plans and room details before installation. Locate 60 inches above floor. Align with lighting switches and humidistats. Refer to Section 26 27 26.
- C. Mount freeze protection thermostats using flanges and element holders.
- D. Mount outdoor reset thermostats and outdoor sensors indoors, with sensing elements outdoors with sun shield.
- E. Provide separable sockets for liquids and flanges for air bulb elements.
- F. Provide guards on thermostats in entrances and public areas.
- G. Provide valves with position indicators and with pilot positioners where sequenced with other controls.
- H. Provide separate steam valves for each bank of coils. Provide two valves in parallel where steam load exceeds 1500 lb/hr with 1/3 - 2/3 load capacities sequenced with smaller valve opening first.
- I. Provide mixing dampers of opposed blade construction arranged to mix streams. Provide pilot positioners on mixed air damper motors.
- J. Provide isolation (two position) dampers of parallel blade construction.
- K. Provide pilot positioners on pneumatic damper operators sequenced with other controls.
- L. Install damper motors on outside of duct in warm areas. Do not install motors in locations at outdoor temperatures.

- M. Mount control panels adjacent to associated equipment on vibration free walls or free standing angle iron supports. One cabinet may accommodate more than one system in same equipment room. Provide engraved plastic nameplates for instruments and controls inside cabinet and engraved plastic nameplates on cabinet face.
- N. Install "hand/off/auto" selector switches to override automatic interlock controls when switch is in "hand" position.
- O. Provide conduit and electrical wiring in accordance with Section 26 27 17. Electrical material and installation shall be in accordance with appropriate requirements of Division 26.

3.03 MAINTENANCE

- A. Provide service and maintenance of control system for one year from Date of Substantial Completion.
- B. Provide complete service of controls systems, including call backs, and submit written report of each service call.

END OF SECTION

SECTION 23 09 23
DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. System Description
- B. Operator Interface
- C. Controllers
- D. Power Supplies and Line Filtering
- E. System Software
- F. Controller Software
- G. HVAC Control Programs
- H. Control equipment.
- I. Software.

1.02 RELATED REQUIREMENTS

- A. Section 23 09 13 - Instrumentation and Control Devices for HVAC.
- B. Section 23 09 93 - Sequence of Operations for HVAC Controls.
- C. Section 26 27 17 - Equipment Wiring: Electrical characteristics and wiring connections.

1.03 REFERENCE STANDARDS

- A. NFPA 70 - National Electrical Code.

1.04 SYSTEM DESCRIPTION

- A. The ATC System shall be one of BACnet MS/TP direct digital controls.
- B. Automatic temperature control field monitoring and control system using field programmable micro-processor based units with connection to the existing, campus-wide Johnson Controls Metasys Building Management System,, fully accessible via fully secured web-assessible internet portal as manufactured by Johnson Controls utilizing electric actuation. A web-based extension to the existing Metasys network shall be installed and appear seamless with the new Metasys or BACnet MS/TP devices to the Owner's operators.
- C. Graphics shall be provided and programmed to include equipment-specific graphics as described in the individual sequences of operations and minimally a diagram showing the layout of each unit with major components and dynamic temperatures shown where temperature sensors exist in the system. An interactive floor plan graphic shall be provided for each building.
- D. Base system on distributed system of fully intelligent, stand-alone controllers, operating in a multi-tasking, multi-user environment on token passing network, with central and remote hardware, software, and interconnecting wire and conduit.
- E. Include computer software and hardware, operator input/output devices, control units, local area networks (LAN), sensors, control devices, actuators.
- F. Controls for AHUs, VAV boxes, exhaust fans, ventilators, make up air units, unit heaters, fan coils, and the like when directly connected to the control units. Individual terminal unit control is specified in Section 23 09 13.
- G. Provide control systems consisting of thermostats, control valves, dampers and operators, indicating devices, interface equipment and other apparatus and accessories required to operate mechanical systems, and to perform functions specified. All sensor locations in rooms, piping, and ductwork shall be confirmed with the engineer prior to installation.

- H. Include installation and calibration, supervision, adjustments, and fine tuning necessary for complete and fully operational system.
- I. Include installation of power wiring for all controllers and control transformers as required to complete the work.

1.05 SUBMITTALS

- A. See Section 01 33 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide data for each system component and software module.
- C. Shop Drawings:
 - 1. Indicate trunk cable schematic showing programmable control unit locations, and trunk data conductors.
 - 2. List connected data points, including connected control unit and input device.
 - 3. Indicate system graphics indicating monitored systems, data (connected and calculated) point addresses, and operator notations.
 - 4. Show system configuration with peripheral devices, batteries, power supplies, diagrams, modems, and interconnections.
 - 5. Indicate description and sequence of operation of operating, user, and application software.
- D. Manufacturer's Instructions: Indicate manufacturer's installation instructions for all manufactured components.
- E. Project Record Documents: Record actual locations of control components, including control units, thermostats, and sensors.
 - 1. Revise shop drawings to reflect actual installation and operating sequences.
 - 2. Include submittals data in final "Record Documents" form.
- F. Operation and Maintenance Data:
 - 1. Include interconnection wiring diagrams complete field installed systems with identified and numbered, system components and devices.
 - 2. Include keyboard illustrations and step-by-step procedures indexed for each operator function.
 - 3. Include inspection period, cleaning methods, cleaning materials recommended, and calibration tolerances.
- G. Warranty: Submit manufacturer's warranty and ensure forms have been filled out in Owner s name and registered with manufacturer.

1.06 QUALITY ASSURANCE

- A. Perform work in accordance with NFPA 70.
- B. Design system software under direct supervision of a Professional Engineer experienced in design of this Work and licensed in the State in which the Project is located.
- C. Manufacturer Qualifications: Company specializing in manufacturing the Products specified in this section with minimum 10 years documented experience.
- D. Installer Qualifications: Company specializing in performing the work of this section minimum 10 years documented experience approved by manufacturer.
- E. Products Requiring Electrical Connection: Listed and classified by Underwriters Laboratories Inc. or testing firm acceptable to the authority having jurisdiction as suitable for the purpose specified and indicated.

1.07 PRE-INSTALLATION MEETING

- A. Convene one week before starting work of this Section.
- B. Require attendance of parties directly affecting the work of this Section.

1.08 WARRANTY

- A. See Section 01 77 00 - Closeout Submittals, for additional warranty requirements.
- B. Correct defective Work within a five year period after Substantial Completion.
- C. Provide five year manufacturer's warranty for field programmable micro-processor based units.

1.09 MAINTENANCE SERVICE

- A. Provide service and maintenance of energy management and control systems for one years from Date of Substantial Completion.
- B. Provide four complete inspections per year, two in each season, to inspect, calibrate, and adjust controls as required, and submit written reports.
- C. Provide complete service of systems, including call backs. Make minimum of 4 complete normal inspections of approximately 4 hours duration in addition to normal service calls to inspect, calibrate, and adjust controls, and submit written reports.

1.10 EXTRA MATERIALS

- A. See Section 01 60 00 - Product Requirements, for additional provisions.

1.11 PROTECTION OF SOFTWARE RIGHTS

- A. Prior to delivery of software, Owner and the party providing the software will enter into a software license agreement with provisions for the following:
 - 1. Limiting use of software to equipment provided under these specifications.
 - 2. Limiting copying.
 - 3. Preserving confidentiality.
 - 4. Prohibiting transfer to a third party.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Johnson Controls, Inc: www.johnsoncontrols.com.
- B. Substitutions: Not Permitted.

2.02 CONTROLLERS

- A. BUILDING CONTROLLERS
 - 1. General:
 - a. Manage global strategies by one or more, independent, standalone, microprocessor based controllers.
 - b. Provide sufficient memory to support controller's operating system, database, and programming requirements.
 - c. Share data between networked controllers.
 - d. Controller operating system manages input and output communication signals allowing distributed controllers to share real and virtual object information and allowing for central monitoring and alarms.
 - e. Utilize real-time clock for scheduling.
 - f. Continuously check processor status and memory circuits for abnormal operation.
 - g. Controller to assume predetermined failure mode and generate alarm notification upon detection of abnormal operation.
 - h. Communication with other network devices to be based on assigned protocol.
 - 2. Communication:
 - a. Controller to reside on a BACnet network using ISO 8802-3 (ETHERNET) Data Link/Physical layer protocol.
 - b. Perform routing when connected to a network of custom application and application specific controllers.

- c. Provide service communication port for connection to a portable operator's terminal or hand held device with compatible protocol.
 3. Anticipated Environmental Ambient Conditions:
 - a. Outdoors and/or in Wet Ambient Conditions:
 - 1) Mount within waterproof enclosures.
 - 2) Rated for operation at 40 to 150 degrees F.
 - b. Conditioned Space:
 - 1) Mount within dustproof enclosures.
 - 2) Rated for operation at 32 to 120 degrees F.
 4. Provisions for Serviceability:
 - a. Diagnostic LEDs for power, communication, and processor.
 - b. Make all wiring connections to field removable, modular terminal strips, or to a termination card connected by a ribbon cable.
 5. Memory: In the event of a power loss, maintain all BIOS and programming information for a minimum of 72 hours.
 6. Power and Noise Immunity:
 - a. Maintain operation at 90 to 110 percent of nominal voltage rating.
 - b. Perform orderly shutdown below 80 percent of nominal voltage.
 - c. Operation protected against electrical noise of 5 to 120 Hz and from keyed radios up to 5 W. at 3 feet.
- B. INPUT/OUTPUT INTERFACE
 1. Hardwired inputs and outputs tie into the DDC system through building, custom application, or application specific controllers.
 2. All Input/Output Points:
 - a. Protect controller from damage resulting from any point short-circuiting or grounding and from voltage up to 24 volts of any duration.
 - b. Provide universal type for building and custom application controllers where input or output is software designated as either binary or analog type with appropriate properties.
 3. Binary Inputs:
 - a. Allow monitoring of On/Off signals from remote devices.
 - b. Provide wetting current of 12 mA minimum, compatible with commonly available control devices and protected against the effects of contact bounce and noise.
 - c. Sense dry contact closure with power provided only by the controller.
 4. Pulse Accumulation Input Objects: Conform to all requirements of binary input objects and accept up to 10 pulses per second.
 5. Analog Inputs:
 - a. Allow for monitoring of low voltage 0 to 10 VDC, 4 to 20 mA current, or resistance signals (thermistor, RTD).
 - b. Compatible with and field configurable to commonly available sensing devices.
 6. Binary Outputs:
 - a. Used for On/Off operation or a pulsed low-voltage signal for pulse width modulation control.
 - b. Outputs provided with three position (On/Off/Auto) override switches.
 - c. Status lights for building and custom application controllers to be selectable for normally open or normally closed operation.
 7. Analog Outputs:
 - a. Monitoring signal provides a 0 to 10 VDC or a 4 to 20 mA output signal for end device control.

- b. Provide status lights and two position (AUTO/MANUAL) switch for building and custom application controllers with manually adjustable potentiometer for manual override on building and custom application controllers.
- c. Drift to not exceed 0.4 percent of range per year.
- 8. Tri State Outputs:
 - a. Coordinate two binary outputs to control three point, floating type, electronic actuators without feedback.
 - b. Limit the use of three point, floating devices to the following zone and terminal unit control applications:
 - c. Control algorithms run the zone actuator to one end of its stroke once every 24 hours for verification of operator tracking.
- 9. System Object Capacity:
 - a. System size to be expandable to twice the number of input output objects required by providing additional controllers, including associated devices and wiring.
 - b. Hardware additions or software revisions for the installed operator interfaces are not to be required for future, system expansions.

2.03 POWER SUPPLIES AND LINE FILTERING

- A. Power Supplies:
 - 1. Provide UL listed control transformers with Class 2 current limiting type or over-current protection in both primary and secondary circuits for Class 2 service as required by the NEC.
 - 2. Limit connected loads to 80 percent of rated capacity.
 - 3. Match DC power supply to current output and voltage requirements.
 - 4. Unit to be full wave rectifier type with output ripple of 5.0 mV maximum peak to peak.
 - 5. Regulation to be 1 percent combined line and load with 100 microsecond response time for 50 percent load changes.
 - 6. Provide over-voltage and over-current protection to withstand a 150 percent current overload for 3 seconds minimum without trip-out or failure.
 - 7. Operational Ambient Conditions: 32 to 120 degrees F.
 - 8. EM/RF meets FCC Class B and VDE 0871 for Class B and MIL-STD 810 for shock and vibration.
 - 9. Line voltage units UL recognized and CSA approved.
- B. Power Line Filtering:
 - 1. Provide external or internal transient voltage and surge suppression component for all workstations and controllers.
 - 2. Minimum surge protection attributes:
 - a. Dielectric strength of 1000 volts minimum.
 - b. Response time of 10 nanoseconds or less.
 - c. Transverse mode noise attenuation of 65 dB or greater.
 - d. Common mode noise attenuation of 150 dB or greater at 40 to 100 Hz.

2.04 OPERATOR STATION

- A. Work Station:
 - 1. Not required. Tie into existing campus-wide BAS network.

2.05 CONTROL UNITS

- A. Units: Modular in design and consisting of processor board with programmable RAM memory, local operator access and display panel, and integral interface equipment.
- B. Battery Backup: For minimum of 48 hours for complete system including RAM without interruption, with automatic battery charger.
- C. Control Units Functions:

1. Monitor or control each input/output point.
 2. Completely independent with hardware clock/calendar and software to maintain control independently.
 3. Acquire, process, and transfer information to operator station or other control units on network.
 4. Accept, process, and execute commands from other control unit's or devices or operator stations.
 5. Access both data base and control functions simultaneously.
 6. Record, evaluate, and report changes of state or value that occur among associated points. Continue to perform associated control functions regardless of status of network.
 7. Perform in stand-alone mode:
 - a. Start/stop.
 - b. Duty cycling.
 - c. Automatic Temperature Control.
 - d. Demand control via a sliding window, predictive algorithm.
 - e. Event initiated control.
 - f. Calculated point.
 - g. Scanning and alarm processing.
 - h. Full direct digital control.
 - i. Trend logging.
 - j. Global communications.
 - k. Maintenance scheduling.
- D. Global Communications:
1. Broadcast point data onto network, making that information available to all other system control units.
 2. Transmit any or all input/output points onto network for use by other control units and utilize data from other control units.
- E. Input/Output Capability:
1. Discrete/digital input (contact status).
 2. Discrete/digital output.
 3. Analog input.
 4. Analog output.
 5. Pulse input (5 pulses/second).
 6. Pulse output (0-655 seconds in duration with 0.01 second resolution).
- F. Monitor, control, or address data points. Mix shall include analog inputs, analog outputs, pulse inputs, pulse outputs and discrete inputs/outputs, as required. Install control unit's with minimum 30 percent spare capacity.
- G. Point Scanning: Set scan or execution speed of each point to operator selected time from 1 to 250 seconds.
- H. Upload/Download Capability: Download from or upload to operator station. Upload/Download time for entire control unit database maximum 10 seconds on hard wired LAN, or 60 seconds over voice grade phone lines.
- I. Test Mode Operation: Place input/output points in test mode to allow testing and developing of control algorithms on line without disrupting field hardware and controlled environment. In test mode:
1. Inhibit scanning and calculation of input points. Issue manual control to input points (set analog or digital input point to operator determined test value) from work station.
 2. Control output points but change only data base state or value; leave external field hardware unchanged.
 3. Enable control actions on output points but change only data base state or value.

- J. Local display and adjustment panel: Portable control unit, containing digital display, and numerical keyboard. Display and adjust:
 - 1. Input/output point information and status.
 - 2. Controller set points.
 - 3. Controller tuning constants.
 - 4. Program execution times.
 - 5. High and low limit values.
 - 6. Limit differential.
 - 7. Set/display date and time.
 - 8. Control outputs connected to the network.
 - 9. Automatic control outputs.
 - 10. Perform control unit diagnostic testing.
 - 11. Points in "Test" mode.

2.06 LOCAL AREA NETWORK (LAN)

- A. Provide communication between control units over local area network (LAN).
- B. LAN Capacity: Not less than 60 stations or nodes.
- C. Break in Communication Path: Alarm and automatically initiate LAN reconfiguration.
- D. LAN Data Speed: Minimum 19.2 Kb.
- E. Communication Techniques: Allow interface into network by multiple operation stations and by auto-answer/auto-dial modems. Support communication over telephone lines utilizing modems.
- F. Transmission Median: Fiber optic or single pair of solid 24 gauge twisted, shielded copper cable.
- G. Network Support: Time for global point to be received by any station, shall be less than 3 seconds. Provide automatic reconfiguration if any station is added or lost. If transmission cable is cut, reconfigure two sections with no disruption to system's operation, without operator intervention.

2.07 SYSTEM SOFTWARE

- A. Operating System:
 - 1. Concurrent, multi-tasking capability.
 - a. Common Software Applications Supported: Microsoft Excel.
 - b. Acceptable Operating Systems: _____.
 - 2. System Graphics:
 - a. Allow up to 10 graphic screens, simultaneously displayed for comparison and monitoring of system status.
 - b. Animation displayed by shifting image files based on object status.
 - c. Provide method for operator with password to perform the following:
 - 1) Move between, change size, and change location of graphic displays.
 - 2) Modify on-line.
 - 3) Add, delete, or change dynamic objects consisting of:
 - (a) Analog and binary values.
 - (b) Dynamic text.
 - (c) Static text.
 - (d) Animation files.
 - 3. Custom Graphics Generation Package:
 - a. Create, modify, and save graphic files and visio format graphics in PCX formats.
 - b. HTML graphics to support web browser compatible formats.
 - c. Capture or convert graphics from AutoCAD.
 - 4. Standard HVAC Graphics Library:

- a. HVAC Equipment:
- b. Ancillary Equipment:
- B. Workstation System Applications:
 - 1. Automatic System Database Save and Restore Functions:
 - a. Current database copy of each Building Controller is automatically stored on hard disk.
 - b. Automatic update occurs upon change in any system panel.
 - c. In the event of database loss in any system panel, the first workstation to detect the loss automatically restores the database for that panel unless disabled by the operator.
 - 2. Manual System Database Save and Restore Functions by Operator with Password Clearance:
 - a. Save database from any system panel.
 - b. Clear a panel database.
 - c. Initiate a download of a specified database to any system panel.
 - 3. Software provided allows system configuration and future changes or additions by operators under proper password protection.
 - 4. On-line Help:
 - a. Context-sensitive system assists operator in operation and editing.
 - b. Available for all applications.
 - c. Relevant screen data provided for particular screen display.
 - d. Additional help available via hypertext.
 - 5. Security:
 - a. Operator log-on requires user name and password to view, edit, add, or delete data.
 - b. System security selectable for each operator.
 - c. System supervisor sets passwords and security levels for all other operators.
 - d. Operator passwords to restrict functions accessible to viewing and/or changing system applications, editor, and object.
 - e. Automatic, operator log-off results from keyboard or mouse inactivity during user-adjustable, time period.
 - f. All system security data stored in encrypted format.
 - 6. System Diagnostics:
 - a. Operations Automatically Monitored:
 - 1) Workstations.
 - 2) Printers.
 - 3) Modems.
 - 4) Network connections.
 - 5) Building management panels.
 - 6) Controllers.
 - b. Device failure is annunciated to the operator.
 - 7. Alarm Processing:
 - a. All system objects are configurable to "alarm in" and "alarm out" of normal state.
 - b. Configurable Objects:
 - 1) Alarm limits.
 - 2) Alarm limit differentials.
 - 3) States.
 - 4) Reactions for each object.
 - 8. Alarm Messages:
 - a. Descriptor: English language.
 - b. Recognizable Features:
 - 1) Source.

- 2) Location.
- 3) Nature.
9. Configurable Alarm Reactions by Workstation and Time of Day:
 - a. Logging.
 - b. Printing.
 - c. Starting programs.
 - d. Displaying messages.
 - e. Dialing out to remote locations.
 - f. Paging.
 - g. Providing audible annunciation.
 - h. Displaying specific system graphics.
10. Custom Trend Logs:
 - a. Definable for any data object in the system including interval, start time, and stop time.
 - b. Trend Data:
 - 1) Sampled and stored on the building controller panel.
 - 2) Archivable on hard disk.
 - 3) Retrievable for use in reports, spreadsheets and standard database programs.
 - 4) Archival on LAN accessible storage media including hard disk, tape, Raid array drive, and virtual cloud environment.
 - 5) Protected and encrypted format to prevent manipulation, or editing of historical data and event logs.
11. Alarm and Event Log:
 - a. View all system alarms and change of states from any system location.
 - b. Events listed chronologically.
 - c. Operator with proper security acknowledges and clears alarms.
 - d. Alarms not cleared by operator are archived to the workstation hard disk.
12. Object, Property Status and Control:
 - a. Provide a method to view, edit if applicable, the status of any object and property in the system.
 - b. Status Available by the Following Methods:
 - 1) Menu.
 - 2) Graphics.
 - 3) Custom Programs.
13. Reports and Logs:
 - a. Reporting Package:
 - 1) Allows operator to select, modify, or create reports.
 - 2) Definable as to data content, format, interval, and date.
 - 3) Archivable to hard disk.
 - b. Real-time logs available by type or status such as alarm, lockout, normal, etc.
 - c. Stored on hard disk and readily accessible by standard software applications, including spreadsheets and word processing.
 - d. Set to be printed on operator command or specific time(s).
14. Reports:
 - a. Standard:
 - 1) Objects with current values.
 - 2) Current alarms not locked out.
 - 3) Disabled and overridden objects, points and SNVTs.
 - 4) Objects in manual or automatic alarm lockout.
 - 5) Objects in alarm lockout currently in alarm.
 - 6) Logs:

- (a) Alarm History.
 - (b) System messages.
 - (c) System events.
 - (d) Trends.
 - b. Custom:
 - 1) Daily.
 - 2) Weekly.
 - 3) Monthly.
 - 4) Annual.
 - 5) Time and date stamped.
 - 6) Title.
 - 7) Facility name.
 - c. Tenant Override:
 - 1) Monthly report showing total, requested, after-hours HVAC and lighting services on a daily basis for each tenant.
 - 2) Annual report showing override usage on a monthly basis.
 - d. Electrical, Fuel, and Weather:
 - 1) Electrical Meter(s):
 - (a) Monthly showing daily electrical consumption and peak electrical demand with time and date stamp for each meter.
 - (b) Annual summary showing monthly electrical consumption and peak demand with time and date stamp for each meter.
 - 2) Fuel Meter(s):
 - (a) Monthly showing daily natural gas consumption for each meter.
 - (b) Annual summary showing monthly consumption for each meter.
 - 3) Weather:
 - (a) Monthly showing minimum, maximum, average outdoor air temperature and heating/cooling degree-days for the month.
- C. Workstation Applications Editors:
 - 1. Provide editing software for all system applications at the PC workstation.
 - 2. Downloaded application is executed at controller panel.
 - 3. Full screen editor for each application allows operator to view and change:
 - a. Configuration.
 - b. Name.
 - c. Control parameters.
 - d. Set-points.
 - 4. Scheduling:
 - a. Monthly calendar indicates schedules, holidays, and exceptions.
 - b. Allows several related objects to be scheduled and copied to other objects or dates.
 - c. Start and stop times adjustable from master schedule.
 - 5. Custom Application Programming:
 - a. Create, modify, debug, edit, compile, and download custom application programming during operation and without disruption of all other system applications.
 - b. Programming Features:
 - 1) English oriented language, based on BASIC, FORTRAN, C, or PASCAL syntax allowing for free form programming.
 - 2) Alternative language graphically based using appropriate function blocks suitable for all required functions and amenable to customizing or compounding.
 - 3) Insert, add, modify, and delete custom programming code that incorporates word processing features such as cut/paste and find/replace.

- 4) Allows the development of independently, executing, program modules designed to enable and disable other modules.
- 5) Debugging/simulation capability that displays intermediate values and/or results including syntax/execution error messages.
- 6) Support for conditional statements (IF/THEN/ELSE/ELSE-F) using compound Boolean (AND, OR, and NOT) and/or relations (EQUAL, LESS THAN, GREATER THAN, NOT EQUAL) comparisons.
- 7) Support for floating-point arithmetic utilizing plus, minus, divide, times, square root operators; including absolute value; minimum/maximum value from a list of values for mathematical functions.
- 8) Language consisting of resettable, predefined, variables representing time of day, day of the week, month of the year, date; and elapsed time in seconds, minutes, hours, and days where the variable values can be used in IF/THEN comparisons, calculations, programming statement logic, etc.
- 9) Language having predefined variables representing status and results of the system software enables, disables, and changes the set points of the controller software.

2.08 CONTROLLER SOFTWARE

- A. All applications reside and operate in the system controllers and editing of all applications occurs at the operator workstation.
- B. System Security:
 1. User access secured via user passwords and user names.
 2. Passwords restrict user to the objects, applications, and system functions as assigned by the system manager.
 3. User Log On/Log Off attempts are recorded.
 4. Automatic Log Off occurs following the last keystroke after a user defined delay time.
- C. Object or Object Group Scheduling:
 1. Weekly Schedules Based on Separate, Daily Schedules:
 - a. Include start, stop, optimal stop, and night economizer.
 - b. 10 events maximum per schedule.
 - c. Start/stop times adjustable for each group object.
- D. Provide standard application for equipment coordination and grouping based on function and location to be used for scheduling and other applications.
- E. Alarms:
 1. Binary object is set to alarm based on the operator specified state.
 2. Analog object to have high/low alarm limits.
 3. All alarming is capable of being automatically and manually disabled.
 4. Alarm Reporting:
 - a. Operator determines action to be taken for alarm event.
 - b. Alarms to be routed to appropriate workstation.
 - c. Reporting Options:
- F. Maintenance Management: System monitors equipment status and generates maintenance messages based upon user-designated run-time limits.
- G. Sequencing: Application software based upon specified sequences of operation in Section 23 09 93.
- H. PID Control Characteristics:
 1. Direct or reverse action.
 2. Anti-windup.
 3. Calculated, time-varying, analog value, positions an output or stages a series of outputs.

4. User selectable controlled variable, set-point, and PED gains.
- I. Staggered Start Application:
 1. Prevents all controlled equipment from simultaneously restarting after power outage.
 2. Order of equipment startup is user selectable.
- J. Energy Calculations:
 1. Accumulated instantaneous power or flow rates are converted to energy use data.
 2. Algorithm calculates a rolling average and allows window of time to be user specified in minute intervals.
 3. Algorithm calculates a fixed window average with a digital input signal from a utility meter defining the start of the window period that in turn synchronizes the fixed-window average with that used by the power company.
- K. Anti-Short Cycling:
 1. All binary output objects protected from short-cycling.
 2. Allows minimum on-time and off-time to be selected.
- L. On-Off Control with Differential:
 1. Algorithm allows binary output to be cycled based on a controlled variable and set-point.
 2. Algorithm to be direct-acting or reverse-acting incorporating an adjustable differential.
- M. Run-Time Totalization:
 1. Totalize run-times for all binary input objects.
 2. Provides operator with capability to assign high run-time alarm.

2.09 OPERATING SYSTEM SOFTWARE

- A. Input/Output Capability From Operator Station:
 1. Request display of current values or status in tabular or graphic format.
 2. Command selected equipment to specified state.
 3. Initiate logs and reports.
 4. Change analog limits.
 5. Add, delete, or change points within each control unit or application routine.
 6. Change point input/output descriptors, status, alarm descriptors, and engineering unit descriptors.
 7. Add new control units to system.
 8. Modify and set up maintenance scheduling parameters.
 9. Develop, modify, delete or display full range of color graphic displays.
 10. Automatically archive select data even when running third party software.
 11. Provide capability to sort and extract data from archived files and to generate custom reports.
 12. Support two printer operations.
 - a. Alarm printer: Print alarms, operator acknowledgements, action messages, system alarms, operator sign-on and sign-off.
 - b. Data printer: Print reports, page prints, and data base prints.
 13. Select daily, weekly or monthly as scheduled frequency to synchronize time and date in digital control units. Accommodate daylight savings time adjustments.
 14. Print selected control unit data base.
- B. Operator System Access: Via software password with minimum 30 access levels at work station and minimum 3 access levels at each control unit.
- C. Data Base Creation and Support: Changes shall utilize standard procedures. Control unit shall automatically check work station data base files upon connection and verify data base match. Minimum capability shall include:
 1. Add and delete points.
 2. Modify any point parameter.

3. Change, add, or delete English language descriptors.
 4. Add, modify, or delete alarm limits.
 5. Add, modify, or delete points in start/stop programs, trend logs, etc.
 6. Create custom relationship between points.
 7. Create or modify DDC loops and parameters.
 8. Create or modify override parameters.
 9. Add, modify, and delete any applications program.
 10. Add, delete, develop, or modify dynamic color graphic displays.
- D. Dynamic Color Graphic Displays:
1. Utilizes custom symbols or system supported library of symbols.
 2. Sixteen (16) colors.
 3. Sixty (60) outputs of real time, live dynamic data per graphic.
 4. Dynamic graphic data.
 5. 1,000 separate graphic pages.
 6. Modify graphic screen refresh rate between 1 and 60 seconds.
- E. Operator Station:
1. Accept data from LAN as needed without scanning entire network for updated point data.
 2. Interrogate LAN for updated point data when requested.
 3. Allow operator command of devices.
 4. Allow operator to place specific control units in or out of service.
 5. Allow parameter editing of control units.
 6. Store duplicate data base for every control unit and allow down loading while system is on line.
 7. Control or modify specific programs.
 8. Develop, store and modify dynamic color graphics.
 9. Provide data archiving of assigned points and support overlay graphing of this data utilizing up to four (4) variables.
- F. Alarm Processing:
1. Off normal condition: Cause alarm and appropriate message, including time, system, point descriptor, and alarm condition. Select alarm state/value and which alarms shall cause automatic dial-out.
 2. Critical alarm or change-of-state: Display message, stored on disk for review and sort, or print.
 3. Print on line changeable message, up to 100 characters in length, for each alarm point specified.
 4. Display alarm reports on video. Display multiple alarms in order of occurrence.
 5. Define time delay for equipment start-up or shutdown.
 6. Allow unique routing of specific alarms.
 7. Operator specifies if alarm requires acknowledgement.
 8. Continue to indicate unacknowledged alarms after return to normal.
 9. Alarm notification:
 - a. Automatic print.
 - b. Display indicating alarm condition.
 - c. Selectable audible alarm indication.
- G. Event Processing: Automatically initiate commands, user defined messages, take specific control actions or change control strategy and application programs resulting from event condition. Event condition may be value crossing operator defined limit, change-of-state, specified state, or alarm occurrence or return to normal.
- H. Automatic Restart: Automatically restart field equipment on restoration of power. Provide time delay between individual equipment restart and time of day start/stop.

- I. Messages:
 - 1. Automatically display or print user-defined message subsequent to occurrence of selected events.
 - 2. Compose, change, or delete any message.
 - 3. Display or log any message at any time.
 - 4. Assign any message to any event.
- J. Reports:
 - 1. Manually requested with time and date.
 - 2. Long term data archiving to hard disk.
 - 3. Automatic directives to download to transportable media such as floppy diskettes for storage.
 - 4. Data selection methods to include data base search and manipulation.
 - 5. Data extraction with mathematical manipulation.
 - 6. Data reports shall allow development of XY curve plotting, tabular reports (both statistical and summary), and multi-point timed based plots with not less than four (4) variables displayed.
 - 7. Generating reports either normally at operator direction, or automatically under work station direction.
 - 8. Reports may either manually displayed or printed, or may be printed automatically on daily, weekly, monthly, yearly or scheduled basis.
 - 9. Include capability for statistical data manipulation and extraction.
 - 10. Provide capability to generate four types of reports: Statistical detail reports, summary reports, trend graphic plots, x-y graphic plots.
- K. Parameter Save/Restore: Store most current operating system, parameter changes, and modifications on disk or diskette.
- L. Data Collection:
 - 1. Automatically collect and store in disk files.
 - 2. Daily electrical energy consumption, peak demand, and time of peak demand for up to electrical meters over 2 year period.
 - 3. Daily consumption for up to 30 meters over a 2 year period.
 - 4. Daily billable electrical energy consumption and time for up to 1024 zones over a 10 year period.
 - 5. Provide archiving of stored data for use with system supplied custom reports.
- M. Graphic Display: Support graphic development on work station with software features:
 - 1. Page linking.
 - 2. Generate, store, and retrieve library symbols.
 - 3. Single or double height characters.
 - 4. Sixty (60) dynamic points of data per graphic page.
 - 5. Pixel level resolution.
 - 6. Animated graphics for discrete points.
 - 7. Analog bar graphs.
 - 8. Display real time value of each input or output line diagram fashion.
- N. Maintenance Management:
 - 1. Run time monitoring, per point.
 - 2. Maintenance scheduling targets with automatic annunciation, scheduling and shutdown.
 - 3. Equipment safety targets.
 - 4. Display of maintenance material and estimated labor.
 - 5. Target point reset, per point.
- O. Advisories:

1. Summary which contains status of points in locked out condition.
2. Continuous operational or not operational report of interrogation of system hardware and programmable control units for failure.
3. Report of power failure detection, time and date.
4. Report of communication failure with operator device, field interface unit, point, programmable control unit.

2.10 LOAD CONTROL PROGRAMS

- A. General: Support inch-pounds and SI (metric) units of measurement.
- B. Demand Limiting:
 1. Monitor total power consumption per power meter and shed associated loads automatically to reduce power consumption to an operator set maximum demand level.
 2. Input: Pulse count from incoming power meter connected to pulse accumulator in control unit.
 3. Forecast demand (kW): Predicted by sliding window method.
 4. Automatically shed loads throughout the demand interval selecting loads with independently adjustable on and off time of between one and 255 minutes.
 5. Demand Target: Minimum of 3 per demand meter; change targets based upon (1) time, (2) status of pre-selected points, or (3) temperature.
 6. Load: Assign load shed priority, minimum "ON" time and maximum "OFF" time.
 7. Limits: Include control band (upper and lower limits).
 8. Output advisory if loads are not available to satisfy required shed amount, advise shed requirements and requiring operator acknowledgement.
- C. Duty Cycling:
 1. Periodically stop and start loads, based on space temperature, and according to various On/Off patterns.
 2. Modify off portion of cycle based on operator specified comfort parameters. Maintain total cycle time by increasing on portion of cycle by same amount that off portion is reduced.
 3. Set and modify following parameters for each individual load.
 - a. Minimum and maximum Off time.
 - b. On/Off time in one minute increments.
 - c. Time period from beginning of interval until load can be cycled.
 - d. Manually override the DCC program and place a load in an On or Off state.
 - e. Cooling Target Temperature and Differential.
 - f. Heating Target Temperature and Differential.
 - g. Cycle off adjustment.
- D. Automatic Time Scheduling:
 1. Self-contained programs for automatic start/stop/scheduling of building loads.
 2. Support up to seven (7) normal day schedules, seven (7) "special day" schedules and two (2) temporary day schedules.
 3. Special days schedule shall support up to 30 unique date/duration combinations.
 4. Any number of loads assigned to any time program; each load can have individual time program.
 5. Each load assigned at least 16 control actions per day with 1 minute resolution.
 6. Time schedule operations may be:
 - a. Start.
 - b. Optimized Start.
 - c. Stop.
 - d. Optimized Stop.
 - e. Cycle.
 - f. Optimized Cycle.

7. Minimum of 30 holiday periods up to 100 days in length may be specified for the year.
 8. Create temporary schedules.
 9. Broadcast temporary "special day" date and duration.
- E. Start/Stop Time Optimization:
1. Perform optimized start/stop as function of outside conditions, inside conditions, or both.
 2. Adaptive and self-tuning, adjusting to changing conditions unattended.
 3. For each point under control, establish and modify:
 - a. Occupancy period.
 - b. Desired temperature at beginning of occupancy period.
 - c. Desired temperature at end of occupancy period.
- F. Night Setback/Setup Program: Reduce heating space temperature setpoint or raise cooling space temperature setpoint during unoccupied hours; in conjunction with scheduled start/stop and optimum start/stop programs.
- G. Calculated Points: Define calculations and totalization computed from monitored points (analog/digital points), constants, or other calculated points.
1. Employ arithmetic, algebraic, Boolean, and special function operations.
 2. Treat calculated values like any other analog value, use for any function that a "hard wired point" might be used.
- H. Event Initiated Programming: Event may be initiated by any data point, causing series of controls in a sequence.
1. Define time interval between each control action between 0 to 3600 seconds.
 2. Output may be analog value.
 3. Provide for "skip" logic.
 4. Verify completion of one action before proceeding to next. If not verified, program shall be able to skip to next action.
- I. Direct Digital Control: Each control unit shall provide Direct Digital Control software so that the operator may customize control strategies and sequences of operation by defining the appropriate control loop algorithms and choosing the optimum loop parameters.
1. Control loops: Defined using "modules" that are analogous to standard control devices.
 2. Output: Paired or individual digital outputs for pulse-width modulation, and analog outputs, as required.
 3. Firmware:
 - a. PID with analog or pulse-width modulation output.
 - b. Floating control with pulse-width modulated outputs.
 - c. Two-position control.
 - d. Primary and secondary reset schedule selector.
 - e. Hi/Lo signal selector.
 - f. Single pole double throw relay.
 - g. Single pole double throw time delay relay with delay before break, delay before make and interval time capabilities.
 4. Direct Digital Control loops: Downloaded upon creation or on operator request. On sensor failure, program shall execute user defined failsafe output.
 5. Display: Value or state of each of the lines which interconnect DDC modules.
- J. Fine Tuning Direct Digital Control PID or floating loops:
1. Display information:
 - a. Control loop being tuned
 - b. Input (process) variable
 - c. Output (control) variable
 - d. Setpoint of loop
 - e. Proportional band

- f. Integral (reset) Interval
- g. Derivative (rate) Interval
- 2. Display format: Graphic, with automatic scaling; with input and output variable superimposed on graph of "time" vs "variable".
- K. Trend logging:
 - 1. Each control unit will store samples of control unit's data points.
 - 2. Update file continuously at discretely assignable intervals.
 - 3. Automatically initiate upload request and then store data on hard disk.
 - 4. Time synchronize sampling at operator specified times and intervals with sample resolution of one minute.
 - 5. Co-ordinate sampling with on/off state of specified point.
 - 6. Display trend samples on work station in graphic format. Automatically scale trend graph with minimum 60 samples of data in plot of time vs data.

2.11 HVAC CONTROL PROGRAMS

- A. General:
 - 1. Support Inch-pounds and SI (metric) units of measurement.
 - 2. Identify each HVAC Control system.
- B. Optimal Run Time:
 - 1. Control start-up and shutdown times of HVAC equipment for both heating and cooling.
 - 2. Base on occupancy schedules, outside air temperature, seasonal requirements, and interior room mass temperature.
 - 3. Start-up systems by using outside air temperature, room mass temperatures, and adaptive model prediction for how long building takes to warm up or cool down under different conditions.
 - 4. Use outside air temperature to determine early shut down with ventilation override.
 - 5. Analyze multiple building mass sensors to determine seasonal mode and worse case condition for each day.
 - 6. Operator commands:
 - a. Define term schedule
 - b. Add/delete fan status point.
 - c. Add/delete outside air temperature point.
 - d. Add/delete mass temperature point.
 - e. Define heating/cooling parameters.
 - f. Define mass sensor heating/cooling parameters.
 - g. Lock/unlock program.
 - h. Request optimal run time control summary.
 - i. Request optimal run time mass temperature summary.
 - j. Request HVAC point summary.
 - k. Request HVAC saving profile summary.
 - 7. Control Summary:
 - a. HVAC Control system begin/end status.
 - b. Optimal run time lock/unlock control status.
 - c. Heating/cooling mode status.
 - d. Optimal run time schedule.
 - e. Start/Stop times.
 - f. Selected mass temperature point ID.
 - g. Optimal run time system normal start times.
 - h. Occupancy and vacancy times.
 - i. Optimal run time system heating/cooling mode parameters.
 - 8. Mass temperature summary:

- a. Mass temperature point type and ID.
- b. Desired and current mass temperature values.
- c. Calculated warm-up/cool-down time for each mass temperature.
- d. Heating/cooling season limits.
- e. Break point temperature for cooling mode analysis.
9. HVAC point summary:
 - a. Control system identifier and status.
 - b. Point ID and status.
 - c. Outside air temperature point ID and status.
 - d. Mass temperature point ID and point.
 - e. Calculated optimal start and stop times.
 - f. Period start.
- C. Supply Air Reset:
 1. Monitor heating and cooling loads in building spaces, terminal reheat systems, both hot deck and cold deck temperatures on dual duct and multizone systems, single zone unit discharge temperatures.
 2. Adjust discharge temperatures to most energy efficient levels satisfying measured load by:
 - a. Raising cooling temperatures to highest possible value.
 - b. Reducing heating temperatures to lowest possible level.
 3. Operator commands:
 - a. Add/delete fan status point.
 - b. Lock/unlock program.
 - c. Request HVAC point summary.
 - d. Add/Delete discharge controller point.
 - e. Define discharge controller parameters.
 - f. Add/delete air flow rate.
 - g. Define space load and load parameters.
 - h. Request space load summary.
 4. Control summary:
 - a. HVAC control system status (begin/end).
 - b. Supply air reset system status.
 - c. Optimal run time system status.
 - d. Heating and cooling loop.
 - e. High/low limits.
 - f. Deadband.
 - g. Response timer.
 - h. Reset times.
 5. Space load summary:
 - a. HVAC system status.
 - b. Optimal run time status.
 - c. Heating/cooling loop status.
 - d. Space load point ID.
 - e. Current space load point value.
 - f. Control heat/cool limited.
 - g. Gain factor.
 - h. Calculated reset values.
 - i. Fan status point ID and status.
 - j. Control discharge temperature point ID and status.
 - k. Space load point ID and status.
 - l. Air flow rate point ID and status.

- D. Enthalpy Switchover:
1. Calculate outside and return air enthalpy using measured temperature and relative humidity; determine energy expended and control outside and return air dampers.
 2. Operator commands:
 - a. Add/delete fan status point.
 - b. Add/delete outside air temperature point.
 - c. Add/delete discharge controller point.
 - d. Define discharge controller parameters.
 - e. Add/delete return air temperature point.
 - f. Add/delete outside air dew point/humidity point.
 - g. Add/delete return air dew point/humidity point.
 - h. Add/delete damper switch.
 - i. Add/delete minimum outside air.
 - j. Add/delete atmospheric pressure.
 - k. Add/delete heating override switch.
 - l. Add/delete evaporative cooling switch.
 - m. Add/delete air flow rate.
 - n. Define enthalpy deadband.
 - o. Lock/unlock program.
 - p. Request control summary.
 - q. Request HVAC point summary.
 3. Control summary:
 - a. HVAC control system begin/end status.
 - b. Enthalpy switchover optimal system status.
 - c. Optimal return time system status.
 - d. Current outside air enthalpy.
 - e. Calculated mixed air enthalpy.
 - f. Calculated cooling coil enthalpy using outside air.
 - g. Calculated cooling coil enthalpy using mixed air.
 - h. Calculated enthalpy difference.
 - i. Enthalpy switchover deadband.
 - j. Status of damper mode switch.

2.12 PROGRAMMING APPLICATION FEATURES

- A. Trend Point:
1. Sample up to 150 points, real or computed, with each point capable of collecting 100 samples at intervals specified in minutes, hours, days, or month.
 2. Output trend logs as line graphs or bar graphs. Output graphic on terminal, with each point for line and bar graphs designated with a unique pattern or color, vertical scale either actual values or percent of range, and horizontal scale time base. Print trend logs up to 12 columns of one point/column.
- B. Alarm Messages:
1. Allow definition of minimum of 100 messages, each having minimum length of 100 characters for each individual message.
 2. Assign alarm messages to system messages including point's alarm condition, point's off-normal condition, totalized point's warning limit, hardware elements advisories.
 3. Output assigned alarm with "message requiring acknowledgement".
 4. Operator commands include define, modify, or delete; output summary listing current alarms and assignments; output summary defining assigned points.
- C. Weekly Scheduling:

1. Automatically initiate equipment or system commands, based on preselected time schedule for points specified.
 2. Provide program times for each day of week, per point, with one minute resolution.
 3. Automatically generate alarm output for points not responding to command.
 4. Provide for holidays, minimum of 366 consecutive holidays.
 5. Operator commands:
 - a. System logs and summaries.
 - b. Start of stop point.
 - c. Lock or unlock control or alarm input.
 - d. Add, delete, or modify analog limits and differentials.
 - e. Adjust point operation position.
 - f. Change point operational mode.
 - g. Open or close point.
 - h. Enable/disable, lock/unlock, or execute interlock sequence or computation profile.
 - i. Begin or end point totalization.
 - j. Modify totalization values and limits.
 - k. Access or secure point.
 - l. Begin or end HVAC or load control system.
 - m. Modify load parameter.
 - n. Modify demand limiting and duty cycle targets.
 6. Output summary: Listing of programmed function points, associated program times, and respective day of week programmed points by software groups or time of day.
- D. Interlocking:
1. Permit events to occur, based on changing condition of one or more associated master points.
 2. Binary contact, high/low limit of analog point or computed point shall be capable of being utilized as master. Same master may monitor or command multiple slaves.
 3. Operator commands:
 - a. Define single master/multiple master interlock process.
 - b. Define logic interlock process.
 - c. Lock/unlock program.
 - d. Enable/disable interlock process.
 - e. Execute terminate interlock process.
 - f. Request interlock type summary.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify existing conditions before starting work.
- B. Verify that conditioned power supply is available to the control units and to the operator work station. Verify that field end devices, wiring, and pneumatic tubing is installed prior to installation proceeding.

3.02 INSTALLATION

- A. Install control units and other hardware in position on permanent walls where not subject to excessive vibration.
- B. Install software in control units and in operator work station. Implement all features of programs to specified requirements and appropriate to sequence of operation. Refer to Section 23 09 93.
- C. Provide with 120v AC, 15 amp dedicated emergency power circuit to each programmable control unit.

- D. Provide conduit and electrical wiring in accordance with Section 26 27 17. Electrical material and installation shall be in accordance with appropriate requirements of Division 26.

3.03 MANUFACTURER'S FIELD SERVICES

- A. Start and commission systems. Allow sufficient time for start-up and commissioning prior to placing control systems in permanent operation.
- B. Provide service engineer to instruct Owner's representative in operation of systems plant and equipment for 3 day period.
- C. Provide basic operator training for 10 persons on data display, alarm and status descriptors, requesting data, execution of commands and request of logs. Include a minimum of 40 hours dedicated instructor time. Provide training on site.

3.04 DEMONSTRATION AND INSTRUCTIONS

- A. Demonstrate complete and operating system to owner.
- B. Provide 4-hour training session at project site.

END OF SECTION

SECTION 23 09 93
SEQUENCE OF OPERATIONS FOR HVAC CONTROLS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. This section defines the manner and method by which controls function. Requirements for each type of control system operation are specified. Equipment, devices, and system components required for control systems are specified in other sections.
- B. Sequence of operation for:
 - 1. Packaged Air Handling Units.

1.02 RELATED SECTIONS

- A. Section 23 09 23 - Direct-Digital Control System for HVAC.
- B. Section 23 09 13 - Instrumentation and Control Devices for HVAC.
- C. Section 26 27 17 - Equipment Wiring: Electrical characteristics and wiring connections.

1.03 SYSTEM DESCRIPTION

- A. This Section defines the manner and method by which controls function. Requirements for each type of control system operation are specified. Equipment, devices, and system components required for control systems are specified in other Sections.

1.04 SUBMITTALS

- A. See Section 01 33 00 - Administrative Requirements, for submittal procedures.
- B. Sequence of Operation Documentation: Submit written sequence of operation for entire HVAC system and each piece of equipment.
 - 1. Preface: 1 or 2 paragraph overview narrative of the system describing its purpose, components and function.
 - 2. State each sequence in small segments and give each segment a unique number for referencing in Functional Test procedures; provide a complete description regardless of the completeness and clarity of the sequences specified in the contract documents.
 - 3. Include at least the following sequences:
 - a. Start-up.
 - b. Warm-up mode.
 - c. Normal operating mode.
 - d. Unoccupied mode.
 - e. Shutdown.
 - f. Capacity control sequences and equipment staging.
 - g. Temperature and pressure control, such as setbacks, setups, resets, etc.
 - h. Detailed sequences for all control strategies, such as economizer control, optimum start/stop, staging, optimization, demand limiting, etc.
 - i. Effects of power or equipment failure with all standby component functions.
 - j. Sequences for all alarms and emergency shut downs.
 - k. Seasonal operational differences and recommendations.
 - l. Interactions and interlocks with other systems.
 - 4. Include initial and recommended values for all adjustable settings, setpoints and parameters that are typically set or adjusted by operating staff; and any other control settings or fixed values, delays, etc. that will be useful during testing and operating the equipment.
 - 5. For packaged controlled equipment, include manufacturer's furnished sequence of operation amplified as required to describe the relationship between the packaged controls

- and the control system, indicating which points are adjustable control points and which points are only monitored.
6. Include schedules, if known.
- C. Control System Diagrams: Submit graphic schematic of the control system showing each control component and each component controlled, monitored, or enabled.
1. Label with settings, adjustable range of control and limits.
 2. Include flow diagrams for each control system, graphically depicting control logic.
 3. Include the system and component layout of all equipment that the control system monitors, enables or controls, even if the equipment is primarily controlled by packaged or integral controls.
 4. Include draft copies of graphic displays indicating mechanical system components, control system components, and controlled function status and value.
 5. Include all monitoring, control and virtual points specified in elsewhere.
 6. Include a key to all abbreviations.
- D. Points List: Submit list of all control points indicating at least the following for each point.
1. Name of controlled system.
 2. Point abbreviation.
 3. Point description; such as dry bulb temperature, airflow, etc.
 4. Display unit.
 5. Control point or setpoint (Yes / No); i.e. a point that controls equipment and can have its setpoint changed.
 6. Monitoring point (Yes / No); i.e. a point that does not control or contribute to the control of equipment but is used for operation, maintenance, or performance verification.
 7. Intermediate point (Yes / No); i.e. a point whose value is used to make a calculation which then controls equipment, such as space temperatures that are averaged to a virtual point to control reset.
 8. Calculated point (Yes / No); i.e. a "virtual" point generated from calculations of other point values.
- E. Project Record Documents: Record actual locations of components and setpoints of controls, including changes to sequences made after submission of shop drawings.

1.05 QUALITY ASSURANCE

- A. Design system under direct supervision of a Professional Engineer experienced in design of this Work and licensed in the State in which the Project is located.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION

3.01 GENERAL SYSTEM DESIGN AND OPERATION STANDARDS

- A. The BAS shall control the mechanical systems within the the facility based upon a packaged, single-zone VAV system with natural gas heating and packaged DX cooling.
- B. Each air handling unit shall be controlled by an individual DDC Controller. The DDC Controller shall be wired to a space temperature sensor, discharge air temperature sensor, return air temperature sensor, damper motors. Units shall include occupied/unoccupied control, night-setback, morning warm-up/cool-down, and enthalpy-based economizer functions. See equipment-specific sequences and drawings for additional requirements and monitoring points.

3.02 SINGLE-ZONE VARIABLE AIR VOLUME AIR HANDLING UNIT WITH DX COOLING, HOT GAS REHEAT, AND GAS HEAT

- A. Sequence of Operation:
 1. Supply Fan: The BAS shall control the starting and stopping of the supply fan as follows:

- a. Start / Stop: The BAS shall command the operation of the supply fan and it shall run continuously whenever the AHU is "energized" as specified for the applicable logic strategies specified.
- b. Modulation: The supply fan shall modulate airflow to maintain space temperature. The supply fan shall not modulate below the speed to maintain OA ventilation required in the space during programmed occupied hours. If cooling or heating is required and the fan is at maximum airflow then the DAT setpoint shall be reset up or down to accommodate space requirements.
2. Return / Relief / OA Dampers: The BAS shall control as follows:
 - a. Closed: When AHU is de-energized, dampers shall remain in their closed position. When AHU is energized during unoccupied periods the OA damper will remain closed.
 - b. Balanced Minimum OA Control: When in occupied mode, the outdoor air damper shall open to its balanced, minimum position. An airflow monitoring station shall provide feedback to ensure the minimum required ventilation is maintained. The barometric relief damper shall maintain neutral pressurization.
3. Unoccupied Mode: During the programmed unoccupied mode, the fan, gas heat, DX compressors, and mixing box dampers shall be cycled / modulated to maintain the unoccupied setpoints (adj.). The outside air damper shall remain closed unless required by economizer cycle.
4. Space Temperature Control: The DX cooling shall stage and modulate to maintain the discharge air setpoint in cooling mode and shall modulate the gas heating valve in heating mode. If economizing is enabled, the outside air damper shall also modulate to maintain the discharge air setpoint. If the discharge air temperature sensor fails, the cooling circuit shall remain disengaged and an alarm shall be annunciated at the unit controller display. The discharge temperature setpoint shall be reset by dynamic proportional logic in response to space temperature.
5. Discharge Temperature Control: The discharge temperature setpoint shall be controlled as follows:
 - a. Cooling setpoint shall be reset from 55 deg. F to 65 deg. F; both adjustable to maintain the cooling requests. Heating setpoint shall be reset from 90 deg. F to 110 deg. F; both adjustable to maintain heating requests.
 - b. When the unit is energized for setback heating during the occupied period, the discharge temperature setpoint shall be 75 deg. F (adj.).
6. Cooling Section: Upon a rise in space temperature above the programmed setpoint, the unit shall energize the first compressor in the associated condensing unit. The hot gas bypass valve or variable capacity compressor shall be modulated by the factory provided capacity controls to provide part-load capacity. On a continued rise in space temperature (and where equipped), subsequent compressors shall be energized. Upon a fall in space temperature the compressor(s) shall de-energize in stages as they were energized.
7. Reheating Section: The gas heating valve shall modulate to maintain the discharge air temperature at setpoint. Temperatures shall be user adjustable. If heating is required and the fan is at maximum airflow, then the DAT setpoint shall be reset up to accommodate space requirements.
8. Dehumidification: The hot gas reheat valve shall modulate to maintain the defined relative humidity (55%, adj.) as read by the space-mounted relative humidity sensor. Cooling sequence is to take precedence, and subsequently dehumidification sequence is to engage once cooling sequence is satisfied. Additional cooling with subsequent reheat is to engage as required to satisfy humidity setpoint.
9. Economizer: The controller shall receive input from the global enthalpy sensor. If the enthalpy of the outdoor air is lower than the defined minimum level (28 BTU/LB, user adj.), the mixing box economizer sequence shall be activated upon a call for cooling. The

outside air damper shall never be closed past the minimum position during the occupied mode.

10. High / Low Temperature Alarms: If the discharge temperature fails to rise to a programmed minimum temperature during a call for heating; a low temperature alarm shall be activated at the operator's terminal. If the discharge temperature fails to fall to a programmed maximum temperature on a call for cooling, a high temperature alarm shall be activated at the operator's terminal.
- B. A duct smoke detector shall be furnished, installed and wired to the fire alarm system as required by the electrical contractor. The duct smoke detector shall be provided with an auxiliary alarm contact which is to be wired to the unit to de-energize the supply fan, and mixing box damper actuators. When de-energized, the mixing box damper actuators shall spring return the outside and relief air dampers closed.
- C. The following items shall be displayed at the Operator's Terminal:
 1. Space temperature.
 2. Space temperature setpoint.
 3. Outdoor Airflow Monitoring station flowrate reading
 4. Low Space temperature alarm
 5. High Space temperature alarm
 6. AHU Discharge temperature.
 7. AHU Return air temperature.
 8. AHU Mixed Air Temperature
 9. Outside air temperature, humidity and enthalpy.
 10. Fan operational status via current sensor.
 11. Commanded status of fan.
 12. Commanded status of compressor(s).
 13. Commanded status of hot-water valve(s).
 14. Commanded position of dampers.
 15. Diagram showing the layout of the unit with major components and dynamic temperatures shown where temperature sensors exist in the system.

END OF SECTION

SECTION 23 31 00
HVAC DUCTS AND CASINGS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Metal ductwork.
- B. Casing and plenums.

1.02 RELATED REQUIREMENTS

- A. Section 03 30 00 - Cast-in-Place Concrete.
- B. Section 09 90 00 - Painting and Coating: Weld priming, weather resistant, paint or coating.
- C. Section 11 40 00 - Foodservice Equipment: Supply of kitchen range hoods for placement by this Section.
- D. Section 23 07 13 - Duct Insulation: External insulation and duct liner.
- E. Section 23 33 00 - Air Duct Accessories.
- F. Section 23 36 00 - Air Terminal Units.
- G. Section 23 37 00 - Air Outlets and Inlets.
- H. Section 23 05 93 - Testing, Adjusting, and Balancing for HVAC.

1.03 REFERENCE STANDARDS

- A. ASTM A36/A36M - Standard Specification for Carbon Structural Steel.
- B. ASTM A653/A653M - Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process.
- C. ASTM A666 - Standard Specification for Annealed or Cold-Worked Austenitic Stainless Steel Sheet, Strip, Plate, and Flat Bar.
- D. ASTM A1008/A1008M - Standard Specification for Steel, Sheet, Cold-Rolled, Carbon, Structural, High-Strength Low-Alloy, High-Strength Low-Alloy with Improved Formability, Solution Hardened, and Bake Hardenable.
- E. ASTM A1011/A1011M - Standard Specification for Steel, Sheet and Strip, Hot-Rolled, Carbon, Structural, High-Strength Low-Alloy, High-Strength Low-Alloy with Improved Formability, and Ultra-High Strength.
- F. ASTM B209 - Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate.
- G. ASTM B209M - Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate [Metric].
- H. ASTM C14 - Standard Specification for Nonreinforced Concrete Sewer, Storm Drain, and Culvert Pipe.
- I. ASTM C14M - Standard Specification for Nonreinforced Concrete Sewer, Storm Drain, and Culvert Pipe (Metric).
- J. ASTM C443 - Standard Specification for Joints for Concrete Pipe and Manholes, Using Rubber Gaskets.
- K. ASTM C443M - Standard Specification for Joints for Concrete Pipe and Manholes, Using Rubber Gaskets (Metric).
- L. NFPA 90A - Standard for the Installation of Air-Conditioning and Ventilating Systems.
- M. NFPA 90B - Standard for the Installation of Warm Air Heating and Air-Conditioning Systems.
- N. NFPA 96 - Standard for Ventilation Control and Fire Protection of Commercial Cooking Operations.

- O. SMACNA (LEAK) - HVAC Air Duct Leakage Test Manual; Sheet Metal and Air Conditioning Contractors' National Association.
- P. SMACNA (DCS) - HVAC Duct Construction Standards Metal and Flexible.
- Q. SMACNA (FGD) - Fibrous Glass Duct Construction Standards.
- R. UL 181 - Standard for Factory-Made Air Ducts and Air Connectors.

1.04 PERFORMANCE REQUIREMENTS

- A. No variation of duct configuration or sizes permitted except by written permission. Size round ducts installed in place of rectangular ducts in accordance with ASHRAE table of equivalent rectangular and round ducts.

1.05 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide data for duct materials and duct connections.
- C. Shop Drawings: Indicate duct fittings, particulars such as gages, sizes, welds, and configuration prior to start of work for all systems.
- D. Test Reports: Indicate pressure tests performed. Include date, section tested, test pressure, and leakage rate, following SMACNA (LEAK) - HVAC Air Duct Leakage Test Manual.
- E. Manufacturer's Certificate: Certify that installation of glass fiber ductwork meet or exceed recommended fabrication and installation requirements.
- F. Project Record Documents: Record actual locations of ducts and duct fittings. Record changes in fitting location and type. Show additional fittings used.

1.06 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing the type of products specified in this section, with minimum three years of documented experience.
- B. Installer Qualifications: Company specializing in performing the type of work specified in this section, with minimum five years of documented experience.

1.07 REGULATORY REQUIREMENTS

- A. Construct ductwork to NFPA 90A, NFPA 90B, and NFPA 96 standards.

1.08 FIELD CONDITIONS

- A. Do not install duct sealants when temperatures are less than those recommended by sealant manufacturers.
- B. Maintain temperatures within acceptable range during and after installation of duct sealants.

PART 2 PRODUCTS

2.01 DUCT ASSEMBLIES

2.02 MATERIALS

- A. Galvanized Steel for Ducts: Hot-dipped galvanized steel sheet, ASTM A653/A653M FS Type B, with G90/Z275 coating.
- B. Aluminum for Ducts: ASTM B209 (ASTM B209M); aluminum sheet, alloy 3003-H14. Aluminum Connectors and Bar Stock: Alloy 6061-T651 or of equivalent strength.
- C. Stainless Steel for Ducts: ASTM A666, Type 304.
- D. Flexible Ducts:
 - 1. Two UL 181, Class 1, aluminum laminate and polyester film with latex adhesive supported by helically wound spring steel wire.
 - a. Pressure Rating: 10 inches WG positive and 1.0 inches WG negative.

- b. Maximum Velocity: 4000 fpm.
- c. Temperature range: -20 F to 160 F
- E. Insulated Flexible Ducts:
 - 1. Two ply vinyl film supported by helically wound spring steel wire; fiberglass insulation; polyethylene vapor barrier film.
 - a. Pressure Rating: 10 inches WG positive and 1.0 inches WG negative.
 - b. Maximum Velocity: 4000 fpm.
 - c. Temperature Range: -10 degrees F to 160 degrees F.
 - d. Thermal resistance 4.2 square feet-hour-degree F per BTU
- F. All Ducts: Galvanized steel, unless otherwise indicated.
- G. Low Pressure Supply (Heating Systems): 1/2 inch w.g. pressure class, galvanized steel.
- H. Low Pressure Supply (System with Cooling Coils): 1/2 inch w.g. pressure class, galvanized steel.
- I. Return and Relief: 1/2 inch w.g. pressure class, galvanized steel.
- J. General Exhaust: 1/2 inch w.g. pressure class, galvanized steel.
- K. Joint Sealers and Sealants: Non-hardening, water resistant, mildew and mold resistant.
 - 1. Type: Heavy mastic or liquid used alone or with tape, suitable for joint configuration and compatible with substrates, and recommended by manufacturer for pressure class of ducts.
 - 2. VOC Content: Not more than 250 g/L, excluding water.
- L. Hanger Rod: ASTM A 36/A 36M; steel; threaded both ends, threaded one end, or continuously threaded.

2.03 DUCTWORK FABRICATION

- A. Fabricate and support in accordance with SMACNA HVAC Duct Construction Standards and as indicated.
- B. Provide duct material, gages, reinforcing, and sealing for operating pressures indicated.
- C. Construct T's, bends, and elbows with radius of not less than 1-1/2 times width of duct on centerline. Where not possible and where rectangular elbows must be used, provide turning vanes. .
- D. Increase duct sizes gradually, not exceeding 15 degrees divergence wherever possible; maximum 30 degrees divergence upstream of equipment and 45 degrees convergence downstream.
- E. Fabricate continuously welded round and oval duct fittings in accordance with SMACNA HVAC Duct Construction Standards.
- F. Fabricate continuously welded round and oval duct fittings two gages heavier than duct gages indicated in SMACNA Standard. Joints shall be minimum 4 inch cemented slip joint, brazed or electric welded. Prime coat welded joints.
- G. Provide standard 45 degree lateral wye takeoffs unless otherwise indicated where 90 degree conical tee connections may be used.
- H. Where ducts are connected to exterior wall louvers and duct outlet is smaller than louver frame, provide blank-out panels sealing louver area around duct. Use same material as duct, painted black on exterior side; seal to louver frame and duct.

2.04 MANUFACTURED DUCTWORK AND FITTINGS

- A. Manufacture in accordance with SMACNA HVAC Duct Construction Standards - Metal and Flexible, and as indicated. Provide duct material, gages, reinforcing, and sealing for operating pressures indicated.

- B. Transverse Duct Connection System: SMACNA "J" rated rigidly class connection, interlocking angle and duct edge connection system with sealant, gasket, cleats, and corner clips.

2.05 CASINGS

- A. Fabricate casings in accordance with SMACNA HVAC Duct Construction Standards and construct for operating pressures indicated.
- B. Mount floor mounted casings on 4 inch high concrete curbs. At floor, rivet panels on 8 inch centers to angles. Where floors are acoustically insulated, provide liner of 18 gage galvanized expanded metal mesh supported at 12 inch centers, turned up 12 inches at sides with sheet metal shields.
- C. Mount floor mounted casings on 4 inch high concrete curbs. At floor, rivet panels on 8 inch centers to angles. Where floors are acoustically insulated, provide liner of 18 gage galvanized expanded metal mesh supported at 12 inch centers, turned up 12 inches at sides with sheet metal shields.
- D. Reinforce door frames with steel angles tied to horizontal and vertical plenum supporting angles. Install hinged access doors where indicated or required for access to equipment for cleaning and inspection.
 - 1. Provide clear wire glass observation ports, minimum 6 X 6 inch size.

PART 3 EXECUTION

3.01 INSTALLATION

- A. Install, support, and seal ducts in accordance with SMACNA HVAC Duct Construction Standards.
- B. Install in accordance with manufacturer's instructions.
- C. Duct sizes indicated are inside clear dimensions. For lined ducts, maintain sizes inside lining.
- D. Install and seal metal and flexible ducts in accordance with SMACNA HVAC Duct Construction Standards - Metal and Flexible.
- E. Provide openings in ductwork where required to accommodate thermometers and controllers. Provide pilot tube openings where required for testing of systems, complete with metal can with spring device or screw to ensure against air leakage. Where openings are provided in insulated ductwork, install insulation material inside a metal ring.
- F. Locate ducts with sufficient space around equipment to allow normal operating and maintenance activities.
- G. Use crimp joints with or without bead for joining round duct sizes 8 inch and smaller with crimp in direction of air flow.
- H. Use double nuts and lock washers on threaded rod supports.
- I. Tape joints of PVC coated metal ductwork with PVC tape.
- J. Connect terminal units to supply ducts with one foot maximum length of flexible duct. Do not use flexible duct to change direction.
- K. Connect diffusers or light troffer boots to low pressure ducts with 5 feet maximum length of flexible duct held in place with strap or clamp.
- L. Connect flexible ducts to metal ducts with adhesive plus sheet metal screws.
- M. Set plenum doors 6 to 12 inches above floor. Arrange door swings so that fan static pressure holds door in closed position.
- N. Use stainless steel for ductwork exposed to view and stainless steel or carbon steel for ducts where concealed.

- O. During construction provide temporary closures of metal or taped polyethylene on open ductwork to prevent construction dust from entering ductwork system.
- P. At exterior wall louvers, seal duct to louver frame and install blank-out panels as required.

3.02 SCHEDULES

- A. Ductwork Material:
 - 1. Low Pressure Supply (Heating Systems): Steel, Aluminum.
 - 2. Low Pressure Supply (System with Cooling Coils): Steel, Aluminum.
 - 3. Return and Relief: Steel, Aluminum.
 - 4. General Exhaust: Steel, Aluminum.
 - 5. Fume Hood Exhaust: Stainless Steel, Glass Fiber Reinforced Plastic.
 - 6. Outside Air Intake: Steel.
 - 7. Exposed round ductwork: Double-walled spiral.
- B. Ductwork Pressure Class:
 - 1. Supply (Heating Systems): 1 inch
 - 2. Supply (System with Cooling Coils): 1 inch.
 - 3. Return and Relief: 1 inch.
 - 4. General Exhaust: 1 inch.
 - 5. Outside Air Intake: 1 inch.

END OF SECTION

SECTION 23 33 00
AIR DUCT ACCESSORIES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Air turning devices/extractors.
- B. Duct access doors.
- C. Duct test holes.
- D. Flexible duct connections.
- E. Volume control dampers.

1.02 RELATED REQUIREMENTS

- A. Section 22 05 48 - Vibration and Seismic Controls for Plumbing Piping and Equipment.
- B. Section 23 31 00 - HVAC Ducts and Casings.
- C. Section 23 36 00 - Air Terminal Units: Pressure regulating damper assemblies.
- D. Section 26 27 17 - Equipment Wiring: Electrical characteristics and wiring connections.

1.03 REFERENCE STANDARDS

- A. NFPA 90A - Standard for the Installation of Air-Conditioning and Ventilating Systems.
- B. NFPA 92 - Standard for Smoke Control Systems.
- C. NFPA 92A - Standard for Smoke-Control Systems Utilizing Barriers and Pressure Differences.
- D. SMACNA (DCS) - HVAC Duct Construction Standards Metal and Flexible.
- E. UL 33 - Safety Heat Responsive Links for Fire-Protection Service.
- F. UL 555 - Standard for Fire Dampers.
- G. UL 555S - Standard for Smoke Dampers.

1.04 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide for shop fabricated assemblies including volume control dampers, duct access doors, duct test holes, and hardware used. Include electrical characteristics and connection requirements.
- C. Shop Drawings: Indicate for shop fabricated assemblies including volume control dampers, duct access doors, and duct test holes.
- D. Manufacturer's Installation Instructions: Provide instructions for fire dampers and combination fire and smoke dampers.

1.05 PROJECT RECORD DOCUMENTS

- A. Record actual locations of access doors and test holes.

1.06 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing the type of products specified in this section, with minimum five years of documented experience.
- B. Products Requiring Electrical Connection: Listed and classified by Underwriters Laboratories Inc. as suitable for the purpose specified and indicated.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. Protect dampers from damage to operating linkages and blades.

1.08 EXTRA MATERIALS

- A. See Section 01 6000 - Product Requirements, for additional provisions.

PART 2 PRODUCTS

2.01 AIR TURNING DEVICES/EXTRACTORS

- A. Manufacturers:
 - 1. Krueger: www.krueger-hvac.com.
 - 2. Ruskin Company: www.ruskin.com.
 - 3. Titus: www.titus-hvac.com.
 - 4. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Multi-blade device with blades aligned in short dimension; steel construction; with individually adjustable blades, mounting straps.

2.02 DUCT ACCESS DOORS

- A. Manufacturers:
 - 1. Nailor Industries Inc: www.nailor.com.
 - 2. Ruskin Company: www.ruskin.com.
 - 3. SEMCO Incorporated: www.semcoinc.com.
 - 4. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Fabricate in accordance with SMACNA HVAC Duct Construction Standards and as indicated.
- C. Fabrication: Rigid and close-fitting of galvanized steel with sealing gaskets and quick fastening locking devices. For insulated ducts, install minimum 1 inch thick insulation with sheet metal cover.
 - 1. Less Than 12 inches Square: Secure with sash locks.
 - 2. Up to 18 inches Square: Provide two hinges and two sash locks.
 - 3. Up to 24 x 48 inches: Three hinges and two compression latches with outside and inside handles.
 - 4. Larger Sizes: Provide an additional hinge.
- D. Access doors with sheet metal screw fasteners are not acceptable.

2.03 DUCT TEST HOLES

- A. Temporary Test Holes: Cut or drill in ducts as required. Cap with neat patches, neoprene plugs, threaded plugs, or threaded or twist-on metal caps.
- B. Permanent Test Holes: Factory fabricated, air tight flanged fittings with screw cap. Provide extended neck fittings to clear insulation.

2.04 FLEXIBLE DUCT CONNECTIONS

- A. Fabricate in accordance with SMACNA HVAC Duct Construction Standards and as indicated.
- B. Flexible Duct Connections: Fabric crimped into metal edging strip.
 - 1. Fabric: UL listed fire-retardant neoprene coated woven glass fiber fabric to NFPA 90A, minimum density 30 oz per sq yd.
 - a. Net Fabric Width: Approximately 6 inches wide.
 - 2. Metal: 3 inches wide, 24 gage thick galvanized steel.
- C. Leaded Vinyl Sheet: Minimum 0.55 inch thick, 0.87 lbs per sq ft, 10 dB attenuation in 10 to 10,000 Hz range.
- D. Provide flexible duct connectors at all equipment connections.

2.05 VOLUME CONTROL DAMPERS

- A. Manufacturers:
 - 1. Nailor Industries Inc; _____: www.nailor.com.

2. Ruskin Company: www.ruskin.com.
 3. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Fabricate in accordance with SMACNA HVAC Duct Construction Standards and as indicated.
- C. Splitter Dampers:
1. Material: Same gage as duct to 24 inches size in either direction, and two gages heavier for sizes over 24 inches.
 2. Blade: Fabricate of double thickness sheet metal to streamline shape, secured with continuous hinge or rod.
 3. Operator: Minimum 1/4 inch diameter rod in self aligning, universal joint action, flanged bushing with set screw .
- D. Single Blade Dampers: Fabricate for duct sizes up to 6 x 30 inch.
- E. Multi-Blade Damper: Fabricate of opposed blade pattern with maximum blade sizes 8 x 72 inch. Assemble center and edge crimped blades in prime coated or galvanized channel frame with suitable hardware.
- F. End Bearings: Except in round ducts 12 inches and smaller, provide end bearings. On multiple blade dampers, provide oil-impregnated nylon or sintered bronze bearings.
- G. Quadrants:
1. Provide locking, indicating quadrant regulators on single and multi-blade dampers.
 2. On insulated ducts mount quadrant regulators on stand-off mounting brackets, bases, or adapters.

PART 3 EXECUTION

3.01 PREPARATION

- A. Verify that electric power is available and of the correct characteristics.

3.02 INSTALLATION

- A. Install accessories in accordance with manufacturer's instructions, NFPA 90A, and follow SMACNA HVAC Duct Construction Standards. Refer to Section 23 31 00 for duct construction and pressure class.
- B. Provide backdraft dampers on exhaust fans or exhaust ducts nearest to outside and where indicated.
- C. Provide duct access doors for inspection and cleaning before and after filters, coils, fans, automatic dampers, at fire dampers, combination fire and smoke dampers, downstream of each VAV box, and elsewhere as indicated. Provide for cleaning kitchen exhaust ducts in accordance with NFPA 96. Provide minimum 8 x 8 inch size for hand access, 18 x 18 inch size for shoulder access, and as indicated. Provide 4 x 4 inch for balancing dampers only. Review locations prior to fabrication.
- D. Provide duct test holes where indicated and required for testing and balancing purposes.
- E. Provide fire dampers, combination fire and smoke dampers, and smoke dampers at locations indicated, where ducts and outlets pass through fire rated components, and where required by authorities having jurisdiction. Install with required perimeter mounting angles, sleeves, breakaway duct connections, corrosion resistant springs, bearings, bushings and hinges.
- F. Install smoke dampers and combination smoke and fire dampers in accordance with NFPA 92.
1. Smoke dampers shall be integrated into the "smoke purge control system". Dampers in the return ductwork shall be overridden to the open position when the smoke purge is activated.
- G. Demonstrate re-setting of fire dampers to Owner's representative.

- H. At fans and motorized equipment associated with ducts, provide flexible duct connections immediately adjacent to the equipment.
- I. At equipment supported by vibration isolators, provide flexible duct connections immediately adjacent to the equipment; see Section 22 05 48.
- J. For fans developing static pressures of 5.0 inches and over, cover flexible connections with leaded vinyl sheet, held in place with metal straps.
- K. Provide balancing dampers at points on supply, return, and exhaust systems where branches are taken from larger ducts as required for air balancing. Install minimum 2 duct widths from duct take-off.
- L. Use splitter dampers only where indicated.
- M. Provide balancing dampers on high velocity systems where indicated. Refer to Section 23 36 00 - Air Terminal Units.
- N. Provide balancing dampers on duct take-off to diffusers, grilles, and registers, regardless of whether dampers are specified as part of the diffuser, grille, or register assembly.

END OF SECTION

SECTION 23 74 13

PACKAGED OUTDOOR CENTRAL-STATION AIR-HANDLING UNITS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Packaged air handling unit
- B. Unit controls.
- C. Remote panel.

1.02 RELATED REQUIREMENTS

- A. Section 26 27 17 - Equipment Wiring: Installation and wiring of thermostats and other controls components; wiring from unit terminal strip to remote panel.
- B. Section 26 27 17 - Equipment Wiring: Electrical characteristics and wiring connections.

1.03 REFERENCE STANDARDS

- A. AHRI 210/240 - Standard for Performance Rating of Unitary Air-Conditioning and Air-Source Heat Pump Equipment.
- B. AHRI 270 - Sound Performance Rating of Outdoor Unitary Equipment.
- C. NFPA 90A - Standard for the Installation of Air-Conditioning and Ventilating Systems.

1.04 SUBMITTALS

- A. See Section 01 33 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide capacity and dimensions of manufactured products and assemblies required for this project. Indicate electrical service with electrical characteristics and connection requirements, and duct connections.
- C. Shop Drawings: Indicate capacity and dimensions of manufactured products and assemblies required for this project. Indicate electrical service with electrical characteristics and connection requirements, and duct connections.
- D. Manufacturer's Instructions: Indicate assembly, support details, connection requirements, and include start-up instructions.
- E. Operation and Maintenance Data: Include manufacturer's descriptive literature, operating instructions, installation instructions, maintenance and repair data, and parts listing.
- F. Warranty: Submit manufacturer's warranty and ensure forms have been filled out in Owner's name and registered with manufacturer.

1.05 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing the type of products specified in this section, with minimum five years of documented experience.
- B. Products Requiring Electrical Connection: Listed and classified by Underwriters Laboratories Inc. as suitable for the purpose specified and indicated.
- C. Unit meets ASHRAE 90.1 minimum efficiency requirements.
- D. Unit shall be rated in accordance with AHRI Standards 210/240 or 340/360.
- E. Unit shall be designed to conform to ASHRAE 15, 2001.
- F. Unit shall be UL- tested and certified in accordance with ANSI Z21.47 -2012/CSA 2.3-2012, CSA C22.2 No. 236-11 (UL 1995) 4th edition and CSA C22.2 No. 3 - M 1988.
- G. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.

- H. Unit casing shall be capable of withstanding 1000- hour salt spray exposure per ASTM B117 (scribed specimen).
- I. Unit shall be designed in accordance with ISO 9001, and shall be manufactured in a facility registered by ISO 9001.
- J. Unit shall be subjected to a completely automated run test on the assembly line. The data for each unit will be stored at the factory, and must be available upon request.
- K. Unit shall be designed in accordance with UL Standard 1995, including tested to withstand rain.
- L. Unit shall be constructed to prevent intrusion of snow and tested to prevent snow intrusion into the control box.
- M. Unit shake tested to assurance Truck 2, ASTM D4169 to ensure shipping reliability.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. Protect units from physical damage by storing off site until roof mounting curbs are in place, ready for immediate installation of units.
- B. Unit shall be stored and handled per manufacturer's recommendations.
- C. Overhead crane can be used to place the units on a roof using rigging holes built into the unit base rails without any additions to the unit.
- D. Unit shall only be stored or positioned in the upright position.

1.07 WARRANTY

- A. Provide a one year warranty to cover parts and labor on the complete unit.
- B. Provide a five year warranty to include coverage for refrigeration compressors.
- C. Provide a ten year warranty to include coverage for the aluminized steel heat exchanger.

1.08 MAINTENANCE SERVICE

- A. Furnish service and maintenance of packaged roof top units for one year from Date of Substantial Completion.
- B. Provide maintenance service with a two month interval as maximum time period between calls. Provide 24-hour emergency service on breakdowns and malfunctions.
- C. Include maintenance items as outlined in manufacturer's operating and maintenance data, including minimum of six filter replacements, minimum of one fan belt replacement, and controls check-out, adjustments, and recalibration.
- D. Submit copy of service call work order or report, and include description of work performed.

1.09 EXTRA MATERIALS

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Johnson Controls / York International Corporation
- B. Trane Company
- C. Daikin / McQuay
- D. Substitutions: See Section 01 60 00 - Product Requirements.

2.02 OPERATING CHARACTERISTICS

- A. Unit shall be capable of starting and running at 125°F (52°C) ambient outdoor temperature, meeting maximum load criteria of AHRI Standard 210/240 or 340/360 at ± 10% voltage.

- B. Compressor with standard controls shall be capable of operation down to 30°F (-1°C), ambient outdoor temperatures. Low ambient kit is necessary if mechanically cooling at ambient temperatures below 30°F (-1°C).
- C. Unit shall be capable of horizontal supply and horizontal return, as shown on contract drawings.

2.03 AIR CONDITIONING UNITS

- A. General: Roof or ground mounted packaged units having natural gas as scheduled and electric refrigeration.
- B. Description: Self-contained, packaged, factory assembled and prewired, consisting of cabinet and frame, supply fan, , factory-mounted controls, air filters, natural gas heating coil, refrigerant cooling coil and compressor with hot-gas bypass or variable-speed compressors and hot-gas reheat circuits, condenser coil and condenser fan as scheduled.
- C. Disconnect Switch: Factory mount disconnect switch on equipment under provisions of Section 26 27 17.
- D. Outdoor, rooftop mounted, electrically controlled, heating and cooling unit utilizing a fully hermetic, suction gas cooled, direct drive compressor(s) for cooling duty and gas combustion or nickel chromium elements for heating duty.
- E. Factory assembled, single-piece heating and cooling rooftop unit. Contained within the unit enclosure shall be all factory wiring, piping, controls, and special features required prior to field start-up.
- F. Unit shall use environmentally sound, R-410A refrigerant.
- G. Unit shall be installed in accordance with the manufacturer's instructions.
- H. Unit must be selected and installed in compliance with local, state, and federal codes.

2.04 EQUIPMENT INSULATION

- A. Evaporator fan compartment:
 - 1. Interior cabinet surfaces shall be insulated with a minimum 1/4- in. thick, elastomeric rubber insulation with thermal conductivity of 0.27 or better, adhered with acrylic based adhesive
 - 2. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.
- B. Gas heat compartment:
 - 1. Interior cabinet surfaces shall be insulated with a minimum 1/4- in. thick, elastomeric rubber insulation with thermal conductivity of 0.27 or better, adhered with acrylic based adhesive
 - 2. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.
- C. Economizer and Control compartment:
 - 1. Interior cabinet surfaces shall be insulated with a minimum 1/4- in. thick, elastomeric rubber insulation with thermal conductivity of 0.27 or better, adhered with acrylic based adhesive
 - 2. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.
- D. . Partition, Base Pan, and Duct Panel:
 - 1. Interior cabinet surfaces shall be insulated with a minimum 1/2- in. thick, minimum 1 1/2 lb. density, flexible fiberglass insulation bonded with a phenolic binder, neoprene coated on the air side.

2. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.

2.05 UNIT CABINET

- A. Unit cabinet shall be constructed of galvanized steel with exterior surfaces coated with a non-chalking, powder paint finish, certified at 1000 hour salt spray test per ASTM-B117 standards.
- B. Unit cabinet exterior paint shall be: film thickness, (dry) 3.0 MILS minimum, gloss (per ASTM D523, 60°F / 16°C): 80+/-5, Hardness: H- 2H Pencil hardness.
- C. Unit cabinet shall have gas and electric utility knockouts in the side of the unit.
- D. Base Rail
 1. Unit shall have base rails on a minimum of 4 sides.
 - a. Holes shall be provided in the base rails for rigging shackles to facilitate maneuvering and overhead rigging.
 - 1) Holes shall be provided in the base rail for moving the rooftop by fork truck.
 - b. Base rail shall be a minimum of 15 gauge thickness.
- E. Condensate pan and connections:
 1. Shall be an internally sloped condensate drain pan made of stainless steel.
 - a. Shall comply with ASHRAE Standard 62.
 - 1) Shall use a 3/4" NPT drain connection, possible either through the bottom or side of the drain pan. Connection shall be made per manufacturer's recommendations.
- F. Top panel:
 1. Shall be a two piece top panel.
- G. Gas Connections:
 1. All gas piping connecting to unit gas valve shall enter the unit cabinet at a single location on side of unit.
- H. Electrical Connections
 1. All unit power wiring shall enter unit cabinet at a single, factory prepared, and knockout location.
 2. Component access panels (standard)
 - a. Cabinet panels shall be hinged with tool-less access.
 - 1) Shall provide easy access through hand tightened "t" handles.
 - 2) Shall be on major panels of: filter, control box, fan motor, and compressor.
 3. Units meet the seismic capacity requirements of the International Code Council Evaluation Service (ICC- ES) document AC156 (Acceptance Criteria for Seismic Qualification by Shake- Table Testing of Nonstructural Components and Systems), the International Building Code (IBC 2009), and the California Building Code (CBC 2010) with quality testing conducted in accordance with the standards of the American Society of Civil Engineers (ASCE 7-05).
 - a. Units are certified with an SDS (g) value of 2.50 using seismic design parameters of $z/h=1.0$, $I_p=1.5$ and certified by independent structural engineers.

2.06 GAS HEAT

- A. General
 1. Heat exchanger shall be an induced draft design. Positive pressure heat exchanger designs shall not be allowed.
 - a. Shall incorporate a direct-spark ignition system and redundant main gas valve.
 - 1) Gas supply pressure at the inlet to the rooftop unit gas valve must match that required by the manufacturer.

Studio JAED Architects & Engineers

PACKAGED OUTDOOR
CENTRAL-STATION
AIR-HANDLING UNITS

- 2) Unit shall have 2 stages of gas heating where 1st stage is 60% of total capacity.
2. The heat exchanger shall be controlled by an integrated gas controller (IGC) microprocessor.
 - a. IGC board shall notify users of fault using an LED (light-emitting diode).
 - 1) The LED shall be visible without removing the control box access panel.
 - b. Unit Control Board shall contain algorithms that modify evaporator fan operation to prevent future cycling on high temperature limit switch.
 - 1) Unit shall be equipped with anti-cycle protection with one cycle on unit flame rollout switch or 3 short cycles on the high temperature limit switch. Fault indication shall be made using an LED.
3. Standard Heat Exchanger construction
 - a. Heat exchanger shall be of the tubular- section type constructed of a minimum of 20-gauge steel coated with a T1-40 aluminum-silicon alloy for corrosion resistance.
 - b. Burners shall be of the in-shot type constructed of aluminum-coated steel.
 - 1) Burners shall incorporate orifices for rated heat output up to 2000 ft. (610m) elevation. Additional accessory kits may be required for applications above 2000 ft. (610m) elevation, depending on local gas supply conditions.
- B. Induced draft combustion motor and blower
 1. Shall be a direct-drive, single inlet, forward-curved centrifugal type.
 - a. Shall be made from steel with a corrosion-resistant finish.
 - 1) Shall have permanently lubricated sealed bearings.
 - (a) Shall have inherent thermal overload protection.
 - (b) Shall have an automatic reset feature.

2.07 COILS

- A. Standard Aluminum Fin - Copper Tube Coils:
 1. Standard evaporator coils shall have aluminum plate fins mechanically bonded to seamless internally grooved copper tubes with all joints brazed.
 2. Shall be leak tested to 150 psig, pressure tested to 250 psig, and qualified to CSA C22.2 No. 236-11(UL 1995) 4th edition burst test at 1775 psig.
 3. Assembled unit shall be pressure tested to 425 psig.
- B. Standard All Aluminum Microchannel Coils:
 1. Standard condenser coils shall have all aluminum microchannel design consisting of aluminum multiport flat tube design and aluminum fin. Coils shall be a furnace brazed design and contain epoxy lined shrink wrap on all aluminum to copper connections.
 - a. Condenser coils on all Heat Pump and Hot Gas Reheat units shall be Standard Aluminum Fin - Copper Tube coils as defined above.
 2. Microchannel condenser coils shall be leak tested to 150 psig, pressure tested to 650 psig, and qualified to UL 1995 burst test at 1980 psig.
 - a. Assembled unit shall be pressure tested to 425 psig.

2.08 REFRIGERANT COMPRESSORS

- A. Units shall utilize 2 independent refrigerant circuits.
- B. Refrigerant circuit shall include the following control, safety, and maintenance features:
 1. Thermostatic Expansion Valve (TXV) shall help provide optimum performance across the entire operating range. Shall contain removable power element to allow change out of power element and bulb without removing the valve body.
 2. Refrigerant filter drier - Solid core design.
 3. Service gauge connections on suction and discharge lines.
- C. Compressors

1. Unit shall use fully hermetic, scroll compressor for each independent refrigeration circuit.
2. Compressor motors shall be cooled by refrigerant gas passing through motor windings.
3. Compressors shall be internally protected from high discharge temperature conditions.
4. Compressors shall be protected from an over-temperature and over-ampereage conditions by an internal, motor overload device.
5. Compressor shall be factory mounted on rubber grommets.
6. Compressor motors shall have internal line break thermal, current overload and high pressure differential protection.
7. Crankcase heaters shall not be required for normal operating range, unless provided by the factory.

2.09 FILTER SECTION

- A. Filters access is specified in the unit cabinet section of this specification.
- B. Filters shall be held placed on a slide out rail that can be pulled out by a handle for easy filter replacement.
- C. Shall consist of factory installed, low velocity, throw-away 2-in. thick fiberglass filters unless otherwise specified.
- D. Units can accept 2-in or 4-in filters and can be converted in the field without tools.
- E. Unit shall be furnished with MERV-10 filters.

2.10 EVAPORATOR FAN AND MOTOR

- A. Evaporator fan motor:
 1. Shall have permanently lubricated ball-bearings.
 2. Shall have inherent automatic-reset thermal overload protection.
 3. The job site selected brake horsepower shall be required to not exceed the motor's nameplate horsepower rating plus the service factor.
- B. Evaporator Fan:
 1. Fan shall be a belt drive assembly with an adjustable pitch motor pulley.
 2. Shall use sealed, permanently lubricated ball-bearing type.
 3. Blower fan shall be double-inlet type with forward-curved blades.
 4. Shall be constructed from steel with a corrosion resistant finish and dynamically balanced.

2.11 CONDENSER FAN AND MOTORS

- A. Condenser fan motors:
 1. Shall be a totally enclosed motor.
 2. Shall use permanently lubricated ball-bearings.
 3. Shall have inherent thermal overload protection with an automatic reset feature.
 4. Shall use a shaft-down design.
- B. Condenser Fans:
 1. Shall be a direct-driven propeller type fan.
 2. Shall have aluminum blades riveted to corrosion-resistant steel spider brackets and be dynamically balanced.

2.12 SPECIAL FEATURES, OPTIONS, AND ACCESSORIES

- A. Evaporator fan motor:
 1. Shall have permanently lubricated bearings.
 2. Shall have a maximum continuous bhp rating for continuous duty operation; no safety factors above that rating.
 3. Shall be Variable Frequency duty.
- B. Variable Frequency Drive (VFD):

Studio JAED Architects & Engineers

PACKAGED OUTDOOR
CENTRAL-STATION
AIR-HANDLING UNITS

1. Shall be installed inside the unit cabinet, mounted, wired and tested.
 2. Shall contain Electromagnetic Interference (EMI) frequency protection.
 - a. Insulated Gate Bi- Polar Transistors (IGBT) used to produce the output pulse width modulated (PWM) waveform.
 - b. Built in LED display and controls. Does not require additional kit or options.
 - c. RS485 capability standard.
 - d. Electronic thermal overload protection.
 - e. 5% swinging chokes for harmonic reduction and improved power factor.
 - f. All printed circuit boards shall be conformal coated.
- C. Mixed Air Casing and Standard Integrated Economizer:
1. Integrated, gear driven opposing modulating blade design type capable of simultaneous economizer and compressor operation.
 2. Independent modules for vertical or horizontal return configuration shall be available. Vertical return modules shall be available as a factory installed option.
 3. Damper blades shall be galvanized steel with metal gears. Plastic or composite blades on intake or return shall not be acceptable.
 4. Damper blades shall be class 1A dampers.
 5. Shall include all hardware and controls to provide free cooling with outdoor air when temperature and/or humidity are below set points.
 6. Shall be equipped with gear driven dampers for both the outdoor ventilation air and the return air for positive air stream control.
 7. Economizer shall comply with, and be certified to, the AMCA 511 standard.
 8. Standard leak rate shall be equipped with dampers not to exceed 3 cfm/ft² leakage at 1 in. wg pressure differential.
 9. Shall be capable of introducing up to 100% outdoor air.
 10. Shall be equipped with a barometric relief damper capable of relieving up to 100% return air and contain seals that meet ASHRAE 90.1 requirements.
 11. Shall be designed to close damper(s) during loss-of-power situations with spring return built into motor.
 12. The economizer shall maintain minimum airflow into the building during occupied period and provide design ventilation rate for full occupancy.
 13. Dampers shall be completely closed when the unit is in the unoccupied mode.
 14. Actuator shall be direct coupled to economizer gear. No linkage arms or control rods shall be acceptable.
 15. Economizer controller shall provide indications when in free cooling mode, in the DCV mode, or the exhaust fan contact is closed.
 16. Provide airflow monitoring station at outside air inlet integrated with packaged controller to maintain minimum ventilation airflow during VAV operation.
- D. Barometric Relief Kit
1. Shall contain all materials necessary to field install a barometric relief damper capable of relieving up to 100% return air and contain seals that meet ASHRAE 90.1 requirements.
- E. Rawal APR control valve factory installed on lead refrigerant circuit for capacity control.
- F. Dehumidification System:
1. The Dehumidification system is factory and provides dehumidification of an occupied space while maintaining temperature control utilizing a hot gas reheat coil.
 2. Determination of unit functionality in straight cooling, straight heating, or reheat mode shall come from standard SSE control board.
 3. Reheat mode shall utilize a specific reheat coil placed after the evaporator coil to heat the conditioned air back to a neutral temperature when the occupied space requires dehumidification, but the temperature requirements are satisfied.

4. The reheat circuit shall utilize solenoids to alter the refrigerant flow from being directed through the condenser circuit to the hot gas reheat circuit.
 5. Changeover from cooling mode to reheat mode shall be accomplished in 30 seconds or less.
- G. Phase Monitor
1. Shall provide protection against phase reversal, phase loss, and phase unbalance.
 2. Switch shall automatically shut off unit control circuit if any of the above conditions is detected.
 3. Shall have visual LED indication of operational status.
 4. All models with a scroll compressor shall have a factory installed phase monitor as standard.
- H. Coil Guard (Field-installed)
1. Shall contain all materials necessary to field install a coil guard.
 2. Shall provide protection for the fins and tubes on the entire exposed surfaces of the outdoor coil
- I. Condenser Coil Hail Guard Assembly (Field-installed)
1. Shall protect against damage from hail.
 2. External sloped hood style.
- J. Unit-Mounted, Non-Fused Disconnect Switch:
1. Switch shall be factory installed, internally mounted.
 2. National Electric Code (NEC) and UL approved non- fused switch shall provide unit power shutoff.
 - a. Shall be accessible from outside the unit.
 3. Shall provide local shutdown and lockout capability.
- K. Convenience Outlet:
1. Powered convenience outlet.
 - a. Outlet shall be powered from main line power to the rooftop unit.
 - b. Outlet shall be factory installed and internally mounted with easily accessible 115-v female receptacle.
 - c. Outlet shall include 15 amp GFI receptacles with independent fuse protection.
 - d. Voltage required to operate convenience outlet shall be provided by a factory installed step-down transformer.
 - e. Outlet shall be accessible from outside the unit.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that roof is ready to receive work and opening dimensions are as indicated on shop drawings or illustrated by the manufacturer.
- B. Verify that proper power supply is available.

3.02 INSTALLATION

- A. Fasten to concrete pad with epoxy anchors.
- B. Install in accordance with manufacturer's instructions.
- C. Install in accordance with NFPA 90A.

3.03 SYSTEM STARTUP

- A. Prepare and start equipment. Adjust for proper operation.
- B. Equipment startup is to be performed by factory-authorized representative.

Studio JAED Architects & Engineers

PACKAGED OUTDOOR
CENTRAL-STATION
AIR-HANDLING UNITS

3.04 CLOSEOUT ACTIVITIES

- A. Demonstrate operation to maintenance personnel.
- B. Provide minimum 4-hours training in minimum 2-hour segments for maintenance personnel.

3.05 MAINTENANCE

- A. Provide service and maintenance of packaged roof top units for one year year from Date of Substantial Completion.
- B. Provide routine maintenance service with a three month interval as maximum time period between calls.
- C. Include maintenance items as outlined in manufacturer's operating and maintenance data, including minimum of six filter replacements, minimum of one fan belt replacement, and controls check-out, adjustments, and recalibration.
- D. After each service call, submit copy of service call work order or report that includes description of work performed.

END OF SECTION

SECTION 26 05 01
MINOR ELECTRICAL DEMOLITION

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Electrical demolition.

1.02 RELATED REQUIREMENTS

- A. Section 01 70 00 - Execution and Closeout Requirements: Additional requirements for alterations work.

PART 2 PRODUCTS

2.01 MATERIALS AND EQUIPMENT

- A. Materials and equipment for patching and extending work: As specified in individual sections.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify field measurements and circuiting arrangements are as shown on Drawings.
- B. Verify that abandoned wiring and equipment serve only abandoned facilities.
- C. Demolition drawings are based on casual field observation .
- D. Report discrepancies to Owner before disturbing existing installation.
- E. Report discrepancies to Architect before disturbing existing installation.
- F. Beginning of demolition means installer accepts existing conditions.

3.02 PREPARATION

- A. Disconnect electrical systems in walls, floors, and ceilings to be removed.
- B. Coordinate utility service outages with utility company.
- C. Provide temporary wiring and connections to maintain existing systems in service during construction. When work must be performed on energized equipment or circuits, use personnel experienced in such operations.
- D. Existing Electrical Service: Maintain existing system in service until new system is complete and ready for service. Disable system only to make switchovers and connections. Minimize outage duration.
 - 1. Obtain permission from Owner at least 24 hours before partially or completely disabling system.
 - 2. Make temporary connections to maintain service in areas adjacent to work area.
- E. Existing Fire Alarm System: Maintain existing system in service until new system is accepted. Disable system only to make switchovers and connections. Minimize outage duration.
 - 1. Notify Owner before partially or completely disabling system.
 - 2. Notify local fire service.
 - 3. Make notifications at least 24 hours in advance.
 - 4. Make temporary connections to maintain service in areas adjacent to work area.

3.03 DEMOLITION AND EXTENSION OF EXISTING ELECTRICAL WORK

- A. Remove, relocate, and extend existing installations to accommodate new construction.
- B. Remove abandoned wiring to source of supply.
- C. Remove exposed abandoned conduit, including abandoned conduit above accessible ceiling finishes. Cut conduit flush with walls and floors, and patch surfaces.

- D. Disconnect abandoned outlets and remove devices. Remove abandoned outlets if conduit servicing them is abandoned and removed. Provide blank cover for abandoned outlets that are not removed.
- E. Disconnect and remove abandoned panelboards and distribution equipment.
- F. Disconnect and remove electrical devices and equipment serving utilization equipment that has been removed.
- G. Disconnect and remove abandoned luminaires. Remove brackets, stems, hangers, and other accessories.
- H. Repair adjacent construction and finishes damaged during demolition and extension work.
- I. Maintain access to existing electrical installations that remain active. Modify installation or provide access panel as appropriate.
- J. Extend existing installations using materials and methods compatible with existing electrical installations, or as specified.

3.04 CLEANING AND REPAIR

- A. See Section 01 74 19 - Construction Waste Management and Disposal for additional requirements.
- B. Clean and repair existing materials and equipment that remain or that are to be reused.
- C. Panelboards: Clean exposed surfaces and check tightness of electrical connections. Replace damaged circuit breakers and provide closure plates for vacant positions. Provide typed circuit directory showing revised circuiting arrangement.
- D. Luminaires: Remove existing luminaires for cleaning. Use mild detergent to clean all exterior and interior surfaces; rinse with clean water and wipe dry. Replace lamps, ballasts and broken electrical parts.
- E. Any lighting or ceiling-mounted devices removed during construction must be reinstalled.

END OF SECTION

SECTION 26 05 19

LV ELEC. POWER CONDUCTORS AND CABLES (600V&LESS)

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Single conductor building wire.
- B. Metal-clad cable.
- C. Wire and cable for 600 volts and less.
- D. Wiring connectors.
- E. Electrical tape.
- F. Wire pulling lubricant.
- G. Cable ties.

1.02 RELATED REQUIREMENTS

- A. Section 07 84 00 - Firestopping.
- B. Section 26 05 01 - Minor Electrical Demolition: Disconnection, removal, and/or extension of existing electrical conductors and cables.
- C. Section 26 05 26 - Grounding and Bonding for Electrical Systems: Additional requirements for grounding conductors and grounding connectors.
- D. Section 26 05 53 - Identification for Electrical Systems: Identification products and requirements.

1.03 REFERENCE STANDARDS

- A. ASTM B3 - Standard Specification for Soft or Annealed Copper Wire.
- B. ASTM B8 - Standard Specification for Concentric-Lay-Stranded Copper Conductors, Hard, Medium-Hard, or Soft.
- C. ASTM B33 - Standard Specification for Tin-Coated Soft or Annealed Copper Wire for Electrical Purposes.
- D. ASTM B787/B787M - Standard Specification for 19 Wire Combination Unilay-Stranded Copper Conductors for Subsequent Insulation.
- E. ASTM D3005 - Standard Specification for Low-Temperature Resistant Vinyl Chloride Plastic Pressure-Sensitive Electrical Insulating Tape.
- F. NECA 1 - Standard for Good Workmanship in Electrical Construction.
- G. NECA 120 - Standard for Installing Armored Cable (AC) and Metal-Clad Cable (MC).
- H. NEMA WC 70 - Nonshielded Power Cable 2000 V or Less for the Distribution of Electrical Energy.
- I. NETA ATS - Acceptance Testing Specifications for Electrical Power Equipment and Systems.
- J. NFPA 70 - National Electrical Code.
- K. UL 44 - Thermoset-Insulated Wires and Cables.
- L. UL 83 - Thermoplastic-Insulated Wires and Cables.
- M. UL 486A-486B - Wire Connectors.
- N. UL 486C - Splicing Wire Connectors.
- O. UL 486D - Sealed Wire Connector Systems.
- P. UL 510 - Polyvinyl Chloride, Polyethylene, and Rubber Insulating Tape.

Studio JAED Architects & Engineers

LV ELEC. POWER
CONDUCTORS AND CABLES
(600V&LESS)

Q. UL 1569 - Metal-Clad Cables.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
1. Coordinate sizes of raceways, boxes, and equipment enclosures installed under other sections with the actual conductors to be installed, including adjustments for conductor sizes increased for voltage drop.
 2. Coordinate with electrical equipment installed under other sections to provide terminations suitable for use with the conductors to be installed.
 3. Notify Architect of any conflicts with or deviations from the contract documents. Obtain direction before proceeding with work.

1.05 SUBMITTALS

- A. See Section 01 33 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide for each cable assembly type.
- C. Samples of Actual Product Delivered: Submit one 18 inch length of cable assembly from each reel.
1. Select each length to include complete set of manufacturer markings.
 2. Attach tag indicating cable size and application information.
- D. Test Reports: Indicate procedures and values obtained.
- E. Design Data: Indicate voltage drop and ampacity calculations for aluminum conductors substituted for copper conductors. Include proposed modifications to raceways, boxes, wiring gutters, enclosures, etc. to accommodate substituted conductors.
- F. Manufacturer's Installation Instructions: Indicate application conditions and limitations of use stipulated by product testing agency. Include instructions for storage, handling, protection, examination, preparation, and installation of product.
- G. Project Record Documents: Record actual locations of components and circuits.

1.06 QUALITY ASSURANCE

- A. Conform to requirements of NFPA 70.
- B. Maintain at the project site a copy of each referenced document that prescribes execution requirements.
- C. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum three years documented experience.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. Receive, inspect, handle, and store conductors and cables in accordance with manufacturer's instructions.

1.08 FIELD CONDITIONS

- A. Do not install or otherwise handle thermoplastic-insulated conductors at temperatures lower than 14 degrees F, unless otherwise permitted by manufacturer's instructions. When installation below this temperature is unavoidable, notify Architect and obtain direction before proceeding with work.

PART 2 PRODUCTS

2.01 CONDUCTOR AND CABLE APPLICATIONS

- A. Do not use conductors and cables for applications other than as permitted by NFPA 70 and product listing.

- B. Provide single conductor building wire installed in suitable raceway unless otherwise indicated, permitted, or required.
- C. Concealed Dry Interior Locations: Use only building wire in raceway type THHN/THHW.
- D. Exposed Dry Interior Locations: Use only building wire in raceway type THHN/THHW.
- E. Above Accessible Ceilings: Use only building wire in raceway type THHN.
- F. Wet or Damp Interior Locations: Use only building wire in raceway type THW.
- G. Exterior Locations: Use only building wire in raceway type THHW.
- H. Use solid conductor for feeders and branch circuits 10 AWG and smaller.
- I. Use solid conductors for control circuits.
- J. Use conductor not smaller than 12 AWG for power and lighting circuits.
- K. Use conductor not smaller than 16 AWG for control circuits.
- L. Use 10 AWG conductors for 20 ampere, 120 volt branch circuits longer than 75 feet.
- M. Use 10 AWG conductors for 20 ampere, 277 volt branch circuits longer than 200 feet.

2.02 CONDUCTOR AND CABLE MANUFACTURERS

- A. Cerro Wire LLC: www.cerrowire.com.
- B. Southwire Company: www.southwire.com.
- C. Substitutions: See Section 01 60 00 - Product Requirements.

2.03 CONDUCTOR AND CABLE GENERAL REQUIREMENTS

- A. Provide products that comply with requirements of NFPA 70.
- B. Provide products listed, classified, and labeled as suitable for the purpose intended.
- C. Unless specifically indicated to be excluded, provide all required conduit, boxes, wiring, connectors, etc. as required for a complete operating system.
- D. Comply with NEMA WC 70.
- E. Thermoplastic-Insulated Conductors and Cables: Listed and labeled as complying with UL 83.
- F. Thermoset-Insulated Conductors and Cables: Listed and labeled as complying with UL 44.
- G. Conductor Material:
 - 1. Copper Conductors: Soft drawn annealed, 98 percent conductivity, uncoated copper conductors complying with ASTM B3, ASTM B8, or ASTM B787/B 787M unless otherwise indicated.
 - 2. Tinned Copper Conductors: Comply with ASTM B33.
- H. Minimum Conductor Size: 12 AWG.
 - 1. Branch Circuits: 12 AWG.
 - a. Exceptions:
 - 1) 20 A, 120 V circuits longer than 75 feet: 10 AWG, for voltage drop.
 - 2) 20 A, 120 V circuits longer than 150 feet: 8 AWG, for voltage drop.
 - 3) 20 A, 277 V circuits longer than 150 feet: 10 AWG, for voltage drop.
 - 2. Control Circuits: 14 AWG.
- I. Conductor Color Coding:
 - 1. Color code conductors as indicated unless otherwise required by the authority having jurisdiction. Maintain consistent color coding throughout project.
 - 2. Color Coding Method: Integrally colored insulation.
 - a. Conductors size 4 AWG and larger may have black insulation color coded using vinyl color coding electrical tape.

Studio JAED Architects & Engineers

LV ELEC. POWER
CONDUCTORS AND CABLES
(600V&LESS)

3. Color Code:
 - a. 480Y/277 V, 3 Phase, 4 Wire System:
 - 1) Phase A: Brown.
 - 2) Phase B: Orange.
 - 3) Phase C: Yellow.
 - 4) Neutral/Grounded: Gray.
 - b. 208Y/120 V, 3 Phase, 4 Wire System:
 - 1) Phase A: Black.
 - 2) Phase B: Red.
 - 3) Phase C: Blue.
 - 4) Neutral/Grounded: White.
 - c. Equipment Ground, All Systems: Green.
 - d. For modifications or additions to existing wiring systems, comply with existing color code when existing code complies with NFPA 70 and is approved by the authority having jurisdiction.
 - e. For control circuits, comply with manufacturer's recommended color code.

2.04 SINGLE CONDUCTOR BUILDING WIRE

- A. Description: Single conductor insulated wire.
- B. Conductor Stranding:
 1. Feeders and Branch Circuits:
 - a. Size 10 AWG and Smaller: Solid.
 - b. Size 8 AWG and Larger: Stranded.
- C. Insulation Voltage Rating: 600 V.
- D. Insulation:
 1. Copper Building Wire: Type THHN/THWN or THHN/THWN-2, except as indicated below.
- E. Conductor: Copper.
 1. For Sizes Smaller Than 4 AWG: Copper.
 2. For Sizes 4 AWG and Larger: Copper.
- F. Insulation Voltage Rating: 600 volts.
- G. Insulation: NFPA 70, Type THHW/THWN/THHN/THW.
- H. Insulation: Thermoplastic material rated 75/90 degrees C.

2.05 METAL-CLAD CABLE

- A. Manufacturers:
 1. AFC Cable Systems Inc: www.afcweb.com.
 2. Encore Wire Corporation: www.encorewire.com.
 3. Southwire Company: www.southwire.com.
 4. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Description: NFPA 70, Type MC cable listed and labeled as complying with UL 1569, and listed for use in classified firestop systems to be used.
- C. Conductor Stranding:
 1. Size 10 AWG and Smaller: Solid.
 2. Size 8 AWG and Larger: Stranded.
- D. Insulation Voltage Rating: 600 V.
- E. Insulation: Type THHN, THHN/THWN, or THHN/THWN-2.
- F. Provide dedicated neutral conductor for each phase conductor where indicated or required.

- G. Grounding: Full-size integral equipment grounding conductor.
- H. Armor: Steel, interlocked tape.
- I. Provide PVC jacket applied over cable armor where indicated or required for environment of installed location.
- J. Insulation Temperature Rating: 75/90 degrees C.

2.06 METAL CLAD CABLE

- A. Description: NFPA 70, Type MC.
- B. Conductor: Copper.
 - 1. For Sizes Smaller Than 4 AWG: Copper.
 - 2. For Sizes 4 AWG and Larger: Copper.
- C. Insulation Voltage Rating: 600 volts.
- D. Insulation Temperature Rating: 90 degrees C.
- E. Insulation Material: Thermoplastic.
- F. Armor Material: Steel.
- G. Armor Design: Interlocked metal tape.
- H. Jacket: PVC.

2.07 WIRING CONNECTORS

- A. Description: Wiring connectors appropriate for the application, suitable for use with the conductors to be connected, and listed as complying with UL 486A-486B or UL 486C as applicable.
- B. Twist-on Insulated Spring Connectors: Rated 600 V, 221 degrees F for standard applications and 302 degrees F for high temperature applications; pre-filled with sealant and listed as complying with UL 486D for damp and wet locations.
 - 1. Manufacturers:
 - a. 3M: www.3m.com.
 - b. Ideal Industries, Inc: www.idealindustries.com.
 - c. NSI Industries LLC: www.nsiindustries.com.
 - d. Substitutions: See Section 01 60 00 - Product Requirements.

2.08 WIRING ACCESSORIES

- A. Electrical Tape:
 - 1. Manufacturers:
 - a. 3M: www.3m.com.
 - b. Plymouth Rubber Europa: www.plymouthrubber.com.
 - c. Substitutions: See Section 01 60 00 - Product Requirements.
 - 2. Vinyl Color Coding Electrical Tape: Integrally colored to match color code indicated; listed as complying with UL 510; minimum thickness of 7 mil; resistant to abrasion, corrosion, and sunlight; suitable for continuous temperature environment up to 221 degrees F.
 - 3. Vinyl Insulating Electrical Tape: Complying with ASTM D3005 and listed as complying with UL 510; minimum thickness of 7 mil; resistant to abrasion, corrosion, and sunlight; conformable for application down to 0 degrees F and suitable for continuous temperature environment up to 221 degrees F.
- B. Wire Pulling Lubricant: Listed; suitable for use with the conductors or cables to be installed and suitable for use at the installation temperature.
 - 1. Manufacturers:
 - a. 3M: www.3m.com.

- b. American Polywater Corporation: www.polywater.com.
- c. Ideal Industries, Inc: www.idealindustries.com.
- C. Cable Ties: Material and tensile strength rating suitable for application.
- D. Split Bolt Connectors: Description: Connector suitable for copper to copper connection tested and listed to UL 486A requirements. Black burn type-H or equal.
 - 1. Product: Thomas R Betts or equal
 - 2. Substitutions: See Section 01 60 00 - Product Requirements.
- E. Spring Wire Connectors: Description: Flame retardant thermoplastic shell with plated steel square wire spring gated for 105 degrees C, 600 volts, Thomas and Betts fixed spring wire connectors or equal.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that interior of building has been protected from weather.
- B. Verify that work likely to damage wire and cable has been completed.
- C. Verify that raceways, boxes, and equipment enclosures are installed and are properly sized to accommodate conductors and cables in accordance with NFPA 70.
- D. Verify that raceway installation is complete and supported.
- E. Verify that field measurements are as shown on the drawings.
- F. Verify that conditions are satisfactory for installation prior to starting work.

3.02 PREPARATION

- A. Clean raceways thoroughly to remove foreign materials before installing conductors and cables.

3.03 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.
- B. Install conductors and cable in a neat and workmanlike manner in accordance with NECA 1.
- C. Install metal-clad cable (Type MC) in accordance with NECA 120.
- D. Installation in Raceway:
 - 1. Tape ends of conductors and cables to prevent infiltration of moisture and other contaminants.
 - 2. Pull all conductors and cables together into raceway at same time.
 - 3. Do not damage conductors and cables or exceed manufacturer's recommended maximum pulling tension and sidewall pressure.
 - 4. Use suitable wire pulling lubricant where necessary, except when lubricant is not recommended by the manufacturer.
- E. Paralleled Conductors: Install conductors of the same length and terminate in the same manner.
- F. Secure and support conductors and cables in accordance with NFPA 70 using suitable supports and methods approved by the authority having jurisdiction. Provide independent support from building structure. Do not provide support from raceways, piping, ductwork, or other systems.
- G. Terminate cables using suitable fittings.
 - 1. Metal-Clad Cable (Type MC):
 - a. Use listed fittings.
 - b. Cut cable armor only using specialized tools to prevent damaging conductors or insulation. Do not use hacksaw or wire cutters to cut armor.
- H. Install conductors with a minimum of 12 inches of slack at each outlet.

- I. Neatly train and bundle conductors inside boxes, wireways, panelboards and other equipment enclosures.
- J. Group or otherwise identify neutral/grounded conductors with associated ungrounded conductors inside enclosures in accordance with NFPA 70.
- K. Make wiring connections using specified wiring connectors.
 - 1. Make splices and taps only in accessible boxes. Do not pull splices into raceways or make splices in conduit bodies or wiring gutters.
 - 2. Remove appropriate amount of conductor insulation for making connections without cutting, nicking or damaging conductors.
 - 3. Do not remove conductor strands to facilitate insertion into connector.
 - 4. Clean contact surfaces on conductors and connectors to suitable remove corrosion, oxides, and other contaminants. Do not use wire brush on plated connector surfaces.
- L. Insulate splices and taps that are made with uninsulated connectors using methods suitable for the application, with insulation and mechanical strength at least equivalent to unspliced conductors.
- M. Insulate ends of spare conductors using vinyl insulating electrical tape.
- N. Field-Applied Color Coding: Where vinyl color coding electrical tape is used in lieu of integrally colored insulation as permitted in Part 2 under "Color Coding", apply half overlapping turns of tape at each termination and at each location conductors are accessible.
- O. Install firestopping to preserve fire resistance rating of partitions and other elements, using materials and methods specified in Section 07 84 00.
- P. Unless specifically indicated to be excluded, provide final connections to all equipment and devices, including those furnished by others, as required for a complete operating system.
- Q. Install wire and cable securely, in a neat and workmanlike manner, as specified in NECA 1.
- R. Route wire and cable as required to meet project conditions.
 - 1. Wire and cable routing indicated is approximate unless dimensioned.
 - 2. Where wire and cable destination is indicated and routing is not shown, determine exact routing and lengths required.
 - 3. Include wire and cable of lengths required to install connected devices within 10 ft of location shown.
- S. Use wiring methods indicated.
- T. Pull all conductors into raceway at same time.
- U. Use suitable wire pulling lubricant for building wire 4 AWG and larger.
- V. Protect exposed cable from damage.
- W. Support cables above accessible ceiling, using spring metal clips or metal cable ties to support cables from structure or ceiling suspension system. Do not rest cable on ceiling panels.
- X. Use suitable cable fittings and connectors.
- Y. Neatly train and lace wiring inside boxes, equipment, and panelboards.
- Z. Clean conductor surfaces before installing lugs and connectors.
- AA. Make splices, taps, and terminations to carry full ampacity of conductors with no perceptible temperature rise.
- AB. Use suitable reducing connectors or mechanical connector adaptors for connecting aluminum conductors to copper conductors.

- AC. Use split bolt connectors for copper conductor splices and taps, 6 AWG and larger. Tape uninsulated conductors and connector with electrical tape to 150 percent of insulation rating of conductor.
- AD. Use solderless pressure connectors with insulating covers for copper conductor splices and taps, 8 AWG and smaller.
- AE. Use insulated spring wire connectors with plastic caps for copper conductor splices and taps, 10 AWG and smaller.
- AF. Identify and color code wire and cable under provisions of Section 26 05 53. Identify each conductor with its circuit number or other designation indicated.

3.04 FIELD QUALITY CONTROL

- A. Perform inspection, testing, and adjusting in accordance with Section 01 45 00.
- B. Perform field inspection and testing in accordance with Section 01 45 00.
- C. Inspect and test in accordance with NETA ATS, except Section 4.
- D. Perform inspections and tests listed in NETA ATS, Section 7.3.2. The insulation resistance test is required for all conductors. The resistance test for parallel conductors listed as optional is not required.
- E. Correct deficiencies and replace damaged or defective conductors and cables.
- F. Perform inspections and tests listed in NETA STD ATS, Section 7.3.2.

END OF SECTION

SECTION 26 05 26

GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Grounding and bonding requirements.
- B. Conductors for grounding and bonding.
- C. Connectors for grounding and bonding.
- D. Grounding and bonding components.
- E. Provide all components necessary to complete the grounding system(s) consisting of:
 - 1. Existing metal underground water pipe.
 - 2. Metal frame of the building.
 - 3. Existing metal underground gas piping system.
 - 4. Metal underground gas piping system.

1.02 REFERENCE STANDARDS

- A. NECA 1 - Standard for Good Workmanship in Electrical Construction.
- B. NETA ATS - Acceptance Testing Specifications for Electrical Power Equipment and Systems.
- C. NETA STD ATS - Acceptance Testing Specifications for Electrical Power Distribution Equipment and Systems; International Electrical Testing Association.
- D. NFPA 70 - National Electrical Code.
- E. UL 467 - Grounding and Bonding Equipment.

1.03 PERFORMANCE REQUIREMENTS

- A. Grounding System Resistance: 25 ohms.

1.04 SUBMITTALS

- A. See Section 01 33 00 - Administrative Requirements for submittals procedures.
- B. Product Data: Provide for grounding electrodes and connections.
- C. Test Reports: Indicate overall resistance to ground and resistance of each electrode.
- D. Manufacturer's Instructions: Indicate application conditions and limitations of use stipulated by product testing agency. Include instructions for storage, handling, protection, examination, preparation, and installation of product.
- E. Project Record Documents: Record actual locations of components and grounding electrodes.

1.05 QUALITY ASSURANCE

- A. Conform to requirements of NFPA 70.

PART 2 PRODUCTS

2.01 GROUNDING AND BONDING REQUIREMENTS

- A. Do not use products for applications other than as permitted by NFPA 70 and product listing.
- B. Unless specifically indicated to be excluded, provide all required components, conductors, connectors, conduit, boxes, fittings, supports, accessories, etc. as necessary for a complete grounding and bonding system.
- C. Where conductor size is not indicated, size to comply with NFPA 70 but not less than applicable minimum size requirements specified.

2.02 GROUNDING AND BONDING COMPONENTS

- A. General Requirements:

Studio JAED Architects & Engineers

GROUNDING AND BONDING
FOR ELECTRICAL SYSTEMS

1. Provide products listed, classified, and labeled as suitable for the purpose intended.
2. Provide products listed and labeled as complying with UL 467 where applicable.
- B. Conductors for Grounding and Bonding, in addition to requirements of Section 26 05 19:
 1. Use insulated copper conductors unless otherwise indicated.
 - a. Exceptions:
 - 1) Use bare copper conductors where installed underground in direct contact with earth.
 - 2) Use bare copper conductors where directly encased in concrete (not in raceway).
- C. Connectors for Grounding and Bonding:
 1. Description: Connectors appropriate for the application and suitable for the conductors and items to be connected; listed and labeled as complying with UL 467.
 2. Unless otherwise indicated, use exothermic welded connections for underground, concealed and other inaccessible connections.
 3. Unless otherwise indicated, use mechanical connectors, compression connectors, or exothermic welded connections for accessible connections.

2.03 MANUFACTURERS

- A. Cooper Power Systems: www.cooperpower.com.
- B. Framatome Connectors International: www.fciconnect.com.
- C. Lightning Master Corporation: www.lightningmaster.com.
- D. Substitutions: See Section 01 60 00 - Product Requirements.

2.04 CONNECTORS AND ACCESSORIES

- A. Mechanical Connectors: Bronze.
 1. Product: manufactured by Thomas and Betts or equal.
 2. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Wire: Stranded copper.
- C. Grounding Electrode Conductor: Size to meet NFPA 70 requirements.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that work likely to damage grounding and bonding system components has been completed.
- B. Verify that field measurements are as shown on the drawings.
- C. Verify that conditions are satisfactory for installation prior to starting work.
- D. Verify existing conditions prior to beginning work.
- E. Verify that final backfill and compaction has been completed before driving rod electrodes.

3.02 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.
- B. Install grounding and bonding system components in a neat and workmanlike manner in accordance with NECA 1.
- C. Make grounding and bonding connections using specified connectors.
 1. Remove appropriate amount of conductor insulation for making connections without cutting, nicking or damaging conductors. Do not remove conductor strands to facilitate insertion into connector.
 2. Remove nonconductive paint, enamel, or similar coating at threads, contact points, and contact surfaces.

3. Exothermic Welds: Make connections using molds and weld material suitable for the items to be connected in accordance with manufacturer's recommendations.
 4. Mechanical Connectors: Secure connections according to manufacturer's recommended torque settings.
 5. Compression Connectors: Secure connections using manufacturer's recommended tools and dies.
- D. Identify grounding and bonding system components in accordance with Section 26 05 53.
 - E. Provide bonding to meet requirements described in Quality Assurance.
 - F. Equipment Grounding Conductor: Provide separate, insulated conductor within each feeder and branch circuit raceway. Terminate each end on suitable lug, bus, or bushing. Each of branch circuits and feeder circuits shall have dedicated equipment grounding conductor, sharing this conductor with other grounding conductors is not permitted.

3.03 FIELD QUALITY CONTROL

- A. Provide field inspection in accordance with Section 01 45 00.
- B. Inspect and test in accordance with NETA ATS except Section 4.
- C. Perform inspections and tests listed in NETA ATS, Section 7.13.
- D. Perform ground electrode resistance tests under normally dry conditions. Precipitation within the previous 48 hours does not constitute normally dry conditions.
- E. Investigate and correct deficiencies where measured ground resistances do not comply with specified requirements.

END OF SECTION

SECTION 26 05 29

HANGERS AND SUPPORTS FOR ELECTRICAL SYSTEMS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Support and attachment components for equipment, conduit, cable, boxes, and other electrical work.

1.02 REFERENCE STANDARDS

- A. ASTM A153/A153M - Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware.
- B. MFMA-4 - Metal Framing Standards Publication.
- C. NECA 1 - Standard for Good Workmanship in Electrical Construction.
- D. NFPA 70 - National Electrical Code.

1.03 SUBMITTALS

- A. See Section 01 33 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide manufacturer's catalog data for fastening systems.
- C. Manufacturer's Instructions: Indicate application conditions and limitations of use stipulated by product testing agency. Include instructions for storage, handling, protection, examination, preparation, and installation of product.

1.04 QUALITY ASSURANCE

- A. Comply with NFPA 70.
- B. Comply with applicable building code.

PART 2 PRODUCTS

2.01 SUPPORT AND ATTACHMENT COMPONENTS

- A. General Requirements:
 - 1. Provide all required hangers, supports, anchors, fasteners, fittings, accessories, and hardware as necessary for the complete installation of electrical work.
 - 2. Provide products listed, classified, and labeled as suitable for the purpose intended, where applicable.
 - 3. Where support and attachment component types and sizes are not indicated, select in accordance with manufacturer's application criteria as required for the load to be supported with a minimum safety factor of _____. Include consideration for vibration, equipment operation, and shock loads where applicable.
 - 4. Do not use products for applications other than as permitted by NFPA 70 and product listing.
 - 5. Steel Components: Use corrosion resistant materials suitable for the environment where installed.
 - a. Zinc-Plated Steel: Electroplated in accordance with ASTM B633.
 - b. Galvanized Steel: Hot-dip galvanized after fabrication in accordance with ASTM A123/A123M or ASTM A153/A153M.
- B. Conduit and Cable Supports: Straps, clamps, etc. suitable for the conduit or cable to be supported.
 - 1. Conduit Straps: One-hole or two-hole type; steel or malleable iron.
 - 2. Conduit Clamps: Bolted type unless otherwise indicated.
- C. Outlet Box Supports: Hangers, brackets, etc. suitable for the boxes to be supported.

- D. Metal Channel (Strut) Framing Systems: Factory-fabricated continuous-slot metal channel (strut) and associated fittings, accessories, and hardware required for field-assembly of supports.
 - 1. Comply with MFMA-4.
- E. Hanger Rods: Threaded zinc-plated steel unless otherwise indicated.
- F. Anchors and Fasteners:
 - 1. Unless otherwise indicated and where not otherwise restricted, use the anchor and fastener types indicated for the specified applications.

2.02 MANUFACTURERS

- A. Thomas & Betts Corporation: www.tnb.com.
- B. Threaded Rod Company: www.threadedrod.com.
- C. Substitutions: See Section 01 60 00 - Product Requirements.

2.03 MATERIALS

- A. Hangers, Supports, Anchors, and Fasteners - General: Corrosion-resistant materials of size and type adequate to carry the loads of equipment and conduit, including weight of wire in conduit.
- B. Supports: Fabricated of structural steel or formed steel members; galvanized.
- C. Anchors and Fasteners:
 - 1. Do not use powder-actuated anchors.
 - 2. Obtain permission from Architect before using powder-actuated anchors.
 - 3. Concrete Structural Elements: Use precast inserts.
 - 4. Steel Structural Elements: Use beam clamps.
 - 5. Concrete Surfaces: Use self-drilling anchors or expansion anchors.
 - 6. Hollow Masonry, Plaster, and Gypsum Board Partitions: Use hollow wall fasteners.
 - 7. Solid Masonry Walls: Use expansion anchors.
 - 8. Sheet Metal: Use sheet metal screws.
 - 9. Wood Elements: Use wood screws.
- D. Formed Steel Channel:
 - 1. Product: manufactured by [B-Line].
 - 2. Substitutions: See Section 01 60 00 - Product Requirements.

PART 3 EXECUTION

3.01 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.
- B. Install support and attachment components in a neat and workmanlike manner in accordance with NECA 1.
- C. Provide independent support from building structure. Do not provide support from piping, ductwork, or other systems.
- D. Unless specifically indicated or approved by Architect, do not provide support from suspended ceiling support system or ceiling grid.
- E. Unless specifically indicated or approved by Architect, do not provide support from roof deck.
- F. Do not penetrate or otherwise notch or cut structural members without approval of Structural Engineer.
- G. Equipment Support and Attachment:
 - 1. Use metal fabricated supports or supports assembled from metal channel (strut) to support equipment as required.

2. Use metal channel (strut) secured to studs to support equipment surface-mounted on hollow stud walls when wall strength is not sufficient to resist pull-out.
 3. Use metal channel (strut) to support surface-mounted equipment in wet or damp locations to provide space between equipment and mounting surface.
 4. Securely fasten floor-mounted equipment. Do not install equipment such that it relies on its own weight for support.
- H. Secure fasteners according to manufacturer's recommended torque settings.
- I. Remove temporary supports.

END OF SECTION

SECTION 26 05 34
CONDUIT

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Flexible metal conduit (FMC).
- B. Liquidtight flexible metal conduit (LFMC).
- C. Electrical metallic tubing (EMT).
- D. Conduit fittings.
- E. Conduit, fittings and conduit bodies.

1.02 RELATED REQUIREMENTS

- A. Section 07 84 00 - Firestopping.
- B. Section 26 05 26 - Grounding and Bonding for Electrical Systems.
- C. Section 26 05 29 - Hangers and Supports for Electrical Systems.
- D. Section 26 05 53 - Identification for Electrical Systems.
- E. Section 26 05 37 - Boxes.

1.03 REFERENCE STANDARDS

- A. ANSI C80.1 - American National Standard for Electrical Rigid Steel Conduit (ERSC).
- B. ANSI C80.3 - American National Standard for Steel Electrical Metallic Tubing (EMT).
- C. ANSI C80.5 - American National Standard for Electrical Rigid Aluminum Conduit (ERAC).
- D. NECA 1 - Standard for Good Workmanship in Electrical Construction.
- E. NECA 101 - Standard for Installing Steel Conduits (Rigid, IMC, EMT).
- F. NEMA FB 1 - Fittings, Cast Metal Boxes, and Conduit Bodies for Conduit, Electrical Metallic Tubing, and Cable.
- G. UL 1 - Flexible Metal Conduit.
- H. UL 360 - Liquid-Tight Flexible Steel Conduit.
- I. UL 514B - Conduit, Tubing, and Cable Fittings.
- J. UL 797 - Electrical Metallic Tubing-Steel.

1.04 SUBMITTALS

- A. See Section 01 33 00 - Administrative Requirements for submittals procedures.
- B. Product Data: Provide for metallic conduit and flexible metal conduit.
- C. Samples of Materials Actually Delivered to Site:
 - 1. Two pieces each of conduit, 2 feet long.
- D. Project Record Documents: Accurately record actual routing of conduits larger than 2 inches.

1.05 QUALITY ASSURANCE

- A. Conform to requirements of NFPA 70.
- B. Products: Listed and classified by Underwriters Laboratories Inc. as suitable for purpose specified and shown.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. Receive, inspect, handle, and store conduit and fittings in accordance with manufacturer's instructions.

- B. Accept conduit on site. Inspect for damage.
- C. Protect conduit from corrosion and entrance of debris by storing above grade. Provide appropriate covering.
- D. Protect PVC conduit from sunlight.

PART 2 PRODUCTS

2.01 CONDUIT REQUIREMENTS

- A. Provide all conduit, fittings, supports, and accessories required for a complete raceway system.
- B. Provide products listed, classified, and labeled as suitable for the purpose intended.
- C. Where conduit size is not indicated, size to comply with NFPA 70 but not less than applicable minimum size requirements specified.

2.02 METAL CONDUIT

- A. Manufacturers:
 - 1. Allied Tube & Conduit: www.alliedtube.com.
 - 2. Beck Manufacturing, Inc: www.beckmfg.com.
 - 3. Wheatland Tube Company: www.wheatland.com.
 - 4. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Rigid Steel Conduit: ANSI C80.1.
- C. Fittings and Conduit Bodies: NEMA FB 1; material to match conduit.

2.03 FLEXIBLE METAL CONDUIT (FMC)

- A. Manufacturers:
 - 1. AFC Cable Systems, Inc: www.afcweb.com.
 - 2. Electri-Flex Company: www.electriflex.com.
 - 3. International Metal Hose: www.metalhose.com.
 - 4. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Description: NFPA 70, Type FMC standard wall steel flexible metal conduit listed and labeled as complying with UL 1, and listed for use in classified firestop systems to be used.
- C. Fittings:
 - 1. Description: Fittings complying with NEMA FB 1 and listed and labeled as complying with UL 514B.
 - 2. Material: Use steel or malleable iron.
- D. Description: Interlocked steel construction.
- E. Fittings: NEMA FB 1.

2.04 LIQUIDTIGHT FLEXIBLE METAL CONDUIT (LFMC)

- A. Manufacturers:
 - 1. AFC Cable Systems, Inc: www.afcweb.com.
 - 2. Electri-Flex Company: www.electriflex.com.
 - 3. International Metal Hose: www.metalhose.com.
 - 4. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Description: NFPA 70, Type LFMC polyvinyl chloride (PVC) jacketed steel flexible metal conduit listed and labeled as complying with UL 360.
- C. Fittings:
 - 1. Description: Fittings complying with NEMA FB 1 and listed and labeled as complying with UL 514B.
 - 2. Material: Use steel or malleable iron.

- D. Description: Interlocked steel construction with PVC jacket.
- E. Fittings: NEMA FB 1.

2.05 ELECTRICAL METALLIC TUBING (EMT)

- A. Manufacturers:
 - 1. Allied Tube & Conduit: www.alliedeg.com.
 - 2. Beck Manufacturing, Inc: www.beckmfg.com.
 - 3. Wheatland Tube Company: www.wheatland.com.
- B. Description: NFPA 70, Type EMT steel electrical metallic tubing complying with ANSI C80.3 and listed and labeled as complying with UL 797.
- C. Fittings:
 - 1. Description: Fittings complying with NEMA FB 1 and listed and labeled as complying with UL 514B.
 - 2. Material: Use steel or malleable iron.
 - 3. Connectors and Couplings: Use compression (gland) or set-screw type.
 - a. Do not use indenter type connectors and couplings.
- D. Fittings and Conduit Bodies: NEMA FB 1; steel set screw type.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field measurements are as shown on drawings.
- B. Verify that mounting surfaces are ready to receive conduits.
- C. Verify that conditions are satisfactory for installation prior to starting work.
- D. Verify routing and termination locations of conduit prior to rough-in.
- E. Conduit routing is shown on drawings in approximate locations unless dimensioned. Route as required to complete wiring system.

3.02 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.
- B. Install conduit in a neat and workmanlike manner in accordance with NECA 1.
- C. Conduit Support:
 - 1. Secure and support conduits in accordance with NFPA 70 and Section 26 05 29 using suitable supports and methods approved by the authority having jurisdiction.
 - 2. Provide independent support from building structure. Do not provide support from piping, ductwork, or other systems.
- D. Connections and Terminations:
 - 1. Use suitable adapters where required to transition from one type of conduit to another.
 - 2. Provide drip loops for liquidtight flexible conduit connections to prevent drainage of liquid into connectors.
 - 3. Provide insulating bushings or insulated throats at all conduit terminations to protect conductors.
 - 4. Secure joints and connections to provide maximum mechanical strength and electrical continuity.
- E. Penetrations:
 - 1. Do not penetrate or otherwise notch or cut structural members, including footings and grade beams, without approval of Structural Engineer.
 - 2. Make penetrations perpendicular to surfaces unless otherwise indicated.

3. Provide sleeves for penetrations as indicated or as required to facilitate installation. Set sleeves flush with exposed surfaces unless otherwise indicated or required.
 4. Conceal bends for conduit risers emerging above ground.
 5. Seal interior of conduits entering the building from underground at first accessible point to prevent entry of moisture and gases.
 6. Where conduits penetrate waterproof membrane, seal as required to maintain integrity of membrane.
 7. Make penetrations for roof-mounted equipment within associated equipment openings and curbs where possible to minimize roofing system penetrations. Where penetrations are necessary, seal as indicated or as required to preserve integrity of roofing system and maintain roof warranty. Include proposed locations of penetrations and methods for sealing with submittals.
 8. Install firestopping to preserve fire resistance rating of partitions and other elements, using materials and methods specified in Section 07 84 00.
- F. Conduit Movement Provisions: Where conduits are subject to movement, provide expansion and expansion/deflection fittings to prevent damage to enclosed conductors or connected equipment. This includes, but is not limited to:
1. Where conduits cross structural joints intended for expansion, contraction, or deflection.
 2. Where conduits are subject to earth movement by settlement or frost.
- G. Condensation Prevention: Where conduits cross barriers between areas of potential substantial temperature differential, provide sealing fitting or approved sealing compound at an accessible point near the penetration to prevent condensation. This includes, but is not limited to:
1. Where conduits pass from outdoors into conditioned interior spaces.
 2. Where conduits pass from unconditioned interior spaces into conditioned interior spaces.
- H. Provide grounding and bonding in accordance with Section 26 05 26.

3.03 INTERFACE WITH OTHER PRODUCTS

- A. Install conduit to preserve fire resistance rating of partitions and other elements, using materials and methods specified in Section 07 84 00.
- B. Route conduit through roof openings for piping and ductwork wherever possible. Where separate roofing penetration is required, coordinate location and installation method with roofing installation specified in Section roofing section.

END OF SECTION

SECTION 26 05 37
BOXES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Outlet and device boxes up to 100 cubic inches, including those used as junction and pull boxes.
- B. Cabinets and enclosures, including junction and pull boxes larger than 100 cubic inches.
- C. Wall and ceiling outlet boxes.
- D. Floor boxes.
- E. Pull and junction boxes.

1.02 RELATED REQUIREMENTS

- A. Section 07 84 00 - Firestopping.
- B. Section 26 05 26 - Grounding and Bonding for Electrical Systems.
- C. Section 26 05 29 - Hangers and Supports for Electrical Systems.
- D. Section 26 05 53 - Identification for Electrical Systems: Identification products and requirements.
- E. Section 26 27 26 - Wiring Devices:
 - 1. Wall plates.
- F. Section 26 27 26 - Wiring Devices: Wall plates in finished areas, floor box service fittings, fire-rated poke-through fittings, and access floor boxes.

1.03 REFERENCE STANDARDS

- A. NECA 1 - Standard for Good Workmanship in Electrical Construction.
- B. NECA 130 - Standard for Installing and Maintaining Wiring Devices.
- C. NEMA FB 1 - Fittings, Cast Metal Boxes, and Conduit Bodies for Conduit, Electrical Metallic Tubing, and Cable.
- D. NEMA OS 1 - Sheet-Steel Outlet Boxes, Device Boxes, Covers, and Box Supports.
- E. NEMA OS 2 - Nonmetallic Outlet Boxes, Device Boxes, Covers and Box Supports.
- F. NEMA 250 - Enclosures for Electrical Equipment (1000 Volts Maximum).
- G. NFPA 70 - National Electrical Code.
- H. UL 50 - Enclosures for Electrical Equipment, Non-Environmental Considerations.
- I. UL 50E - Enclosures for Electrical Equipment, Environmental Considerations.
- J. UL 508A - Industrial Control Panels.
- K. UL 514A - Metallic Outlet Boxes.

1.04 SUBMITTALS

- A. See Section 01 33 00 - Administrative Requirements, for submittal procedures.
- B. Project Record Documents: Record actual locations and mounting heights of outlet, pull, and junction boxes on project record documents.

1.05 QUALITY ASSURANCE

- A. Conform to requirements of NFPA 70.

PART 2 PRODUCTS

2.01 BOXES

- A. General Requirements:
 - 1. Do not use boxes and associated accessories for applications other than as permitted by NFPA 70 and product listing.
 - 2. Provide all boxes, fittings, supports, and accessories required for a complete raceway system and to accommodate devices and equipment to be installed.
 - 3. Provide products listed, classified, and labeled as suitable for the purpose intended.
 - 4. Where box size is not indicated, size to comply with NFPA 70 but not less than applicable minimum size requirements specified.
 - 5. Provide grounding terminals within boxes where equipment grounding conductors terminate.
- B. Outlet and Device Boxes Up to 100 cubic inches, Including Those Used as Junction and Pull Boxes:
 - 1. Use sheet-steel boxes for dry locations unless otherwise indicated or required.
 - 2. Use cast iron boxes or cast aluminum boxes for damp or wet locations unless otherwise indicated or required; furnish with compatible weatherproof gasketed covers.
 - 3. Use suitable concrete type boxes where flush-mounted in concrete.
 - 4. Use suitable masonry type boxes where flush-mounted in masonry walls.
 - 5. Use raised covers suitable for the type of wall construction and device configuration where required.
 - 6. Use shallow boxes where required by the type of wall construction.
 - 7. Do not use "through-wall" boxes designed for access from both sides of wall.
 - 8. Sheet-Steel Boxes: Comply with NEMA OS 1, and list and label as complying with UL 514A.
 - 9. Cast Metal Boxes: Comply with NEMA FB 1, and list and label as complying with UL 514A; furnish with threaded hubs.
 - 10. Boxes for Supporting Luminaires and Ceiling Fans: Listed as suitable for the type and weight of load to be supported; furnished with fixture stud to accommodate mounting of luminaire where required.
 - 11. Boxes for Ganged Devices: Use multigang boxes of single-piece construction. Do not use field-connected gangable boxes.
 - 12. Wall Plates: Comply with Section 26 27 26.
- C. Cabinets and Enclosures, Including Junction and Pull Boxes Larger Than 100 cubic inches:
 - 1. Comply with NEMA 250, and list and label as complying with UL 50 and UL 50E, or UL 508A.
 - 2. NEMA 250 Environment Type, Unless Otherwise Indicated:
 - 3. Junction and Pull Boxes Larger Than 100 cubic inches:
 - a. Provide screw-cover or hinged-cover enclosures unless otherwise indicated.

2.02 MANUFACTURERS

- A. Appleton Electric: www.appletonelec.com.
- B. Arc-Co./Division of Arcade Technology: www.arc-co.com.
- C. Unity Manufacturing: www.unitymfg.com.
- D. Substitutions: Reco, Inc. See Section 01 60 00 - Product Requirements.
- E. Steelcity

2.03 OUTLET BOXES

- A. Sheet Metal Outlet Boxes: NEMA OS 1, galvanized steel.

1. Luminaire and Equipment Supporting Boxes: Rated for weight of equipment supported; include 1/2 inch male fixture studs where required.
2. Concrete Ceiling Boxes: Concrete type.
- B. Nonmetallic Outlet Boxes: NEMA OS 2.
- C. Cast Boxes: NEMA FB 1, Type FD, aluminum. Provide gasketed cover by box manufacturer. Provide threaded hubs.
- D. Wall Plates for Finished Areas: As specified in Section 26 27 26.

2.04 PULL AND JUNCTION BOXES

- A. Sheet Metal Boxes: NEMA OS 1, galvanized steel.
- B. Surface Mounted Cast Metal Box: NEMA 250, Type 4; flat-flanged, surface mounted junction box:
 1. Material: Galvanized cast iron; Cast Aluminum.
 2. Cover: Furnish with ground flange, neoprene gasket, and stainless steel cover screws.
- C. In-Ground Cast Metal Box: NEMA 250, Type 6, outside flanged, recessed cover box for flush mounting:
 1. Material: Galvanized cast iron; Cast Aluminum.
 2. Cover: Nonskid cover with neoprene gasket and stainless steel cover screws.
 3. Cover Legend: "ELECTRIC".

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field measurements are as shown on drawings.
- B. Verify that mounting surfaces are ready to receive boxes.
- C. Verify that conditions are satisfactory for installation prior to starting work.
- D. Verify locations of floor boxes and outlets in offices and work areas prior to rough-in.

3.02 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.
- B. Perform work in a neat and workmanlike manner in accordance with NECA 1 and, where applicable, NECA 130, including mounting heights specified in those standards where mounting heights are not indicated.
- C. Arrange equipment to provide minimum clearances in accordance with manufacturer's instructions and NFPA 70.
- D. Box Supports:
 1. Secure and support boxes in accordance with NFPA 70 and Section 26 05 29 using suitable supports and methods approved by the authority having jurisdiction.
 2. Provide independent support from building structure except for cast metal boxes (other than boxes used for fixture support) supported by threaded conduit connections in accordance with NFPA 70. Do not provide support from piping, ductwork, or other systems.
- E. Install boxes plumb and level.
- F. Flush-Mounted Boxes:
 1. Install boxes in noncombustible materials such as concrete, tile, gypsum, plaster, etc. so that front edge of box or associated raised cover is not set back from finished surface more than 1/4 inch or does not project beyond finished surface.
 2. Install boxes in combustible materials such as wood so that front edge of box or associated raised cover is flush with finished surface.

3. Repair rough openings around boxes in noncombustible materials such as concrete, tile, gypsum, plaster, etc. so that there are no gaps or open spaces greater than 1/8 inch at the edge of the box.
- G. Install boxes as required to preserve insulation integrity.
- H. Install permanent barrier between ganged wiring devices when voltage between adjacent devices exceeds 300 V.
- I. Install firestopping to preserve fire resistance rating of partitions and other elements, using materials and methods specified in Section 07 84 00.
- J. Close unused box openings.
- K. Install blank wall plates on junction boxes and on outlet boxes with no devices or equipment installed or designated for future use.
- L. Provide grounding and bonding in accordance with Section 26 05 26.
- M. Install boxes securely, in a neat and workmanlike manner, as specified in NECA 1.
- N. Install in locations as shown on Drawings, and as required for splices, taps, wire pulling, equipment connections, and as required by NFPA 70.
- O. Coordinate installation of outlet boxes for equipment connected under Section 26 27 17.
- P. Set wall mounted boxes at elevations to accommodate mounting heights indicated.
- Q. Electrical boxes are shown on Drawings in approximate locations unless dimensioned.
 1. Adjust box locations up to 10 feet if required to accommodate intended purpose.
- R. Orient boxes to accommodate wiring devices oriented as specified in Section 26 27 26.
- S. Maintain headroom and present neat mechanical appearance.
- T. Install pull boxes and junction boxes above accessible ceilings and in unfinished areas only.
- U. Inaccessible Ceiling Areas: Install outlet and junction boxes no more than 6 inches from ceiling access panel or from removable recessed luminaire.
- V. Install boxes to preserve fire resistance rating of partitions and other elements, using materials and methods specified in Section 07 84 00.
- W. Coordinate mounting heights and locations of outlets mounted above counters, benches, and backsplashes.
- X. Locate outlet boxes to allow luminaires positioned as shown on reflected ceiling plan.
- Y. Align adjacent wall mounted outlet boxes for switches, thermostats, and similar devices.
- Z. Use flush mounting outlet box in finished areas.
- AA. Locate flush mounting box in masonry wall to require cutting of masonry unit corner only. Coordinate masonry cutting to achieve neat opening.
- AB. Do not install flush mounting box back-to-back in walls; provide minimum 6 inches separation. Provide minimum 24 inches separation in acoustic rated walls.
- AC. Secure flush mounting box to interior wall and partition studs. Accurately position to allow for surface finish thickness.
- AD. Use stamped steel bridges to fasten flush mounting outlet box between studs.
- AE. Install flush mounting box without damaging wall insulation or reducing its effectiveness.
- AF. Use adjustable steel channel fasteners for hung ceiling outlet box.
- AG. Do not fasten boxes to ceiling support wires.
- AH. Support boxes independently of conduit, except cast box that is connected to two rigid metal conduits both supported within 12 inches of box.

- AI. Use gang box where more than one device is mounted together. Do not use sectional box.
- AJ. Use gang box with plaster ring for single device outlets.
- AK. Use cast outlet box in exterior locations exposed to the weather and wet locations.
- AL. Use cast floor boxes for installations in slab on grade; formed steel boxes are acceptable for other installations.
- AM. Set floor boxes level.
- AN. Large Pull Boxes: Use hinged enclosure in interior dry locations, surface-mounted cast metal box in other locations.

3.03 ADJUSTING

- A. Adjust floor boxes flush with finish flooring material.
- B. Adjust flush-mounting outlets to make front flush with finished wall material.
- C. Install knockout closures in unused box openings.

3.04 CLEANING

- A. Clean interior of boxes to remove dirt, debris, plaster and other foreign material.

END OF SECTION

SECTION 26 05 53
IDENTIFICATION FOR ELECTRICAL SYSTEMS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Electrical identification requirements.
- B. Identification nameplates and labels.
- C. Wire and cable markers.
- D. Voltage markers.
- E. Warning signs and labels.
- F. Field-painted identification of conduit.

1.02 RELATED REQUIREMENTS

- A. Section 09 90 00 - Painting and Coating.
- B. Section 26 05 19 - LV Elec. Power Conductors and Cables (600V&Less): Color coding for power conductors and cables 600 V and less; vinyl color coding electrical tape.
- C. Section 26 27 26 - Wiring Devices: Device and wallplate finishes; factory pre-marked wallplates.

1.03 REFERENCE STANDARDS

- A. ANSI Z535.2 - American National Standard for Environmental and Facility Safety Signs.
- B. ANSI Z535.4 - American National Standard for Product Safety Signs and Labels.
- C. NFPA 70 - National Electrical Code.
- D. UL 969 - Marking and Labeling Systems.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Verify final designations for equipment, systems, and components to be identified prior to fabrication of identification products.
- B. Sequencing:
 - 1. Do not conceal items to be identified, in locations such as above suspended ceilings, until identification products have been installed.
 - 2. Do not install identification products until final surface finishes and painting are complete.

1.05 SUBMITTALS

- A. See Section 01 33 00 - Administrative Requirements for submittals procedures.
- B. Product Data: Provide catalog data for nameplates, labels, and markers.
- C. Manufacturer's Instructions: Indicate application conditions and limitations of use stipulated by product testing agency. Include instructions for storage, handling, protection, examination, preparation and installation of product.

1.06 QUALITY ASSURANCE

- A. Conform to requirements of NFPA 70.

1.07 EXTRA MATERIALS

- A. See Section 01 60 00 - Product Requirements for additional requirements.

PART 2 PRODUCTS

2.01 IDENTIFICATION REQUIREMENTS

- A. Existing Work: Unless specifically excluded, identify existing elements to remain that are not already identified in accordance with specified requirements.
- B. Identification for Equipment:
 - 1. Use identification nameplate to identify each piece of electrical distribution and control equipment and associated sections, compartments, and components.
 - a. Switchboards:
 - 1) Identify ampere rating.
 - 2) Identify voltage and phase.
 - 3) Identify power source and circuit number. Include location when not within sight of equipment.
 - 4) Use identification nameplate to identify main overcurrent protective device.
 - 5) Use identification nameplate to identify load(s) served for each branch device. Do not identify spares and spaces.
 - b. Motor Control Centers:
 - 1) Identify ampere rating.
 - 2) Identify voltage and phase.
 - 3) Identify power source and circuit number. Include location when not within sight of equipment.
 - 4) Use identification nameplate to identify main overcurrent protective device.
 - 5) Use identification nameplate to identify load(s) served for each branch device. Do not identify spares and spaces.
 - c. Panelboards:
 - 1) Identify ampere rating.
 - 2) Identify voltage and phase.
 - 3) Identify power source and circuit number. Include location when not within sight of equipment.
 - 4) Identify main overcurrent protective device. Use identification label for panelboards with a door. For power distribution panelboards without a door, use identification nameplate.
 - 5) Use typewritten circuit directory to identify load(s) served for panelboards with a door. Identify spares and spaces using pencil.
 - 6) For power panelboards without a door, use identification nameplate to identify load(s) served for each branch device. Do not identify spares and spaces.
 - d. Enclosed switches, circuit breakers, and motor controllers:
 - 1) Identify voltage and phase.
 - 2) Identify power source and circuit number. Include location when not within sight of equipment.
 - 3) Identify load(s) served. Include location when not within sight of equipment.
 - e. Enclosed Contactors:
 - 1) Identify ampere rating.
 - 2) Identify voltage and phase.
 - 3) Identify configuration, e.g., E.O.E.H. (electrically operated, electrically held) or E.O.M.H. (electrically operated, mechanically held).
 - 4) Identify coil voltage.
 - 5) Identify load(s) and associated circuits controlled. Include location.
 - f. Transfer Switches:
 - 1) Identify voltage and phase.

- 2) Identify power source and circuit number for both normal power source and standby power source. Include location when not within sight of equipment.
 2. Service Equipment:
 - a. Use identification nameplate to identify each service disconnecting means.
 - b. For buildings or structures supplied by more than one service, or any combination of branch circuits, feeders, and services, use identification nameplate or means of identification acceptable to authority having jurisdiction at each service disconnecting means to identify all other services, feeders, and branch circuits supplying that building or structure. Verify format and descriptions with authority having jurisdiction.
 - c. Use identification nameplate at each piece of service equipment to identify the available fault current and the date calculations were performed.
 3. Emergency System Equipment:
 - a. Use identification nameplate or voltage marker to identify emergency system equipment in accordance with NFPA 70.
 - b. Use identification nameplate at each piece of service equipment to identify type and location of on-site emergency power sources.
 4. Use identification nameplate to identify disconnect location for equipment with remote disconnecting means.
 5. Use identification label or handwritten text using indelible marker on inside of door at each fused switch to identify required NEMA fuse class and size.
- C. Identification for Conductors and Cables:
1. Color Coding for Power Conductors 600 V and Less: Comply with Section 26 05 19.
 2. Use identification nameplate or identification label to identify color code for ungrounded and grounded power conductors inside door or enclosure at each piece of feeder or branch-circuit distribution equipment when premises has feeders or branch circuits served by more than one nominal voltage system.
 3. Use wire and cable markers to identify circuit number or other designation indicated for power, control, and instrumentation conductors and cables at the following locations:
 - a. At each source and load connection.
 - b. Within boxes when more than one circuit is present.
 - c. Within equipment enclosures when conductors and cables enter or leave the enclosure.
- D. Identification for Raceways:
1. Use voltage markers to identify highest voltage present for accessible conduits at maximum intervals of 20 feet.
 2. Use voltage markers or color-coded bands to identify systems other than normal power system for accessible conduits at maximum intervals of 20 feet.
 - a. Color-Coded Bands: Use field-painting or vinyl color coding electrical tape to mark bands 3 inches wide.
 - 1) Color Code:
 - 2) Field-Painting: Comply with Section 09 90 00.
 - 3) Vinyl Color Coding Electrical Tape: Comply with Section 26 05 19.
 3. Use identification labels, handwritten text using indelible marker, or plastic marker tags to identify circuits enclosed for accessible conduits at wall penetrations, at floor penetrations, at roof penetrations, and at equipment terminations when source is not within sight.
- E. Identification for Boxes:
1. Use voltage markers to identify highest voltage present.
 2. Use voltage markers or color coded boxes to identify systems other than normal power system.
 - a. Color-Coded Boxes: Field-painted in accordance with Section 09 90 00 per the same color code used for raceways.

- 1) Emergency Power System: Red.
3. Use identification labels or handwritten text using indelible marker to identify circuits enclosed.
 - a. For exposed boxes in public areas, use only identification labels.
- F. Identification for Devices:
 1. Factory Pre-Marked Wallplates: Comply with Section 26 27 26.

2.02 MANUFACTURERS

- A. Brady Corporation: www.bradycorp.com.
- B. Seton Identification Products: www.seton.com/aec.
- C. HellermannTyton: www.hellermanntyton.com.
- D. Substitutions: See Section 01 60 00 - Product Requirements.

2.03 IDENTIFICATION NAMEPLATES AND LABELS

- A. Identification Nameplates:
 1. Manufacturers:
 - a. Brimar Industries, Inc: www.brimar.com.
 - b. Kolbi Pipe Marker Co: www.kolbipipemarkers.com.
 - c. Seton Identification Products: www.seton.com.
 - d. Substitutions: See Section 01 60 00 - Product Requirements.
 2. Materials:
 - a. Indoor Clean, Dry Locations: Use plastic nameplates.
 - b. Outdoor Locations: Use plastic, stainless steel, or aluminum nameplates suitable for exterior use.
 3. Plastic Nameplates: Two-layer or three-layer laminated acrylic or electrically non-conductive phenolic with beveled edges; minimum thickness of 1/16 inch; engraved text.
 - a. Exception: Provide minimum thickness of 1/8 inch when any dimension is greater than 4 inches.
 4. Stainless Steel Nameplates: Minimum thickness of 1/32 inch; engraved or laser-etched text.
 5. Aluminum Nameplates: Anodized; minimum thickness of 1/32 inch; engraved or laser-etched text.
 6. Mounting Holes for Mechanical Fasteners: Two, centered on sides for sizes up to 1 inch high; Four, located at corners for larger sizes.
- B. Identification Labels:
 1. Manufacturers:
 - a. Brady Corporation: www.bradyid.com.
 - b. Brother International Corporation: www.brother-usa.com.
 - c. Panduit Corp: www.panduit.com.
 - d. Substitutions: See Section 01 60 00 - Product Requirements.
 2. Materials: Use self-adhesive laminated plastic labels; UV, chemical, water, heat, and abrasion resistant.
 - a. Use only for indoor locations.
 3. Text: Use factory pre-printed or machine-printed text. Do not use handwritten text unless otherwise indicated.
- C. Format for General Information and Operating Instructions:
 1. Minimum Size: 1 inch by 2.5 inches.
 2. Legend: Include information or instructions indicated or as required for proper and safe operation and maintenance.

3. Text: All capitalized unless otherwise indicated.
 4. Minimum Text Height: 1/4 inch.
 5. Color: Black text on white background unless otherwise indicated.
- D. Format for Control Device Identification:
1. Minimum Size: 3/8 inch by 1.5 inches.
 2. Legend: Load controlled or other designation indicated.
 3. Text: All capitalized unless otherwise indicated.
 4. Minimum Text Height: 3/16 inch.
 5. Color: Black text on clear background.
- E. Nameplates: Engraved three-layer laminated plastic, black letters on white background.
- F. Locations:
1. Each electrical distribution and control equipment enclosure.
 2. Communication cabinets.
 3. Disconnect switches, and starters.
- G. Letter Size:
1. Use 1/8 inch letters for identifying individual equipment and loads.
 2. Use 1/4 inch letters for identifying grouped equipment and loads.

2.04 WIRE AND CABLE MARKERS

- A. Manufacturers:
1. Brady Corporation: www.bradyid.com.
 2. HellermannTyton: www.hellermanntyton.com.
 3. Panduit Corp: www.panduit.com.
 4. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Markers for Conductors and Cables: Use wrap-around self-adhesive vinyl cloth, wrap-around self-adhesive vinyl self-laminating, heat-shrink sleeve, plastic sleeve, plastic clip-on, or vinyl split sleeve type markers suitable for the conductor or cable to be identified.
- C. Markers for Conductor and Cable Bundles: Use plastic marker tags secured by nylon cable ties.
- D. Legend: Power source and circuit number or other designation indicated.
- E. Text: Use factory pre-printed or machine-printed text, all capitalized unless otherwise indicated.
- F. Minimum Text Height: 1/8 inch.
- G. Color: Black text on white background unless otherwise indicated.
- H. Description: split sleeve type wire markers.
- I. Locations: Each conductor at panelboard gutters, pull boxes, outlet boxes, and junction boxes each load connection.
- J. Legend:
1. Power and Lighting Circuits: Branch circuit or feeder number indicated on drawings.
 2. Control Circuits: Control wire number indicated on shop drawings.

2.05 VOLTAGE MARKERS

- A. Manufacturers: Panduit Corp
1. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Markers for Conduits: Use factory pre-printed self-adhesive vinyl, self-adhesive vinyl cloth, or vinyl snap-around type markers.
- C. Markers for Boxes and Equipment Enclosures: Use factory pre-printed self-adhesive vinyl or self-adhesive vinyl cloth type markers.

- D. Minimum Size:
 - 1. Markers for Equipment: 1 1/8 by 4 1/2 inches.
 - 2. Markers for Conduits: As recommended by manufacturer for conduit size to be identified.
 - 3. Markers for Pull Boxes: 1 1/8 by 4 1/2 inches.
 - 4. Markers for Junction Boxes: 1/2 by 2 1/4 inches.
- E. Legend:
 - 1. Markers for Voltage Identification: Highest voltage present.
 - 2. Markers for System Identification:
 - a. Emergency Power System: Text "EMERGENCY".
- F. Color: Black text on orange background unless otherwise indicated.
- G. Location: Furnish markers for each conduit longer than 6 feet.
- H. Spacing: 20 feet on center.
- I. Color:
 - 1. 480 Volt System: Brown.
 - 2. 208 Volt System: Yellow.
 - 3. Fire Alarm System: Red.
- J. Legend:
 - 1. 480 Volt System: brown.
 - 2. 208 Volt System: yellow.
 - 3. Fire Alarm System: red.

2.06 WARNING SIGNS AND LABELS

- A. Manufacturers:
 - 1. Brimar Industries, Inc: www.brimar.com.
 - 2. Clarion Safety Systems, LLC: www.clarionsafety.com.
 - 3. Seton Identification Products: www.seton.com.
 - 4. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Comply with ANSI Z535.2 or ANSI Z535.4 as applicable.
- C. Warning Signs:
 - 1. Materials:
 - a. Indoor Dry, Clean Locations: Use factory pre-printed rigid plastic or self-adhesive vinyl signs.
 - b. Outdoor Locations: Use factory pre-printed rigid aluminum signs.
 - 2. Rigid Signs: Provide four mounting holes at corners for mechanical fasteners.
 - 3. Minimum Size: 7 by 10 inches unless otherwise indicated.
- D. Warning Labels:
 - 1. Materials: Use factory pre-printed or machine-printed self-adhesive polyester or self-adhesive vinyl labels; UV, chemical, water, heat, and abrasion resistant; produced using materials recognized to UL 969.
 - a. Do not use labels designed to be completed using handwritten text.
 - b. Provide polyester overlamine to protect handwritten text.
 - 2. Machine-Printed Labels: Use thermal transfer process printing machines and accessories recommended by label manufacturer.
 - 3. Minimum Size: 2 by 4 inches unless otherwise indicated.

PART 3 EXECUTION

3.01 PREPARATION

- A. Clean surfaces to receive adhesive products according to manufacturer's instructions.

- B. Degrease and clean surfaces to receive nameplates and labels.

3.02 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.
- B. Install identification products to be plainly visible for examination, adjustment, servicing, and maintenance. Unless otherwise indicated, locate products as follows:
 - 1. Surface-Mounted Equipment: Enclosure front.
 - 2. Flush-Mounted Equipment: Inside of equipment door.
 - 3. Free-Standing Equipment: Enclosure front; also enclosure rear for equipment with rear access.
 - 4. Elevated Equipment: Legible from the floor or working platform.
 - 5. Branch Devices: Adjacent to device.
 - 6. Interior Components: Legible from the point of access.
 - 7. Conduits: Legible from the floor.
 - 8. Boxes: Outside face of cover.
 - 9. Conductors and Cables: Legible from the point of access.
 - 10. Devices: Outside face of cover.
- C. Install identification products centered, level, and parallel with lines of item being identified.
- D. Secure nameplates to exterior surfaces of enclosures using stainless steel screws and to interior surfaces using self-adhesive backing or epoxy cement.
- E. Install self-adhesive labels and markers to achieve maximum adhesion, with no bubbles or wrinkles and edges properly sealed.
- F. Secure rigid signs using stainless steel screws.
- G. Mark all handwritten text, where permitted, to be neat and legible.

END OF SECTION

SECTION 26 24 16
PANELBOARDS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Power distribution panelboards.
- B. Lighting and appliance panelboards.
- C. Overcurrent protective devices for panelboards.

1.02 RELATED REQUIREMENTS

- A. Section 26 05 26 - Grounding and Bonding for Electrical Systems.
- B. Section 26 05 29 - Hangers and Supports for Electrical Systems.
- C. Section 26 05 53 - Identification for Electrical Systems: Identification products and requirements.
- D. Section 26 28 13 - Fuses: Fuses for fusible switches and spare fuse cabinets.

1.03 REFERENCE STANDARDS

- A. FS W-C-375 - Circuit Breakers, Molded Case; Branch Circuit and Service; Federal Specification.
- B. NECA 1 - Standard for Good Workmanship in Electrical Construction.
- C. NECA 407 - Standard for Installing and Maintaining Panelboards.
- D. NEMA 250 - Enclosures for Electrical Equipment (1000 Volts Maximum).
- E. NEMA ICS 2 - Industrial Control and Systems Controllers, Contactors and Overload Relays Rated 600 Volts.
- F. NEMA KS 1 - Heavy Duty Enclosed and Dead-Front Switches (600 Volts Maximum).
- G. NEMA PB 1 - Panelboards.
- H. NEMA PB 1.1 - General Instructions for Proper Installation, Operation and Maintenance of Panelboards Rated 600 Volts or Less.
- I. NETA ATS - Acceptance Testing Specifications for Electrical Power Equipment and Systems.
- J. NFPA 70 - National Electrical Code.
- K. UL 50 - Enclosures for Electrical Equipment, Non-Environmental Considerations.
- L. UL 50E - Enclosures for Electrical Equipment, Environmental Considerations.
- M. UL 67 - Panelboards.
- N. UL 489 - Molded-Case Circuit Breakers, Molded-Case Switches and Circuit Breaker Enclosures.

1.04 SUBMITTALS

- A. See Section 01 33 00 - Administrative Requirements, for submittal procedures.
- B. Shop Drawings: Indicate outline and support point dimensions, voltage, main bus ampacity, overcurrent protective device arrangement and sizes, short circuit current ratings, conduit entry locations, conductor terminal information, and installed features and accessories.
- C. Manufacturer's Installation Instructions: Indicate application conditions and limitations of use stipulated by product testing agency. Include instructions for storage, handling, protection, examination, preparation, and installation of product.
- D. Project Record Documents: Record actual installed locations of panelboards and actual installed circuiting arrangements.

- E. Maintenance Data: Include information on replacement parts and recommended maintenance procedures and intervals.

1.05 QUALITY ASSURANCE

- A. Conform to requirements of NFPA 70.
- B. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum three years documented experience.

1.06 MAINTENANCE MATERIALS

- A. See Section 01 60 00 - Product Requirements, for additional provisions.
- B. Furnish two of each panelboard key.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Eaton Corporation; Cutler-Hammer Products: www.eaton.com.
- B. General Electric Company: www.geindustrial.com.
- C. Schneider Electric; Square D Products: www.schneider-electric.us.
- D. Substitutions: See Section 01 60 00 - Product Requirements.

2.02 PANELBOARDS - GENERAL REQUIREMENTS

- A. Provide products listed, classified, and labeled as suitable for the purpose intended.
- B. Unless otherwise indicated, provide products suitable for continuous operation under the following service conditions:
 - 1. Altitude: Less than 6,600 feet.
 - 2. Ambient Temperature:
 - a. Panelboards Containing Circuit Breakers: Between 23 degrees F and 104 degrees F.
- C. Short Circuit Current Rating:
- D. Mains: Configure for top or bottom incoming feed as indicated or as required for the installation.
- E. Branch Overcurrent Protective Devices: Replaceable without disturbing adjacent devices.
- F. Bussing: Sized in accordance with UL 67 temperature rise requirements.
 - 1. Provide solidly bonded equipment ground bus in each panelboard, with a suitable lug for each feeder and branch circuit equipment grounding conductor.
- G. Conductor Terminations: Suitable for use with the conductors to be installed.
- H. Enclosures: Comply with NEMA 250, and list and label as complying with UL 50 and UL 50E.
 - 1. Environment Type per NEMA 250: Unless otherwise indicated, as specified for the following installation locations:
 - 2. Boxes: Galvanized steel unless otherwise indicated.
 - a. Provide wiring gutters sized to accommodate the conductors to be installed.
 - 3. Fronts:
 - a. Fronts for Surface-Mounted Enclosures: Same dimensions as boxes.
 - b. Fronts for Flush-Mounted Enclosures: Overlap boxes on all sides to conceal rough opening.
 - 4. Lockable Doors: All locks keyed alike unless otherwise indicated.
- I. Future Provisions: Prepare all unused spaces for future installation of devices including bussing, connectors, mounting hardware and all other required provisions.

2.03 POWER DISTRIBUTION PANELBOARDS

- A. Description: Panelboards complying with NEMA PB 1, power and feeder distribution type, circuit breaker type, and listed and labeled as complying with UL 67; ratings, configurations and features as indicated on the drawings.
- B. Conductor Terminations:
 - 1. Main and Neutral Lug Material: Aluminum, suitable for terminating aluminum or copper conductors.
 - 2. Main and Neutral Lug Type: Mechanical.
- C. Bussing:
 - 1. Phase and Neutral Bus Material: Aluminum.
 - 2. Ground Bus Material: Aluminum.
- D. Circuit Breakers:
 - 1. Provide bolt-on type or plug-in type secured with locking mechanical restraints.
- E. Enclosures:
 - 1. Provide surface-mounted enclosures unless otherwise indicated.
- F. Manufacturers:
 - 1. SQ.D or Equal.
 - 2. Substitutions: See Section 01 60 00 - Product Requirements.
- G. Description: NEMA PB 1, circuit breaker type.
- H. Service Conditions:
 - 1. Altitude: 1000 feet.
 - 2. Temperature: 55 degrees F.
- I. Panelboard Bus: Copper, ratings as indicated. Provide copper ground bus in each panelboard.
- J. Minimum integrated short circuit rating: As indicated.
 - 1. 240 Volt Panelboards: 14,000 amperes rms symmetrical.
 - 2. 480 Volt Panelboards: 21,000 amperes rms symmetrical.
- K. Molded Case Circuit Breakers: With integral thermal and instantaneous magnetic trip in each pole; UL listed. For air conditioning equipment branch circuits provide circuit breakers UL listed as Type HACR.
- L. Molded Case Circuit Breakers with Current Limiters: With replaceable current limiting elements, in addition to integral thermal and instantaneous magnetic trip in each pole; UL listed.
- M. Current Limiting Molded Case Circuit Breakers: With integral thermal and instantaneous magnetic trip in each pole, coordinated with automatically resetting current limiting elements in each pole; UL listed. Interrupting rating 100,000 symmetrical amperes, let-through current and energy level less than permitted for same size Class RK-5 fuse.
- N. Circuit Breaker Accessories: Trip units and auxiliary switches as indicated.
- O. Enclosure: NEMA PB 1, Type 1, 5 3/4" deep, 20" wide, cabinet box. With continued hinge and lock.
- P. Cabinet Front: Surface type, fastened with , hinged door with flush lock, finished in manufacturer's standard gray enamel.

2.04 LIGHTING AND APPLIANCE PANELBOARDS

- A. Description: Panelboards complying with NEMA PB 1, lighting and appliance branch circuit type, circuit breaker type, and listed and labeled as complying with UL 67; ratings, configurations and features as indicated on the drawings.
- B. Conductor Terminations:

1. Main and Neutral Lug Material: Aluminum, suitable for terminating aluminum or copper conductors.
2. Main and Neutral Lug Type: Mechanical.
- C. Bussing:
 1. Phase Bus Connections: Arranged for sequential phasing of overcurrent protective devices.
 2. Phase and Neutral Bus Material: Aluminum.
 3. Ground Bus Material: Aluminum.
- D. Circuit Breakers: Thermal magnetic bolt-on type unless otherwise indicated.
- E. Enclosures:
 1. Provide surface-mounted or flush-mounted enclosures as indicated.
 2. Provide clear plastic circuit directory holder mounted on inside of door.
- F. Manufacturers:
 1. SQ.D or Equal.
 2. Substitutions: See Section 01 60 00 - Product Requirements.
- G. Description: NEMA PB1, circuit breaker type, lighting and appliance branch circuit panelboard.
- H. Panelboard Bus: Copper, ratings as indicated. Provide copper ground bus in each panelboard; provide insulated ground bus where scheduled.
- I. Minimum Integrated Short Circuit Rating: As indicated.
 1. 240 Volt Panelboards: 14,000 amperes rms symmetrical.
 2. 480 Volt Panelboards: 21,000 amperes rms symmetrical.
- J. Molded Case Circuit Breakers: Thermal magnetic trip circuit breakers, bolt-on type, with common trip handle for all poles; UL listed.
 1. Type SWD for lighting circuits.
 2. Type HACR for air conditioning equipment circuits.
 3. Class A ground fault interrupter circuit breakers where scheduled.
 4. Do not use tandem circuit breakers, or miniature circuit breakers.
- K. Current Limiting Molded Case Circuit Breakers: With integral thermal and instantaneous magnetic trip in each pole, coordinated with automatically resetting current limiting elements in each pole; UL listed. Interrupting rating 100,000 symmetrical amperes, let-through current and energy level less than permitted for same size Class RK-5 fuse.
- L. Enclosure: NEMA PB 1, Type 1.
- M. Cabinet Box: 6 inches deep, 20 inches wide for 240 volt and less panelboards, 20 inches wide for 480 volt panelboards.
- N. Cabinet Front: Flush or Surface cabinet front with concealed trim clamps, concealed hinge, metal directory frame, and flush lock all keyed alike. Finish in manufacturer's standard gray enamel.

2.05 OVERCURRENT PROTECTIVE DEVICES

- A. Molded Case Circuit Breakers:
 1. Description: Quick-make, quick-break, over center toggle, trip-free, trip-indicating circuit breakers listed and labeled as complying with UL 489, and complying with FS W-C-375 where applicable; ratings, configurations, and features as indicated on the drawings.
 2. Interrupting Capacity:
 - a. Provide circuit breakers with interrupting capacity as required to provide the short circuit current rating indicated, but not less than:
 - b. Fully Rated Systems: Provide circuit breakers with interrupting capacity not less than the short circuit current rating indicated.

3. Conductor Terminations:
 - a. Lug Material: Aluminum, suitable for terminating aluminum or copper conductors.
4. Thermal Magnetic Circuit Breakers: For each pole, furnish thermal inverse time tripping element for overload protection and magnetic instantaneous tripping element for short circuit protection.
5. Multi-Pole Circuit Breakers: Furnish with common trip for all poles.

PART 3 EXECUTION

3.01 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.
- B. Install panelboards securely, in a neat and workmanlike manner in accordance with NECA 1 (general workmanship), NECA 407 (panelboards), and NEMA PB 1.1.
- C. Arrange equipment to provide minimum clearances in accordance with manufacturer's instructions and NFPA 70.
- D. Provide required supports in accordance with Section 26 05 29.
- E. Install panelboards plumb.
- F. Install flush-mounted panelboards so that trims fit completely flush to wall with no gaps and rough opening completely covered.
- G. Mount panelboards such that the highest position of any operating handle for circuit breakers or switches does not exceed 79 inches above the floor or working platform.
- H. Provide minimum of six spare 1 inch trade size conduits out of each flush-mounted panelboard stubbed into accessible space above ceiling and below floor.
- I. Provide grounding and bonding in accordance with Section 26 05 26.
- J. Install all field-installed branch devices, components, and accessories.
- K. Install panelboards in accordance with NEMA PB 1.1 and NECA 1.
- L. Install panelboards plumb. Install recessed panelboards flush with wall finishes, where installed surface mounted secure or anchor panelboard to brick or cinder block wall.
- M. Height: 6 feet to top of panelboard; install panelboards taller than 6 feet with bottom no more than 4 inches above floor.
- N. Provide filler plates to cover unused spaces in panelboards.
- O. Provide computer-generated circuit directory for each lighting and appliance panelboard and each power distribution panelboard provided with a door, clearly and specifically indicating the loads served. Identify spares and spaces.
- P. Provide typed or neatly handwritten circuit directory for each branch circuit panelboard. Revise directory to reflect circuiting changes required to balance phase loads.
- Q. Provide identification nameplate for each panelboard in accordance with Section 26 05 53.
- R. Provide arc flash warning labels in accordance with NFPA 70.
- S. Provide spare conduits out of each recessed panelboard to an accessible location above ceiling. Identify each as SPARE.
 1. Minimum spare conduits: 5 empty 1 inch.
- T. Ground and bond panelboard enclosure according to Section 26 05 26.

3.02 FIELD QUALITY CONTROL

- A. Perform inspection, testing, and adjusting in accordance with Section 01 45 00.
- B. Inspect and test in accordance with NETA ATS, except Section 4.
- C. Correct deficiencies and replace damaged or defective panelboards or associated components.

- D. Perform inspections and tests listed in NETA STD ATS, Section 7.5 for switches, Section 7.6 for circuit breakers.

3.03 ADJUSTING

- A. Adjust tightness of mechanical and electrical connections to manufacturer's recommended torque settings.
- B. Adjust alignment of panelboard fronts.
- C. Load Balancing: For each panelboard, rearrange circuits such that the difference between each measured steady state phase load does not exceed 20 percent and adjust circuit directories accordingly. Maintain proper phasing for multi-wire branch circuits.

END OF SECTION

SECTION 26 27 17
EQUIPMENT WIRING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Electrical connections to equipment.

1.02 RELATED REQUIREMENTS

- A. Section 26 05 34 - Conduit.
- B. Section 26 05 19 - LV Elec. Power Conductors and Cables (600V&Less) (600 V and Less).
- C. Section 26 05 37 - Boxes.
- D. Section 26 27 26 - Wiring Devices.

1.03 REFERENCE STANDARDS

- A. NEMA WD 1 - General Color Requirements for Wiring Devices.
- B. NEMA WD 6 - Wiring Devices - Dimensional Specifications.
- C. NFPA 70 - National Electrical Code.

1.04 SUBMITTALS

- A. See Section 01 33 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide wiring device manufacturer's catalog information showing dimensions, configurations, and construction.
- C. Manufacturer's Instructions: Indicate application conditions and limitations of use stipulated by product testing agency. Include instructions for storage, handling, protection, examination, preparation, and installation of product.

1.05 QUALITY ASSURANCE

- A. Conform to requirements of NFPA 70.
- B. Products: Listed, classified, and labeled as suitable for the purpose intended.

1.06 COORDINATION

- A. Obtain and review shop drawings, product data, manufacturer's wiring diagrams, and manufacturer's instructions for equipment furnished under other sections.
- B. Determine connection locations and requirements.
- C. Sequence rough-in of electrical connections to coordinate with installation of equipment.
- D. Sequence electrical connections to coordinate with start-up of equipment.

PART 2 PRODUCTS

2.01 MATERIALS

- A. Cords and Caps: NEMA WD 6; match receptacle configuration at outlet provided for equipment.
 - 1. Colors: Conform to NEMA WD 1.
 - 2. Cord Construction: NFPA 70, Type SO, multiconductor flexible cord with identified equipment grounding conductor, suitable for use in damp locations.
 - 3. Size: Suitable for connected load of equipment, length of cord, and rating of branch circuit overcurrent protection.
 - 4. Product:
 - 5. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Disconnect Switches: As specified in Section and in individual equipment sections.

- C. Wiring Devices: As specified in Section 26 27 26.
- D. Flexible Conduit: As specified in Section 26 05 34.
- E. Wire and Cable: As specified in Section 26 05 19.
- F. Boxes: As specified in Section 26 05 37.

2.02 EQUIPMENT CONNECTIONS

- A. As required by equipment manufacturer.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that equipment is ready for electrical connection, wiring, and energization.

3.02 ELECTRICAL CONNECTIONS

- A. Make electrical connections in accordance with equipment manufacturer's instructions.
- B. Make conduit connections to equipment using flexible conduit. Use liquidtight flexible conduit with watertight connectors in damp or wet locations.
- C. Connect heat producing equipment using wire and cable with insulation suitable for temperatures encountered.
- D. Provide receptacle outlet to accommodate connection with attachment plug.
- E. Provide cord and cap where field-supplied attachment plug is required.
- F. Install suitable strain-relief clamps and fittings for cord connections at outlet boxes and equipment connection boxes.
- G. Install disconnect switches, controllers, control stations, and control devices to complete equipment wiring requirements.
- H. Install terminal block jumpers to complete equipment wiring requirements.
- I. Install interconnecting conduit and wiring between devices and equipment to complete equipment wiring requirements.
- J. Coolers and Freezers: Cut and seal conduit openings in freezer and cooler walls, floor, and ceilings.

END OF SECTION

SECTION 26 27 26
WIRING DEVICES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Wall switches.
- B. Receptacles.
- C. Wall plates.

1.02 RELATED REQUIREMENTS

- A. Section 26 05 37 - Boxes.

1.03 REFERENCE STANDARDS

- A. FS W-C-596 - Connector, Electrical, Power, General Specification for; Federal Specification.
- B. FS W-S-896 - Switches, Toggle (Toggle and Lock), Flush-mounted (General Specification); Federal Specification.
- C. NECA 1 - Standard for Good Workmanship in Electrical Construction.
- D. NECA 130 - Standard for Installing and Maintaining Wiring Devices.
- E. NEMA WD 1 - General Color Requirements for Wiring Devices.
- F. NEMA WD 6 - Wiring Devices - Dimensional Specifications.
- G. NFPA 70 - National Electrical Code.
- H. UL 20 - General-Use Snap Switches.
- I. UL 498 - Attachment Plugs and Receptacles.
- J. UL 514D - Cover Plates for Flush-Mounted Wiring Devices.

1.04 SUBMITTALS

- A. See Section 01 33 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide manufacturer's catalog information showing dimensions, colors, and configurations.
- C. Manufacturer's Installation Instructions: Indicate application conditions and limitations of use stipulated by product testing agency. Include instructions for storage, handling, protection, examination, preparation, and installation of product.

1.05 QUALITY ASSURANCE

- A. Conform to requirements of NFPA 70.
- B. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum three years documented experience.
- C. Products: Listed, classified, and labeled as suitable for the purpose intended.

1.06 EXTRA MATERIALS

- A. See Section 01 60 00 - Product Requirements, for additional provisions.
- B. Furnish two of each style, size, and finish wall plate.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Cooper Wiring Devices: www.cooperwiringdevices.com.
- B. Leviton Manufacturing, Inc: www.leviton.com.

- C. Substitutions: See Section 01 60 00 - Product Requirements.

2.02 ALL WIRING DEVICES

- A. Provide products listed and classified by Underwriters Laboratories Inc. as suitable for the purpose specified and indicated.

2.03 WALL SWITCHES

- A. All Wall Switches: AC only, quiet operating, general-use snap switches with silver alloy contacts, complying with NEMA WD 1 and NEMA WD 6, and listed as complying with UL 20 and where applicable, FS W-S-896; types as indicated on the drawings.
1. Wiring Provisions: Terminal screws for side wiring and screw actuated binding clamp for back wiring with separate ground terminal screw.
- B. Wall Switches: Heavy Duty, AC only general-use snap switch, complying with NEMA WD 6 and WD 1.
1. Body and Handle: White plastic with toggle handle.
 2. Ratings:
 - a. Voltage: 120 - 277 volts, AC.
 - b. Current: 20 amperes.
 3. Ratings: Match branch circuit and load characteristics.
- C. Switch Types: Single pole, double pole, 3-way, and 4-way.

2.04 RECEPTACLES

- A. All Receptacles: Self-grounding, complying with NEMA WD 1 and NEMA WD 6, and listed as complying with UL 498, and where applicable, FS W-C-596; types as indicated on the drawings.
1. Wiring Provisions: Terminal screws for side wiring or screw actuated binding clamp for back wiring with separate ground terminal screw.
 2. NEMA configurations specified are according to NEMA WD 6.
- B. Receptacles: Heavy duty, complying with NEMA WD 6 and WD 1.
1. Device Body: White plastic.
 2. Configuration: NEMA WD 6, type as specified and indicated.
- C. Convenience Receptacles: Type 5 - 20.
- D. Single Convenience Receptacles.
- E. Duplex Convenience Receptacles.
- F. GFCI Receptacles: Convenience receptacle with integral ground fault circuit interrupter to meet regulatory requirements.

2.05 TELEPHONE JACKS

- A. Product: AMP manufacturing
- B. Substitutions: See Section 01 60 00 - Product Requirements.

2.06 WALL PLATES

- A. All Wall Plates: Comply with UL 514D.
1. Configuration: One piece cover as required for quantity and types of corresponding wiring devices.
 2. Size: Standard.
 3. Screws: Metal with slotted heads finished to match wall plate finish.
- B. Decorative Cover Plates: stainless steel.
- C. Jumbo Cover Plates: stainless steel.
- D. Weatherproof Cover Plates: Gasketed cast metal with hinged cover.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field measurements are as shown on the drawings.
- B. Verify that outlet boxes are installed in proper locations and at proper mounting heights and are properly sized to accommodate devices and conductors in accordance with NFPA 70.
- C. Verify that wall openings are neatly cut and will be completely covered by wall plates.
- D. Verify that final surface finishes are complete, including painting.
- E. Verify that floor boxes are adjusted properly.
- F. Verify that branch circuit wiring installation is completed, tested, and ready for connection to wiring devices.
- G. Verify that openings in access floor are in proper locations.
- H. Verify that conditions are satisfactory for installation prior to starting work.

3.02 PREPARATION

- A. Provide extension rings to bring outlet boxes flush with finished surface.
- B. Clean dirt, debris, plaster, and other foreign materials from outlet boxes.

3.03 INSTALLATION

- A. Perform work in a neat and workmanlike manner in accordance with NECA 1 and, where applicable, NECA 130, including mounting heights specified in those standards unless otherwise indicated.
- B. Perform work in a neat and workmanlike manner in accordance with NECA 1, including mounting heights specified in that standard unless otherwise indicated.
- C. Coordinate locations of outlet boxes provided under Section 26 05 37 as required for installation of wiring devices provided under this section.
- D. Install wiring devices in accordance with manufacturer's instructions.
- E. Install permanent barrier between ganged wiring devices when voltage between adjacent devices exceeds 300 V.
- F. Where required, connect wiring devices using pigtails not less than 6 inches long. Do not connect more than one conductor to wiring device terminals.
- G. Connect wiring devices by wrapping conductor clockwise 3/4 turn around screw terminal and tightening to proper torque specified by the manufacturer. Where present, do not use push-in pressure terminals that do not rely on screw-actuated binding.
- H. Unless otherwise indicated, connect wiring device grounding terminal to branch circuit equipment grounding conductor and to outlet box with bonding jumper.
- I. Install securely, in a neat and workmanlike manner, as specified in NECA 1.
- J. Install wiring devices plumb and level with mounting yoke held rigidly in place.
- K. Install wall switches with OFF position down.
- L. Do not share neutral conductor on branch circuits utilizing wall dimmers.
- M. Install vertically mounted receptacles with grounding pole on top and horizontally mounted receptacles with grounding pole on left.
- N. Install wall plates to fit completely flush to wall with no gaps and rough opening completely covered without strain on wall plate. Repair or reinstall improperly installed outlet boxes or improperly sized rough openings. Do not use oversized wall plates in lieu of meeting this requirement.

- O. Install blank wall plates on junction boxes and on outlet boxes with no wiring devices installed or designated for future use.
- P. Install receptacles with grounding pole on top.
- Q. Connect wiring device grounding terminal to outlet box with bonding jumper.
- R. Install decorative plates on switch, receptacle, and blank outlets in finished areas.
- S. Connect wiring devices by wrapping conductor around screw terminal.
- T. Use jumbo size plates for outlets installed in masonry walls.
- U. Install galvanized steel plates on outlet boxes and junction boxes in unfinished areas, above accessible ceilings, and on surface mounted outlets.

3.04 INTERFACE WITH OTHER PRODUCTS

- A. Coordinate locations of outlet boxes provided under Section 26 05 37 to obtain mounting heights.
- B. Install wall switch 48 inches above finished floor.
- C. Install convenience receptacle 18 inches above finished floor.
- D. Install convenience receptacle 6 inches above backsplash of counter.
- E. Install telephone jack 18 inches above finished floor.
- F. Install telephone jack for side-reach wall telephone to position top of telephone at 54 inches above finished floor.
- G. Install telephone jack for forward-reach wall telephone to position top of telephone at 48 inches above finished floor.

3.05 FIELD QUALITY CONTROL

- A. Perform field inspection, testing, adjusting, and balancing in accordance with Section 01 45 00.
- B. Inspect each wiring device for damage and defects.
- C. Operate each wall switch, wall dimmer, and fan speed controller with circuit energized to verify proper operation.
- D. Operate each wall switch with circuit energized and verify proper operation.
- E. Verify that each receptacle device is energized.
- F. Test each receptacle to verify operation and proper polarity.
- G. Test each GFCI receptacle for proper tripping operation according to manufacturer's instructions.
- H. Correct wiring deficiencies and replace damaged or defective wiring devices.
- I. Verify that each telephone jack is properly connected and circuit is operational.

3.06 ADJUSTING

- A. Adjust devices and wall plates to be flush and level.

3.07 CLEANING

- A. Clean exposed surfaces to remove dirt, paint, or other foreign material and restore to match original factory finish.

END OF SECTION

SECTION 26 28 13

FUSES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Fuses.

1.02 REFERENCE STANDARDS

- A. NEMA FU 1 - Low Voltage Cartridge Fuses.
- B. NFPA 70 - National Electrical Code.
- C. UL 248-1 - Low-Voltage Fuses - Part 1: General Requirements.
- D. UL 248-4 - Low-Voltage Fuses - Part 4: Class CC Fuses.
- E. UL 248-12 - Low-Voltage Fuses - Part 12: Class R Fuses.

1.03 SUBMITTALS

- A. See Section 01 33 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide manufacturer's standard data sheets including voltage and current ratings, interrupting ratings, time-current curves, and current limitation curves.

1.04 QUALITY ASSURANCE

- A. Conform to requirements of NFPA 70.
- B. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum three years documented experience.
- C. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum three years documented experience and with service facilities within 100 miles of Project.
- D. Products: Listed and classified by Underwriters Laboratories Inc. as suitable for the purpose specified and indicated.

1.05 MAINTENANCE MATERIALS

- A. See Section 01 60 00 - Product Requirements, for additional provisions.
- B. Furnish two fuse pullers.
- C. Furnish three of each size and type fuse installed.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Cooper Bussmann, a division of Cooper Industries: www.cooperindustries.com.
- B. Mersen (formerly Ferraz Shawmut): ferrazshawmut.mersen.com.
- C. Littelfuse, Inc: www.littelfuse.com.
- D. Substitutions: See Section 01 60 00 - Product Requirements.

2.02 APPLICATIONS

- A. Service Entrance:
 - 1. Fusible Switches up to 600 Amperes: Class RK1, time-delay.
- B. Feeders:
 - 1. Fusible Switches up to 600 Amperes: Class RK1, time-delay.
- C. Individual Motor Branch Circuits: Class RK1, time-delay.
- D. Primary Protection for Control Transformers: Class CC, time-delay.

2.03 FUSES

- A. Provide products listed, classified, and labeled as suitable for the purpose intended.
- B. Unless specifically indicated to be excluded, provide fuses for all fusible equipment as required for a complete operating system.
- C. Provide fuses of the same type, rating, and manufacturer within the same switch.
- D. Comply with UL 248-1.
- E. Unless otherwise indicated, provide cartridge type fuses complying with NEMA FU 1, Class and ratings as indicated.
- F. Voltage Rating: Suitable for circuit voltage.
- G. Class R Fuses: Comply with UL 248-12.
 - 1. Class RK1, Time-Delay Fuses:
 - a. Products:
 - 1) BUSS MAN.
 - 2) COOPER.
 - 3) Substitutions: See Section 01 60 00 - Product Requirements.
- H. Class CC Fuses: Comply with UL 248-4.
 - 1. Class CC, Time-Delay Fuses:
 - a. Products:
 - 1) BUSSMAN.
 - 2) COOPER.
 - 3) Substitutions: See Section 01 60 00 - Product Requirements.
- I. Power Load Feeder Switches: Class RK1 (time delay).
- J. Motor Load Feeder Switches: Class RK1 (time delay).
- K. Other Feeder Switches: Class RK1 (time delay).
- L. General Purpose Branch Circuits: Class RK1 (time delay).
- M. Motor Branch Circuits: Class L time delay.
- N. Lighting Branch Circuits: Class G.

2.04 CLASS RK1 (TIME DELAY) FUSES

- A. Manufacturers:
 - 1. Bussman Corp.
 - 2. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Construction: Current limiting, dual-element fuse, 10 seconds minimum at 500% rated amps, with copper fuse element.

2.05 CLASS G FUSES

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that fuse ratings are consistent with circuit voltage and manufacturer's recommendations and nameplate data for equipment.
- B. Verify that mounting surfaces are ready to receive spare fuse cabinet.
- C. Verify that conditions are satisfactory for installation prior to starting work.

3.02 INSTALLATION

- A. Do not install fuses until circuits are ready to be energized.

- B. Install fuses with label oriented such that manufacturer, type, and size are easily read.

END OF SECTION

SECTION 26 28 18
ENCLOSED SWITCHES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Enclosed safety switches.
- B. Fusible switches.
- C. Nonfusible switches.

1.02 RELATED REQUIREMENTS

- A. Section 26 05 26 - Grounding and Bonding for Electrical Systems.
- B. Section 26 05 29 - Hangers and Supports for Electrical Systems.
- C. Section 26 05 53 - Identification for Electrical Systems: Identification products and requirements.
- D. Section 26 28 13 - Fuses.
- E. Section 26 29 13 - Enclosed Controllers: Manual motor controllers.

1.03 REFERENCE STANDARDS

- A. NECA 1 - Standard for Good Workmanship in Electrical Construction.
- B. NEMA 250 - Enclosures for Electrical Equipment (1000 Volts Maximum).
- C. NEMA FU 1 - Low Voltage Cartridge Fuses; National Electrical Manufacturers Association.
- D. NEMA KS 1 - Heavy Duty Enclosed and Dead-Front Switches (600 Volts Maximum).
- E. NETA ATS - Acceptance Testing Specifications for Electrical Power Equipment and Systems.
- F. NFPA 70 - National Electrical Code.
- G. UL 50 - Enclosures for Electrical Equipment, Non-Environmental Considerations.
- H. UL 50E - Enclosures for Electrical Equipment, Environmental Considerations.
- I. UL 98 - Enclosed and Dead-Front Switches.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Coordinate the work with other trades. Avoid placement of ductwork, piping, equipment, or other potential obstructions within the dedicated equipment spaces and within working clearances for electrical equipment required by NFPA 70.
 - 2. Coordinate arrangement of electrical equipment with the dimensions and clearance requirements of the actual equipment to be installed.
 - 3. Verify with manufacturer that conductor terminations are suitable for use with the conductors to be installed.
 - 4. Notify Architect of any conflicts with or deviations from the contract documents. Obtain direction before proceeding with work.

1.05 SUBMITTALS

- A. See Section 01 33 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide manufacturer's standard catalog pages and data sheets for enclosed switches and other installed components and accessories.
- C. Shop Drawings: Indicate outline and support point dimensions, voltage and current ratings, short circuit current ratings, conduit entry locations, conductor terminal information, and installed features and accessories.

- D. Manufacturer's Installation Instructions: Indicate application conditions and limitations of use stipulated by product testing agency. Include instructions for storage, handling, protection, examination, preparation, installation, and starting of product.
- E. Project Record Documents: Record actual locations of enclosed switches.
- F. Maintenance Data: Include information on replacement parts and recommended maintenance procedures and intervals.
- G. Maintenance Materials: Furnish the following for Owner's use in maintenance of project.
 - 1. See Section 01 60 00 - Product Requirements, for additional provisions.

1.06 QUALITY ASSURANCE

- A. Conform to requirements of NFPA 70.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. Store in a clean, dry space. Maintain factory wrapping or provide an additional heavy canvas or heavy plastic cover to protect units from dirt, water, construction debris, and traffic.
- B. Handle carefully in accordance with manufacturer's written instructions to avoid damage to enclosed switch internal components, enclosure, and finish.

1.08 FIELD CONDITIONS

- A. Maintain ambient temperature between 55 degree F and 75 degree F during and after installation of enclosed switches.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Siemens Industry, Inc: www.usa.siemens.com.
- B. Eaton Corporation; Cutler-Hammer Products; Model : www.eaton.com.
- C. General Electric Company; Model : www.geindustrial.com.
- D. Schneider Electric; Square D Products; Model : www.schneider-electric.us.
- E. Substitutions: See Section 01 60 00 - Product Requirements.
- F. Source Limitations: Furnish enclosed switches and associated components produced by the same manufacturer as the other electrical distribution equipment used for this project and obtained from a single supplier.

2.02 ENCLOSED SAFETY SWITCHES

- A. Description: Quick-make, quick-break enclosed safety switches listed and labeled as complying with UL 98; heavy duty; ratings, configurations, and features as indicated on the drawings.
- B. Provide products listed, classified, and labeled as suitable for the purpose intended.
- C. Unless otherwise indicated, provide products suitable for continuous operation under the following service conditions:
 - 1. Altitude: Less than 6,600 feet.
- D. Horsepower Rating: Suitable for connected load.
- E. Voltage Rating: Suitable for circuit voltage.
- F. Short Circuit Current Rating:
 - 1. Provide enclosed safety switches, when protected by the fuses or supply side overcurrent protective devices to be installed, with listed short circuit current rating not less than the available fault current at the installed location as indicated on the drawings.
- G. Provide with switch blade contact position that is visible when the cover is open.
- H. Fuse Clips for Fusible Switches: As required to accept fuses indicated.

1. Where NEMA Class R fuses are installed, provide rejection feature to prevent installation of fuses other than Class R.
- I. Conductor Terminations: Suitable for use with the conductors to be installed.
- J. Provide insulated, groundable fully rated solid neutral assembly where a neutral connection is required, with a suitable lug for terminating each neutral conductor.
- K. Provide solidly bonded equipment ground bus in each enclosed safety switch, with a suitable lug for terminating each equipment grounding conductor.
- L. Enclosures: Comply with NEMA 250, and list and label as complying with UL 50 and UL 50E.
 1. Environment Type per NEMA 250: Unless otherwise indicated, as specified for the following installation locations:
 - a. Indoor Clean, Dry Locations: Type 1.
 - b. Outdoor Locations: Type 3R.
- M. Provide safety interlock to prevent opening the cover with the switch in the ON position with capability of overriding interlock for testing purposes.
- N. Heavy Duty Switches:
 1. Products:
 - a. SQD.
 - b. SIEMENS.
 - c. GE.
 - d. Substitutions: See Section 01 60 00 - Product Requirements.
 2. Comply with NEMA KS 1.
 3. Conductor Terminations:
 - a. Provide mechanical lugs unless otherwise indicated.
 - b. Lug Material: Copper, suitable for terminating copper conductors only.
 4. Provide externally operable handle with means for locking in the OFF position, capable of accepting three padlocks.
 - a. Provide means for locking handle in the ON position where indicated.

2.03 COMPONENTS

- A. Fusible Switch Assemblies: NEMA KS 1, Type HD enclosed load interrupter knife switch.
 1. Externally operable handle interlocked to prevent opening front cover with switch in ON position.
 2. Handle lockable in OFF position.
 3. Fuse clips: Designed to accommodate NEMA FU1, Class R fuses.
- B. Nonfusible Switch Assemblies: NEMA KS 1, Type HD enclosed load interrupter knife switch.
 1. Externally operable handle interlocked to prevent opening front cover with switch in ON position.
 2. Handle lockable in OFF position.
- C. Enclosures: NEMA KS 1.
 1. Interior Dry Locations: Type 1.
 2. Exterior Locations: Type 3R.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field measurements are as shown on the drawings.
- B. Verify that the ratings of the enclosed switches are consistent with the indicated requirements.
- C. Verify that mounting surfaces are ready to receive enclosed safety switches.
- D. Verify that conditions are satisfactory for installation prior to starting work.

3.02 INSTALLATION

- A. Install enclosed switches in accordance with manufacturer's instructions.
- B. Install enclosed switches securely, in a neat and workmanlike manner in accordance with NECA 1.
- C. Arrange equipment to provide minimum clearances in accordance with manufacturer's instructions and NFPA 70.
- D. Provide required supports in accordance with Section 26 05 29.
- E. Install enclosed switches plumb.
- F. Except where indicated to be mounted adjacent to the equipment they supply, mount enclosed switches such that the highest position of the operating handle does not exceed 79 inches above the floor or working platform.
- G. Provide grounding and bonding in accordance with Section 26 05 26.
- H. Provide fuses complying with Section 26 28 13 for fusible switches as indicated or as required by equipment manufacturer's recommendations.
- I. Provide identification nameplate for each enclosed switch in accordance with Section 26 05 53.
- J. Provide arc flash warning labels in accordance with NFPA 70.
- K. Install fuses in fusible disconnect switches.
- L. Apply adhesive tag on inside door of each fused switch indicating NEMA fuse class and size installed.

3.03 FIELD QUALITY CONTROL

- A. Perform field inspection, testing, and adjusting in accordance with Section 01 40 00.
- B. Inspect and test in accordance with NETA ATS, except Section 4.
- C. Perform inspections and tests listed in NETA ATS, Section 7.5.1.1.
- D. Correct deficiencies and replace damaged or defective enclosed safety switches or associated components.

3.04 ADJUSTING

- A. Adjust tightness of mechanical and electrical connections to manufacturer's recommended torque settings.

3.05 CLEANING

- A. Clean dirt and debris from switch enclosures and components according to manufacturer's instructions.
- B. Repair scratched or marred exterior surfaces to match original factory finish.

END OF SECTION

SECTION 32 31 13
CHAIN LINK FENCES AND GATES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Fence framework, fabric, vinyl sprivacy slats, and accessories.
- B. Excavation and/or core drilling and grouting for post bases.
- C. Manual gates and related hardware.

1.02 RELATED REQUIREMENTS

- A. Section 03 30 00 - Cast-in-Place Concrete: Concrete anchorage for posts.

1.03 REFERENCE STANDARDS

- A. ASTM A121 - Standard Specification for Metallic-Coated Carbon Steel Barbed Wire.
- B. ASTM A123/A123M - Standard Specification for Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products.
- C. ASTM A153/A153M - Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware.
- D. ASTM A392 - Standard Specification for Zinc-Coated Steel Chain-Link Fence Fabric.
- E. ASTM A428/A428M - Standard Test Method for Weight (Mass) of Coating on Aluminum-Coated Iron or Steel Articles.
- F. ASTM A491 - Standard Specification for Aluminum-Coated Steel Chain-Link Fence Fabric.
- G. ASTM A653/A653M - Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process.
- H. ASTM A1011/A1011M - Standard Specification for Steel, Sheet and Strip, Hot-Rolled, Carbon, Structural, High-Strength Low-Alloy, High-Strength Low-Alloy with Improved Formability, and Ultra-High Strength.
- I. ASTM C94/C94M - Standard Specification for Ready-Mixed Concrete.
- J. ASTM F567 - Standard Practice for Installation of Chain-Link Fence.
- K. ASTM F1043 - Standard Specification for Strength and Protective Coatings on Steel Industrial Fence Framework.
- L. ASTM F1083 - Standard Specification for Pipe, Steel, Hot-Dipped Zinc-Coated (Galvanized) Welded, for Fence Structures.
- M. CLFMI CLF 2445 - Product Manual.

1.04 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide data on fabric, posts, accessories, fittings and hardware.
- C. Shop Drawings: Indicate plan layout, spacing of components, post foundation dimensions, hardware anchorage, and schedule of components.

1.05 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing products specified in this section, with not less than three years of documented experience.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Chain Link Fences and Gates:

Studio JAED Architects & Engineers

CHAIN LINK FENCES AND
GATES

1. Master-Halco, Inc.: www.fenceonline.com.
2. Merchants Metals: www.merchantsmetals.com.
3. Substitutions: See Section 01 60 00 - Product Requirements.

2.02 MATERIALS

- A. Posts, Rails, and Frames: ASTM F1083 Schedule 40 hot-dipped galvanized steel pipe, welded construction, minimum yield strength of 50 ksi for sizes NPS 5 and larger.
- B. Wire Fabric: ASTM A392 zinc coated steel chain link fabric.
- C. Concrete: Ready-mixed, complying with ASTM C94/C94M; normal Portland cement; 4,000 psi strength at 28 days, 3 inch slump; 5/8 inch aggregate.

2.03 COMPONENTS

- A. Line Posts: 2.38 inch diameter.
- B. Corner and Terminal Posts: 4.0 inch.
- C. Gate Posts: 4.5 inch diameter.
- D. Top and Brace Rail: 1.66 inch diameter, plain end, sleeve coupled.
- E. Gate Frame: 1.66 inch diameter for welded fabrication.
- F. Fabric: 2 inch diamond mesh interwoven wire, 6 gage thick, top selvage knuckle end closed, bottom selvage twisted tight.
- G. Tension Wire: 6 gage thick steel, single strand.

2.04 ACCESSORIES

- A. Caps: Cast steel galvanized; sized to post diameter, set screw retainer.
- B. Fittings: Sleeves, bands, clips, rail ends, tension bars, fasteners and fittings; steel.
- C. Hardware for Single Swinging Gates: 180 degree hinges, 4 for gates up to 120 high; fork latch with gravity drop and padlock hasp; keeper to hold gate in fully open position.
- D. Hardware for Double Swinging Gates: 180 degree hinges, 4 for gates up to 120 inches high; drop bolt on inactive leaf engaging socket stop set in concrete, active leaf latched to inactive leaf preventing raising of drop bolt, padlock hasp; keepers to hold gate in fully open position.
- E. Privacy Slats: Vinyl strips, sized to fit fabric weave.

2.05 FINISHES

- A. Accessories: Same finish as framing.

PART 3 EXECUTION

3.01 INSTALLATION

- A. Install framework, fabric, accessories and gates in accordance with ASTM F567.
- B. Place fabric on outside of posts and rails.
- C. Set intermediate posts plumb, in concrete footings with top of footing 2 inches above finish grade. Slope top of concrete for water runoff.
- D. Line Post Footing Depth Below Finish Grade: ASTM F567.
- E. Corner, Gate and Terminal Post Footing Depth Below Finish Grade: ASTM F567.
- F. Brace each gate and corner post to adjacent line post with horizontal center brace rail and diagonal truss rods. Install brace rail one bay from end and gate posts.
- G. Provide top rail through line post tops and splice with 6 inch long rail sleeves.
- H. Install center brace rail on corner gate leaves.
- I. Do not stretch fabric until concrete foundation has cured 28 days.

- J. Stretch fabric between terminal posts or at intervals of 100 feet maximum, whichever is less.
- K. Position bottom of fabric 2 inches above finished grade.
- L. Fasten fabric to top rail, line posts, braces, and bottom tension wire with tie wire at maximum 15 inches on centers.
- M. Attach fabric to end, corner, and gate posts with tension bars and tension bar clips.
- N. Install bottom tension wire stretched taut between terminal posts.
- O. Install support arms sloped inward and attach barbed wire; tension and secure.
- P. Do not attach the hinged side of gate to building wall; provide gate posts.
- Q. Install gate with fabric and barbed wire overhang to match fence. Install hardware.
- R. Provide concrete center drop to footing depth and drop rod retainers at center of double gate openings.
- S. Ground fence in accordance with Section 33 79 00.

3.02 TOLERANCES

- A. Maximum Variation From Plumb: 1/4 inch.
- B. Maximum Offset From True Position: 1 inch.

END OF SECTION

STATE OF DELAWARE
DEPARTMENT OF LABOR
DIVISION OF INDUSTRIAL AFFAIRS
OFFICE OF LABOR LAW ENFORCEMENT
PHONE: (302) 761-3300


Mailing Address:
4425 North Market St., 3rd Fl
Wilmington, DE 19802

Located at:
4425 North Market St., 3rd Fl
Wilmington, DE 19802

PREVAILING WAGES FOR **BUILDING CONSTRUCTION** EFFECTIVE MARCH 15, 2017

CLASSIFICATION	NEW CASTLE	KENT	SUSSEX
ASBESTOS WORKERS	22.86	28.16	40.98
BOILERMAKERS	68.44	34.72	51.05
BRICKLAYERS	51.99	51.99	51.99
CARPENTERS	53.81	53.81	42.77
CEMENT FINISHERS	72.28	46.71	22.17
ELECTRICAL LINE WORKERS	45.47	38.99	29.73
ELECTRICIANS	66.85	66.85	66.85
ELEVATOR CONSTRUCTORS	90.49	64.49	31.94
GLAZIERS	71.20	71.20	56.66
INSULATORS	55.48	55.48	55.48
IRON WORKERS	62.85	62.85	62.85
LABORERS	44.70	44.70	44.70
MILLWRIGHTS	69.18	69.18	55.75
PAINTERS	48.47	48.47	48.47
PILEDRIVERS	75.27	39.35	31.83
PLASTERERS	29.84	29.84	22.12
PLUMBERS/PIPEFITTERS/STEAMFITTERS	65.95	51.49	57.01
POWER EQUIPMENT OPERATORS	67.29	67.29	43.83
ROOFERS-COMPOSITION	24.01	23.70	21.64
ROOFERS-SHINGLE/SLATE/TILE	18.39	21.86	17.19
SHEET METAL WORKERS	67.03	67.03	67.03
SOFT FLOOR LAYERS	51.12	51.12	51.12
SPRINKLER FITTERS	57.29	57.29	57.29
TERRAZZO/MARBLE/TILE FNRS	57.72	57.72	47.51
TERRAZZO/MARBLE/TILE STRS	66.02	66.02	55.02
TRUCK DRIVERS	28.75	27.44	20.94

CERTIFIED: 01/10/2018

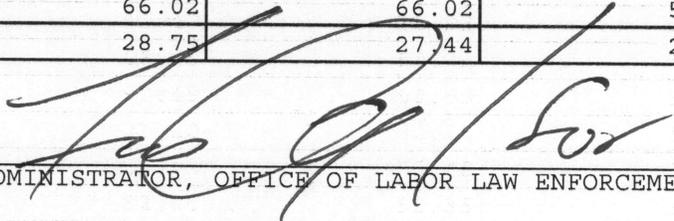
BY: 
ADMINISTRATOR, OFFICE OF LABOR LAW ENFORCEMENT

NOTE: THESE RATES ARE PROMULGATED AND ENFORCED PURSUANT TO THE PREVAILING WAGE REGULATIONS ADOPTED BY THE DEPARTMENT OF LABOR ON APRIL 3, 1992.

CLASSIFICATIONS OF WORKERS ARE DETERMINED BY THE DEPARTMENT OF LABOR. FOR ASSISTANCE IN CLASSIFYING WORKERS, OR FOR A COPY OF THE REGULATIONS OR CLASSIFICATIONS, PHONE (302) 451-3423.

NON-REGISTERED APPRENTICES MUST BE PAID THE MECHANIC'S RATE.

PROJECT: PC-16-048 Student Health Center Air Handling Unit Replacement, Kent County

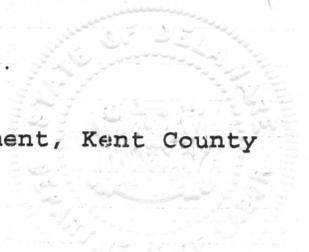

PREVAILING WAGE DEBARMENT LIST

The following contractors have been debarred for violations of the prevailing wage law 29Del.C. §6960 or other applicable State statutes.

Therefore, no public construction contract in this State shall be bid on, awarded to, or received by contractors and individuals on this list for a period of (3) three years from the date of the judgment or as deemed by a court of competent jurisdiction.

Contractor	Address	Date of Debarment
Mullen Brothers, Inc. and Daniel Mullen, individually	3375 Garnett Road, Boothwyn, PA 19060	Indefinite/ Civil Contempt
MMR Associates DBA Peninsula Glass and Michael Rooney, individually	679 Horse Pond Road, Dover, DE 19901	1/20/2015
Site Work Safety Supplies, Inc. and Peter Coker, individually	4020 Seven Hickories Road Dover, DE 19904	1/12/2016
Green Granite and Jason Green, individually	604 Heatherbrooke Court Avondale, PA 19311	Indefinite/ Civil Contempt
Pro Image Landscaping, Inc. and Owner(s) individually	23 Commerce Street Wilmington, DE 19801 and/or 2 Cameo Road Claymont, DE 19703	Indefinite/19 Del.C. §108 & 10 Del.C. 542(c)
Liberty Mechanical, LLC and Owner(s), individually	2032 Duncan Road Wilmington, DE 19801	Indefinite/ 19 Del.C. 2374(f)
Integrated Mechanical and Fire Systems Inc. and Allison Sheldon, individually	4601 Governor Printz Boulevard Wilmington, DE 19809	Indefinite/19 Del.C. §108 & 10 Del.C. 542(c)

Updated: May 11, 2017



To: DSU Facilities and Planning & Construction

From: Safety and Risk Management Department

RE: Procedure and Protocol Notice for placing any DSU Building on Test Mode

All internal and external contractors are required to do the following procedure when performing a project task in any DSU Building

- Call DSU Public Safety dispatch center (302-857-7911) and the Local Fire Department (302-736-7168) to notify the respected areas that work will be performed and have the **Building to be put on Test.**

In accordance with the State of Delaware fire prevention code Title 16, Chapter 66 -Any contractor doing work on DSU Campuses must make contact with the local fire dept. and DSU public safety to inform them that they will be site doing a project. They are also required to inform Public Safety when the project will be started and finished for building testing purposes each day.

Facilities Building



Student Health Center



RT13

Main Gate

Gate 3

College Road

