

11 April 2014

RE: IRSD
North Georgetown Elementary School
Georgetown, Delaware 19947

ADDENDUM NO. 2 NOTICE

NOTICE: The addendum to the project manual for this project has been uploaded to the project FTP site. It modifies and becomes a part of the contract documents. Work or materials not specifically mentioned herein are to be described in the main body of the specifications and as shown on the drawings. Bidders shall acknowledge receipt of this addendum on the space provided on the Bid Form. Failure to do so may subject the bidder to disqualification.

NOTICE: The time and location for the bid opening remains April 15, 2014 at 4:00 PM local time at the Indian River School District, District Office, 31 Hosier Street Selbyville, Delaware 19975.

ADDENDUM NO. 2
NORTH GEORGETOWN ELEMENTARY SCHOOL
Georgetown, Delaware 19947

April 11, 2014

NOTICE: Attach this addendum to the project manual for this project. It modifies and becomes a part of the contract documents. Work or materials not specifically mentioned herein are to be described in the main body of the specifications and as shown on the drawings. Bidders shall acknowledge receipt of this addendum on the space provided on the Bid Form. Failure to do so may subject the bidder to disqualification.

The time and location for the bid opening remains April 15, 2014 at 4:00 PM local time at the Indian River School District, District Office, 31 Hosier Street Selbyville, Delaware 19975.

Whenever this Addendum modifies a portion of the Project Manual added information is shown in **Bold/Italicized** and deleted information is shown as ~~strikethrough~~.

The contract documents for the above referenced project are amended as follows:

CLARIFICATIONS

1. All joints at cast stone, between units and from cast stone to other materials, shall be pointed with sealant, per 047200-3.2.E.
2. Joint between existing building and new Work shall be control joint.
3. Intent is that standing seam metal roofing, soffit, and associated fascia, gutters, and trim match existing.
4. Contract NGE-13 Electrical shall include all labor, materials and equipment for temporary electric service to the Construction Manager's field office.
5. Contract NGE-07 Acoustical Ceilings shall include in the base bid 40 hours of journeyman carpenter time for acoustical ceiling work to be directed by the Construction Manager.
6. Contract NGE-04 Carpentry and General Work shall include in the base bid temporary wood frames with reinforced poly for weather protection, in all of the window and door openings on the exterior elevations, until the windows and doors are ready to be installed. Remove and dispose of the temporary frames immediately prior to window and door installation. Provide temporary wood doors at the exterior doors, to include self-closing hardware and padlocks.
7. Contract NGE-04 Carpentry and General Work shall include in the base bid a temporary demising partition, seven feet in length, from the floor to the bottom chord of the roof truss. The partition shall be sound attenuated with insulation and sealed to ensure no migration of sound, dust or odors. Provide ½" drywall on both sides. Occupant side shall receive a level 4 finish. Remove and dispose of the temporary partition when directed by the Construction Manager.
8. Contract NGE-09 Painting shall include in the base bid painting of the occupant side of the temporary demising wall, color TBD.
9. Contract NGE-09 Painting shall include in the base bid painting of the new sprinkler main where it runs exposed in the gymnasium, color TBD.
10. Contract NGE-08 Flooring shall include in the base bid carpet tiles as shown on the Drawings.
11. Contract NGE-01 Sitework shall include in the base bid 600 linear feet of 6' high #9 gauge galvanized chain link fence, one double swing gates 6' high by 24' wide with top rail and bottom tension wire. The posts shall be installed in the ground. The exact location will be as directed by the Construction Manager. Maintain this work until Substantial Completion. At the end of the project, the Sitework Contractor shall remove the fence, patch

and repair the finished surfaces to a like-new condition.

12. All deliveries shall correspond to the construction schedule. No deliveries can be made prior to 9:00 AM, unless trucks can be unloaded and off site prior to 8:00 AM, due to student and staff arrivals. No deliveries can be made after 2:30 PM due to student and staff departures.

CHANGES TO PROJECT MANUAL

1. Section 000110 TABLE OF CONTENTS
 - a. REPLACE section with attached.
2. Section 000115 LIST OF DRAWINGS
 - a. DELETE this section.
3. Section 074113 Standing Seam Metal Roofing
 - a. REPLACE section with attached.
4. Section 081113 Hollow Metal Doors and Frames
 - a. REPLACE section with attached.
5. Section 081416 Flush Wood Doors
 - a. REPLACE section with attached.
6. Section 087100 Door Hardware
 - a. REPLACE section with attached.
7. Section 096813 Carpet Tile
 - a. ADD section.

CHANGES TO DRAWINGS

1. C-201 SITE & UTILITIES PLAN
 - a. ADD reinstalled light pole (refer to C-101) at center of new island at bus loop turnaround.
2. A100 OVERALL FIRST FLOOR PLAN AND ROOF PLAN
 - a. Detail 2, ADD devices RH-1 and RH-2, per M103, with the following note: "EQPT ON CURB – SEE MECH AND STRUCT; REFER TO DETAIL 2/A102".
 - b. ADD detail 4 per SKA-03.
3. A104 CASEWORK AND FINISH PLAN, FINISH SCHEDULE, AND FINISH LEGEND
 - a. Finish Schedule, REVISE floor finish at IDF 117A from CPT to VCT.
 - b. Finish Schedule Legend, REVISE spec reference for CPT-1 from 096816 to 096813.
4. A501 WALL TYPES AND MISCELLANEOUS DETAILS
 - a. ADD detail 8 "Typical Rated Partition Marking Detail", per SKA-01.

5. A601 DOOR SCHEDULE
 - a. REPLACE door schedule with attached, per SKA-02

6. M402 SCHEDULES - HVAC
 - a. REVISE "Energy Recover Wheel Module Schedule with Remote Fans" volts designation from "120" to "208".


7. E102A MEZZANINE PLAN – AREA A – ELECTRICAL – NEW WORK
 - a. REVISE branch circuit designation serving ERM-1 from P1A1-10 to P1A1-35,37.

8. E403 SCHEDULES - ELECTRICAL
 - a. Panelboard P1A1:
 - i. REVISE circuit breaker description #10 to read "Spare".
 - ii. REVISE circuit #35 & #37 designations and circuit descriptions from "1", "20", "Spare" (two (2) 1-pole circuit breakers) to "2", "15", "Energy Recovery Module (ERM-1)" (one (1) 2-pole circuit breaker)".

ATTACHMENTS


Section 000110
Section 074113
Section 081113
Section 081416
Section 087100
Section 096813
SKA-01, SKA-02, SKA-03, dated 4/9/2014

END OF ADDENDUM NO. 2

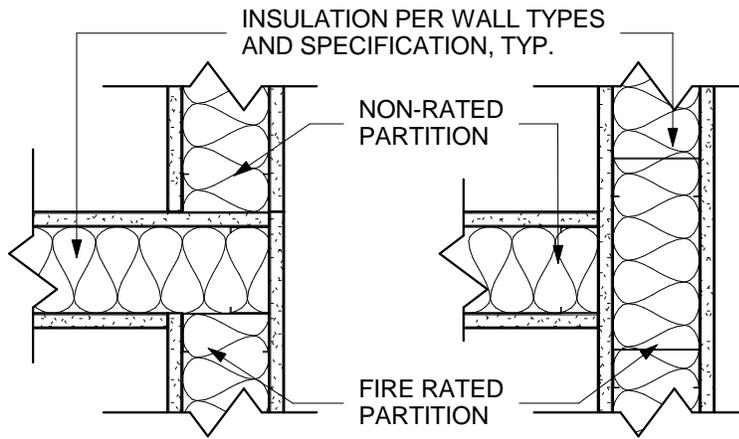


NOTE: SEE PLANS & WALL TYPES FOR TYPES & CONFIGURATION OF PARTITIONS AND SURROUNDING ELEMENTS

8A. TYPICAL FIRE RATED PARTITION INTERSECTION DETAILS

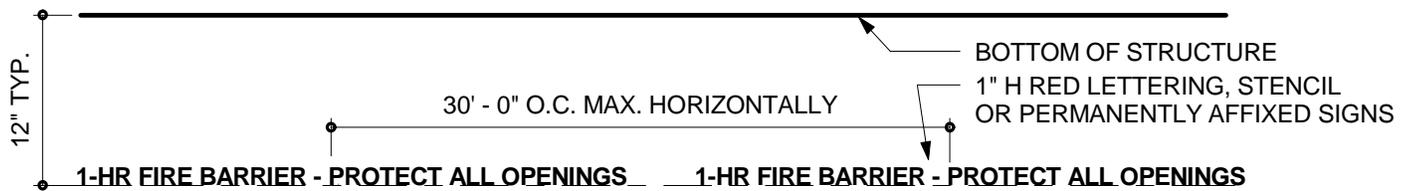

8B. MARKING OF RATED PARTITIONS AND WALLS AT EXPOSED STRUCTURE

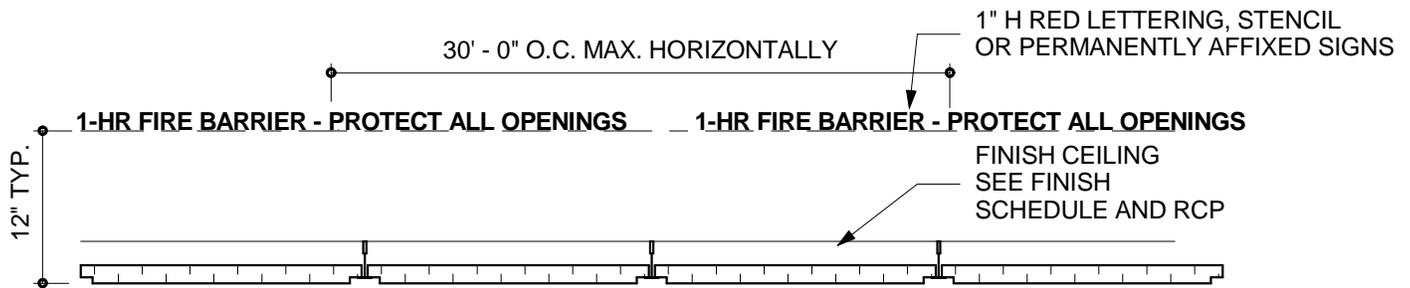

8C. MARKING OF RATED PARTITIONS AND WALLS AT FINISH CEILING

NOTE:

1. PROVIDE MARKING ON BOTH SIDES OF RATED WALLS AND PARTITIONS.
2. WHERE CHANGE IN WALL OR PARTITION DIRECTION OCCURS, MARK EACH SEGMENT INDIVIDUALLY.
3. LOCATE MARKINGS TO BE VISIBLE ABOVE CEILING.
4. LETTERING SHALL READ AS FOLLOWS:
 SMOKE PARTITION: " SMOKE PARTITION - PROTECT ALL OPENINGS "
 1-HR FIRE BARRIER: " 1-HR FIRE BARRIER - PROTECT ALL OPENINGS "
 2-HR FIRE WALL: " 2-HR FIRE WALL - PROTECT ALL OPENINGS "



Salisbury, MD
 312 West Main Street
 Suite 300
 Salisbury, MD 21801
 P: 410.546.9100
 F: 410.546.9100
 www.beckermorgan.com

NORTH GEORGETOWN ELEMENTARY

664 NORTH BEDFORD STREET
 GEORGETOWN, DELAWARE
 19947

TYPICAL RATED PARTITION MARKING DETAIL - 8/A501

PROJECT NO.:	2013157.00
DATE:	APRIL 9, 2014
SCALE:	1 1/2" = 1'-0"
DRAWN BY:	JML

SKA-01

DOOR SCHEDULE																	
MARK	DOOR							FRAME						FIRE RATING	HDWE SET	COMMENTS	
	SIZE			MATL	TYPE	FIN	GLAZ	UNDER CUT	MATL	TYPE	FIN	DETAIL					
	WIDTH	HT	THICK									HEAD	JAMB				SILL
107/1	3' - 0"	7' - 2"	1 3/4"	SCWD	B	SRO	1/4" Tempered		HM	HM-1	PT	H1	J1			4.0	
108/1	3' - 0"	7' - 2"	1 3/4"	SCWD	B	SRO	1/4" Tempered		HM	HM-1	PT	H1	J1			4.0	
109/1	3' - 0"	7' - 2"	1 3/4"	SCWD	B	SRO	1/4" Tempered		HM	HM-1	PT	H1	J1			4.0	
110/1	3' - 0"	7' - 2"	1 3/4"	SCWD	B	SRO	1/4" Tempered		HM	HM-1	PT	H1	J1			4.0	
111/1	3' - 0"	7' - 2"	1 3/4"	SCWD	B	SRO	1/4" Tempered		HM	HM-1	PT	H1	J1			4.0	
112/1	3' - 0"	7' - 2"	1 3/4"	SCWD	B	SRO	1/4" Tempered		HM	HM-1	PT	H1	J1			4.0	
113/1	3' - 0"	7' - 2"	1 3/4"	SCWD	B	SRO	1/4" Tempered		HM	HM-1	PT	H1	J1			4.0	
114/1	3' - 0"	7' - 2"	1 3/4"	SCWD	B	SRO	1/4" Tempered		HM	HM-1	PT	H1	J1			4.0	
115/1	6' - 0"	7' - 2"	1 3/4"	ALUM	D	Anodized	1" Insulated			AL-1	-	H2	J3	S2		6.0	PAIR DOOR, EXIT DEVICE
117/1	3' - 0"	7' - 2"	1 3/4"	SCWD	A	SRO			HM	HM-1	PT	H1	J1		45 minutes	1.0	
117A/1	3' - 0"	7' - 2"	1 3/4"	SCWD	A	SRO			HM	HM-1	PT	H1	J1		45 minutes	2.0	
118/1	6' - 0"	7' - 2"	1 3/4"	ALUM	D	Anodized	1" Insulated			AL-1	-	H2	J3	S1		6.0	PAIR DOOR, EXIT DEVICE
118/2	6' - 0"	7' - 2"	1 3/4"	HM	D	PT	1/4" Tempered		HM	HM-1	PT	H1	J3 SIM			5.0	PAIR DOOR
B114/1	3' - 0"	7' - 2"	1 3/4"	SCWD	A	SRO			HM	HM-1	PT	H1	J2	S1		3.0	


DOOR SCHEDULE - A601
PROJECT NO.: 2013157.00
DATE: APRIL 9, 2014
SCALE:
DRAWN BY: JML

NORTH GEORGETOWN ELEMENTARY

664 NORTH BEDFORD STREET
GEORGETOWN, DELAWARE
19947

BECKER MORGAN
ARCHITECTURE
ENGINEERING

Salisbury, MD
312 West Main Street
Suite 300
Salisbury, MD 21801
P: 410.5469100
F: 410.5469100
www.beckermorgan.com

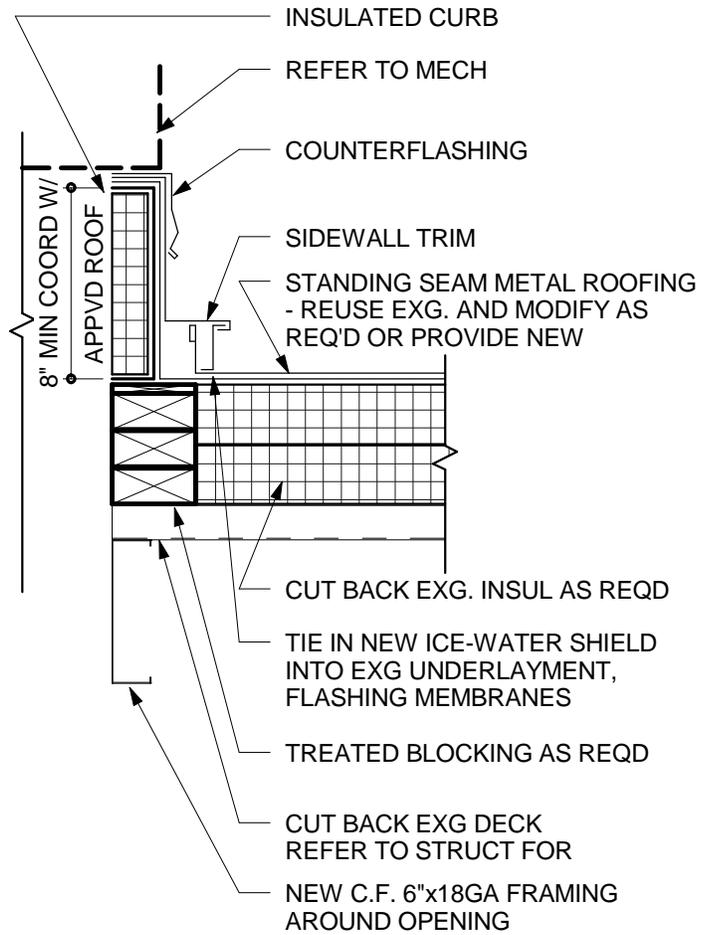

**BECKER
MORGAN**
GROUP
ARCHITECTURE
ENGINEERING

Salisbury, MD
312 West Main Street
Suite 300
Salisbury, MD 21801
P: 410.546.9100
F: 410.546.9100
www.beckermorgan.com

NORTH GEORGETOWN ELEMENTARY

664 NORTH BEDFORD STREET
GEORGETOWN, DELAWARE
19947

ROOF CURB DETAIL - 4/A100

PROJECT NO.:	2013157.00
DATE:	APRIL 9, 2014
SCALE:	1 1/2" = 1'-0"
DRAWN BY:	Author

SKA-03

**Indian River School District
Referendum 2013
North Georgetown Elementary School**

SECTION 000110 - TABLE OF CONTENTS

Volume 1

Division 0 - Procurement and Contract Requirements

000110	Table of Contents
000115	List of Drawings
001113	Advertisement for Bid
002113	Instructions to Bidders
003132	Geotechnical Data
004100	Bid Forms
005200	Agreement Forms
006113	Performance and Payment Bond Forms
006216	Certificate of Insurance
007200	General Conditions
007300	Supplementary Conditions
007343	Wage Rate Requirements

Division 1 - General Requirements

011100	Summary of Work - Work Covered by Contract Documents
012100	Allowances
012200	Unit Prices
012300	Alternates
012600	Change Order Procedures
012613	Contractor Compensation
012900	Payment Procedures
013113	Project Coordination Meetings
013119	Pre-installation Meetings
013125	Web-Based Project Management System
013216	Construction Progress Schedule
013219	Submittals Register
013226	Contractor Daily Reports
013300	Submittal Procedures
013500	Contractor Employee Background Check
013523	Safety Program
014500	Quality Control
015113	Temporary Electricity
015123	Temporary Heating, Cooling, and Ventilating
015200	Construction Facilities & Temporary Controls
016200	Material and Equipment
017123	Field Engineering [Include Survey & Layout Data]
017329	Cutting and Patching

**Indian River School District
Referendum 2013
North Georgetown Elementary School**

017700	Contract Closeout
019113	General Commissioning Requirements
019115	HVAC Commissioning Requirements
019116	Electrical Systems Commissioning Requirements

Division 02 - Existing Conditions

024119	Selective Demolition
--------	----------------------

Division 03 – Concrete

033000	Cast-In-Place Concrete
--------	------------------------

Division 04 – Masonry

042000	Unit Masonry
047200	Cast Stone Masonry

Division 05 – Metals

053100	Steel Decking
054400	Cold Formed Metal Trusses
055000	Metal Fabrications
055213	Pipe And Tube Railings

Division 06 - Wood, Plastics, And Composites

061000	Rough Carpentry
064023	Interior Architectural Woodwork

Division 07 - Thermal And Moisture Protection

072100	Thermal Insulation
072110	Insulating Air Barrier System
074113	Standing Seam Roof Panels
076200	Sheet Metal Flashing And Trim
077200	Roof Accessories
077253	Snow Guards
078413	Fire Protection, Hvac & Plumbing Penetration Firestopping
079200	Joint Sealants
079500	Expansion Control

Division 08 - Openings

081113	Hollow Metal Doors And Frames
--------	-------------------------------

**Indian River School District
Referendum 2013
North Georgetown Elementary School**

081416	Flush Wood Doors
084113	Aluminum-Framed Entrances And Storefronts
087100	Door Hardware
088000	Glazing
089000	Louvers And Vents

Division 09 – Finishes

092216	Non-Structural Metal Framing
092900	Gypsum Board
093000	Tiling
095113	Acoustical Panel Ceilings
096513	Resilient Base And Accessories
096519	Resilient Tile Flooring
096813	Carpet Tile
099113	Exterior Painting
099123	Interior Painting
099600	High Performance Coatings

Division 10 – Specialties

101100	Visual Display Units
101400	Signs
102800	Toilet, Bath And Laundry Accessories
104400	Fire Protection Specialties

Division 11 - Equipment

Not Applicable

Division 12 – Furnishings

122113	Horizontal Louver Blinds
123200	Institutional Casework

Division 13 – Special Construction

Not Applicable

Division 14 - Conveying Equipment

Not Applicable

Volume 2

Division 21 - Fire Protection

**Indian River School District
Referendum 2013
North Georgetown Elementary School**

210500	Common Work Results For Fire Protection
210505	Fire Protection Piping, Fittings And Valves
211003	Water Based Fire Suppression System – Sprinklers And Standpipes

Division 22 – Plumbing

220500	Common Work Results For Plumbing
220505	Plumbing Piping, Fittings And Valves
220701	Plumbing Insulation
221313	Facility Sanitary Sewers
224000	Plumbing Fixtures
224005	Plumbing Equipment

Division 23 - Heating Ventilating And Air Conditioning

230500	Common Work Results For HVAC
230505	HVAC Piping, Fittings And Valves
230548	Vibration Controls For HVAC, Plumbing And Fire Protection Equipment
230593	Testing Adjusting And Balancing For HVAC And Plumbing
230600	Heating, Ventilating And Air Conditioning Equipment
230701	HVAC Insulation
230900	Instrumentation And Controls Of HVAC And Plumbing Systems
233000	HVAC Air Distribution
238126	Variable Refrigerant Volume Split Systems With Heat Recovery

Division 26 – Electrical

260500	Common Work Results For Electrical	
260519	Conductors And Cables	
260526	Grounding And Bonding	
260528	Electrical Firestopping	
260529	Hangers And Supports	
260533	Raceways And Boxes	
230534	Surface Metal Raceway	
230535	Miscellaneous Raceway Systems	
260544	Innerduct	
260553	Electrical Identification	
260573	Short Circuit Analysis, Coordination Study And Arc Flash Hazard	Analysis
260924	Lighting Control System	
260926	Occupancy Sensors	
262200	Transformers	
262416	Panelboards	
262726	Wiring Devices	
262813	Fuses	

**Indian River School District
Referendum 2013
North Georgetown Elementary School**

262816 Disconnect Switches & Circuit Breakers
262913 Motor Controllers
265100 Lighting

Division 27 – Communications

270500 Common Work Results For Communications
272000 Communications Equipment And Cabling

Division 28 - Electronic Safety And Security

280500 Common Work Results For Electronic Safety And Security
283112 Fire Alarm System – Existing System Expansion

Division 31 – Earthwork

311000 Site Clearing
312000 Earth Moving
312319 Dewatering
315000 Excavation Support & Protection

Division 32 - Exterior Improvements

321216 Asphalt Paving
321313 Concrete Paving
323113 Chain Link Fences And Gates

Division 33 - Utilities

334100 Storm Utility Drainage Piping

END OF SECTION

SECTION 074113 - STANDING-SEAM METAL ROOFING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes

1. Standing-seam metal roof panels.
2. Metal soffit panels.

- B. Related Sections:

1. Section 077253 "Snow Guards" for prefabricated devices designed to hold snow on the roof surface, allowing it to melt and drain off slowly.

1.3 PREINSTALLATION MEETINGS

- A. Preinstallation Conference: Conduct conference at Project site.

1. Meet with Owner, Owner's insurer if applicable, metal panel Installer, metal panel manufacturer's representative, structural-support Installer, and installers whose work interfaces with or affects metal panels, including installers of roof accessories and roof-mounted equipment.
2. Review and finalize construction schedule and verify availability of materials, Installer's personnel, equipment, and facilities needed to make progress and avoid delays.
3. Review methods and procedures related to metal panel installation, including manufacturer's written instructions.
4. Examine support conditions for compliance with requirements, including alignment between and attachment to structural members.
5. Review structural loading limitations of deck during and after roofing.
6. Review flashings, special details, drainage, penetrations, equipment curbs, and condition of other construction that affect metal panels.
7. Review governing regulations and requirements for insurance, certificates, and tests and inspections if applicable.
8. Review temporary protection requirements for metal panel systems during and after installation.
9. Review procedures for repair of metal panels damaged after installation.
10. Document proceedings, including corrective measures and actions required, and furnish copy of record to each participant.

1.4 ACTION SUBMITTALS

- A. Product Data: For each type of product.

1. Include construction details, material descriptions, dimensions of individual components and profiles, and finishes for each type of panel and accessory.
 - B. Shop Drawings:
 1. Include fabrication and installation layouts of metal panels; details of edge conditions, joints, panel profiles, corners, anchorages, attachment system, trim, flashings, closures, and accessories; and special details.
 2. Accessories: Include details of the flashing, trim, and anchorage systems, at a scale of not less than 1-1/2 inches per 12 inches (1:10).
 - C. Samples for Initial Selection: For each type of metal panel indicated with factory-applied color finishes.
 1. Include similar Samples of trim and accessories involving color selection.
 - D. Samples for Verification: For each type of exposed finish required, prepared on Samples of size indicated below.
 1. Metal Panels: 12 inches (305 mm) long by actual panel width. Include clips, fasteners, closures, and other metal panel accessories.
- 1.5 INFORMATIONAL SUBMITTALS
- A. Qualification Data: For Installer.
 - B. Product Test Reports: For each product, for tests performed by a qualified testing agency.
 - C. Field quality-control reports.
 - D. Sample Warranties: For special warranties.
- 1.6 CLOSEOUT SUBMITTALS
- A. Maintenance Data: For metal panels to include in maintenance manuals.
- 1.7 QUALITY ASSURANCE
- A. Installer Qualifications: An entity that employs installers and supervisors who are trained and approved by manufacturer. Minimum ten years experience installing standing seam roofing.
 - B. Manufacturer Qualifications: Manufacturer shall have minimum ten years experience in fabrication of metal standing seam roof panels.
- 1.8 DELIVERY, STORAGE, AND HANDLING
- A. Deliver components, metal panels, and other manufactured items so as not to be damaged or deformed. Package metal panels for protection during transportation and handling.
 - B. Unload, store, and erect metal panels in a manner to prevent bending, warping, twisting, and surface damage.

- C. Stack metal panels horizontally on platforms or pallets, covered with suitable weathertight and ventilated covering. Store metal panels to ensure dryness, with positive slope for drainage of water. Do not store metal panels in contact with other materials that might cause staining, denting, or other surface damage.
- D. Retain strippable protective covering on metal panels during installation.

1.9 FIELD CONDITIONS

- A. Weather Limitations: Proceed with installation only when existing and forecasted weather conditions permit assembly of metal panels to be performed according to manufacturers' written instructions and warranty requirements.

1.10 COORDINATION

- A. Coordinate sizes and locations of roof curbs, equipment supports, and roof penetrations with actual equipment provided.
- B. Coordinate metal panel installation with rain drainage work, flashing, trim, construction of soffits, and other adjoining work to provide a leakproof, secure, and noncorrosive installation.

1.11 WARRANTY

- A. Special Warranty: Manufacturer's standard form in which manufacturer agrees to repair or replace components of metal panel systems that fail in materials or workmanship within specified warranty period.
 - 1. Failures include, but are not limited to, the following:
 - a. Structural failures including rupturing, cracking, or puncturing.
 - b. Deterioration of metals and other materials beyond normal weathering.
 - 2. Warranty Period: Two years from date of Substantial Completion.
- B. Special Warranty on Panel Finishes: Manufacturer's standard form in which manufacturer agrees to repair finish or replace metal panels that show evidence of deterioration of factory-applied finishes within specified warranty period.
 - 1. Exposed Panel Finish: Deterioration includes, but is not limited to, the following:
 - a. Color fading more than 5 Hunter units when tested according to ASTM D 2244.
 - b. Chalking in excess of a No. 8 rating when tested according to ASTM D 4214.
 - c. Cracking, checking, peeling, or failure of paint to adhere to bare metal.
 - 2. Finish Warranty Period: 20 years from date of Substantial Completion.
- C. Special Weathertightness Warranty: Manufacturer's standard form in which manufacturer agrees to repair or replace standing-seam metal roof panel assemblies that fail to remain weathertight, including leaks, within specified warranty period.
 - 1. Warranty Period: 20 years from date of Substantial Completion.

PART 2 - PRODUCTS

2.1 PERFORMANCE REQUIREMENTS

- A. Energy Performance: Provide roof panels that are listed on the EPA/DOE's ENERGY STAR "Roof Product List" for steep-slope roof products.
- B. Structural Performance: Provide metal panel systems capable of withstanding the effects of the following loads, based on testing according to ASTM E 1592:
 - 1. Wind Loads: As indicated on Drawings.
 - 2. Other Design Loads: As indicated on Drawings.
 - 3. Deflection Limits: For wind loads, no greater than 1/240 of the span.
- C. Air Infiltration: Air leakage of not more than **0.06 cfm/sq. ft. (0.3 L/s per sq. m)** when tested according to ASTM E 1680 at the following test-pressure difference:
 - 1. Test-Pressure Difference: **6.24 lbf/sq. ft. (300 Pa)**.
- D. Water Penetration under Static Pressure: No water penetration when tested according to ASTM E 1646 at the following test-pressure difference:
 - 1. Test-Pressure Difference: **6.24 lbf/sq. ft. (300 Pa)**.
- E. Hydrostatic-Head Resistance: No water penetration when tested according to ASTM E 2140.
- F. Wind-Uplift Resistance: Provide metal roof panel assemblies that comply with UL 580 for wind-uplift-resistance class indicated.
 - 1. Uplift Rating: UL 90.
- G. Thermal Movements: Allow for thermal movements from ambient and surface temperature changes by preventing buckling, opening of joints, overstressing of components, failure of joint sealants, failure of connections, and other detrimental effects. Base calculations on surface temperatures of materials due to both solar heat gain and nighttime-sky heat loss.
 - 1. Temperature Change (Range): **120 deg F (67 deg C)**, ambient; **180 deg F (100 deg C)**, material surfaces.

2.2 STANDING-SEAM METAL ROOF PANELS

- A. General: Provide factory-formed metal roof panels designed to be installed by lapping and interconnecting raised side edges of adjacent panels with joint type indicated and mechanically attaching panels to supports using concealed clips in side laps. Include clips, cleats, pressure plates, and accessories required for weathertight installation.
 - 1. Steel Panel Systems: Unless more stringent requirements are indicated, comply with ASTM E 1514.
- B. Integral-Standing-Seam Metal Roof Panels: Formed with integral ribs at panel edges and intermediate stiffening ribs symmetrically spaced between ribs; designed for sequential installation by mechanically attaching panels to supports using concealed clips located under one side of panels and lapping and interconnecting side edges of adjacent panels.

1. **Basis-of-Design Product:** Subject to compliance with requirements, provide ATAS International, Inc.; 2” Field-Lok panel or comparable product by one of the following:
 - a. Architectural Metal Systems; a Nucor company.
 - b. ATAS International, Inc.
 - c. Bemo USA, Inc.
 - d. Cheney Flashing Company.
 - e. Garland Company, Inc.
 - f. McElroy Metal, Inc.
 - g. Petersen Aluminum Corporation.
 - h. Tremco Inc..
2. **Metallic-Coated Steel Sheet:** Zinc-coated (galvanized) steel sheet complying with ASTM A 653/A 653M, **G90 (Z275)** coating designation, or aluminum-zinc alloy-coated steel sheet complying with ASTM A 792/A 792M, **Class AZ50 (Class AZM150)** coating designation; structural quality. Prepainted by the coil-coating process to comply with ASTM A 755/A 755M.
 - a. Nominal Thickness: Minimum **0.028 inch (0.71 mm)**.
 - b. Exterior Finish: Two-coat fluoropolymer.
 - c. Color: To match existing.
3. **Clips:** Two-piece floating to accommodate thermal movement.
 - a. Material: **0.064-inch- (1.63-mm-)** nominal thickness, zinc-coated (galvanized) or aluminum-zinc alloy-coated steel sheet.
4. **Panel Coverage:** **15.25 inches**.
 - a. Where existing panels are to be replaced, match existing 14.5 inches width, or replace panels from penetration to start of new work.
5. **Panel Height:** **2.0 inches (51 mm)**.
6. **Panel Length:** Continuous without end laps.

2.3 UNDERLAYMENT MATERIALS

- A. **Self-Adhering, High-Temperature Underlayment:** Provide self-adhering, cold-applied, sheet underlayment, a minimum of **30 mils (0.76 mm)** thick, consisting of slip-resistant, polyethylene-film top surface laminated to a layer of butyl or SBS-modified asphalt adhesive, with release-paper backing. Provide primer when recommended by underlayment manufacturer.
 1. **Thermal Stability:** Stable after testing at **240 deg F (116 deg C)**; ASTM D 1970.
 2. **Low-Temperature Flexibility:** Passes after testing at minus **20 deg F (29 deg C)**; ASTM D 1970.
 3. **Products:** Subject to compliance with requirements and manufacturer’s written approval, available products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Carlisle Residential, a division of Carlisle Construction Materials; WIP 300HT.
 - b. Grace Construction Products, a unit of W. R. Grace & Co.; Grace Ice and Water Shield HT.
 - c. Henry Company; Blueskin PE200 HT.
 - d. Kirsch Building Products, LLC; Sharkskin Ultra SA.
 - e. Metal-Fab Manufacturing, LLC; MetShield.
 - f. Owens Corning; WeatherLock Metal High Temperature Underlayment.

- B. Slip Sheet: Manufacturer's recommended slip sheet, of type required for application, if required.

2.4 METAL SOFFIT PANELS

- A. General: Provide metal soffit panels designed to be installed by lapping and interconnecting side edges of adjacent panels and mechanically attaching through panel to supports using concealed fasteners in side laps. Include accessories required for weathertight installation.
- B. Metal Soffit Panels: Match profile and material of existing metal soffit panels.
 - 1. Finish: Match finish and color of existing metal soffit panels.
 - 2. Sealant: Factory applied within interlocking joint.
- C. Flush-Profile Metal Soffit Panels: Solid panels formed with vertical panel edges and intermediate stiffening ribs symmetrically spaced between panel edges; with flush joint between panels.
 - 1. Manufacturers: Subject to compliance with requirements, provide products by the following:
 - a. AEP Span; a BlueScope Steel company.
 - b. Architectural Building Components.
 - c. ATAS International, Inc.
 - d. CENTRIA Architectural Systems.
 - e. Dimensional Metals, Inc.
 - f. Firestone Metal Products, LLC.
 - g. McElroy Metal, Inc.
 - h. Merchant & Evans Inc.
 - i. Metal-Fab Manufacturing, LLC.
 - j. Other roofing manufacturer listed above.
 - 2. Material: Same material, finish, and color as existing metal soffit panels.
 - 3. Metallic-Coated Steel Sheet: Zinc-coated (galvanized) steel sheet complying with ASTM A 653/A 653M, **G90 (Z275)** coating designation, or aluminum-zinc alloy-coated steel sheet complying with ASTM A 792/A 792M, **Class AZ50 (Class AZM150)** coating designation; structural quality. Prepainted by the coil-coating process to comply with ASTM A 755/A 755M.
 - a. Nominal Thickness: **0.028 inch (0.71 mm)** minimum.
 - b. Exterior Finish: Two-coat fluoropolymer.
 - c. Color: To match existing.
 - 4. Panel Coverage: **12 inches (305 mm)** or **16 inches (406 mm)**.
 - 5. Rib spacing: To match existing.
 - 6. Panel Height: **0.875 inch (22 mm)**.

2.5 MISCELLANEOUS MATERIALS

- A. Miscellaneous Metal Subframing and Furring: ASTM C 645; cold-formed, metallic-coated steel sheet, ASTM A 653/A 653M, **G90 (Z275 hot-dip galvanized)** coating designation or ASTM A 792/A 792M, **Class AZ50 (Class AZM150)** coating designation unless otherwise indicated. Provide manufacturer's standard sections as required for support and alignment of metal panel system.
- B. Panel Accessories: Provide components required for a complete, weathertight panel system including trim, copings, fasciae, mullions, sills, corner units, clips, flashings, sealants, gaskets, fillers, closure strips, and similar items. Match material and finish of metal panels unless otherwise indicated.

1. Closures: Provide closures at eaves and ridges, fabricated of same metal as metal panels.
 2. Backing Plates: Provide metal backing plates at panel end splices, fabricated from material recommended by manufacturer.
 3. Closure Strips: Closed-cell, expanded, cellular, rubber or crosslinked, polyolefin-foam or closed-cell laminated polyethylene; minimum **1-inch- (25-mm-)** thick, flexible closure strips; cut or premolded to match metal panel profile. Provide closure strips where indicated or necessary to ensure weathertight construction.
- C. Flashing and Trim: Provide flashing and trim formed from same material as metal panels as required to seal against weather and to provide finished appearance. Locations include, but are not limited to, eaves, rakes, corners, bases, framed openings, ridges, fasciae, and fillers. Finish flashing and trim with same finish system as adjacent metal panels.
- D. Gutters: Formed from same material as roof panels, complete with end pieces, outlet tubes, and other special pieces as required. Fabricate in minimum **96-inch- (2400-mm-)** long sections, of size and metal thickness according to SMACNA's "Architectural Sheet Metal Manual." Furnish gutter supports spaced a maximum of **36 inches (914 mm)** o.c., fabricated from same metal as gutters. Provide wire ball strainers of compatible metal at outlets. Finish gutters to match metal roof panels.
- E. Downspouts: Formed from same material as roof panels. Fabricate in **10-foot- (3-m-)** long sections, complete with formed elbows and offsets, of size and metal thickness according to SMACNA's "Architectural Sheet Metal Manual." Finish downspouts to match gutters.
- F. Roof Curbs: Fabricated from same material as roof panels, **0.048-inch (1.2-mm)** nominal thickness; with bottom of skirt profiled to match roof panel profiles and with welded top box and integral full-length cricket. Fabricate curb subframing of **0.060-inch- (1.52-mm-)** nominal thickness, angle-, C-, or Z-shaped steel sheet. Fabricate curb and subframing to withstand indicated loads of size and height indicated. Finish roof curbs to match metal roof panels.
1. Insulate roof curb with minimum **1-inch- (25-mm-)** thick, rigid insulation.
- G. Panel Fasteners: Self-tapping screws designed to withstand design loads.
- H. Panel Sealants: Provide sealant type recommended by manufacturer that are compatible with panel materials, are nonstaining, and do not damage panel finish.
1. Sealant Tape: Pressure-sensitive, 100 percent solids, gray polyisobutylene compound sealant tape with release-paper backing. Provide permanently elastic, nonsag, nontoxic, nonstaining tape **1/2 inch (13 mm)** wide and **1/8 inch (3 mm)** thick.
 2. Joint Sealant: ASTM C 920; elastomeric polyurethane or silicone sealant; of type, grade, class, and use classifications required to seal joints in metal panels and remain weathertight; and as recommended in writing by metal panel manufacturer.
 3. Butyl-Rubber-Based, Solvent-Release Sealant: ASTM C 1311.
- 2.6 FABRICATION
- A. General: Fabricate and finish metal panels and accessories at the factory, by manufacturer's standard procedures and processes, as necessary to fulfill indicated performance requirements demonstrated by laboratory testing. Comply with indicated profiles and with dimensional and structural requirements.
- B. On-Site Fabrication: Subject to compliance with requirements of this Section, metal panels may be fabricated on-site using UL-certified, portable roll-forming equipment if panels are of same profile and warranted by manufacturer to be equal to factory-formed panels. Fabricate according to equipment manufacturer's written instructions and to comply with details shown.

- C. Provide panel profile, including major ribs and intermediate stiffening ribs, if any, for full length of panel.
- D. Fabricate metal panel joints with factory-installed captive gaskets or separator strips that provide a weathertight seal and prevent metal-to-metal contact, and that minimize noise from movements.
- E. Sheet Metal Flashing and Trim: Fabricate flashing and trim to comply with manufacturer's recommendations and recommendations in SMACNA's "Architectural Sheet Metal Manual" that apply to design, dimensions, metal, and other characteristics of item indicated.
 - 1. Form exposed sheet metal accessories that are without excessive oil canning, buckling, and tool marks and that are true to line and levels indicated, with exposed edges folded back to form hems.
 - 2. Seams for Aluminum: Fabricate nonmoving seams with flat-lock seams. Form seams and seal with epoxy seam sealer. Rivet joints for additional strength.
 - 3. Seams for Other Than Aluminum: Fabricate nonmoving seams in accessories with flat-lock seams. Tin edges to be seamed, form seams, and solder.
 - 4. Sealed Joints: Form nonexpansion, but movable, joints in metal to accommodate sealant and to comply with SMACNA standards.
 - 5. Conceal fasteners and expansion provisions where possible. Exposed fasteners are not allowed on faces of accessories exposed to view.
 - 6. Fabricate cleats and attachment devices from same material as accessory being anchored or from compatible, noncorrosive metal recommended in writing by metal panel manufacturer.
 - a. Size: As recommended by SMACNA's "Architectural Sheet Metal Manual" or metal panel manufacturer for application, but not less than thickness of metal being secured.

2.7 FINISHES

- A. Protect mechanical and painted finishes on exposed surfaces from damage by applying a strippable, temporary protective covering before shipping.
- B. Appearance of Finished Work: Variations in appearance of abutting or adjacent pieces are acceptable if they are within one-half of the range of approved Samples. Noticeable variations in same piece are unacceptable. Variations in appearance of other components are acceptable if they are within the range of approved Samples and are assembled or installed to minimize contrast.
- C. Steel Panels and Accessories:
 - 1. Two-Coat Fluoropolymer: AAMA 621. Fluoropolymer finish containing not less than 70 percent PVDF resin by weight in color coat. Prepare, pretreat, and apply coating to exposed metal surfaces to comply with coating and resin manufacturers' written instructions.
 - 2. Concealed Finish: Apply pretreatment and manufacturer's standard white or light-colored acrylic or polyester backer finish consisting of prime coat and wash coat with a minimum total dry film thickness of 0.5 mil (0.013 mm).

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine substrates, areas, and conditions, with Installer present, for compliance with requirements for installation tolerances, metal panel supports, and other conditions affecting performance of the Work.

1. Examine primary and secondary roof framing to verify that rafters, purlins, angles, channels, and other structural panel support members and anchorages have been installed within alignment tolerances required by metal roof panel manufacturer.
2. Examine solid roof sheathing to verify that sheathing joints are supported by framing or blocking and that installation is within flatness tolerances required by metal roof panel manufacturer.
 - a. Verify that air- or water-resistive barriers have been installed over sheathing or backing substrate to prevent air infiltration or water penetration.
- B. Examine roughing-in for components and systems penetrating metal panels to verify actual locations of penetrations relative to seam locations of metal panels before installation.
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 PREPARATION

- A. Miscellaneous Supports: Install subframing, furring, and other miscellaneous panel support members and anchorages according to ASTM C 754 and metal panel manufacturer's written recommendations.
 1. Soffit Framing: Wire tie or clip furring channels to supports, as required to comply with requirements for assemblies indicated.

3.3 UNDERLAYMENT INSTALLATION

- A. Self-Adhering Sheet Underlayment: Apply primer if required by manufacturer. Comply with temperature restrictions of underlayment manufacturer for installation. Apply at locations indicated below, wrinkle free, in shingle fashion to shed water, and with end laps of not less than **6 inches (152 mm)** staggered **24 inches (610 mm)** between courses. Overlap side edges not less than **3-1/2 inches (90 mm)**. Roll laps with roller. Cover underlayment within 14 days.
 1. Apply over the entire roof surface.
- B. Slip Sheet: Apply slip sheet over underlayment before installing metal roof panels, where required by manufacturer.
- C. Flashings: Install flashings to cover underlayment to comply with requirements specified in Section 076200 "Sheet Metal Flashing and Trim."

3.4 METAL PANEL INSTALLATION

- A. General: Install metal panels according to manufacturer's written instructions in orientation, sizes, and locations indicated. Install panels perpendicular to supports unless otherwise indicated. Anchor metal panels and other components of the Work securely in place, with provisions for thermal and structural movement.
 1. Shim or otherwise plumb substrates receiving metal panels.
 2. Flash and seal metal panels at perimeter of all openings. Fasten with self-tapping screws. Do not begin installation until air- or water-resistive barriers and flashings that will be concealed by metal panels are installed.
 3. Install screw fasteners in predrilled holes.
 4. Locate and space fasteners in uniform vertical and horizontal alignment.
 5. Install flashing and trim as metal panel work proceeds.

6. Locate panel splices over, but not attached to, structural supports. Stagger panel splices and end laps to avoid a four-panel lap splice condition.
 7. Align bottoms of metal panels and fasten with blind rivets, bolts, or self-tapping screws. Fasten flashings and trim around openings and similar elements with self-tapping screws.
 8. Provide weathertight escutcheons for pipe- and conduit-penetrating panels.
- B. Fasteners:
1. Steel Panels: Use stainless-steel fasteners for surfaces exposed to the exterior; use galvanized-steel fasteners for surfaces exposed to the interior.
- C. Anchor Clips: Anchor metal roof panels and other components of the Work securely in place, using manufacturer's approved fasteners according to manufacturers' written instructions.
- D. Metal Protection: Where dissimilar metals contact each other or corrosive substrates, protect against galvanic action as recommended in writing by metal panel manufacturer.
- E. Standing-Seam Metal Roof Panel Installation: Fasten metal roof panels to supports with concealed clips at each standing-seam joint at location, spacing, and with fasteners recommended in writing by manufacturer.
1. Install clips to supports with self-tapping fasteners.
 2. Install pressure plates at locations indicated in manufacturer's written installation instructions.
 3. Seamed Joint: Crimp standing seams with manufacturer-approved, motorized seamer tool so clip, metal roof panel, and factory-applied sealant are completely engaged.
 4. Watertight Installation:
 - a. Apply a continuous ribbon of sealant or tape to seal joints of metal panels, using sealant or tape as recommend in writing by manufacturer as needed to make panels watertight.
 - b. Provide sealant or tape between panels and protruding equipment, vents, and accessories.
- F. Accessory Installation: Install accessories with positive anchorage to building and weathertight mounting, and provide for thermal expansion. Coordinate installation with flashings and other components.
1. Install components required for a complete metal panel system including trim, copings, corners, seam covers, flashings, sealants, gaskets, fillers, closure strips, and similar items. Provide types indicated by metal roof panel manufacturers; or, if not indicated, types recommended by metal roof panel manufacturer.
- G. Flashing and Trim: Comply with performance requirements, manufacturer's written installation instructions, and SMACNA's "Architectural Sheet Metal Manual." Provide concealed fasteners where possible, and set units true to line and level as indicated. Install work with laps, joints, and seams that will be permanently watertight and weather resistant.
1. Install exposed flashing and trim that is without buckling and tool marks, and that is true to line and levels indicated, with exposed edges folded back to form hems. Install sheet metal flashing and trim to fit substrates and achieve waterproof and weather-resistant performance.
 2. Expansion Provisions: Provide for thermal expansion of exposed flashing and trim. Space movement joints at a maximum of 10 feet (3 m) with no joints allowed within 24 inches (610 mm) of corner or intersection. Where lapped expansion provisions cannot be used or would not be sufficiently weather resistant and waterproof, form expansion joints of intermeshing hooked flanges, not less than 1 inch (25 mm) deep, filled with mastic sealant (concealed within joints).

- H. Gutters: Join sections with riveted and soldered or lapped and sealed joints. Attach gutters to eave with gutter hangers spaced not more than **36 inches (914 mm)** o.c. using manufacturer's standard fasteners. Provide end closures and seal watertight with sealant. Provide for thermal expansion.
- I. Downspouts: Join sections with telescoping joints. Provide fasteners designed to hold downspouts securely **1 inch (25 mm)** away from walls; locate fasteners at top and bottom and at approximately **60 inches (1524 mm)** o.c. in between.
 - 1. Provide elbows at base of downspouts to direct water away from building.
 - 2. Connect downspouts to underground drainage system indicated.
- J. Roof Curbs: Install flashing around bases where they meet metal roof panels.
- K. Pipe Flashing: Form flashing around pipe penetration and metal roof panels. Fasten and seal to metal roof panels as recommended by manufacturer.

3.5 ERECTION TOLERANCES

- A. Installation Tolerances: Shim and align metal panel units within installed tolerance of **1/4 inch in 20 feet (6 mm in 6 m)** on slope and location lines as indicated and within **1/8-inch (3-mm)** offset of adjoining faces and of alignment of matching profiles.

3.6 FIELD QUALITY CONTROL

- A. Manufacturer's Field Service: Engage a factory-authorized service representative to test and inspect metal roof panel installation, including accessories. Report results in writing.
- B. Remove and replace applications of metal roof panels where tests and inspections indicate that they do not comply with specified requirements.
- C. Additional tests and inspections, at Contractor's expense, are performed to determine compliance of replaced or additional work with specified requirements.
- D. Prepare test and inspection reports.

3.7 CLEANING AND PROTECTION

- A. Remove temporary protective coverings and strippable films, if any, as metal panels are installed, unless otherwise indicated in manufacturer's written installation instructions. On completion of metal panel installation, clean finished surfaces as recommended by metal panel manufacturer. Maintain in a clean condition during construction.
- B. Replace metal panels that have been damaged or have deteriorated beyond successful repair by finish touchup or similar minor repair procedures.

END OF SECTION 074113.16

SECTION 081113 - HOLLOW METAL DOORS AND FRAMES

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Standard and custom hollow metal doors and frames.
2. Steel sidelight, borrowed lite and transom frames.
3. Light frames and glazing installed in hollow metal doors.

B. Codes and References: Comply with the version year adopted by the Authority Having Jurisdiction.

1. ANSI/SDI A250.8 - Recommended Specifications for Standard Steel Doors and Frames.
2. ANSI/SDI A250.4 - Test Procedure and Acceptance Criteria for Physical Endurance for Steel Doors, Frames, Frames Anchors and Hardware Reinforcing.
3. ANSI/SDI A250.6 - Recommended Practice for Hardware Reinforcing on Standard Steel Doors and Frames.
4. ANSI/SDI A250.10 - Test Procedure and Acceptance Criteria for Prime Painted Steel Surfaces for Steel Doors and Frames.
5. ANSI/SDI A250.11 - Recommended Erection Instructions for Steel Frames.
6. ASTM A1008 - Standard Specification for Steel Sheet, Cold-Rolled, Carbon, Structural, High-Strength Low-Alloy and High-Strength Low-Alloy with Improved Formability.
7. ASTM A653 - Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process.
8. ANSI/BHMA A156.115 - Hardware Preparation in Steel Doors and Frames.
9. ANSI/SDI 122 - Installation and Troubleshooting Guide for Standard Steel Doors and Frames.
10. ANSI/NFPA 80 - Standard for Fire Doors and Fire Windows; National Fire Protection Association.
11. ANSI/NFPA 105: Standard for the Installation of Smoke Door Assemblies.
12. NFPA 252 - Standard Methods of Fire Tests of Door Assemblies; National Fire Protection Association.
13. UL 10C - Positive Pressure Fire Tests of Door Assemblies.
14. UL 1784 - Standard for Air Leakage Tests of Door Assemblies.

1.2 SUBMITTALS

A. Product Data: For each type of product indicated. Include construction details, material descriptions, core descriptions, hardware reinforcements, profiles, anchors, fire-resistance rating, and finishes.

B. Door hardware supplier is to furnish templates, template reference number and/or physical hardware to the steel door and frame supplier in order to prepare the doors and frames to receive the finish hardware items.

C. Shop Drawings: Include the following:

1. Elevations of each door design.
2. Details of doors, including vertical and horizontal edge details and metal thicknesses.
3. Frame details for each frame type, including dimensioned profiles and metal thicknesses.
4. Locations of reinforcement and preparations for hardware.
5. Details of anchorages, joints, field splices, and connections.
6. Details of accessories.

7. Details of moldings, removable stops, and glazing.
8. Details of conduit and preparations for power, signal, and control systems.

D. Samples for Verification:

1. Samples are only required by request of the architect and for manufacturers that are not current members of the Steel Door Institute.

1.3 QUALITY ASSURANCE

- A. Source Limitations: Obtain hollow metal doors and frames through one source from a single manufacturer wherever possible.
- B. Quality Standard: In addition to requirements specified, comply with ANSI/SDI A250.8, latest edition, "Recommended Specifications for Standard Steel Doors and Frames".
- C. Fire-Rated Door Assemblies: Assemblies complying with NFPA 80 that are listed and labeled by a qualified testing agency, for fire-protection ratings indicated, based on testing at positive pressure according to NFPA 252 (neutral pressure at 40" above sill) or UL 10C.
1. Oversize Fire-Rated Door Assemblies Construction: For units exceeding sizes of tested assemblies, attach construction label certifying doors are built to standard construction requirements for tested and labeled fire rated door assemblies except for size.
 2. Temperature-Rise Limit: Where indicated and at vertical exit enclosures (stairwell openings) and exit passageways, provide doors that have a maximum transmitted temperature end point of not more than 450 deg F (250 deg C) above ambient after 30 minutes of standard fire-test exposure.
 3. Smoke Control Door Assemblies: Comply with NFPA 105.
 - a. Smoke "S" Label: Doors to bear "S" label, and include smoke and draft control gasketing applied to frame and on meeting stiles of pair doors.
- D. Fire-Rated, Borrowed-Light Frame Assemblies: Assemblies complying with NFPA 80 that are listed and labeled, by a testing and inspecting agency acceptable to authorities having jurisdiction, for fire-protection ratings indicated, based on testing according to NFPA 257. Provide labeled glazing material.
- E. Pre-Submittal Conference: Conduct conference in compliance with requirements in Division 01 Section "Project Meetings" with attendance by representatives of Supplier, Installer, and Contractor to review proper methods and procedures for installing hollow metal doors and frames and to verify installation of electrical knockout boxes and conduit at frames with electrified or access control hardware.

1.4 DELIVERY, STORAGE, AND HANDLING

- A. Deliver hollow metal work palletized, wrapped, or crated to provide protection during transit and Project site storage. Do not use non-vented plastic.
- B. Deliver welded frames with two removable spreader bars across bottom of frames, tack welded to jambs and mullions.
- C. Store hollow metal work under cover at Project site. Place in stacks of five units maximum in a vertical position with heads up, spaced by blocking, on minimum 4-inch high wood blocking. Do not store in a manner that traps excess humidity.

1. Provide minimum 1/4-inch space between each stacked door to permit air circulation. Door and frames to be stacked in a vertical upright position.

1.5 PROJECT CONDITIONS

- A. Field Measurements: Verify actual dimensions of openings by field measurements before fabrication.

1.6 COORDINATION

- A. Coordinate installation of anchorages for hollow metal frames. Furnish setting drawings, templates, and directions for installing anchorages, including sleeves, concrete inserts, anchor bolts, and items with integral anchors. Deliver such items to Project site in time for installation.

1.7 WARRANTY

- A. Special Warranty: Manufacturer's standard form in which manufacturer agrees to repair or replace doors that fail in materials or workmanship within specified warranty period.
- B. Warranty includes installation and finishing that may be required due to repair or replacement of defective doors.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 1. CECO Door Products.
 2. Curries Company.
 3. Steelcraft.

2.2 MATERIALS

- A. Cold-Rolled Steel Sheet: ASTM A 1008/A 1008M, Commercial Steel (CS), Type B; suitable for exposed applications.
- B. Metallic-Coated Steel Sheet: ASTM A 653/A 653M, Commercial Steel (CS), Type B; with minimum G60 (Z180) or A60 (ZF180) metallic coating.
- C. Frame Anchors: ASTM A 653/A 653M, Commercial Steel (CS), Commercial Steel (CS), Type B; with minimum G60 (Z180) or A60 (ZF180) metallic coating.

2.3 STANDARD HOLLOW METAL DOORS

- A. General: Provide 1-3/4 inch doors of design indicated, not less than thickness indicated; fabricated with smooth surfaces, without visible joints or seams on exposed faces unless otherwise indicated. Comply with ANSI/SDI A250.8.

- B. Interior Doors: Face sheets fabricated of commercial quality cold rolled steel that complies with ASTM A 1008/A 1008M. Provide doors complying with requirements indicated below by referencing ANSI/SDI A250.8 for level and model and ANSI/SDI A250.4 for physical performance level:
1. Design: Flush panel.
 2. Core Construction: Manufacturer's standard kraft-paper honeycomb, or one-piece polystyrene core, securely bonded to both faces.
 - a. Fire Door Core: As required to provide fire-protection and temperature-rise ratings indicated.
 3. Level/Model: Level 2 and Physical Performance Level B (Heavy Duty), Minimum 18 gauge (0.042-inch - 1.0-mm) thick steel, Model 2.
 4. Top and Bottom Edges: Reinforce tops and bottoms of doors with a continuous steel channel not less than 16 gauge, extending the full width of the door and welded to the face sheet.
 5. Hinge Reinforcement: Minimum 7 gauge (3/16") plate 1-1/4" x 9" or minimum 14 gauge continuous channel with pierced holes, drilled and tapped.
 6. Hardware Reinforcements: Fabricate according to ANSI/SDI A250.6 with reinforcing plates from same material as door face sheets.
- C. Basis of Design:
1. Curries Company 707 Series.

2.4 STANDARD HOLLOW METAL FRAMES

- A. General: Comply with ANSI/SDI A250.8 and with details indicated for type and profile.
- B. Interior Frames: Fabricated from cold-rolled steel sheet that complies with ASTM A 1008/A 1008M.
1. Fabricate frames with mitered or coped corners.
 2. Fabricate frames, with the exception of slip-on drywall types, with "closed and tight" miter seams continuously welded on face, finished smooth with no visible seam unless otherwise indicated.
 3. Frames for Steel Doors: Minimum 16 gauge (0.053-inch -1.3-mm) thick steel sheet.
 4. Frames for Wood Doors: Minimum 16 gauge (0.053-inch-1.3-mm-) thick steel sheet.
 5. Frames for Borrowed Lights: Minimum 16 gauge (0.053-inch-1.3-mm-) thick steel sheet.
 6. Basis of Design:
 - a. Curries Company M/CM Series.
- C. Fire rated frames: Fabricate frames in accordance with NFPA 80, listed and labeled by a qualified testing agency, for fire-protection ratings indicated.
- D. Hardware Reinforcement: Fabricate according to ANSI/SDI A250.6 Table 4 with reinforcement plates from same material as frames.

2.5 FRAME ANCHORS

- A. Jamb Anchors:
1. Masonry Type: Adjustable strap-and-stirrup or T-shaped anchors to suit frame size, formed from A60 metallic coated material, not less than 0.042 inch thick, with corrugated or perforated straps not less than 2 inches wide by 10 inches long; or wire anchors not less than 0.177 inch thick.
 2. Stud Wall Type: Designed to engage stud and not less than 0.042 inch thick.

- B. Floor Anchors: Floor anchors to be provided at each jamb, formed from A60 metallic coated material, not less than 0.042 inches thick.
- C. Mortar Guards: Formed from same material as frames, not less than 0.016 inches thick.

2.6 LIGHT OPENINGS AND GLAZING

- A. Stops and Moldings: Provide stops and moldings around glazed lites where indicated. Form corners of stops and moldings with butted or mitered hairline joints at fabricator's shop. Fixed and removable stops to allow multiple glazed lites each to be removed independently. Coordinate frame rabbet widths between fixed and removable stops with the type of glazing and installation indicated.
- B. Moldings for Glazed Lites in Doors and Loose Stops for Glazed Lites in Frames: Minimum 20 gauge thick, fabricated from same material as door face sheet in which they are installed.
- C. Fixed Frame Moldings: Formed integral with hollow metal frames, a minimum of 5/8 inch (16 mm) high unless otherwise indicated. Provide fixed frame moldings and stops on outside of exterior and on secure side of interior doors and frames
- D. Preformed Metal Frames for Light Openings: Manufacturer's standard frame formed of 0.048-inch-thick, cold rolled steel sheet; with baked enamel or powder coated finish; and approved for use in doors of fire protection rating indicated. Match pre-finished door paint color where applicable.
- E. Glazing: Comply with requirements in Division 08 Section "Glazing" and with the hollow metal door manufacturer's written instructions.
 - 1. Factory Glazing: Factory install glazing in doors as indicated. Doors with factory installed glass to include all of the required glazing material.

2.7 ACCESSORIES

- A. Mullions and Transom Bars: Join to adjacent members by welding or rigid mechanical anchors.
- B. Grout Guards: Formed from same material as frames, not less than 0.016 inches thick.

2.8 FABRICATION

- A. Fabricate hollow metal work to be rigid and free of defects, warp, or buckle. Accurately form metal to required sizes and profiles, with minimum radius for thickness of metal. Where practical, fit and assemble units in manufacturer's plant. When shipping limitations so dictate, frames for large openings are to be fabricated in sections for splicing or splining in the field by others.
- B. Tolerances: Fabricate hollow metal work to tolerances indicated in ANSI/SDI A250.8.
- C. Hollow Metal Doors:
 - 1. Exterior Doors: Provide optional weep-hole openings in bottom of exterior doors to permit moisture to escape where specified.
 - 2. Glazed Lites: Factory cut openings in doors with applied trim or kits to fit. Factory install glazing where indicated.
 - 3. Astragals: Provide overlapping astragals as noted in door hardware sets in Division 08 Section "Door Hardware" on one leaf of pairs of doors where required by NFPA 80 for fire-performance rating or where indicated. Extend minimum 3/4 inch beyond edge of door on which astragal is mounted.

4. Continuous Hinge Reinforcement: Provide welded continuous 12 gauge strap for continuous hinges specified in hardware sets in Division 08 Section "Door Hardware".

D. Hollow Metal Frames:

1. Shipping Limitations: Where frames are fabricated in sections due to shipping or handling limitations, provide alignment plates or angles at each joint, fabricated of same thickness metal as frames.
2. Welded Frames: Weld flush face joints continuously; grind, fill, dress, and make smooth, flush, and invisible.
 - a. Welded frames are to be provided with two steel spreaders temporarily attached to the bottom of both jambs to serve as a brace during shipping and handling. Spreader bars are for bracing only and are not to be used to size the frame opening.
3. Sidelight and Transom Bar Frames: Provide closed tubular members with no visible face seams or joints, fabricated from same material as door frame. Fasten members at crossings and to jambs by butt welding.
4. High Frequency Hinge Reinforcement: Provide high frequency hinge reinforcements at door openings 48-inches and wider with mortise butt type hinges at top hinge locations.
5. Continuous Hinge Reinforcement: Provide welded continuous 12 gauge straps for continuous hinges specified in hardware sets in Division 08 Section "Door Hardware".
6. Provide countersunk, flat- or oval-head exposed screws and bolts for exposed fasteners unless otherwise indicated for removable stops, provide security screws at exterior locations.
7. Mortar Guards: Provide guard boxes at back of hardware mortises in frames at all hinges and strike preps regardless of grouting requirements.
8. Floor Anchors: Weld anchors to bottom of jambs and mullions with at least four spot welds per anchor.
9. Jamb Anchors: Provide number and spacing of anchors as follows:
 - a. Masonry Type: Locate anchors not more than 18 inches from top and bottom of frame. Space anchors not more than 32 inches o.c. and as follows:
 - 1) Two anchors per jamb up to 60 inches high.
 - 2) Three anchors per jamb from 60 to 90 inches high.
 - 3) Four anchors per jamb from 90 to 120 inches high.
 - 4) Four anchors per jamb plus 1 additional anchor per jamb for each 24 inches or fraction thereof above 120 inches high.
 - b. Stud Wall Type: Locate anchors not more than 18 inches from top and bottom of frame. Space anchors not more than 32 inches o.c. and as follows:
 - 1) Three anchors per jamb up to 60 inches high.
 - 2) Four anchors per jamb from 60 to 90 inches high.
 - 3) Five anchors per jamb from 90 to 96 inches high.
 - 4) Five anchors per jamb plus 1 additional anchor per jamb for each 24 inches or fraction thereof above 96 inches high.
 - 5) Two anchors per head for frames above 42 inches wide and mounted in metal stud partitions.
10. Door Silencers: Except on weatherstripped or gasketed doors, drill stops to receive door silencers. Silencers to be supplied by frame manufacturer regardless if specified in Division 08 Section "Door Hardware".

- E. Hardware Preparation: Factory prepare hollow metal work to receive template mortised hardware; include cutouts, reinforcement, mortising, drilling, and tapping according to the Door Hardware Schedule and templates furnished as specified in Division 08 Section "Door Hardware."
1. Locate hardware as indicated, or if not indicated, according to ANSI/SDI A250.8.
 2. Reinforce doors and frames to receive non-template, mortised and surface mounted door hardware.
 3. Comply with applicable requirements in ANSI/SDI A250.6 and ANSI/DHI A115 Series specifications for preparation of hollow metal work for hardware.
 4. Coordinate locations of conduit and wiring boxes for electrical connections with Division 26 Sections.

2.9 STEEL FINISHES

- A. Prime Finishes: Doors and frames to be cleaned, and chemically treated to insure maximum finish paint adhesion. Surfaces of the door and frame exposed to view to receive a factory applied coat of rust inhibiting shop primer.
1. Shop Primer: Manufacturer's standard, fast-curing, lead and chromate free primer complying with ANSI/SDI A250.10 acceptance criteria; recommended by primer manufacturer for substrate; and compatible with substrate and field-applied coatings.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine substrates, areas, and conditions, with Installer present, for compliance with requirements for installation tolerances and other conditions affecting performance of the Work.
- B. General Contractor to verify the accuracy of dimensions given to the steel door and frame manufacturer for existing openings or existing frames (strike height, hinge spacing, hinge back set, etc.).
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 PREPARATION

- A. Remove welded in shipping spreaders installed at factory. Restore exposed finish by grinding, filling, and dressing, as required to make repaired area smooth, flush, and invisible on exposed faces.
- B. Prior to installation, adjust and securely brace welded hollow metal frames for squareness, alignment, twist, and plumbness.
- C. Tolerances shall comply with SDI-117 "Manufacturing Tolerances Standard Steel Doors and Frames."
- D. Drill and tap doors and frames to receive non-template, mortised, and surface-mounted door hardware.

3.3 INSTALLATION

- A. General: Install hollow metal work plumb, rigid, properly aligned, and securely fastened in place; comply with Drawings and manufacturer's written instructions.

- B. Hollow Metal Frames: Install hollow metal frames of size and profile indicated. Comply with ANSI/SDI A250.11 and NFPA 80 at fire rated openings.
1. Set frames accurately in position, plumbed, aligned, and braced securely until permanent anchors are set. After wall construction is complete and frames properly set and secured, remove temporary braces, leaving surfaces smooth and undamaged. Shim as necessary to comply with installation tolerances.
 2. Floor Anchors: Provide floor anchors for each jamb and mullion that extends to floor, and secure with post-installed expansion anchors.
 3. Masonry Walls: Coordinate installation of frames to allow for solidly filling space between frames and masonry with mortar.
 4. Grout Requirements: Do not grout head of frames unless reinforcing has been installed in head of frame. Do not grout vertical or horizontal closed mullion members.
- C. Hollow Metal Doors: Fit hollow metal doors accurately in frames, within clearances specified below. Shim as necessary.
1. Non-Fire-Rated Standard Steel Doors:
 - a. Jamb and Head: 1/8 inch plus or minus 1/16 inch.
 - b. Between Edges of Pairs of Doors: 1/8 inch plus or minus 1/16 inch.
 - c. Between Bottom of Door and Top of Threshold: Maximum 3/8 inch.
 - d. Between Bottom of Door and Top of Finish Floor (No Threshold): Maximum 3/4 inch.
 2. Fire-Rated Doors: Install doors with clearances according to NFPA 80.
- D. Field Glazing: Comply with installation requirements in Division 08 Section "Glazing" and with hollow metal manufacturer's written instructions.

3.4 ADJUSTING AND CLEANING

- A. Final Adjustments: Check and readjust operating hardware items immediately before final inspection. Leave work in complete and proper operating condition. Remove and replace defective work, including hollow metal work that is warped, bowed, or otherwise unacceptable.
- B. Remove grout and other bonding material from hollow metal work immediately after installation.
- C. Prime-Coat and Painted Finish Touchup: Immediately after erection, sand smooth rusted or damaged areas of prime coat, or painted finishes, and apply touchup of compatible air drying, rust-inhibitive primer, zinc rich primer (exterior and galvanized openings) or finish paint.

END OF SECTION 081113

SECTION 081416 - FLUSH WOOD DOORS

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Solid core doors with wood veneer, hardboard or MDF faces.
2. Factory finishing wood doors.
3. Factory fitting wood doors to frames and factory machining for hardware.
4. Light frames and glazing installed in wood doors.

B. Standards and References: Comply with the version year adopted by the Authority Having Jurisdiction.

1. ANSI A208.1 – Wood Particleboard.
2. Intertek Testing Service (ITS Warnock Hersey) - Certification Listings for Fire Doors.
3. NFPA 80 - Standard for Fire Doors and Fire Windows; National Fire Protection Association.
4. NFPA 252 - Standard Methods of Fire Tests of Door Assemblies; National Fire Protection Association.
5. UL 10C - Positive Pressure Fire Tests of Door Assemblies; UL 1784 - Standard for Air Leakage Tests of Door Assemblies.
6. Window and Door Manufacturers Association - WDMA I.S.1-A Architectural Wood Flush Doors.

1.2 SUBMITTALS

A. Product Data: For each type of door indicated. Include details of core and edge construction, louvers, trim for openings, and WDMA I.S.1-A or AWS classifications. Include factory finishing specifications.

B. Door hardware supplier is to furnish templates, template reference number and/or physical hardware to the wood door supplier in order to prepare the doors and frames to receive the finish hardware items.

C. Shop Drawings: Indicate location, size, and hand of each door; elevation of each kind of door; construction details not covered in Product Data; location and extent of hardware blocking; and other pertinent data.

1. Indicate dimensions and locations of mortises and holes for hardware.
2. Indicate dimensions and locations of cutouts.
3. Indicate requirements for veneer matching.
4. Indicate doors to be factory finished and finish requirements.
5. Indicate fire protection ratings for fire rated doors.

D. Samples for Initial Selection: For factory finished doors.

1. Factory finishes applied to actual door face materials, approximately 8 by 10 inches, for each material and finish. For each wood species and transparent finish, provide set of three samples showing typical range of color and grain to be expected in the finished work.
2. Frames for light openings, 6 inches long, for each material, type, and finish required.

E. Warranty: Sample of special warranties.

1.3 QUALITY ASSURANCE

- A. Source Limitations: Obtain flush wood doors through one source from a single manufacturer wherever possible.
- B. Quality Standard: In addition to requirements specified, comply with WDMA I.S.1-A, latest edition, "Industry Standard for Architectural Wood Flush Doors".
- C. Fire Rated Wood Doors: Doors complying with NFPA 80 that are listed and labeled by a testing and inspecting agency acceptable to authorities having jurisdiction, for fire ratings indicated, based on testing at positive pressure according to NFPA 252 (neutral pressure at 40" above sill) or UL 10C (neutral pressure testing according to UL 10B where specified).
 - 1. Oversize Fire Rated Door Assemblies: For units exceeding sizes of tested assemblies provide manufacturer's construction label, indicating compliance to independent 3rd party certification agency's procedure, except for size.
 - 2. Temperature Rise Limit: Where indicated and at vertical exit enclosures (stairwell openings) and exit passageways, provide doors that have a maximum transmitted temperature end point of not more than 450 deg F (250 deg C) above ambient after 30 minutes of standard fire test exposure.
 - 3. Smoke Control Door Assemblies: Comply with NFPA 105.
 - 1) Smoke "S" Label: Doors to bear "S" label, and include smoke and draft control gasketing applied to frame and on meeting stiles of pair doors.
 - 4. Blocking: Indicate size and location of blocking in 45, 60 and 90 minute mineral core doors.
- D. Pre-Submittal Conference: Conduct conference in compliance with requirements in Division 01 Section "Project Meetings" with attendance by representatives of Supplier, Installer, and Contractor to review proper methods and procedures for receiving, handling, and installing flush wood doors.

1.4 DELIVERY, STORAGE, AND HANDLING

- A. Comply with requirements of referenced standard and manufacturer's written instructions.
- B. Package pre-finished doors individually in plastic bags or cardboard cartons and wrap bundles of doors in plastic sheeting.
- C. Mark each door on top rail with opening number used on Shop Drawings.

1.5 PROJECT CONDITIONS

- A. Environmental Limitations: Do not deliver or install doors until spaces are enclosed and weather tight, wet work in spaces is complete and dry, and HVAC system is operating and maintaining ambient temperature and humidity conditions at occupancy levels during the remainder of the construction period.

1.6 WARRANTY

- A. Special Warranty: Manufacturer's standard form in which manufacturer agrees to repair or replace doors that fail in materials or workmanship within specified warranty period.

1. Failures include, but are not limited to, the following:
 - a. Warping (bow, cup, or twist) more than 1/4 inch in a 42-by-84-inch section.
 - b. Telegraphing of core construction in wood face veneers exceeding 0.01 inch in a 3-inch span.
 - c. Telegraphing of core construction and delaminating of face in decorative laminate-faced doors.
2. Warranty includes installation and finishing that may be required due to repair or replacement of defective doors.
3. Warranty Period for Solid Core Interior Doors: Life of installation according to manufacturer's written warranty.

PART 2 - PRODUCTS

2.1 DOOR CONSTRUCTION – GENERAL

- A. WDMA I.S.1-A Performance Grade: Extra Heavy Duty; Aesthetic Grade: Premium.
- B. Fire Rated Doors: Provide construction and core as needed to provide fire ratings indicated.
 1. Category A Edge Construction: Provide fire rated door edge construction with intumescent seals concealed by outer stile (Category A) at 45, 60, and 90 minute rated doors. Comply with specified requirements for exposed edges.
 2. Pairs: Provide fire retardant stiles that are listed and labeled for applications indicated without formed steel edges and astragals. Provide stiles with concealed intumescent seals. Comply with specified requirements for exposed edges.
 - a. Where required or specified, provide formed steel edges and astragals with intumescent seals. Finish steel edges and astragals with baked enamel.

2.2 CORE CONSTRUCTION

- A. Particleboard Core Doors:
 1. Particleboard: Wood fiber based materials complying with ANSI A208.1 Particleboard standard. Grade LD-2.
 2. Adhesive: Fully bonded construction using Polyurethane (PUR) glue.
 3. Blocking: When through-bolted hardware is not used, provide wood blocking in particleboard core doors as follows:
 - a. 5-inch (125-mm) top-rail blocking, in doors indicated to have closers.
 - b. 5-inch (125-mm) mid-rail blocking, in doors indicated to have exit devices.
 - 1) Optional Cores for Blocking: Provide doors with either glued-wood-stave or structural-composite-lumber core instead of particleboard core for doors indicated to receive closers and exit devices.

4. Basis of Design:
 - a. Graham: PC, PC5

B. Mineral Core Doors:

1. Core: Non-combustible mineral product complying with requirements of referenced quality standard and testing and inspecting agency for fire protection rating indicated.
2. Blocking: Provide composite blocking with improved screw holding capability approved for use in doors of fire protection ratings indicated as needed to eliminate through-bolting hardware.
3. Edge Construction: At hinge stiles, provide laminated edge construction with improved screw holding capability and split resistance. Comply with specified requirements for exposed edges.
4. Basis of Design: Graham FD.

2.3 VENEERED DOORS FOR TRANSPARENT FINISH

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

1. Eggers Industries: Premium
2. Graham: GPD
3. Marshfield: Signature
4. VT Industries: Artistry

B. Interior Solid Core Doors:

1. Grade: Premium
2. Faces: Veneer grades as noted below; veneer minimum 1/50-inch (0.5mm) thickness at moisture content of 12% or less.
 - a. Plain Sliced Red Oak, A grade faces, to match existing.
3. Match between Veneer Leaves: Book match.
4. Assembly of Veneer Leaves on Door Faces: Running Match.
5. Pair and Set Match: Provide for doors hung in same opening or separated only by mullions.
6. Vertical Edges: Matching same species as faces. Wood or composite material, one piece, laminated, or veneered. Minimum requirements per WDMA section P-1, Performance Standards for Architectural Wood Flush Doors.
7. Horizontal Edges: Solid wood or structural composite material meeting the minimum requirements per WDMA section P-1, Performance Standards for Architectural Wood Flush Doors
8. Construction: Five plies. Stiles and rails are bonded to core, then entire unit sanded before applying face veneers.
9. At doors over 40% of the face cut-out for lights and or louvers, furnish engineered composite lumber core.

2.4 LIGHT FRAMES AND GLAZING

A. Wood Beads for Light Openings in Wood Doors up to and including 20-minute rating:

1. Wood Species: Same species as door faces.
 2. Profile: Manufacturer's standard lipped profile. At wood core doors with 20-minute fire protection ratings, provide wood beads and metal glazing clips approved for such use.
- B. Metal Frames for Light Openings in Fire Rated Doors over 20-minute rating: Manufacturer's standard frame formed of 0.048-inch-thick, cold rolled steel sheet; with baked enamel or powder coated finish; and approved for use in doors of fire protection rating indicated.
- C. Glazing: Comply with installation requirements in Division 08 Section "Glazing" and with the flush wood door manufacturer's written instructions.

2.5 FABRICATION

- A. Factory fit doors to suit frame opening sizes indicated. Comply with clearance requirements of referenced quality standard for fitting unless otherwise indicated.
1. Comply with requirements in NFPA 80 for fire rated doors.
- B. Factory machine doors for hardware that is not surface applied. Comply with final hardware schedules, door frame Shop Drawings, DHI A115-W series standards, and hardware templates.
1. Coordinate with hardware mortises in metal frames to verify dimensions and alignment before factory machining.
 2. Metal Astragals: Factory machine astragals and formed steel edges for hardware for pairs of fire rated doors.
- C. Openings: Cut and trim openings through doors in factory.
1. Light Openings: Trim openings with moldings of material and profile indicated.
 2. Glazing: Comply with applicable requirements in Division 08 Section "Glazing."
 3. Louvers: Factory install louvers in prepared openings.
- D. Electrical Raceways: Provide flush wood doors receiving electrified hardware with concealed wiring harness and standardized Molex™ plug connectors on both ends to accommodate up to twelve wires. Coordinate connectors on end of the wiring harness to plug directly into the electrified hardware and the through wire transfer hardware or wiring harness specified in hardware sets in Division 08 "Door Hardware". Wire nut connections are not acceptable.

2.6 FACTORY FINISHING

- A. General: Comply with referenced quality standard for factory finishing. Complete fabrication, including fitting doors for openings and machining for hardware that is not surface applied, before finishing.
1. Finish faces, all four edges, edges of cutouts, and mortises. Stains and fillers may be omitted on top and bottom edges, edges of cutouts, and mortises.
- B. Transparent Finish: Provide a clear protective coating over the wood veneer allowing the natural color and grain of the selected wood species to provide the appearance specified. Stain is applied to the wood surface underneath the transparent finish to add color and design flexibility.
1. Grade: Premium.

2. Finish: Meet or exceed WDMA I.S. 1A TR6 Catalyzed Polyurethane finish performance requirements.
3. Staining: To match existing.
4. Sheen: Satin.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine doors and installed door frames before hanging doors.
 1. Verify that frames comply with indicated requirements for type, size, location, and swing characteristics and have been installed with level heads and plumb jambs.
 2. Reject doors with defects.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 INSTALLATION

- A. Hardware: For installation, see Division 8 Section "Door Hardware."
- B. Installation Instructions: Install doors to comply with manufacturer's written instructions and the referenced quality standard, and as indicated.
 1. Install fire rated doors in corresponding fire rated frames according to NFPA 80.
- C. Factory Fitted Doors: Align in frames for uniform clearance at each edge.
- D. Factory Finished Doors: Restore finish before installation if fitting or machining is required at Project site.

3.3 ADJUSTING

- A. Operation: Re-hang or replace doors that do not swing or operate freely.
- B. Finished Doors: Replace doors that do not comply with requirements. Doors may be repaired or refinished if work complies with requirements and shows no evidence of repair or refinishing.

END OF SECTION 081416

SECTION 087100 – DOOR HARDWARE

PART 1 - GENERAL

1.1 SUMMARY

- A. This Section includes commercial door hardware for the following:
 - 1. Swinging doors.
 - 2. Other doors to the extent indicated.
- B. Door hardware includes, but is not necessarily limited to, the following:
 - 1. Mechanical door hardware.
- C. Codes and References: Comply with the version year adopted by the Authority Having Jurisdiction.
 - 1. ANSI A117.1 - Accessible and Usable Buildings and Facilities.
 - 2. ICC/IBC - International Building Code.
 - 3. NFPA 70 - National Electrical Code.
 - 4. NFPA 80 - Fire Doors and Windows.
 - 5. NFPA 101 - Life Safety Code.
 - 6. NFPA 105 - Installation of Smoke Door Assemblies.
 - 7. State Building Codes, Local Amendments.
- D. Standards: All hardware specified herein shall comply with the following industry standards:
 - 1. ANSI/BHMA Certified Product Standards - A156 Series
 - 2. UL10C – Positive Pressure Fire Tests of Door Assemblies

1.2 SUBMITTALS

- A. Product Data: Manufacturer's product data sheets including installation details, material descriptions, dimensions of individual components and profiles, operational descriptions and finishes.
- B. Door Hardware Schedule: Prepared by or under the supervision of supplier, detailing fabrication and assembly of door hardware, as well as procedures and diagrams. Coordinate the final Door Hardware Schedule with doors, frames, and related work to ensure proper size, thickness, hand, function, and finish of door hardware.
 - 1. Format: Comply with scheduling sequence and vertical format in DHI's "Sequence and Format for the Hardware Schedule."
 - 2. Organization: Organize the Door Hardware Schedule into door hardware sets indicating complete designations of every item required for each door or opening. Organize door hardware sets in same order as in the Door Hardware Sets at the end of Part 3. Submittals that do not follow the same format and order as the Door Hardware Sets will be rejected and subject to resubmission.

3. Content: Include the following information:
 - a. Type, style, function, size, label, hand, and finish of each door hardware item.
 - b. Manufacturer of each item.
 - c. Fastenings and other pertinent information.
 - d. Location of door hardware set, cross-referenced to Drawings, both on floor plans and in door and frame schedule.
 - e. Explanation of abbreviations, symbols, and codes contained in schedule.
 - f. Mounting locations for door hardware.
 - g. Door and frame sizes and materials.
 4. Submittal Sequence: Submit the final Door Hardware Schedule at earliest possible date, particularly where approval of the Door Hardware Schedule must precede fabrication of other work that is critical in the Project construction schedule. Include Product Data, Samples, Shop Drawings of other work affected by door hardware, and other information essential to the coordinated review of the Door Hardware Schedule.
- C. Keying Schedule: Prepared under the supervision of the Owner, separate schedule detailing final keying instructions for locksets and cylinders in writing. Include keying system explanation, door numbers, key set symbols, hardware set numbers and special instructions. Owner to approve submitted keying schedule prior to the ordering of permanent cylinders.
- D. Operating and Maintenance Manuals: Provide manufacturers operating and maintenance manuals for each item comprising the complete door hardware installation in quantity as required in Division 01, Closeout Submittals. The manual to include the name, address, and contact information of the manufacturers providing the hardware and their nearest service representatives. The final copies delivered after completion of the installation test to include "as built" modifications made during installation, checkout, and acceptance.
- E. Warranties and Maintenance: Special warranties and maintenance agreements specified in this Section.

1.3 QUALITY ASSURANCE

- A. Manufacturers Qualifications: Engage qualified manufacturers with a minimum 5 years of documented experience in producing hardware and equipment similar to that indicated for this Project and that have a proven record of successful in-service performance.
- B. Installer Qualifications: Installers, trained by the primary product manufacturers, with a minimum 3 years documented experience installing both standard and electrified builders hardware similar in material, design, and extent to that indicated for this Project and whose work has resulted in construction with a record of successful in-service performance.
- C. Door Hardware Supplier Qualifications: Experienced commercial door hardware distributors with a minimum 5 years documented experience supplying both mechanical and electromechanical hardware installations comparable in material, design, and extent to that indicated for this Project. Supplier recognized as a factory direct distributor in good standing by the manufacturers of the primary materials with a warehousing facility in Project's vicinity. Supplier to have on staff a certified Architectural Hardware Consultant (AHC) available during the course of the Work to consult with Contractor, Architect, and Owner concerning both standard and electromechanical door hardware and keying.
 1. Scheduling Responsibility: Preparation of door hardware and keying schedules.

- D. Source Limitations: Obtain each type and variety of Door Hardware specified in this Section from a single source, qualified supplier unless otherwise indicated.
1. Electrified modifications or enhancements made to a source manufacturer's product line by a secondary or third party source will not be accepted.
 2. Provide electromechanical door hardware from the same manufacturer as mechanical door hardware, unless otherwise indicated.
- E. Regulatory Requirements: Comply with NFPA 70, NFPA 80, NFPA 101 and ANSI A117.1 requirements and guidelines as directed in the model building code including, but not limited to, the following:
1. NFPA 70 "National Electrical Code", including electrical components, devices, and accessories listed and labeled as defined in Article 100 by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.
 2. Where indicated to comply with accessibility requirements, comply with Americans with Disabilities Act (ADA), "Accessibility Guidelines for Buildings and Facilities (ADAAG)," ANSI A117.1 as follows:
 - a. Handles, Pulls, Latches, Locks, and other Operating Devices: Shape that is easy to grasp with one hand and does not require tight grasping, tight pinching, or twisting of the wrist.
 - b. Door Closers: Comply with the following maximum opening-force requirements indicated:
 - 1) Interior Hinged Doors: 5 lbf applied perpendicular to door.
 - 2) Fire Doors: Minimum opening force allowable by authorities having jurisdiction.
 - c. Thresholds: Not more than 1/2 inch high. Bevel raised thresholds with a slope of not more than 1:2.
 3. NFPA 101: Comply with the following for means of egress doors:
 - a. Latches, Locks, and Exit Devices: Not more than 15 lbf to release the latch. Locks shall not require the use of a key, tool, or special knowledge for operation.
 - b. Thresholds: Not more than 1/2 inch high.
 4. Fire-Rated Door Assemblies: Provide door hardware for assemblies complying with NFPA 80 that are listed and labeled by a testing and inspecting agency acceptable to authorities having jurisdiction, for fire ratings indicated, based on testing according to NFPA 252 (neutral pressure at 40" above sill) or UL-10C.
 - a. Test Pressure: Positive pressure labeling.
- F. Each unit to bear third party permanent label demonstrating compliance with the referenced standards.
- G. Keying Conference: Conduct conference to comply with requirements in Division 01 Section "Project Meetings." Keying conference to incorporate the following criteria into the final keying schedule document:
1. Function of building, purpose of each area and degree of security required.
 2. Plans for existing and future key system expansion.
 3. Requirements for key control storage and software.

4. Installation of permanent keys, cylinder cores and software.
5. Address and requirements for delivery of keys.

H. Pre-Submittal Conference: Conduct coordination conference in compliance with requirements in Division 01 Section "Project Meetings" with attendance by representatives of Supplier(s), Installer(s), and Contractor(s) to review proper methods and the procedures for receiving, handling, and installing door hardware.

1. Prior to installation of door hardware, conduct a project specific training meeting to instruct the installing contractors' personnel on the proper installation and adjustment of their respective products. Product training to be attended by installers of door hardware (including electromechanical hardware) for aluminum, hollow metal and wood doors. Training will include the use of installation manuals, hardware schedules, templates and physical product samples as required.
2. Inspect and discuss electrical roughing-in, power supply connections, and other preparatory work performed by other trades.
3. Review sequence of operation narratives for each unique access controlled opening.
4. Review and finalize construction schedule and verify availability of materials.
5. Review the required inspecting, testing, commissioning, and demonstration procedures

I. At completion of installation, provide written documentation that components were applied to manufacturer's instructions and recommendations and according to approved schedule.

1.4 DELIVERY, STORAGE, AND HANDLING

- A. Inventory door hardware on receipt and provide secure lock-up and shelving for door hardware delivered to Project site. Do not store electronic access control hardware, software or accessories at Project site without prior authorization.
- B. Tag each item or package separately with identification related to the final Door Hardware Schedule, and include basic installation instructions with each item or package.
- C. Deliver, as applicable, permanent keys, cylinders, cores, access control credentials, software and related accessories directly to Owner via registered mail or overnight package service. Instructions for delivery to the Owner shall be established at the "Keying Conference".

1.5 COORDINATION

- A. Templates: Obtain and distribute to the parties involved templates for doors, frames, and other work specified to be factory prepared for installing standard and electrified hardware. Check Shop Drawings of other work to confirm that adequate provisions are made for locating and installing hardware to comply with indicated requirements.
- B. Door Hardware and Electrical Connections: Coordinate the layout and installation of scheduled electrified door hardware and related access control equipment with required connections to source power junction boxes, low voltage power supplies, detection and monitoring hardware, and fire and detection alarm systems.
- C. Door and Frame Preparation: Related Division 08 Sections (Steel, Aluminum and Wood) doors and corresponding frames are to be prepared, reinforced and pre-wired (if applicable) to receive the

installation of the specified electrified, monitoring, signaling and access control system hardware without additional in-field modifications.

1.6 WARRANTY

- A. General Warranty: Reference Division 01, General Requirements. Special warranties specified in this Article shall not deprive Owner of other rights Owner may have under other provisions of the Contract Documents and shall be in addition to, and run concurrent with, other warranties made by Contractor under requirements of the Contract Documents.
- B. Warranty Period: Written warranty, executed by manufacturer(s), agreeing to repair or replace components of standard and electrified door hardware that fails in materials or workmanship within specified warranty period after final acceptance by the Owner. Failures include, but are not limited to, the following:
 - 1. Structural failures including excessive deflection, cracking, or breakage.
 - 2. Faulty operation of the hardware.
 - 3. Deterioration of metals, metal finishes, and other materials beyond normal weathering.
 - 4. Electrical component defects and failures within the systems operation.
- C. Standard Warranty Period: One year from date of Substantial Completion, unless otherwise indicated.
- D. Special Warranty Periods:
 - 1. Five years for exit hardware.
 - 2. Twenty five years for manual surface door closers.

1.7 MAINTENANCE SERVICE

- A. Maintenance Tools and Instructions: Furnish a complete set of specialized tools and maintenance instructions as needed for Owner's continued adjustment, maintenance, and removal and replacement of door hardware.
- B. Continuing Service: Beginning at Substantial Completion, and running concurrent with the specified warranty period, provide continuous (6) months full maintenance including repair and replacement of worn or defective components, lubrication, cleaning, and adjusting as required for proper door opening operation. Provide parts and supplies as used in the manufacture and installation of original products.

PART 2 - PRODUCTS

2.1 SCHEDULED DOOR HARDWARE

- A. General: Provide door hardware for each door to comply with requirements in Door Hardware Sets and each referenced section that products are to be supplied under.
 - 1. Designations: Requirements for quantity, item, size, finish or color, grade, function, and other distinctive qualities of each type of door hardware are indicated in the Door Hardware Sets at the end of Part 3. Products are identified by using door hardware designations, as follows:

- a. Named Manufacturer's Products: Product designation and manufacturer are listed for each door hardware type required for the purpose of establishing requirements. Manufacturers' names are abbreviated in the Door Hardware Schedule.
- B. Substitutions: Requests for substitution and product approval for inclusive mechanical and electromechanical door hardware in compliance with the specifications must be submitted in writing and in accordance with the procedures and time frames outlined in Division 01, Substitution Procedures. Approval of requests is at the discretion of the architect, owner, and their designated consultants.

2.2 HANGING DEVICES

- A. Hinges: ANSI/BHMA A156.1 certified butt hinges with number of hinge knuckles as specified in the Door Hardware Sets.
 1. Quantity: Provide the following hinge quantity, unless otherwise indicated:
 - a. Two Hinges: For doors with heights up to 60 inches.
 - b. Three Hinges: For doors with heights 61 to 90 inches.
 - c. Four Hinges: For doors with heights 91 to 120 inches.
 - d. For doors with heights more than 120 inches, provide 4 hinges, plus 1 hinge for every 30 inches of door height greater than 120 inches.
 2. Hinge Size: Provide the following, unless otherwise indicated, with hinge widths sized for door thickness and clearances required:
 - a. Widths up to 3'0": 4-1/2" standard or heavy weight as specified.
 - b. Sizes from 3'1" to 4'0": 5" standard or heavy weight as specified.
 3. Hinge Options: Comply with the following where indicated in the Hardware Sets or on Drawings:
 - a. Non-removable Pins: Provide set screw in hinge barrel that, when tightened into a groove in hinge pin, prevents removal of pin while door is closed; for the following applications:
 - 1) Out-swinging exterior doors.
 - 2) Out-swinging access controlled doors.
 - 3) Out-swinging lockable doors.
 4. Acceptable Manufacturers:
 - a. Bommer Industries (BO).
 - b. Hager Companies (HA).
 - c. McKinney Products (MK).
- B. Continuous Geared Hinges: ANSI/BHMA A156.26 certified continuous geared hinge with minimum 0.120-inch thick extruded 6060 T6 aluminum alloy hinge leaves and a minimum overall width of 4 inches. Hinges are non-handed, reversible and fabricated to template screw locations. Provide concealed flush mount (with or without inset), full surface, or half surface, in standard and heavy duty models, as specified in the Hardware Sets. Concealed continuous hinges to be U.L. listed for use on up to and including 90 minute rated door installations and U.L. listed for windstorm components where applicable. Factory cut hinges for door size and provide with removable service power transfer panel where indicated at electrified openings.

1. Acceptable Manufacturers:
 - a. Bommer Industries (BO).
 - b. McKinney Products (MK).
 - c. Pemko Manufacturing (PE).

2.3 DOOR OPERATING TRIM

- A. Door Push Plates and Pulls: ANS/BHMA A156.6 certified door pushes and pulls of type and design specified below or in the Hardware Sets. Coordinate and provide proper width and height as required where conflicting hardware dictates.
 1. Push/Pull Plates: Minimum .050 inch thick, size as indicated in hardware sets, with beveled edges, secured with exposed screws unless otherwise indicated.
 2. Door Pull and Push Bar Design: Size, shape, and material as indicated in the hardware sets. Minimum clearance of 2 1/2-inches from face of door unless otherwise indicated.
 3. Offset Pull Design: Size, shape, and material as indicated in the hardware sets. Minimum clearance of 2 1/2-inches from face of door and offset of 90 degrees unless otherwise indicated.
 4. Fasteners: Provide manufacturer's designated fastener type as indicated in Hardware Sets.
 - a. Acceptable Manufacturers:
 - 1) Burns Manufacturing (BU).
 - 2) Rockwood Manufacturing (RO).
 - 3) Trimco (TC).

2.4 CYLINDERS AND KEYING

- A. General: Cylinder manufacturer to have minimum (10) years experience designing secured master key systems and have on record a published security keying system policy.
- B. Source Limitations: Obtain each type of keyed cylinder and keys from the same source manufacturer as locksets and exit devices, unless otherwise indicated.
- C. Cylinders: Original manufacturer cylinders complying with the following:
 1. Mortise Type: Threaded cylinders with rings and straight- or clover-type cam.
 2. Rim Type: Cylinders with back plate, flat-type vertical or horizontal tailpiece, and raised trim ring.
 3. Bored-Lock Type: Cylinders with tailpieces to suit locks.
 4. Mortise and rim cylinder collars to be solid and recessed to allow the cylinder face to be flush and be free spinning with matching finishes.
 5. Keyway: Match Facility Standard.
- D. Permanent Cores: Manufacturer's standard; finish face to match lockset; complying with the following:
 1. Removable Cores: Core insert, removable by use of a special key, and for use with only the core manufacturer's cylinder and door hardware. Provide removable core (small or large format) as specified in Hardware Sets.
- E. Security Cylinders: ANSI/BHMA A156.5, Grade 1, patented security cylinders and keys able to be used together under the same facility master or grandmaster key system. Cylinders are to be factory keyed.

1. Acceptable Manufacturers:
 - a. Corbin Russwin (RU) - Pyramid PS Series (Interior).
 - b. Sargent Manufacturing (SA) - KESO Series (Exterior).

- F. Keying System: Each type of lock and cylinders to be factory keyed. Conduct specified "Keying Conference" to define and document keying system instructions and requirements. Furnish factory cut, nickel-silver large bow permanently inscribed with a visual key control number as directed by Owner. Incorporate decisions made in keying conference, and as follows:
 1. Existing System: Master key or grand master key locks to Owner's existing system.

- G. Key Quantity: Provide the following minimum number of keys:
 1. Top Master Key: One (1)
 2. Change Keys per Cylinder: Two (2)
 3. Master Keys (per Master Key Group): Two (2)
 4. Grand Master Keys (per Grand Master Key Group): Two (2)
 5. Construction Keys (where required): Ten (10)
 6. Construction Control Keys (where required): Two (2)
 7. Permanent Control Keys (where required): Two (2)

- H. Construction Keying: Provide construction master keyed cylinders or temporary keyed construction cores where specified. Provide construction master keys in quantity as required by project Contractor. Replace construction cores with permanent cores. Furnish permanent cores for installation as directed under specified "Keying Conference".

- I. Key Registration List: Provide keying transcript list to Owner's representative in the proper format for importing into key control software.

2.5 MECHANICAL LOCKS AND LATCHING DEVICES

- A. Cylindrical Locksets, Grade 1 (Heavy Duty): ANSI/BHMA A156.2, Series 4000, Grade 1 certified cylindrical (bored) locksets furnished in the functions as specified in the Hardware Sets. Lock chassis fabricated of heavy gauge steel, zinc dichromate plated, with through-bolted application. Furnish with solid cast levers, standard 2 3/4" backset, and 1/2" (3/4" at rated paired openings) throw brass or stainless steel latchbolt. Locks are to be non-handed and fully field reversible.
 1. Acceptable Manufacturers:
 - a. Corbin Russwin Hardware (RU) – CL3300 Series.
 - b. No Substitution – Facility Standard.

- B. Lock Trim Design: As specified in Hardware Sets.

2.6 LOCK AND LATCH STRIKES

- A. Strikes: Provide manufacturer's standard strike with strike box for each latch or lock bolt, with curved lip extended to protect frame, finished to match door hardware set, unless otherwise indicated, and as follows:

1. Flat-Lip Strikes: For locks with three-piece antifriction latchbolts, as recommended by manufacturer.
2. Extra-Long-Lip Strikes: For locks used on frames with applied wood casing trim.
3. Aluminum-Frame Strike Box: Provide manufacturer's special strike box fabricated for aluminum framing.

B. Standards: Comply with the following:

1. Strikes for Mortise Locks and Latches: BHMA A156.13.
2. Strikes for Bored Locks and Latches: BHMA A156.2.
3. Strikes for Auxiliary Deadlocks: BHMA A156.5.
4. Dustproof Strikes: BHMA A156.16.

2.7 CONVENTIONAL EXIT DEVICES

A. General Requirements: All exit devices specified herein shall meet or exceed the following criteria:

1. At doors not requiring a fire rating, provide devices complying with NFPA 101 and listed and labeled for "Panic Hardware" according to UL305. Provide proper fasteners as required by manufacturer including sex nuts and bolts at openings specified in the Hardware Sets.
2. Where exit devices are required on fire rated doors, provide devices complying with NFPA 80 and with UL labeling indicating "Fire Exit Hardware". Provide devices with the proper fasteners for installation as tested and listed by UL. Consult manufacturer's catalog and template book for specific requirements.
 - a. Fire Exit Removable Mullions: Provide keyed removable mullions for use with fire exit devices complying with NFPA 80 that are listed and labeled by a testing and inspecting agency acceptable to authorities having jurisdiction, for fire and panic protection, based on testing according to UL 305 and NFPA 252. Mullions to be used only with exit devices for which they have been tested.
3. Except on fire rated doors, provide exit devices with hex key dogging device to hold the pushbar and latch in a retracted position. Provide optional keyed cylinder dogging on devices where specified in Hardware Sets.
4. Devices must fit flat against the door face with no gap that permits unauthorized dogging of the push bar. The addition of filler strips is not acceptable except in any case where the door light extends behind the device as in a full glass configuration.
5. Flush End Caps: Provide heavy weight impact resistant flush end caps made of architectural metal in the same finish as the devices as in the Hardware Sets. Plastic end caps will not be acceptable.
6. Lever Operating Trim: Where exit devices require lever trim, furnish manufacturer's heavy duty trim with cold forged escutcheons, beveled edges, and four threaded studs for thru-bolts.
 - a. Lock Trim Design: As indicated in Hardware Sets, provide finishes and designs to match that of the specified locksets. Provided free-wheeling type trim where indicated.
 - b. Where function of exit device requires a cylinder, provide an interchangeable core type keyed cylinder (Rim or Mortise) as specified in Hardware Sets.

7. Vertical Rod Exit Devices: Provide and install interior surface and concealed vertical rod exit devices as Less Bottom Rod (LBR) unless otherwise indicated.
 8. Narrow Stile Applications: At doors constructed with narrow stiles, or as specified in Hardware Sets, provide devices designed for maximum 2” wide stiles.
 9. Dummy Push Bar: Nonfunctioning push bar matching functional push bar.
 10. Rail Sizing: Provide exit device rails factory sized for proper door width application.
 11. Through Bolt Installation: For exit devices and trim as indicated in Door Hardware Sets.
- B. Conventional Push Rail Exit Devices (Heavy Duty): ANSI/BHMA A156.3, Grade 1 certified panic and fire exit hardware devices furnished in the functions specified in the Hardware Sets. Mounting rails to be formed from smooth stainless steel, brass or bronze architectural materials no less than 0.072" thick, with push rails a minimum of 0.062" thickness. Painted or aluminum metal rails are not acceptable. Exit device latch to be investment cast stainless steel, pullman type, with deadlock feature.
1. Acceptable Manufacturers:
 - a. Corbin Russwin Hardware (RU) - ED4000 / ED5000 Series.
 - b. Von Duprin (VD) - 35A/98 XP Series.
 - c. Yale Locks and Hardware (YA) - 7000 Series.
- C. Tube Steel Removable Mullions: ANSI/BHMA A156.3 removable steel mullions with malleable-iron top and bottom retainers and a primed paint finish. Provide keyed removable feature, stabilizers, and mounting brackets as specified in the Hardware Sets. At openings designed for severe wind load conditions due to hurricanes or tornadoes, provide manufacturers approved mullion and accessories to meet applicable state and local windstorm codes.
1. Acceptable Manufacturers:
 - a. Corbin Russwin Hardware (RU) - 700/900 Series.
 - b. Von Duprin (VD) - 9954 Series.
 - c. Yale Locks and Hardware (YA) - M200 Series.

2.8 DOOR CLOSERS

- A. All door closers specified herein shall meet or exceed the following criteria:
1. General: Door closers to be from one manufacturer, matching in design and style, with the same type door preparations and templates regardless of application or spring size. Closers to be non-handed with full sized covers including installation and adjusting information on inside of cover.
 2. Standards: Closers to comply with UL-10C and UBC 7-2 for Positive Pressure Fire Test and be U.L. listed for use of fire rated doors.
 3. Cycle Testing: Provide closers which have surpassed 15 million cycles in a test witnessed and verified by UL.
 4. Size of Units: Comply with manufacturer's written recommendations for sizing of door closers depending on size of door, exposure to weather, and anticipated frequency of use. Where closers

are indicated for doors required to be accessible to the physically handicapped, provide units complying with ANSI ICC/A117.1.

5. Closer Arms: Provide heavy duty, forged steel closer arms unless otherwise indicated in Hardware Sets.
 - a. Where closers are indicated to have mechanical dead-stop, provide heavy duty arms and brackets with an integral positive stop.
 - b. Where closers are indicated to have mechanical hold open, provide heavy duty units with an additional built-in mechanical holder assembly designed to hold open against normal wind and traffic conditions. Holder to be manually selectable to on-off position.
 - c. Where closers are indicated to have a cushion-type stop, provide heavy duty arms and brackets with spring stop mechanism to cushion door when opened to maximum degree.
 - d. Closers shall not be installed on exterior or corridor side of doors; where possible install closers on door for optimum aesthetics. Provide drop plates or other accessories as required for proper mounting.
 6. Closer Accessories: Provide door closer accessories including custom templates, special mounting brackets, spacers and drop plates, and through-bolt or security type fasteners as specified in the door Hardware Sets.
- B. Door Closers, Surface Mounted (Heavy Duty): ANSI/BHMA A156.4, Grade 1 surface mounted, heavy duty door closers with complete spring power adjustment, sizes 1 thru 6; and fully operational adjustable according to door size, frequency of use, and opening force. Closers to be rack and pinion type, one piece cast iron or aluminum alloy body construction, with adjustable backcheck and separate non-critical valves for closing sweep and latch speed control. Provide non-handed units standard.
1. Acceptable Manufacturers:
 - a. Corbin Russwin Hardware (RU) - DC8000 Series.
 - b. LCN Closers (LC) - 4040XP Series.
 - c. Norton Door Controls (NO) - 7500 Series.

2.9 ARCHITECTURAL TRIM

A. Door Protective Trim

1. General: Door protective trim units to be of type and design as specified below or in the Hardware Sets.
2. Size: Fabricate protection plates (kick, armor, or mop) not more than 2" less than door width (LDW) on stop side of single doors and 1" LDW on stop side of pairs of doors, and not more than 1" less than door width on pull side. Coordinate and provide proper width and height as required where conflicting hardware dictates. Height to be as specified in the Hardware Sets.
3. Metal Protection Plates: ANSI/BHMA A156.6 certified metal protection plates (kick, armor, or mop), beveled on four edges (B4E), fabricated from the following:
 - a. Stainless Steel: 300 series, 050-inch thick, with countersunk screw holes (CSK).
4. Fasteners: Provide manufacturer's designated fastener type as specified in the Hardware Sets.

5. Acceptable Manufacturers:

- a. Burns Manufacturing (BU).
- b. Rockwood Manufacturing (RO).
- c. Trimco (TC).

2.10 DOOR STOPS AND HOLDERS

A. General: Door stops and holders to be of type and design as specified below or in the Hardware Sets.

B. Door Stops and Bumpers: ANSI/BHMA A156.16, Grade 1 certified door stops and wall bumpers. Provide wall bumpers, either convex or concave types with anchorage as indicated, unless floor or other types of door stops are specified in Hardware Sets. Do not mount floor stops where they will impede traffic. Where floor or wall bumpers are not appropriate, provide overhead type stops and holders.

1. Acceptable Manufacturers:

- a. Burns Manufacturing (BU).
- b. Rockwood Manufacturing (RO).
- c. Trimco (TC).

2.11 ARCHITECTURAL SEALS

A. General: Thresholds, weatherstripping, and gasket seals to be of type and design as specified below or in the Hardware Sets. Provide continuous weatherstrip gasketing on exterior doors and provide smoke, light, or sound gasketing on interior doors where indicated. At exterior applications provide non-corrosive fasteners and elsewhere where indicated.

B. Smoke Labeled Gasketing: Assemblies complying with NFPA 105 that are listed and labeled by a testing and inspecting agency acceptable to authorities having jurisdiction, for smoke control ratings indicated, based on testing according to UL 1784.

1. Provide smoke labeled perimeter gasketing at all smoke labeled openings.

C. Fire Labeled Gasketing: Assemblies complying with NFPA 80 that are listed and labeled by a testing and inspecting agency acceptable to authorities having jurisdiction, for fire ratings indicated, based on testing according to UL-10C.

1. Provide intumescent seals as indicated to meet UL10C Standard for Positive Pressure Fire Tests of Door Assemblies, and UBC 7-2, Fire Tests of Door Assemblies.

D. Sound-Rated Gasketing: Assemblies that are listed and labeled by a testing and inspecting agency, for sound ratings indicated, based on testing according to ASTM E 1408.

E. Replaceable Seal Strips: Provide only those units where resilient or flexible seal strips are easily replaceable and readily available from stocks maintained by manufacturer.

F. Acceptable Manufacturers:

1. Pemko Manufacturing (PE).

2. Reese Enterprises, Inc. (RS).
3. Zero International (ZE).

2.12 FABRICATION

- A. Fasteners: Provide door hardware manufactured to comply with published templates generally prepared for machine, wood, and sheet metal screws. Provide screws according to manufacturers recognized installation standards for application intended.

2.13 FINISHES

- A. Standard: Designations used in the Hardware Sets and elsewhere indicate hardware finishes complying with ANSI/BHMA A156.18, including coordination with traditional U.S. finishes indicated by certain manufacturers for their products.
- B. Provide quality of finish, including thickness of plating or coating (if any), composition, hardness, and other qualities complying with manufacturer's standards, but in no case less than specified by referenced standards for the applicable units of hardware.
- C. Protect mechanical finishes on exposed surfaces from damage by applying a strippable, temporary protective covering before shipping.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine scheduled openings, with Installer present, for compliance with requirements for installation tolerances, labeled fire door assembly construction, wall and floor construction, and other conditions affecting performance.
- B. Notify architect of any discrepancies or conflicts between the door schedule, door types, drawings and scheduled hardware. Proceed only after such discrepancies or conflicts have been resolved in writing.

3.2 PREPARATION

- A. Hollow Metal Doors and Frames: Comply with ANSI/DHI A115 series.
- B. Wood Doors: Comply with ANSI/DHI A115-W series.

3.3 INSTALLATION

- A. Install each item of mechanical and electromechanical hardware and access control equipment to comply with manufacturer's written instructions and according to specifications.
 1. Installers are to be trained and certified by the manufacturer on the proper installation and adjustment of fire, life safety, and security products including: hanging devices; locking devices; closing devices; and seals.

- B. Mounting Heights: Mount door hardware units at heights indicated in following applicable publications, unless specifically indicated or required to comply with governing regulations:
 - 1. Standard Steel Doors and Frames: DHI's "Recommended Locations for Architectural Hardware for Standard Steel Doors and Frames."
 - 2. Wood Doors: DHI WDHS.3, "Recommended Locations for Architectural Hardware for Wood Flush Doors."
 - 3. Where indicated to comply with accessibility requirements, comply with ANSI A117.1 "Accessibility Guidelines for Buildings and Facilities."
 - 4. Provide blocking in drywall partitions where wall stops or other wall mounted hardware is located.
- C. Retrofitting: Install door hardware to comply with manufacturer's published templates and written instructions. Where cutting and fitting are required to install door hardware onto or into surfaces that are later to be painted or finished in another way, coordinate removal, storage, and reinstallation of surface protective trim units with finishing work specified in Division 9 Sections. Do not install surface-mounted items until finishes have been completed on substrates involved.
- D. Thresholds: Set thresholds for exterior and acoustical doors in full bed of sealant complying with requirements specified in Division 7 Section "Joint Sealants."
- E. Storage: Provide a secure lock up for hardware delivered to the project but not yet installed. Control the handling and installation of hardware items so that the completion of the work will not be delayed by hardware losses before and after installation.

3.4 FIELD QUALITY CONTROL

- A. Field Inspection: Supplier will perform a final inspection of installed door hardware and state in report whether work complies with or deviates from requirements, including whether door hardware is properly installed, operating and adjusted.

3.5 ADJUSTING

- A. Initial Adjustment: Adjust and check each operating item of door hardware and each door to ensure proper operation or function of every unit. Replace units that cannot be adjusted to operate as intended. Adjust door control devices to compensate for final operation of heating and ventilating equipment and to comply with referenced accessibility requirements.

3.6 CLEANING AND PROTECTION

- A. Protect all hardware stored on construction site in a covered and dry place. Protect exposed hardware installed on doors during the construction phase. Install any and all hardware at the latest possible time frame.
- B. Clean adjacent surfaces soiled by door hardware installation.
- C. Clean operating items as necessary to restore proper finish. and provide final protection and maintain conditions that ensure door hardware is without damage or deterioration at time of owner occupancy.

3.7 DEMONSTRATION

- A. Instruct Owner's maintenance personnel to adjust, operate, and maintain mechanical and electromechanical door hardware.

3.8 DOOR HARDWARE SCHEDULE

- A. The hardware sets represent the design intent and direction of the owner and architect. They are a guideline only and should not be considered a detailed hardware schedule. Discrepancies, conflicting hardware and missing items should be brought to the attention of the architect with corrections made prior to the bidding process. Omitted items not included in a hardware set should be scheduled with the appropriate additional hardware required for proper application and functionality.
- B. Manufacturer’s Abbreviations:

- 1. MK - McKinney
- 2. RU - Corbin Russwin
- 3. SA - Sargent
- 4. RO - Rockwood
- 5. NO - Norton
- 6. PE - Pemko

Hardware Schedule

Set: 1.0

Doors: 117/1

3 Hinge	TA2714	US26D	MK
1 Cylindrical Lock (storeroom)	CL3357 PZD CTP	626	RU
1 Cylinder Core (Pyramid)	8027		RU
1 Door Closer	R7500	689	NO
1 Kick Plate	K1050 8" 4BE	US32D	RO
1 Door Stop	403 (or) 441CU	US26D	RO
1 Gasketing	S88BL		PE

Set: 2.0

Doors: 117A/1

3 Hinge	TA2714	US26D	MK
1 Cylindrical Lock (storeroom)	CL3357 PZD CTP	626	RU
1 Cylinder Core (Pyramid)	8027		RU
1 Door Closer	PR7500	689	NO
1 Kick Plate	K1050 8" 4BE	US32D	RO

1 Door Stop	403 (or) 441CU	US26D	RO
1 Gasketing	S88BL		PE

Set: 3.0

Doors: B114/1

3 Hinge	TA2714	US26D	MK
1 Cylindrical Lock (privacy)	CL3320 PZD	626	RU
1 Door Closer	CLP7500	689	NO
1 Kick Plate	K1050 8" 4BE	US32D	RO
3 Silencer	608 (or) 609	GRY	RO

Set: 4.0

Doors: 107/1, 108/1, 109/1, 110/1, 111/1, 112/1, 113/1, 114/1

3 Hinge (heavy weight)	T4A3786	US26D	MK
1 Cylindrical Lock (classroom intruder)	CL3352 PZD CTPD	626	RU
1 Cylinder Core (Pyramid)	8027		RU
1 Door Closer	PR7500	689	NO
1 Kick Plate	K1050 8" 4BE	US32D	RO
1 Door Stop	403 (or) 441CU	US26D	RO
1 Gasketing	S773BL		PE

Set: 5.0

Doors: 118/2

6 Hinge (heavy weight)	T4A3786	US26D	MK
2 Push/Pull Bar Set	BF15847 T1	US32D	RO
2 Door Closer	PR7500	689	NO
2 Door Stop	403 (or) 441CU	US26D	RO
1 Threshold	166A MSES10SS		PE
1 Gasketing	S773BL		PE
2 Sweep	315CN		PE
2 Astragal	297AS		PE

Set: 6.0

Doors: 115/1, 118/1

2 Continuous Hinge	MCK-12HD - DOOR HEIGHT	CL	MK
1 Removable Mullion	900BKM - DOOR HEIGHT		RU
1 Exit Device (rim, dummy trim)	ED4200 P1050 M52	630	RU
1 Exit Device (rim, nightlatch)	ED4200 P1057 M52	630	RU
3 Cylinder (KESO, mortise)	82-72 CMK	US26D	SA

1 Cylinder (KESO, rim)	82-64 CMK	US26D	SA
2 Door Closer	PR7500	689	NO
2 Door Stop - HD Floor	471	US26D	RO
1 Threshold	270A MSES25SS		PE
2 Sweep	3452CNB		PE

Notes: Perimeter/meeting stile seals by door/frame supplier.

END OF SECTION 087100

SECTION 096813 - TILE CARPETING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes modular carpet tile.
- B. Related Requirements:
 - 1. Section 096513 "Resilient Base and Accessories" for resilient wall base and accessories installed with carpet tile.

1.3 ACTION SUBMITTALS

- A. Product Data: For each type of product.
 - 1. Include manufacturer's written data on physical characteristics, durability, and fade resistance.
 - 2. Include installation recommendations for each type of substrate.
- B. Samples: For each of the following products and for each color and texture required. Label each Sample with manufacturer's name, material description, color, pattern, and designation indicated on Drawings and in schedules.

1.4 CLOSEOUT SUBMITTALS

- A. Maintenance Data: For carpet tiles to include in maintenance manuals. Include the following:
 - 1. Methods for maintaining carpet tile, including cleaning and stain-removal products and procedures and manufacturer's recommended maintenance schedule.
 - 2. Precautions for cleaning materials and methods that could be detrimental to carpet tile.

1.5 MAINTENANCE MATERIAL SUBMITTALS

- A. Furnish extra materials, from the same product run, that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.
 - 1. Carpet Tile: Full-size units equal to 100 percent of amount installed for each type indicated.

1.6 QUALITY ASSURANCE

- A. **Installer Qualifications:** An experienced installer who is certified by the International Certified Floorcovering Installers Association at the Commercial II or Master II certification level.
- B. **Fire-Test-Response Ratings:** Where indicated, provide carpet tile identical to those of assemblies tested for fire response according to NFPA 253 by a qualified testing agency.

1.7 DELIVERY, STORAGE, AND HANDLING

- A. Comply with CRI 104.

1.8 FIELD CONDITIONS

- A. Comply with CRI 104 for temperature, humidity, and ventilation limitations.
- B. **Environmental Limitations:** Do not deliver or install carpet tiles until spaces are enclosed and weathertight, wet work in spaces is complete and dry, and ambient temperature and humidity conditions are maintained at occupancy levels during the remainder of the construction period.
- C. Do not install carpet tiles over concrete slabs until slabs have cured and are sufficiently dry to bond with adhesive and concrete slabs have pH range recommended by carpet tile manufacturer.
- D. Where demountable partitions or other items are indicated for installation on top of carpet tiles, install carpet tiles before installing these items.

1.9 WARRANTY

- A. **Special Warranty for Carpet Tiles:** Manufacturer agrees to repair or replace components of carpet tile installation that fail in materials or workmanship within specified warranty period.
 - 1. Warranty does not include deterioration or failure of carpet tile due to unusual traffic, failure of substrate, vandalism, or abuse.
 - 2. Failures include, but are not limited to, more than 10 percent edge raveling, snags, runs, dimensional stability, excess static discharge, loss of tuft bind strength, loss of face fiber, and delamination.
 - 3. **Warranty Period:** 10 years from date of Substantial Completion.

PART 2 - PRODUCTS

2.1 CARPET TILE (CPT-1)

- A. **Basis-of-Design Product:** Subject to compliance with requirements, provide Tandus; Abrasive Action II or comparable product by one of the following:
 - 1. Mannington
 - 2. Shaw.
- B. **Characteristics:**

1. Color: As selected by Architect from manufacturer's full range.
2. Dye Method: 100 percent solution dyed.
3. Fiber Type: TDX Nylon.
4. Pile Characteristic: Accuweave patterned loop.
5. Tuft Density: 96 tufts per square inch.
6. Pile Height (average): .0187 inches.
7. Stitches: 8.0 per inch.
8. Gage: 1/12.
9. Backing System: Powerbond, or approved equivalent.
10. Size: 24 by 24 inches (610 by 610 mm).
11. Applied Soil-Resistance Treatment: Ensure.

2.2 INSTALLATION ACCESSORIES

- A. Trowelable Leveling and Patching Compounds: Latex-modified, hydraulic-cement-based formulation provided or recommended by carpet tile manufacturer.
- B. Adhesives: Water-resistant, mildew-resistant, nonstaining, pressure-sensitive type to suit products and subfloor conditions indicated, that complies with flammability requirements for installed carpet tile and is recommended by carpet tile manufacturer for releasable installation.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine substrates, areas, and conditions, with Installer present, for compliance with requirements for maximum moisture content, alkalinity range, installation tolerances, and other conditions affecting carpet tile performance. Examine carpet tile for type, color, pattern, and potential defects.
- B. Concrete Subfloors: Verify that concrete slabs comply with ASTM F 710 and the following:
 1. Slab substrates are dry and free of curing compounds, sealers, hardeners, and other materials that may interfere with adhesive bond. Determine adhesion and dryness characteristics by performing bond and moisture tests recommended by carpet tile manufacturer.
 2. Subfloor finishes comply with requirements specified in Section 033000 "Cast-in-Place Concrete" for slabs receiving carpet tile.
 3. Subfloors are free of cracks, ridges, depressions, scale, and foreign deposits.

3.2 PREPARATION

- A. General: Comply with CRI 104, Section 6.2, "Site Conditions; Floor Preparation," and with carpet tile manufacturer's written installation instructions for preparing substrates indicated to receive carpet tile installation.
- B. Use trowelable leveling and patching compounds, according to manufacturer's written instructions, to fill cracks, holes, depressions, and protrusions in substrates. Fill or level cracks, holes and depressions 1/8 inch (3 mm) wide or wider and protrusions more than 1/32 inch (0.8 mm) unless more stringent requirements are required by manufacturer's written instructions.

- C. Remove coatings, including curing compounds, and other substances that are incompatible with adhesives and that contain soap, wax, oil, or silicone, without using solvents. Use mechanical methods recommended in writing by carpet tile manufacturer.
- D. Broom and vacuum clean substrates to be covered immediately before installing carpet tile.

3.3 INSTALLATION

- A. General: Comply with CRI 104, Section 14, "Carpet Modules," and with carpet tile manufacturer's written installation instructions.
- B. Installation Method: As recommended in writing by carpet tile manufacturer.
- C. Maintain dye lot integrity. Do not mix dye lots in same area.
- D. Cut and fit carpet tile to butt tightly to vertical surfaces, permanent fixtures, and built-in furniture including cabinets, pipes, outlets, edgings, thresholds, and nosings. Bind or seal cut edges as recommended by carpet tile manufacturer.
- E. Extend carpet tile into toe spaces, door reveals, closets, open-bottomed obstructions, removable flanges, alcoves, and similar openings.
- F. Maintain reference markers, holes, and openings that are in place or marked for future cutting by repeating on finish flooring as marked on subfloor. Use nonpermanent, nonstaining marking device.
- G. Install pattern parallel to walls and borders.

3.4 CLEANING AND PROTECTION

- A. Perform the following operations immediately after installing carpet tile:
 - 1. Remove excess adhesive, seam sealer, and other surface blemishes using cleaner recommended by carpet tile manufacturer.
 - 2. Remove yarns that protrude from carpet tile surface.
 - 3. Vacuum carpet tile using commercial machine with face-beater element.
- B. Protect installed carpet tile to comply with CRI 104, Section 16, "Protecting Indoor Installations."
- C. Protect carpet tile against damage from construction operations and placement of equipment and fixtures during the remainder of construction period. Use protection methods indicated or recommended in writing by carpet tile manufacturer.

END OF SECTION 096813