

***STATE OF DELAWARE  
DELAWARE STATE COURTS  
OMB/DFM CONTRACT # MC1002000170***

***SPECIFICATIONS  
FOR***

***SPRINKLER SYSTEM INSTALLATION***

***AT***

***SUPREME COURT BUILDING  
DOVER, DELAWARE***



***ISSUED FOR BID  
MAY 2013***

***DEDC PROJECT # 11P379***

**TABLE OF CONTENTS**

- A. Specifications for this project are arranged in accordance with the Construction Specification Institute numbering system and format. Section numbering is discontinuous and all numbers not appearing in the Table of Contents are not used for this Project.
- B. DOCUMENTS BOUND HEREWITH

**DIVISION 0 – PROCUREMENT AND CONTRACT REQUIREMENTS****INTRODUCTORY INFORMATION**

00 01 01 - PROJECT TITLE PAGE	1 page
00 01 10 - TABLE OF CONTENTS	2 pages
00 01 15 - LIST OF DRAWING SHEETS	1 page

**PROCUREMENT REQUIREMENTS**

00 11 16 - INVITATION TO BID	1 page
00 21 13 - INSTRUCTIONS TO BIDDERS	12 pages
00 41 13 - BID FORM	5 pages
00 43 13 - BID BOND	1 page

**CONTRACTING REQUIREMENTS**

00 52 13 – STANDARD FORM OF AGREEMENT BETWEEN OWNER AND CONTRACTOR (SAMPLE AIA A101)	1 page 7 pages
00 54 13- SUPPLEMENT TO THE CONTRACT FOR CONSTRUCTION	1 page
00 61 13.13 - PERFORMANCE BOND	2 pages
00 61 13.16 - PAYMENT BOND	2 pages
00 62 76 - APPLICATION AND CERTIFICATE FOR PAYMENT FORMS (SAMPLE AIA G702 & G703)	1 page 2 pages
00 72 13 - GENERAL CONDITIONS TO THE CONTRACT (SAMPLE AIA A201)	1 page 41 pages
00 73 13 - SUPPLEMENTARY GENERAL CONDITIONS	11 pages
00 73 46 - WAGE RATE REQUIREMENTS	1 page
00 81 13 - GENERAL REQUIREMENTS	14 pages

**DIVISION 01 – GENERAL REQUIREMENTS**

01 10 00 – SUMMARY	2 pages
01 20 00 - PRICE AND PAYMENT PROCEDURES	2 pages

01 30 00 - ADMINISTRATIVE REQUIREMENTS	5 pages
01 40 00 - QUALITY REQUIREMENTS	3 pages
01 50 00 - TEMPORARY FACILITIES AND CONTROLS	1 page
01 55 00 – VEHICULAR ACCESS AND PARKING	1 page
01 60 00 - PRODUCT REQUIREMENTS	4 pages
01 70 00 - EXECUTION AND CLOSEOUT REQUIREMENTS	7 pages
01 74 19 - CONSTRUCTION WASTE MANAGEMENT AND DISPOSAL	5 pages
01 78 00 - CLOSEOUT SUBMITTALS	3 pages
01 79 00 - DEMONSTRATION AND TRAINING	3 pages
01 91 13 - GENERAL COMMISSIONING REQUIREMENTS	4 pages

**DIVISION 7 – THERMAL AND MOISTURE PROTECTION**

07 84 00 – FIRESTOPPING

**DIVISION 21 – FIRE SUPPRESSION**

21 13 00 – FIRE SUPPRESSION SPRINKLER SYSTEMS

**DIVISION 26 – ELECTRICAL**

26 0519 - LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 V AND LESS)  
26 05 26 - GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS  
26 05 29 - HANGERS AND SUPPORTS FOR ELECTRICAL SYSTEMS  
26 05 34 - CONDUIT  
26 05 37 - BOXES  
26 05 53 - IDENTIFICATION FOR ELECTRICAL SYSTEMS  
26 27 01 – ELECTRICAL SERVICE ENTRANCE  
26 27 17 - EQUIPMENT WIRING  
26 28 17 - ENCLOSED CIRCUIT BREAKERS

END OF TABLE OF CONTENTS

**LIST OF DRAWING SHEETS**

COVER SHEET

FS-1 FIRE SUPPRESSION SYSTEM - BASEMENT PLAN

FS-2 FIRE SUPPRESSION SYSTEM – FIRST AND SECOND FLOOR PLANS

FS-3 FIRE SUPPRESSION SYSTEM – ATTIC PLANS AND NOTES

FS-4 FIRE SUPPRESSION SYSTEM – SYSTEM DETAILS AND NOTES

FS-5 FIRE SUPPRESSION SYSTEM – WATER SUPPLY AND FDC DETAILS

E-0 ELECTRICAL – LEGEND AND ABBREVIATIONS

E-1 ELECTRICAL – PARTIAL LOWER LEVEL & SITE PLAN

Not For Bidding Purposes

**INVITATION TO BID**

Sealed bids for OMB/DFM Contract No. MC1002000170, Supreme Court Building, Sprinkler System Installation, will be received by the State of Delaware, Office of Management and Budget, Division of Facilities Management, at the Thomas Collins Building 3<sup>rd</sup> floor Conference Room until 3:00 p.m. local time on Thursday, June 6, 2013, at which time they will be publicly opened and read aloud in the Conference Room. Bidder bears the risk of late delivery. Any bids received after the stated time will be returned unopened.

Project involves the installation of a new sprinkler system, in the basement level, first and second floor and attic area, including all new piping and associated items to complete the system in its entirety.

A **MANDATORY** Pre-Bid Meeting will be held on Thursday, May 16, 2013 at 1:00 p.m. at Supreme Court Building, The Green, Dover, DE, for the purpose of establishing the listing of subcontractors and to answer questions. Representatives of each party to any Joint Venture must attend this meeting. **ATTENDANCE OF THIS MEETING IS A PREREQUISITE FOR BIDDING ON THIS CONTRACT.**

Sealed bids shall be addressed to the Division of Facilities Management, Suite 1, 540 S. DuPont Highway, Dover, DE, 19901. The outer envelope should clearly indicate: "**OMB/DFM CONTRACT NO. MC1002000170 – Supreme Court Building - Sprinkler System Installation - SEALED BID - DO NOT OPEN.**"

Contract documents may be obtained at the office of DEDC, Inc. upon receipt of \$75.00 per set/non-refundable. Checks are to be made payable to "Delaware Engineering and Design Corporation."

Construction documents will be available for review at the following locations: DEDC, Association of Builders and Contractors, and Delaware Contractors Association.

Minority Business Enterprises (MBE), Disadvantaged Business Enterprises (DBE) and Women-Owned Business Enterprises (WBE) will be afforded full opportunity to submit bids on this contract and will not be subject to discrimination on the basis of race, color, national origin or sex in consideration of this award. Each bid must be accompanied by a bid security equivalent to ten percent of the bid amount and all additive alternates. The successful bidder must post a performance bond and payment bond in a sum equal to 100 percent of the contract price upon execution of the contract. The Owner reserves the right to reject any or all bids and to waive any informalities therein. The Owner may extend the time and place for the opening of the bids from that described in the advertisement, with not less than two calendar days notice by certified delivery, facsimile machine or other electronic means to those bidders receiving plans.

## INSTRUCTIONS TO BIDDERS

### TABLE OF ARTICLES

1. DEFINITIONS
2. BIDDER'S REPRESENTATION
3. BIDDING DOCUMENTS
4. BIDDING PROCEDURES
5. CONSIDERATION OF BIDS
6. POST-BID INFORMATION
7. PERFORMANCE BOND AND PAYMENT BOND
8. FORM OF AGREEMENT BETWEEN OWNER AND CONTRACTOR

Not For Bidding Purposes

**ARTICLE 1: GENERAL**

## 1.1 DEFINITIONS

1.1.1 Whenever the following terms are used, their intent and meaning shall be interpreted as follows:

1.2 STATE: The State of Delaware.

1.3 AGENCY: Contracting State Agency as noted on cover sheet.

1.4 DESIGNATED OFFICIAL: The agent authorized to act for the Agency.

1.5 BIDDING DOCUMENTS: Bidding Documents include the Bidding Requirements and the proposed Contract Documents. The Bidding Requirements consist of the Advertisement for Bid, Invitation to Bid, Instructions to Bidders, Supplementary Instructions to Bidders (if any), General Conditions, Supplementary General Conditions, General Requirements, Special Provisions (if any), the Bid Form (including the Non-collusion Statement), and other sample bidding and contract forms. The proposed Contract Documents consist of the form of Agreement between the Owner and Contractor, as well as the Drawings, Specifications (Project Manual) and all Addenda issued prior to execution of the Contract.

1.6 CONTRACT DOCUMENTS: The Contract Documents consist of the, Instructions to Bidders, Supplementary Instructions to Bidders (if any), General Conditions, Supplementary General Conditions, General Requirements, Special Provisions (if any), the form of agreement between the Owner and the Contractor, Drawings (if any), Specifications (Project Manual), and all addenda.

1.7 AGREEMENT: The form of the Agreement shall be AIA Document A101, Standard Form of Agreement between Owner and Contractor where the basis of payment is a STIPULATED SUM. In the case of conflict between the instructions contained therein and the General Requirements herein, these General Requirements shall prevail.

1.8 GENERAL REQUIREMENTS (or CONDITIONS): General Requirements (or conditions) are instructions pertaining to the Bidding Documents and to contracts in general. They contain, in summary, requirements of laws of the State; policies of the Agency and instructions to bidders.

1.9 SPECIAL PROVISIONS: Special Provisions are specific conditions or requirements peculiar to the bidding documents and to the contract under consideration and are supplemental to the General Requirements. Should the Special Provisions conflict with the General Requirements, the Special Provisions shall prevail.

1.10 ADDENDA: Written or graphic instruments issued by the Owner/Architect prior to the execution of the contract which modify or interpret the Bidding Documents by additions, deletions, clarifications or corrections.

1.11 BIDDER OR VENDOR: A person or entity who formally submits a Bid for the material or Work contemplated, acting directly or through a duly authorized representative who meets the requirements set forth in the Bidding Documents.

1.12 SUB-BIDDER: A person or entity who submits a Bid to a Bidder for materials or labor, or both for a portion of the Work.

- 1.13 BID: A complete and properly executed proposal to do the Work for the sums stipulated therein, submitted in accordance with the Bidding Documents.
- 1.14 BASE BID: The sum stated in the Bid for which the Bidder offers to perform the Work described in the Bidding Documents as the base, to which Work may be added or from which Work may be deleted for sums stated in Alternate Bids (if any are required to be stated in the bid).
- 1.15 ALTERNATE BID (or ALTERNATE): An amount stated in the Bid, where applicable, to be added to or deducted from the amount of the Base Bid if the corresponding change in the Work, as described in the Bidding Documents is accepted.
- 1.16 UNIT PRICE: An amount stated in the Bid, where applicable, as a price per unit of measurement for materials, equipment or services or a portion of the Work as described in the Bidding Documents.
- 1.17 SURETY: The corporate body which is bound with and for the Contract, or which is liable, and which engages to be responsible for the Contractor's payments of all debts pertaining to and for his acceptable performance of the Work for which he has contracted.
- 1.18 BIDDER'S DEPOSIT: The security designated in the Bid to be furnished by the Bidder as a guaranty of good faith to enter into a contract with the Agency if the Work to be performed or the material or equipment to be furnished is awarded to him.
- 1.19 CONTRACT: The written agreement covering the furnishing and delivery of material or work to be performed.
- 1.20 CONTRACTOR: Any individual, firm or corporation with whom a contract is made by the Agency.
- 1.21 SUBCONTRACTOR: An individual, partnership or corporation which has a direct contract with a contractor to furnish labor and materials at the job site, or to perform construction labor and furnish material in connection with such labor at the job site.
- 1.22 CONTRACT BOND: The approved form of security furnished by the contractor and his surety as a guaranty of good faith on the part of the contractor to execute the work in accordance with the terms of the contract.

## **ARTICLE 2: BIDDER'S REPRESENTATIONS**

- 2.1 PRE-BID MEETING
- 2.1.1 A pre-bid meeting for this project will be held at the time and place designated. Attendance at this meeting is a pre-requisite for submitting a Bid, unless this requirement is specifically waived elsewhere in the Bid Documents.
- 2.2 By submitting a Bid, the Bidder represents that:
- 2.2.1 The Bidder has read and understands the Bidding Documents and that the Bid is made in accordance therewith.
- 2.2.2 The Bidder has visited the site, become familiar with existing conditions under which the Work is to be performed, and has correlated the Bidder's his personal observations with the requirements of the proposed Contract Documents.

2.2.3 The Bid is based upon the materials, equipment, and systems required by the Bidding Documents without exception.

### 2.3 JOINT VENTURE REQUIREMENTS

2.3.1 For Public Works Contracts, each Joint Venturer shall be qualified and capable to complete the Work with their own forces.

2.3.2 Included with the Bid submission, and as a requirement to bid, a copy of the executed Joint Venture Agreement shall be submitted and signed by all Joint Venturers involved.

2.3.3 All required Bid Bonds, Performance Bonds, Material and Labor Payment Bonds must be executed by both Joint Venturers and be placed in both of their names.

2.3.4 All required insurance certificates shall name both Joint Venturers.

2.3.5 Both Joint Venturers shall sign the Bid Form and shall submit a valid Delaware Business License Number with their Bid or shall state that the process of application for a Delaware Business License has been initiated.

2.3.6 Both Joint Venturers shall include their Federal E.I. Number with the Bid.

2.3.7 In the event of a mandatory Pre-bid Meeting, each Joint Venturer shall have a representative in attendance.

2.3.8 Due to exceptional circumstances and for good cause shown, one or more of these provisions may be waived at the discretion of the State.

### 2.4 ASSIGNMENT OF ANTITRUST CLAIMS

2.4.1 As consideration for the award and execution by the Owner of this contract, the Contractor hereby grants, conveys, sells, assigns and transfers to the State of Delaware all of its right, title and interests in and to all known or unknown causes of action it presently has or may now or hereafter acquire under the antitrust laws of the United States and the State of Delaware, relating to the particular goods or services purchased or acquired by the Owner pursuant to this contract.

## ARTICLE 3: BIDDING DOCUMENTS

### 3.1 COPIES OF BID DOCUMENTS

3.1.1 Bidders may obtain complete sets of the Bidding Documents from the Architectural/Engineering firm designated in the Advertisement or Invitation to Bid in the number and for the deposit sum, if any, stated therein.

3.1.2 Bidders shall use complete sets of Bidding Documents for preparation of Bids. The issuing Agency nor the Architect assumes no responsibility for errors or misinterpretations resulting from the use of incomplete sets of Bidding Documents.

3.1.3 Any errors, inconsistencies or omissions discovered shall be reported to the Architect immediately.

3.1.4 The Agency and Architect may make copies of the Bidding Documents available on the above terms for the purpose of obtaining Bids on the Work. No license or grant of use is conferred by issuance of copies of the Bidding Documents.

### 3.2 INTERPRETATION OR CORRECTION OF BIDDING DOCUMENTS

3.2.1 The Bidder shall carefully study and compare the Bidding Documents with each other, and with other work being bid concurrently or presently under construction to the extent that it relates to the Work for which the Bid is submitted, shall examine the site and local conditions, and shall report any errors, inconsistencies, or ambiguities discovered to the Architect.

3.2.2 Bidders or Sub-bidders requiring clarification or interpretation of the Bidding Documents shall make a written request to the Architect at least seven days prior to the date for receipt of Bids. Interpretations, corrections and changes to the Bidding Documents will be made by written Addendum. Interpretations, corrections, or changes to the Bidding Documents made in any other manner shall not be binding.

3.2.3 The apparent silence of the specifications as to any detail, or the apparent omission from it of detailed description concerning any point, shall be regarded as meaning that only the best commercial practice is to prevail and only material and workmanship of the first quality are to be used. Proof of specification compliance will be the responsibility of the Bidder.

3.2.4 Unless otherwise provided in the Contract Documents, the Contractor shall provide and pay for all permits, labor, materials, equipment, tools, construction equipment and machinery, water, heat, utilities, transportation, and other facilities and services necessary for the proper execution and completion of the Work.

3.2.5 The Owner will bear the costs for all impact and user fees associated with the project.

### 3.3 SUBSTITUTIONS

3.3.1 The materials, products and equipment described in the Bidding Documents establish a standard of quality, required function, dimension, and appearance to be met by any proposed substitution. The specification of a particular manufacturer or model number is not intended to be proprietary in any way. Substitutions of products for those named will be considered, providing that the Vendor certifies that the function, quality, and performance characteristics of the material offered is equal or superior to that specified. It shall be the Bidder's responsibility to assure that the proposed substitution will not affect the intent of the design, and to make any installation modifications required to accommodate the substitution.

3.3.2 Requests for substitutions shall be made in writing to the Architect at least ten days prior to the date of the Bid Opening. Such requests shall include a complete description of the proposed substitution, drawings, performance and test data, explanation of required installation modifications due the substitution, and any other information necessary for an evaluation. The burden of proof of the merit of the proposed substitution is upon the proposer. The Architect's decision of approval or disapproval shall be final. The Architect is to notify Owner prior to any approvals.

- 3.3.3 If the Architect approves a substitution prior to the receipt of Bids, such approval shall be set forth in an Addendum. Approvals made in any other manner shall not be binding.
- 3.3.4 The Architect shall have no obligation to consider any substitutions after the Contract award.
- 3.4 ADDENDA
- 3.4.1 Addenda will be mailed or delivered to all who are known by the Architect to have received a complete set of the Bidding Documents.
- 3.4.2 Copies of Addenda will be made available for inspection wherever Bidding Documents are on file for that purpose.
- 3.4.3 No Addenda will be issued later than 4 days prior to the date for receipt of Bids except an Addendum withdrawing the request for Bids or one which extends the time or changes the location for the opening of bids.
- 3.4.4 Each bidder shall ascertain prior to submitting his Bid that they have received all Addenda issued, and shall acknowledge their receipt in their Bid in the appropriate space. Not acknowledging an issued Addenda could be grounds for determining a bid to be non-responsive.

**ARTICLE 4: BIDDING PROCEDURES**

**4.1 PREPARATION OF BIDS**

- 4.1.1 Submit the bids on the Bid Forms included with the Bidding Documents.
- 4.1.2 Submit the original Bid Form for each bid. Bid Forms may be removed from the project manual for this purpose.
- 4.1.3 Execute all blanks on the Bid Form in a non-erasable medium (typewriter or manually in ink).
- 4.1.4 Where so indicated by the makeup on the Bid Form, express sums in both words and figures, in case of discrepancy between the two, the written amount shall govern.
- 4.1.5 Interlineations, alterations or erasures must be initialed by the signer of the Bid.
- 4.1.6 BID ALL REQUESTED ALTERNATES AND UNIT PRICES, IF ANY. If there is no change in the Base Bid for an Alternate, enter "No Change". The Contractor is responsible for verifying that they have received all addenda issued during the bidding period. Work required by Addenda shall automatically become part of the Contract.
- 4.1.7 Make no additional stipulations on the Bid Form and do not qualify the Bid in any other manner.
- 4.1.8 Each copy of the Bid shall include the legal name of the Bidder and a statement whether the Bidder is a sole proprietor, a partnership, a corporation, or any legal entity, and each copy shall be signed by the person or persons legally authorized to bind the Bidder to a contract. A Bid by a corporation shall further give the state of incorporation and have the corporate seal affixed. A Bid submitted by an agent shall have a current Power of Attorney attached, certifying agent's authority to bind the Bidder.

- 4.1.9 Bidder shall complete the Non-Collusion Statement form included with the Bid Forms and include it with their Bid.
- 4.1.10 In the construction of all Public Works projects for the State of Delaware or any agency thereof, preference in employment of laborers, workers or mechanics shall be given to bona fide legal citizens of the State who have established citizenship by residence of at least 90 days in the State.
- 4.2 BID SECURITY
- 4.2.1 All bids shall be accompanied by a deposit of either a good and sufficient bond to the agency for the benefit of the agency, with corporate surety authorized to do business in this State, the form of the bond and the surety to be approved by the agency, or a security of the bidder assigned to the agency, for a sum equal to at least 10% of the bid plus all add alternates, or in lieu of the bid bond a security deposit in the form of a certified check, bank treasurer's check, cashier's check, money order, or other prior approved secured deposit assigned to the State. The bid bond need not be for a specific sum, but may be stated to be for a sum equal to 10% of the bid plus all add alternates to which it relates and not to exceed a certain stated sum, if said sum is equal to at least 10% of the bid. The Bid Bond form used shall be the standard OMB form (attached).
- 4.2.2 The Agency has the right to retain the bid security of Bidders to whom an award is being considered until either a formal contract has been executed and bonds have been furnished or the specified time has elapsed so the Bids may be withdrawn or all Bids have been rejected.
- 4.2.3 In the event of any successful Bidder refusing or neglecting to execute a formal contract and bond within 20 days of the awarding of the contract, the bid bond or security deposited by the successful bidder shall be forfeited.
- 4.3 SUBCONTRACTOR LIST
- 4.3.1 As required by Delaware Code, Title 29, section 6962(d)(10)b, each Bidder shall submit with their Bid a completed List of Sub-Contractors included with the Bid Form. NAME ONLY ONE SUBCONTRACTOR FOR EACH TRADE. A Bid will be considered non-responsive unless the completed list is included.
- 4.3.2 Provide the Name and Address for each listed subcontractor. Addresses by City, Town or Locality, plus State, will be acceptable.
- 4.3.3 It is the responsibility of the Contractor to ensure that their Subcontractors are in compliance with the provisions of this law. Also, if a Contractor elects to list themselves as a Subcontractor for any category, they must specifically name themselves on the Bid Form and be able to document their capability to act as Subcontractor in that category in accordance with this law.
- 4.4 EQUALITY OF EMPLOYMENT OPPORTUNITY ON PUBLIC WORKS
- 4.4.1 During the performance of this contract, the contractor agrees as follows:
- A. The Contractor will not discriminate against any employee or applicant for employment because of race, creed, color, sex or national origin. The Contractor will take affirmative action to ensure the applicants are employed, and that employees are treated during employment, without regard to their race, creed,

color, sex or national origin. Such action shall include, but not be limited to, the following: Employment, upgrading, demotion or transfer; recruitment or recruitment advertising; layoff or termination; rates of pay or other forms of compensation; and selection for training, including apprenticeship. The Contractor agrees to post in conspicuous places available to employees and applicants for employment notices to be provided by the contracting agency setting forth this nondiscrimination clause.

- B. The Contractor will, in all solicitations or advertisements for employees placed by or on behalf of the Contractor, state that all qualified applicants will receive consideration for employment without regard to race, creed, color, sex or national origin."

#### 4.5 PREVAILING WAGE REQUIREMENT

4.5.1 Wage Provisions: In accordance with Delaware Code, Title 29, Section 6960, renovation projects whose total cost shall exceed \$15,000, and \$100,000 for new construction, the minimum wage rates for various classes of laborers and mechanics shall be as determined by the Department of Labor, Division of Industrial Affairs of the State of Delaware.

4.5.2 The prevailing wage shall be the wage paid to a majority of employees performing similar work as reported in the Department's annual prevailing wage survey or in the absence of a majority, the average paid to all employees reported.

4.5.3 The employer shall pay all mechanics and labors employed directly upon the site of work, unconditionally and not less often than once a week and without subsequent deduction or rebate on any account, the full amounts accrued at time of payment, computed at wage rates not less than those stated in the specifications, regardless of any contractual relationship which may be alleged to exist between the employer and such laborers and mechanics.

4.5.4 The scale of the wages to be paid shall be posted by the employer in a prominent and easily accessible place at the site of the work.

4.5.5 Every contract based upon these specifications shall contain a stipulation that sworn payroll information, as required by the Department of Labor, be furnished weekly. The Department of Labor shall keep and maintain the sworn payroll information for a period of 6 months from the last day of the work week covered by the payroll.

#### 4.6 SUBMISSION OF BIDS

4.6.1 Enclose the Bid, the Bid Security, and any other documents required to be submitted with the Bid in a sealed opaque envelope. Address the envelope to the party receiving the Bids. Identify with the project name, project number, and the Bidder's name and address. If the Bid is sent by mail, enclose the sealed envelope in a separate mailing envelope with the notation "BID ENCLOSED" on the face thereof. The State is not responsible for the opening of bids prior to bid opening date and time that are not properly marked.

4.6.2 Deposit Bids at the designated location prior to the time and date for receipt of bids indicated in the Advertisement for Bids. Bids received after the time and date for receipt of bids will be marked "LATE BID" and returned.

- 4.6.3 Bidder assumes full responsibility for timely delivery at location designated for receipt of bids.
- 4.6.4 Oral, telephonic or telegraphic bids are invalid and will not receive consideration.
- 4.6.5 Withdrawn Bids may be resubmitted up to the date and time designated for the receipt of Bids, provided that they are then fully in compliance with these Instructions to Bidders.
- 4.7 **MODIFICATION OR WITHDRAW OF BIDS**
- 4.7.1 Prior to the closing date for receipt of Bids, a Bidder may withdraw a Bid by personal request and by showing proper identification to the Architect. A request for withdraw by letter or fax, if the Architect is notified in writing prior to receipt of fax, is acceptable. A fax directing a modification in the bid price will render the Bid informal, causing it to be ineligible for consideration of award. Telephone directives for modification of the bid price shall not be permitted and will have no bearing on the submitted proposal in any manner.
- 4.7.2 Bidders submitting Bids that are late shall be notified as soon as practicable and the bid shall be returned.
- 4.7.3 A Bid may not be modified, withdrawn or canceled by the Bidder during a thirty (30) day period following the time and date designated for the receipt and opening of Bids, and Bidder so agrees in submitting their Bid. Bids shall be binding for 30 days after the date of the Bid opening.

**ARTICLE 5: CONSIDERATION OF BIDS**

- 5.1 **OPENING/REJECTION OF BIDS**
- 5.1.1 Unless otherwise stated, Bids received on time will be publicly opened and will be read aloud. An abstract of the Bids will be made available to Bidders.
- 5.1.2 The Agency shall have the right to reject any and all Bids. A Bid not accompanied by a required Bid Security or by other data required by the Bidding Documents, or a Bid which is in any way incomplete or irregular is subject to rejection.
- 5.1.3 If the Bids are rejected, it will be done within thirty (30) calendar day of the Bid opening.
- 5.2 **COMPARISON OF BIDS**
- 5.2.1 After the Bids have been opened and read, the bid prices will be compared and the result of such comparisons will be made available to the public. Comparisons of the Bids may be based on the Base Bid plus desired Alternates. The Agency shall have the right to accept Alternates in any order or combination.
- 5.2.2 The Agency reserves the right to waive technicalities, to reject any or all Bids, or any portion thereof, to advertise for new Bids, to proceed to do the Work otherwise, or to abandon the Work, if in the judgment of the Agency or its agent(s), it is in the best interest of the State.
- 5.2.3 An increase or decrease in the quantity for any item is not sufficient grounds for an increase or decrease in the Unit Price.

- 5.2.4 The prices quoted are to be those for which the material will be furnished F.O.B. Job Site and include all charges that may be imposed during the period of the Contract.
- 5.2.5 No qualifying letter or statements in or attached to the Bid, or separate discounts will be considered in determining the low Bid except as may be otherwise herein noted. Cash or separate discounts should be computed and incorporated into Unit Bid Price(s).
- 5.3 DISQUALIFICATION OF BIDDERS
- 5.3.1 An agency shall determine that each Bidder on any Public Works Contract is responsible before awarding the Contract. Factors to be considered in determining the responsibility of a Bidder include:
- A. The Bidder's financial, physical, personnel or other resources including Subcontracts;
  - B. The Bidder's record of performance on past public or private construction projects, including, but not limited to, defaults and/or final adjudication or admission of violations of the Prevailing Wage Laws in Delaware or any other state;
  - C. The Bidder's written safety plan;
  - D. Whether the Bidder is qualified legally to contract with the State;
  - E. Whether the Bidder supplied all necessary information concerning its responsibility; and,
  - F. Any other specific criteria for a particular procurement, which an agency may establish; provided however, that, the criteria be set forth in the Invitation to Bid and is otherwise in conformity with State and/or Federal law.
- 5.3.2 If an agency determines that a Bidder is nonresponsive and/or nonresponsible, the determination shall be in writing and set forth the basis for the determination. A copy of the determination shall be sent to the affected Bidder within five (5) working days of said determination.
- 5.3.3 In addition, any one or more of the following causes may be considered as sufficient for the disqualification of a Bidder and the rejection of their Bid or Bids.
- 5.3.3.1 More than one Bid for the same Contract from an individual, firm or corporation under the same or different names.
  - 5.3.3.2 Evidence of collusion among Bidders.
  - 5.3.3.3 Unsatisfactory performance record as evidenced by past experience.
  - 5.3.3.4 If the Unit Prices are obviously unbalanced either in excess or below reasonable cost analysis values.
  - 5.3.3.5 If there are any unauthorized additions, interlineation, conditional or alternate bids or irregularities of any kind which may tend to make the Bid incomplete, indefinite or ambiguous as to its meaning.

- 5.3.3.6 If the Bid is not accompanied by the required Bid Security and other data required by the Bidding Documents.
- 5.3.3.7 If any exceptions or qualifications of the Bid are noted on the Bid Form.
- 5.4 ACCEPTANCE OF BID AND AWARD OF CONTRACT
- 5.4.1 A formal Contract shall be executed with the successful Bidder within twenty (20) calendar days after the award of the Contract.
- 5.4.2 Per Section 6962(d)(13) a., Title 29, Delaware Code, "The contracting agency shall award any public works contract within thirty (30) days of the bid opening to the lowest responsive and responsible Bidder, unless the Agency elects to award on the basis of best value, in which case the election to award on the basis of best value shall be stated in the Invitation To Bid."
- 5.4.3 Each Bid on any Public Works Contract must be deemed responsive by the Agency to be considered for award. A responsive Bid shall conform in all material respects to the requirements and criteria set forth in the Contract Documents and specifications.
- 5.4.4 The Agency shall have the right to accept Alternates in any order or combination, and to determine the low Bidder on the basis of the sum of the Base Bid, plus accepted Alternates.
- 5.4.5 The successful Bidder shall execute a formal contract, submit the required Insurance Certificate, and furnish good and sufficient bonds, unless specifically waived in the General Requirements, in accordance with the General Requirement, within twenty (20) days of official notice of contract award. Bonds shall be for the benefit of the Agency with surety in the amount of 100% of the total contract award. Said Bonds shall be conditioned upon the faithful performance of the contract. Bonds shall remain in affect for period of one year after the date of substantial completion.
- 5.4.6 If the successful Bidder fails to execute the required Contract and Bond, as aforesaid, within twenty (20) calendar days after the date of official Notice of the Award of the Contract, their Bid guaranty shall immediately be taken and become the property of the State for the benefit of the Agency as liquidated damages, and not as a forfeiture or as a penalty. Award will then be made to the next lowest qualified Bidder of the Work or readvertised, as the Agency may decide.
- 5.4.7 Each bidder shall supply with its bid its taxpayer identification number (i.e., federal employer identification number or social security number) or a Delaware business license number, and should the vendor be awarded a contract, such vendor shall provide to the agency the taxpayer identification or Delaware business license numbers of such subcontractors. Such numbers shall be provided on the later of the date on which such subcontractor is required to be identified or the time the contract is executed. Prior to execution of the resulting contract, the successful Bidder shall be required to produce proof of its Delaware business license if not provided in its bid.
- 5.4.8 The Bid Security shall be returned to the successful Bidder upon the execution of the formal contract. The Bid Securities of unsuccessful bidders shall be returned within thirty (30) calendar days after the opening of the Bids.

**ARTICLE 6: POST-BID INFORMATION****6.1 CONTRACTOR'S QUALIFICATION STATEMENT**

6.1.1 Bidders to whom award of a Contract is under consideration shall, if requested by the Agency, submit a properly executed AIA Document A305, Contractor's Qualification Statement, unless such a statement has been previously required and submitted.

**6.2 BUSINESS DESIGNATION FORM**

6.2.1 Successful bidder shall be required to accurately complete an Office of Management and Budget Business Designation Form for Subcontractors.

**ARTICLE 7: PERFORMANCE BOND AND PAYMENT BOND****7.1 BOND REQUIREMENTS**

7.1.1 The cost of furnishing the required Bonds, that are stipulated in the Bidding Documents, shall be included in the Bid.

7.1.2 If the Bidder is required by the Agency to secure a bond from other than the Bidder's usual sources, changes in cost will be adjusted as provide in the Contract Documents.

7.1.3 The Performance and Payment Bond forms used shall be the standard OMB forms (attached).

**7.2 TIME OF DELIVERY AND FORM OF BONDS**

7.2.1 The bonds shall be dated on or after the date of the Contract.

7.2.2 The Bidder shall require the attorney-in-fact who executes the required bonds on behalf of the surety to affix a certified and current copy of the power of attorney.

**ARTICLE 8: FORM OF AGREEMENT BETWEEN AGENCY AND CONTRACTOR**

8.1 Unless otherwise required in the Bidding Documents, the Agreement for the Work will be written on AIA Document A101, Standard Form of Agreement Between Owner and Contractor Where the Basis of Payment is a Stipulated Sum.

END OF INSTRUCTIONS TO BIDDERS



SUPREME COURT BUILDING SPRINKLER SYSTEM INSTALLATION  
DOVER, DELAWARE  
OMB/DFM# MC1002000170

BID FORM

I/We acknowledge Addendums numbered \_\_\_\_\_ and the price(s) submitted include any cost/schedule impact they may have.

This bid shall remain valid and cannot be withdrawn for (30) days from the date of opening of bids, and the undersigned shall abide by the Bid Security forfeiture provisions. Bid Security is attached to this Bid.

The Owner shall have the right to reject any or all bids, and to waive any informality or irregularity in any bid received.

This bid is based upon work being accomplished by the Sub-Contractors named on the list attached to this bid.

Should I/We be awarded this contract, I/We pledge to achieve substantial completion of all the work within \_\_\_\_\_ calendar days of the Notice to Proceed.

The undersigned represents and warrants that he has complied and shall comply with all requirements of local, state, and national laws; that no legal requirement has been or shall be violated in making or accepting this bid, in awarding the contract to him or in the prosecution of the work required; that the bid is legal and firm; that he has not, directly or indirectly, entered into any agreement, participated in any collusion, or otherwise taken action in restraint of free competitive bidding.

Upon receipt of written notice of the acceptance of this Bid, the Bidder shall, within twenty (20) calendar days, execute the agreement in the required form and deliver the Contract Bonds, and Insurance Certificates, required by the Contract Documents.

I am / We are an Individual / a Partnership / a Corporation

By \_\_\_\_\_ Trading as \_\_\_\_\_  
(Individual's / General Partner's / Corporate Name)  
\_\_\_\_\_  
(State of Corporation)

Business Address: \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

Witness: \_\_\_\_\_ By: \_\_\_\_\_  
(SEAL) ( Authorized Signature )  
\_\_\_\_\_  
( Title )  
Date: \_\_\_\_\_

**ATTACHMENTS**

- Sub-Contractor List
- Non-Collusion Statement
- Bid Security
- (Others as Required by Project Manuals)

SUPREME COURT BUILDING SPRINKLER SYSTEM INSTALLATION  
DOVER, DELAWARE  
OMB/DFM# MC1002000170

**BID FORM**

**SUBCONTRACTOR LIST**

In accordance with Title 29, Chapter 6962 (d)(10)b Delaware Code, the following sub-contractor listing must accompany the bid submittal. The name and address of the sub-contractor **must be listed for each category** where the bidder intends to use a sub-contractor to perform that category of work. In order to provide full disclosure and acceptance of the bid by the *Owner*, **it is required that bidders list themselves as being the sub-contractor for all categories where he/she is qualified and intends to perform such work.**

<u>Subcontractor Category</u>	<u>Subcontractor</u>	<u>Address (City &amp; State)</u>
1. SPRINKLER	_____	_____
2. ELECTRICAL	_____	_____
3. FIRE ALARM	_____	_____
4.	_____	_____

Not For Bidding Purposes

**BID FORM**

**NON-COLLUSION STATEMENT**

This is to certify that the undersigned bidder has neither directly nor indirectly, entered into any agreement, participated in any collusion or otherwise taken any action in restraint of free competitive bidding in connection with this proposal submitted this date to the Office of Management and Budget, Division of Facilities Management.

All the terms and conditions of OMB/DFM# MC1002000170 have been thoroughly examined and are understood.

**NAME OF BIDDER:** \_\_\_\_\_

**AUTHORIZED REPRESENTATIVE (TYPED):** \_\_\_\_\_

**AUTHORIZED REPRESENTATIVE (SIGNATURE):** \_\_\_\_\_

**TITLE:** \_\_\_\_\_

**ADDRESS OF BIDDER:** \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

**PHONE NUMBER:** \_\_\_\_\_

Sworn to and Subscribed before me this \_\_\_\_\_ day of \_\_\_\_\_ 20\_\_\_\_.

My Commission expires \_\_\_\_\_ NOTARY PUBLIC \_\_\_\_\_.

**THIS PAGE MUST BE SIGNED AND NOTARIZED FOR YOUR BID TO BE CONSIDERED.**

STATE OF DELAWARE  
OFFICE OF MANAGEMENT AND BUDGET

**BID BOND**

TO ACCOMPANY PROPOSAL  
(Not necessary if security is used)

KNOW ALL MEN BY THESE PRESENTS That: \_\_\_\_\_  
\_\_\_\_\_ of \_\_\_\_\_ in the County of \_\_\_\_\_  
\_\_\_\_\_ and State of \_\_\_\_\_ as **Principal**, and \_\_\_\_\_  
\_\_\_\_\_ of \_\_\_\_\_ in the County of \_\_\_\_\_  
and State of \_\_\_\_\_ as **Surety**, legally authorized to do business in the State of Delaware  
("State"), are held and firmly unto the **State** in the sum of \_\_\_\_\_  
\_\_\_\_\_ Dollars (\$ \_\_\_\_\_), or \_\_\_\_\_ percent not to exceed \_\_\_\_\_  
\_\_\_\_\_ Dollars (\$ \_\_\_\_\_)  
of amount of bid on Contract No. \_\_\_\_\_, to be paid to the **State** for the use and  
benefit of the State of Delaware OMB / Division of Facilities Management for which payment well and truly  
to be made, we do bind ourselves, our and each of our heirs, executors, administrators, and successors,  
jointly and severally for and in the whole firmly by these presents.

NOW THE CONDITION OF THIS OBLIGATION IS SUCH That if the above bonded **Principal**  
who has submitted to the State of Delaware OMB / Division of Facilities Management a certain proposal to  
enter into this contract for the furnishing of certain material and/or services within the **State**, shall be  
awarded this Contract, and if said **Principal** shall well and truly enter into and execute this Contract as may  
be required by the terms of this Contract and approved by the State of Delaware OMB / Division of Facilities  
Management this Contract to be entered into within twenty days after the date of official notice of the award  
thereof in accordance with the terms of said proposal, then this obligation shall be void or else to be and  
remain in full force and virtue.

Sealed with \_\_\_\_\_ seal and dated this \_\_\_\_\_ day of \_\_\_\_\_ in the year of our Lord two  
thousand and \_\_\_\_\_ (20\_\_\_\_).

SEALED, AND DELIVERED IN THE  
Presence of

Corporate  
Seal

By:

\_\_\_\_\_  
Name of Bidder (Organization)

\_\_\_\_\_  
Authorized Signature

Attest \_\_\_\_\_

\_\_\_\_\_  
Title

\_\_\_\_\_  
Name of Surety

Witness: \_\_\_\_\_

By:

\_\_\_\_\_  
Title

STANDARD FORM OF AGREEMENT  
BETWEEN OWNER AND CONTRACTOR

The Standard Form of Agreement Between Owner and Contractor are as stated in the American Institute of Architects Document AIA A101 (2007 version) entitled Standard Form of Agreement Between Owner and Contractor and is part of this project manual as if herein written in full. A draft sample has been included for reference.

Not For Bidding Purposes

# AIA<sup>®</sup> Document A101<sup>™</sup> – 2007

## **Standard Form of Agreement Between Owner and Contractor where the basis of payment is a Stipulated Sum**

**AGREEMENT** made as of the # day of Month in the year Year  
*(In words, indicate day, month and year)*

**BETWEEN** the Owner:  
*(Name, legal status, address and other information)*

State of Delaware  
540 S. DuPont Highway, Suite 1  
Dover, DE 19901  
Telephone Number: (302) 739 5644  
Fax Number: (302) 739 5644

and the Contractor:  
*(Name, legal status, address and other information)*

for the following Project:  
*(Name, location and detailed description)*

The Architect:  
*(Name, legal status, address and other information)*

DEDC, LLC  
315 S. Chapel Street  
Newark, DE 19711  
Telephone Number: 302 738 7172  
Fax Number: 302 738 7172

The Owner and Contractor agree as follows.

### **ADDITIONS AND DELETIONS:**

The author of this document has added information needed for its completion. The author may also have revised the text of the original AIA standard form. An *Additions and Deletions Report* that notes added information as well as revisions to the standard form text is available from the author and should be reviewed. A vertical line in the left margin of this document indicates where the author has added necessary information and where the author has added to or deleted from the original AIA text.

This document has important legal consequences. Consultation with an attorney is encouraged with respect to its completion or modification.

AIA Document A201<sup>™</sup>–2007, General Conditions of the Contract for Construction, is adopted in this document by reference. Do not use with other general conditions unless this document is modified.

Not For Bidding Purposes

Init.

## TABLE OF ARTICLES

1	THE CONTRACT DOCUMENTS
2	THE WORK OF THIS CONTRACT
3	DATE OF COMMENCEMENT AND SUBSTANTIAL COMPLETION
4	CONTRACT SUM
5	PAYMENTS
6	DISPUTE RESOLUTION
7	TERMINATION OR SUSPENSION
8	MISCELLANEOUS PROVISIONS
9	ENUMERATION OF CONTRACT DOCUMENTS
10	INSURANCE AND BONDS

### ARTICLE 1 THE CONTRACT DOCUMENTS

The Contract Documents consist of this Agreement, Conditions of the Contract (General, Supplementary and other Conditions), Drawings, Specifications, Addenda issued prior to execution of this Agreement, other documents listed in this Agreement and Modifications issued after execution of this Agreement, all of which form the Contract, and are as fully a part of the Contract as if attached to this Agreement or repeated herein. The Contract represents the entire and integrated agreement between the parties hereto and supersedes prior negotiations, representations or agreements, either written or oral. An enumeration of the Contract Documents, other than a Modification, appears in Article 9.

### ARTICLE 2 THE WORK OF THIS CONTRACT

The Contractor shall fully execute the Work described in the Contract Documents, except as specifically indicated in the Contract Documents to be the responsibility of others.

### ARTICLE 3 DATE OF COMMENCEMENT AND SUBSTANTIAL COMPLETION

§ 3.1 The date of commencement of the Work shall be the date of this Agreement unless a different date is stated below or provision is made for the date to be fixed in a notice to proceed issued by the Owner.

*(Insert the date of commencement if it differs from the date of this Agreement or, if applicable, state that the date will be fixed in a notice to proceed.)*

The commencement date will be fixed in a notice to proceed.

If, prior to the commencement of the Work, the Owner requires time to file mortgages and other security interests, the Owner's time requirement shall be as follows:

§ 3.2 The Contract Time shall be measured from the date of commencement.

§ 3.3 The Contractor shall achieve Substantial Completion of the entire Work not later than ( ) days from the date of commencement, or as follows:

*(Insert number of calendar days. Alternatively, a calendar date may be used when coordinated with the date of commencement. If appropriate, insert requirements for earlier Substantial Completion of certain portions of the Work.)*

Init.

**Portion of Work**

**Substantial Completion Date**

, subject to adjustments of this Contract Time as provided in the Contract Documents.  
*(Insert provisions, if any, for liquidated damages relating to failure to achieve Substantial Completion on time or for bonus payments for early completion of the Work.)*

**ARTICLE 4 CONTRACT SUM**

§ 4.1 The Owner shall pay the Contractor the Contract Sum in current funds for the Contractor’s performance of the Contract. The Contract Sum shall be Zero Dollars and Zero Cents (\$ 0.00 ), subject to additions and deductions as provided in the Contract Documents.

§ 4.2 The Contract Sum is based upon the following alternates, if any, which are described in the Contract Documents and are hereby accepted by the Owner:

*(State the numbers or other identification of accepted alternates. If the bidding or proposal documents permit the Owner to accept other alternates subsequent to the execution of this Agreement, attach a schedule of such other alternates showing the amount for each and the date when that amount expires.)*

§ 4.3 Unit prices, if any:

*(Identify and state the unit price; state quantity limitations, if any, to which the unit price will be applicable.)*

Item	Units and Limitations	Price Per Unit (\$ 0.00)
------	-----------------------	--------------------------

§ 4.4 Allowances included in the Contract Sum, if any:

*(Identify allowance and state exclusions, if any, from the allowance price.)*

Item	Price
------	-------

**ARTICLE 5 PAYMENTS**

**§ 5.1 PROGRESS PAYMENTS**

§ 5.1.1 Based upon Applications for Payment submitted to the Architect by the Contractor and Certificates for Payment issued by the Architect, the Owner shall make progress payments on account of the Contract Sum to the Contractor as provided below and elsewhere in the Contract Documents.

§ 5.1.2 The period covered by each Application for Payment shall be one calendar month ending on the last day of the month, or as follows:

§ 5.1.3 *Provided that a valid Application for Payment is received by the Architect that meets all requirements of the Contract, payment shall be made by the Owner not later than 30 days after the Owner receives the valid Application for Payment.*

§ 5.1.4 Each Application for Payment shall be based on the most recent schedule of values submitted by the Contractor in accordance with the Contract Documents. The schedule of values shall allocate the entire Contract Sum among the various portions of the Work. The schedule of values shall be prepared in such form and supported by such data to substantiate its accuracy as the Architect may require. This schedule, unless objected to by the Architect, shall be used as a basis for reviewing the Contractor’s Applications for Payment.

Init.

§ 5.1.5 Applications for Payment shall show the percentage of completion of each portion of the Work as of the end of the period covered by the Application for Payment.

§ 5.1.6 Subject to other provisions of the Contract Documents, the amount of each progress payment shall be computed as follows:

- .1 Take that portion of the Contract Sum properly allocable to completed Work as determined by multiplying the percentage completion of each portion of the Work by the share of the Contract Sum allocated to that portion of the Work in the schedule of values, less retainage of five percent ( 5% ). Pending final determination of cost to the Owner of changes in the Work, amounts not in dispute shall be included as provided in Section 7.3.9 of AIA Document A201™–2007, General Conditions of the Contract for Construction;
- .2 Add that portion of the Contract Sum properly allocable to materials and equipment delivered and suitably stored at the site for subsequent incorporation in the completed construction (or, if approved in advance by the Owner, suitably stored off the site at a location agreed upon in writing), less retainage of five percent (5% );
- .3 Subtract the aggregate of previous payments made by the Owner; and
- .4 Subtract amounts, if any, for which the Architect has withheld or nullified a Certificate for Payment as provided in Section 9.5 of AIA Document A201–2007.

§ 5.1.7 The progress payment amount determined in accordance with Section 5.1.6 shall be further modified under the following circumstances:

- .1 Add, upon Substantial Completion of the Work, a sum sufficient to increase the total payments to the full amount of the Contract Sum, less such amounts as the Architect shall determine for incomplete Work, retainage applicable to such work and unsettled claims; and  
*(Section 9.8.5 of AIA Document A201–2007 requires release of applicable retainage upon Substantial Completion of Work with consent of surety, if any.)*
- .2 Add, if final completion of the Work is thereafter materially delayed through no fault of the Contractor, any additional amounts payable in accordance with Section 9.10.3 of AIA Document A201–2007.

§ 5.1.8 Reduction or limitation of retainage, if any, shall be as follows:

*(If it is intended, prior to Substantial Completion of the entire Work, to reduce or limit the retainage resulting from the percentages inserted in Sections 5.1.6.1 and 5.1.6.2 above, and this is not explained elsewhere in the Contract Documents, insert here provisions for such reduction or limitation.)*

§ 5.1.9 Except with the Owner's prior approval, the Contractor shall not make advance payments to suppliers for materials or equipment which have not been delivered and stored at the site.

## § 5.2 FINAL PAYMENT

§ 5.2.1 Final payment, constituting the entire unpaid balance of the Contract Sum, shall be made by the Owner to the Contractor when

- .1 the Contractor has fully performed the Contract except for the Contractor's responsibility to correct Work as provided in Section 12.2.2 of AIA Document A201–2007, and to satisfy other requirements, if any, which extend beyond final payment; and
- .2 a final Certificate for Payment has been issued by the Architect.

§ 5.2.2 The Owner's final payment to the Contractor shall be made no later than 30 days after the issuance of the Architect's final Certificate for Payment, or as follows:

## ARTICLE 6 DISPUTE RESOLUTION

### § 6.1 INITIAL DECISION MAKER

The Architect will serve as Initial Decision Maker pursuant to Section 15.2 of AIA Document A201–2007, unless the parties appoint below another individual, not a party to this Agreement, to serve as Initial Decision Maker.

Init.

*(If the parties mutually agree, insert the name, address and other contact information of the Initial Decision Maker, if other than the Architect.)*

## § 6.2 BINDING DISPUTE RESOLUTION

For any Claim subject to, but not resolved by, mediation pursuant to Section 15.3 of AIA Document A201–2007, the method of binding dispute resolution shall be as follows:

*(Check the appropriate box. If the Owner and Contractor do not select a method of binding dispute resolution below, or do not subsequently agree in writing to a binding dispute resolution method other than litigation, Claims will be resolved by litigation in a court of competent jurisdiction.)*

Arbitration pursuant to Section 15.4 of AIA Document A201–2007

Litigation in a court of competent jurisdiction

Other (Any remedies available in law or in equity)

## ARTICLE 7 TERMINATION OR SUSPENSION

§ 7.1 The Contract may be terminated by the Owner or the Contractor as provided in Article 14 of AIA Document A201–2007.

§ 7.2 The Work may be suspended by the Owner as provided in Article 14 of AIA Document A201–2007.

## ARTICLE 8 MISCELLANEOUS PROVISIONS

§ 8.1 Where reference is made in this Agreement to a provision of AIA Document A201–2007 or another Contract Document, the reference refers to that provision as amended or supplemented by other provisions of the Contract Documents.

§ 8.2 Payments due and unpaid under the Contract shall bear interest from the date payment is due at the rate stated below, or in the absence thereof, at the legal rate prevailing from time to time at the place where the Project is located. *(Insert rate of interest agreed upon, if any.)*

Payments are due 30 days after receipt of a valid Application for Payment. After that 30 day period, interest may be charged at the rate of 1% per month not to exceed 12% per annum.

§ 8.3 The Owner's representative:  
*(Name, address and other information)*

§ 8.4 The Contractor's representative:  
*(Name, address and other information)*

§ 8.5 The Contractor's representative shall not be changed without ten days written notice to the Owner.

§ 8.6 Other provisions:

## ARTICLE 9 ENUMERATION OF CONTRACT DOCUMENTS

§ 9.1 The Contract Documents, except for Modifications issued after execution of this Agreement, are enumerated in the sections below.

§ 9.1.1 The Agreement is this executed AIA Document A101–2007, Standard Form of Agreement Between Owner and Contractor.

§ 9.1.2 The General Conditions are AIA Document A201–2007, General Conditions of the Contract for Construction.

Init.

AIA Document A101™ – 2007. Copyright © 1915, 1918, 1925, 1937, 1951, 1958, 1961, 1963, 1967, 1974, 1977, 1987, 1991, 1997 and 2007 by The American Institute of Architects. All rights reserved. WARNING: This AIA Document is protected by U.S. Copyright Law and International Treaties. Unauthorized reproduction or distribution of this AIA Document, or any portion of it, may result in severe civil and criminal penalties, and will be prosecuted to the maximum extent possible under the law. This document was produced by AIA software at 14:50:16 on 12/05/2012 under Order No.5598983966\_1 which expires on 06/24/2013, and is not for resale.

User Notes:

(964114507)

§ 9.1.3 The Supplementary and other Conditions of the Contract:

|

§ 9.1.4 The Specifications:

(Either list the Specifications here or refer to an exhibit attached to this Agreement.)

|

§ 9.1.5 The Drawings:

(Either list the Drawings here or refer to an exhibit attached to this Agreement.)

|

§ 9.1.6 The Addenda, if any:

Number	Date	Pages
--------	------	-------

Portions of Addenda relating to bidding requirements are not part of the Contract Documents unless the bidding requirements are also enumerated in this Article 9.

§ 9.1.7 Additional documents, if any, forming part of the Contract Documents:

- .1 AIA Document E201™–2007, Digital Data Protocol Exhibit, if completed by the parties, or the following:
- .2 Other documents, if any, listed below:  
(List here any additional documents that are intended to form part of the Contract Documents. AIA Document A201–2007 provides that bidding requirements such as advertisement or invitation to bid, Instructions to Bidders, sample forms and the Contractor’s bid are not part of the Contract Documents unless enumerated in this Agreement. They should be listed here only if intended to be part of the Contract Documents.)

**ARTICLE 10 INSURANCE AND BONDS**

The Contractor shall purchase and maintain insurance and provide bonds as set forth in Article 11 of AIA Document A201–2007.

(State bonding requirements, if any, and limits of liability for insurance required in Article 11 of AIA Document A201–2007.)

|

Type of insurance or bond	Limit of liability or bond amount (\$ 0.00)
---------------------------	---

Init.

This Agreement entered into as of the day and year first written above.

\_\_\_\_\_  
**OWNER** *(Signature)*

\_\_\_\_\_  
**CONTRACTOR** *(Signature)*

\_\_\_\_\_  
*(Printed name and title)*

\_\_\_\_\_  
*(Printed name and title)*

Not For Bidding Purposes

Init.

# Additions and Deletions Report for

AIA® Document A101™ – 2007

This Additions and Deletions Report, as defined on page 1 of the associated document, reproduces below all text the author has added to the standard form AIA document in order to complete it, as well as any text the author may have added to or deleted from the original AIA text. Added text is shown underlined. Deleted text is indicated with a horizontal line through the original AIA text.

Note: This Additions and Deletions Report is provided for information purposes only and is not incorporated into or constitute any part of the associated AIA document. This Additions and Deletions Report and its associated document were generated simultaneously by AIA software at 14:50:16 on 12/05/2012.

## PAGE 1

**AGREEMENT** made as of the # day of Month in the year Year  
(In words, indicate day, month and ~~year~~ year)

...

State of Delaware  
540 S. DuPont Highway, Suite 1  
Dover, DE 19901  
Telephone Number: (302) 739 5644  
Fax Number: (302) 739 5644

...

DEDC, LLC  
315 S. Chapel Street  
Newark, DE 19711  
Telephone Number: 302 738 7172  
Fax Number: 302 738 7172

## PAGE 2

The commencement date will be fixed in a notice to proceed.

...

§ 3.3 The Contractor shall achieve Substantial Completion of the entire Work not later than ~~(→)0~~ days from the date of commencement, or as follows:

## PAGE 3

§ 4.1 The Owner shall pay the Contractor the Contract Sum in current funds for the Contractor's performance of the Contract. The Contract Sum shall be Zero Dollars and Zero Cents (\$ 0.00), subject to additions and deductions as provided in the Contract Documents.

...

Item	Units and Limitations	Price Per Unit <del>(\$0.00)</del> <u>(\$ 0.00)</u>
------	-----------------------	---

...

§ 5.1.3 Provided that ~~an a valid~~ Application for Payment is received by the Architect ~~not later than the~~ day of a month, the Owner shall make payment of the certified amount to the Contractor ~~not later than the~~ day of the month.

If an Application for Payment is received by the Architect after the application date fixed above, payment that meets all requirements of the Contract, payment shall be made by the Owner not later than ~~(---) days after the Architect receives the Application for Payment.~~  
*(Federal, state or local laws may require payment within a certain period of time.)* 30 days after the Owner receives the valid Application for Payment.

PAGE 4

- .1 Take that portion of the Contract Sum properly allocable to completed Work as determined by multiplying the percentage completion of each portion of the Work by the share of the Contract Sum allocated to that portion of the Work in the schedule of values, less retainage of five percent (5%). Pending final determination of cost to the Owner of changes in the Work, amounts not in dispute shall be included as provided in Section 7.3.9 of AIA Document A201™-2007, General Conditions of the Contract for Construction;
- .2 Add that portion of the Contract Sum properly allocable to materials and equipment delivered and suitably stored at the site for subsequent incorporation in the completed construction (or, if approved in advance by the Owner, suitably stored off the site at a location agreed upon in writing), less retainage of five percent (5%);

PAGE 5

[ ] ~~Other (Specify)~~  Other (Any remedies available in law or in equity)

...

%

Payments are due 30 days after receipt of a valid Application for Payment. After that 30 day period, interest may be charged at the rate of 1% per month not to exceed 12% per annum.

...

§ 8.5 Neither the Owner's nor the Contractor's representative shall not be changed without ten days written notice to the other party: Owner.

PAGE 6

Document	Title	Date	Pages
----------	-------	------	-------

...

Section	Title	Date	Pages
---------	-------	------	-------

...

Number	Title	Date
--------	-------	------

...

Type of insurance or bond	Limit of liability or bond amount <del>(\$0.00)</del> <u>(\$ 0.00)</u>
---------------------------	--

## **Certification of Document's Authenticity**

AIA® Document D401™ – 2003

I, John R. Farina, hereby certify, to the best of my knowledge, information and belief, that I created the attached final document simultaneously with its associated Additions and Deletions Report and this certification at 14:50:16 on 12/05/2012 under Order No. 5598983966\_1 from AIA Contract Documents software and that in preparing the attached final document I made no changes to the original text of AIA® Document A101™ – 2007, Standard Form of Agreement Between Owner and Contractor where the basis of payment is a Stipulated Sum, as published by the AIA in its software, other than those additions and deletions shown in the associated Additions and Deletions Report.

\_\_\_\_\_  
(Signed)

\_\_\_\_\_  
(Title)

\_\_\_\_\_  
(Dated)

Not For Bidding Purposes

**SUPPLEMENT TO THE CONTRACT FOR CONSTRUCTION A101-2007**

The following supplements modify the "Standard Form of Agreement Between Owner and Constructor," AIA Document A101-2007. Where a portion of the Standard Form of Agreement is modified or deleted by the following, the unaltered portions of the Standard Form of Agreement shall remain in effect.

**ARTICLE 5: PAYMENTS**

## 5.1 PROGRESS PAYMENTS

## 5.1.3 Delete paragraph 5.1.3 in its entirety and replace with the following:

"Provided that a valid Application for Payment is received by the Architect that meets all requirements of the Contract, payment shall be made by the Owner not later than 30 days after the Owner receives the valid Application for Payment."

**ARTICLE 6: DISPUTE RESOLUTION**

## 6.2 BINDING DISPUTE RESOLUTION

Check Other – and add the following sentence:

"Any remedies available in law or in equity."

**ARTICLE 8: MISCELLANEOUS PROVISIONS**

## 8.2 Insert the following:

"Payments are due 30 days after receipt of a valid Application for Payment. After that 30 day period, interest may be charged at the rate of 1% per month not to exceed 12% per annum."

## 8.5 Delete paragraph 8.5 in its entirety and replace with the following:

"The Contractor's representative shall not be changed without ten days written notice to the Owner."

**END OF SUPPLEMENT TO THE CONTRACT FOR CONSTRUCTION**

STATE OF DELAWARE  
OFFICE OF MANAGEMENT AND BUDGET

**PERFORMANCE BOND**

Bond Number: \_\_\_\_\_

KNOW ALL PERSONS BY THESE PRESENTS, that we, \_\_\_\_\_, as principal (“**Principal**”), and \_\_\_\_\_, a \_\_\_\_\_ corporation, legally authorized to do business in the State of Delaware, as surety (“**Surety**”), are held and firmly bound unto the State of Delaware OMB / Division of Facilities Management (“**Owner**”) in the amount of \_\_\_\_\_ (\$\_\_\_\_\_), to be paid to **Owner**, for which payment well and truly to be made, we do bind ourselves, our and each and every of our heirs, executors, administrations, successors and assigns, jointly and severally, for and in the whole, firmly by these presents.

Sealed with our seals and dated this \_\_\_\_\_ day of \_\_\_\_\_, 20\_\_.

NOW THE CONDITION OF THIS OBLIGATION IS SUCH that if **Principal**, who has been awarded by **Owner** that certain contract known as Contract No. \_\_\_\_\_ dated the \_\_\_\_\_ day of \_\_\_\_\_, 20\_\_ (the “Contract”), which Contract is incorporated herein by reference, shall well and truly provide and furnish all materials, appliances and tools and perform all the work required under and pursuant to the terms and conditions of the Contract and the Contract Documents (as defined in the Contract) or any changes or modifications thereto made as therein provided, shall make good and reimburse **Owner** sufficient funds to pay the costs of completing the Contract that **Owner** may sustain by reason of any failure or default on the part of **Principal**, and shall also indemnify and save harmless **Owner** from all costs, damages and expenses arising out of or by reason of the performance of the Contract and for as long as provided by the Contract; then this obligation shall be void, otherwise to be and remain in full force and effect.

**Surety**, for value received, hereby stipulates and agrees, if requested to do so by **Owner**, to fully perform and complete the work to be performed under the Contract pursuant to the terms, conditions and covenants thereof, if for any cause **Principal** fails or neglects to so fully perform and complete such work.

**Surety**, for value received, for itself and its successors and assigns, hereby stipulates and agrees that the obligation of **Surety** and its bond shall be in no way impaired or affected by any extension of time, modification, omission, addition or change in or to the Contract or the work to be performed thereunder, or by any payment thereunder before the time required therein, or by any waiver of any provisions thereof, or by any assignment, subletting or other transfer thereof or of any work to be performed or any monies due or to become due thereunder; and **Surety** hereby waives notice of any and all such extensions, modifications, omissions, additions, changes, payments, waivers, assignments, subcontracts and transfers and hereby expressly stipulates and agrees that any and all things done and omitted to be done by and in relation to assignees, subcontractors, and other transferees shall have the same effect as to **Surety** as though done or omitted to be done by or in relation to **Principal**.

**Surety** hereby stipulates and agrees that no modifications, omissions or additions in or to the terms of the Contract shall in any way whatsoever affect the obligation of **Surety** and its bond.

Any proceeding, legal or equitable, under this Bond may be brought in any court of competent jurisdiction in the State of Delaware. Notices to **Surety** or Contractor may be mailed or delivered to them at their respective addresses shown below.

IN WITNESS WHEREOF, **Principal** and **Surety** have hereunto set their hand and seals, and such of them as are corporations have caused their corporate seal to be hereto affixed and these presents to be signed by their duly authorized officers, the day and year first above written.

PRINCIPAL

Name: \_\_\_\_\_

Witness or Attest: Address: \_\_\_\_\_

\_\_\_\_\_  
Name:  
  
(Corporate Seal)

By: \_\_\_\_\_ (SEAL)  
Name:  
Title:

SURETY

Name: \_\_\_\_\_

Witness or Attest: Address: \_\_\_\_\_

\_\_\_\_\_  
Name:  
  
(Corporate Seal)

By: \_\_\_\_\_ (SEAL)  
Name:  
Title:

STATE OF DELAWARE  
OFFICE OF MANAGEMENT AND BUDGET

**PAYMENT BOND**

Bond Number: \_\_\_\_\_

KNOW ALL PERSONS BY THESE PRESENTS, that we, \_\_\_\_\_, as principal (“**Principal**”), and \_\_\_\_\_, a \_\_\_\_\_ corporation, legally authorized to do business in the State of Delaware, as surety (“**Surety**”), are held and firmly bound unto the State of Delaware OMB / Division of Facilities Management (“**Owner**”) in the amount of \_\_\_\_\_ (\$\_\_\_\_\_), to be paid to **Owner**, for which payment well and truly to be made, we do bind ourselves, our and each and every of our heirs, executors, administrations, successors and assigns, jointly and severally, for and in the whole firmly by these presents.

Sealed with our seals and dated this \_\_\_\_\_ day of \_\_\_\_\_, 20\_\_.

NOW THE CONDITION OF THIS OBLIGATION IS SUCH, that if **Principal**, who has been awarded by **Owner** that certain contract known as Contract No. \_\_\_\_\_ dated the \_\_\_\_\_ day of \_\_\_\_\_, 20\_\_ (the “Contract”), which Contract is incorporated herein by reference, shall well and truly pay all and every person furnishing materials or performing labor or service in and about the performance of the work under the Contract, all and every sums of money due him, her, them or any of them, for all such materials, labor and service for which **Principal** is liable, shall make good and reimburse **Owner** sufficient funds to pay such costs in the completion of the Contract as **Owner** may sustain by reason of any failure or default on the part of **Principal**, and shall also indemnify and save harmless **Owner** from all costs, damages and expenses arising out of or by reason of the performance of the Contract and for as long as provided by the Contract; then this obligation shall be void, otherwise to be and remain in full force and effect.

**Surety**, for value received, for itself and its successors and assigns, hereby stipulates and agrees that the obligation of **Surety** and its bond shall be in no way impaired or affected by any extension of time, modification, omission, addition or change in or to the Contract or the work to be performed thereunder, or by any payment thereunder before the time required therein, or by any waiver of any provisions thereof, or by any assignment, subletting or other transfer thereof or of any work to be performed or any monies due or to become due thereunder; and **Surety** hereby waives notice of any and all such extensions, modifications, omissions, additions, changes, payments, waivers, assignments, subcontracts and transfers and hereby expressly stipulates and agrees that any and all things done and omitted to be done by and in relation to assignees, subcontractors, and other transferees shall have the same effect as to **Surety** as though done or omitted to be done by or in relation to **Principal**.

**Surety** hereby stipulates and agrees that no modifications, omission or additions in or to the terms of the Contract shall in any way whatsoever affect the obligation of **Surety** and its bond.

Any proceeding, legal or equitable, under this Bond may be brought in any court of competent jurisdiction in the State of Delaware. Notices to **Surety** or Contractor may be mailed or delivered to them at their respective addresses shown below.

IN WITNESS WHEREOF, **Principal** and **Surety** have hereunto set their hand and seals, and such of them as are corporations have caused their corporate seal to be hereto affixed and these presents to be signed by their duly authorized officers, the day and year first above written.

PRINCIPAL

Name: \_\_\_\_\_

Witness or Attest: Address: \_\_\_\_\_

\_\_\_\_\_  
Name:  
  
(Corporate Seal)

By: \_\_\_\_\_ (SEAL)  
Name:  
Title:

SURETY

Name: \_\_\_\_\_

Witness or Attest: Address: \_\_\_\_\_

\_\_\_\_\_  
Name:  
  
(Corporate Seal)

By: \_\_\_\_\_ (SEAL)  
Name:  
Title:

APPLICATION AND  
CERTIFICATE FOR PAYMENT

The Application and Certificate for Payment are as stated in the American Institute of Architects Document AIA G702 & AIA G703 (1992 version) entitled Application and Certificate for Payment and is part of this project manual as if herein written in full. A draft sample has been included for reference.

Not For Bidding Purposes

## Application and Certificate for Payment

<b>TO OWNER:</b> State of Delaware	<b>PROJECT:</b>	<b>APPLICATION NO:</b> 001 <b>PERIOD TO:</b> <b>CONTRACT FOR:</b> <b>CONTRACT DATE:</b> <b>PROJECT NOS:</b> / /	<b>Distribution to:</b> OWNER: <input type="checkbox"/> ARCHITECT: <input type="checkbox"/> CONTRACTOR: <input type="checkbox"/> FIELD: <input type="checkbox"/> OTHER: <input type="checkbox"/>
<b>FROM CONTRACTOR:</b>	<b>VIA ARCHITECT:</b> Delaware Engineering and Design Corporation 315 S. Chapel Street Newark, DE 19711		

### CONTRACTOR'S APPLICATION FOR PAYMENT

Application is made for payment, as shown below, in connection with the Contract. Continuation Sheet, AIA Document G703, is attached.

1. ORIGINAL CONTRACT SUM .....	\$	0.00
2. Net change by Change Orders .....	\$	0.00
3. CONTRACT SUM TO DATE (Line 1 + 2) .....	\$	0.00
4. TOTAL COMPLETED & STORED TO DATE (Column G on G703) .....	\$	0.00
5. RETAINAGE:		
a. 0 % of Completed Work (Column D + E on G703)	\$	0.00
b. 0 % of Stored Material (Column F on G703)	\$	0.00
Total Retainage (Lines 5a + 5b or Total in Column I of G703) .....	\$	0.00
6. TOTAL EARNED LESS RETAINAGE .....	\$	0.00
(Line 4 Less Line 5 Total)		
7. LESS PREVIOUS CERTIFICATES FOR PAYMENT .....	\$	0.00
(Line 6 from prior Certificate)		
8. CURRENT PAYMENT DUE .....	\$	0.00
9. BALANCE TO FINISH, INCLUDING RETAINAGE .....		
(Line 3 less Line 6)	\$	0.00

CHANGE ORDER SUMMARY	ADDITIONS	DEDUCTIONS
Total changes approved in previous months by Owner	\$ 0.00	\$ 0.00
Total approved this Month	\$ 0.00	\$ 0.00
<b>TOTALS</b>	<b>\$ 0.00</b>	<b>\$ 0.00</b>
NET CHANGES by Change Order	\$	0.00

The undersigned Contractor certifies that to the best of the Contractor's knowledge, information and belief the Work covered by this Application for Payment has been completed in accordance with the Contract Documents, that all amounts have been paid by the Contractor for Work for which previous Certificates for Payment were issued and payments received from the Owner, and that current payment shown herein is now due.

**CONTRACTOR:** \_\_\_\_\_  
 By: \_\_\_\_\_ Date: \_\_\_\_\_  
 State of: \_\_\_\_\_  
 County of: \_\_\_\_\_  
 Subscribed and sworn to before  
 me this \_\_\_\_\_ day of \_\_\_\_\_

Notary Public: \_\_\_\_\_  
 My Commission expires: \_\_\_\_\_

### ARCHITECT'S CERTIFICATE FOR PAYMENT

In accordance with the Contract Documents, based on on-site observations and the data comprising this application, the Architect certifies to the Owner that to the best of the Architect's knowledge, information and belief the Work has progressed as indicated, the quality of the Work is in accordance with the Contract Documents, and the Contractor is entitled to payment of the AMOUNT CERTIFIED.

AMOUNT CERTIFIED ..... \$ 0.00  
 (Attach explanation if amount certified differs from the amount applied. Initial all figures on this Application and on the Continuation Sheet that are changed to conform with the amount certified.)

**ARCHITECT:** \_\_\_\_\_  
 By: \_\_\_\_\_ Date: \_\_\_\_\_

This Certificate is not negotiable. The AMOUNT CERTIFIED is payable only to the Contractor named herein. Issuance, payment and acceptance of payment are without prejudice to any rights of the Owner or Contractor under this Contract

# DRAFT AIA<sup>®</sup> Document G703<sup>™</sup> - 1992

## Continuation Sheet

AIA Document G702, APPLICATION AND CERTIFICATION FOR PAYMENT, containing Contractor's signed certification is attached.

In tabulations below, amounts are stated to the nearest dollar.

Use Column I on Contracts where variable retainage for line items may apply.

APPLICATION NO: 001


APPLICATION DATE:

PERIOD TO:

ARCHITECT'S PROJECT NO: N/A

A ITEM NO.	B DESCRIPTION OF WORK	C SCHEDULED VALUE	D WORK COMPLETED		F MATERIALS PRESENTLY STORED (NOT IN D OR E)	G		H BALANCE TO FINISH (C - G)	I RETAINAGE (IF VARIABLE RATE)
			FROM PREVIOUS APPLICATION (D + E)	THIS PERIOD		TOTAL COMPLETED AND STORED TO DATE (D+E+F)	% (G ÷ C)		
	GRAND TOTAL	\$ 0.00	\$ 0.00	\$ 0.00	\$ 0.00	\$ 0.00	0.00 %	\$ 0.00	\$ 0.00

Not For Bidding Purposes

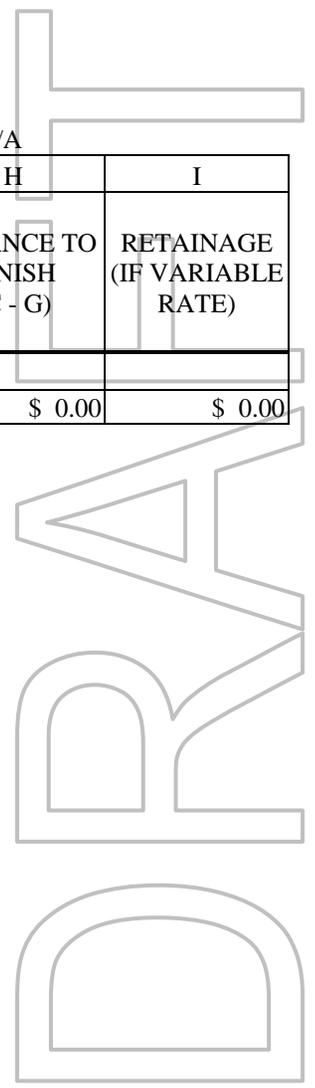

GENERAL CONDITIONS  
OF THE  
CONSTRUCTION CONTRACT

The General Conditions of this Contract are as stated in the American Institute of Architects Document AIA A201 (2007 Edition) entitled General Conditions of the Construction Contract and is part of this project manual as if herein written in full. A draft sample has been included for reference.

Not For Bidding Purposes

# AIA<sup>®</sup> Document A201<sup>™</sup> – 2007

## General Conditions of the Contract for Construction

### for the following PROJECT:

*(Name and location or address)*

### THE OWNER:

*(Name, legal status and address)*

State of Delaware  
540 S. DuPont Highway, Suite 1  
Dover, DE 19901

### THE ARCHITECT:

*(Name, legal status and address)*

DEDC, LLC  
315 S. Chapel Street  
Newark, DE 19711

### ADDITIONS AND DELETIONS:

The author of this document has added information needed for its completion. The author may also have revised the text of the original AIA standard form. An *Additions and Deletions Report* that notes added information as well as revisions to the standard form text is available from the author and should be reviewed. A vertical line in the left margin of this document indicates where the author has added necessary information and where the author has added to or deleted from the original AIA text.

This document has important legal consequences. Consultation with an attorney is encouraged with respect to its completion or modification.

### TABLE OF ARTICLES

- 1 GENERAL PROVISIONS
- 2 OWNER
- 3 CONTRACTOR
- 4 ARCHITECT
- 5 SUBCONTRACTORS
- 6 CONSTRUCTION BY OWNER OR BY SEPARATE CONTRACTORS
- 7 CHANGES IN THE WORK
- 8 TIME
- 9 PAYMENTS AND COMPLETION
- 10 PROTECTION OF PERSONS AND PROPERTY
- 11 INSURANCE AND BONDS
- 12 UNCOVERING AND CORRECTION OF WORK
- 13 MISCELLANEOUS PROVISIONS
- 14 TERMINATION OR SUSPENSION OF THE CONTRACT
- 15 CLAIMS AND DISPUTES

Init.

AIA Document A201<sup>™</sup> – 2007. Copyright © 1911, 1915, 1918, 1925, 1937, 1951, 1958, 1961, 1963, 1966, 1970, 1976, 1987, 1997 and 2007 by The American Institute of Architects. All rights reserved. WARNING: This AIA<sup>®</sup> Document is protected by U.S. Copyright Law and International Treaties. Unauthorized reproduction or distribution of this AIA<sup>®</sup> Document, or any portion of it, may result in severe civil and criminal penalties, and will be prosecuted to the maximum extent possible under the law. This document was produced by AIA software at 14:45:20 on 12/05/2012 under Order No.5598983966\_1 which expires on 06/24/2013, and is not for resale.

User Notes:

(1414030955)

## INDEX

(Numbers and Topics in Bold are Section Headings)

### Acceptance of Nonconforming Work

9.6.6, 9.9.3, **12.3**

Acceptance of Work

9.6.6, 9.8.2, 9.9.3, 9.10.1, 9.10.3, **12.3**

### Access to Work

**3.16**, 6.2.1, 12.1

Accident Prevention

10

Acts and Omissions

3.2, 3.3.2, 3.12.8, 3.18, 4.2.3, 8.3.1, 9.5.1, 10.2.5,

10.2.8, 13.4.2, 13.7.1, 14.1, 15.2

Addenda

1.1.1, 3.11.1

Additional Costs, Claims for

3.7.4, 3.7.5, 6.1.1, 7.3.7.5, 10.3, 15.1.4

### Additional Inspections and Testing

9.4.2, 9.8.3, 12.2.1, **13.5**

Additional Insured

11.1.4

### Additional Time, Claims for

3.2.4, 3.7.4, 3.7.5, 3.10.2, 8.3.2, **15.1.5**

### Administration of the Contract

3.1.3, **4.2**, 9.4, 9.5

Advertisement or Invitation to Bid

1.1.1

Aesthetic Effect

4.2.13

### Allowances

**3.8**, 7.3.8

All-risk Insurance

11.3.1, 11.3.1.1

### Applications for Payment

4.2.5, 7.3.9, 9.2, **9.3**, 9.4, 9.5.1, **9.6.3**, 9.7.1, 9.10,

11.1.3

Approvals

2.1.1, 2.2.2, 2.4, 3.1.3, 3.10.2, 3.12.8, 3.12.9, 3.12.10,

4.2.7, 9.3.2, 13.5.1

### Arbitration

8.3.1, 11.3.10, 13.1.1, 15.3.2, **15.4**

## ARCHITECT

**4**

Architect, Definition of

### 4.1.1

Architect, Extent of Authority

2.4.1, 3.12.7, 4.1, 4.2, 5.2, 6.3.1, 7.1.2, 7.3.7, 7.4,

9.2.1, 9.3.1, 9.4, 9.5, 9.6.3, 9.8, 9.10.1, 9.10.3, 12.1,

12.2.1, 13.5.1, 13.5.2, 14.2.2, 14.2.4, 15.1.3, 15.2.1

Architect, Limitations of Authority and Responsibility

2.1.1, 3.12.4, 3.12.8, 3.12.10, 4.1.2, 4.2.1, 4.2.2, 4.2.3,

4.2.6, 4.2.7, 4.2.10, 4.2.12, 4.2.13, 5.2.1, 7.4.1, 9.4.2,

9.5.3, 9.6.4, 15.1.3, 15.2

Architect's Additional Services and Expenses

2.4.1, 11.3.1.1, 12.2.1, 13.5.2, 13.5.3, 14.2.4

Architect's Administration of the Contract

3.1.3, 4.2, 3.7.4, 15.2, 9.4.1, 9.5

Architect's Approvals

2.4.1, 3.1.3, 3.5.1, 3.10.2, 4.2.7

Architect's Authority to Reject Work

3.5.1, 4.2.6, 12.1.2, 12.2.1

Architect's Copyright

1.1.7, 1.5

Architect's Decisions

3.7.4, 4.2.6, 4.2.7, 4.2.11, 4.2.12, 4.2.13, 4.2.14, 6.3.1,

7.3.7, 7.3.9, 8.1.3, 8.3.1, 9.2.1, 9.4.1, 9.5, 9.8.4, 9.9.1,

13.5.2, 15.2, 15.3

Architect's Inspections

3.7.4, 4.2.2, 4.2.9, 9.4.2, 9.8.3, 9.9.2, 9.10.1, 13.5

Architect's Instructions

3.2.4, 3.3.1, 4.2.6, 4.2.7, **13.5.2**

Architect's Interpretations

4.2.11, 4.2.12

Architect's Project Representative

4.2.10

Architect's Relationship with Contractor

1.1.2, 1.5, 3.1.3, 3.2.2, 3.2.3, 3.2.4, 3.3.1, 3.4.2, 3.5.1,

3.7.4, 3.7.5, 3.9.2, 3.9.3, 3.10, 3.11, 3.12, 3.16, 3.18,

4.1.2, 4.1.3, 4.2, 5.2, 6.2.2, 7, 8.3.1, 9.2, 9.3, 9.4, 9.5,

9.7, 9.8, 9.9, 10.2.6, 10.3, 11.3.7, 12, 13.4.2, 13.5, 15.2

Architect's Relationship with Subcontractors

1.1.2, 4.2.3, 4.2.4, 4.2.6, 9.6.3, 9.6.4, 11.3.7

Architect's Representations

9.4.2, 9.5.1, 9.10.1

Architect's Site Visits

3.7.4, 4.2.2, 4.2.9, 9.4.2, 9.5.1, 9.9.2, 9.10.1, 13.5

Asbestos

10.3.1

Attorneys' Fees

3.18.1, 9.10.2, 10.3.3

Award of Separate Contracts

6.1.1, 6.1.2

**Award of Subcontracts and Other Contracts for**

**Portions of the Work**

**5.2**

## Basic Definitions

### 1.1

Bidding Requirements

1.1.1, 5.2.1, 11.4.1

Binding Dispute Resolution

9.7.1, 11.3.9, 11.3.10, 13.1.1, 15.2.5, 15.2.6.1, 15.3.1,

15.3.2, 15.4.1

### Boiler and Machinery Insurance

### 11.3.2

Bonds, Lien

7.3.7.4, 9.10.2, 9.10.3

### Bonds, Performance, and Payment

7.3.7.4, 9.6.7, 9.10.3, 11.3.9, **11.4**

Init.

AIA Document A201™ – 2007. Copyright © 1911, 1915, 1918, 1925, 1937, 1951, 1958, 1961, 1963, 1966, 1970, 1976, 1987, 1997 and 2007 by The American Institute of Architects. All rights reserved. WARNING: This AIA Document is protected by U.S. Copyright Law and International Treaties. Unauthorized reproduction or distribution of this AIA Document, or any portion of it, may result in severe civil and criminal penalties, and will be prosecuted to the maximum extent possible under the law. This document was produced by AIA software at 14:45:20 on 12/05/2012 under Order No.5598983966\_1 which expires on 06/24/2013, and is not for resale.

User Notes:

(1414030955)

Building Permit

3.7.1

## Capitalization

### 1.3

Certificate of Substantial Completion

9.8.3, 9.8.4, 9.8.5

### Certificates for Payment

4.2.1, 4.2.5, 4.2.9, 9.3.3, 9.4, 9.5, 9.6.1, 9.6.6, 9.7.1,

9.10.1, 9.10.3, 14.1.1.3, 14.2.4, 15.1.3

Certificates of Inspection, Testing or Approval

13.5.4

Certificates of Insurance

9.10.2, 11.1.3

### Change Orders

1.1.1, 2.4.1, 3.4.2, 3.7.4, 3.8.2.3, 3.11.1, 3.12.8, 4.2.8,

5.2.3, 7.1.2, 7.1.3, 7.2, 7.3.2, 7.3.6, 7.3.9, 7.3.10, 8.3.1,

9.3.1.1, 9.10.3, 10.3.2, 11.3.1.2, 11.3.4, 11.3.9, 12.1.2,

15.1.3

Change Orders, Definition of

### 7.2.1

## CHANGES IN THE WORK

2.2.1, 3.11, 4.2.8, 7, 7.2.1, 7.3.1, 7.4, 7.4.1, 8.3.1,

9.3.1.1, 11.3.9

Claims, Definition of

### 15.1.1

## CLAIMS AND DISPUTES

3.2.4, 6.1.1, 6.3.1, 7.3.9, 9.3.3, 9.10.4, 10.3.3, 15, 15.4

Claims and Timely Assertion of Claims

15.4.1

### Claims for Additional Cost

3.2.4, 3.7.4, 6.1.1, 7.3.9, 10.3.2, 15.1.4

### Claims for Additional Time

3.2.4, 3.7.46.1.1, 8.3.2, 10.3.2, 15.1.5

### Concealed or Unknown Conditions, Claims for

### 3.7.4

Claims for Damages

3.2.4, 3.18, 6.1.1, 8.3.3, 9.5.1, 9.6.7, 10.3.3, 11.1.1,

11.3.5, 11.3.7, 14.1.3, 14.2.4, 15.1.6

Claims Subject to Arbitration

15.3.1, 15.4.1

### Cleaning Up

3.15, 6.3

Commencement of the Work, Conditions Relating to

2.2.1, 3.2.2, 3.4.1, 3.7.1, 3.10.1, 3.12.6, 5.2.1, 5.2.3,

6.2.2, 8.1.2, 8.2.2, 8.3.1, 11.1, 11.3.1, 11.3.6, 11.4.1,

15.1.4

Commencement of the Work, Definition of

### 8.1.2

### Communications Facilitating Contract

### Administration

3.9.1, 4.2.4

Completion, Conditions Relating to

3.4.1, 3.11, 3.15, 4.2.2, 4.2.9, 8.2, 9.4.2, 9.8, 9.9.1,

9.10, 12.2, 13.7, 14.1.2

## COMPLETION, PAYMENTS AND

9

Completion, Substantial

4.2.9, 8.1.1, 8.1.3, 8.2.3, 9.4.2, 9.8, 9.9.1, 9.10.3, 12.2,

13.7

Compliance with Laws

1.6.1, 3.2.3, 3.6, 3.7, 3.12.10, 3.13, 4.1.1, 9.6.4, 10.2.2,

11.1, 11.3, 13.1, 13.4, 13.5.1, 13.5.2, 13.6, 14.1.1,

14.2.1.3, 15.2.8, 15.4.2, 15.4.3

Concealed or Unknown Conditions

3.7.4, 4.2.8, 8.3.1, 10.3

Conditions of the Contract

1.1.1, 6.1.1, 6.1.4

Consent, Written

3.4.2, 3.7.4, 3.12.8, 3.14.2, 4.1.2, 9.3.2, 9.8.5, 9.9.1,

9.10.2, 9.10.3, 11.3.1, 13.2, 13.4.2, 15.4.4.2

### Consolidation or Joinder

### 15.4.4

## CONSTRUCTION BY OWNER OR BY

## SEPARATE CONTRACTORS

1.1.4, 6

Construction Change Directive, Definition of

### 7.3.1

### Construction Change Directives

1.1.1, 3.4.2, 3.12.8, 4.2.8, 7.1.1, 7.1.2, 7.1.3, 7.3,

9.3.1.1

Construction Schedules, Contractor's

3.10, 3.12.1, 3.12.2, 6.1.3, 15.1.5.2

### Contingent Assignment of Subcontracts

5.4, 14.2.2.2

### Continuing Contract Performance

### 15.1.3

Contract, Definition of

### 1.1.2

## CONTRACT, TERMINATION OR

## SUSPENSION OF THE

5.4.1.1, 11.3.9, 14

Contract Administration

3.1.3, 4, 9.4, 9.5

Contract Award and Execution, Conditions Relating

to

3.7.1, 3.10, 5.2, 6.1, 11.1.3, 11.3.6, 11.4.1

### Contract Documents, The

### 1.1.1

Contract Documents, Copies Furnished and Use of

1.5.2, 2.2.5, 5.3

Contract Documents, Definition of

### 1.1.1

### Contract Sum

3.7.4, 3.8, 5.2.3, 7.2, 7.3, 7.4, 9.1, 9.4.2, 9.5.1.4, 9.6.7,

9.7, 10.3.2, 11.3.1, 14.2.4, 14.3.2, 15.1.4, 15.2.5

Contract Sum, Definition of

### 9.1

Contract Time

3.7.4, 3.7.5, 3.10.2, 5.2.3, 7.2.1.3, 7.3.1, 7.3.5, 7.4,

8.1.1, 8.2.1, 8.3.1, 9.5.1, 9.7.1, 10.3.2, 12.1.1, 14.3.2,

15.1.5.1, 15.2.5

Contract Time, Definition of

### 8.1.1

Init.

## CONTRACTOR

3

**Contractor**, Definition of

**3.1, 6.1.2**

**Contractor's Construction Schedules**

**3.10, 3.12.1, 3.12.2, 6.1.3, 15.1.5.2**

Contractor's Employees

3.3.2, 3.4.3, 3.8.1, 3.9, 3.18.2, 4.2.3, 4.2.6, 10.2, 10.3,

11.1.1, 11.3.7, 14.1, 14.2.1.1,

**Contractor's Liability Insurance**

**11.1**

Contractor's Relationship with Separate Contractors and Owner's Forces

3.12.5, 3.14.2, 4.2.4, 6, 11.3.7, 12.1.2, 12.2.4

Contractor's Relationship with Subcontractors

1.2.2, 3.3.2, 3.18.1, 3.18.2, 5, 9.6.2, 9.6.7, 9.10.2,

11.3.1.2, 11.3.7, 11.3.8

Contractor's Relationship with the Architect

1.1.2, 1.5, 3.1.3, 3.2.2, 3.2.3, 3.2.4, 3.3.1, 3.4.2, 3.5.1,

3.7.4, 3.10, 3.11, 3.12, 3.16, 3.18, 4.1.3, 4.2, 5.2, 6.2.2,

7, 8.3.1, 9.2, 9.3, 9.4, 9.5, 9.7, 9.8, 9.9, 10.2.6, 10.3,

11.3.7, 12, 13.5, 15.1.2, 15.2.1

Contractor's Representations

3.2.1, 3.2.2, 3.5.1, 3.12.6, 6.2.2, 8.2.1, 9.3.3, 9.8.2

Contractor's Responsibility for Those Performing the Work

3.3.2, 3.18, 5.3.1, 6.1.3, 6.2, 9.5.1, 10.2.8

Contractor's Review of Contract Documents

3.2

Contractor's Right to Stop the Work

9.7

Contractor's Right to Terminate the Contract

14.1, 15.1.6

Contractor's Submittals

3.10, 3.11, 3.12.4, 4.2.7, 5.2.1, 5.2.3, 9.2, 9.3, 9.8.2,

9.8.3, 9.9.1, 9.10.2, 9.10.3, 11.1.3, 11.4.2

Contractor's Superintendent

3.9, 10.2.6

Contractor's Supervision and Construction

Procedures

1.2.2, 3.3, 3.4, 3.12.10, 4.2.2, 4.2.7, 6.1.3, 6.2.4, 7.1.3,

7.3.5, 7.3.7, 8.2, 10, 12, 14, 15.1.3

Contractual Liability Insurance

11.1.1.8, 11.2

Coordination and Correlation

1.2, 3.2.1, 3.3.1, 3.10, 3.12.6, 6.1.3, 6.2.1

Copies Furnished of Drawings and Specifications

1.5, 2.2.5, 3.11

Copyrights

1.5, **3.17**

Correction of Work

2.3, 2.4, 3.7.3, 9.4.2, 9.8.2, 9.8.3, 9.9.1, 12.1.2, **12.2**

**Correlation and Intent of the Contract Documents**

**1.2**

**Cost**, Definition of

**7.3.7**

Costs

2.4.1, 3.2.4, 3.7.3, 3.8.2, 3.15.2, 5.4.2, 6.1.1, 6.2.3,

7.3.3.3, 7.3.7, 7.3.8, 7.3.9, 9.10.2, 10.3.2, 10.3.6, 11.3,

12.1.2, 12.2.1, 12.2.4, 13.5, 14

**Cutting and Patching**

**3.14, 6.2.5**

Damage to Construction of Owner or Separate Contractors

3.14.2, 6.2.4, 10.2.1.2, 10.2.5, 10.4, 11.1.1, 11.3, 12.2.4

Damage to the Work

3.14.2, 9.9.1, 10.2.1.2, 10.2.5, 10.4.1, 11.3.1, 12.2.4

Damages, Claims for

3.2.4, 3.18, 6.1.1, 8.3.3, 9.5.1, 9.6.7, 10.3.3, 11.1.1,

11.3.5, 11.3.7, 14.1.3, 14.2.4, 15.1.6

Damages for Delay

6.1.1, 8.3.3, 9.5.1.6, 9.7, 10.3.2

**Date of Commencement of the Work**, Definition of **8.1.2**

**Date of Substantial Completion**, Definition of

**8.1.3**

**Day**, Definition of

**8.1.4**

Decisions of the Architect

3.7.4, 4.2.6, 4.2.7, 4.2.11, 4.2.12, 4.2.13, 15.2, 6.3,

7.3.7, 7.3.9, 8.1.3, 8.3.1, 9.2.1, 9.4, 9.5.1, 9.8.4, 9.9.1,

13.5.2, 14.2.2, 14.2.4, 15.1, 15.2

**Decisions to Withhold Certification**

9.4.1, **9.5**, 9.7, 14.1.1.3

Defective or Nonconforming Work, Acceptance, Rejection and Correction of

2.3.1, 2.4.1, 3.5.1, 4.2.6, 6.2.5, 9.5.1, 9.5.2, 9.6.6,

9.8.2, 9.9.3, 9.10.4, 12.2.1

**Defective Work**, Definition of

**3.5.1**

Definitions

1.1, 2.1.1, 3.1.1, 3.5.1, 3.12.1, 3.12.2, 3.12.3, 4.1.1,

15.1.1, 5.1, 6.1.2, 7.2.1, 7.3.1, 8.1, 9.1, 9.8.1

**Delays and Extensions of Time**

3.2., 3.7.4, 5.2.3, 7.2.1, 7.3.1, 7.4.1, **8.3**, 9.5.1, 9.7.1,

10.3.2, 10.4.1, 14.3.2, 15.1.5, 15.2.5

Disputes

6.3.1, 7.3.9, 15.1, 15.2

**Documents and Samples at the Site**

**3.11**

**Drawings**, Definition of

**1.1.5**

Drawings and Specifications, Use and Ownership of

3.11

Effective Date of Insurance

8.2.2, 11.1.2

**Emergencies**

**10.4, 14.1.1.2, 15.1.4**

Employees, Contractor's

3.3.2, 3.4.3, 3.8.1, 3.9, 3.18.2, 4.2.3, 4.2.6, 10.2,

10.3.3, 11.1.1, 11.3.7, 14.1, 14.2.1.1

Init.

Equipment, Labor, Materials or  
1.1.3, 1.1.6, 3.4, 3.5.1, 3.8.2, 3.8.3, 3.12, 3.13.1,  
3.15.1, 4.2.6, 4.2.7, 5.2.1, 6.2.1, 7.3.7, 9.3.2, 9.3.3,  
9.5.1.3, 9.10.2, 10.2.1, 10.2.4, 14.2.1.1, 14.2.1.2  
Execution and Progress of the Work  
1.1.3, 1.2.1, 1.2.2, 2.2.3, 2.2.5, 3.1, 3.3.1, 3.4.1, 3.5.1,  
3.7.1, 3.10.1, 3.12, 3.14, 4.2, 6.2.2, 7.1.3, 7.3.5, 8.2,  
9.5.1, 9.9.1, 10.2, 10.3, 12.2, 14.2, 14.3.1, 15.1.3  
Extensions of Time  
3.2.4, 3.7.4, 5.2.3, 7.2.1, 7.3, 7.4.1, 9.5.1, 9.7.1, 10.3.2,  
10.4.1, 14.3, 15.1.5, 15.2.5

#### **Failure of Payment**

9.5.1.3, 9.7, 9.10.2, 13.6, 14.1.1.3, 14.2.1.2

#### **Faulty Work**

(See Defective or Nonconforming Work)

#### **Final Completion and Final Payment**

4.2.1, 4.2.9, 9.8.2, 9.10, 11.1.2, 11.1.3, 11.3.1, 11.3.5,  
12.3.1, 14.2.4, 14.4.3

#### **Financial Arrangements, Owner's**

2.2.1, 13.2.2, 14.1.1.4

#### **Fire and Extended Coverage Insurance**

11.3.1.1

### **GENERAL PROVISIONS**

#### **1**

#### **Governing Law**

##### **13.1**

Guarantees (See Warranty)

#### **Hazardous Materials**

10.2.4, 10.3

#### **Identification of Subcontractors and Suppliers**

5.2.1

#### **Indemnification**

3.17.1, 3.18, 9.10.2, 10.3.3, 10.3.5, 10.3.6, 11.3.1.2,  
11.3.7

#### **Information and Services Required of the Owner**

2.1.2, 2.2, 3.2.2, 3.12.4, 3.12.10, 6.1.3, 6.1.4, 6.2.5,  
9.6.1, 9.6.4, 9.9.2, 9.10.3, 10.3.3, 11.2, 11.4, 13.5.1,  
13.5.2, 14.1.1.4, 14.1.4, 15.1.3

#### **Initial Decision**

##### **15.2**

#### **Initial Decision Maker, Definition of**

1.1.8

#### **Initial Decision Maker, Decisions**

14.2.2, 14.2.4, 15.2.1, 15.2.2, 15.2.3, 15.2.4, 15.2.5

#### **Initial Decision Maker, Extent of Authority**

14.2.2, 14.2.4, 15.1.3, 15.2.1, 15.2.2, 15.2.3, 15.2.4,  
15.2.5

#### **Injury or Damage to Person or Property**

10.2.8, 10.4.1

#### **Inspections**

3.1.3, 3.3.3, 3.7.1, 4.2.2, 4.2.6, 4.2.9, 9.4.2, 9.8.3,  
9.9.2, 9.10.1, 12.2.1, 13.5

#### **Instructions to Bidders**

1.1.1

#### **Instructions to the Contractor**

3.2.4, 3.3.1, 3.8.1, 5.2.1, 7, 8.2.2, 12, 13.5.2

#### **Instruments of Service, Definition of**

##### **1.1.7**

#### **Insurance**

3.18.1, 6.1.1, 7.3.7, 9.3.2, 9.8.4, 9.9.1, 9.10.2, 11

#### **Insurance, Boiler and Machinery**

##### **11.3.2**

#### **Insurance, Contractor's Liability**

##### **11.1**

Insurance, Effective Date of

8.2.2, 11.1.2

#### **Insurance, Loss of Use**

##### **11.3.3**

#### **Insurance, Owner's Liability**

##### **11.2**

#### **Insurance, Property**

10.2.5, 11.3

Insurance, Stored Materials

9.3.2, 11.4.1.4

### **INSURANCE AND BONDS**

#### **11**

Insurance Companies, Consent to Partial Occupancy

9.9.1, 11.4.1.5

Insurance Companies, Settlement with

11.4.10

Intent of the Contract Documents\*

1.2.1, 4.2.7, 4.2.12, 4.2.13, 7.4

#### **Interest**

##### **13.6**

#### **Interpretation**

1.2.3, 1.4, 4.1.1, 5.1, 6.1.2, 15.1.1

Interpretations, Written

4.2.11, 4.2.12, 15.1.4

Judgment on Final Award

15.4.2

#### **Labor and Materials, Equipment**

1.1.3, 1.1.6, 3.4, 3.5.1, 3.8.2, 3.8.3, 3.12, 3.13, 3.15.1,  
4.2.6, 4.2.7, 5.2.1, 6.2.1, 7.3.7, 9.3.2, 9.3.3, 9.5.1.3,  
9.10.2, 10.2.1, 10.2.4, 14.2.1.1, 14.2.1.2

#### **Labor Disputes**

8.3.1

#### **Laws and Regulations**

1.5, 3.2.3, 3.6, 3.7, 3.12.10, 3.13.1, 4.1.1, 9.6.4, 9.9.1,  
10.2.2, 11.1.1, 11.3, 13.1.1, 13.4, 13.5.1, 13.5.2,

13.6.1, 14, 15.2.8, 15.4

#### **Liens**

2.1.2, 9.3.3, 9.10.2, 9.10.4, 15.2.8

#### **Limitations, Statutes of**

12.2.5, 13.7, 15.4.1.1

#### **Limitations of Liability**

2.3.1, 3.2.2, 3.5.1, 3.12.10, 3.17.1, 3.18.1, 4.2.6, 4.2.7,  
4.2.12, 6.2.2, 9.4.2, 9.6.4, 9.6.7, 10.2.5, 10.3.3, 11.1.2,  
11.2, 11.3.7, 12.2.5, 13.4.2

#### **Limitations of Time**

2.1.2, 2.2, 2.4, 3.2.2, 3.10, 3.11, 3.12.5, 3.15.1, 4.2.7,  
5.2, 5.3.1, 5.4.1, 6.2.4, 7.3, 7.4, 8.2, 9.2.1, 9.3.1, 9.3.3,  
9.4.1, 9.5, 9.6, 9.7.1, 9.8, 9.9, 9.10, 11.1.3, 11.3.1.5,  
11.3.6, 11.3.10, 12.2, 13.5, 13.7, 14, 15

Init.

AIA Document A201™ – 2007. Copyright © 1911, 1915, 1918, 1925, 1937, 1951, 1958, 1961, 1963, 1966, 1970, 1976, 1987, 1997 and 2007 by The American Institute of Architects. All rights reserved. WARNING: This AIA™ Document is protected by U.S. Copyright Law and International Treaties. Unauthorized reproduction or distribution of this AIA™ Document, or any portion of it, may result in severe civil and criminal penalties, and will be prosecuted to the maximum extent possible under the law. This document was produced by AIA software at 14:45:20 on 12/05/2012 under Order No.5598983966\_1 which expires on 06/24/2013, and is not for resale.

User Notes:

(1414030955)

## Loss of Use Insurance

### 11.3.3

#### Material Suppliers

1.5, 3.12.1, 4.2.4, 4.2.6, 5.2.1, 9.3, 9.4.2, 9.6, 9.10.5

#### Materials, Hazardous

### 10.2.4, 10.3

#### Materials, Labor, Equipment and

1.1.3, 1.1.6, 1.5.1, 3.4.1, 3.5.1, 3.8.2, 3.8.3, 3.12, 3.13.1, 3.15.1, 4.2.6, 4.2.7, 5.2.1, 6.2.1, 7.3.7, 9.3.2, 9.3.3, 9.5.1.3, 9.10.2, 10.2.1.2, 10.2.4, 14.2.1.1, 14.2.1.2

#### Means, Methods, Techniques, Sequences and Procedures of Construction

3.3.1, 3.12.10, 4.2.2, 4.2.7, 9.4.2

#### Mechanic's Lien

2.1.2, 15.2.8

#### Mediation

8.3.1, 10.3.5, 10.3.6, 15.2.1, 15.2.5, 15.2.6, 15.3, 15.4.1

#### Minor Changes in the Work

1.1.1, 3.12.8, 4.2.8, 7.1, 7.4

## MISCELLANEOUS PROVISIONS

### 13

#### Modifications, Definition of

### 1.1.1

#### Modifications to the Contract

1.1.1, 1.1.2, 3.11, 4.1.2, 4.2.1, 5.2.3, 7, 8.3.1, 9.7.1, 10.3.2, 11.3.1

#### Mutual Responsibility

### 6.2

#### Nonconforming Work, Acceptance of

9.6.6, 9.9.3, 12.3

#### Nonconforming Work, Rejection and Correction of

2.3.1, 2.4.1, 3.5.1, 4.2.6, 6.2.4, 9.5.1, 9.8.2, 9.9.3, 9.10.4, 12.2.1

#### Notice

2.2.1, 2.3.1, 2.4.1, 3.2.4, 3.3.1, 3.7.2, 3.12.9, 5.2.1, 9.7.1, 9.10, 10.2.2, 11.1.3, 11.4.6, 12.2.2.1, 13.3, 13.5.1, 13.5.2, 14.1, 14.2, 15.2.8, 15.4.1

#### Notice, Written

2.3.1, 2.4.1, 3.3.1, 3.9.2, 3.12.9, 3.12.10, 5.2.1, 9.7.1, 9.10, 10.2.2, 10.3, 11.1.3, 11.3.6, 12.2.2.1, 13.3, 14, 15.2.8, 15.4.1

#### Notice of Claims

3.7.4, 4.5, 10.2.8, 15.1.2, 15.4

#### Notice of Testing and Inspections

13.5.1, 13.5.2

#### Observations, Contractor's

3.2, 3.7.4

#### Occupancy

2.2.2, 9.6.6, 9.8, 11.3.1.5

#### Orders, Written

1.1.1, 2.3, 3.9.2, 7, 8.2.2, 11.3.9, 12.1, 12.2.2.1, 13.5.2, 14.3.1

## OWNER

### 2

#### Owner, Definition of

### 2.1.1

#### Owner, Information and Services Required of the

2.1.2, 2.2, 3.2.2, 3.12.10, 6.1.3, 6.1.4, 6.2.5, 9.3.2, 9.6.1, 9.6.4, 9.9.2, 9.10.3, 10.3.3, 11.2, 11.3, 13.5.1, 13.5.2, 14.1.1.4, 14.1.4, 15.1.3

#### Owner's Authority

1.5, 2.1.1, 2.3.1, 2.4.1, 3.4.2, 3.8.1, 3.12.10, 3.14.2, 4.1.2, 4.1.3, 4.2.4, 4.2.9, 5.2.1, 5.2.4, 5.4.1, 6.1, 6.3.1, 7.2.1, 7.3.1, 8.2.2, 8.3.1, 9.3.1, 9.3.2, 9.5.1, 9.6.4, 9.9.1, 9.10.2, 10.3.2, 11.1.3, 11.3.3, 11.3.10, 12.2.2, 12.3.1, 13.2.2, 14.3, 14.4, 15.2.7

#### Owner's Financial Capability

2.2.1, 13.2.2, 14.1.1.4

#### Owner's Liability Insurance

### 11.2

#### Owner's Loss of Use Insurance

### 11.3.3

#### Owner's Relationship with Subcontractors

1.1.2, 5.2, 5.3, 5.4, 9.6.4, 9.10.2, 14.2.2

#### Owner's Right to Carry Out the Work

2.4, 14.2.2

#### Owner's Right to Clean Up

### 6.3

#### Owner's Right to Perform Construction and to Award Separate Contracts

### 6.1

#### Owner's Right to Stop the Work

### 2.3

#### Owner's Right to Suspend the Work

14.3

#### Owner's Right to Terminate the Contract

14.2

#### Ownership and Use of Drawings, Specifications and Other Instruments of Service

1.1.1, 1.1.6, 1.1.7, 1.5, 2.2.5, 3.2.2, 3.11.1, 3.17.1, 4.2.12, 5.3.1

#### Partial Occupancy or Use

9.6.6, 9.9, 11.3.1.5

#### Patching, Cutting and

3.14, 6.2.5

#### Patents

3.17

#### Payment, Applications for

4.2.5, 7.3.9, 9.2.1, 9.3, 9.4, 9.5, 9.6.3, 9.7.1, 9.8.5, 9.10.1, 14.2.3, 14.2.4, 14.4.3

#### Payment, Certificates for

4.2.5, 4.2.9, 9.3.3, 9.4, 9.5, 9.6.1, 9.6.6, 9.7.1, 9.10.1, 9.10.3, 13.7, 14.1.1.3, 14.2.4

#### Payment, Failure of

9.5.1.3, 9.7, 9.10.2, 13.6, 14.1.1.3, 14.2.1.2

#### Payment, Final

4.2.1, 4.2.9, 9.8.2, 9.10, 11.1.2, 11.1.3, 11.4.1, 11.4.5, 12.3.1, 13.7, 14.2.4, 14.4.3

#### Payment Bond, Performance Bond and

7.3.7.4, 9.6.7, 9.10.3, 11.4.9, 11.4

## **Payments, Progress**

9.3, 9.6, 9.8.5, 9.10.3, 13.6, 14.2.3, 15.1.3

## **PAYMENTS AND COMPLETION**

9

### **Payments to Subcontractors**

5.4.2, 9.5.1.3, 9.6.2, 9.6.3, 9.6.4, 9.6.7, 11.4.8, 14.2.1.2

### **PCB**

10.3.1

### **Performance Bond and Payment Bond**

7.3.7.4, 9.6.7, 9.10.3, 11.4.9, 11.4

### **Permits, Fees, Notices and Compliance with Laws**

2.2.2, 3.7, 3.13, 7.3.7.4, 10.2.2

## **PERSONS AND PROPERTY, PROTECTION OF**

10

### **Polychlorinated Biphenyl**

10.3.1

### **Product Data, Definition of**

3.12.2

### **Product Data and Samples, Shop Drawings**

3.11, 3.12, 4.2.7

### **Progress and Completion**

4.2.2, 8.2, 9.8, 9.9.1, 14.1.4, 15.1.3

### **Progress Payments**

9.3, 9.6, 9.8.5, 9.10.3, 13.6, 14.2.3, 15.1.3

### **Project, Definition of the**

1.1.4

### **Project Representatives**

4.2.10

### **Property Insurance**

10.2.5, 11.3

## **PROTECTION OF PERSONS AND PROPERTY**

10

### **Regulations and Laws**

1.5, 3.2.3, 3.6, 3.7, 3.12.10, 3.13, 4.1.1, 9.6.4, 9.9.1, 10.2.2, 11.1, 11.4, 13.1, 13.4, 13.5.1, 13.5.2, 13.6, 14, 15.2.8, 15.4

### **Rejection of Work**

3.5.1, 4.2.6, 12.2.1

### **Releases and Waivers of Liens**

9.10.2

### **Representations**

3.2.1, 3.5.1, 3.12.6, 6.2.2, 8.2.1, 9.3.3, 9.4.2, 9.5.1, 9.8.2, 9.10.1

### **Representatives**

2.1.1, 3.1.1, 3.9, 4.1.1, 4.2.1, 4.2.2, 4.2.10, 5.1.1, 5.1.2, 13.2.1

### **Responsibility for Those Performing the Work**

3.3.2, 3.18, 4.2.3, 5.3.1, 6.1.3, 6.2, 6.3, 9.5.1, 10

### **Retainage**

9.3.1, 9.6.2, 9.8.5, 9.9.1, 9.10.2, 9.10.3

### **Review of Contract Documents and Field**

#### **Conditions by Contractor**

3.2, 3.12.7, 6.1.3

#### **Review of Contractor's Submittals by Owner and Architect**

3.10.1, 3.10.2, 3.11, 3.12, 4.2, 5.2, 6.1.3, 9.2, 9.8.2

#### **Review of Shop Drawings, Product Data and Samples by Contractor**

3.12

### **Rights and Remedies**

1.1.2, 2.3, 2.4, 3.5.1, 3.7.4, 3.15.2, 4.2.6, 4.5, 5.3, 5.4, 6.1, 6.3, 7.3.1, 8.3, 9.5.1, 9.7, 10.2.5, 10.3, 12.2.2, 12.2.4, 13.4, 14, 15.4

### **Royalties, Patents and Copyrights**

3.17

### **Rules and Notices for Arbitration**

15.4.1

### **Safety of Persons and Property**

10.2, 10.4

### **Safety Precautions and Programs**

3.3.1, 4.2.2, 4.2.7, 5.3.1, 10.1, 10.2, 10.4

### **Samples, Definition of**

3.12.3

### **Samples, Shop Drawings, Product Data and**

3.11, 3.12, 4.2.7

### **Samples at the Site, Documents and**

3.11

### **Schedule of Values**

9.2, 9.3.1

### **Schedules, Construction**

3.10, 3.12.1, 3.12.2, 6.1.3, 15.1.5.2

### **Separate Contracts and Contractors**

1.1.4, 3.12.5, 3.14.2, 4.2.4, 4.2.7, 6, 8.3.1, 11.4.7, 12.1.2

### **Shop Drawings, Definition of**

3.12.1

### **Shop Drawings, Product Data and Samples**

3.11, 3.12, 4.2.7

### **Site, Use of**

3.13, 6.1.1, 6.2.1

### **Site Inspections**

3.2.2, 3.3.3, 3.7.1, 3.7.4, 4.2, 9.4.2, 9.10.1, 13.5

### **Site Visits, Architect's**

3.7.4, 4.2.2, 4.2.9, 9.4.2, 9.5.1, 9.9.2, 9.10.1, 13.5

### **Special Inspections and Testing**

4.2.6, 12.2.1, 13.5

### **Specifications, Definition of the**

1.1.6

### **Specifications, The**

1.1.1, 1.1.6, 1.2.2, 1.5, 3.11, 3.12.10, 3.17, 4.2.14

### **Statute of Limitations**

13.7, 15.4.1.1

### **Stopping the Work**

2.3, 9.7, 10.3, 14.1

### **Stored Materials**

6.2.1, 9.3.2, 10.2.1.2, 10.2.4, 11.4.1.4

### **Subcontractor, Definition of**

5.1.1

## **SUBCONTRACTORS**

5

### **Subcontractors, Work by**

1.2.2, 3.3.2, 3.12.1, 4.2.3, 5.2.3, 5.3, 5.4, 9.3.1.2, 9.6.7

Init.

## **Subcontractual Relations**

5.3, 5.4, 9.3.1.2, 9.6, 9.10, 10.2.1, 11.4.7, 11.4.8, 14.1, 14.2.1

### **Submittals**

3.10, 3.11, 3.12, 4.2.7, 5.2.1, 5.2.3, 7.3.7, 9.2, 9.3, 9.8, 9.9.1, 9.10.2, 9.10.3, 11.1.3

### **Submittal Schedule**

3.10.2, 3.12.5, 4.2.7

## **Subrogation, Waivers of**

6.1.1, 11.4.5, 11.3.7

## **Substantial Completion**

4.2.9, 8.1.1, 8.1.3, 8.2.3, 9.4.2, 9.8, 9.9.1, 9.10.3, 12.2, 13.7

## **Substantial Completion, Definition of 9.8.1**

### **Substitution of Subcontractors**

5.2.3, 5.2.4

### **Substitution of Architect**

4.1.3

### **Substitutions of Materials**

3.4.2, 3.5.1, 7.3.8

## **Sub-subcontractor, Definition of**

5.1.2

### **Subsurface Conditions**

3.7.4

## **Successors and Assigns**

13.2

## **Superintendent**

3.9, 10.2.6

## **Supervision and Construction Procedures**

1.2.2, 3.3, 3.4, 3.12.10, 4.2.2, 4.2.7, 6.1.3, 6.2.4, 7.1.3, 7.3.7, 8.2, 8.3.1, 9.4.2, 10, 12, 14, 15.1.3

### **Surety**

5.4.1.2, 9.8.5, 9.10.2, 9.10.3, 14.2.2, 15.2.7

### **Surety, Consent of**

9.10.2, 9.10.3

### **Surveys**

2.2.3

## **Suspension by the Owner for Convenience**

14.3

### **Suspension of the Work**

5.4.2, 14.3

### **Suspension or Termination of the Contract**

5.4.1.1, 11.4.9, 14

## **Taxes**

3.6, 3.8.2.1, 7.3.7.4

## **Termination by the Contractor**

14.1, 15.1.6

## **Termination by the Owner for Cause**

5.4.1.1, 14.2, 15.1.6

## **Termination by the Owner for Convenience**

14.4

### **Termination of the Architect**

4.1.3

### **Termination of the Contractor**

14.2.2

## **TERMINATION OR SUSPENSION OF THE**

## **CONTRACT**

14

## **Tests and Inspections**

3.1.3, 3.3.3, 4.2.2, 4.2.6, 4.2.9, 9.4.2, 9.8.3, 9.9.2, 9.10.1, 10.3.2, 11.4.1.1, 12.2.1, 13.5

## **TIME**

8

## **Time, Delays and Extensions of**

3.2.4, 3.7.4, 5.2.3, 7.2.1, 7.3.1, 7.4.1, 8.3, 9.5.1, 9.7.1, 10.3.2, 10.4.1, 14.3.2, 15.1.5, 15.2.5

### **Time Limits**

2.1.2, 2.2, 2.4, 3.2.2, 3.10, 3.11, 3.12.5, 3.15.1, 4.2, 4.4, 4.5, 5.2, 5.3, 5.4, 6.2.4, 7.3, 7.4, 8.2, 9.2, 9.3.1, 9.3.3, 9.4.1, 9.5, 9.6, 9.7, 9.8, 9.9, 9.10, 11.1.3, 11.4.1.5, 11.4.6, 11.4.10, 12.2, 13.5, 13.7, 14, 15.1.2, 15.4

### **Time Limits on Claims**

3.7.4, 10.2.8, 13.7, 15.1.2

### **Title to Work**

9.3.2, 9.3.3

## **Transmission of Data in Digital Form**

1.6

## **UNCOVERING AND CORRECTION OF WORK**

12

## **Uncovering of Work**

12.1

### **Unforeseen Conditions, Concealed or Unknown**

3.7.4, 8.3.1, 10.3

### **Unit Prices**

7.3.3.2, 7.3.4

### **Use of Documents**

1.1.1, 1.5, 2.2.5, 3.12.6, 5.3

### **Use of Site**

3.13, 6.1.1, 6.2.1

## **Values, Schedule of**

9.2, 9.3.1

### **Waiver of Claims by the Architect**

13.4.2

### **Waiver of Claims by the Contractor**

9.10.5, 11.4.7, 13.4.2, 15.1.6

### **Waiver of Claims by the Owner**

9.9.3, 9.10.3, 9.10.4, 11.4.3, 11.4.5, 11.4.7, 12.2.2.1, 13.4.2, 14.2.4, 15.1.6

### **Waiver of Consequential Damages**

14.2.4, 15.1.6

### **Waiver of Liens**

9.10.2, 9.10.4

## **Waivers of Subrogation**

6.1.1, 11.4.5, 11.3.7

## **Warranty**

3.5, 4.2.9, 9.3.3, 9.8.4, 9.9.1, 9.10.4, 12.2.2, 13.7.1

### **Weather Delays**

15.1.5.2

## **Work, Definition of**

1.1.3

Init.

AIA Document A201™ – 2007. Copyright © 1911, 1915, 1918, 1925, 1937, 1951, 1958, 1961, 1963, 1966, 1970, 1976, 1987, 1997 and 2007 by The American Institute of Architects. All rights reserved. WARNING: This AIA Document is protected by U.S. Copyright Law and International Treaties. Unauthorized reproduction or distribution of this AIA Document, or any portion of it, may result in severe civil and criminal penalties, and will be prosecuted to the maximum extent possible under the law. This document was produced by AIA software at 14:45:20 on 12/05/2012 under Order No.5598983966\_1 which expires on 06/24/2013, and is not for resale.

User Notes:

(1414030955)

Written Consent

1.5.2, 3.4.2, 3.7.4, 3.12.8, 3.14.2, 4.1.2, 9.3.2, 9.8.5,  
9.9.1, 9.10.2, 9.10.3, 11.4.1, 13.2, 13.4.2, 15.4.4.2

Written Interpretations

4.2.11, 4.2.12

Written Notice

2.3, 2.4, 3.3.1, 3.9, 3.12.9, 3.12.10, 5.2.1, 8.2.2, 9.7,  
9.10, 10.2.2, 10.3, 11.1.3, 11.4.6, 12.2.2, 12.2.4, **13.3**,  
14, 15.4.1

Written Orders

1.1.1, 2.3, 3.9, 7, 8.2.2, 11.4.9, 12.1, 12.2, 13.5.2,  
14.3.1, 15.1.2

Not For Bidding Purposes

Init.

## **ARTICLE 1 GENERAL PROVISIONS**

### **§ 1.1 BASIC DEFINITIONS**

#### **§ 1.1.1 THE CONTRACT DOCUMENTS**

The Contract Documents are enumerated in the Agreement between the Owner and Contractor (hereinafter the Agreement) and consist of the Agreement, Conditions of the Contract (General, Supplementary and other Conditions), Drawings, Specifications, Addenda issued prior to execution of the Contract, other documents listed in the Agreement and Modifications issued after execution of the Contract. A Modification is (1) a written amendment to the Contract signed by both parties, (2) a Change Order, (3) a Construction Change Directive or (4) a written order for a minor change in the Work issued by the Architect. Unless specifically enumerated in the Agreement, the Contract Documents do not include the advertisement or invitation to bid, Instructions to Bidders, sample forms, other information furnished by the Owner in anticipation of receiving bids or proposals, the Contractor's bid or proposal, or portions of Addenda relating to bidding requirements.

#### **§ 1.1.2 THE CONTRACT**

The Contract Documents form the Contract for Construction. The Contract represents the entire and integrated agreement between the parties hereto and supersedes prior negotiations, representations or agreements, either written or oral. The Contract may be amended or modified only by a Modification. The Contract Documents shall not be construed to create a contractual relationship of any kind (1) between the Contractor and the Architect or the Architect's consultants, (2) between the Owner and a Subcontractor or a Sub-subcontractor, (3) between the Owner and the Architect or the Architect's consultants or (4) between any persons or entities other than the Owner and the Contractor. The Architect shall, however, be entitled to performance and enforcement of obligations under the Contract intended to facilitate performance of the Architect's duties.

#### **§ 1.1.3 THE WORK**

The term "Work" means the construction and services required by the Contract Documents, whether completed or partially completed, and includes all other labor, materials, equipment and services provided or to be provided by the Contractor to fulfill the Contractor's obligations. The Work may constitute the whole or a part of the Project.

#### **§ 1.1.4 THE PROJECT**

The Project is the total construction of which the Work performed under the Contract Documents may be the whole or a part and which may include construction by the Owner and by separate contractors.

#### **§ 1.1.5 THE DRAWINGS**

The Drawings are the graphic and pictorial portions of the Contract Documents showing the design, location and dimensions of the Work, generally including plans, elevations, sections, details, schedules and diagrams.

#### **§ 1.1.6 THE SPECIFICATIONS**

The Specifications are that portion of the Contract Documents consisting of the written requirements for materials, equipment, systems, standards and workmanship for the Work, and performance of related services.

#### **§ 1.1.7 INSTRUMENTS OF SERVICE**

Instruments of Service are representations, in any medium of expression now known or later developed, of the tangible and intangible creative work performed by the Architect and the Architect's consultants under their respective professional services agreements. Instruments of Service may include, without limitation, studies, surveys, models, sketches, drawings, specifications, and other similar materials.

#### **§ 1.1.8 INITIAL DECISION MAKER**

The Initial Decision Maker is the person identified in the Agreement to render initial decisions on Claims in accordance with Section 15.2 and certify termination of the Agreement under Section 14.2.2.

### **§ 1.2 CORRELATION AND INTENT OF THE CONTRACT DOCUMENTS**

**§ 1.2.1** The intent of the Contract Documents is to include all items necessary for the proper execution and completion of the Work by the Contractor. The Contract Documents are complementary, and what is required by one shall be as binding as if required by all; performance by the Contractor shall be required only to the extent consistent with the Contract Documents and reasonably inferable from them as being necessary to produce the indicated results.

§ 1.2.2 Organization of the Specifications into divisions, sections and articles, and arrangement of Drawings shall not control the Contractor in dividing the Work among Subcontractors or in establishing the extent of Work to be performed by any trade.

§ 1.2.3 Unless otherwise stated in the Contract Documents, words that have well-known technical or construction industry meanings are used in the Contract Documents in accordance with such recognized meanings.

### § 1.3 CAPITALIZATION

Terms capitalized in these General Conditions include those that are (1) specifically defined, (2) the titles of numbered articles or (3) the titles of other documents published by the American Institute of Architects.

### § 1.4 INTERPRETATION

In the interest of brevity the Contract Documents frequently omit modifying words such as "all" and "any" and articles such as "the" and "an," but the fact that a modifier or an article is absent from one statement and appears in another is not intended to affect the interpretation of either statement.

### § 1.5 OWNERSHIP AND USE OF DRAWINGS, SPECIFICATIONS AND OTHER INSTRUMENTS OF SERVICE

§ 1.5.1 The Architect and the Architect's consultants shall be deemed the authors and owners of their respective Instruments of Service, including the Drawings and Specifications, and will retain all common law, statutory and other reserved rights, including copyrights. The Contractor, Subcontractors, Sub-subcontractors, and material or equipment suppliers shall not own or claim a copyright in the Instruments of Service. Submittal or distribution to meet official regulatory requirements or for other purposes in connection with this Project is not to be construed as publication in derogation of the Architect's or Architect's consultants' reserved rights.

§ 1.5.2 The Contractor, Subcontractors, Sub-subcontractors and material or equipment suppliers are authorized to use and reproduce the Instruments of Service provided to them solely and exclusively for execution of the Work. All copies made under this authorization shall bear the copyright notice, if any, shown on the Instruments of Service. The Contractor, Subcontractors, Sub-subcontractors, and material or equipment suppliers may not use the Instruments of Service on other projects or for additions to this Project outside the scope of the Work without the specific written consent of the Owner, Architect and the Architect's consultants.

### § 1.6 TRANSMISSION OF DATA IN DIGITAL FORM

If the parties intend to transmit Instruments of Service or any other information or documentation in digital form, they shall endeavor to establish necessary protocols governing such transmissions, unless otherwise already provided in the Agreement or the Contract Documents.

## ARTICLE 2 OWNER

### § 2.1 GENERAL

§ 2.1.1 The Owner is the person or entity identified as such in the Agreement and is referred to throughout the Contract Documents as if singular in number. The Owner shall designate in writing a representative who shall have express authority to bind the Owner with respect to all matters requiring the Owner's approval or authorization. Except as otherwise provided in Section 4.2.1, the Architect does not have such authority. The term "Owner" means the Owner or the Owner's authorized representative.

§ 2.1.2 The Owner shall furnish to the Contractor within fifteen days after receipt of a written request, information necessary and relevant for the Contractor to evaluate, give notice of or enforce mechanic's lien rights. Such information shall include a correct statement of the record legal title to the property on which the Project is located, usually referred to as the site, and the Owner's interest therein.

### § 2.2 INFORMATION AND SERVICES REQUIRED OF THE OWNER

§ 2.2.1 Prior to commencement of the Work, the Contractor may request in writing that the Owner provide reasonable evidence that the Owner has made financial arrangements to fulfill the Owner's obligations under the Contract. Thereafter, the Contractor may only request such evidence if (1) the Owner fails to make payments to the Contractor as the Contract Documents require; (2) a change in the Work materially changes the Contract Sum; or (3) the Contractor identifies in writing a reasonable concern regarding the Owner's ability to make payment when due. The Owner shall furnish such evidence as a condition precedent to commencement or continuation of the Work or the

portion of the Work affected by a material change. After the Owner furnishes the evidence, the Owner shall not materially vary such financial arrangements without prior notice to the Contractor.

§ 2.2.2 Except for permits and fees that are the responsibility of the Contractor under the Contract Documents, including those required under Section 3.7.1, the Owner shall secure and pay for necessary approvals, easements, assessments and charges required for construction, use or occupancy of permanent structures or for permanent changes in existing facilities.

§ 2.2.3 The Owner shall furnish surveys describing physical characteristics, legal limitations and utility locations for the site of the Project, and a legal description of the site. The Contractor shall be entitled to rely on the accuracy of information furnished by the Owner but shall exercise proper precautions relating to the safe performance of the Work.

§ 2.2.4 The Owner shall furnish information or services required of the Owner by the Contract Documents with reasonable promptness. The Owner shall also furnish any other information or services under the Owner's control and relevant to the Contractor's performance of the Work with reasonable promptness after receiving the Contractor's written request for such information or services.

§ 2.2.5 Unless otherwise provided in the Contract Documents, the Owner shall furnish to the Contractor one copy of the Contract Documents for purposes of making reproductions pursuant to Section 1.5.2.

### § 2.3 OWNER'S RIGHT TO STOP THE WORK

If the Contractor fails to correct Work that is not in accordance with the requirements of the Contract Documents as required by Section 12.2 or repeatedly fails to carry out Work in accordance with the Contract Documents, the Owner may issue a written order to the Contractor to stop the Work, or any portion thereof, until the cause for such order has been eliminated; however, the right of the Owner to stop the Work shall not give rise to a duty on the part of the Owner to exercise this right for the benefit of the Contractor or any other person or entity, except to the extent required by Section 6.1.3.

### § 2.4 OWNER'S RIGHT TO CARRY OUT THE WORK

If the Contractor defaults or neglects to carry out the Work in accordance with the Contract Documents and fails within a ten-day period after receipt of written notice from the Owner to commence and continue correction of such default or neglect with diligence and promptness, the Owner may, without prejudice to other remedies the Owner may have, correct such deficiencies. In such case an appropriate Change Order shall be issued deducting from payments then or thereafter due the Contractor the reasonable cost of correcting such deficiencies, including Owner's expenses and compensation for the Architect's additional services made necessary by such default, neglect or failure. Such action by the Owner and amounts charged to the Contractor are both subject to prior approval of the Architect. If payments then or thereafter due the Contractor are not sufficient to cover such amounts, the Contractor shall pay the difference to the Owner.

## ARTICLE 3 CONTRACTOR

### § 3.1 GENERAL

§ 3.1.1 The Contractor is the person or entity identified as such in the Agreement and is referred to throughout the Contract Documents as if singular in number. The Contractor shall be lawfully licensed, if required in the jurisdiction where the Project is located. The Contractor shall designate in writing a representative who shall have express authority to bind the Contractor with respect to all matters under this Contract. The term "Contractor" means the Contractor or the Contractor's authorized representative.

§ 3.1.2 The Contractor shall perform the Work in accordance with the Contract Documents.

§ 3.1.3 The Contractor shall not be relieved of obligations to perform the Work in accordance with the Contract Documents either by activities or duties of the Architect in the Architect's administration of the Contract, or by tests, inspections or approvals required or performed by persons or entities other than the Contractor.

## **§ 3.2 REVIEW OF CONTRACT DOCUMENTS AND FIELD CONDITIONS BY CONTRACTOR**

**§ 3.2.1** Execution of the Contract by the Contractor is a representation that the Contractor has visited the site, become generally familiar with local conditions under which the Work is to be performed and correlated personal observations with requirements of the Contract Documents.

**§ 3.2.2** Because the Contract Documents are complementary, the Contractor shall, before starting each portion of the Work, carefully study and compare the various Contract Documents relative to that portion of the Work, as well as the information furnished by the Owner pursuant to Section 2.2.3, shall take field measurements of any existing conditions related to that portion of the Work, and shall observe any conditions at the site affecting it. These obligations are for the purpose of facilitating coordination and construction by the Contractor and are not for the purpose of discovering errors, omissions, or inconsistencies in the Contract Documents; however, the Contractor shall promptly report to the Architect any errors, inconsistencies or omissions discovered by or made known to the Contractor as a request for information in such form as the Architect may require. It is recognized that the Contractor's review is made in the Contractor's capacity as a contractor and not as a licensed design professional, unless otherwise specifically provided in the Contract Documents.

**§ 3.2.3** The Contractor is not required to ascertain that the Contract Documents are in accordance with applicable laws, statutes, ordinances, codes, rules and regulations, or lawful orders of public authorities, but the Contractor shall promptly report to the Architect any nonconformity discovered by or made known to the Contractor as a request for information in such form as the Architect may require.

**§ 3.2.4** If the Contractor believes that additional cost or time is involved because of clarifications or instructions the Architect issues in response to the Contractor's notices or requests for information pursuant to Sections 3.2.2 or 3.2.3, the Contractor shall make Claims as provided in Article 15. If the Contractor fails to perform the obligations of Sections 3.2.2 or 3.2.3, the Contractor shall pay such costs and damages to the Owner as would have been avoided if the Contractor had performed such obligations. If the Contractor performs those obligations, the Contractor shall not be liable to the Owner or Architect for damages resulting from errors, inconsistencies or omissions in the Contract Documents, for differences between field measurements or conditions and the Contract Documents, or for nonconformities of the Contract Documents to applicable laws, statutes, ordinances, codes, rules and regulations, and lawful orders of public authorities.

## **§ 3.3 SUPERVISION AND CONSTRUCTION PROCEDURES**

**§ 3.3.1** The Contractor shall supervise and direct the Work, using the Contractor's best skill and attention. The Contractor shall be solely responsible for, and have control over, construction means, methods, techniques, sequences and procedures and for coordinating all portions of the Work under the Contract, unless the Contract Documents give other specific instructions concerning these matters. If the Contract Documents give specific instructions concerning construction means, methods, techniques, sequences or procedures, the Contractor shall evaluate the jobsite safety thereof and, except as stated below, shall be fully and solely responsible for the jobsite safety of such means, methods, techniques, sequences or procedures. If the Contractor determines that such means, methods, techniques, sequences or procedures may not be safe, the Contractor shall give timely written notice to the Owner and Architect and shall not proceed with that portion of the Work without further written instructions from the Architect. If the Contractor is then instructed to proceed with the required means, methods, techniques, sequences or procedures without acceptance of changes proposed by the Contractor, the Owner shall be solely responsible for any loss or damage arising solely from those Owner-required means, methods, techniques, sequences or procedures.

**§ 3.3.2** The Contractor shall be responsible to the Owner for acts and omissions of the Contractor's employees, Subcontractors and their agents and employees, and other persons or entities performing portions of the Work for, or on behalf of, the Contractor or any of its Subcontractors.

**§ 3.3.3** The Contractor shall be responsible for inspection of portions of Work already performed to determine that such portions are in proper condition to receive subsequent Work.

## **§ 3.4 LABOR AND MATERIALS**

**§ 3.4.1** Unless otherwise provided in the Contract Documents, the Contractor shall provide and pay for labor, materials, equipment, tools, construction equipment and machinery, water, heat, utilities, transportation, and other facilities and services necessary for proper execution and completion of the Work, whether temporary or permanent and whether or not incorporated or to be incorporated in the Work.

§ 3.4.2 Except in the case of minor changes in the Work authorized by the Architect in accordance with Sections 3.12.8 or 7.4, the Contractor may make substitutions only with the consent of the Owner, after evaluation by the Architect and in accordance with a Change Order or Construction Change Directive.

§ 3.4.3 The Contractor shall enforce strict discipline and good order among the Contractor's employees and other persons carrying out the Work. The Contractor shall not permit employment of unfit persons or persons not properly skilled in tasks assigned to them.

### § 3.5 WARRANTY

The Contractor warrants to the Owner and Architect that materials and equipment furnished under the Contract will be of good quality and new unless the Contract Documents require or permit otherwise. The Contractor further warrants that the Work will conform to the requirements of the Contract Documents and will be free from defects, except for those inherent in the quality of the Work the Contract Documents require or permit. Work, materials, or equipment not conforming to these requirements may be considered defective. The Contractor's warranty excludes remedy for damage or defect caused by abuse, alterations to the Work not executed by the Contractor, improper or insufficient maintenance, improper operation, or normal wear and tear and normal usage. If required by the Architect, the Contractor shall furnish satisfactory evidence as to the kind and quality of materials and equipment.

### § 3.6 TAXES

The Contractor shall pay sales, consumer, use and similar taxes for the Work provided by the Contractor that are legally enacted when bids are received or negotiations concluded, whether or not yet effective or merely scheduled to go into effect.

### § 3.7 PERMITS, FEES, NOTICES, AND COMPLIANCE WITH LAWS

§ 3.7.1 Unless otherwise provided in the Contract Documents, the Contractor shall secure and pay for the building permit as well as for other permits, fees, licenses, and inspections by government agencies necessary for proper execution and completion of the Work that are customarily secured after execution of the Contract and legally required at the time bids are received or negotiations concluded.

§ 3.7.2 The Contractor shall comply with and give notices required by applicable laws, statutes, ordinances, codes, rules and regulations, and lawful orders of public authorities applicable to performance of the Work.

§ 3.7.3 If the Contractor performs Work knowing it to be contrary to applicable laws, statutes, ordinances, codes, rules and regulations, or lawful orders of public authorities, the Contractor shall assume appropriate responsibility for such Work and shall bear the costs attributable to correction.

§ 3.7.4 **Concealed or Unknown Conditions.** If the Contractor encounters conditions at the site that are (1) subsurface or otherwise concealed physical conditions that differ materially from those indicated in the Contract Documents or (2) unknown physical conditions of an unusual nature, that differ materially from those ordinarily found to exist and generally recognized as inherent in construction activities of the character provided for in the Contract Documents, the Contractor shall promptly provide notice to the Owner and the Architect before conditions are disturbed and in no event later than 21 days after first observance of the conditions. The Architect will promptly investigate such conditions and, if the Architect determines that they differ materially and cause an increase or decrease in the Contractor's cost of, or time required for, performance of any part of the Work, will recommend an equitable adjustment in the Contract Sum or Contract Time, or both. If the Architect determines that the conditions at the site are not materially different from those indicated in the Contract Documents and that no change in the terms of the Contract is justified, the Architect shall promptly notify the Owner and Contractor in writing, stating the reasons. If either party disputes the Architect's determination or recommendation, that party may proceed as provided in Article 15.

§ 3.7.5 If, in the course of the Work, the Contractor encounters human remains or recognizes the existence of burial markers, archaeological sites or wetlands not indicated in the Contract Documents, the Contractor shall immediately suspend any operations that would affect them and shall notify the Owner and Architect. Upon receipt of such notice, the Owner shall promptly take any action necessary to obtain governmental authorization required to resume the operations. The Contractor shall continue to suspend such operations until otherwise instructed by the Owner but shall continue with all other operations that do not affect those remains or features. Requests for adjustments in the Contract Sum and Contract Time arising from the existence of such remains or features may be made as provided in Article 15.

Init.

### § 3.8 ALLOWANCES

§ 3.8.1 The Contractor shall include in the Contract Sum all allowances stated in the Contract Documents. Items covered by allowances shall be supplied for such amounts and by such persons or entities as the Owner may direct, but the Contractor shall not be required to employ persons or entities to whom the Contractor has reasonable objection.

§ 3.8.2 Unless otherwise provided in the Contract Documents,

- .1 allowances shall cover the cost to the Contractor of materials and equipment delivered at the site and all required taxes, less applicable trade discounts;
- .2 Contractor's costs for unloading and handling at the site, labor, installation costs, overhead, profit and other expenses contemplated for stated allowance amounts shall be included in the Contract Sum but not in the allowances; and
- .3 whenever costs are more than or less than allowances, the Contract Sum shall be adjusted accordingly by Change Order. The amount of the Change Order shall reflect (1) the difference between actual costs and the allowances under Section 3.8.2.1 and (2) changes in Contractor's costs under Section 3.8.2.2.

§ 3.8.3 Materials and equipment under an allowance shall be selected by the Owner with reasonable promptness.

### § 3.9 SUPERINTENDENT

§ 3.9.1 The Contractor shall employ a competent superintendent and necessary assistants who shall be in attendance at the Project site during performance of the Work. The superintendent shall represent the Contractor, and communications given to the superintendent shall be as binding as if given to the Contractor.

§ 3.9.2 The Contractor, as soon as practicable after award of the Contract, shall furnish in writing to the Owner through the Architect the name and qualifications of a proposed superintendent. The Architect may reply within 14 days to the Contractor in writing stating (1) whether the Owner or the Architect has reasonable objection to the proposed superintendent or (2) that the Architect requires additional time to review. Failure of the Architect to reply within the 14 day period shall constitute notice of no reasonable objection.

§ 3.9.3 The Contractor shall not employ a proposed superintendent to whom the Owner or Architect has made reasonable and timely objection. The Contractor shall not change the superintendent without the Owner's consent, which shall not unreasonably be withheld or delayed.

### § 3.10 CONTRACTOR'S CONSTRUCTION SCHEDULES

§ 3.10.1 The Contractor, promptly after being awarded the Contract, shall prepare and submit for the Owner's and Architect's information a Contractor's construction schedule for the Work. The schedule shall not exceed time limits current under the Contract Documents, shall be revised at appropriate intervals as required by the conditions of the Work and Project, shall be related to the entire Project to the extent required by the Contract Documents, and shall provide for expeditious and practicable execution of the Work.

§ 3.10.2 The Contractor shall prepare a submittal schedule, promptly after being awarded the Contract and thereafter as necessary to maintain a current submittal schedule, and shall submit the schedule(s) for the Architect's approval. The Architect's approval shall not unreasonably be delayed or withheld. The submittal schedule shall (1) be coordinated with the Contractor's construction schedule, and (2) allow the Architect reasonable time to review submittals. If the Contractor fails to submit a submittal schedule, the Contractor shall not be entitled to any increase in Contract Sum or extension of Contract Time based on the time required for review of submittals.

§ 3.10.3 The Contractor shall perform the Work in general accordance with the most recent schedules submitted to the Owner and Architect.

### § 3.11 DOCUMENTS AND SAMPLES AT THE SITE

The Contractor shall maintain at the site for the Owner one copy of the Drawings, Specifications, Addenda, Change Orders and other Modifications, in good order and marked currently to indicate field changes and selections made during construction, and one copy of approved Shop Drawings, Product Data, Samples and similar required submittals. These shall be available to the Architect and shall be delivered to the Architect for submittal to the Owner upon completion of the Work as a record of the Work as constructed.

Init.

**§ 3.12 SHOP DRAWINGS, PRODUCT DATA AND SAMPLES**

**§ 3.12.1** Shop Drawings are drawings, diagrams, schedules and other data specially prepared for the Work by the Contractor or a Subcontractor, Sub-subcontractor, manufacturer, supplier or distributor to illustrate some portion of the Work.

**§ 3.12.2** Product Data are illustrations, standard schedules, performance charts, instructions, brochures, diagrams and other information furnished by the Contractor to illustrate materials or equipment for some portion of the Work.

**§ 3.12.3** Samples are physical examples that illustrate materials, equipment or workmanship and establish standards by which the Work will be judged.

**§ 3.12.4** Shop Drawings, Product Data, Samples and similar submittals are not Contract Documents. Their purpose is to demonstrate the way by which the Contractor proposes to conform to the information given and the design concept expressed in the Contract Documents for those portions of the Work for which the Contract Documents require submittals. Review by the Architect is subject to the limitations of Section 4.2.7. Informational submittals upon which the Architect is not expected to take responsive action may be so identified in the Contract Documents. Submittals that are not required by the Contract Documents may be returned by the Architect without action.

**§ 3.12.5** The Contractor shall review for compliance with the Contract Documents, approve and submit to the Architect Shop Drawings, Product Data, Samples and similar submittals required by the Contract Documents in accordance with the submittal schedule approved by the Architect or, in the absence of an approved submittal schedule, with reasonable promptness and in such sequence as to cause no delay in the Work or in the activities of the Owner or of separate contractors.

**§ 3.12.6** By submitting Shop Drawings, Product Data, Samples and similar submittals, the Contractor represents to the Owner and Architect that the Contractor has (1) reviewed and approved them, (2) determined and verified materials, field measurements and field construction criteria related thereto, or will do so and (3) checked and coordinated the information contained within such submittals with the requirements of the Work and of the Contract Documents.

**§ 3.12.7** The Contractor shall perform no portion of the Work for which the Contract Documents require submittal and review of Shop Drawings, Product Data, Samples or similar submittals until the respective submittal has been approved by the Architect.

**§ 3.12.8** The Work shall be in accordance with approved submittals except that the Contractor shall not be relieved of responsibility for deviations from requirements of the Contract Documents by the Architect's approval of Shop Drawings, Product Data, Samples or similar submittals unless the Contractor has specifically informed the Architect in writing of such deviation at the time of submittal and (1) the Architect has given written approval to the specific deviation as a minor change in the Work, or (2) a Change Order or Construction Change Directive has been issued authorizing the deviation. The Contractor shall not be relieved of responsibility for errors or omissions in Shop Drawings, Product Data, Samples or similar submittals by the Architect's approval thereof.

**§ 3.12.9** The Contractor shall direct specific attention, in writing or on resubmitted Shop Drawings, Product Data, Samples or similar submittals, to revisions other than those requested by the Architect on previous submittals. In the absence of such written notice, the Architect's approval of a resubmission shall not apply to such revisions.

**§ 3.12.10** The Contractor shall not be required to provide professional services that constitute the practice of architecture or engineering unless such services are specifically required by the Contract Documents for a portion of the Work or unless the Contractor needs to provide such services in order to carry out the Contractor's responsibilities for construction means, methods, techniques, sequences and procedures. The Contractor shall not be required to provide professional services in violation of applicable law. If professional design services or certifications by a design professional related to systems, materials or equipment are specifically required of the Contractor by the Contract Documents, the Owner and the Architect will specify all performance and design criteria that such services must satisfy. The Contractor shall cause such services or certifications to be provided by a properly licensed design professional, whose signature and seal shall appear on all drawings, calculations, specifications, certifications, Shop Drawings and other submittals prepared by such professional. Shop Drawings and other submittals related to the Work designed or certified by such professional, if prepared by others, shall bear such professional's written approval when submitted to the Architect. The Owner and the Architect shall be entitled to rely upon the adequacy, accuracy and

Init.

completeness of the services, certifications and approvals performed or provided by such design professionals, provided the Owner and Architect have specified to the Contractor all performance and design criteria that such services must satisfy. Pursuant to this Section 3.12.10, the Architect will review, approve or take other appropriate action on submittals only for the limited purpose of checking for conformance with information given and the design concept expressed in the Contract Documents. The Contractor shall not be responsible for the adequacy of the performance and design criteria specified in the Contract Documents.

### § 3.13 USE OF SITE

The Contractor shall confine operations at the site to areas permitted by applicable laws, statutes, ordinances, codes, rules and regulations, and lawful orders of public authorities and the Contract Documents and shall not unreasonably encumber the site with materials or equipment.

### § 3.14 CUTTING AND PATCHING

§ 3.14.1 The Contractor shall be responsible for cutting, fitting or patching required to complete the Work or to make its parts fit together properly. All areas requiring cutting, fitting and patching shall be restored to the condition existing prior to the cutting, fitting and patching, unless otherwise required by the Contract Documents.

§ 3.14.2 The Contractor shall not damage or endanger a portion of the Work or fully or partially completed construction of the Owner or separate contractors by cutting, patching or otherwise altering such construction, or by excavation. The Contractor shall not cut or otherwise alter such construction by the Owner or a separate contractor except with written consent of the Owner and of such separate contractor; such consent shall not be unreasonably withheld. The Contractor shall not unreasonably withhold from the Owner or a separate contractor the Contractor's consent to cutting or otherwise altering the Work.

### § 3.15 CLEANING UP

§ 3.15.1 The Contractor shall keep the premises and surrounding area free from accumulation of waste materials or rubbish caused by operations under the Contract. At completion of the Work, the Contractor shall remove waste materials, rubbish, the Contractor's tools, construction equipment, machinery and surplus materials from and about the Project.

§ 3.15.2 If the Contractor fails to clean up as provided in the Contract Documents, the Owner may do so and Owner shall be entitled to reimbursement from the Contractor.

### § 3.16 ACCESS TO WORK

The Contractor shall provide the Owner and Architect access to the Work in preparation and progress wherever located.

### § 3.17 ROYALTIES, PATENTS AND COPYRIGHTS

The Contractor shall pay all royalties and license fees. The Contractor shall defend suits or claims for infringement of copyrights and patent rights and shall hold the Owner and Architect harmless from loss on account thereof, but shall not be responsible for such defense or loss when a particular design, process or product of a particular manufacturer or manufacturers is required by the Contract Documents, or where the copyright violations are contained in Drawings, Specifications or other documents prepared by the Owner or Architect. However, if the Contractor has reason to believe that the required design, process or product is an infringement of a copyright or a patent, the Contractor shall be responsible for such loss unless such information is promptly furnished to the Architect.

### § 3.18 INDEMNIFICATION

§ 3.18.1 To the fullest extent permitted by law the Contractor shall indemnify and hold harmless the Owner, Architect, Architect's consultants, and agents and employees of any of them from and against claims, damages, losses and expenses, including but not limited to attorneys' fees, arising out of or resulting from performance of the Work, provided that such claim, damage, loss or expense is attributable to bodily injury, sickness, disease or death, or to injury to or destruction of tangible property (other than the Work itself), but only to the extent caused by the negligent acts or omissions of the Contractor, a Subcontractor, anyone directly or indirectly employed by them or anyone for whose acts they may be liable, regardless of whether or not such claim, damage, loss or expense is caused in part by a party indemnified hereunder. Such obligation shall not be construed to negate, abridge, or reduce other rights or obligations of indemnity which would otherwise exist as to a party or person described in this Section 3.18.

Init.

§ 3.18.2 In claims against any person or entity indemnified under this Section 3.18 by an employee of the Contractor, a Subcontractor, anyone directly or indirectly employed by them or anyone for whose acts they may be liable, the indemnification obligation under Section 3.18.1 shall not be limited by a limitation on amount or type of damages, compensation or benefits payable by or for the Contractor or a Subcontractor under workers' compensation acts, disability benefit acts or other employee benefit acts.

#### ARTICLE 4 ARCHITECT

##### § 4.1 GENERAL

§ 4.1.1 The Owner shall retain an architect lawfully licensed to practice architecture or an entity lawfully practicing architecture in the jurisdiction where the Project is located. That person or entity is identified as the Architect in the Agreement and is referred to throughout the Contract Documents as if singular in number.

§ 4.1.2 Duties, responsibilities and limitations of authority of the Architect as set forth in the Contract Documents shall not be restricted, modified or extended without written consent of the Owner, Contractor and Architect. Consent shall not be unreasonably withheld.

§ 4.1.3 If the employment of the Architect is terminated, the Owner shall employ a successor architect as to whom the Contractor has no reasonable objection and whose status under the Contract Documents shall be that of the Architect.

##### § 4.2 ADMINISTRATION OF THE CONTRACT

§ 4.2.1 The Architect will provide administration of the Contract as described in the Contract Documents and will be an Owner's representative during construction until the date the Architect issues the final Certificate For Payment. The Architect will have authority to act on behalf of the Owner only to the extent provided in the Contract Documents.

§ 4.2.2 The Architect will visit the site at intervals appropriate to the stage of construction, or as otherwise agreed with the Owner, to become generally familiar with the progress and quality of the portion of the Work completed, and to determine in general if the Work observed is being performed in a manner indicating that the Work, when fully completed, will be in accordance with the Contract Documents. However, the Architect will not be required to make exhaustive or continuous on-site inspections to check the quality or quantity of the Work. The Architect will not have control over, charge of, or responsibility for, the construction means, methods, techniques, sequences or procedures, or for the safety precautions and programs in connection with the Work, since these are solely the Contractor's rights and responsibilities under the Contract Documents, except as provided in Section 3.3.1.

§ 4.2.3 On the basis of the site visits, the Architect will keep the Owner reasonably informed about the progress and quality of the portion of the Work completed, and report to the Owner (1) known deviations from the Contract Documents and from the most recent construction schedule submitted by the Contractor, and (2) defects and deficiencies observed in the Work. The Architect will not be responsible for the Contractor's failure to perform the Work in accordance with the requirements of the Contract Documents. The Architect will not have control over or charge of and will not be responsible for acts or omissions of the Contractor, Subcontractors, or their agents or employees, or any other persons or entities performing portions of the Work.

##### § 4.2.4 COMMUNICATIONS FACILITATING CONTRACT ADMINISTRATION

Except as otherwise provided in the Contract Documents or when direct communications have been specially authorized, the Owner and Contractor shall endeavor to communicate with each other through the Architect about matters arising out of or relating to the Contract. Communications by and with the Architect's consultants shall be through the Architect. Communications by and with Subcontractors and material suppliers shall be through the Contractor. Communications by and with separate contractors shall be through the Owner.

§ 4.2.5 Based on the Architect's evaluations of the Contractor's Applications for Payment, the Architect will review and certify the amounts due the Contractor and will issue Certificates for Payment in such amounts.

§ 4.2.6 The Architect has authority to reject Work that does not conform to the Contract Documents. Whenever the Architect considers it necessary or advisable, the Architect will have authority to require inspection or testing of the Work in accordance with Sections 13.5.2 and 13.5.3, whether or not such Work is fabricated, installed or completed. However, neither this authority of the Architect nor a decision made in good faith either to exercise or not to exercise such authority shall give rise to a duty or responsibility of the Architect to the Contractor, Subcontractors, material and equipment suppliers, their agents or employees, or other persons or entities performing portions of the Work.

§ 4.2.7 The Architect will review and approve, or take other appropriate action upon, the Contractor's submittals such as Shop Drawings, Product Data and Samples, but only for the limited purpose of checking for conformance with information given and the design concept expressed in the Contract Documents. The Architect's action will be taken in accordance with the submittal schedule approved by the Architect or, in the absence of an approved submittal schedule, with reasonable promptness while allowing sufficient time in the Architect's professional judgment to permit adequate review. Review of such submittals is not conducted for the purpose of determining the accuracy and completeness of other details such as dimensions and quantities, or for substantiating instructions for installation or performance of equipment or systems, all of which remain the responsibility of the Contractor as required by the Contract Documents. The Architect's review of the Contractor's submittals shall not relieve the Contractor of the obligations under Sections 3.3, 3.5 and 3.12. The Architect's review shall not constitute approval of safety precautions or, unless otherwise specifically stated by the Architect, of any construction means, methods, techniques, sequences or procedures. The Architect's approval of a specific item shall not indicate approval of an assembly of which the item is a component.

§ 4.2.8 The Architect will prepare Change Orders and Construction Change Directives, and may authorize minor changes in the Work as provided in Section 7.4. The Architect will investigate and make determinations and recommendations regarding concealed and unknown conditions as provided in Section 3.7.4.

§ 4.2.9 The Architect will conduct inspections to determine the date or dates of Substantial Completion and the date of final completion; issue Certificates of Substantial Completion pursuant to Section 9.8; receive and forward to the Owner, for the Owner's review and records, written warranties and related documents required by the Contract and assembled by the Contractor pursuant to Section 9.10; and issue a final Certificate for Payment pursuant to Section 9.10.

§ 4.2.10 If the Owner and Architect agree, the Architect will provide one or more project representatives to assist in carrying out the Architect's responsibilities at the site. The duties, responsibilities and limitations of authority of such project representatives shall be as set forth in an exhibit to be incorporated in the Contract Documents.

§ 4.2.11 The Architect will interpret and decide matters concerning performance under, and requirements of, the Contract Documents on written request of either the Owner or Contractor. The Architect's response to such requests will be made in writing within any time limits agreed upon or otherwise with reasonable promptness.

§ 4.2.12 Interpretations and decisions of the Architect will be consistent with the intent of, and reasonably inferable from, the Contract Documents and will be in writing or in the form of drawings. When making such interpretations and decisions, the Architect will endeavor to secure faithful performance by both Owner and Contractor, will not show partiality to either and will not be liable for results of interpretations or decisions rendered in good faith.

§ 4.2.13 The Architect's decisions on matters relating to aesthetic effect will be final if consistent with the intent expressed in the Contract Documents.

§ 4.2.14 The Architect will review and respond to requests for information about the Contract Documents. The Architect's response to such requests will be made in writing within any time limits agreed upon or otherwise with reasonable promptness. If appropriate, the Architect will prepare and issue supplemental Drawings and Specifications in response to the requests for information.

## ARTICLE 5 SUBCONTRACTORS

### § 5.1 DEFINITIONS

§ 5.1.1 A Subcontractor is a person or entity who has a direct contract with the Contractor to perform a portion of the Work at the site. The term "Subcontractor" is referred to throughout the Contract Documents as if singular in number and means a Subcontractor or an authorized representative of the Subcontractor. The term "Subcontractor" does not include a separate contractor or subcontractors of a separate contractor.

§ 5.1.2 A Sub-subcontractor is a person or entity who has a direct or indirect contract with a Subcontractor to perform a portion of the Work at the site. The term "Sub-subcontractor" is referred to throughout the Contract Documents as if singular in number and means a Sub-subcontractor or an authorized representative of the Sub-subcontractor.

## § 5.2 AWARD OF SUBCONTRACTS AND OTHER CONTRACTS FOR PORTIONS OF THE WORK

§ 5.2.1 Unless otherwise stated in the Contract Documents or the bidding requirements, the Contractor, as soon as practicable after award of the Contract, shall furnish in writing to the Owner through the Architect the names of persons or entities (including those who are to furnish materials or equipment fabricated to a special design) proposed for each principal portion of the Work. The Architect may reply within 14 days to the Contractor in writing stating (1) whether the Owner or the Architect has reasonable objection to any such proposed person or entity or (2) that the Architect requires additional time for review. Failure of the Owner or Architect to reply within the 14 day period shall constitute notice of no reasonable objection.

§ 5.2.2 The Contractor shall not contract with a proposed person or entity to whom the Owner or Architect has made reasonable and timely objection. The Contractor shall not be required to contract with anyone to whom the Contractor has made reasonable objection.

§ 5.2.3 If the Owner or Architect has reasonable objection to a person or entity proposed by the Contractor, the Contractor shall propose another to whom the Owner or Architect has no reasonable objection. If the proposed but rejected Subcontractor was reasonably capable of performing the Work, the Contract Sum and Contract Time shall be increased or decreased by the difference, if any, occasioned by such change, and an appropriate Change Order shall be issued before commencement of the substitute Subcontractor's Work. However, no increase in the Contract Sum or Contract Time shall be allowed for such change unless the Contractor has acted promptly and responsively in submitting names as required.

§ 5.2.4 The Contractor shall not substitute a Subcontractor, person or entity previously selected if the Owner or Architect makes reasonable objection to such substitution.

## § 5.3 SUBCONTRACTUAL RELATIONS

By appropriate agreement, written where legally required for validity, the Contractor shall require each Subcontractor, to the extent of the Work to be performed by the Subcontractor, to be bound to the Contractor by terms of the Contract Documents, and to assume toward the Contractor all the obligations and responsibilities, including the responsibility for safety of the Subcontractor's Work, which the Contractor, by these Documents, assumes toward the Owner and Architect. Each subcontract agreement shall preserve and protect the rights of the Owner and Architect under the Contract Documents with respect to the Work to be performed by the Subcontractor so that subcontracting thereof will not prejudice such rights, and shall allow to the Subcontractor, unless specifically provided otherwise in the subcontract agreement, the benefit of all rights, remedies and redress against the Contractor that the Contractor, by the Contract Documents, has against the Owner. Where appropriate, the Contractor shall require each Subcontractor to enter into similar agreements with Sub-subcontractors. The Contractor shall make available to each proposed Subcontractor, prior to the execution of the subcontract agreement, copies of the Contract Documents to which the Subcontractor will be bound, and, upon written request of the Subcontractor, identify to the Subcontractor terms and conditions of the proposed subcontract agreement that may be at variance with the Contract Documents. Subcontractors will similarly make copies of applicable portions of such documents available to their respective proposed Sub-subcontractors.

## § 5.4 CONTINGENT ASSIGNMENT OF SUBCONTRACTS

§ 5.4.1 Each subcontract agreement for a portion of the Work is assigned by the Contractor to the Owner, provided that

- .1 assignment is effective only after termination of the Contract by the Owner for cause pursuant to Section 14.2 and only for those subcontract agreements that the Owner accepts by notifying the Subcontractor and Contractor in writing; and
- .2 assignment is subject to the prior rights of the surety, if any, obligated under bond relating to the Contract.

When the Owner accepts the assignment of a subcontract agreement, the Owner assumes the Contractor's rights and obligations under the subcontract.

§ 5.4.2 Upon such assignment, if the Work has been suspended for more than 30 days, the Subcontractor's compensation shall be equitably adjusted for increases in cost resulting from the suspension.

§ 5.4.3 Upon such assignment to the Owner under this Section 5.4, the Owner may further assign the subcontract to a successor contractor or other entity. If the Owner assigns the subcontract to a successor contractor or other entity, the

Init.

Owner shall nevertheless remain legally responsible for all of the successor contractor's obligations under the subcontract.

## **ARTICLE 6 CONSTRUCTION BY OWNER OR BY SEPARATE CONTRACTORS**

### **§ 6.1 OWNER'S RIGHT TO PERFORM CONSTRUCTION AND TO AWARD SEPARATE CONTRACTS**

**§ 6.1.1** The Owner reserves the right to perform construction or operations related to the Project with the Owner's own forces, and to award separate contracts in connection with other portions of the Project or other construction or operations on the site under Conditions of the Contract identical or substantially similar to these including those portions related to insurance and waiver of subrogation. If the Contractor claims that delay or additional cost is involved because of such action by the Owner, the Contractor shall make such Claim as provided in Article 15.

**§ 6.1.2** When separate contracts are awarded for different portions of the Project or other construction or operations on the site, the term "Contractor" in the Contract Documents in each case shall mean the Contractor who executes each separate Owner-Contractor Agreement.

**§ 6.1.3** The Owner shall provide for coordination of the activities of the Owner's own forces and of each separate contractor with the Work of the Contractor, who shall cooperate with them. The Contractor shall participate with other separate contractors and the Owner in reviewing their construction schedules. The Contractor shall make any revisions to the construction schedule deemed necessary after a joint review and mutual agreement. The construction schedules shall then constitute the schedules to be used by the Contractor, separate contractors and the Owner until subsequently revised.

**§ 6.1.4** Unless otherwise provided in the Contract Documents, when the Owner performs construction or operations related to the Project with the Owner's own forces, the Owner shall be deemed to be subject to the same obligations and to have the same rights that apply to the Contractor under the Conditions of the Contract, including, without excluding others, those stated in Article 3, this Article 6 and Articles 10, 11 and 12.

### **§ 6.2 MUTUAL RESPONSIBILITY**

**§ 6.2.1** The Contractor shall afford the Owner and separate contractors reasonable opportunity for introduction and storage of their materials and equipment and performance of their activities, and shall connect and coordinate the Contractor's construction and operations with theirs as required by the Contract Documents.

**§ 6.2.2** If part of the Contractor's Work depends for proper execution or results upon construction or operations by the Owner or a separate contractor, the Contractor shall, prior to proceeding with that portion of the Work, promptly report to the Architect apparent discrepancies or defects in such other construction that would render it unsuitable for such proper execution and results. Failure of the Contractor so to report shall constitute an acknowledgment that the Owner's or separate contractor's completed or partially completed construction is fit and proper to receive the Contractor's Work, except as to defects not then reasonably discoverable.

**§ 6.2.3** The Contractor shall reimburse the Owner for costs the Owner incurs that are payable to a separate contractor because of the Contractor's delays, improperly timed activities or defective construction. The Owner shall be responsible to the Contractor for costs the Contractor incurs because of a separate contractor's delays, improperly timed activities, damage to the Work or defective construction.

**§ 6.2.4** The Contractor shall promptly remedy damage the Contractor wrongfully causes to completed or partially completed construction or to property of the Owner or separate contractors as provided in Section 10.2.5.

**§ 6.2.5** The Owner and each separate contractor shall have the same responsibilities for cutting and patching as are described for the Contractor in Section 3.14.

### **§ 6.3 OWNER'S RIGHT TO CLEAN UP**

If a dispute arises among the Contractor, separate contractors and the Owner as to the responsibility under their respective contracts for maintaining the premises and surrounding area free from waste materials and rubbish, the Owner may clean up and the Architect will allocate the cost among those responsible.

## ARTICLE 7 CHANGES IN THE WORK

### § 7.1 GENERAL

§ 7.1.1 Changes in the Work may be accomplished after execution of the Contract, and without invalidating the Contract, by Change Order, Construction Change Directive or order for a minor change in the Work, subject to the limitations stated in this Article 7 and elsewhere in the Contract Documents.

§ 7.1.2 A Change Order shall be based upon agreement among the Owner, Contractor and Architect; a Construction Change Directive requires agreement by the Owner and Architect and may or may not be agreed to by the Contractor; an order for a minor change in the Work may be issued by the Architect alone.

§ 7.1.3 Changes in the Work shall be performed under applicable provisions of the Contract Documents, and the Contractor shall proceed promptly, unless otherwise provided in the Change Order, Construction Change Directive or order for a minor change in the Work.

### § 7.2 CHANGE ORDERS

§ 7.2.1 A Change Order is a written instrument prepared by the Architect and signed by the Owner, Contractor and Architect stating their agreement upon all of the following:

- .1 The change in the Work;
- .2 The amount of the adjustment, if any, in the Contract Sum; and
- .3 The extent of the adjustment, if any, in the Contract Time.

### § 7.3 CONSTRUCTION CHANGE DIRECTIVES

§ 7.3.1 A Construction Change Directive is a written order prepared by the Architect and signed by the Owner and Architect, directing a change in the Work prior to agreement on adjustment, if any, in the Contract Sum or Contract Time, or both. The Owner may by Construction Change Directive, without invalidating the Contract, order changes in the Work within the general scope of the Contract consisting of additions, deletions or other revisions, the Contract Sum and Contract Time being adjusted accordingly.

§ 7.3.2 A Construction Change Directive shall be used in the absence of total agreement on the terms of a Change Order.

§ 7.3.3 If the Construction Change Directive provides for an adjustment to the Contract Sum, the adjustment shall be based on one of the following methods:

- .1 Mutual acceptance of a lump sum properly itemized and supported by sufficient substantiating data to permit evaluation;
- .2 Unit prices stated in the Contract Documents or subsequently agreed upon;
- .3 Cost to be determined in a manner agreed upon by the parties and a mutually acceptable fixed or percentage fee; or
- .4 As provided in Section 7.3.7.

§ 7.3.4 If unit prices are stated in the Contract Documents or subsequently agreed upon, and if quantities originally contemplated are materially changed in a proposed Change Order or Construction Change Directive so that application of such unit prices to quantities of Work proposed will cause substantial inequity to the Owner or Contractor, the applicable unit prices shall be equitably adjusted.

§ 7.3.5 Upon receipt of a Construction Change Directive, the Contractor shall promptly proceed with the change in the Work involved and advise the Architect of the Contractor's agreement or disagreement with the method, if any, provided in the Construction Change Directive for determining the proposed adjustment in the Contract Sum or Contract Time.

§ 7.3.6 A Construction Change Directive signed by the Contractor indicates the Contractor's agreement therewith, including adjustment in Contract Sum and Contract Time or the method for determining them. Such agreement shall be effective immediately and shall be recorded as a Change Order.

§ 7.3.7 If the Contractor does not respond promptly or disagrees with the method for adjustment in the Contract Sum, the Architect shall determine the method and the adjustment on the basis of reasonable expenditures and savings of those performing the Work attributable to the change, including, in case of an increase in the Contract Sum, an amount

for overhead and profit as set forth in the Agreement, or if no such amount is set forth in the Agreement, a reasonable amount. In such case, and also under Section 7.3.3.3, the Contractor shall keep and present, in such form as the Architect may prescribe, an itemized accounting together with appropriate supporting data. Unless otherwise provided in the Contract Documents, costs for the purposes of this Section 7.3.7 shall be limited to the following:

- .1 Costs of labor, including social security, old age and unemployment insurance, fringe benefits required by agreement or custom, and workers' compensation insurance;
- .2 Costs of materials, supplies and equipment, including cost of transportation, whether incorporated or consumed;
- .3 Rental costs of machinery and equipment, exclusive of hand tools, whether rented from the Contractor or others;
- .4 Costs of premiums for all bonds and insurance, permit fees, and sales, use or similar taxes related to the Work; and
- .5 Additional costs of supervision and field office personnel directly attributable to the change.

§ 7.3.8 The amount of credit to be allowed by the Contractor to the Owner for a deletion or change that results in a net decrease in the Contract Sum shall be actual net cost as confirmed by the Architect. When both additions and credits covering related Work or substitutions are involved in a change, the allowance for overhead and profit shall be figured on the basis of net increase, if any, with respect to that change.

§ 7.3.9 Pending final determination of the total cost of a Construction Change Directive to the Owner, the Contractor may request payment for Work completed under the Construction Change Directive in Applications for Payment. The Architect will make an interim determination for purposes of monthly certification for payment for those costs and certify for payment the amount that the Architect determines, in the Architect's professional judgment, to be reasonably justified. The Architect's interim determination of cost shall adjust the Contract Sum on the same basis as a Change Order, subject to the right of either party to disagree and assert a Claim in accordance with Article 15.

§ 7.3.10 When the Owner and Contractor agree with a determination made by the Architect concerning the adjustments in the Contract Sum and Contract Time, or otherwise reach agreement upon the adjustments, such agreement shall be effective immediately and the Architect will prepare a Change Order. Change Orders may be issued for all or any part of a Construction Change Directive.

#### § 7.4 MINOR CHANGES IN THE WORK

The Architect has authority to order minor changes in the Work not involving adjustment in the Contract Sum or extension of the Contract Time and not inconsistent with the intent of the Contract Documents. Such changes will be effected by written order signed by the Architect and shall be binding on the Owner and Contractor.

### ARTICLE 8 TIME

#### § 8.1 DEFINITIONS

§ 8.1.1 Unless otherwise provided, Contract Time is the period of time, including authorized adjustments, allotted in the Contract Documents for Substantial Completion of the Work.

§ 8.1.2 The date of commencement of the Work is the date established in the Agreement.

§ 8.1.3 The date of Substantial Completion is the date certified by the Architect in accordance with Section 9.8.

§ 8.1.4 The term "day" as used in the Contract Documents shall mean calendar day unless otherwise specifically defined.

#### § 8.2 PROGRESS AND COMPLETION

§ 8.2.1 Time limits stated in the Contract Documents are of the essence of the Contract. By executing the Agreement the Contractor confirms that the Contract Time is a reasonable period for performing the Work.

§ 8.2.2 The Contractor shall not knowingly, except by agreement or instruction of the Owner in writing, prematurely commence operations on the site or elsewhere prior to the effective date of insurance required by Article 11 to be furnished by the Contractor and Owner. The date of commencement of the Work shall not be changed by the effective date of such insurance.

§ 8.2.3 The Contractor shall proceed expeditiously with adequate forces and shall achieve Substantial Completion within the Contract Time.

### § 8.3 DELAYS AND EXTENSIONS OF TIME

§ 8.3.1 If the Contractor is delayed at any time in the commencement or progress of the Work by an act or neglect of the Owner or Architect, or of an employee of either, or of a separate contractor employed by the Owner; or by changes ordered in the Work; or by labor disputes, fire, unusual delay in deliveries, unavoidable casualties or other causes beyond the Contractor's control; or by delay authorized by the Owner pending mediation and arbitration; or by other causes that the Architect determines may justify delay, then the Contract Time shall be extended by Change Order for such reasonable time as the Architect may determine.

§ 8.3.2 Claims relating to time shall be made in accordance with applicable provisions of Article 15.

§ 8.3.3 This Section 8.3 does not preclude recovery of damages for delay by either party under other provisions of the Contract Documents.

## ARTICLE 9 PAYMENTS AND COMPLETION

### § 9.1 CONTRACT SUM

The Contract Sum is stated in the Agreement and, including authorized adjustments, is the total amount payable by the Owner to the Contractor for performance of the Work under the Contract Documents.

### § 9.2 SCHEDULE OF VALUES

Where the Contract is based on a stipulated sum or Guaranteed Maximum Price, the Contractor shall submit to the Architect, before the first Application for Payment, a schedule of values allocating the entire Contract Sum to the various portions of the Work and prepared in such form and supported by such data to substantiate its accuracy as the Architect may require. This schedule, unless objected to by the Architect, shall be used as a basis for reviewing the Contractor's Applications for Payment.

### § 9.3 APPLICATIONS FOR PAYMENT

§ 9.3.1 At least ten days before the date established for each progress payment, the Contractor shall submit to the Architect an itemized Application for Payment prepared in accordance with the schedule of values, if required under Section 9.2., for completed portions of the Work. Such application shall be notarized, if required, and supported by such data substantiating the Contractor's right to payment as the Owner or Architect may require, such as copies of requisitions from Subcontractors and material suppliers, and shall reflect retainage if provided for in the Contract Documents.

§ 9.3.1.1 As provided in Section 7.3.9, such applications may include requests for payment on account of changes in the Work that have been properly authorized by Construction Change Directives, or by interim determinations of the Architect, but not yet included in Change Orders.

§ 9.3.1.2 Applications for Payment shall not include requests for payment for portions of the Work for which the Contractor does not intend to pay a Subcontractor or material supplier, unless such Work has been performed by others whom the Contractor intends to pay.

§ 9.3.2 Unless otherwise provided in the Contract Documents, payments shall be made on account of materials and equipment delivered and suitably stored at the site for subsequent incorporation in the Work. If approved in advance by the Owner, payment may similarly be made for materials and equipment suitably stored off the site at a location agreed upon in writing. Payment for materials and equipment stored on or off the site shall be conditioned upon compliance by the Contractor with procedures satisfactory to the Owner to establish the Owner's title to such materials and equipment or otherwise protect the Owner's interest, and shall include the costs of applicable insurance, storage and transportation to the site for such materials and equipment stored off the site.

§ 9.3.3 The Contractor warrants that title to all Work covered by an Application for Payment will pass to the Owner no later than the time of payment. The Contractor further warrants that upon submittal of an Application for Payment all Work for which Certificates for Payment have been previously issued and payments received from the Owner shall, to the best of the Contractor's knowledge, information and belief, be free and clear of liens, claims, security interests or

encumbrances in favor of the Contractor, Subcontractors, material suppliers, or other persons or entities making a claim by reason of having provided labor, materials and equipment relating to the Work.

#### § 9.4 CERTIFICATES FOR PAYMENT

§ 9.4.1 The Architect will, within seven days after receipt of the Contractor's Application for Payment, either issue to the Owner a Certificate for Payment, with a copy to the Contractor, for such amount as the Architect determines is properly due, or notify the Contractor and Owner in writing of the Architect's reasons for withholding certification in whole or in part as provided in Section 9.5.1.

§ 9.4.2 The issuance of a Certificate for Payment will constitute a representation by the Architect to the Owner, based on the Architect's evaluation of the Work and the data comprising the Application for Payment, that, to the best of the Architect's knowledge, information and belief, the Work has progressed to the point indicated and that the quality of the Work is in accordance with the Contract Documents. The foregoing representations are subject to an evaluation of the Work for conformance with the Contract Documents upon Substantial Completion, to results of subsequent tests and inspections, to correction of minor deviations from the Contract Documents prior to completion and to specific qualifications expressed by the Architect. The issuance of a Certificate for Payment will further constitute a representation that the Contractor is entitled to payment in the amount certified. However, the issuance of a Certificate for Payment will not be a representation that the Architect has (1) made exhaustive or continuous on-site inspections to check the quality or quantity of the Work, (2) reviewed construction means, methods, techniques, sequences or procedures, (3) reviewed copies of requisitions received from Subcontractors and material suppliers and other data requested by the Owner to substantiate the Contractor's right to payment, or (4) made examination to ascertain how or for what purpose the Contractor has used money previously paid on account of the Contract Sum.

#### § 9.5 DECISIONS TO WITHHOLD CERTIFICATION

§ 9.5.1 The Architect may withhold a Certificate for Payment in whole or in part, to the extent reasonably necessary to protect the Owner, if in the Architect's opinion the representations to the Owner required by Section 9.4.2 cannot be made. If the Architect is unable to certify payment in the amount of the Application, the Architect will notify the Contractor and Owner as provided in Section 9.4.1. If the Contractor and Architect cannot agree on a revised amount, the Architect will promptly issue a Certificate for Payment for the amount for which the Architect is able to make such representations to the Owner. The Architect may also withhold a Certificate for Payment or, because of subsequently discovered evidence, may nullify the whole or a part of a Certificate for Payment previously issued, to such extent as may be necessary in the Architect's opinion to protect the Owner from loss for which the Contractor is responsible, including loss resulting from acts and omissions described in Section 3.3.2, because of

- .1 defective Work not remedied;
- .2 third party claims filed or reasonable evidence indicating probable filing of such claims unless security acceptable to the Owner is provided by the Contractor;
- .3 failure of the Contractor to make payments properly to Subcontractors or for labor, materials or equipment;
- .4 reasonable evidence that the Work cannot be completed for the unpaid balance of the Contract Sum;
- .5 damage to the Owner or a separate contractor;
- .6 reasonable evidence that the Work will not be completed within the Contract Time, and that the unpaid balance would not be adequate to cover actual or liquidated damages for the anticipated delay; or
- .7 repeated failure to carry out the Work in accordance with the Contract Documents.

§ 9.5.2 When the above reasons for withholding certification are removed, certification will be made for amounts previously withheld.

§ 9.5.3 If the Architect withholds certification for payment under Section 9.5.1.3, the Owner may, at its sole option, issue joint checks to the Contractor and to any Subcontractor or material or equipment suppliers to whom the Contractor failed to make payment for Work properly performed or material or equipment suitably delivered. If the Owner makes payments by joint check, the Owner shall notify the Architect and the Architect will reflect such payment on the next Certificate for Payment.

#### § 9.6 PROGRESS PAYMENTS

§ 9.6.1 After the Architect has issued a Certificate for Payment, the Owner shall make payment in the manner and within the time provided in the Contract Documents, and shall so notify the Architect.

§ 9.6.2 The Contractor shall pay each Subcontractor no later than seven days after receipt of payment from the Owner the amount to which the Subcontractor is entitled, reflecting percentages actually retained from payments to the Contractor on account of the Subcontractor's portion of the Work. The Contractor shall, by appropriate agreement with each Subcontractor, require each Subcontractor to make payments to Sub-subcontractors in a similar manner.

§ 9.6.3 The Architect will, on request, furnish to a Subcontractor, if practicable, information regarding percentages of completion or amounts applied for by the Contractor and action taken thereon by the Architect and Owner on account of portions of the Work done by such Subcontractor.

§ 9.6.4 The Owner has the right to request written evidence from the Contractor that the Contractor has properly paid Subcontractors and material and equipment suppliers amounts paid by the Owner to the Contractor for subcontracted Work. If the Contractor fails to furnish such evidence within seven days, the Owner shall have the right to contact Subcontractors to ascertain whether they have been properly paid. Neither the Owner nor Architect shall have an obligation to pay or to see to the payment of money to a Subcontractor, except as may otherwise be required by law.

§ 9.6.5 Contractor payments to material and equipment suppliers shall be treated in a manner similar to that provided in Sections 9.6.2, 9.6.3 and 9.6.4.

§ 9.6.6 A Certificate for Payment, a progress payment, or partial or entire use or occupancy of the Project by the Owner shall not constitute acceptance of Work not in accordance with the Contract Documents.

§ 9.6.7 Unless the Contractor provides the Owner with a payment bond in the full penal sum of the Contract Sum, payments received by the Contractor for Work properly performed by Subcontractors and suppliers shall be held by the Contractor for those Subcontractors or suppliers who performed Work or furnished materials, or both, under contract with the Contractor for which payment was made by the Owner. Nothing contained herein shall require money to be placed in a separate account and not commingled with money of the Contractor, shall create any fiduciary liability or tort liability on the part of the Contractor for breach of trust or shall entitle any person or entity to an award of punitive damages against the Contractor for breach of the requirements of this provision.

#### § 9.7 FAILURE OF PAYMENT

If the Architect does not issue a Certificate for Payment, through no fault of the Contractor, within seven days after receipt of the Contractor's Application for Payment, or if the Owner does not pay the Contractor within seven days after the date established in the Contract Documents the amount certified by the Architect or awarded by binding dispute resolution, then the Contractor may, upon seven additional days' written notice to the Owner and Architect, stop the Work until payment of the amount owing has been received. The Contract Time shall be extended appropriately and the Contract Sum shall be increased by the amount of the Contractor's reasonable costs of shut-down, delay and start-up, plus interest as provided for in the Contract Documents.

#### § 9.8 SUBSTANTIAL COMPLETION

§ 9.8.1 Substantial Completion is the stage in the progress of the Work when the Work or designated portion thereof is sufficiently complete in accordance with the Contract Documents so that the Owner can occupy or utilize the Work for its intended use.

§ 9.8.2 When the Contractor considers that the Work, or a portion thereof which the Owner agrees to accept separately, is substantially complete, the Contractor shall prepare and submit to the Architect a comprehensive list of items to be completed or corrected prior to final payment. Failure to include an item on such list does not alter the responsibility of the Contractor to complete all Work in accordance with the Contract Documents.

§ 9.8.3 Upon receipt of the Contractor's list, the Architect will make an inspection to determine whether the Work or designated portion thereof is substantially complete. If the Architect's inspection discloses any item, whether or not included on the Contractor's list, which is not sufficiently complete in accordance with the Contract Documents so that the Owner can occupy or utilize the Work or designated portion thereof for its intended use, the Contractor shall, before issuance of the Certificate of Substantial Completion, complete or correct such item upon notification by the Architect. In such case, the Contractor shall then submit a request for another inspection by the Architect to determine Substantial Completion.

§ 9.8.4 When the Work or designated portion thereof is substantially complete, the Architect will prepare a Certificate of Substantial Completion that shall establish the date of Substantial Completion, shall establish responsibilities of the Owner and Contractor for security, maintenance, heat, utilities, damage to the Work and insurance, and shall fix the time within which the Contractor shall finish all items on the list accompanying the Certificate. Warranties required by the Contract Documents shall commence on the date of Substantial Completion of the Work or designated portion thereof unless otherwise provided in the Certificate of Substantial Completion.

§ 9.8.5 The Certificate of Substantial Completion shall be submitted to the Owner and Contractor for their written acceptance of responsibilities assigned to them in such Certificate. Upon such acceptance and consent of surety, if any, the Owner shall make payment of retainage applying to such Work or designated portion thereof. Such payment shall be adjusted for Work that is incomplete or not in accordance with the requirements of the Contract Documents.

#### § 9.9 PARTIAL OCCUPANCY OR USE

§ 9.9.1 The Owner may occupy or use any completed or partially completed portion of the Work at any stage when such portion is designated by separate agreement with the Contractor, provided such occupancy or use is consented to by the insurer as required under Section 11.3.1.5 and authorized by public authorities having jurisdiction over the Project. Such partial occupancy or use may commence whether or not the portion is substantially complete, provided the Owner and Contractor have accepted in writing the responsibilities assigned to each of them for payments, retainage, if any, security, maintenance, heat, utilities, damage to the Work and insurance, and have agreed in writing concerning the period for correction of the Work and commencement of warranties required by the Contract Documents. When the Contractor considers a portion substantially complete, the Contractor shall prepare and submit a list to the Architect as provided under Section 9.8.2. Consent of the Contractor to partial occupancy or use shall not be unreasonably withheld. The stage of the progress of the Work shall be determined by written agreement between the Owner and Contractor or, if no agreement is reached, by decision of the Architect.

§ 9.9.2 Immediately prior to such partial occupancy or use, the Owner, Contractor and Architect shall jointly inspect the area to be occupied or portion of the Work to be used in order to determine and record the condition of the Work.

§ 9.9.3 Unless otherwise agreed upon, partial occupancy or use of a portion or portions of the Work shall not constitute acceptance of Work not complying with the requirements of the Contract Documents.

#### § 9.10 FINAL COMPLETION AND FINAL PAYMENT

§ 9.10.1 Upon receipt of the Contractor's written notice that the Work is ready for final inspection and acceptance and upon receipt of a final Application for Payment, the Architect will promptly make such inspection and, when the Architect finds the Work acceptable under the Contract Documents and the Contract fully performed, the Architect will promptly issue a final Certificate for Payment stating that to the best of the Architect's knowledge, information and belief, and on the basis of the Architect's on-site visits and inspections, the Work has been completed in accordance with terms and conditions of the Contract Documents and that the entire balance found to be due the Contractor and noted in the final Certificate is due and payable. The Architect's final Certificate for Payment will constitute a further representation that conditions listed in Section 9.10.2 as precedent to the Contractor's being entitled to final payment have been fulfilled.

§ 9.10.2 Neither final payment nor any remaining retained percentage shall become due until the Contractor submits to the Architect (1) an affidavit that payrolls, bills for materials and equipment, and other indebtedness connected with the Work for which the Owner or the Owner's property might be responsible or encumbered (less amounts withheld by Owner) have been paid or otherwise satisfied, (2) a certificate evidencing that insurance required by the Contract Documents to remain in force after final payment is currently in effect and will not be canceled or allowed to expire until at least 30 days' prior written notice has been given to the Owner, (3) a written statement that the Contractor knows of no substantial reason that the insurance will not be renewable to cover the period required by the Contract Documents, (4) consent of surety, if any, to final payment and (5), if required by the Owner, other data establishing payment or satisfaction of obligations, such as receipts, releases and waivers of liens, claims, security interests or encumbrances arising out of the Contract, to the extent and in such form as may be designated by the Owner. If a Subcontractor refuses to furnish a release or waiver required by the Owner, the Contractor may furnish a bond satisfactory to the Owner to indemnify the Owner against such lien. If such lien remains unsatisfied after payments are made, the Contractor shall refund to the Owner all money that the Owner may be compelled to pay in discharging such lien, including all costs and reasonable attorneys' fees.

§ 9.10.3 If, after Substantial Completion of the Work, final completion thereof is materially delayed through no fault of the Contractor or by issuance of Change Orders affecting final completion, and the Architect so confirms, the Owner shall, upon application by the Contractor and certification by the Architect, and without terminating the Contract, make payment of the balance due for that portion of the Work fully completed and accepted. If the remaining balance for Work not fully completed or corrected is less than retainage stipulated in the Contract Documents, and if bonds have been furnished, the written consent of surety to payment of the balance due for that portion of the Work fully completed and accepted shall be submitted by the Contractor to the Architect prior to certification of such payment. Such payment shall be made under terms and conditions governing final payment, except that it shall not constitute a waiver of claims.

§ 9.10.4 The making of final payment shall constitute a waiver of Claims by the Owner except those arising from

- .1 liens, Claims, security interests or encumbrances arising out of the Contract and unsettled;
- .2 failure of the Work to comply with the requirements of the Contract Documents; or
- .3 terms of special warranties required by the Contract Documents.

§ 9.10.5 Acceptance of final payment by the Contractor, a Subcontractor or material supplier shall constitute a waiver of claims by that payee except those previously made in writing and identified by that payee as unsettled at the time of final Application for Payment.

## ARTICLE 10 PROTECTION OF PERSONS AND PROPERTY

### § 10.1 SAFETY PRECAUTIONS AND PROGRAMS

The Contractor shall be responsible for initiating, maintaining and supervising all safety precautions and programs in connection with the performance of the Contract.

### § 10.2 SAFETY OF PERSONS AND PROPERTY

§ 10.2.1 The Contractor shall take reasonable precautions for safety of, and shall provide reasonable protection to prevent damage, injury or loss to

- .1 employees on the Work and other persons who may be affected thereby;
- .2 the Work and materials and equipment to be incorporated therein, whether in storage on or off the site, under care, custody or control of the Contractor or the Contractor's Subcontractors or Sub-subcontractors; and
- .3 other property at the site or adjacent thereto, such as trees, shrubs, lawns, walks, pavements, roadways, structures and utilities not designated for removal, relocation or replacement in the course of construction.

§ 10.2.2 The Contractor shall comply with and give notices required by applicable laws, statutes, ordinances, codes, rules and regulations, and lawful orders of public authorities bearing on safety of persons or property or their protection from damage, injury or loss.

§ 10.2.3 The Contractor shall erect and maintain, as required by existing conditions and performance of the Contract, reasonable safeguards for safety and protection, including posting danger signs and other warnings against hazards, promulgating safety regulations and notifying owners and users of adjacent sites and utilities.

§ 10.2.4 When use or storage of explosives or other hazardous materials or equipment or unusual methods are necessary for execution of the Work, the Contractor shall exercise utmost care and carry on such activities under supervision of properly qualified personnel.

§ 10.2.5 The Contractor shall promptly remedy damage and loss (other than damage or loss insured under property insurance required by the Contract Documents) to property referred to in Sections 10.2.1.2 and 10.2.1.3 caused in whole or in part by the Contractor, a Subcontractor, a Sub-subcontractor, or anyone directly or indirectly employed by any of them, or by anyone for whose acts they may be liable and for which the Contractor is responsible under Sections 10.2.1.2 and 10.2.1.3, except damage or loss attributable to acts or omissions of the Owner or Architect or anyone directly or indirectly employed by either of them, or by anyone for whose acts either of them may be liable, and not attributable to the fault or negligence of the Contractor. The foregoing obligations of the Contractor are in addition to the Contractor's obligations under Section 3.18.

§ 10.2.6 The Contractor shall designate a responsible member of the Contractor's organization at the site whose duty shall be the prevention of accidents. This person shall be the Contractor's superintendent unless otherwise designated by the Contractor in writing to the Owner and Architect.

§ 10.2.7 The Contractor shall not permit any part of the construction or site to be loaded so as to cause damage or create an unsafe condition.

### § 10.2.8 INJURY OR DAMAGE TO PERSON OR PROPERTY

If either party suffers injury or damage to person or property because of an act or omission of the other party, or of others for whose acts such party is legally responsible, written notice of such injury or damage, whether or not insured, shall be given to the other party within a reasonable time not exceeding 21 days after discovery. The notice shall provide sufficient detail to enable the other party to investigate the matter.

### § 10.3 HAZARDOUS MATERIALS

§ 10.3.1 The Contractor is responsible for compliance with any requirements included in the Contract Documents regarding hazardous materials. If the Contractor encounters a hazardous material or substance not addressed in the Contract Documents and if reasonable precautions will be inadequate to prevent foreseeable bodily injury or death to persons resulting from a material or substance, including but not limited to asbestos or polychlorinated biphenyl (PCB), encountered on the site by the Contractor, the Contractor shall, upon recognizing the condition, immediately stop Work in the affected area and report the condition to the Owner and Architect in writing.

§ 10.3.2 Upon receipt of the Contractor's written notice, the Owner shall obtain the services of a licensed laboratory to verify the presence or absence of the material or substance reported by the Contractor and, in the event such material or substance is found to be present, to cause it to be rendered harmless. Unless otherwise required by the Contract Documents, the Owner shall furnish in writing to the Contractor and Architect the names and qualifications of persons or entities who are to perform tests verifying the presence or absence of such material or substance or who are to perform the task of removal or safe containment of such material or substance. The Contractor and the Architect will promptly reply to the Owner in writing stating whether or not either has reasonable objection to the persons or entities proposed by the Owner. If either the Contractor or Architect has an objection to a person or entity proposed by the Owner, the Owner shall propose another to whom the Contractor and the Architect have no reasonable objection. When the material or substance has been rendered harmless, Work in the affected area shall resume upon written agreement of the Owner and Contractor. By Change Order, the Contract Time shall be extended appropriately and the Contract Sum shall be increased in the amount of the Contractor's reasonable additional costs of shut-down, delay and start-up.

§ 10.3.3 To the fullest extent permitted by law, the Owner shall indemnify and hold harmless the Contractor, Subcontractors, Architect, Architect's consultants and agents and employees of any of them from and against claims, damages, losses and expenses, including but not limited to attorneys' fees, arising out of or resulting from performance of the Work in the affected area if in fact the material or substance presents the risk of bodily injury or death as described in Section 10.3.1 and has not been rendered harmless, provided that such claim, damage, loss or expense is attributable to bodily injury, sickness, disease or death, or to injury to or destruction of tangible property (other than the Work itself), except to the extent that such damage, loss or expense is due to the fault or negligence of the party seeking indemnity.

§ 10.3.4 The Owner shall not be responsible under this Section 10.3 for materials or substances the Contractor brings to the site unless such materials or substances are required by the Contract Documents. The Owner shall be responsible for materials or substances required by the Contract Documents, except to the extent of the Contractor's fault or negligence in the use and handling of such materials or substances.

§ 10.3.5 The Contractor shall indemnify the Owner for the cost and expense the Owner incurs (1) for remediation of a material or substance the Contractor brings to the site and negligently handles, or (2) where the Contractor fails to perform its obligations under Section 10.3.1, except to the extent that the cost and expense are due to the Owner's fault or negligence.

§ 10.3.6 If, without negligence on the part of the Contractor, the Contractor is held liable by a government agency for the cost of remediation of a hazardous material or substance solely by reason of performing Work as required by the Contract Documents, the Owner shall indemnify the Contractor for all cost and expense thereby incurred.

## § 10.4 EMERGENCIES

In an emergency affecting safety of persons or property, the Contractor shall act, at the Contractor's discretion, to prevent threatened damage, injury or loss. Additional compensation or extension of time claimed by the Contractor on account of an emergency shall be determined as provided in Article 15 and Article 7.

## ARTICLE 11 INSURANCE AND BONDS

### § 11.1 CONTRACTOR'S LIABILITY INSURANCE

§ 11.1.1 The Contractor shall purchase from and maintain in a company or companies lawfully authorized to do business in the jurisdiction in which the Project is located such insurance as will protect the Contractor from claims set forth below which may arise out of or result from the Contractor's operations and completed operations under the Contract and for which the Contractor may be legally liable, whether such operations be by the Contractor or by a Subcontractor or by anyone directly or indirectly employed by any of them, or by anyone for whose acts any of them may be liable:

- .1 Claims under workers' compensation, disability benefit and other similar employee benefit acts that are applicable to the Work to be performed;
- .2 Claims for damages because of bodily injury, occupational sickness or disease, or death of the Contractor's employees;
- .3 Claims for damages because of bodily injury, sickness or disease, or death of any person other than the Contractor's employees;
- .4 Claims for damages insured by usual personal injury liability coverage;
- .5 Claims for damages, other than to the Work itself, because of injury to or destruction of tangible property, including loss of use resulting therefrom;
- .6 Claims for damages because of bodily injury, death of a person or property damage arising out of ownership, maintenance or use of a motor vehicle;
- .7 Claims for bodily injury or property damage arising out of completed operations; and
- .8 Claims involving contractual liability insurance applicable to the Contractor's obligations under Section 3.18.

§ 11.1.2 The insurance required by Section 11.1.1 shall be written for not less than limits of liability specified in the Contract Documents or required by law, whichever coverage is greater. Coverages, whether written on an occurrence or claims-made basis, shall be maintained without interruption from the date of commencement of the Work until the date of final payment and termination of any coverage required to be maintained after final payment, and, with respect to the Contractor's completed operations coverage, until the expiration of the period for correction of Work or for such other period for maintenance of completed operations coverage as specified in the Contract Documents.

§ 11.1.3 Certificates of insurance acceptable to the Owner shall be filed with the Owner prior to commencement of the Work and thereafter upon renewal or replacement of each required policy of insurance. These certificates and the insurance policies required by this Section 11.1 shall contain a provision that coverages afforded under the policies will not be canceled or allowed to expire until at least 30 days' prior written notice has been given to the Owner. An additional certificate evidencing continuation of liability coverage, including coverage for completed operations, shall be submitted with the final Application for Payment as required by Section 9.10.2 and thereafter upon renewal or replacement of such coverage until the expiration of the time required by Section 11.1.2. Information concerning reduction of coverage on account of revised limits or claims paid under the General Aggregate, or both, shall be furnished by the Contractor with reasonable promptness.

§ 11.1.4 The Contractor shall cause the commercial liability coverage required by the Contract Documents to include (1) the Owner, the Architect and the Architect's Consultants as additional insureds for claims caused in whole or in part by the Contractor's negligent acts or omissions during the Contractor's operations; and (2) the Owner as an additional insured for claims caused in whole or in part by the Contractor's negligent acts or omissions during the Contractor's completed operations.

### § 11.2 OWNER'S LIABILITY INSURANCE

The Owner shall be responsible for purchasing and maintaining the Owner's usual liability insurance.

### § 11.3 PROPERTY INSURANCE

§ 11.3.1 Unless otherwise provided, the Owner shall purchase and maintain, in a company or companies lawfully authorized to do business in the jurisdiction in which the Project is located, property insurance written on a builder's risk "all-risk" or equivalent policy form in the amount of the initial Contract Sum, plus value of subsequent Contract Modifications and cost of materials supplied or installed by others, comprising total value for the entire Project at the site on a replacement cost basis without optional deductibles. Such property insurance shall be maintained, unless otherwise provided in the Contract Documents or otherwise agreed in writing by all persons and entities who are beneficiaries of such insurance, until final payment has been made as provided in Section 9.10 or until no person or entity other than the Owner has an insurable interest in the property required by this Section 11.3 to be covered, whichever is later. This insurance shall include interests of the Owner, the Contractor, Subcontractors and Sub-subcontractors in the Project.

§ 11.3.1.1 Property insurance shall be on an "all-risk" or equivalent policy form and shall include, without limitation, insurance against the perils of fire (with extended coverage) and physical loss or damage including, without duplication of coverage, theft, vandalism, malicious mischief, collapse, earthquake, flood, windstorm, falsework, testing and startup, temporary buildings and debris removal including demolition occasioned by enforcement of any applicable legal requirements, and shall cover reasonable compensation for Architect's and Contractor's services and expenses required as a result of such insured loss.

§ 11.3.1.2 If the Owner does not intend to purchase such property insurance required by the Contract and with all of the coverages in the amount described above, the Owner shall so inform the Contractor in writing prior to commencement of the Work. The Contractor may then effect insurance that will protect the interests of the Contractor, Subcontractors and Sub-subcontractors in the Work, and by appropriate Change Order the cost thereof shall be charged to the Owner. If the Contractor is damaged by the failure or neglect of the Owner to purchase or maintain insurance as described above, without so notifying the Contractor in writing, then the Owner shall bear all reasonable costs properly attributable thereto.

§ 11.3.1.3 If the property insurance requires deductibles, the Owner shall pay costs not covered because of such deductibles.

§ 11.3.1.4 This property insurance shall cover portions of the Work stored off the site, and also portions of the Work in transit.

§ 11.3.1.5 Partial occupancy or use in accordance with Section 9.9 shall not commence until the insurance company or companies providing property insurance have consented to such partial occupancy or use by endorsement or otherwise. The Owner and the Contractor shall take reasonable steps to obtain consent of the insurance company or companies and shall, without mutual written consent, take no action with respect to partial occupancy or use that would cause cancellation, lapse or reduction of insurance.

### § 11.3.2 BOILER AND MACHINERY INSURANCE

The Owner shall purchase and maintain boiler and machinery insurance required by the Contract Documents or by law, which shall specifically cover such insured objects during installation and until final acceptance by the Owner; this insurance shall include interests of the Owner, Contractor, Subcontractors and Sub-subcontractors in the Work, and the Owner and Contractor shall be named insureds.

### § 11.3.3 LOSS OF USE INSURANCE

The Owner, at the Owner's option, may purchase and maintain such insurance as will insure the Owner against loss of use of the Owner's property due to fire or other hazards, however caused. The Owner waives all rights of action against the Contractor for loss of use of the Owner's property, including consequential losses due to fire or other hazards however caused.

§ 11.3.4 If the Contractor requests in writing that insurance for risks other than those described herein or other special causes of loss be included in the property insurance policy, the Owner shall, if possible, include such insurance, and the cost thereof shall be charged to the Contractor by appropriate Change Order.

§ 11.3.5 If during the Project construction period the Owner insures properties, real or personal or both, at or adjacent to the site by property insurance under policies separate from those insuring the Project, or if after final payment

Init.

property insurance is to be provided on the completed Project through a policy or policies other than those insuring the Project during the construction period, the Owner shall waive all rights in accordance with the terms of Section 11.3.7 for damages caused by fire or other causes of loss covered by this separate property insurance. All separate policies shall provide this waiver of subrogation by endorsement or otherwise.

§ 11.3.6 Before an exposure to loss may occur, the Owner shall file with the Contractor a copy of each policy that includes insurance coverages required by this Section 11.3. Each policy shall contain all generally applicable conditions, definitions, exclusions and endorsements related to this Project. Each policy shall contain a provision that the policy will not be canceled or allowed to expire, and that its limits will not be reduced, until at least 30 days' prior written notice has been given to the Contractor.

#### § 11.3.7 WAIVERS OF SUBROGATION

The Owner and Contractor waive all rights against (1) each other and any of their subcontractors, sub-subcontractors, agents and employees, each of the other, and (2) the Architect, Architect's consultants, separate contractors described in Article 6, if any, and any of their subcontractors, sub-subcontractors, agents and employees, for damages caused by fire or other causes of loss to the extent covered by property insurance obtained pursuant to this Section 11.3 or other property insurance applicable to the Work, except such rights as they have to proceeds of such insurance held by the Owner as fiduciary. The Owner or Contractor, as appropriate, shall require of the Architect, Architect's consultants, separate contractors described in Article 6, if any, and the subcontractors, sub-subcontractors, agents and employees of any of them, by appropriate agreements, written where legally required for validity, similar waivers each in favor of other parties enumerated herein. The policies shall provide such waivers of subrogation by endorsement or otherwise. A waiver of subrogation shall be effective as to a person or entity even though that person or entity would otherwise have a duty of indemnification, contractual or otherwise, did not pay the insurance premium directly or indirectly, and whether or not the person or entity had an insurable interest in the property damaged.

§ 11.3.8 A loss insured under the Owner's property insurance shall be adjusted by the Owner as fiduciary and made payable to the Owner as fiduciary for the insureds, as their interests may appear, subject to requirements of any applicable mortgagee clause and of Section 11.3.10. The Contractor shall pay Subcontractors their just shares of insurance proceeds received by the Contractor, and by appropriate agreements, written where legally required for validity, shall require Subcontractors to make payments to their Sub-subcontractors in similar manner.

§ 11.3.9 If required in writing by a party in interest, the Owner as fiduciary shall, upon occurrence of an insured loss, give bond for proper performance of the Owner's duties. The cost of required bonds shall be charged against proceeds received as fiduciary. The Owner shall deposit in a separate account proceeds so received, which the Owner shall distribute in accordance with such agreement as the parties in interest may reach, or as determined in accordance with the method of binding dispute resolution selected in the Agreement between the Owner and Contractor. If after such loss no other special agreement is made and unless the Owner terminates the Contract for convenience, replacement of damaged property shall be performed by the Contractor after notification of a Change in the Work in accordance with Article 7.

§ 11.3.10 The Owner as fiduciary shall have power to adjust and settle a loss with insurers unless one of the parties in interest shall object in writing within five days after occurrence of loss to the Owner's exercise of this power; if such objection is made, the dispute shall be resolved in the manner selected by the Owner and Contractor as the method of binding dispute resolution in the Agreement. If the Owner and Contractor have selected arbitration as the method of binding dispute resolution, the Owner as fiduciary shall make settlement with insurers or, in the case of a dispute over distribution of insurance proceeds, in accordance with the directions of the arbitrators.

#### § 11.4 PERFORMANCE BOND AND PAYMENT BOND

§ 11.4.1 The Owner shall have the right to require the Contractor to furnish bonds covering faithful performance of the Contract and payment of obligations arising thereunder as stipulated in bidding requirements or specifically required in the Contract Documents on the date of execution of the Contract.

§ 11.4.2 Upon the request of any person or entity appearing to be a potential beneficiary of bonds covering payment of obligations arising under the Contract, the Contractor shall promptly furnish a copy of the bonds or shall authorize a copy to be furnished.

## ARTICLE 12 UNCOVERING AND CORRECTION OF WORK

### § 12.1 UNCOVERING OF WORK

§ 12.1.1 If a portion of the Work is covered contrary to the Architect's request or to requirements specifically expressed in the Contract Documents, it must, if requested in writing by the Architect, be uncovered for the Architect's examination and be replaced at the Contractor's expense without change in the Contract Time.

§ 12.1.2 If a portion of the Work has been covered that the Architect has not specifically requested to examine prior to its being covered, the Architect may request to see such Work and it shall be uncovered by the Contractor. If such Work is in accordance with the Contract Documents, costs of uncovering and replacement shall, by appropriate Change Order, be at the Owner's expense. If such Work is not in accordance with the Contract Documents, such costs and the cost of correction shall be at the Contractor's expense unless the condition was caused by the Owner or a separate contractor in which event the Owner shall be responsible for payment of such costs.

### § 12.2 CORRECTION OF WORK

#### § 12.2.1 BEFORE OR AFTER SUBSTANTIAL COMPLETION

The Contractor shall promptly correct Work rejected by the Architect or failing to conform to the requirements of the Contract Documents, whether discovered before or after Substantial Completion and whether or not fabricated, installed or completed. Costs of correcting such rejected Work, including additional testing and inspections, the cost of uncovering and replacement, and compensation for the Architect's services and expenses made necessary thereby, shall be at the Contractor's expense.

#### § 12.2.2 AFTER SUBSTANTIAL COMPLETION

§ 12.2.2.1 In addition to the Contractor's obligations under Section 3.5, if, within one year after the date of Substantial Completion of the Work or designated portion thereof or after the date for commencement of warranties established under Section 9.9.1, or by terms of an applicable special warranty required by the Contract Documents, any of the Work is found to be not in accordance with the requirements of the Contract Documents, the Contractor shall correct it promptly after receipt of written notice from the Owner to do so unless the Owner has previously given the Contractor a written acceptance of such condition. The Owner shall give such notice promptly after discovery of the condition. During the one-year period for correction of Work, if the Owner fails to notify the Contractor and give the Contractor an opportunity to make the correction, the Owner waives the rights to require correction by the Contractor and to make a claim for breach of warranty. If the Contractor fails to correct nonconforming Work within a reasonable time during that period after receipt of notice from the Owner or Architect, the Owner may correct it in accordance with Section 2.4.

§ 12.2.2.2 The one-year period for correction of Work shall be extended with respect to portions of Work first performed after Substantial Completion by the period of time between Substantial Completion and the actual completion of that portion of the Work.

§ 12.2.2.3 The one-year period for correction of Work shall not be extended by corrective Work performed by the Contractor pursuant to this Section 12.2.

§ 12.2.3 The Contractor shall remove from the site portions of the Work that are not in accordance with the requirements of the Contract Documents and are neither corrected by the Contractor nor accepted by the Owner.

§ 12.2.4 The Contractor shall bear the cost of correcting destroyed or damaged construction, whether completed or partially completed, of the Owner or separate contractors caused by the Contractor's correction or removal of Work that is not in accordance with the requirements of the Contract Documents.

§ 12.2.5 Nothing contained in this Section 12.2 shall be construed to establish a period of limitation with respect to other obligations the Contractor has under the Contract Documents. Establishment of the one-year period for correction of Work as described in Section 12.2.2 relates only to the specific obligation of the Contractor to correct the Work, and has no relationship to the time within which the obligation to comply with the Contract Documents may be sought to be enforced, nor to the time within which proceedings may be commenced to establish the Contractor's liability with respect to the Contractor's obligations other than specifically to correct the Work.

### § 12.3 ACCEPTANCE OF NONCONFORMING WORK

If the Owner prefers to accept Work that is not in accordance with the requirements of the Contract Documents, the Owner may do so instead of requiring its removal and correction, in which case the Contract Sum will be reduced as appropriate and equitable. Such adjustment shall be effected whether or not final payment has been made.

## ARTICLE 13 MISCELLANEOUS PROVISIONS

### § 13.1 GOVERNING LAW

The Contract shall be governed by the law of the place where the Project is located except that, if the parties have selected arbitration as the method of binding dispute resolution, the Federal Arbitration Act shall govern Section 15.4.

### § 13.2 SUCCESSORS AND ASSIGNS

§ 13.2.1 The Owner and Contractor respectively bind themselves, their partners, successors, assigns and legal representatives to covenants, agreements and obligations contained in the Contract Documents. Except as provided in Section 13.2.2, neither party to the Contract shall assign the Contract as a whole without written consent of the other. If either party attempts to make such an assignment without such consent, that party shall nevertheless remain legally responsible for all obligations under the Contract.

§ 13.2.2 The Owner may, without consent of the Contractor, assign the Contract to a lender providing construction financing for the Project, if the lender assumes the Owner's rights and obligations under the Contract Documents. The Contractor shall execute all consents reasonably required to facilitate such assignment.

### § 13.3 WRITTEN NOTICE

Written notice shall be deemed to have been duly served if delivered in person to the individual, to a member of the firm or entity, or to an officer of the corporation for which it was intended, or if delivered at, or sent by registered or certified mail or by courier service providing proof of delivery to, the last business address known to the party giving notice.

### § 13.4 RIGHTS AND REMEDIES

§ 13.4.1 Duties and obligations imposed by the Contract Documents and rights and remedies available thereunder shall be in addition to and not a limitation of duties, obligations, rights and remedies otherwise imposed or available by law.

§ 13.4.2 No action or failure to act by the Owner, Architect or Contractor shall constitute a waiver of a right or duty afforded them under the Contract, nor shall such action or failure to act constitute approval of or acquiescence in a breach there under, except as may be specifically agreed in writing.

### § 13.5 TESTS AND INSPECTIONS

§ 13.5.1 Tests, inspections and approvals of portions of the Work shall be made as required by the Contract Documents and by applicable laws, statutes, ordinances, codes, rules and regulations or lawful orders of public authorities. Unless otherwise provided, the Contractor shall make arrangements for such tests, inspections and approvals with an independent testing laboratory or entity acceptable to the Owner, or with the appropriate public authority, and shall bear all related costs of tests, inspections and approvals. The Contractor shall give the Architect timely notice of when and where tests and inspections are to be made so that the Architect may be present for such procedures. The Owner shall bear costs of (1) tests, inspections or approvals that do not become requirements until after bids are received or negotiations concluded, and (2) tests, inspections or approvals where building codes or applicable laws or regulations prohibit the Owner from delegating their cost to the Contractor.

§ 13.5.2 If the Architect, Owner or public authorities having jurisdiction determine that portions of the Work require additional testing, inspection or approval not included under Section 13.5.1, the Architect will, upon written authorization from the Owner, instruct the Contractor to make arrangements for such additional testing, inspection or approval by an entity acceptable to the Owner, and the Contractor shall give timely notice to the Architect of when and where tests and inspections are to be made so that the Architect may be present for such procedures. Such costs, except as provided in Section 13.5.3, shall be at the Owner's expense.

§ 13.5.3 If such procedures for testing, inspection or approval under Sections 13.5.1 and 13.5.2 reveal failure of the portions of the Work to comply with requirements established by the Contract Documents, all costs made necessary by

init.

such failure including those of repeated procedures and compensation for the Architect's services and expenses shall be at the Contractor's expense.

§ 13.5.4 Required certificates of testing, inspection or approval shall, unless otherwise required by the Contract Documents, be secured by the Contractor and promptly delivered to the Architect.

§ 13.5.5 If the Architect is to observe tests, inspections or approvals required by the Contract Documents, the Architect will do so promptly and, where practicable, at the normal place of testing.

§ 13.5.6 Tests or inspections conducted pursuant to the Contract Documents shall be made promptly to avoid unreasonable delay in the Work.

#### § 13.6 INTEREST

Payments due and unpaid under the Contract Documents shall bear interest from the date payment is due at such rate as the parties may agree upon in writing or, in the absence thereof, at the legal rate prevailing from time to time at the place where the Project is located.

#### § 13.7 TIME LIMITS ON CLAIMS

The Owner and Contractor shall commence all claims and causes of action, whether in contract, tort, breach of warranty or otherwise, against the other arising out of or related to the Contract in accordance with the requirements of the final dispute resolution method selected in the Agreement within the time period specified by applicable law, but in any case not more than 10 years after the date of Substantial Completion of the Work. The Owner and Contractor waive all claims and causes of action not commenced in accordance with this Section 13.7.

### ARTICLE 14 TERMINATION OR SUSPENSION OF THE CONTRACT

#### § 14.1 TERMINATION BY THE CONTRACTOR

§ 14.1.1 The Contractor may terminate the Contract if the Work is stopped for a period of 30 consecutive days through no act or fault of the Contractor or a Subcontractor, Sub-subcontractor or their agents or employees or any other persons or entities performing portions of the Work under direct or indirect contract with the Contractor, for any of the following reasons:

- .1 Issuance of an order of a court or other public authority having jurisdiction that requires all Work to be stopped;
- .2 An act of government, such as a declaration of national emergency that requires all Work to be stopped;
- .3 Because the Architect has not issued a Certificate for Payment and has not notified the Contractor of the reason for withholding certification as provided in Section 9.4.1, or because the Owner has not made payment on a Certificate for Payment within the time stated in the Contract Documents; or
- .4 The Owner has failed to furnish to the Contractor promptly, upon the Contractor's request, reasonable evidence as required by Section 2.2.1.

§ 14.1.2 The Contractor may terminate the Contract if, through no act or fault of the Contractor or a Subcontractor, Sub-subcontractor or their agents or employees or any other persons or entities performing portions of the Work under direct or indirect contract with the Contractor, repeated suspensions, delays or interruptions of the entire Work by the Owner as described in Section 14.3 constitute in the aggregate more than 100 percent of the total number of days scheduled for completion, or 120 days in any 365-day period, whichever is less.

§ 14.1.3 If one of the reasons described in Section 14.1.1 or 14.1.2 exists, the Contractor may, upon seven days' written notice to the Owner and Architect, terminate the Contract and recover from the Owner payment for Work executed, including reasonable overhead and profit, costs incurred by reason of such termination, and damages.

§ 14.1.4 If the Work is stopped for a period of 60 consecutive days through no act or fault of the Contractor or a Subcontractor or their agents or employees or any other persons performing portions of the Work under contract with the Contractor because the Owner has repeatedly failed to fulfill the Owner's obligations under the Contract Documents with respect to matters important to the progress of the Work, the Contractor may, upon seven additional days' written notice to the Owner and the Architect, terminate the Contract and recover from the Owner as provided in Section 14.1.3.

**§ 14.2 TERMINATION BY THE OWNER FOR CAUSE**

**§ 14.2.1** The Owner may terminate the Contract if the Contractor

- .1 repeatedly refuses or fails to supply enough properly skilled workers or proper materials;
- .2 fails to make payment to Subcontractors for materials or labor in accordance with the respective agreements between the Contractor and the Subcontractors;
- .3 repeatedly disregards applicable laws, statutes, ordinances, codes, rules and regulations, or lawful orders of a public authority; or
- .4 otherwise is guilty of substantial breach of a provision of the Contract Documents.

**§ 14.2.2** When any of the above reasons exist, the Owner, upon certification by the Initial Decision Maker that sufficient cause exists to justify such action, may without prejudice to any other rights or remedies of the Owner and after giving the Contractor and the Contractor's surety, if any, seven days' written notice, terminate employment of the Contractor and may, subject to any prior rights of the surety:

- .1 Exclude the Contractor from the site and take possession of all materials, equipment, tools, and construction equipment and machinery thereon owned by the Contractor;
- .2 Accept assignment of subcontracts pursuant to Section 5.4; and
- .3 Finish the Work by whatever reasonable method the Owner may deem expedient. Upon written request of the Contractor, the Owner shall furnish to the Contractor a detailed accounting of the costs incurred by the Owner in finishing the Work.

**§ 14.2.3** When the Owner terminates the Contract for one of the reasons stated in Section 14.2.1, the Contractor shall not be entitled to receive further payment until the Work is finished.

**§ 14.2.4** If the unpaid balance of the Contract Sum exceeds costs of finishing the Work, including compensation for the Architect's services and expenses made necessary thereby, and other damages incurred by the Owner and not expressly waived, such excess shall be paid to the Contractor. If such costs and damages exceed the unpaid balance, the Contractor shall pay the difference to the Owner. The amount to be paid to the Contractor or Owner, as the case may be, shall be certified by the Initial Decision Maker, upon application, and this obligation for payment shall survive termination of the Contract.

**§ 14.3 SUSPENSION BY THE OWNER FOR CONVENIENCE**

**§ 14.3.1** The Owner may, without cause, order the Contractor in writing to suspend, delay or interrupt the Work in whole or in part for such period of time as the Owner may determine.

**§ 14.3.2** The Contract Sum and Contract Time shall be adjusted for increases in the cost and time caused by suspension, delay or interruption as described in Section 14.3.1. Adjustment of the Contract Sum shall include profit. No adjustment shall be made to the extent

- .1 that performance is, was or would have been so suspended, delayed or interrupted by another cause for which the Contractor is responsible; or
- .2 that an equitable adjustment is made or denied under another provision of the Contract.

**§ 14.4 TERMINATION BY THE OWNER FOR CONVENIENCE**

**§ 14.4.1** The Owner may, at any time, terminate the Contract for the Owner's convenience and without cause.

**§ 14.4.2** Upon receipt of written notice from the Owner of such termination for the Owner's convenience, the Contractor shall

- .1 cease operations as directed by the Owner in the notice;
- .2 take actions necessary, or that the Owner may direct, for the protection and preservation of the Work; and
- .3 except for Work directed to be performed prior to the effective date of termination stated in the notice, terminate all existing subcontracts and purchase orders and enter into no further subcontracts and purchase orders.

**§ 14.4.3** In case of such termination for the Owner's convenience, the Contractor shall be entitled to receive payment for Work executed, and costs incurred by reason of such termination, along with reasonable overhead and profit on the Work not executed.

Init.

## ARTICLE 15 CLAIMS AND DISPUTES

### § 15.1 CLAIMS

#### § 15.1.1 DEFINITION

A Claim is a demand or assertion by one of the parties seeking, as a matter of right, payment of money, or other relief with respect to the terms of the Contract. The term "Claim" also includes other disputes and matters in question between the Owner and Contractor arising out of or relating to the Contract. The responsibility to substantiate Claims shall rest with the party making the Claim.

#### § 15.1.2 NOTICE OF CLAIMS

Claims by either the Owner or Contractor must be initiated by written notice to the other party and to the Initial Decision Maker with a copy sent to the Architect, if the Architect is not serving as the Initial Decision Maker. Claims by either party must be initiated within 21 days after occurrence of the event giving rise to such Claim or within 21 days after the claimant first recognizes the condition giving rise to the Claim, whichever is later.

#### § 15.1.3 CONTINUING CONTRACT PERFORMANCE

Pending final resolution of a Claim, except as otherwise agreed in writing or as provided in Section 9.7 and Article 14, the Contractor shall proceed diligently with performance of the Contract and the Owner shall continue to make payments in accordance with the Contract Documents. The Architect will prepare Change Orders and issue Certificates for Payment in accordance with the decisions of the Initial Decision Maker.

#### § 15.1.4 CLAIMS FOR ADDITIONAL COST

If the Contractor wishes to make a Claim for an increase in the Contract Sum, written notice as provided herein shall be given before proceeding to execute the Work. Prior notice is not required for Claims relating to an emergency endangering life or property arising under Section 10.4.

#### § 15.1.5 CLAIMS FOR ADDITIONAL TIME

§ 15.1.5.1 If the Contractor wishes to make a Claim for an increase in the Contract Time, written notice as provided herein shall be given. The Contractor's Claim shall include an estimate of cost and of probable effect of delay on progress of the Work. In the case of a continuing delay, only one Claim is necessary.

§ 15.1.5.2 If adverse weather conditions are the basis for a Claim for additional time, such Claim shall be documented by data substantiating that weather conditions were abnormal for the period of time, could not have been reasonably anticipated and had an adverse effect on the scheduled construction.

#### § 15.1.6 CLAIMS FOR CONSEQUENTIAL DAMAGES

The Contractor and Owner waive Claims against each other for consequential damages arising out of or relating to this Contract. This mutual waiver includes

- .1 damages incurred by the Owner for rental expenses, for losses of use, income, profit, financing, business and reputation, and for loss of management or employee productivity or of the services of such persons; and
- .2 damages incurred by the Contractor for principal office expenses including the compensation of personnel stationed there, for losses of financing, business and reputation, and for loss of profit except anticipated profit arising directly from the Work.

This mutual waiver is applicable, without limitation, to all consequential damages due to either party's termination in accordance with Article 14. Nothing contained in this Section 15.1.6 shall be deemed to preclude an award of liquidated damages, when applicable, in accordance with the requirements of the Contract Documents.

### § 15.2 INITIAL DECISION

§ 15.2.1 Claims, excluding those arising under Sections 10.3, 10.4, 11.3.9, and 11.3.10, shall be referred to the Initial Decision Maker for initial decision. The Architect will serve as the Initial Decision Maker, unless otherwise indicated in the Agreement. Except for those Claims excluded by this Section 15.2.1, an initial decision shall be required as a condition precedent to mediation of any Claim arising prior to the date final payment is due, unless 30 days have passed after the Claim has been referred to the Initial Decision Maker with no decision having been rendered. Unless the Initial Decision Maker and all affected parties agree, the Initial Decision Maker will not decide disputes between the Contractor and persons or entities other than the Owner.

Init.

§ 15.2.2 The Initial Decision Maker will review Claims and within ten days of the receipt of a Claim take one or more of the following actions: (1) request additional supporting data from the claimant or a response with supporting data from the other party, (2) reject the Claim in whole or in part, (3) approve the Claim, (4) suggest a compromise, or (5) advise the parties that the Initial Decision Maker is unable to resolve the Claim if the Initial Decision Maker lacks sufficient information to evaluate the merits of the Claim or if the Initial Decision Maker concludes that, in the Initial Decision Maker's sole discretion, it would be inappropriate for the Initial Decision Maker to resolve the Claim.

§ 15.2.3 In evaluating Claims, the Initial Decision Maker may, but shall not be obligated to, consult with or seek information from either party or from persons with special knowledge or expertise who may assist the Initial Decision Maker in rendering a decision. The Initial Decision Maker may request the Owner to authorize retention of such persons at the Owner's expense.

§ 15.2.4 If the Initial Decision Maker requests a party to provide a response to a Claim or to furnish additional supporting data, such party shall respond, within ten days after receipt of such request, and shall either (1) provide a response on the requested supporting data, (2) advise the Initial Decision Maker when the response or supporting data will be furnished or (3) advise the Initial Decision Maker that no supporting data will be furnished. Upon receipt of the response or supporting data, if any, the Initial Decision Maker will either reject or approve the Claim in whole or in part.

§ 15.2.5 The Initial Decision Maker will render an initial decision approving or rejecting the Claim, or indicating that the Initial Decision Maker is unable to resolve the Claim. This initial decision shall (1) be in writing; (2) state the reasons therefor; and (3) notify the parties and the Architect, if the Architect is not serving as the Initial Decision Maker, of any change in the Contract Sum or Contract Time or both. The initial decision shall be final and binding on the parties but subject to mediation and, if the parties fail to resolve their dispute through mediation, to binding dispute resolution.

§ 15.2.6 Either party may file for mediation of an initial decision at any time, subject to the terms of Section 15.2.6.1.

§ 15.2.6.1 Either party may, within 30 days from the date of an initial decision, demand in writing that the other party file for mediation within 60 days of the initial decision. If such a demand is made and the party receiving the demand fails to file for mediation within the time required, then both parties waive their rights to mediate or pursue binding dispute resolution proceedings with respect to the initial decision.

§ 15.2.7 In the event of a Claim against the Contractor, the Owner may, but is not obligated to, notify the surety, if any, of the nature and amount of the Claim. If the Claim relates to a possibility of a Contractor's default, the Owner may, but is not obligated to, notify the surety and request the surety's assistance in resolving the controversy.

§ 15.2.8 If a Claim relates to or is the subject of a mechanic's lien, the party asserting such Claim may proceed in accordance with applicable law to comply with the lien notice or filing deadlines.

### § 15.3 MEDIATION

§ 15.3.1 Claims, disputes, or other matters in controversy arising out of or related to the Contract except those waived as provided for in Sections 9.10.4, 9.10.5, and 15.1.6 shall be subject to mediation as a condition precedent to binding dispute resolution.

§ 15.3.2 The parties shall endeavor to resolve their Claims by mediation which, unless the parties mutually agree otherwise, shall be administered by the American Arbitration Association in accordance with its Construction Industry Mediation Procedures in effect on the date of the Agreement. A request for mediation shall be made in writing, delivered to the other party to the Contract, and filed with the person or entity administering the mediation. The request may be made concurrently with the filing of binding dispute resolution proceedings but, in such event, mediation shall proceed in advance of binding dispute resolution proceedings, which shall be stayed pending mediation for a period of 60 days from the date of filing, unless stayed for a longer period by agreement of the parties or court order. If an arbitration is stayed pursuant to this Section 15.3.2, the parties may nonetheless proceed to the selection of the arbitrator(s) and agree upon a schedule for later proceedings.

§ 15.3.3 The parties shall share the mediator's fee and any filing fees equally. The mediation shall be held in the place where the Project is located, unless another location is mutually agreed upon. Agreements reached in mediation shall be enforceable as settlement agreements in any court having jurisdiction thereof.

#### § 15.4 ARBITRATION

§ 15.4.1 If the parties have selected arbitration as the method for binding dispute resolution in the Agreement, any Claim subject to, but not resolved by, mediation shall be subject to arbitration which, unless the parties mutually agree otherwise, shall be administered by the American Arbitration Association in accordance with its Construction Industry Arbitration Rules in effect on the date of the Agreement. A demand for arbitration shall be made in writing, delivered to the other party to the Contract, and filed with the person or entity administering the arbitration. The party filing a notice of demand for arbitration must assert in the demand all Claims then known to that party on which arbitration is permitted to be demanded.

§ 15.4.1.1 A demand for arbitration shall be made no earlier than concurrently with the filing of a request for mediation, but in no event shall it be made after the date when the institution of legal or equitable proceedings based on the Claim would be barred by the applicable statute of limitations. For statute of limitations purposes, receipt of a written demand for arbitration by the person or entity administering the arbitration shall constitute the institution of legal or equitable proceedings based on the Claim.

§ 15.4.2 The award rendered by the arbitrator or arbitrators shall be final, and judgment may be entered upon it in accordance with applicable law in any court having jurisdiction thereof.

§ 15.4.3 The foregoing agreement to arbitrate and other agreements to arbitrate with an additional person or entity duly consented to by parties to the Agreement shall be specifically enforceable under applicable law in any court having jurisdiction thereof.

#### § 15.4.4 CONSOLIDATION OR JOINDER

§ 15.4.4.1 Either party, at its sole discretion, may consolidate an arbitration conducted under this Agreement with any other arbitration to which it is a party provided that (1) the arbitration agreement governing the other arbitration permits consolidation, (2) the arbitrations to be consolidated substantially involve common questions of law or fact, and (3) the arbitrations employ materially similar procedural rules and methods for selecting arbitrator(s).

§ 15.4.4.2 Either party, at its sole discretion, may include by joinder persons or entities substantially involved in a common question of law or fact whose presence is required if complete relief is to be accorded in arbitration, provided that the party sought to be joined consents in writing to such joinder. Consent to arbitration involving an additional person or entity shall not constitute consent to arbitration of any claim, dispute or other matter in question not described in the written consent.

§ 15.4.4.3 The Owner and Contractor grant to any person or entity made a party to an arbitration conducted under this Section 15.4, whether by joinder or consolidation, the same rights of joinder and consolidation as the Owner and Contractor under this Agreement.

# Additions and Deletions Report for

AIA<sup>®</sup> Document A201<sup>™</sup> – 2007

This Additions and Deletions Report, as defined on page 1 of the associated document, reproduces below all text the author has added to the standard form AIA document in order to complete it, as well as any text the author may have added to or deleted from the original AIA text. Added text is shown underlined. Deleted text is indicated with a horizontal line through the original AIA text.

Note: This Additions and Deletions Report is provided for information purposes only and is not incorporated into or constitute any part of the associated AIA document. This Additions and Deletions Report and its associated document were generated simultaneously by AIA software at 14:45:20 on 12/05/2012.

## PAGE 1

State of Delaware  
540 S. DuPont Highway, Suite 1  
Dover, DE 19901

...

DEDC, LLC  
315 S. Chapel Street  
Newark, DE 19711

## PAGE 2

(Topics and numbers in bold are section headings.)(Numbers and Topics in Bold are Section Headings)

...

3.2, 3.3.2, 3.12.8, 3.18, 4.2.3, 8.3.1, 9.5.1, 10.2.5, 10.2.8, 13.4.2, ~~13.7~~, 13.7.1, 14.1, 15.2

...

4.2.5, 7.3.9, 9.2, **9.3**, 9.4, 9.5.1, 9.6.3, ~~9.7~~, 9.7.1, 9.10, 11.1.3

...

2.4.1, 3.12.7, 4.1, 4.2, 5.2, ~~6.3~~, ~~6.3.1~~, 7.1.2, 7.3.7, 7.4, ~~9.2~~, 9.2.1, 9.3.1, 9.4, 9.5, 9.6.3, 9.8, 9.10.1, 9.10.3, 12.1, 12.2.1, 13.5.1, 13.5.2, 14.2.2, 14.2.4, 15.1.3, 15.2.1

...

2.1.1, 3.12.4, 3.12.8, 3.12.10, 4.1.2, 4.2.1, 4.2.2, 4.2.3, 4.2.6, 4.2.7, 4.2.10, 4.2.12, 4.2.13, 5.2.1, ~~7.4~~, 7.4.1, 9.4.2, 9.5.3, 9.6.4, 15.1.3, 15.2

...

2.4.1, 3.1.3, ~~3.5~~, 3.5.1, 3.10.2, 4.2.7

...

~~3.5~~, 3.5.1, 4.2.6, 12.1.2, 12.2.1

...

3.7.4, 4.2.6, 4.2.7, 4.2.11, 4.2.12, 4.2.13, 4.2.14, ~~6.3, 6.3.1~~, 7.3.7, 7.3.9, 8.1.3, 8.3.1, ~~9.2, 9.2.1~~, 9.4.1, 9.5, 9.8.4, 9.9.1, 13.5.2, 15.2, 15.3

...

1.1.2, 1.5, 3.1.3, 3.2.2, 3.2.3, 3.2.4, 3.3.1, 3.4.2, ~~3.5, 3.5.1~~, 3.7.4, 3.7.5, 3.9.2, 3.9.3, 3.10, 3.11, 3.12, 3.16, 3.18, 4.1.2, 4.1.3, 4.2, 5.2, 6.2.2, 7, 8.3.1, 9.2, 9.3, 9.4, 9.5, 9.7, 9.8, 9.9, 10.2.6, 10.3, 11.3.7, 12, 13.4.2, 13.5, 15.2

...

~~9.7, 9.7.1~~, 11.3.9, 11.3.10, 13.1.1, 15.2.5, 15.2.6.1, 15.3.1, 15.3.2, 15.4.1

### PAGE 3

4.2.1, 4.2.5, 4.2.9, 9.3.3, **9.4**, 9.5, 9.6.1, 9.6.6, ~~9.7, 9.7.1~~, 9.10.1, 9.10.3, 14.1.1.3, 14.2.4, 15.1.3

...

2.2.1, 3.11, 4.2.8, 7, 7.2.1, 7.3.1, 7.4, 7.4.1, 8.3.1, 9.3.1.1, 11.3.9

...

3.2.4, 6.1.1, ~~6.3, 6.3.1~~, 7.3.9, 9.3.3, 9.10.4, 10.3.3, **15**, 15.4

...

3.7.1, 3.10, 5.2, 6.1, 11.1.3, 11.3.6, 11.4.1

#### Contract Documents, The

##### 1.1.1

...

3.7.4, 3.7.5, 3.10.2, 5.2.3, 7.2.1.3, 7.3.1, 7.3.5, 7.4, 8.1.1, 8.2.1, 8.3.1, 9.5.1, ~~9.7, 9.7.1~~, 10.3.2, 12.1.1, 14.3.2, 15.1.5.1, 15.2.5

### PAGE 4

3.3.2, 3.4.3, 3.8.1, 3.9, 3.18.2, 4.2.3, 4.2.6, 10.2, 10.3, 11.1.1, 11.3.7, 14.1, ~~14.2.1, 14.2.1.1~~

...

1.1.2, 1.5, 3.1.3, 3.2.2, 3.2.3, 3.2.4, 3.3.1, 3.4.2, ~~3.5, 3.5.1~~, 3.7.4, 3.10, 3.11, 3.12, 3.16, 3.18, 4.1.3, 4.2, 5.2, 6.2.2, 7, 8.3.1, 9.2, 9.3, 9.4, 9.5, 9.7, 9.8, 9.9, 10.2.6, 10.3, 11.3.7, 12, 13.5, 15.1.2, 15.2.1

...

3.2.1, 3.2.2, ~~3.5, 3.5.1~~, 3.12.6, 6.2.2, 8.2.1, 9.3.3, 9.8.2

...

3.7.4, 4.2.6, 4.2.7, 4.2.11, 4.2.12, 4.2.13, 15.2, 6.3, 7.3.7, 7.3.9, 8.1.3, 8.3.1, ~~9.2, 9.2.1~~, 9.4, 9.5.1, 9.8.4, 9.9.1, 13.5.2, 14.2.2, 14.2.4, 15.1, 15.2

...

2.3.1, 2.4.1, ~~3.5, 3.5.1~~, 4.2.6, 6.2.5, 9.5.1, 9.5.2, 9.6.6, 9.8.2, 9.9.3, 9.10.4, 12.2.1

**Defective Work, Definition of**

**3.5.1**

1.1, 2.1.1, 3.1.1, ~~3.5~~, ~~3.5.1~~, 3.12.1, 3.12.2, 3.12.3, 4.1.1, 15.1.1, 5.1, 6.1.2, 7.2.1, 7.3.1, 8.1, 9.1, 9.8.1

...

~~3.2~~, ~~3.2.~~, 3.7.4, 5.2.3, 7.2.1, 7.3.1, ~~7.4~~, ~~7.4.1~~, **8.3**, 9.5.1, ~~9.7~~, ~~9.7.1~~, 10.3.2, 10.4.1, 14.3.2, 15.1.5, 15.2.5

...

~~6.3~~, ~~6.3.1~~, 7.3.9, 15.1, 15.2

**PAGE 5**

1.1.3, 1.1.6, 3.4, ~~3.5~~, ~~3.5.1~~, 3.8.2, 3.8.3, 3.12, 3.13.1, 3.15.1, 4.2.6, 4.2.7, 5.2.1, 6.2.1, 7.3.7, 9.3.2, 9.3.3, 9.5.1.3, 9.10.2, 10.2.1, 10.2.4, 14.2.1.1, 14.2.1.2

...

1.1.3, 1.2.1, 1.2.2, 2.2.3, 2.2.5, 3.1, 3.3.1, 3.4.1, ~~3.5~~, ~~3.5.1~~, 3.7.1, 3.10.1, 3.12, 3.14, 4.2, 6.2.2, 7.1.3, 7.3.5, 8.2, 9.5.1, 9.9.1, 10.2, 10.3, 12.2, 14.2, 14.3.1, 15.1.3

...

3.2.4, 3.7.4, 5.2.3, 7.2.1, 7.3, ~~7.4~~, ~~9.5.1~~, ~~9.7~~, ~~7.4.1~~, ~~9.5.1~~, ~~9.7.1~~, 10.3.2, 10.4.1, 14.3, 15.1.5, 15.2.5

...

~~3.17~~, ~~3.17.1~~, **3.18**, 9.10.2, 10.3.3, 10.3.5, 10.3.6, 11.3.1.2, 11.3.7

...

~~9.3~~, ~~29.3.2~~, ~~11.4.1.4~~

...

Insurance Companies, Consent to Partial Occupancy

9.9.1, 11.4.1.5

Insurance Companies, Settlement with

9.9+11.4.10

...

1.1.3, 1.1.6, **3.4**, ~~3.5~~, ~~3.5.1~~, 3.8.2, 3.8.3, 3.12, 3.13, 3.15.1, 4.2.6, 4.2.7, 5.2.1, 6.2.1, 7.3.7, 9.3.2, 9.3.3, 9.5.1.3, 9.10.2, 10.2.1, 10.2.4, 14.2.1.1, 14.2.1.2

...

2.3.1, 3.2.2, ~~3.5~~, ~~3.12.10~~, ~~3.17~~, ~~3.5.1~~, ~~3.12.10~~, ~~3.17.1~~, 3.18.1, 4.2.6, 4.2.7, 4.2.12, 6.2.2, 9.4.2, 9.6.4, 9.6.7, 10.2.5, 10.3.3, 11.1.2, 11.2, 11.3.7, 12.2.5, 13.4.2

...

2.1.2, 2.2, 2.4, 3.2.2, 3.10, 3.11, 3.12.5, 3.15.1, 4.2.7, 5.2, 5.3.1, 5.4.1, 6.2.4, 7.3, 7.4, 8.2, ~~9.2~~, ~~9.2.1~~, 9.3.1, 9.3.3, 9.4.1, 9.5, 9.6, ~~9.7~~, ~~9.7.1~~, 9.8, 9.9, 9.10, 11.1.3, 11.3.1.5, 11.3.6, 11.3.10, 12.2, 13.5, 13.7, 14, 15

**PAGE 6**

1.1.3, 1.1.6, 1.5.1, 3.4.1, ~~3.5~~, ~~3.5.1~~, 3.8.2, 3.8.3, 3.12, 3.13.1, 3.15.1, 4.2.6, 4.2.7, 5.2.1, 6.2.1, 7.3.7, 9.3.2, 9.3.3, 9.5.1.3, 9.10.2, 10.2.1.2, 10.2.4, 14.2.1.1, 14.2.1.2

...

1.1.1, 1.1.2, 3.11, 4.1.2, 4.2.1, 5.2.3, 7, 8.3.1, ~~9-7~~, ~~9.7.1~~, 10.3.2, 11.3.1

...

2.3.1, 2.4.1, ~~3.5~~, ~~3.5.1~~, 4.2.6, 6.2.4, 9.5.1, 9.8.2, 9.9.3, 9.10.4, 12.2.1

...

2.2.1, 2.3.1, 2.4.1, 3.2.4, 3.3.1, 3.7.2, 3.12.9, 5.2.1, ~~9-7~~, ~~9.7.1~~, 9.10, 10.2.2, 11.1.3, ~~11.4.6~~, 12.2.2.1, 13.3, 13.5.1, 13.5.2, 14.1, 14.2, 15.2.8, 15.4.1

...

2.3.1, 2.4.1, 3.3.1, 3.9.2, 3.12.9, 3.12.10, 5.2.1, ~~9-7~~, ~~9.7.1~~, 9.10, 10.2.2, 10.3, 11.1.3, ~~11.3.6~~, 12.2.2.1, **13.3**, 14, 15.2.8, 15.4.1

...

3.7.4, ~~4.5~~, 10.2.8, **15.1.2**, 15.4

...

1.5, 2.1.1, 2.3.1, 2.4.1, 3.4.2, 3.8.1, 3.12.10, 3.14.2, 4.1.2, 4.1.3, 4.2.4, 4.2.9, 5.2.1, 5.2.4, 5.4.1, 6.1, ~~6.3~~, ~~6.3.1~~, 7.2.1, 7.3.1, 8.2.2, 8.3.1, 9.3.1, 9.3.2, 9.5.1, 9.6.4, 9.9.1, 9.10.2, 10.3.2, 11.1.3, 11.3.3, 11.3.10, 12.2.2, 12.3.1, 13.2.2, 14.3, 14.4, 15.2.7

...

## **11.2**

### **Owner's Loss of Use Insurance**

#### **11.3.3**

...

1.1.1, 1.1.6, 1.1.7, **1.5**, 2.2.5, 3.2.2, 3.11.1, ~~3.17~~, ~~3.17.1~~, 4.2.12, 5.3.1

...

4.2.5, 7.3.9, ~~9.2~~, ~~9.2.1~~, **9.3**, 9.4, 9.5, 9.6.3, ~~9.7~~, ~~9.7.1~~, 9.8.5, 9.10.1, 14.2.3, 14.2.4, 14.4.3

...

4.2.5, 4.2.9, 9.3.3, **9.4**, 9.5, 9.6.1, 9.6.6, ~~9.7~~, ~~9.7.1~~, 9.10.1, 9.10.3, 13.7, 14.1.1.3, 14.2.4

...

4.2.1, 4.2.9, 9.8.2, 9.10, 11.1.2, 11.1.3, 11.4.1, ~~11.4.5~~, 12.3.1, 13.7, 14.2.4, 14.4.3

...

7.3.7.4, 9.6.7, 9.10.3, ~~11.4.9~~, **11.4**

**PAGE 7**

5.4.2, 9.5.1.3, 9.6.2, 9.6.3, 9.6.4, 9.6.7, 11.4.8, 14.2.1.2

...

7.3.7.4, 9.6.7, 9.10.3, 11.4.9, **11.4**

...

**Project, Definition of the**

...

~~3.5~~, 3.5.1, 4.2.6, 12.2.1

...

3.2.1, ~~3.5~~, 3.5.1, 3.12.6, 6.2.2, 8.2.1, 9.3.3, 9.4.2, 9.5.1, 9.8.2, 9.10.1

...

1.1.2, 2.3, 2.4, ~~3.5~~, 3.5.1, 3.7.4, 3.15.2, 4.2.6, 4.5, 5.3, 5.4, 6.1, 6.3, 7.3.1, 8.3, 9.5.1, 9.7, 10.2.5, 10.3, 12.2.2, 12.2.4, **13.4**, 14, 15.4

...

1.1.4, 3.12.5, 3.14.2, 4.2.4, 4.2.7, 6, 8.3.1, 11.4.7, 12.1.2

...

**Specifications, Definition of the**

...

~~Specifications~~ **Specifications, The**

...

6.2.1, 9.3.2, 10.2.1.2, ~~10.2.4~~ 10.2.4, 11.4.1.4

**PAGE 8**

**5.3**, 5.4, 9.3.1.2, 9.6, 9.10, 10.2.1, 11.4.7, 11.4.8, 14.1, 14.2.1

...

6.1.1, 11.4.5, **11.3.7**

...

3.4.2, ~~3.5~~, 3.5.1, 7.3.8

...

5.4.1.1, 11.4.9, 14

...

3.2.4, 3.7.4, 5.2.3, 7.2.1, 7.3.1, ~~7.4, 7.4.1~~, **8.3**, 9.5.1, ~~9.7, 9.7.1~~, 10.3.2, 10.4.1, 14.3.2, 15.1.5, 15.2.5

...

2.1.2, 2.2, 2.4, 3.2.2, 3.10, 3.11, 3.12.5, 3.15.1, 4.2, ~~4.4, 4.5~~, 5.2, 5.3, 5.4, 6.2.4, 7.3, 7.4, 8.2, 9.2, 9.3.1, 9.3.3, 9.4.1, 9.5, 9.6, 9.7, 9.8, 9.9, 9.10, 11.1.3, ~~11.4.1.5, 11.4.6, 11.4.10~~, 12.2, 13.5, 13.7, 14, 15.1.2, 15.4

...

9.10.5, ~~11.4.7~~, 13.4.2, 15.1.6

...

9.9.3, 9.10.3, 9.10.4, ~~11.4.3, 11.4.5, 11.4.7~~, 12.2.2.1, 13.4.2, 14.2.4, 15.1.6

...

6.1.1, ~~11.4.5~~, **11.3.7**

...

3.5, 4.2.9, 9.3.3, 9.8.4, 9.9.1, 9.10.4, 12.2.2, ~~13.7~~**13.7.1**

#### PAGE 9

2.3, 2.4, 3.3.1, 3.9, 3.12.9, 3.12.10, 5.2.1, 8.2.2, 9.7, 9.10, ~~10.2.2~~, 10.3, 11.1.3, ~~11.4.6~~, 12.2.2, 12.2.4, **13.3**, 14, 15.4.1

...

1.1.1, 2.3, 3.9, 7, 8.2.2, ~~11.4.9~~, 12.1, 12.2, 13.5.2, 14.3.1, 15.1.2

#### PAGE 14

##### § 3.7

##### ~~PERMITS, FEES, NOTICES AND COMPLIANCE WITH LAWS~~ **PERMITS, FEES, NOTICES, AND COMPLIANCE WITH LAWS**

#### PAGE 15

- .1 ~~Allowances~~allowances shall cover the cost to the Contractor of materials and equipment delivered at the site and all required taxes, less applicable trade discounts;

...

- .3 ~~Whenever~~whenever costs are more than or less than allowances, the Contract Sum shall be adjusted accordingly by Change Order. The amount of the Change Order shall reflect (1) the difference between actual costs and the allowances under Section 3.8.2.1 and (2) changes in Contractor's costs under Section 3.8.2.2.

#### PAGE 17

§ 3.18.1 To the fullest extent permitted by law the Contractor shall indemnify and hold harmless the Owner, Architect, Architect's consultants, and agents and employees of any of them from and against claims, damages, losses and expenses, including but not limited to attorneys' fees, arising out of or resulting from performance of the Work,

provided that such claim, damage, loss or expense is attributable to bodily injury, sickness, disease or death, or to injury to or destruction of tangible property (other than the Work itself), but only to the extent caused by the negligent acts or omissions of the Contractor, a Subcontractor, anyone directly or indirectly employed by them or anyone for whose acts they may be liable, regardless of whether or not such claim, damage, loss or expense is caused in part by a party indemnified hereunder. Such obligation shall not be construed to negate, abridge, or reduce other rights or obligations of indemnity ~~that which~~ would otherwise exist as to a party or person described in this Section 3.18.

**PAGE 18**

§ 4.2.1 The Architect will provide administration of the Contract as described in the Contract Documents and will be an Owner's representative during construction until the date the Architect issues the final Certificate ~~for~~ For Payment. The Architect will have authority to act on behalf of the Owner only to the extent provided in the Contract Documents.

**PAGE 20**

§ 5.2.1 Unless otherwise stated in the Contract Documents or the bidding requirements, the Contractor, as soon as practicable after award of the Contract, shall furnish in writing to the Owner through the Architect the names of persons or entities (including those who are to furnish materials or equipment fabricated to a special design) proposed for each principal portion of the Work. The Architect may reply within 14 days to the Contractor in writing stating (1) whether the Owner or the Architect has reasonable objection to any such proposed person or entity or (2) that the Architect requires additional time for review. Failure of the Owner or Architect to reply within the ~~14 day~~ 14 day period shall constitute notice of no reasonable objection.

**PAGE 24**

§ 9.3.1 At least ten days before the date established for each progress payment, the Contractor shall submit to the Architect an itemized Application for Payment prepared in accordance with the schedule of values, if required under Section ~~9.2, 9.2.~~ for completed portions of the Work. Such application shall be notarized, if required, and supported by such data substantiating the Contractor's right to payment as the Owner or Architect may require, such as copies of requisitions from Subcontractors and material suppliers, and shall reflect retainage if provided for in the Contract Documents.

**PAGE 30**

§ 11.1.4 The Contractor shall cause the commercial liability coverage required by the Contract Documents to include (1) the Owner, the Architect and the Architect's ~~consultants~~ Consultants as additional insureds for claims caused in whole or in part by the Contractor's negligent acts or omissions during the Contractor's operations; and (2) the Owner as an additional insured for claims caused in whole or in part by the Contractor's negligent acts or omissions during the Contractor's completed operations.

## **Certification of Document's Authenticity**

AIA® Document D401™ – 2003

I, John R. Farina, hereby certify, to the best of my knowledge, information and belief, that I created the attached final document simultaneously with its associated Additions and Deletions Report and this certification at 14:45:20 on 12/05/2012 under Order No. 5598983966\_1 from AIA Contract Documents software and that in preparing the attached final document I made no changes to the original text of AIA® Document A201™ – 2007, General Conditions of the Contract for Construction, as published by the AIA in its software, other than those additions and deletions shown in the associated Additions and Deletions Report.

\_\_\_\_\_  
(Signed)

\_\_\_\_\_  
(Title)

\_\_\_\_\_  
(Dated)

Not For Bidding Purposes

**SUPPLEMENTARY GENERAL CONDITIONS A201-2007**

The following supplements modify the "General Conditions of the Contract for Construction," AIA Document A201-2007. Where a portion of the General Conditions is modified or deleted by the Supplementary Conditions, the unaltered portions of the General Conditions shall remain in effect.

## TABLE OF ARTICLES

1. GENERAL PROVISIONS
2. OWNER
3. CONTRACTOR
4. ADMINISTRATION OF THE CONTRACT
5. SUBCONTRACTORS
6. CONSTRUCTION BY OWNER OR BY SEPARATE CONTRACTORS
7. CHANGES IN THE WORK
8. TIME
9. PAYMENTS AND COMPLETION
10. PROTECTION OF PERSONS AND PROPERTY
11. INSURANCE AND BONDS
12. UNCOVERING AND CORRECTION OF WORK
13. MISCELLANEOUS PROVISIONS
14. TERMINATION OR SUSPENSION OF THE CONTRACT

**ARTICLE 1: GENERAL PROVISIONS**

## 1.1 BASIC DEFINITIONS

## 1.1.1 THE CONTRACT DOCUMENTS

Delete the last sentence in its entirety and replace with the following:

“The Contract Documents also include Advertisement for Bid, Instructions to Bidder, sample forms, the Bid Form, the Contractor’s completed Bid and the Award Letter.”

Add the following Paragraph:

1.1.2 In the event of conflict or discrepancies among the Contract Documents, the Documents prepared by the State of Delaware, Division of Facilities Management shall take precedence over all other documents.

## 1.2 CORRELATION AND INTENT OF THE CONTRACT DOCUMENTS

Add the following Paragraphs:

1.2.4 In the case of an inconsistency between the Drawings and the Specifications, or within either document not clarified by addendum, the better quality or greater quantity of work shall be provided in accordance with the Architect’s interpretation.

1.2.5 The word “PROVIDE” as used in the Contract Documents shall mean “FURNISH AND INSTALL” and shall include, without limitation, all labor, materials, equipment, transportation, services and other items required to complete the Work.

1.2.6 The word “PRODUCT” as used in the Contract Documents means all materials, systems and equipment.

## 1.5 OWNERSHIP AND USE OF DRAWINGS, SPECIFICATIONS AND OTHER INSTRUMENTS OF SERVICE

Delete Paragraph 1.5.1 in its entirety and replace with the following:

“All pre-design studies, drawings, specifications and other documents, including those in electronic form, prepared by the Architect under this Agreement are, and shall remain, the property of the Owner whether the Project for which they are made is executed or not. Such documents may be used by the Owner to construct one or more like Projects without the approval of, or additional compensation to, the Architect. The Contractor, Subcontractors, Sub-subcontractors and Material or Equipment Suppliers are authorized to use and reproduce applicable portions of the Drawings, Specifications and other documents prepared by the Architect and the Architect’s consultants appropriate to and for use in the execution of their Work under the Contract Documents. They are not to be used by the Contractor or any Subcontractor, Sub-subcontractor or Material and Equipment Supplier on other Projects or for additions to this Project outside the scope of the Work without the specific written consent of the Owner, Architect and Architect’s consultants.

The Architect shall not be liable for injury or damage resulting from the re-use of drawings and specifications if the Architect is not involved in the re-use Project. Prior to re-use of construction documents for a Project in which the Architect is not also involved, the Owner will remove from such documents all identification of the original Architect, including name, address and professional seal or stamp.”

Delete Paragraph 1.5.2 in its entirety.

## **ARTICLE 2: OWNER**

### **2.2 INFORMATION AND SERVICES REQUIRED OF THE OWNER**

To Subparagraph 2.2.3 – Add the following sentence:

“The Contractor, at their expense shall bear the costs to accurately identify the location of all underground utilities in the area of their excavation and shall bear all cost for any repairs required, out of failure to accurately identify said utilities.”

Delete Subparagraph 2.2.5 in its entirety and substitute the following:

2.2.5 The Contractor shall be furnished free of charge up to five (5) sets of the Drawings and Project Manuals. Additional sets will be furnished at the cost of reproduction, postage and handling.

## **ARTICLE 3: CONTRACTOR**

### **3.2 REVIEW OF CONTRACT DOCUMENTS AND FIELD CONDITIONS BY CONTRACTOR**

Amend Paragraph 3.2.2 to state that any errors, inconsistencies or omissions discovered shall be reported to the Architect and Owner immediately.

Delete the third sentence in Paragraph 3.2.3.

### **3.3 SUPERVISION AND CONSTRUCTION PROCEDURES**

Add the following Paragraphs:

3.3.2.1 The Contractor shall immediately remove from the Work, whenever requested to do so by the Owner, any person who is considered by the Owner or Architect to be incompetent or disposed to be so disorderly, or who for any reason is not satisfactory to the Owner, and that person shall not again be employed on the Work without the consent of the Owner or the Architect.

3.3.4 The Contractor must provide suitable storage facilities at the Site for the proper protection and safe storage of their materials. Consult the Owner and the Architect before storing any materials.

3.3.5 When any room is used as a shop, storeroom, office, etc., by the Contractor or Subcontractor(s) during the construction of the Work, the Contractor making use of these areas will be held responsible for any repairs, patching or cleaning arising from such use.

### 3.4 LABOR AND MATERIALS

Add the Following Paragraphs:

- 3.4.4 Before starting the Work, each Contractor shall carefully examine all preparatory Work that has been executed to receive their Work. Check carefully, by whatever means are required, to insure that its Work and adjacent, related Work, will finish to proper contours, planes and levels. Promptly notify the General Contractor/Construction Manager of any defects or imperfections in preparatory Work which will in any way affect satisfactory completion of its Work. Absence of such notification will be construed as an acceptance of preparatory Work and later claims of defects will not be recognized.
- 3.4.5 Under no circumstances shall the Contractor's Work proceed prior to preparatory Work having been completely cured, dried and/or otherwise made satisfactory to receive this Work. Responsibility for timely installation of all materials rests solely with the Contractor responsible for that Work, who shall maintain coordination at all times.

### 3.5 WARRANTY

Add the following Paragraphs:

- 3.5.1 The Contractor will guarantee all materials and workmanship against original defects, except injury from proper and usual wear when used for the purpose intended, for two years after Acceptance by the Owner, and will maintain all items in perfect condition during the period of guarantee.
- 3.5.2 Defects appearing during the period of guarantee will be made good by the Contractor at his expense upon demand of the Owner, it being required that all work will be in perfect condition when the period of guarantee will have elapsed.
- 3.5.3 In addition to the General Guarantee there are other guarantees required for certain items for different periods of time than the two years as above, and are particularly so stated in that part of the specifications referring to same. The said guarantees will commence at the same time as the General Guarantee.
- 3.5.4 If the Contractor fails to remedy any failure, defect or damage within a reasonable time after receipt of notice, the Owner will have the right to replace, repair, or otherwise remedy the failure, defect or damage at the Contractor's expense.

### 3.11 DOCUMENTS AND SAMPLES AT THE SITE

Add the following Paragraphs:

- 3.11.1 During the course of the Work, the Contractor shall maintain a record set of drawings on which the Contractor shall mark the actual physical location of all

pipng, valves, equipment, conduit, outlets, access panels, controls, actuators, including all appurtenances that will be concealed once construction is complete, etc., including all invert elevations.

- 3.11.2 At the completion of the project, the Contractor shall obtain a set of reproducible drawings from the Architect, and neatly transfer all information outlined in 3.11.1 to provide a complete record of the as-built conditions.
- 3.11.3 The Contractor shall provide two (2) prints of the as-built conditions, along with the reproducible drawings themselves, to the Owner and one (1) set to the Architect. In addition, attach one complete set to each of the Operating and Maintenance Instructions/Manuals.

3.17 In the first sentence of the paragraph, insert "indemnify" between "shall" and "hold".

#### **ARTICLE 4: ADMINISTRATION OF THE CONTRACT**

##### **4.2 ADMINISTRATION OF THE CONTRACT**

Delete the first sentence of Paragraph 4.2.7 and replace with the following:

The Architect will review and approve or take other appropriate action upon the Contractor's submittals such as Shop Drawings, Product Data and Samples for the purpose of checking for conformance with the Contract Documents.

Delete the second sentence of Paragraph 4.2.7 and replace with the following:

The Architect's action will be taken with such reasonable promptness as to cause no delay in the Work in the activities of the Owner, Contractor or separate Contractors, while allowing sufficient time in the Owner's professional judgment to permit adequate review.

Add the following Paragraph:

- 4.2.10.1 There will be no full-time project representative provided by the Owner or Architect on this project.

Add to Paragraph 4.2.13 "and in compliance with all local requirements." to the end of the sentence

#### **ARTICLE 5: SUBCONTRACTORS**

##### **5.2 AWARD OF SUBCONTRACTS AND OTHER CONTRACTS FOR PORTIONS OF THE WORK**

Delete Paragraph 5.2.3 in its entirety and replace with the following:

- 5.2.3 If the Owner or Architect has reasonable objection to a person or entity proposed by the Contractor, the Contractor shall propose another to whom the Owner or Architect has no reasonable objection, subject to the statutory requirements of 29 Delaware Code § 6962(d)(10)b.3 and 4.

**ARTICLE 6: CONSTRUCTION BY OWNER OR BY SEPARATE CONTRACTORS****6.1 OWNER'S RIGHT TO PERFORM CONSTRUCTION AND TO AWARD SEPARATE CONTRACTS**

Delete Paragraph 6.1.4 in its entirety.

**6.2 MUTUAL RESPONSIBILITY**

6.2.3 In the second sentence, strike the word "shall" and insert the word "may".

**ARTICLE 7: CHANGES IN THE WORK**

(SEE ARTICLE 7: CHANGES IN WORK IN THE GENERAL REQUIREMENTS)

**ARTICLE 8: TIME****8.2 PROGRESS AND COMPLETION**

Add the following Paragraphs:

8.2.1.1 Refer to Specification Section SUMMARY OF WORK for Contract time requirements.

8.2.4 If the Work falls behind the Progress Schedule as submitted by the Contractor, the Contractor shall employ additional labor and/or equipment necessary to bring the Work into compliance with the Progress Schedule at no additional cost to the Owner.

**8.3 DELAYS AND EXTENSION OF TIME**

8.3.1 Strike "arbitration" and insert "remedies at law or in equity".

Add the following Paragraph:

8.3.2.1 The Contractor shall update the status of the suspension, delay, or interruption of the Work with each Application for Payment. (The Contractor shall report the termination of such cause immediately upon the termination thereof.) Failure to comply with this procedure shall constitute a waiver for any claim for adjustment of time or price based upon said cause.

Delete Paragraph 8.3.3 in its entirety and replace with the following:

8.3.3 Except in the case of a suspension of the Work directed by the Owner, an extension of time under the provisions of Paragraph 8.3.1 shall be the Contractor's sole remedy in the progress of the Work and there shall be no payment or compensation to the Contractor for any expense or damage resulting from the delay.

Add the following Paragraph:

8.3.4 By permitting the Contractor to work after the expired time for completion of the project, the Owner does not waive their rights under the Contract.

**ARTICLE 9: PAYMENTS AND COMPLETION**

## 9.2 SCHEDULE OF VALUES

Add the following Paragraphs:

- 9.2.1 The Schedule of Values shall be submitted using AIA Document G702, Continuation Sheet to G703.
- 9.2.2 The Schedule of Values is to include a line item for Project Closeout Document Submittal. The value of this item is to be no less than 1% of the initial contract amount.

## 9.3 APPLICATIONS FOR PAYMENT

Add the following Paragraph:

- 9.3.1.3 Application for Payment shall be submitted on AIA Document G702 "Application and Certificate for Payment", supported by AIA Document G703 "Continuation Sheet". Said Applications shall be fully executed and notarized.

Add the following Paragraphs:

- 9.3.4 Until Closeout Documents have been received and outstanding items completed the Owner will pay 95% (ninety-five percent) of the amount due the Contractor on account of progress payments.
- 9.3.5 The Contractor shall provide a current and updated Progress Schedule to the Architect with each Application for Payment. Failure to provide Schedule will be just cause for rejection of Application for Payment.

## 9.5 DECISIONS TO WITHHOLD CERTIFICATION

Add the following to 9.5.1:

- .8 failure to provide a current Progress Schedule;
- .9 a lien or attachment is filed;
- .10 failure to comply with mandatory requirements for maintaining Record Documents.

## 9.6 PROGRESS PAYMENTS

Delete Paragraph 9.6.1 in its entirety and replace with the following:

- 9.6.1 After the Architect has approved and issued a Certificate for Payment, payment shall be made by the Owner within 30 days after Owner's receipt of the Certificate for Payment.

## 9.7 FAILURE OF PAYMENT

In first sentence, strike "seven" and insert "thirty (30)". Also strike "binding dispute resolution" and insert "remedies at law or in equity".

## 9.8 SUBSTANTIAL COMPLETION

To Subparagraph 9.8.3- Add the following sentence:

"If the Architect is required to make more than 2 inspections of the same portion of work, the Contractor shall be responsible for all costs associated with subsequent inspections including but not limited to any Architect's fees."

9.8.5 In the second sentence, strike "shall" and insert "may".

**ARTICLE 10: PROTECTION OF PERSONS AND PROPERTY**

## 10.1 SAFETY PRECAUTIONS AND PROGRAMS

Add the following Paragraphs:

10.1.1.1 Each Contractor shall develop a safety program in accordance with the Occupational Safety and Health Act of 1970. A copy of said plan shall be furnished to the Owner and Architect prior to the commencement of that Contractor's Work.

10.1.2 Each Contractor shall appoint a Safety Representative. Safety Representatives shall be someone who is on site on a full time basis. If deemed necessary by the Owner or Architect, Contractor Safety meetings will be scheduled. The attendance of all Safety Representatives will be required. Minutes will be recorded of said meetings by the Contractor and will be distributed to all parties as well as posted in all job offices/trailers etc.

## 10.2 SAFETY OF PERSONS AND PROPERTY

Add the following Paragraph:

10.2.4.1 As required in the Hazardous Chemical Act of June 1984, all vendors supplying any material that may be defined as hazardous must provide Material Safety Data Sheets for those products. Any chemical product should be considered hazardous if it has a caution warning on the label relating to a potential physical or health hazard, if it is known to be present in the work place, and if employees may be exposed under normal conditions or in foreseeable emergency situations. Material Safety Data Sheets shall be provided directly to the Owner, along with the shipping slips that include those products.

## 10.3 HAZARDOUS MATERIALS

Delete Paragraph 10.3.3 in its entirety.

10.5 Delete Paragraphs 10.3.6 in its entirety.

**ARTICLE 11: INSURANCE AND BONDS**

## 11.1 CONTRACTOR'S LIABILITY INSURANCE

11.1.4 Strike "the Owner" immediately following "(1)" and strike "and (2) the Owner as an additional insured for claims caused in whole or in part by the Contractor's negligent acts or omissions during the Contractor's completed operations."

11.2 OWNER'S LIABILITY INSURANCE

Delete Paragraph 11.2 in its entirety.

11.3 PROPERTY INSURANCE

Delete Paragraph 11.3 in its entirety and replace with the following:

11.3 The State will not provide Builder's All Risk Insurance for the Project. The Contractor and all Subcontractors shall provide property coverage for their tools and equipment, as necessary. Any mandatory deductible required by the Contractor's Insurance shall be the responsibility of the Contractor.

11.4 PERFORMANCE BOND AND PAYMENT BOND

Add the following sentence: "The bonds will conform to those forms approved by the Office of Management and Budget."

**ARTICLE 12: UNCOVERING AND CORRECTION OF WORK**

12.2.2 AFTER SUBSTANTIAL COMPLETION

Add the following Paragraph:

12.2.2.1.1 At any time during the progress of the Work, or in any case where the nature of the defects will be such that it is not expedient to have corrected, the Owner, at its option, will have the right to deduct such sum, or sums, of money from the amount of the Contract as it considers justified to adjust the difference in value between the defective work and that required under contract including any damage to the structure.

12.2.2.1 Strike "one" and insert "two".

12.2.2.2 Strike "one" and insert "two".

12.2.2.3 Strike "one" and insert "two".

12.2.5 In second sentence, strike "one" and insert "two".

**ARTICLE 13: MISCELLANEOUS PROVISIONS**

13.1 GOVERNING LAW

Strike "except that, if the parties have selected arbitration as the method of binding dispute resolution, the Federal Arbitration Act shall govern Section 15.4."

13.6 INTEREST

Strike "the date payment is due at such rate as the parties may agree upon in writing or, in the absence thereof, at the legal rate prevailing from time to time at the place where the Project is located." Insert "30 days of presentment of the authorized Certificate of Payment at the annual rate of 12% or 1% per month.

13.7 TIME LIMITS ON CLAIMS

Strike the last sentence.

Add the following Paragraph:

13.8 CONFLICTS WITH FEDERAL STATUTES OR REGULATIONS

13.8.1 If any provision, specifications or requirement of the Contract Documents conflict or is inconsistent with any statute, law or regulation of the government of the United State of America, the Contractor shall notify the Architect and Owner immediately upon discovery.

**ARTICLE 14: TERMINATION OR SUSPENSION OF THE CONTRACT**

14.4 TERMINATION BY THE OWNER FOR CONVENIENCE

Delete Paragraph 14.4.3 in its entirety and replace with the following:

14.4.3 In case of such termination for the Owner's convenience, the Contractor shall be entitled to receive payment for Work executed, and cost incurred by reason of such termination along with reasonable overhead.

**ARTICLE 15: CLAIMS AND DISPUTES**

15.1.2 Throughout the Paragraph strike "21" and insert "45".

15.1.6 CLAIMS FOR CONSEQUENTIAL DAMAGES

Delete Paragraph 15.1.6 in its entirety.

15.2 INITIAL DECISION

Delete Paragraph 15.2.5 in its entirety and replace with the following:

15.2.5 The Architect will approve or reject Claims by written decision, which shall state the reasons therefore and shall notify the parties of any change in the Contract Sum or Contract Time or both. The approval or rejection of a Claim by the Architect shall be subject to mediation and other remedies at law or in equity.

Delete Paragraph 15.2.6 and its subparagraphs in their entirety.

15.3 MEDIATION

15.3.1 Strike "binding dispute resolution" and insert "any or all remedies at law or in equity".

15.3.2 In the first sentence, delete "administered by the American Arbitration Association in accordance with its Construction Industry Mediation Procedure in

effect on the date of the Agreement,” Strike “binding dispute resolution” and insert “remedies at law and in equity”.

15.4 ARBITRATION

Delete Paragraph 15.4 and its sub-sections in its entirety.

END OF SUPPLEMENTARY GENERAL CONDITIONS

Not For Bidding Purposes

STATE OF DELAWARE  
DEPARTMENT OF LABOR  
DIVISION OF INDUSTRIAL AFFAIRS  
OFFICE OF LABOR LAW ENFORCEMENT  
PHONE: (302) 451-3423


Mailing Address:  
225 CORPORATE BOULEVARD  
SUITE 104  
NEWARK, DE 19702

Located at:  
225 CORPORATE BOULEVARD  
SUITE 104  
NEWARK, DE 19702

PREVAILING WAGES FOR BUILDING CONSTRUCTION EFFECTIVE MARCH 15, 2013

CLASSIFICATION	NEW CASTLE	KENT	SUSSEX
ASBESTOS WORKERS	21.87	26.94	39.20
BOILERMAKERS	65.47	33.22	48.83
BRICKLAYERS	46.83	46.83	46.83
CARPENTERS	50.06	50.06	39.82
CEMENT FINISHERS	27.61	29.11	21.20
ELECTRICAL LINE WORKERS	43.49	37.29	28.44
ELECTRICIANS	60.60	60.60	60.60
ELEVATOR CONSTRUCTORS	75.33	40.93	30.55
GLAZIERS	64.10	64.10	54.20
INSULATORS	51.48	51.48	51.48
IRON WORKERS	59.12	59.12	59.12
LABORERS	38.30	38.30	38.30
MILLWRIGHTS	62.18	62.18	48.75
PAINTERS	42.02	42.02	42.02
PILEDRIVERS	67.87	37.64	30.45
PLASTERERS	28.55	28.55	17.50
PLUMBERS/PIPEFITTERS/STEAMFITTERS	59.00	49.26	46.28
POWER EQUIPMENT OPERATORS	57.06	57.06	24.13
ROOFERS-COMPOSITION	21.77	17.96	19.34
ROOFERS-SHINGLE/SLATE/TILE	17.59	17.50	16.45
SHEET METAL WORKERS	62.74	62.74	62.74
SOFT FLOOR LAYERS	45.97	45.97	45.97
SPRINKLER FITTERS	51.75	51.75	51.75
TERRAZZO/MARBLE/TILE FNRS	51.41	51.41	45.45
TERRAZZO/MARBLE/TILE STRS	59.03	59.03	52.63
TRUCK DRIVERS	26.58	23.89	20.03

CERTIFIED: 4/26/13

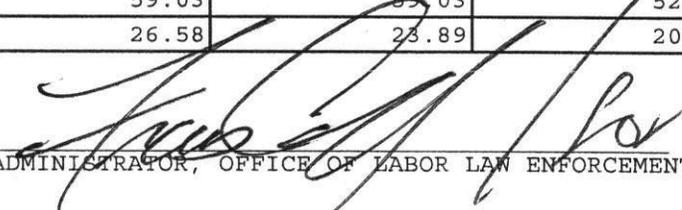BY: 

ADMINISTRATOR, OFFICE OF LABOR LAW ENFORCEMENT

**NOTE:** THESE RATES ARE PROMULGATED AND ENFORCED PURSUANT TO THE PREVAILING WAGE REGULATIONS ADOPTED BY THE DEPARTMENT OF LABOR ON APRIL 3, 1992.

CLASSIFICATIONS OF WORKERS ARE DETERMINED BY THE DEPARTMENT OF LABOR. FOR ASSISTANCE IN CLASSIFYING WORKERS, OR FOR A COPY OF THE REGULATIONS OR CLASSIFICATIONS, PHONE (302) 451-3423.

NON-REGISTERED APPRENTICES MUST BE PAID THE MECHANIC'S RATE.

PROJECT: Supreme Court Building Basement Level Sprinkler System, New Castle County

## GENERAL REQUIREMENTS

### TABLE OF ARTICLES

1. GENERAL PROVISIONS
2. OWNER
3. CONTRACTOR
4. ADMINISTRATION OF THE CONTRACT
5. SUBCONTRACTORS
6. CONSTRUCTION BY OWNER OR BY SEPARATE CONTRACTORS
7. CHANGES IN THE WORK
8. TIME
9. PAYMENTS AND COMPLETION
10. PROTECTION OF PERSONS AND PROPERTY
11. INSURANCE AND BONDS
12. UNCOVERING AND CORRECTION OF WORK
13. MISCELLANEOUS PROVISIONS
14. TERMINATION OR SUSPENSION OF THE CONTRACT

Not For Bidding Purposes

**ARTICLE 1: GENERAL****1.1 CONTRACT DOCUMENTS**

1.1.1 The intent of the Contract Documents is to include all items necessary for the proper execution and completion of the Work by the Contractor. The Contract Documents are complementary and what is required by one shall be as binding as if required by all. Performance by the Contractor shall be required to an extent consistent with the Contract Documents and reasonably inferable from them as being necessary to produce the intended results.

1.1.2 Work including material purchases shall not begin until the Contractor is in receipt of a bonafide State of Delaware Purchase Order. Any work performed or material purchases prior to the issuance of the Purchase Order is done at the Contractor's own risk and cost.

**1.2 EQUALITY OF EMPLOYMENT OPPORTUNITY ON PUBLIC WORKS**

1.2.1 For Public Works Projects financed in whole or in part by state appropriation the Contractor agrees that during the performance of this contract:

1. The Contractor will not discriminate against any employee or applicant for employment because of race, creed, color, sex or national origin. The Contractor will take positive steps to ensure that applicants are employed and that employees are treated during employment without regard to their race, creed, color, sex or national origin. Such action shall include, but not be limited to, the following: employment, upgrading, demotion or transfer; recruitment or recruitment advertising; layoff or termination; rates of pay or other forms of compensation; and selection for training, including apprenticeship. The Contractor agrees to post in conspicuous places available to employees and applicants for employment notices to be provided by the contracting agency setting forth this nondiscrimination clause.
2. The Contractor will, in all solicitations or advertisements for employees placed by or on behalf of the Contractor, state that all qualified applicants will receive consideration for employment without regard to race, creed, color, sex or national origin.

**ARTICLE 2: OWNER**

(NO ADDITIONAL GENERAL REQUIREMENTS – SEE SUPPLEMENTARY GENERAL CONDITIONS)

**ARTICLE 3: CONTRACTOR**

3.1 Schedule of Values: The successful Bidder shall within twenty (20) days after receiving notice to proceed with the work, furnish to the Owner a complete schedule of values on the various items comprising the work.

3.2 Subcontracts: Upon approval of Subcontractors, the Contractor shall award their Subcontracts as soon as possible after the signing of their own contract and see that all material, their own and those of their Subcontractors, are promptly ordered so that the work will not be delayed by failure of materials to arrive on time.

- 3.3 Before commencing any work or construction, the General Contractor is to consult with the Owner as to matters in connection with access to the site and the allocation of Ground Areas for the various features of hauling, storage, etc.
- 3.4 The Contractor shall supervise and direct the Work, using the Contractor's best skill and attention. The Contractor shall be solely responsible for and have control over construction means, methods, techniques, sequences and procedures and for coordinating all portions of the Work under the Contract, unless the Contract Documents give other specific instructions.
- 3.5 The Contractor shall enforce strict discipline and good order among the Contractor's employees and other persons carrying out the Contract. The Contractor shall not permit employment of unfit persons or persons not skilled in tasks assigned to them.
- 3.6 The Contractor warrants to the Owner that materials and equipment furnished will be new and of good quality, unless otherwise permitted, and that the work will be free from defects and in conformance with the Contract Documents. Work not conforming to these requirements, including substitutions not properly approved, may be considered defective. If required by the Owner, the Contractor shall furnish evidence as to the kind and quality of materials and equipment provided.
- 3.7 Unless otherwise provided, the Contractor shall pay all sales, consumer, use and other similar taxes, and shall secure and pay for required permits, fees, licenses, and inspections necessary for proper execution of the Work.
- 3.8 The Contractor shall comply with and give notices required by laws, ordinances, rules, regulations, and lawful orders of public authorities bearing on performance of the Work. The Contractor shall promptly notify the Owner if the Drawings and Specifications are observed to be at variance therewith.
- 3.9 The Contractor shall be responsible to the Owner for the acts and omissions of the Contractor's employees, Subcontractors and their agents and employees, and other persons performing portions of the Work under contract with the Contractor.
- 3.10 The Contractor shall keep the premises and surrounding area free from accumulation of waste materials or rubbish caused by operations under the Contract. At completion of the Work the Contractor shall remove from and about the Project all waste materials, rubbish, the Contractor's tools, construction equipment, machinery and surplus materials. The Contractor shall be responsible for returning all damaged areas to their original conditions.
- 3.11 STATE LICENSE AND TAX REQUIREMENTS
- 3.11.1 Each Contractor and Subcontractor shall be licensed to do business in the State of Delaware and shall pay all fees and taxes due under State laws. In conformance with Section 2503, Chapter 25, Title 30, Delaware Code, "the Contractor shall furnish the Delaware Department of Finance within ten (10) days after entering into any contract with a contractor or subcontractor not a resident of this State, a statement of total value of such contract or contracts together with the names and addresses of the contracting parties."
- 3.12. The Contractor shall comply with all requirements set forth in Section 6962, Chapter 69, Title 29 of the Delaware Code.

**ARTICLE 4: ADMINISTRATION OF THE CONTRACT****4.1 CONTRACT SURETY**

#### 4.1.1 PERFORMANCE BOND AND LABOR AND MATERIAL PAYMENT BOND

4.1.2 All bonds will be required as follows unless specifically waived elsewhere in the Bidding Documents.

4.1.3 Contents of Performance Bonds – The bond shall be in the form approved by the Office of Management and Budget. The bond shall be conditioned upon the faithful compliance and performance by the successful bidder of each and every term and condition of the contract and the proposal, plans, specifications, and bid documents thereof. Each term and condition shall be met at the time and in the manner prescribed by the Contract, Bid documents and the specifications, including the payment in full to every person furnishing material or performing labor in the performance of the Contract, of all sums of money due the person for such labor and material. (The bond shall also contain the successful bidder's guarantee to indemnify and save harmless the State and the agency from all costs, damages and expenses growing out of or by reason of the Contract in accordance with the Contract.)

4.1.4 Invoking a Performance Bond – The agency may, when it considers that the interest of the State so require, cause judgement to be confessed upon the bond.

4.1.5 Within twenty (20) days after the date of notice of award of contract, the Bidder to whom the award is made shall furnish a Performance Bond and Labor and Material Payment Bond, each equal to the full amount of the Contract price to guarantee the faithful performance of all terms, covenants and conditions of the same. The bonds are to be issued by an acceptable Bonding Company licensed to do business in the State of Delaware and shall be issued in duplicate.

4.1.6 Performance and Payment Bonds shall be maintained in full force (warranty bond) for a period of two (2) years after the date of the Certificate for Final Payment. The Performance Bond shall guarantee the satisfactory completion of the Project and that the Contractor will make good any faults or defects in his work which may develop during the period of said guarantees as a result of improper or defective workmanship, material or apparatus, whether furnished by themselves or their Sub-Contractors. The Payment Bond shall guarantee that the Contractor shall pay in full all persons, firms or corporations who furnish labor or material or both labor and material for, or on account of, the work included herein. The bonds shall be paid for by this Contractor. The Owner shall have the right to demand that the proof parties signing the bonds are duly authorized to do so.

#### 4.2 FAILURE TO COMPLY WITH CONTRACT

4.2.1 If any firm entering into a contract with the State, or Agency that neglects or refuses to perform or fails to comply with the terms thereof, the Agency which signed the Contract may terminate the Contract and proceed to award a new contract in accordance with this Chapter 69, Title 29 of the Delaware Code or may require the Surety on the Performance Bond to complete the Contract in accordance with the terms of the Performance Bond. Nothing herein shall preclude the Agency from pursuing additional remedies as otherwise provided by law.

#### 4.3 CONTRACT INSURANCE AND CONTRACT LIABILITY

4.3.1 In addition to the bond requirements stated in the Bid Documents, each successful Bidder shall purchase adequate insurance for the performance of the Contract and, by submission of a Bid, agrees to indemnify and save harmless and to defend all legal or equitable actions brought against the State, any Agency, officer and/or employee of the

State, for and from all claims of liability which is or may be the result of the successful Bidder's actions during the performance of the Contract.

4.3.2 The purchase or nonpurchase of such insurance or the involvement of the successful Bidder in any legal or equitable defense of any action brought against the successful Bidder based upon work performed pursuant to the Contract will not waive any defense which the State, its agencies and their respective officers, employees and agents might otherwise have against such claims, specifically including the defense of sovereign immunity, where applicable, and by the terms of this section, the State and all agencies, officers and employees thereof shall not be financially responsible for the consequences of work performed, pursuant to said contract.

#### 4.4 RIGHT TO AUDIT RECORDS

4.4.1 The Owner shall have the right to audit the books and records of a Contractor or any Subcontractor under any Contract or Subcontract to the extent that the books and records relate to the performance of the Contract or Subcontract.

4.4.2 Said books and records shall be maintained by the Contractor for a period of seven (7) years from the date of final payment under the Prime Contract and by the Subcontractor for a period of seven (7) years from the date of final payment under the Subcontract.

### ARTICLE 5: SUBCONTRACTORS

#### 5.1 SUBCONTRACTING REQUIREMENTS

5.1.1 All contracts for the construction, reconstruction, alteration or repair of any public building (not a road, street or highway) shall be subject to the following provisions:

1. A contract shall be awarded only to a Bidder whose Bid is accompanied by a statement containing, for each Subcontractor category, the name and address (city or town and State only – street number and P.O. Box addresses not required) of the subcontractor whose services the Bidder intends to use in performing the Work and providing the material for such Subcontractor category.
2. A Bid will not be accepted nor will an award of any Contract be made to any Bidder which, as the Prime Contractor, has listed itself as the Subcontractor for any Subcontractor unless:
  - A. It has been established to the satisfaction of the awarding Agency that the Bidder has customarily performed the specialty work of such Subcontractor category by artisans regularly employed by the Bidder's firm;
  - B. That the Bidder is duly licensed by the State to engage in such specialty work, if the State requires licenses; and
  - C. That the Bidder is recognized in the industry as a bona fide Subcontractor or Contractor in such specialty work and Subcontractor category.

5.1.2 The decision of the awarding Agency as to whether a Bidder who list itself as the Subcontractor for a Subcontractor category shall be final and binding upon all Bidders, and no action of any nature shall lie against any awarding agency or its employees or officers because of its decision in this regard.

- 5.1.3 After such a Contract has been awarded, the successful Bidder shall not substitute another Subcontractor for any Subcontractor whose name was set forth in the statement which accompanied the Bid without the written consent of the awarding Agency.
- 5.1.4 No Agency shall consent to any substitution of Subcontractors unless the Agency is satisfied that the Subcontractor whose name is on the Bidders accompanying statement:
- A. Is unqualified to perform the work required;
  - B. Has failed to execute a timely reasonable Subcontract;
  - C. Has defaulted in the performance on the portion of the work covered by the Subcontract; or
  - D. Is no longer engaged in such business.
- 5.2 PENALTY FOR SUBSTITUTION OF SUBCONTRACTORS
- 5.2.1 Should the Contractor fail to utilize any or all of the Subcontractors in the Contractor's Bid statement in the performance of the Work on the public bidding, the Contractor shall be penalized in the amount of (project specific amount\*). The Agency may determine to deduct payments of the penalty from the Contractor or have the amount paid directly to the Agency. Any penalty amount assessed against the Contractor may be remitted or refunded, in whole or in part, by the Agency awarding the Contract, only if it is established to the satisfaction of the Agency that the Subcontractor in question has defaulted or is no longer engaged in such business. No claim for the remission or refund of any penalty shall be granted unless an application is filed within one year after the liability of the successful Bidder accrues. All penalty amounts assessed and not refunded or remitted to the contractor shall be reverted to the State.
- \*one (1) percent of contract amount not to exceed \$10,000
- 5.3 ASBESTOS ABATEMENT
- 5.3.1 The selection of any Contractor to perform asbestos abatement for State-funded projects shall be approved by the Office of Management and Budget, Division of Facilities Management pursuant to Chapter 78 of Title 16.
- 5.4 STANDARDS OF CONSTRUCTION FOR THE PROTECTION OF THE PHYSICALLY HANDICAPPED
- 5.4.1 All Contracts shall conform with the standard established by the Delaware Architectural Accessibility Board unless otherwise exempted by the Board.
- 5.5 CONTRACT PERFORMANCE
- 5.5.1 Any firm entering into a Public Works Contract that neglects or refuses to perform or fails to comply with its terms, the Agency may terminate the Contract and proceed to award a new Contract or may require the Surety on the Performance Bond to complete the Contract in accordance with the terms of the Performance Bond.

**ARTICLE 6: CONSTRUCTION BY OWNER OR SEPARATE CONTRACTORS**

- 6.1 The Owner reserves the right to simultaneously perform other construction or operations related to the Project with the Owner's own forces, and to award separate contracts in connection with other portions of the Project or other Projects at the same site.
- 6.2 The Contractor shall afford the Owner and other Contractors reasonable opportunity for access and storage of materials and equipment, and for the performance of their activities, and shall connect and coordinate their activities with other forces as required by the Contract Documents.

**ARTICLE 7: CHANGES IN THE WORK**

- 7.1 The Owner, without invalidating the Contract, may order changes in the Work consisting of Additions, Deletions, Modifications or Substitutions, with the Contract Sum and Contract completion date being adjusted accordingly. Such changes in the Work shall be authorized by written Change Order signed by the Professional, as the duly authorized agent, the Contractor and the Owner.
- 7.2 The Contract Sum and Contract Completion Date shall be adjusted only by a fully executed Change Order.
- 7.3 The additional cost, or credit to the Owner resulting from a change in the Work shall be by mutual agreement of the Owner, Contractor and the Architect. In all cases, this cost or credit shall be based on the 'DPE' wages required and the "invoice price" of the materials/equipment needed.
- 7.3.1 "DPE" shall be defined to mean "direct personnel expense". Direct payroll expense includes direct salary plus customary fringe benefits (prevailing wage rates) and documented statutory costs such as workman's compensation insurance, Social Security/Medicare, and unemployment insurance (a maximum multiplier of 1.35 times DPE).
- 7.3.2 "Invoice price" of materials/equipment shall be defined to mean the actual cost of materials and/or equipment that is paid by the Contractor, (or subcontractor), to a material distributor, direct factory vendor, store, material provider, or equipment leasing entity. Rates for equipment that is leased and/or owned by the Contractor or subcontractor(s) shall not exceed those listed in the latest version of the "Means Building Construction Cost Data" publication.
- 7.3.3 In addition to the above, the General Contractor is allowed a fifteen percent (15%) markup for overhead and profit for additional work performed by the General Contractor's own forces. For additional subcontractor work, the Subcontractor is allowed a fifteen (15) percent overhead and profit on change order work above and beyond the direct costs stated previously. To this amount, the General Contractor will be allowed a mark-up not exceeding seven and one half percent (7.5%) on the subcontractors work. These mark-ups shall include all costs including, but not limited to: overhead, profit, bonds, insurance, supervision, etc. No markup is permitted on the work of the subcontractors subcontractor. No additional costs shall be allowed for changes related to the Contractor's onsite superintendent/staff, or project manager, unless a change in the work changes the project duration and is identified by the CPM schedule. There will be no other costs associated with the change order.

**ARTICLE 8: TIME**

- 8.1 Time limits, if any, are as stated in the Project Manual. By executing the Agreement, the Contractor confirms that the stipulated limits are reasonable, and that the Work will be completed within the anticipated time frame.
- 8.2 If progress of the Work is delayed at any time by changes ordered by the Owner, by labor disputes, fire, unusual delay in deliveries, abnormal adverse weather conditions, unavoidable casualties or other causes beyond the Contractor's control, the Contract Time shall be extended for such reasonable time as the Owner may determine.
- 8.3 Any extension of time beyond the date fixed for completion of the construction and acceptance of any part of the Work called for by the Contract, or the occupancy of the building by the Owner, in whole or in part, previous to the completion shall not be deemed a waiver by the Owner of his right to annul or terminate the Contract for abandonment or delay in the matter provided for, nor relieve the Contractor of full responsibility.
- 8.4 **SUSPENSION AND DEBARMENT**
- 8.4.1 Per Section 6962(d)(14), Title 29, Delaware Code, "Any Contractor who fails to perform a public works contract or complete a public works project within the time schedule established by the Agency in the Invitation To Bid, may be subject to Suspension or Debarment for one or more of the following reasons: a) failure to supply the adequate labor supply ratio for the project; b) inadequate financial resources; or, c) poor performance on the Project."
- 8.4.2 "Upon such failure for any of the above stated reasons, the Agency that contracted for the public works project may petition the Director of the Office of Management and Budget for Suspension or Debarment of the Contractor. The Agency shall send a copy of the petition to the Contractor within three (3) working days of filing with the Director. If the Director concludes that the petition has merit, the Director shall schedule and hold a hearing to determine whether to suspend the Contractor, debar the Contractor or deny the petition. The Agency shall have the burden of proving, by a preponderance of the evidence, that the Contractor failed to perform or complete the public works project within the time schedule established by the Agency and failed to do so for one or more of the following reasons: a) failure to supply the adequate labor supply ratio for the project; b) inadequate financial resources; or, c) poor performance on the project. Upon a finding in favor of the Agency, the Director may suspend a Contractor from Bidding on any project funded, in whole or in part, with public funds for up to 1 year for a first offense, up to 3 years for a second offense and permanently debar the Contractor for a third offense. The Director shall issue a written decision and shall send a copy to the Contractor and the Agency. Such decision may be appealed to the Superior Court within thirty (30) days for a review on the record."
- 8.5 **RETAINAGE**
- 8.5.1 Per Section 6962(d)(5) a.3, Title 29, Delaware Code: The Agency may at the beginning of each public works project establish a time schedule for the completion of the project. If the project is delayed beyond the completion date due to the Contractor's failure to meet their responsibilities, the Agency may forfeit, at its discretion, all or part of the Contractor's retainage.
- 8.5.2 This forfeiture of retainage also applies to the timely completion of the punchlist. A punchlist will only be prepared upon the mutual agreement of the Owner, Architect and Contractor. Once the punchlist is prepared, all three parties will by mutual agreement, establish a schedule for its completion. Should completion of the punchlist be delayed beyond the established date due to the Contractor's failure to meet their responsibilities,

the Agency may hold permanently, at its discretion, all or part of the Contractor's retainage.

## **ARTICLE 9: PAYMENTS AND COMPLETION**

### **9.1 APPLICATION FOR PAYMENT**

9.1.1 Applications for payment shall be made upon AIA Document G702. There will be a five percent (5%) retainage on all Contractor's monthly invoices until completion of the project. This retainage may become payable upon receipt of all required closeout documentation, provided all other requirements of the Contract Documents have been met.

9.1.2 A date will be fixed for the taking of the monthly account of work done. Upon receipt of Contractor's itemized application for payment, such application will be audited, modified, if found necessary, and approved for the amount. Statement shall be submitted to the Owner.

9.1.3 Section 6516, Title 29 of the Delaware Code annualized interest is not to exceed 12% per annum beginning thirty (30) days after the "presentment" (as opposed to the date) of the invoice.

### **9.2 PARTIAL PAYMENTS**

9.2.1 Any public works Contract executed by any Agency may provide for partial payments at the option of the Owner with respect to materials placed along or upon the sites or stored at secured locations, which are suitable for use in the performance of the contract.

9.2.2 When approved by the agency, partial payment may include the values of tested and acceptable materials of a nonperishable or noncontaminative nature which have been produced or furnished for incorporation as a permanent part of the work yet to be completed, provided acceptable provisions have been made for storage.

9.2.2.1 Any allowance made for materials on hand will not exceed the delivered cost of the materials as verified by invoices furnished by the Contractor, nor will it exceed the contract bid price for the material complete in place.

9.2.3 If requested by the Agency, receipted bills from all Contractors, Subcontractors, and material, men, etc., for the previous payment must accompany each application for payment. Following such a request, no payment will be made until these receipted bills have been received by the Owner.

### **9.3 SUBSTANTIAL COMPLETION**

9.3.1 When the building has been made suitable for occupancy, but still requires small items of miscellaneous work, the Owner will determine the date when the project has been substantially completed.

9.3.2 If, after the Work has been substantially completed, full completion thereof is materially delayed through no fault of the Contractor, and without terminating the Contract, the Owner may make payment of the balance due for the portion of the Work fully completed and

accepted. Such payment shall be made under the terms and conditions governing final payment that it shall not constitute a waiver of claims.

- 9.3.3 On projects where commissioning is included, the commissioning work as defined in the specifications must be complete prior to the issuance of substantial completion.

#### 9.4 FINAL PAYMENT

- 9.4.1 Final payment, including the five percent (5%) retainage if determined appropriate, shall be made within thirty (30) days after the Work is fully completed and the Contract fully performed and provided that the Contractor has submitted the following closeout documentation (in addition to any other documentation required elsewhere in the Contract Documents):

- 9.4.1.1 Evidence satisfactory to the Owner that all payrolls, material bills, and other indebtedness connected with the work have been paid,

- 9.4.1.2 An acceptable RELEASE OF LIENS,

- 9.4.1.3 Copies of all applicable warranties,

- 9.4.1.4 As-built drawings,

- 9.4.1.5 Operations and Maintenance Manuals,

- 9.4.1.6 Instruction Manuals,

- 9.4.1.7 Consent of Surety to final payment.

- 9.4.1.8 The Owner reserves the right to retain payments, or parts thereof, for its protection until the foregoing conditions have been complied with, defective work corrected and all unsatisfactory conditions remedied.

#### ARTICLE 10: PROTECTION OF PERSONS AND PROPERTY

- 10.1 The Contractor shall be responsible for initiating, maintaining, and supervising all safety precautions and programs in connection with the performance of the Contract. The Contractor shall take all reasonable precautions to prevent damage, injury or loss to: workers, persons nearby who may be affected, the Work, materials and equipment to be incorporated, and existing property at the site or adjacent thereto. The Contractor shall give notices and comply with applicable laws ordinances, rules regulations, and lawful orders of public authorities bearing on the safety of persons and property and their protection from injury, damage, or loss. The Contractor shall promptly remedy damage and loss to property at the site caused in whole or in part by the Contractor, a Subcontractor, or anyone directly or indirectly employed by any of them, or by anyone for whose acts they may be liable.

- 10.2 The Contractor shall notify the Owner in the event any existing hazardous material such as lead, PCBs, asbestos, etc. is encountered on the project. The Owner will arrange with a qualified specialist for the identification, testing, removal, handling and protection against exposure or environmental pollution, to comply with applicable regulation laws and ordinances. The Contractor and Architect will not be required to participate in or to perform

this operation. Upon completion of this work, the Owner will notify the Contractor and Architect in writing the area has been cleared and approved by the authorities in order for the work to proceed. The Contractor shall attach documentation from the authorities of said approval.

- 10.3 As required in the Hazardous Chemical Information Act of June 1984, all vendors supplying any materials that may be defined as hazardous, must provide Material Safety Data Sheets for those products. Any chemical product should be considered hazardous if it has a warning caution on the label relating to a potential physical or health hazard, if it is known to be present in the work place, and if employees may be exposed under normal conditions or in any foreseeable emergency situation. Material Safety Data Sheets must be provided directly to the Owner along with the shipping slips that include those products.
- 10.4 The Contractor shall certify to the Owner that materials incorporated into the Work are free of all asbestos. This certification may be in the form of Material Safety Data Sheet (MSDS) provided by the product manufacturer for the materials used in construction, as specified or as provided by the Contractor.

#### **ARTICLE 11: INSURANCE AND BONDS**

- 11.1 The Contractor shall carry all insurance required by law, such as Unemployment Insurance, etc. The Contractor shall carry such insurance coverage as they desire on their own property such as a field office, storage sheds or other structures erected upon the project site that belong to them and for their own use. The Subcontractors involved with this project shall carry whatever insurance protection they consider necessary to cover the loss of any of their personal property, etc.
- 11.2 Upon being awarded the Contract, the Contractor shall obtain a minimum of two (2) copies of all required insurance certificates called for herein, and submit one (1) copy of each certificate, to the Owner, within 20 days of contract award.
- 11.3 Bodily Injury Liability and Property Damage Liability Insurance shall, in addition to the coverage included herein, include coverage for injury to or destruction of any property arising out of the collapse of or structural injury to any building or structure due to demolition work and evidence of these coverages shall be filed with and approved by the Owner.
- 11.4 The Contractor's Property Damage Liability Insurance shall, in addition to the coverage noted herein, include coverage on all real and personal property in their care, custody and control damaged in any way by the Contractor or their Subcontractors during the entire construction period on this project.
- 11.5 Builders Risk (including Standard Extended Coverage Insurance) on the existing building during the entire construction period, shall not be provided by the Contractor under this contract. The Owner shall insure the existing building and all of its contents and all this new alteration work under this contract during entire construction period for the full insurable value of the entire work at the site. Note, however, that the Contractor and their Subcontractors shall be responsible for insuring building materials (installed and stored) and their tools and equipment whenever in use on the project, against fire damage, theft, vandalism, etc.
- 11.6 Certificates of the insurance company or companies stating the amount and type of coverage, terms of policies, etc., shall be furnished to the Owner, within 20 days of contract award.
- 11.7 The Contractor shall, at their own expense, (in addition to the above) carry the following forms of insurance:

11.7.1 Contractor's Contractual Liability Insurance

Minimum coverage to be:

Bodily Injury	\$ 500,000	for each person
	\$1,000,000	for each occurrence
	\$1,000,000	aggregate
Property Damage	\$ 500,000	for each occurrence
	\$1,000,000	aggregate

11.7.2 Contractor's Protective Liability Insurance

Minimum coverage to be:

Bodily Injury	\$ 500,000	for each person
	\$1,000,000	for each occurrence
	\$1,000,000	aggregate
Property Damage	\$ 500,000	for each occurrence
	\$500,000	aggregate

11.7.3 Automobile Liability Insurance

Minimum coverage to be:

Bodily Injury	\$1,000,000	for each person
	\$1,000,000	for each occurrence
Property Damage	\$ 500,000	per accident

11.7.4 Prime Contractor's and Subcontractors' policies shall include contingent and contractual liability coverage in the same minimum amounts as 11.7.1 above.

11.7.5 Workmen's Compensation (including Employer's Liability):

11.7.5.1 Minimum Limit on employer's liability to be as required by law.

11.7.5.2 Minimum Limit for all employees working at one site.

11.7.6 Certificates of Insurance must be filed with the Owner guaranteeing fifteen (15) days prior notice of cancellation, non-renewal, or any change in coverages and limits of liability shown as included on certificates.

11.7.7 Social Security Liability

- 11.7.7.1 With respect to all persons at any time employed by or on the payroll of the Contractor or performing any work for or on their behalf, or in connection with or arising out of the Contractor's business, the Contractor shall accept full and exclusive liability for the payment of any and all contributions or taxes or unemployment insurance, or old age retirement benefits, pensions or annuities now or hereafter imposed by the Government of the United States and the State or political subdivision thereof, whether the same be measured by wages, salaries or other remuneration paid to such persons or otherwise.
- 11.7.7.2 Upon request, the Contractor shall furnish Owner such information on payrolls or employment records as may be necessary to enable it to fully comply with the law imposing the aforesaid contributions or taxes.
- 11.7.7.3 If the Owner is required by law to and does pay any and/or all of the aforesaid contributions or taxes, the Contractor shall forthwith reimburse the Owner for the entire amount so paid by the Owner.

#### **ARTICLE 12: UNCOVERING AND CORRECTION OF WORK**

- 12.1 The Contractor shall promptly correct Work rejected by the Owner or failing to conform to the requirements of the Contract Documents, whether observed before or after Substantial Completion and whether or not fabricated, installed or completed, and shall correct any Work found to be not in accordance with the requirements of the Contract Documents within a period of one year from the date of Substantial Completion, or by terms of an applicable special warranty required by the Contract Documents. The provisions of this Article apply to work done by Subcontractors as well as to Work done by direct employees of the Contractor.
- 12.2 At any time during the progress of the work, or in any case where the nature of the defects shall be such that it is not expedient to have them corrected, the Owner, at their option, shall have the right to deduct such sum, or sums, of money from the amount of the contract as they consider justified to adjust the difference in value between the defective work and that required under contract including any damage to the structure.

#### **ARTICLE 13: MISCELLANEOUS PROVISIONS**

- 13.1 CUTTING AND PATCHING
- 13.1.1 The Contractor shall be responsible for all cutting and patching. The Contractor shall coordinate the work of the various trades involved.
- 13.2 DIMENSIONS
- 13.2.1 All dimensions shown shall be verified by the Contractor by actual measurements at the project site. Any discrepancies between the drawings and specifications and the existing conditions shall be referred to the Owner for adjustment before any work affected thereby has been performed.
- 13.3 LABORATORY TESTS
- 13.3.1 Any specified laboratory tests of material and finished articles to be incorporated in the work shall be made by bureaus, laboratories or agencies approved by the Owner and reports of such tests shall be submitted to the Owner. The cost of the testing shall be paid for by the Contractor.

13.3.2 The Contractor shall furnish all sample materials required for these tests and shall deliver same without charge to the testing laboratory or other designated agency when and where directed by the Owner.

13.4 ARCHAEOLOGICAL EVIDENCE

13.4.1 Whenever, in the course of construction, any archaeological evidence is encountered on the surface or below the surface of the ground, the Contractor shall notify the authorities of the Delaware Archaeological Board and suspend work in the immediate area for a reasonable time to permit those authorities, or persons designated by them, to examine the area and ensure the proper removal of the archaeological evidence for suitable preservation in the State Museum.

13.5 GLASS REPLACEMENT AND CLEANING

13.5.1 The General Contractor shall replace without expense to the Owner all glass broken during the construction of the project. If job conditions warrant, at completion of the job the General Contractor shall have all glass cleaned and polished.

13.6 WARRANTY

13.6.1 For a period of two (2) years from the date of substantial completion, as evidenced by the date of final acceptance of the work, the contractor warrants that work performed under this contract conforms to the contract requirements and is free of any defect of equipment, material or workmanship performed by the contractor or any of his subcontractors or suppliers. However, manufacturer's warranties and guarantees, if for a period longer than two (2) years, shall take precedence over the above warranties. The contractor shall remedy, at his own expense, any such failure to conform or any such defect. The protection of this warranty shall be included in the Contractor's Performance Bond.

**ARTICLE 14: TERMINATION OF CONTRACT**

14.1 If the Contractor defaults or persistently fails or neglects to carry out the Work in accordance with the Contract Documents or fails to perform a provision of the Contract, the Owner, after seven days written notice to the Contractor, may make good such deficiencies and may deduct the cost thereof from the payment then or thereafter due the Contractor. Alternatively, at the Owner's option, and the Owner may terminate the Contract and take possession of the site and of all materials, equipment, tools, and machinery thereon owned by the Contractor and may finish the Work by whatever method the Owner may deem expedient. If the costs of finishing the Work exceed any unpaid compensation due the Contractor, the Contractor shall pay the difference to the Owner.

14.2 "If the continuation of this Agreement is contingent upon the appropriation of adequate state, or federal funds, this Agreement may be terminated on the date beginning on the first fiscal year for which funds are not appropriated or at the exhaustion of the appropriation. The Owner may terminate this Agreement by providing written notice to the parties of such non-appropriation. All payment obligations of the Owner will cease upon the date of termination. Notwithstanding the foregoing, the Owner agrees that it will use its best efforts to obtain approval of necessary funds to continue the Agreement by taking appropriate action to request adequate funds to continue the Agreement."

END OF GENERAL REQUIREMENTS

Not For Bidding Purposes

**SECTION 01 10 00**

**SUMMARY**

**PART 1 GENERAL**

**1.01 PROJECT**

- A. Project Name: Supreme Court Building Sprinkler System Installation.
- B. Owner's Name: State of Delaware - Delaware State Courts
- C. The Project consists of the installation of a new sprinkler system in the Supreme Court Building in Dover, Delaware].

**1.02 CONTRACT DESCRIPTION**

- A. Contract Type: A single prime contract based on a Stipulated Price as described in Division 0 - Procurement and Contract Requirements).

**1.03 DESCRIPTION OF WORK**

- A. Scope of demolition and removal work is shown on drawings.
- B. Scope of work is shown on drawings.
- C. Fire Suppression Sprinklers: Replace existing system with new construction, keeping existing in operation until ready for changeover.

**1.04 OWNER OCCUPANCY**

- A. State of Delaware intends to continue to occupy adjacent portions of the existing building during the entire construction period.
- B. State of Delaware intends to occupy the Project upon Substantial Completion.
- C. Cooperate with State of Delaware to minimize conflict and to facilitate continuation of normal State of Delaware's operations.
- D. Schedule the Work to accommodate State of Delaware occupancy.

**1.05 CONTRACTOR USE OF SITE AND PREMISES**

- A. Provide access to and from site as required by law and by State of Delaware:
  - 1. Emergency Building Exits During Construction: Keep all exits required by code clear and open during construction period; provide temporary exit signs if exit routes are temporarily altered.
  - 2. Do not obstruct roadways, sidewalks, or other public ways without permit.
- B. Utility Outages and Shutdown:
  - 1. Limit disruption of utility services to hours the building is unoccupied.
  - 2. Do not disrupt or shut down life safety systems, including but not limited to fire sprinklers and fire alarm system, without 7 days notice to State of Delaware and authorities having jurisdiction.
  - 3. Prevent accidental disruption of utility services to other facilities.

**PART 2 PRODUCTS - NOT USED**

**PART 3 EXECUTION - NOT USED**

**END OF SECTION**

**SECTION 01 20 00**

**PRICE AND PAYMENT PROCEDURES**

**PART 1 GENERAL**

**1.01 SECTION INCLUDES**

- A. Procedures for preparation and submittal of applications for progress payments.

**1.02 RELATED REQUIREMENTS**

- A. Section 01 21 00 - Allowances: Payment procedures relating to allowances.
- B. Section 01 22 00 - Unit Prices: Monetary values of unit prices, payment and modification procedures relating to unit prices.

**1.03 SCHEDULE OF VALUES**

- A. Forms to be used: AIA G703.
- B. Electronic media printout including equivalent information will be considered in lieu of standard form specified; submit sample to Delaware Engineering and Design Corporation for approval.
- C. Forms shall be typed. Forms filled out by hand will not be accepted.
- D. Submit Schedule of Values in duplicate within 5 days after date of Pre-Construction Meeting.

**1.04 APPLICATIONS FOR PROGRESS PAYMENTS**

- A. Payment Period: Submit at intervals stipulated in the Agreement.
- B. Form to be used: AIA G702 and G703.
- C. Electronic media printout including equivalent information will be considered in lieu of standard form specified; submit sample to Delaware Engineering and Design Corporation for approval.
- D. Forms shall be typed. Forms filled out by hand will not be accepted.
- E. Execute certification by signature of authorized officer.
- F. Submit three copies of each Application for Payment.
- G. Include the following with the application:
  - 1. OMB/DFM Project Number.
  - 2. Contractors Purchase Order Number from the State.

**1.05 MODIFICATION PROCEDURES**

- A. For minor changes not involving an adjustment to the Contract Sum or Contract Time, Delaware Engineering and Design Corporation will issue instructions directly to Contractor.
- B. For other required changes, Delaware Engineering and Design Corporation will issue a document signed by State of Delaware instructing Contractor to proceed with the change, for subsequent inclusion in a Change Order.
  - 1. The document will describe the required changes and will designate method of determining any change in Contract Sum or Contract Time.
  - 2. Promptly execute the change.

- C. For changes for which advance pricing is desired, Delaware Engineering and Design Corporation will issue a document that includes a detailed description of a proposed change with supplementary or revised drawings and specifications, a change in Contract Time for executing the change with a stipulation of any overtime work required and the period of time during which the requested price will be considered valid. Contractor shall prepare and submit a fixed price quotation within 5 days.
- D. Computation of Change in Contract Amount: As specified in the Agreement and Conditions of the Contract.
- E. Execution of Change Orders: Delaware Engineering and Design Corporation will issue Change Orders for signatures of parties as provided in the Conditions of the Contract.
- F. After execution of Change Order, promptly revise Schedule of Values and Application for Payment forms to record each authorized Change Order as a separate line item and adjust the Contract Sum.
- G. Promptly revise progress schedules to reflect any change in Contract Time, and revise sub-schedules to adjust times for other items of work affected by the change.
- H. Promptly enter changes in Project Record Documents.

#### **1.06 APPLICATION FOR FINAL PAYMENT**

- A. Prepare Application for Final Payment as specified for progress payments, identifying total adjusted Contract Sum, previous payments, and sum remaining due.
- B. Application for Final Payment will not be considered until the following have been accomplished:
  - 1. All closeout procedures specified in Section 01 70 00.

#### **PART 2 PRODUCTS - NOT USED**

#### **PART 3 EXECUTION - NOT USED**

**END OF SECTION**

**SECTION 01 30 00**

**ADMINISTRATIVE REQUIREMENTS**

**PART 1 GENERAL**

**1.01 SECTION INCLUDES**

- A. Preconstruction meeting.
- B. Progress meetings.
- C. Construction progress schedule.
- D. Progress photographs.
- E. Coordination drawings.
- F. Submittals for review, information, and project closeout.
- G. Number of copies of submittals.
- H. Submittal procedures.

**1.02 RELATED REQUIREMENTS**

- A. Section 01 70 00 - Execution and Closeout Requirements: Additional coordination requirements.
- B. Section 01 78 00 - Closeout Submittals: Project record documents.
- C. Section 01 91 13 - General Commissioning Requirements: Additional procedures for submittals relating to commissioning.
  - 1. Where submittals are indicated for review by both Delaware Engineering and Design Corporation and the Commissioning Authority, submit one extra and route to Delaware Engineering and Design Corporation first, for forwarding to the Commissioning Authority.
  - 2. Where submittals are not indicated to be reviewed by Delaware Engineering and Design Corporation, submit directly to the Commissioning Authority; otherwise, the procedures specified in this section apply to commissioning submittals.

**1.03 PROJECT COORDINATION**

- A. Project Coordinator: State of Delaware's Project Manager and DEDC.
- B. Cooperate with the Project Coordinator in allocation of mobilization areas of site; for field offices and sheds, for access, traffic, and parking facilities.
- C. During construction, coordinate use of site and facilities through the Project Coordinator.
- D. Comply with Project Coordinator's procedures for intra-project communications; submittals, reports and records, schedules, coordination drawings, and recommendations; and resolution of ambiguities and conflicts.
- E. Comply with instructions of the Project Coordinator for use of temporary utilities and construction facilities.
- F. Coordinate field engineering and layout work under instructions of the Project Coordinator.
- G. Make the following types of submittals to Delaware Engineering and Design Corporation through the Project Coordinator:
  - 1. Requests for interpretation.
  - 2. Requests for substitution.
  - 3. Shop drawings, product data, and samples.
  - 4. Test and inspection reports.

5. Manufacturer's instructions and field reports.
6. Applications for payment and change order requests.
7. Progress schedules.
8. Coordination drawings.
9. Closeout submittals.

## **PART 2 PRODUCTS - NOT USED**

## **PART 3 EXECUTION**

### **3.01 PRECONSTRUCTION MEETING**

- A. State of Delaware will schedule a meeting after Notice of Award.
- B. Attendance Required:
  1. State of Delaware.
  2. Delaware Engineering and Design Corporation.
  3. Contractor.
- C. Agenda:
  1. Execution of State of Delaware-Contractor Agreement.
  2. Designation of personnel representing the parties to Contract, State of Delaware, Contractor, Subcontractors, and Delaware Engineering and Design Corporation.
  3. Designation of personnel representing the parties to Contract, owner, and Delaware Engineering and Design Corporation.
  4. Procedures and processing of field decisions, submittals, substitutions, applications for payments, proposal request, Change Orders, and Contract closeout procedures.
  5. Scheduling.

### **3.02 PROGRESS MEETINGS**

- A. Schedule and administer meetings throughout progress of the Work at maximum two week intervals.
- B. Delaware Engineering and Design Corporation will make arrangements for meetings, prepare agenda with copies for participants, preside at meetings.
- C. Attendance Required: Job superintendent, major Subcontractors and suppliers, State of Delaware, Delaware Engineering and Design Corporation, as appropriate to agenda topics for each meeting.
- D. Contractor shall provide a 3-week look ahead schedule in writing at each meeting and be prepared to review with attendees.
- E. Agenda:
  1. Review minutes of previous meetings.
  2. Review of Work progress.
  3. Field observations, problems, and decisions.
  4. Identification of problems that impede, or will impede, planned progress.
  5. Review of submittals schedule and status of submittals.
  6. Maintenance of progress schedule.
  7. Review contractor's 3 week look ahead schedule.
  8. Corrective measures to regain projected schedules.
  9. Planned progress during succeeding work period.
  10. Maintenance of quality and work standards.
  11. Effect of proposed changes on progress schedule and coordination.
  12. Other business relating to Work.

### **3.03 CONSTRUCTION PROGRESS SCHEDULE**

- A. If preliminary construction progress schedule requires revision after review, submit revised schedule within 10 days.
- B. Within 20 days after review of preliminary construction progress schedule, submit draft of proposed final schedule for review.
  - 1. Include written certification that major Subcontractors have reviewed and accepted proposed schedule.
- C. Within 10 days after joint review, submit final schedule.
- D. Submit updated schedule with each Application for Payment.

#### **3.04 PROGRESS PHOTOGRAPHS**

- A. Submit photographs with each application for payment, taken not more than 3 days prior to submission of application for payment.
- B. Photography Type: Digital; electronic files.
- C. Provide photographs of construction throughout progress of Work produced by an experienced photographer, acceptable to Delaware Engineering and Design Corporation.
- D. In addition to periodic, recurring views, take photographs of each of the following events:
- E. Views:
  - 1. Provide non-aerial photographs from four cardinal views at each specified time, until Date of Substantial Completion.
  - 2. Consult with Delaware Engineering and Design Corporation for instructions on views required.
  - 3. Provide factual presentation.
  - 4. Provide correct exposure and focus, high resolution and sharpness, maximum depth of field, and minimum distortion.
- F. Digital Photographs: 24 bit color, minimum resolution of 1024 by 768, in JPG format; provide files unaltered by photo editing software.
  - 1. Delivery Medium: On photo CD.
  - 2. File Naming: Include project identification, date and time of view, and view identification.
  - 3. Point of View Sketch: Include digital copy of point of view sketch with each electronic submittal; include point of view identification in each photo file name.

#### **3.05 COORDINATION DRAWINGS**

- A. Provide information required by Project Coordinator for preparation of coordination drawings.

#### **3.06 SUBMITTALS FOR REVIEW**

- A. When the following are specified in individual sections, submit them for review:
  - 1. Product data.
  - 2. Shop drawings.
  - 3. Samples for selection.
  - 4. Samples for verification.
- B. Submit to Delaware Engineering and Design Corporation for review for the limited purpose of checking for conformance with information given and the design concept expressed in the contract documents.
- C. Samples will be reviewed only for aesthetic, color, or finish selection.

- D. After review, provide copies and distribute in accordance with SUBMITTAL PROCEDURES article below.

### **3.07 SUBMITTALS FOR INFORMATION**

- A. When the following are specified in individual sections, submit them for information:
  - 1. Design data.
  - 2. Certificates.
  - 3. Test reports.
  - 4. Inspection reports.
  - 5. Manufacturer's instructions.
  - 6. Manufacturer's field reports.
  - 7. Other types indicated.
- B. Submit for Delaware Engineering and Design Corporation's knowledge as contract administrator or for State of Delaware.

### **3.08 SUBMITTALS FOR PROJECT CLOSEOUT**

- A. When the following are specified in individual sections, submit them at project closeout:
  - 1. Project record documents.
  - 2. Operation and maintenance data.
  - 3. Warranties.
  - 4. Bonds.
  - 5. Other types as indicated.
- B. Submit for State of Delaware's benefit during and after project completion.

### **3.09 NUMBER OF COPIES OF SUBMITTALS**

- A. Documents for Review:
  - 1. Small Size Sheets, Not Larger Than 8-1/2 x 11 inches: Submit the number of copies that Contractor requires, plus one copy that will be retained by Delaware Engineering and Design Corporation.
- B. Documents for Information: Submit one copy.
- C. Documents for Project Closeout: Make one reproduction of submittal originally reviewed. Submit one extra of submittals for information.
- D. Samples: Submit the number specified in individual specification sections; one of which will be retained by Delaware Engineering and Design Corporation.
  - 1. After review, produce duplicates.
  - 2. Retained samples will not be returned to Contractor unless specifically so stated.

### **3.10 SUBMITTAL PROCEDURES**

- A. Transmit each submittal with approved form.
- B. Sequentially number the transmittal form. Revise submittals with original number and a sequential alphabetic suffix.
- C. Identify Project, Contractor, Subcontractor or supplier; pertinent drawing and detail number, and specification section number, as appropriate on each copy.
- D. Apply Contractor's stamp, signed or initialed certifying that review, approval, verification of Products required, field dimensions, adjacent construction Work, and coordination of information is in accordance with the requirements of the Work and Contract Documents.
- E. Deliver submittals to Delaware Engineering and Design Corporation at business address.

- F. Schedule submittals to expedite the Project, and coordinate submission of related items.
- G. For each submittal for review, allow 15 days excluding delivery time to and from the Contractor.
- H. Identify variations from Contract Documents and Product or system limitations that may be detrimental to successful performance of the completed Work.
- I. Provide space for Contractor and Delaware Engineering and Design Corporation review stamps.
- J. When revised for resubmission, identify all changes made since previous submission.
- K. Distribute reviewed submittals as appropriate. Instruct parties to promptly report any inability to comply with requirements.
- L. Submittals not requested will not be recognized or processed.

**END OF SECTION**

Not For Bidding Purposes

**SECTION 01 40 00**

**QUALITY REQUIREMENTS**

**PART 1 GENERAL**

**1.01 SECTION INCLUDES**

- A. Control of installation.
- B. Testing and inspection services.
- C. Manufacturers' field services.

**1.02 RELATED REQUIREMENTS**

- A. Section 01 30 00 - Administrative Requirements: Submittal procedures.
- B. Section 01 60 00 - Product Requirements: Requirements for material and product quality.

**1.03 REFERENCE STANDARDS**

- A. ASTM C1077 - Standard Practice for Laboratories Testing Concrete and Concrete Aggregates for Use in Construction and Criteria for Laboratory Evaluation; 2011c.

**1.04 SUBMITTALS**

- A. Design Data: Submit for Delaware Engineering and Design Corporation's knowledge as contract administrator for the limited purpose of assessing conformance with information given and the design concept expressed in the contract documents, or for State of Delaware's information.
- B. Test Reports: After each test/inspection, promptly submit two copies of report to Delaware Engineering and Design Corporation and to Contractor.
  - 1. Include:
    - a. Date issued.
    - b. Project title and number.
    - c. Name of inspector.
    - d. Date and time of sampling or inspection.
    - e. Identification of product and specifications section.
    - f. Location in the Project.
    - g. Type of test/inspection.
    - h. Date of test/inspection.
    - i. Results of test/inspection.
    - j. Conformance with Contract Documents.
    - k. When requested by Delaware Engineering and Design Corporation, provide interpretation of results.

**1.05 TESTING AND INSPECTION AGENCIES**

- A. State of Delaware will employ and pay for services of an independent testing agency to perform other specified testing.
- B. Employment of agency in no way relieves Contractor of obligation to perform Work in accordance with requirements of Contract Documents.

**PART 2 PRODUCTS - NOT USED**

### **PART 3 EXECUTION**

#### **3.01 CONTROL OF INSTALLATION**

- A. Monitor quality control over suppliers, manufacturers, products, services, site conditions, and workmanship, to produce Work of specified quality.
- B. Comply with manufacturers' instructions, including each step in sequence.
- C. Should manufacturers' instructions conflict with Contract Documents, request clarification from Delaware Engineering and Design Corporation before proceeding.
- D. Comply with specified standards as minimum quality for the Work except where more stringent tolerances, codes, or specified requirements indicate higher standards or more precise workmanship.
- E. Have Work performed by persons qualified to produce required and specified quality.
- F. Verify that field measurements are as indicated on shop drawings or as instructed by the manufacturer.
- G. Secure products in place with positive anchorage devices designed and sized to withstand stresses, vibration, physical distortion, and disfigurement.

#### **3.02 TESTING AND INSPECTION**

- A. Testing Agency Duties:
  - 1. Provide qualified personnel at site. Cooperate with Delaware Engineering and Design Corporation and Contractor in performance of services.
  - 2. Perform specified sampling and testing of products in accordance with specified standards.
  - 3. Ascertain compliance of materials and mixes with requirements of Contract Documents.
  - 4. Promptly notify Delaware Engineering and Design Corporation and Contractor of observed irregularities or non-conformance of Work or products.
  - 5. Perform additional tests and inspections required by Delaware Engineering and Design Corporation.
  - 6. Submit reports of all tests/inspections specified.
- B. Limits on Testing/Inspection Agency Authority:
  - 1. Agency may not release, revoke, alter, or enlarge on requirements of Contract Documents.
  - 2. Agency may not approve or accept any portion of the Work.
  - 3. Agency may not assume any duties of Contractor.
  - 4. Agency has no authority to stop the Work.
- C. Contractor Responsibilities:
  - 1. Deliver to agency at designated location, adequate samples of materials proposed to be used that require testing, along with proposed mix designs.
  - 2. Cooperate with laboratory personnel, and provide access to the Work and to manufacturers' facilities.
  - 3. Provide incidental labor and facilities:
    - a. To provide access to Work to be tested/inspected.
    - b. To obtain and handle samples at the site or at source of Products to be tested/inspected.
    - c. To facilitate tests/inspections.
    - d. To provide storage and curing of test samples.
  - 4. Notify Delaware Engineering and Design Corporation and laboratory 24 hours prior to expected time for operations requiring testing/inspection services.
  - 5. Employ services of an independent qualified testing laboratory and pay for additional samples, tests, and inspections required by Contractor beyond specified requirements.

6. Arrange with State of Delaware's agency and pay for additional samples, tests, and inspections required by Contractor beyond specified requirements.
- D. Re-testing required because of non-conformance to specified requirements shall be performed by the same agency on instructions by Delaware Engineering and Design Corporation.
- E. Re-testing required because of non-conformance to specified requirements shall be paid for by Contractor.

### **3.03 MANUFACTURERS' FIELD SERVICES**

- A. When specified in individual specification sections, require material or product suppliers or manufacturers to provide qualified staff personnel to observe site conditions, conditions of surfaces and installation, quality of workmanship, start-up of equipment, test, adjust and balance of equipment as applicable, and to initiate instructions when necessary.
- B. Report observations and site decisions or instructions given to applicators or installers that are supplemental or contrary to manufacturers' written instructions.

### **3.04 DEFECT ASSESSMENT**

- A. Replace Work or portions of the Work not conforming to specified requirements.
- B. The Fire Marshal (authority having jurisdiction) has the authority to stop work deemed to be substandard.
- C. If, in the opinion of Delaware Engineering and Design Corporation, it is not practical to remove and replace the Work, Delaware Engineering and Design Corporation will direct an appropriate remedy or adjust payment.

**END OF SECTION**

**SECTION 01 50 00**

**TEMPORARY FACILITIES AND CONTROLS**

**PART 1 GENERAL**

**1.01 SECTION INCLUDES**

- A. Vehicular access and parking.
- B. Waste removal facilities and services.

**1.02 VEHICULAR ACCESS AND PARKING - See Section 01 55 00**

- A. Coordinate access and haul routes with governing authorities and State of Delaware.
- B. Provide and maintain access to fire hydrants, free of obstructions.
- C. Provide means of removing mud from vehicle wheels before entering streets.
- D. Provide temporary parking areas to accommodate construction personnel. When site space is not adequate, provide additional off-site parking.

**1.03 WASTE REMOVAL**

- A. Provide waste removal facilities and services as required to maintain the site in clean and orderly condition.
- B. Provide containers with lids. Remove trash from site periodically.
- C. If materials to be recycled or re-used on the project must be stored on-site, provide suitable non-combustible containers; locate containers holding flammable material outside the structure unless otherwise approved by the authorities having jurisdiction.
- D. Open free-fall chutes are not permitted. Terminate closed chutes into appropriate containers with lids.

**PART 2 PRODUCTS - NOT USED**

**PART 3 EXECUTION - NOT USED**

**END OF SECTION**

**SECTION 01 55 00**

**VEHICULAR ACCESS AND PARKING**

**PART 1 GENERAL**

**1.01 SECTION INCLUDES**

- A. Parking.

**PART 2 PRODUCTS**

**2.01 NOT USED**

**PART 3 EXECUTION**

**3.01 PARKING**

- A. Use of designated areas of existing parking facilities by construction personnel is permitted. Designated area for parking for construction personnel will be discussed at the preconstruction meeting.

**END OF SECTION**

Not For Bidding Purposes

**SECTION 01 60 00**

**PRODUCT REQUIREMENTS**

**PART 1 GENERAL**

**1.01 SECTION INCLUDES**

- A. General product requirements.
- B. Re-use of existing products.
- C. Transportation, handling, storage and protection.
- D. Product option requirements.
- E. Substitution "or Equal" limitations and procedures.

**1.02 RELATED REQUIREMENTS**

- A. Document Instructions to Bidders: Product options and substitution procedures prior to bid date.
- B. Section 01 10 00 - Summary:
- C. Section 01 40 00 - Quality Requirements: Product quality monitoring.
- D. Section 01 74 19 - Construction Waste Management and Disposal: Waste disposal requirements potentially affecting packaging and substitutions.

**1.03 REFERENCE STANDARDS**

- A. NFPA 70 - National Electrical Code; National Fire Protection Association; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.

**1.04 SUBMITTALS**

- A. Product Data Submittals: Submit manufacturer's standard published data. Mark each copy to identify applicable products, models, options, and other data. Supplement manufacturers' standard data to provide information specific to this Project.
- B. Shop Drawing Submittals: Prepared specifically for this Project; indicate utility and electrical characteristics, utility connection requirements, and location of utility outlets for service for functional equipment and appliances.
- C. Sample Submittals: Illustrate functional and aesthetic characteristics of the product, with integral parts and attachment devices. Coordinate sample submittals for interfacing work.
  - 1. For selection from standard finishes, submit samples of the full range of the manufacturer's standard colors, textures, and patterns.

**PART 2 PRODUCTS**

**2.01 EXISTING PRODUCTS**

- A. Do not use materials and equipment removed from existing premises unless specifically required or permitted by the Contract Documents.
- B. Unforeseen historic items encountered remain the property of the State of Delaware; notify State of Delaware promptly upon discovery; protect, remove, handle, and store as directed by State of Delaware.
- C. Existing materials and equipment indicated to be removed, but not to be re-used, relocated, reinstalled, delivered to the State of Delaware, or otherwise indicated as to remain the property of the State of Delaware, become the property of the Contractor; remove from site.

- D. Reused Products: Reused products include materials and equipment previously used in this or other construction, salvaged and refurbished as specified.
- E. Specific Products to be Reused: The reuse of certain materials and equipment already existing on the project site is not prohibited.
  - 1. See Section 01 10 00 for list of items required to be salvaged for reuse and relocation.

## 2.02 NEW PRODUCTS

- A. Provide new products unless specifically required or permitted by the Contract Documents.
- B. Do not use products having any of the following characteristics:
  - 1. Made using or containing CFC's or HCFC's.
- C. Where all other criteria are met, Contractor shall give preference to products that:
  - 1. Are extracted, harvested, and/or manufactured closer to the location of the project.
  - 2. Have longer documented life span under normal use.
  - 3. Result in less construction waste.
  - 4. Are made of vegetable materials that are rapidly renewable.
- D. Provide interchangeable components of the same manufacture for components being replaced.
- E. Wiring Terminations: Provide terminal lugs to match branch circuit conductor quantities, sizes, and materials indicated. Size terminal lugs to NFPA 70, include lugs for terminal box.

## 2.03 PRODUCT OPTIONS

- A. Products Specified by Reference Standards or by Description Only: Use any product meeting those standards or description.
- B. Products Specified by Naming One or More Manufacturers with a Provision for Substitutions: Submit a request for substitution for any manufacturer not named in accordance with this specification.

## PART 3 EXECUTION

### 3.01 SUBSTITUTION PROCEDURES

- A. The intent of this process is to allow for manufacturers not listed to provide an "Equal" product to Delaware Engineering and Design Corporation for review and approval. This process must take place prior to award of bid.
- B. Instructions to Bidders specify time restrictions for submitting requests for substitutions during the bidding period. Comply with requirements specified in this section.
- C. Document each request with complete data substantiating compliance of proposed substitution with Contract Documents.
- D. A request for substitution constitutes a representation that the submitter:
  - 1. Has investigated proposed product and determined that it meets or exceeds the quality level of the specified product.
  - 2. Will provide the same warranty for the substitution as for the specified product.
  - 3. Will coordinate installation and make changes to other Work that may be required for the Work to be complete with no additional cost to State of Delaware.
  - 4. Waives claims for additional costs or time extension that may subsequently become apparent.
  - 5. Has investigated proper clearances and working spaces for substituted equipment and waives claims for additional costs or time extension that may subsequently become apparent. These physical differences must be pointed out at the time of the submittal.
- E. Substitution Submittal Procedure:

1. Submit three copies of request for substitution for consideration. Limit each request to one proposed substitution.
2. Submit shop drawings, product data, and certified test results attesting to the proposed product equivalence. Burden of proof is on proposer.
3. The Delaware Engineering and Design Corporation will notify Contractor in writing of decision to accept or reject request.

### **3.02 TRANSPORTATION AND HANDLING**

- A. Coordinate schedule of product delivery to designated prepared areas in order to minimize site storage time and potential damage to stored materials.
- B. Transport and handle products in accordance with manufacturer's instructions.
- C. Transport materials in covered trucks to prevent contamination of product and littering of surrounding areas.
- D. Promptly inspect shipments to ensure that products comply with requirements, quantities are correct, and products are undamaged.
- E. Provide equipment and personnel to handle products by methods to prevent soiling, disfigurement, or damage.
- F. Arrange for the return of packing materials, such as wood pallets, where economically feasible.

### **3.03 STORAGE AND PROTECTION**

- A. Designate receiving/storage areas for incoming products so that they are delivered according to installation schedule and placed convenient to work area in order to minimize waste due to excessive materials handling and misapplication.
- B. Store and protect products in accordance with manufacturers' instructions.
- C. Store with seals and labels intact and legible.
- D. Store sensitive products in weather tight, climate controlled, enclosures in an environment favorable to product.
- E. For exterior storage of fabricated products, place on sloped supports above ground.
- F. Cover products subject to deterioration with impervious sheet covering. Provide ventilation to prevent condensation and degradation of products.
- G. Prevent contact with material that may cause corrosion, discoloration, or staining.
- H. Provide equipment and personnel to store products by methods to prevent soiling, disfigurement, or damage.
- I. Arrange storage of products to permit access for inspection. Periodically inspect to verify products are undamaged and are maintained in acceptable condition.

**END OF SECTION**

**SECTION 01 70 00**

**EXECUTION AND CLOSEOUT REQUIREMENTS**

**PART 1 GENERAL**

**1.01 SECTION INCLUDES**

- A. Examination, preparation, and general installation procedures.
- B. Requirements for alterations work, including selective demolition, except removal, disposal, and/or remediation of hazardous materials and toxic substances.
- C. Pre-installation meetings.
- D. Cutting and patching.
- E. Cleaning and protection.
- F. Starting of systems and equipment.
- G. Demonstration and instruction of State of Delaware personnel.
- H. Closeout procedures, except payment procedures.
- I. General requirements for maintenance service.

**1.02 RELATED REQUIREMENTS**

- A. Section 01 10 00 - Summary: Limitations on working in existing building; continued occupancy; work sequence; identification of salvaged and relocated materials.
- B. Section 01 30 00 - Administrative Requirements: Submittals procedures.
- C. Section 01 74 19 - Construction Waste Management and Disposal: Additional procedures for trash/waste removal, recycling, salvage, and reuse.
- D. Section 01 78 00 - Closeout Submittals: Project record documents, operation and maintenance data, warranties and bonds.
- E. Section 01 91 13 - General Commissioning Requirements: Contractor's responsibilities in regard to commissioning.
- F. Section 07 84 00 - Firestopping.

**1.03 REFERENCE STANDARDS**

- A. NFPA 241 - Standard for Safeguarding Construction, Alteration, and Demolition Operations; 2009.

**1.04 SUBMITTALS**

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Cutting and Patching: Submit written request in advance of cutting or alteration that affects:
  - 1. Structural integrity of any element of Project.
  - 2. Integrity of weather exposed or moisture resistant element.
  - 3. Efficiency, maintenance, or safety of any operational element.
  - 4. Visual qualities of sight exposed elements.
  - 5. Work of State of Delaware or separate Contractor.
  - 6. Include in request:
    - a. Identification of Project.
    - b. Location and description of affected work.
    - c. Necessity for cutting or alteration.

- d. Description of proposed work and products to be used.
- e. Effect on work of State of Delaware or separate Contractor.
- f. Written permission of affected separate Contractor.
- g. Date and time work will be executed.

C. Project Record Documents: Accurately record actual locations of capped and active utilities.

### 1.05 PROJECT CONDITIONS

- A. Use of explosives is not permitted.
- B. Ventilate enclosed areas to assist cure of materials, to dissipate humidity, and to prevent accumulation of dust, fumes, vapors, or gases.
- C. Dust Control: Execute work by methods to minimize raising dust from construction operations. Provide positive means to prevent air-borne dust from dispersing into atmosphere and over adjacent property.
  - 1. Provide dust-proof barriers between construction areas and areas continuing to be occupied by State of Delaware.
- D. Noise Control: Provide methods, means, and facilities to minimize noise produced by construction operations.
  - 1. Outdoors: Limit conduct of especially noisy exterior work to the hours of 8 am to 5 pm.
  - 2. Indoors: Limit conduct of especially noisy interior work to the hours of 6 pm to 7 am.
- E. Pest and Rodent Control: Provide methods, means, and facilities to prevent pests and insects from damaging the work.

### 1.06 COORDINATION

- A. See Section 01 10 00 for occupancy-related requirements.
- B. Coordinate scheduling, submittals, and work of the various sections of the Project Manual to ensure efficient and orderly sequence of installation of interdependent construction elements, with provisions for accommodating items installed later.
- C. Notify affected utility companies and comply with their requirements.
- D. Verify that utility requirements and characteristics of new operating equipment are compatible with building utilities. Coordinate work of various sections having interdependent responsibilities for installing, connecting to, and placing in service, such equipment.
- E. Coordinate space requirements, supports, and installation of mechanical and electrical work that are indicated diagrammatically on Drawings. Follow routing shown for pipes, ducts, and conduit, as closely as practicable; place runs parallel with lines of building. Utilize spaces efficiently to maximize accessibility for other installations, for maintenance, and for repairs.
- F. In finished areas except as otherwise indicated, conceal pipes, ducts, and wiring within the construction. Coordinate locations of fixtures and outlets with finish elements.
- G. Coordinate completion and clean-up of work of separate sections.
- H. After State of Delaware occupancy of premises, coordinate access to site for correction of defective work and work not in accordance with Contract Documents, to minimize disruption of State of Delaware's activities.

## PART 2 PRODUCTS

### 2.01 PATCHING MATERIALS

- A. New Materials: As specified in product sections; match existing products and work for patching and extending work.

- B. Type and Quality of Existing Products: Determine by inspecting and testing products where necessary, referring to existing work as a standard.
- C. Product Substitution: For any proposed change in materials, submit request for substitution described in Section 01 60 00.

### **PART 3 EXECUTION**

#### **3.01 EXAMINATION**

- A. Verify that existing site conditions and substrate surfaces are acceptable for subsequent work. Start of work means acceptance of existing conditions.
- B. Verify that existing substrate is capable of structural support or attachment of new work being applied or attached.
- C. Examine and verify specific conditions described in individual specification sections.
- D. Take field measurements before confirming product orders or beginning fabrication, to minimize waste due to over-ordering or misfabrication.
- E. Verify that utility services are available, of the correct characteristics, and in the correct locations.
- F. Prior to Cutting: Examine existing conditions prior to commencing work, including elements subject to damage or movement during cutting and patching. After uncovering existing work, assess conditions affecting performance of work. Beginning of cutting or patching means acceptance of existing conditions.

#### **3.02 PREPARATION**

- A. Clean substrate surfaces prior to applying next material or substance.
- B. Seal cracks or openings of substrate prior to applying next material or substance.
- C. Apply manufacturer required or recommended substrate primer, sealer, or conditioner prior to applying any new material or substance in contact or bond.

#### **3.03 PREINSTALLATION MEETINGS**

- A. When required in individual specification sections, convene a preinstallation meeting at the site prior to commencing work of the section.
- B. Require attendance of parties directly affecting, or affected by, work of the specific section.
- C. Notify Delaware Engineering and Design Corporation four days in advance of meeting date.
- D. Prepare agenda and preside at meeting:
  - 1. Review conditions of examination, preparation and installation procedures.
  - 2. Review coordination with related work.
- E. Record minutes and distribute copies within two days after meeting to participants, with two copies to Delaware Engineering and Design Corporation, State of Delaware, participants, and those affected by decisions made.

#### **3.04 GENERAL INSTALLATION REQUIREMENTS**

- A. Install products as specified in individual sections, in accordance with manufacturer's instructions and recommendations, and so as to avoid waste due to necessity for replacement.
- B. Make vertical elements plumb and horizontal elements level, unless otherwise indicated.
- C. Install equipment and fittings plumb and level, neatly aligned with adjacent vertical and horizontal lines, unless otherwise indicated.

- D. Make consistent texture on surfaces, with seamless transitions, unless otherwise indicated.
- E. Make neat transitions between different surfaces, maintaining texture and appearance.

### 3.05 ALTERATIONS

- A. Drawings showing existing construction and utilities are based on casual field observation and existing record documents only.
  - 1. Verify that construction and utility arrangements are as shown.
  - 2. Report discrepancies to Delaware Engineering and Design Corporation before disturbing existing installation.
  - 3. Beginning of alterations work constitutes acceptance of existing conditions.
- B. Maintain weatherproof exterior building enclosure except for interruptions required for replacement or modifications; take care to prevent water and humidity damage.
  - 1. Where openings in exterior enclosure exist, provide construction to make exterior enclosure weatherproof.
  - 2. Insulate existing ducts or pipes that are exposed to outdoor ambient temperatures by alterations work.
- C. Remove existing work as indicated and as required to accomplish new work.
  - 1. Remove items indicated on drawings.
  - 2. Relocate items indicated on drawings.
  - 3. Where new surface finishes are to be applied to existing work, perform removals, patch, and prepare existing surfaces as required to receive new finish; remove existing finish if necessary for successful application of new finish.
  - 4. Where new surface finishes are not specified or indicated, patch holes and damaged surfaces to match adjacent finished surfaces as closely as possible.
- D. Services (Including but not limited to HVAC, Plumbing, Fire Protection, Electrical, and Telecommunications): Remove, relocate, and extend existing systems to accommodate new construction.
  - 1. Maintain existing active systems that are to remain in operation; maintain access to equipment and operational components; if necessary, modify installation to allow access or provide access panel.
  - 2. Where existing systems or equipment are not active and Contract Documents require reactivation, put back into operational condition; repair supply, distribution, and equipment as required.
  - 3. Where existing active systems serve occupied facilities but are to be replaced with new services, maintain existing systems in service until new systems are complete and ready for service.
    - a. Disable existing systems only to make switchovers and connections; minimize duration of outages.
    - b. See Section 01 10 00 for other limitations on outages and required notifications.
    - c. Provide temporary connections as required to maintain existing systems in service.
  - 4. Verify that abandoned services serve only abandoned facilities.
  - 5. Remove abandoned pipe, ducts, conduits, and equipment, including those above accessible ceilings; remove back to source of supply where possible, otherwise cap stub and tag with identification; patch holes left by removal using materials specified for new construction.
- E. Protect existing work to remain.
  - 1. Prevent movement of structure; provide shoring and bracing if necessary.
  - 2. Perform cutting to accomplish removals neatly and as specified for cutting new work.
  - 3. Repair adjacent construction and finishes damaged during removal work.
- F. Adapt existing work to fit new work: Make as neat and smooth transition as possible.

- G. Patching: Where the existing surface is not indicated to be refinished, patch to match the surface finish that existed prior to cutting. Where the surface is indicated to be refinished, patch so that the substrate is ready for the new finish.
- H. Refinish existing surfaces as indicated:
  - 1. Where rooms or spaces are indicated to be refinished, refinish all visible existing surfaces to remain to the specified condition for each material, with a neat transition to adjacent finishes.
  - 2. If mechanical or electrical work is exposed accidentally during the work, re-cover and refinish to match.
- I. Clean existing systems and equipment.
- J. Remove demolition debris and abandoned items from alterations areas and dispose of off-site; do not burn or bury.
- K. Do not begin new construction in alterations areas before demolition is complete.
- L. Comply with all other applicable requirements of this section.

### 3.06 CUTTING AND PATCHING

- A. Whenever possible, execute the work by methods that avoid cutting or patching.
- B. See Alterations article above for additional requirements.
- C. Perform whatever cutting and patching is necessary to:
  - 1. Complete the work.
  - 2. Fit products together to integrate with other work.
  - 3. Provide openings for penetration of mechanical, electrical, and other services.
  - 4. Match work that has been cut to adjacent work.
  - 5. Repair areas adjacent to cuts to required condition.
  - 6. Repair new work damaged by subsequent work.
  - 7. Remove samples of installed work for testing when requested.
  - 8. Remove and replace defective and non-conforming work.
- D. Execute work by methods that avoid damage to other work and that will provide appropriate surfaces to receive patching and finishing. In existing work, minimize damage and restore to original condition.
- E. Employ original installer to perform cutting for weather exposed and moisture resistant elements, and sight exposed surfaces.
- F. Cut rigid materials using masonry saw or core drill. Pneumatic tools not allowed without prior approval.
- G. Restore work with new products in accordance with requirements of Contract Documents.
- H. Fit work air tight to pipes, sleeves, ducts, conduit, and other penetrations through surfaces.
- I. At penetrations of fire rated walls, partitions, ceiling, or floor construction, completely seal voids with fire rated material in accordance with Section 07 84 00, to full thickness of the penetrated element.
- J. Patching:
  - 1. Finish patched surfaces to match finish that existed prior to patching. On continuous surfaces, refinish to nearest intersection or natural break. For an assembly, refinish entire unit.
  - 2. Match color, texture, and appearance.

3. Repair patched surfaces that are damaged, lifted, discolored, or showing other imperfections due to patching work. If defects are due to condition of substrate, repair substrate prior to repairing finish.

### **3.07 PROGRESS CLEANING**

- A. Maintain areas free of waste materials, debris, and rubbish. Maintain site in a clean and orderly condition.
- B. Remove debris and rubbish from pipe chases, plenums, attics, crawl spaces, and other closed or remote spaces, prior to enclosing the space.
- C. Broom and vacuum clean interior areas prior to start of surface finishing, and continue cleaning to eliminate dust.
- D. Collect and remove waste materials, debris, and trash/rubbish from site periodically and dispose off-site; do not burn or bury.

### **3.08 PROTECTION OF INSTALLED WORK**

- A. Protect installed work from damage by construction operations.
- B. Provide special protection where specified in individual specification sections.
- C. Provide temporary and removable protection for installed products. Control activity in immediate work area to prevent damage.
- D. Provide protective coverings at walls, projections, jambs, sills, and soffits of openings.
- E. Protect finished floors, stairs, and other surfaces from traffic, dirt, wear, damage, or movement of heavy objects, by protecting with durable sheet materials.
- F. Prohibit traffic or storage upon waterproofed or roofed surfaces. If traffic or activity is necessary, obtain recommendations for protection from waterproofing or roofing material manufacturer.
- G. Remove protective coverings when no longer needed; reuse or recycle plastic coverings if possible.

### **3.09 SYSTEM STARTUP**

- A. Coordinate schedule for start-up of various equipment and systems.
- B. Verify that each piece of equipment or system has been checked for proper lubrication, drive rotation, belt tension, control sequence, and for conditions that may cause damage.
- C. Verify tests, meter readings, and specified electrical characteristics agree with those required by the equipment or system manufacturer.
- D. Verify that wiring and support components for equipment are complete and tested.
- E. Execute start-up under supervision of applicable Contractor personnel and manufacturer's representative in accordance with manufacturers' instructions.
- F. Submit a written report that equipment or system has been properly installed and is functioning correctly.

### **3.10 DEMONSTRATION AND INSTRUCTION**

- A. See Section 01 79 00 - Demonstration and Training.

### **3.11 ADJUSTING**

- A. Adjust operating products and equipment to ensure smooth and unhindered operation.

### **3.12 FINAL CLEANING**

- A. Use cleaning materials that are nonhazardous.
- B. Clean interior and exterior glass, surfaces exposed to view; remove temporary labels, stains and foreign substances, polish transparent and glossy surfaces, vacuum carpeted and soft surfaces.
- C. Remove all labels that are not permanent. Do not paint or otherwise cover fire test labels or nameplates on mechanical and electrical equipment.
- D. Clean equipment and fixtures to a sanitary condition with cleaning materials appropriate to the surface and material being cleaned.
- E. Clean filters of operating equipment.
- F. Clean debris from roofs, gutters, downspouts, and drainage systems.
- G. Clean site; sweep paved areas, rake clean landscaped surfaces.
- H. Remove waste, surplus materials, trash/rubbish, and construction facilities from the site; dispose of in legal manner; do not burn or bury.

### **3.13 CLOSEOUT PROCEDURES**

- A. Make submittals that are required by governing or other authorities.
  - 1. Provide copies to Delaware Engineering and Design Corporation.
- B. Notify Delaware Engineering and Design Corporation when work is considered ready for Substantial Completion.
- C. Submit written certification that Contract Documents have been reviewed, work has been inspected, and that work is complete in accordance with Contract Documents and ready for Delaware Engineering and Design Corporation's review.
- D. Correct items of work listed in executed Certificates of Substantial Completion and comply with requirements for access to State of Delaware-occupied areas.
- E. Notify Delaware Engineering and Design Corporation when work is considered finally complete.
- F. Complete items of work determined by Delaware Engineering and Design Corporation's final inspection.
- G. Closeout documents to include the Consent of Surety to Final Payment, the Release of Liens, and the Affidavit of Payment of Debts and Claims.

### **3.14 MAINTENANCE**

- A. Provide service and maintenance of components indicated in specification sections.
- B. Maintenance Period: As indicated in specification sections or, if not indicated, not less than one year from the Date of Substantial Completion or the length of the specified warranty, whichever is longer.
- C. Examine system components at a frequency consistent with reliable operation. Clean, adjust, and lubricate as required.
- D. Include systematic examination, adjustment, and lubrication of components. Repair or replace parts whenever required. Use parts produced by the manufacturer of the original component.
- E. Maintenance service shall not be assigned or transferred to any agent or subcontractor without prior written consent of the State of Delaware.

**END OF SECTION**

**SECTION 01 74 19**

**CONSTRUCTION WASTE MANAGEMENT**

**PART 1 - GENERAL**

**1.01 SUMMARY**

- A. Section includes: Administrative and procedural requirements for construction waste management activities.

**1.02 DEFINITIONS**

- A. Construction, Demolition, and Land clearing (CDL) Waste: Includes all non-hazardous solid wastes resulting from construction, remodeling, alterations, repair, demolition and land clearing. Includes material that is recycled, reused, salvaged or disposed as garbage.
- B. Salvage: Recovery of materials for on-site reuse, sale or donation to a third party.
- C. Reuse: Making use of a material without altering its form. Materials can be reused on-site or reused on other projects off-site. Examples include, but are not limited to the following: Crushing or grinding of concrete for use as sub-base material. Chipping of land clearing debris for use as mulch.
- D. Recycling: The process of sorting, cleaning, treating, and reconstituting materials for the purpose of using the material in the manufacture of a new product.
- E. Source-Separated CDL Recycling: The process of separating recyclable materials in separate containers as they are generated on the job-site. The separated materials are hauled directly to a recycling facility or transfer station.
- F. Co-mingled CDL Recycling: The process of collecting mixed recyclable materials in one container on-site. The container is taken to a material recovery facility where materials are separated for recycling.
- G. Approved Recycling Facility: Any of the following:
  - 1. A facility that can legally accept CDL waste materials for the purpose of processing thematerials into an altered form for the manufacture of a new product.
  - 2. Material Recovery Facility: A general term used to describe a waste-sorting facility.
    - a. Mechanical, hand-separation, or a combination of both procedures, are used to recover
    - b. recyclable materials.

**1.03 SUBMITTALS**

- A. Contractor shall develop a Waste Management Plan: Submit 3 copies of plan within 14 days of date established for the Notice to Proceed.
- B. Contractor shall provide Waste Management Report: Concurrent with each Application for Payment, submit 3 copies of report.

**1.04 PERFORMANCE REQUIREMENTS**

- A. General: Divert a minimum of 75% CDL waste, by weight, from the landfill by one, or a combination of the following activities:
  - 1. Salvage
  - 2. Reuse
  - 3. Source-Separated CDL Recycling
  - 4. Co-mingled CDL Recycling
- B. CDL waste materials that can be salvaged, reused or recycled include, but are not limited to, the following:

1. Acoustical ceiling tiles
2. Asphalt
3. Asphalt shingles
4. Cardboard packaging
5. Carpet and carpet pad
6. Concrete
7. Drywall
8. Fluorescent lights and ballasts
9. Land clearing debris (vegetation, stumpage, dirt)
10. Metals
11. Paint (through hazardous waste outlets)
12. Wood
13. Plastic film (sheeting, shrink wrap, packaging)
14. Window glass
15. Wood
16. Field office waste, including office paper, aluminum cans, glass, plastic, and office cardboard.

#### **1.05 QUALITY ASSURANCE**

- A. Waste Management Coordinator Qualifications: Experienced firm, with a record of successful waste management coordination of projects with similar requirements, that employs a LEED Accredited Professional, certified by the USGBC as waste management coordinator.
- B. Refrigerant Recovery Technician Qualifications: Certified by EPA-approved certification program.
- C. Regulatory Requirements: Conduct construction waste management activities in accordance with hauling and disposal regulations of all authorities having jurisdiction and all other applicable laws and ordinances.
- D. Preconstruction Conference: Schedule and conduct meeting at Project site prior to construction activities.
  1. Attendees: Inform the following individuals, whose presence is required, of date and time of meeting.
    - a. Owner
    - b. Architect
    - c. Contractor's superintendent
    - d. Major subcontractors
    - e. Waste Management Coordinator
    - f. Other concerned parties.
  2. Agenda Items: Review methods and procedures related to waste management including, but not limited to, the following:
    - a. Review and discuss waste management plan including responsibilities of Waste Management Coordinator.
    - b. Review requirements for documenting quantities of each type of waste and its disposition.
    - c. Review and finalize procedures for materials separation and verify availability of containers and bins needed to avoid delays.
    - d. Review procedures for periodic waste collection and transportation to recycling and disposal facilities.
    - e. Review waste management requirements for each trade.
  3. Minutes: Record discussion. Distribute meeting minutes to all participants.  
Note: If there is a Project Architect, they will perform this role.

#### **1.06 WASTE MANAGEMENT PLAN - Contactor shall develop and document the following:**

- A. Develop a plan to meet the requirements listed in this section at a minimum. Plan shall consist of waste identification, waste reduction plan and cost/revenue analysis. Distinguish between demolition and construction waste. Indicate quantities by weight throughout the plan.
- B. Indicate anticipated types and quantities of demolition, site-cleaning and construction waste generated by the project. List all assumptions made for the quantities estimates.
- C. List each type of waste and whether it will be salvaged, recycled, or disposed of in an landfill. The plan should included the following information:
  1. Types and estimated quantities, by weight, of CDL waste expected to be generated during demolition and construction.
  2. Proposed methods for CDL waste salvage, reuse, recycling and disposal during demolition including, but not limited to, one or more of the following:
    - a. Contracting with a deconstruction specialist to salvage materials generated,
    - b. Selective salvage as part of demolition contractor's work,
    - c. Reuse of materials on-site or sale or donation to a third party.
  3. Proposed methods for salvage, reuse, recycling and disposal during construction including, but not limited to, one or more of the following:
    - a. Requiring subcontractors to take their CDL waste to a recycling facility;
    - b. Contracting with a recycling hauler to haul recyclable CDL waste to an approved recycling or material recovery facility;
    - c. Processing and reusing materials on-site;
    - d. Self-hauling to a recycling or material recovery facility.
  4. Name of recycling or material recovery facility receiving the CDL wastes.
  5. Handling and Transportation Procedures: Include method that will be used for separating recyclable waste including sizes of containers, container labeling, and designated location on project site where materials separation will be located.
- D. Cost/Revenue Analysis: Indicate total cost of waste disposal as if there was no waste management plan and net additional cost or net savings resulting from implementing waste management plan. Include the following:
  1. Total quantity of waste.
  2. Estimated cost of disposal (cost per unit). Include hauling and tipping fees and cost of collection containers for each type of waste.
  3. Total cost of disposal (with no waste management).
  4. Revenue from salvaged materials.
  5. Revenue from recycled materials.
  6. Savings in hauling and tipping fees by donating materials.
  7. Savings in hauling and tipping fees that are avoided.
  8. Handling and transportation costs. Including cost of collection containers for each type of waste.
  9. Net additional cost or net savings from waste management plan.

## **PART 2 - PRODUCTS (NOT USED)**

## **PART 3 - EXECUTION**

### **3.01 CONSTRUCTION WASTE MANAGEMENT, GENERAL**

- A. Provide containers for CDL waste that is to be recycled clearly labeled as such with a list of acceptable and unacceptable materials. The list of acceptable materials must be the same as the materials recycled at the receiving material recovery facility or recycling processor.
- B. The collection containers for recyclable CDL waste must contain no more than 10% non-recyclable material, by volume.
- C. Provide containers for CDL waste that is disposed in a landfill clearly labeled as such.

- D. Use detailed material estimates to reduce risk of unplanned and potentially wasteful cuts.
- E. To the greatest extent possible, include in material purchasing agreements a waste reduction provision requesting that materials and equipment be delivered in packaging made of recyclable material, that they reduce the amount of packaging, that packaging be taken back for reuse or recycling, and to take back all unused product. Insure that subcontractors require the same provisions in their purchase agreements.
- F. Conduct regular visual inspections of dumpsters and recycling bins to remove contaminants.

### **3.02 SOURCE SEPARATION**

- A. General: Contractor shall separate recyclable materials from CDL waste to the maximum extent possible.

Separate recyclable materials by type.

1. Provide containers, clearly labeled, by type of separated materials or provide other storage method for managing recyclable materials until they are removed from Project site.
2. Stockpile processed materials on-site without intermixing with other materials. Place, grade, and shape stockpiles to drain surface water and to minimize pest attraction. Cover to prevent windblown dust.
3. Stockpile materials away from demolition area. Do not store within drip line of remaining trees.
4. Store components off the ground and protect from weather.

### **3.03 CO-MINGLED RECYCLING**

- A. General: Do not put CDL waste that will be disposed in a landfill into a co-mingled CDL waste recycling container.

### **3.04 REMOVAL OF CONSTRUCTION WASTE MATERIALS**

- A. Remove CDL waste materials from project site on a regular basis. Do not allow CDL waste to accumulate on-site.
- B. Transport CDL waste materials off Owner's property and legally dispose of them.
- C. Burning of CDL waste is not permitted.

**WASTE MANAGEMENT PROGRESS REPORT**

MATERIAL CATEGORY	DISPOSED IN MUNICIPAL SOLID WASTE LANDFILL	DIVERTED FROM LANDFILL BY	DIVERTED FROM LANDFILL BY	DIVERTED FROM LANDFILL BY
		RECYCLED	SALVAGED	REUSED
ACOUSTICAL CEILING TILES				
ASPHALT				
ASPHALT SHINGLES				
CARDBOARD PACKAGING				
CARPET AND CARPET PAD				
CONCRETE				
DRYWALL				
FLUORESCENT LIGHTS AND BALLASTS				
LAND CLEARING DEBRIS (VEGETATION, STUMPAGE, DIRT)				
METALS				
PAINT (THROUGH HAZARDOUS WASTE OUTLETS)				
WOOD				
PLASTIC FILM (SHEETING, SHRINK WRAP, PACKAGING)				
WINDOW GLASS				
FIELD OFFICE WASTE (OFFICE PAPER, ALUMINUM CANS, GLASS, PLASTIC, AND COFFEE CARDBOARD)				
OTHER (INSERT DESCRIPTION)				
OTHER (INSERT DESCRIPTION)				
<b>TOTAL (IN WEIGHT)</b>				

Not For Bidding Purposes

**PERCENTAGE OF WASTE DIVERTED.**

**(TOTAL WASTE DIVIDED BY TOTAL DIVERTED) \_\_\_\_\_**

**END OF SECTION**

**SECTION 01 78 00**

**CLOSEOUT SUBMITTALS**

**PART 1 GENERAL**

**1.01 SECTION INCLUDES**

- A. Project Record Documents.
- B. Operation and Maintenance Data.
- C. Warranties and bonds.

**1.02 RELATED REQUIREMENTS**

- A. Division 00 Documents
- B. Section 01 30 00 - Administrative Requirements: Submittals procedures, shop drawings, product data, and samples.
- C. Section 01 70 00 - Execution and Closeout Requirements: Contract closeout procedures.
- D. Individual Product Sections: Specific requirements for operation and maintenance data.
- E. Individual Product Sections: Warranties required for specific products or Work.

**1.03 SUBMITTALS**

- A. Project Record Documents: Submit documents to Delaware Engineering and Design Corporation prior to final payment application.
- B. Operation and Maintenance Data:
  - 1. For equipment, or component parts of equipment put into service during construction and operated by State of Delaware, submit completed documents within ten days after acceptance.
  - 2. Submit one copy of completed documents 15 days prior to final inspection. This copy will be reviewed and returned after final inspection, with Delaware Engineering and Design Corporation comments. Revise content of all document sets as required prior to final submission.
  - 3. Submit two sets of revised final documents in final form within 10 days after final inspection.
- C. Warranties and Bonds:
  - 1. For equipment or component parts of equipment put into service during construction with State of Delaware's permission, submit documents within 10 days after acceptance.
  - 2. Make other submittals within 10 days after Date of Substantial Completion, prior to final Application for Payment.
  - 3. For items of Work for which acceptance is delayed beyond Date of Substantial Completion, submit within 10 days after acceptance, listing the date of acceptance as the beginning of the warranty period.

**PART 2 PRODUCTS - NOT USED**

**PART 3 EXECUTION**

**3.01 PROJECT RECORD DOCUMENTS**

- A. Maintain on site one set of the following record documents; record actual revisions to the Work:
  - 1. Drawings.
  - 2. Addenda.
  - 3. Change Orders and other modifications to the Contract.

4. Manufacturer's instruction for assembly, installation, and adjusting.
- B. Ensure entries are complete and accurate, enabling future reference by State of Delaware.
- C. Closeout documents at the end of the project to include the Consent of Surety to Final Payment, the Release of Liens, and the Affidavit of Payment of Debts and Claims
- D. Store record documents separate from documents used for construction.
- E. Record information concurrent with construction progress.
- F. Record Drawings: Legibly mark each item to record actual construction including:
  1. Field changes of dimension and detail.
  2. Details not on original Contract drawings.

### **3.02 OPERATION AND MAINTENANCE DATA**

- A. For Each Product or System: List names, addresses and telephone numbers of Subcontractors and suppliers, including local source of supplies and replacement parts.
- B. Product Data: Mark each sheet to clearly identify specific products and component parts, and data applicable to installation. Delete inapplicable information.
- C. Drawings: Supplement product data to illustrate relations of component parts of equipment and systems, to show control and flow diagrams. Do not use Project Record Documents as maintenance drawings.
- D. Typed Text: As required to supplement product data. Provide logical sequence of instructions for each procedure, incorporating manufacturer's instructions.

### **3.03 OPERATION AND MAINTENANCE DATA FOR EQUIPMENT AND SYSTEMS**

- A. For Each Item of Equipment and Each System:
  1. Description of unit or system, and component parts.
  2. Identify function, normal operating characteristics, and limiting conditions.
  3. Include performance curves, with engineering data and tests.
  4. Complete nomenclature and model number of replaceable parts.
- B. Operating Procedures: Include start-up, break-in, and routine normal operating instructions and sequences. Include regulation, control, stopping, shut-down, and emergency instructions. Include summer, winter, and any special operating instructions.
- C. Maintenance Requirements: Include routine procedures and guide for preventative maintenance and trouble shooting; disassembly, repair, and reassembly instructions; and alignment, adjusting, balancing, and checking instructions.
- D. Provide servicing and lubrication schedule, and list of lubricants required.
- E. Include manufacturer's printed operation and maintenance instructions.
- F. Include sequence of operation by controls manufacturer.
- G. Provide original manufacturer's parts list, illustrations, assembly drawings, and diagrams required for maintenance.
- H. Provide charts of valve tag numbers, with location and function of each valve, keyed to flow and control diagrams.
- I. Additional Requirements: As specified in individual product specification sections.

### **3.04 WARRANTIES AND BONDS**

State of Delaware  
Supreme Court Building - Basement Level Sprinkler System  
OMB/DFM Project # MC1002000170

- A. Obtain warranties and bonds, executed in duplicate by responsible Subcontractors, suppliers, and manufacturers, within 10 days after completion of the applicable item of work. Except for items put into use with State of Delaware's permission, leave date of beginning of time of warranty until the Date of Substantial completion is determined.
- B. Verify that documents are in proper form, contain full information, and are notarized.
- C. Co-execute submittals when required.
- D. Retain warranties and bonds until time specified for submittal.

**END OF SECTION**

Not For Bidding Purposes

**SECTION 01 79 00**

**DEMONSTRATION AND TRAINING**

**PART 1 GENERAL**

**1.01 SUMMARY**

- A. Demonstration of products and systems to be commissioned and where indicated in specific specification sections.
- B. Training of State of Delaware personnel in operation and maintenance is required for:
  - 1. All software-operated systems.
  - 2. HVAC systems and equipment.
  - 3. Plumbing equipment.
  - 4. Electrical systems and equipment.
  - 5. Items specified in individual product Sections.
- C. Training of State of Delaware personnel in care, cleaning, maintenance, and repair is required for:
  - 1. Items specified in individual product Sections.

**1.02 RELATED REQUIREMENTS**

- A. Section 01 78 00 - Closeout Submittals: Operation and maintenance manuals.
- B. Section 01 91 13 - General Commissioning Requirements: Additional requirements applicable to demonstration and training.

**1.03 SUBMITTALS**

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures; except:
  - 1. Make all submittals specified in this section, and elsewhere where indicated for commissioning purposes, directly to the Commissioning Authority.
  - 2. Submit one copy to the Commissioning Authority, not to be returned.
  - 3. Make commissioning submittals on time schedule specified by Commissioning Authority.
  - 4. Submittals indicated as "Draft" are intended for the use of the Commissioning Authority in preparation of overall Training Plan; submit in editable electronic format, Microsoft Word 2003 preferred.
- B. Draft Training Plans: State of Delaware will designate personnel to be trained; tailor training to needs and skill-level of attendees.
  - 1. Submit to Delaware Engineering and Design Corporation for transmittal to State of Delaware.
  - 2. Submit to Commissioning Authority for review and inclusion in overall training plan.
  - 3. Submit not less than four weeks prior to start of training.
  - 4. Revise and resubmit until acceptable.
  - 5. Provide an overall schedule showing all training sessions.
  - 6. Include at least the following for each training session:
    - a. Identification, date, time, and duration.
    - b. Description of products and/or systems to be covered.
    - c. Name of firm and person conducting training; include qualifications.
    - d. Intended audience, such as job description.
    - e. Objectives of training and suggested methods of ensuring adequate training.
    - f. Methods to be used, such as classroom lecture, live demonstrations, hands-on, etc.
    - g. Media to be used, such as slides, hand-outs, etc.
    - h. Training equipment required, such as projector, projection screen, etc., to be provided by Contractor.

- C. Training Manuals: Provide training manual for each attendee; allow for minimum of two attendees per training session.
  - 1. Include applicable portion of O&M manuals.
  - 2. Include copies of all hand-outs, slides, overheads, video presentations, etc., that are not included in O&M manuals.
  - 3. Provide one extra copy of each training manual to be included with operation and maintenance data.
- D. Training Reports:
  - 1. Identification of each training session, date, time, and duration.
  - 2. Sign-in sheet showing names and job titles of attendees.
  - 3. List of attendee questions and written answers given, including copies of and references to supporting documentation required for clarification; include answers to questions that could not be answered in original training session.
  - 4. Include Commissioning Authority's formal acceptance of training session.
- E. Video Recordings: Submit digital video recording of each demonstration and training session for State of Delaware's subsequent use.
  - 1. Format: DVD Disc.
  - 2. Label each disc and container with session identification and date.

#### **1.04 QUALITY ASSURANCE**

- A. Instructor Qualifications: Familiar with design, operation, maintenance and troubleshooting of the relevant products and systems.
  - 1. Provide as instructors the most qualified trainer of those contractors and/or installers who actually supplied and installed the systems and equipment.
  - 2. Where a single person is not familiar with all aspects, provide specialists with necessary qualifications.

#### **PART 2 PRODUCTS - NOT USED**

#### **PART 3 EXECUTION**

##### **3.01 DEMONSTRATION - GENERAL**

- A. Demonstrations conducted during system start-up do not qualify as demonstrations for the purposes of this section, unless approved in advance by State of Delaware.
- B. Demonstrations conducted during Functional Testing need not be repeated unless State of Delaware personnel training is specified.
- C. Demonstration may be combined with State of Delaware personnel training if applicable.
- D. Operating Equipment and Systems: Demonstrate operation in all modes, including start-up, shut-down, seasonal changeover, emergency conditions, and troubleshooting, and maintenance procedures, including scheduled and preventive maintenance.
  - 1. Perform demonstrations not less than two weeks prior to Substantial Completion.
  - 2. For equipment or systems requiring seasonal operation, perform demonstration for other season within six months.
- E. Non-Operating Products: Demonstrate cleaning, scheduled and preventive maintenance, and repair procedures.
  - 1. Perform demonstrations not less than two weeks prior to Substantial Completion.

##### **3.02 TRAINING - GENERAL**

- A. Commissioning Authority will prepare the Training Plan based on draft plans submitted.
- B. Conduct training on-site unless otherwise indicated.

- C. State of Delaware will provide classroom and seating at no cost to Contractor.
- D. Do not start training until Functional Testing is complete, unless otherwise specified or approved by the Commissioning Authority.
- E. Provide training in minimum two hour segments.
- F. The Commissioning Authority is responsible for determining that the training was satisfactorily completed and will provide approval forms.
- G. Training schedule will be subject to availability of State of Delaware's personnel to be trained; re-schedule training sessions as required by State of Delaware; once schedule has been approved by State of Delaware failure to conduct sessions according to schedule will be cause for State of Delaware to charge Contractor for personnel "show-up" time.
- H. Review of Facility Policy on Operation and Maintenance Data: During training discuss:
  - 1. The location of the O&M manuals and procedures for use and preservation; backup copies.
  - 2. Typical contents and organization of all manuals, including explanatory information, system narratives, and product specific information.
  - 3. Typical uses of the O&M manuals.
- I. Product- and System-Specific Training:
  - 1. Review the applicable O&M manuals.
  - 2. For systems, provide an overview of system operation, design parameters and constraints, and operational strategies.
  - 3. Review instructions for proper operation in all modes, including start-up, shut-down, seasonal changeover and emergency procedures, and for maintenance, including preventative maintenance.
  - 4. Provide hands-on training on all operational modes possible and preventive maintenance.
  - 5. Emphasize safe and proper operating requirements; discuss relevant health and safety issues and emergency procedures.
  - 6. Discuss common troubleshooting problems and solutions.
  - 7. Discuss any peculiarities of equipment installation or operation.
  - 8. Discuss warranties and guarantees, including procedures necessary to avoid voiding coverage.
  - 9. Review recommended tools and spare parts inventory suggestions of manufacturers.
  - 10. Review spare parts and tools required to be furnished by Contractor.
  - 11. Review spare parts suppliers and sources and procurement procedures.
- J. Be prepared to answer questions raised by training attendees; if unable to answer during training session, provide written response within three days.

**END OF SECTION**

**SECTION 01 91 13**

**GENERAL COMMISSIONING REQUIREMENTS**

**PART 1 GENERAL**

**1.01 SUMMARY**

- A. Commissioning is intended to achieve the following specific objectives; this section specifies the Contractor's responsibilities for commissioning:
  - 1. Verify that the work is installed in accordance with the Contract Documents, the manufacturer's recommendations and instructions, and that it receives adequate operational checkout prior to startup: Startup reports are utilized to achieve this.
  - 2. Verify and document that functional performance is in accordance with the Contract Documents: Functional Tests such as manufacturers startup reports, balancing, and site demonstrations executed by the contractor and witnessed by the Commissioning Authority are utilized to achieve this.
  - 3. Verify that operation and maintenance manuals submitted to State of Delaware are complete: Detailed operation and maintenance (O&M) data submittals by Contractor are utilized to achieve this.
  - 4. Verify that the State of Delaware's operating personnel are adequately trained: Formal training conducted by Contractor is utilized to achieve this.
- B. The Commissioning Authority is the State of Delaware

**1.02 SCOPE OF COMMISSIONING**

- A. The following are to be commissioned:
- B. Other equipment and systems explicitly identified elsewhere in Contract Documents as requiring commissioning.

**1.03 RELATED REQUIREMENTS**

- A. Section 01 70 00 - Execution and Closeout Requirements: General startup requirements.
- B. Section 01 78 00 - Closeout Submittals: Scope and procedures for operation and maintenance manuals and project record documents.
- C. Section 01 79 00 - Demonstration and Training: Scope and procedures for State of Delaware personnel training.
- D. Section 23 08 00 - Commissioning of HVAC: HVAC control system testing; other requirements.
- E. Section 23 09 59 - BAS System Commissioning

**1.04 SUBMITTALS**

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures, General Requirements:
- B. Make all submittals specified in this section, and elsewhere where indicated for commissioning purposes, directly to the Commissioning Authority, unless they require review by Delaware Engineering and Design Corporation; in that case, submit to Delaware Engineering and Design Corporation first.
- C. Manufacturers' Instructions: Submit copies of all manufacturer-provided instructions that are shipped with the equipment as soon as the equipment is delivered.
- D. Product Data: If submittals to Delaware Engineering and Design Corporation do not include the following, submit copies as soon as possible:

- E. Product Data: Submit to Delaware Engineering and Design Corporation:
  - 1. Manufacturer's product data, cut sheets, and shop drawings.
  - 2. Manufacturer's installation instructions.
  - 3. Startup, operating, and troubleshooting procedures.
  - 4. Fan and pump curves.
  - 5. Factory test reports.
  - 6. Warranty information, including details of State of Delaware's responsibilities in regard to keeping warranties in force.
- F. Startup Plans and Reports.

## **PART 2 PRODUCTS**

### **2.01 TEST EQUIPMENT**

- A. Provide all standard testing equipment required to perform startup and initial checkout and required Functional Testing; unless otherwise noted such testing equipment will NOT become the property of State of Delaware.
- B. Calibration Tolerances: Provide testing equipment of sufficient quality and accuracy to test and/or measure system performance with the tolerances specified. If not otherwise noted, the following minimum requirements apply:
  - 1. Temperature Sensors and Digital Thermometers: Certified calibration within past year to accuracy of 0.5 degree F and resolution of plus/minus 0.1 degree F.
  - 2. Pressure Sensors: Accuracy of plus/minus 2.0 percent of the value range being measured (not full range of meter), calibrated within the last year.
  - 3. Calibration: According to the manufacturer's recommended intervals and when dropped or damaged; affix calibration tags or keep certificates readily available for inspection.
- C. Equipment-Specific Tools: Where special testing equipment, tools and instruments are specific to a piece of equipment, are only available from the vendor, and are required in order to accomplish startup or Functional Testing, provide such equipment, tools, and instruments as part of the work at no extra cost to State of Delaware; such equipment, tools, and instruments are to become the property of State of Delaware.

## **PART 3 EXECUTION**

### **3.01 STARTUP PLANS AND REPORTS**

- A. Startup Plans: For each item of equipment and system for which the manufacturer provides a startup plan, submit the plan not less than 2 weeks prior to startup.
- B. Startup Reports: For each item of equipment and system for which the manufacturer provides a startup checklist (or startup plan or field checkout sheet), document compliance by submitting the completed startup checklist prior to startup, signed and dated by responsible entity.
- C. Submit directly to the Commissioning Authority and Delaware Engineering and Design Corporation.

### **3.02 FUNCTIONAL TESTS**

- A. A Functional Test is required for each item of equipment, system, or other assembly specified to be commissioned, unless sampling of multiple identical or near-identical units is allowed by the final test procedures.
- B. Commissioning Authority is responsible for witnessing results of Functional Tests.
- C. Contractor is responsible for correction of deficiencies and re-testing at no extra cost to State of Delaware; if a deficiency is not corrected and re-tested immediately, the Commissioning Authority will document the deficiency and the Contractor's stated intentions regarding correction.

1. Deficiencies are any condition in the installation or function of a component, piece of equipment or system that is not in compliance with the Contract Documents or does not perform properly.
  2. When the deficiency has been corrected, the Contractor completes the form certifying that the item is ready to be re-tested and returns the form to the Commissioning Authority; the Commissioning Authority will reschedule the test and the Contractor shall re-test.
  3. Identical or Near-Identical Items: If 10 percent, or three, whichever is greater, of identical or near-identical items fail to perform due to material or manufacturing defect, all items will be considered defective; provide a proposal for correction within 2 weeks after notification of defect, including provision for testing sample installations prior to replacement of all items.
  4. Contractor shall bear the cost of State of Delaware and Commissioning Authority personnel time witnessing re-testing.
- D. Functional Test Procedures:
1. Some test procedures are included in the Contract Documents; where Functional Test procedures are not included in the Contract Documents, test procedures will be determined by the Commissioning Authority with input by and coordination with Contractor.
  2. Examples of Functional Testing:
    - a. Test the dynamic function and operation of equipment and systems (rather than just components) using manual (direct observation) or monitoring methods under full operation (e.g., the chiller pump is tested interactively with the chiller functions to see if the pump ramps up and down to maintain the differential pressure setpoint).
    - b. Systems are tested under various modes, such as during low cooling or heating loads, high loads, component failures, unoccupied, varying outside air temperatures, fire alarm, power failure, etc.
    - c. Systems are run through all the HVAC control system's sequences of operation and components are verified to be responding as the sequence's state.
    - d. Traditional air or water test and balancing (TAB) is not Functional Testing; spot checking of TAB by demonstration to the Commissioning Authority is Functional Testing.
- E. Deferred Functional Tests: Some tests may need to be performed later, after substantial completion, due to partial occupancy, equipment, seasonal requirements, design or other site conditions; performance of these tests remains the Contractor's responsibility regardless of timing.

### **3.03 TEST PROCEDURES - GENERAL**

- A. Provide skilled technicians to execute starting of equipment and to execute the Functional Tests. Ensure that they are available and present during the agreed upon schedules and for sufficient duration to complete the necessary tests, adjustments and problem-solving.
- B. Provide all necessary materials and system modifications required to produce the flows, pressures, temperatures, and conditions necessary to execute the test according to the specified conditions. At completion of the test, return all affected equipment and systems to their pre-test condition.
- C. Refer to section 21 13 00 Fire Suppression Sprinkler Systems for more detail of testing required on the new sprinkler system.

### **3.04 OPERATION AND MAINTENANCE MANUALS**

- A. See Section 01 78 00 for additional requirements.
- B. Add design intent documentation furnished by Delaware Engineering and Design Corporation to manuals prior to submission to State of Delaware.

**END OF SECTION**

Not For Bidding Purposes

**SECTION 07 84 00**

**FIRESTOPPING**

**PART 1 GENERAL**

**1.01 SECTION INCLUDES**

- A. Firestopping systems.
- B. Firestopping of all joints and penetrations in fire-resistance rated and smoke-resistant assemblies, whether indicated on drawings or not, and other openings indicated.

**1.02 RELATED REQUIREMENTS**

- A. Section 01 70 00 - Execution and Closeout Requirements: Cutting and patching.

**1.03 REFERENCE STANDARDS**

- A. ASTM E814 - Standard Test Method for Fire Tests of Through-Penetration Fire Stops; 2011a.
- B. ITS (DIR) - Directory of Listed Products; Intertek Testing Services NA, Inc.; current edition.
- C. FM 4991 - Approval of Firestop Contractors; Factory Mutual Research Corporation; 2001.
- D. FM P7825 - Approval Guide; Factory Mutual Research Corporation; current edition.
- E. SCAQMD 1168 - South Coast Air Quality Management District Rule No.1168; current edition; [www.aqmd.gov](http://www.aqmd.gov).
- F. UL (FRD) - Fire Resistance Directory; Underwriters Laboratories Inc.; current edition.

**1.04 SUBMITTALS**

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Schedule of Firestopping: List each type of penetration, fire rating of the penetrated assembly, and firestopping test or design number.
- C. Product Data: Provide data on product characteristics, performance ratings, and limitations.

**1.05 QUALITY ASSURANCE**

- A. Fire Testing: Provide firestopping assemblies of designs that provide the scheduled fire ratings when tested in accordance with methods indicated.
  - 1. Listing in the current-year classification or certification books of UL, FM, or ITS (Warnock Hersey) will be considered as constituting an acceptable test report.
  - 2. Valid evaluation report published by ICC Evaluation Service, Inc. (ICC-ES) at [www.icc-es.org](http://www.icc-es.org) will be considered as constituting an acceptable test report.
- B. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum three years documented experience.
- C. Installer Qualifications: Company specializing in performing the work of this section and:
  - 1. Approved by Factory Mutual Research under FM Standard 4991, Approval of Firestop Contractors, or meeting any two of the following requirements:.
  - 2. With minimum 3 years documented experience installing work of this type.
  - 3. Able to show at least 5 satisfactorily completed projects of comparable size and type.
  - 4. Licensed by authority having jurisdiction.

**PART 2 PRODUCTS**

**2.01 FIRESTOPPING - GENERAL REQUIREMENTS**

- A. Primers, Sleeves, Forms, Insulation, Packing, Stuffing, and Accessories: Type required for tested assembly design.

## 2.02 FIRESTOPPING SYSTEMS

- A. Firestopping: Any material meeting requirements.
1. Fire Ratings: Use any system listed by UL or tested in accordance with ASTM E814 that has F Rating equal to fire rating of penetrated assembly and minimum T Rating Equal to F Rating and that meets all other specified requirements.

## 2.03 MATERIALS

- A. Firestopping Sealants: Provide only products having lower volatile organic compound (VOC) content than required by South Coast Air Quality Management District Rule No.1168.
- B. Elastomeric Silicone Firestopping: Single component silicone elastomeric compound and compatible silicone sealant; conforming to the following:
1. Color: Black, dark gray, or red.
  2. Manufacturers:
    - a. A/D Fire Protection Systems Inc: [www.adfire.com](http://www.adfire.com).
    - b. 3M Fire Protection Products: [www.3m.com/firestop](http://www.3m.com/firestop).
    - c. Hilti, Inc: [www.us.hilti.com](http://www.us.hilti.com).
    - d. Specified Technologies, Inc: [www.stifirestop.com](http://www.stifirestop.com).
    - e. Substitutions: See Section 01 60 00 - Product Requirements.
- C. Foam Firestopping: Single component silicone foam compound; conforming to the following:
1. Durability and Longevity: Permanent.
  2. Color: Dark grey.
  3. Manufacturers:
    - a. 3M Fire Protection Products: [www.3m.com/firestop](http://www.3m.com/firestop).
    - b. Hilti, Inc: [www.us.hilti.com](http://www.us.hilti.com).
    - c. Specified Technologies, Inc: [www.stifirestop.com](http://www.stifirestop.com).
    - d. Substitutions: See Section 01 60 00 - Product Requirements.
- D. Fibered Compound Firestopping: Formulated compound mixed with incombustible non-asbestos fibers; conforming to the following:
1. Durability and Longevity: Permanent.
  2. Color: Dark grey.
  3. Manufacturers:
    - a. A/D Fire Protection Systems Inc: [www.adfire.com](http://www.adfire.com).
    - b. USG: [www.usg.com](http://www.usg.com).
    - c. Substitutions: See Section 01 60 00 - Product Requirements.
- E. Fiber Firestopping: Mineral fiber insulation used in conjunction with elastomeric surface sealer forming airtight bond to opening; conforming to the following:
1. Durability and Longevity: Permanent.
  2. Manufacturers:
    - a. A/D Fire Protection Systems Inc: [www.adfire.com](http://www.adfire.com).
    - b. Pecora Corporation: [www.pecora.com](http://www.pecora.com).
    - c. Thermafiber, Inc: [www.thermafiber.com](http://www.thermafiber.com).
    - d. Substitutions: See Section 01 60 00 - Product Requirements.
- F. Firestop Devices - Wrap Type: Mechanical device with incombustible filler and sheet stainless steel jacket, intended to be installed after penetrating item has been installed; conforming to the following:
1. Manufacturers:
    - a. Grace Construction Products: [www.na.graceconstruction.com](http://www.na.graceconstruction.com).

State of Delaware  
Supreme Court Building - Basement Level Sprinkler System  
OMB/DFM Project # MC1002000170

- b. 3M Fire Protection Products: [www.3m.com/firestop](http://www.3m.com/firestop).
  - c. Hilti, Inc: [www.us.hilti.com](http://www.us.hilti.com).
  - d. Specified Technologies, Inc: [www.stifirestop.com](http://www.stifirestop.com).
  - e. Substitutions: See Section 01 60 00 - Product Requirements.
- G. Intumescent Putty: Compound that expands on exposure to surface heat gain; conforming to the following:
- 1. Potential Expansion: Minimum 1000 percent.
  - 2. Durability and Longevity: Permanent.
  - 3. Color: Black, dark gray, or red.
  - 4. Manufacturers:
    - a. Grace Construction Products; Product yuoiyoutiot: [www.na.graceconstruction.com](http://www.na.graceconstruction.com).
    - b. 3M Fire Protection Products: [www.3m.com/firestop](http://www.3m.com/firestop).
    - c. Hilti, Inc: [www.us.hilti.com](http://www.us.hilti.com).
    - d. Specified Technologies, Inc: [www.stifirestop.com](http://www.stifirestop.com).
    - e. Substitutions: See Section 01 60 00 - Product Requirements.
- H. Primers, Sleeves, Forms, Insulation, Packing, Stuffing, and Accessories. Type required for tested assembly design.

**END OF SECTION**

Not For Bidding Purposes

**SECTION 26 05 19**

**LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES**

**PART 1 GENERAL**

**1.01 SECTION INCLUDES**

- A. Single conductor building wire.
- B. Wire and cable for 600 volts and less.
- C. Wiring connectors.
- D. Electrical tape.
- E. Heat shrink tubing.
- F. Oxide inhibiting compound.
- G. Wire pulling lubricant.

**1.02 RELATED REQUIREMENTS**

- A. Section 07 84 00 - Firestopping.
- B. Section 26 05 26 - Grounding and Bonding for Electrical Systems: Additional requirements for grounding conductors and grounding connectors.
- C. Section 26 05 53 - Identification for Electrical Systems: Identification products and requirements.

**1.03 REFERENCE STANDARDS**

- A. ASTM B3 - Standard Specification for Soft or Annealed Copper Wire; 2001 (Reapproved 2007).
- B. ASTM B8 - Standard Specification for Concentric-Lay-Stranded Copper Conductors, Hard, Medium-Hard, or Soft; 2011.
- C. ASTM B33 - Standard Specification for Tin-Coated Soft or Annealed Copper Wire for Electrical Purposes; 2010.
- D. ASTM B787/B787M - Standard Specification for 19 Wire Combination Unilay-Stranded Copper Conductors for Subsequent Insulation; 2004 (Reapproved 2009).
- E. ASTM B801 - Standard Specification for Concentric-Lay-Stranded Conductors of 8000 Series Aluminum Alloy Wire for Subsequent Covering of Insulation; 2007.
- F. ASTM D3005 - Standard Specification for Low-Temperature Resistant Vinyl Chloride Plastic Pressure-Sensitive Electrical Insulating Tape; 2010.
- G. ASTM D4388 - Standard Specification for Nonmetallic Semi-Conducting and Electrically Insulating Rubber Tapes; 2008.
- H. NECA 1 - Standard for Good Workmanship in Electrical Construction; National Electrical Contractors Association; 2010.
- I. NECA 104 - Recommended Practice for Installing Aluminum Building Wire and Cable; National Electrical Contractors Association; 2006 (NECA/AA 104).
- J. NEMA WC 70 - Power Cables Rated 2000 Volts or Less for the Distribution of Electrical Energy; National Electrical Manufacturers Association; 2009 (ANSI/NEMA WC 70/ICEA S-95-658).

- K. NETA STD ATS - Acceptance Testing Specifications for Electrical Power Distribution Equipment and Systems; International Electrical Testing Association; 2009.
- L. NFPA 70 - National Electrical Code; National Fire Protection Association; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- M. UL 44 - Thermoset-Insulated Wires and Cables; Current Edition, Including All Revisions.
- N. UL 83 - Thermoplastic-Insulated Wires and Cables; Current Edition, Including All Revisions.
- O. UL 486A-486B - Wire Connectors; Current Edition, Including All Revisions.
- P. UL 486C - Splicing Wire Connectors; Current Edition, Including All Revisions.
- Q. UL 486D - Sealed Wire Connector Systems; Current Edition, Including All Revisions.
- R. UL 510 - Polyvinyl Chloride, Polyethylene, and Rubber Insulating Tape; Current Edition, Including All Revisions.

#### **1.04 ADMINISTRATIVE REQUIREMENTS**

- A. Coordination:
  - 1. Coordinate sizes of raceways, boxes, and equipment enclosures installed under other sections with the actual conductors to be installed, including adjustments for conductor sizes increased for voltage drop.
  - 2. Coordinate with electrical equipment installed under other sections to provide terminations suitable for use with the conductors to be installed.
  - 3. Notify Delaware Engineering and Design Corporation of any conflicts with or deviations from the contract documents. Obtain direction before proceeding with work.

#### **1.05 SUBMITTALS**

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide manufacturer's standard catalog pages and data sheets for conductors and cables, including detailed information on materials, construction, ratings, listings, and available sizes, configurations, and stranding.
- C. Project Record Documents: Record actual installed circuiting arrangements. Record actual routing for underground circuits.

#### **1.06 QUALITY ASSURANCE**

- A. Conform to requirements of NFPA 70.
- B. Maintain at the project site a copy of each referenced document that prescribes execution requirements.
- C. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum three years documented experience.

#### **1.07 DELIVERY, STORAGE, AND HANDLING**

- A. Receive, inspect, handle, and store conductors and cables in accordance with manufacturer's instructions.

### **1.08 FIELD CONDITIONS**

- A. Do not install or otherwise handle thermoplastic-insulated conductors at temperatures lower than 14 degrees F, unless otherwise permitted by manufacturer's instructions. When installation below this temperature is unavoidable, notify Delaware Engineering and Design Corporation and obtain direction before proceeding with work.

## **PART 2 PRODUCTS**

### **2.01 CONDUCTOR AND CABLE APPLICATIONS**

- A. Do not use conductors and cables for applications other than as permitted by NFPA 70 and product listing.
- B. Provide single conductor building wire installed in suitable raceway unless otherwise indicated, permitted, or required.
- C. Nonmetallic-sheathed cable is not permitted.
- D. Underground feeder and branch-circuit cable is not permitted.
- E. Service entrance cable is not permitted.
- F. Armored cable is not permitted.
- G. Metal-clad cable is not permitted.
- H. Concealed Dry Interior Locations: Use only building wire in raceway.
- I. Exposed Dry Interior Locations: Use only building wire in raceway.
- J. Above Accessible Ceilings: Use only building wire in raceway.
- K. Wet or Damp Interior Locations: Use only building wire in raceway.
- L. Exterior Locations: Use only building wire with Type THWN-2 insulation in raceway.

### **2.02 CONDUCTOR AND CABLE MANUFACTURERS**

- A. Cerro Wire LLC: [www.cerrowire.com](http://www.cerrowire.com).
- B. Encore Wire Corporation: [www.encorewire.com](http://www.encorewire.com).
- C. Southwire Company: [www.southwire.com](http://www.southwire.com).
- D. Substitutions: See Section 01 60 00 - Product Requirements.

### **2.03 ALL CONDUCTORS AND CABLES**

- A. Provide products that comply with requirements of NFPA 70.
- B. Provide products listed and classified by Underwriters Laboratories Inc. as suitable for the purpose indicated.
- C. Unless specifically indicated to be excluded, provide all required conduit, boxes, wiring, connectors, etc. as required for a complete operating system.
- D. Comply with NEMA WC 70.
- E. Thermoplastic-Insulated Conductors and Cables: Listed and labeled as complying with UL 83.
- F. Thermoset-Insulated Conductors and Cables: Listed and labeled as complying with UL 44.
- G. Conductors for Grounding and Bonding: Also comply with Section 26 05 26.
- H. Conductor Material:

1. Provide copper conductors only. Aluminum conductors are not acceptable for this project. Conductor sizes indicated are based on copper.
  2. Copper Conductors: Soft drawn annealed, 98 percent conductivity, uncoated copper conductors complying with ASTM B3, ASTM B8, or ASTM B787/B787M unless otherwise indicated.
  3. Tinned Copper Conductors: Comply with ASTM B33.
- I. Minimum Conductor Size:
1. Branch Circuits: 12 AWG.
  2. Control Circuits: 14 AWG.
- J. Where conductor size is not indicated, size to comply with NFPA 70 but not less than applicable minimum size requirements specified.
- K. Conductor Color Coding:
1. Color code conductors as indicated unless otherwise required by the authority having jurisdiction. Maintain consistent color coding throughout project.
  2. Color Coding Method: Integrally colored insulation.
    - a. Conductors size 4 AWG and larger may have black insulation color coded using vinyl color coding electrical tape.
  3. Color Code:
    - a. 208Y/120 V, 3 Phase, 4 Wire System:
      - 1) Phase A: Black.
      - 2) Phase B: Red.
      - 3) Phase C: Blue.
      - 4) Neutral/Grounded: White.
    - b. Equipment Ground, All Systems: Green.
    - c. For control circuits, comply with manufacturer's recommended color code.

#### 2.04 SINGLE CONDUCTOR BUILDING WIRE

- A. Manufacturers:
1. Copper Building Wire:
    - a. Cerro Wire LLC: [www.cerrowire.com](http://www.cerrowire.com).
    - b. Encore Wire Corporation: [www.encorewire.com](http://www.encorewire.com).
    - c. Southwire Company: [www.southwire.com](http://www.southwire.com).
    - d. Substitutions: See Section 01 60 00 - Product Requirements.
  2. Aluminum Building Wire (only where specifically indicated or permitted for substitution):
    - a. Alcan Products Corporation/Alcan Cable (Stabiloy): [www.cable.alcan.com](http://www.cable.alcan.com).
- B. Description: Single conductor insulated wire.
- C. Conductor Stranding:
1. Feeders and Branch Circuits:
    - a. Size 10 AWG and Smaller: Solid.
    - b. Size 8 AWG and Larger: Stranded.
  2. Control Circuits: Stranded.
- D. Insulation Voltage Rating: 600 V.
- E. Insulation:
1. Copper Building Wire: Type THHN/THWN-2.
- F. Conductor: Copper.
- G. Insulation Voltage Rating: 600 volts.
- H. Insulation: NFPA 70, Type THHN/THWN-2.

## 2.05 WIRING CONNECTORS

- A. Description: Wiring connectors appropriate for the application, suitable for use with the conductors to be connected, and listed as complying with UL 486A-486B or UL 486C as applicable.
- B. Connectors for Grounding and Bonding: Comply with Section 26 05 26.
- C. Wiring Connectors for Splices and Taps:
  - 1. Copper Conductors Size 8 AWG and Smaller: Use twist-on insulated spring connectors.
  - 2. Copper Conductors Size 6 AWG and Larger: Use mechanical connectors or compression connectors.
- D. Wiring Connectors for Terminations:
  - 1. Provide terminal lugs for connecting conductors to equipment furnished with terminations designed for terminal lugs.
  - 2. Provide compression adapters for connecting conductors to equipment furnished with mechanical lugs when only compression connectors are specified.
  - 3. Where over-sized conductors are larger than the equipment terminations can accommodate, provide connectors suitable for reducing to appropriate size, but not less than required for the rating of the overcurrent protective device.
  - 4. Provide motor pigtail connectors for connecting motor leads in order to facilitate disconnection.
  - 5. Copper Conductors Size 8 AWG and Larger: Use mechanical connectors or compression connectors where connectors are required.
- E. Do not use insulation-piercing or insulation-displacement connectors designed for use with conductors without stripping insulation.
- F. Twist-on Insulated Spring Connectors: Rated 600 V, 221 degrees F for standard applications and 302 degrees F for high temperature applications; pre-filled with sealant and listed as complying with UL 486D for damp and wet locations.
- G. Mechanical Connectors: Provide bolted type or set-screw type.
- H. Compression Connectors: Provide circumferential type or hex type crimp configuration.

## 2.06 WIRING ACCESSORIES

- A. Electrical Tape:
  - 1. Vinyl Color Coding Electrical Tape: Integrally colored to match color code indicated; listed as complying with UL 510; minimum thickness of 7 mil; resistant to abrasion, corrosion, and sunlight; suitable for continuous temperature environment up to 221 degrees F.
  - 2. Vinyl Insulating Electrical Tape: Complying with ASTM D3005 and listed as complying with UL 510; minimum thickness of 7 mil; resistant to abrasion, corrosion, and sunlight; conformable for application down to 0 degrees F and suitable for continuous temperature environment up to 221 degrees F.
  - 3. Rubber Splicing Electrical Tape: Ethylene Propylene Rubber (EPR) tape, complying with ASTM D4388; minimum thickness of 30 mil; suitable for continuous temperature environment up to 194 degrees F and short-term 266 degrees F overload service.
  - 4. Electrical Filler Tape: Rubber-based insulating moldable putty, minimum thickness of 125 mil; suitable for continuous temperature environment up to 176 degrees F.
  - 5. Varnished Cambric Electrical Tape: Cotton cambric fabric tape, with or without adhesive, oil-primed and coated with high-grade insulating varnish; minimum thickness of 7 mil; suitable for continuous temperature environment up to 221 degrees F.

6. Moisture Sealing Electrical Tape: Insulating mastic compound laminated to flexible, all-weather vinyl backing; minimum thickness of 90 mil.
- B. Heat Shrink Tubing: Heavy-wall, split-resistant, with factory-applied adhesive; rated 600 V; suitable for direct burial applications; listed as complying with UL 486D.
- C. Oxide Inhibiting Compound: Listed; suitable for use with the conductors or cables to be installed.
- D. Wire Pulling Lubricant: Listed; suitable for use with the conductors or cables to be installed and suitable for use at the installation temperature.

### **PART 3 EXECUTION**

#### **3.01 EXAMINATION**

- A. Verify that interior of building has been protected from weather.
- B. Verify that work likely to damage wire and cable has been completed.
- C. Verify that raceways, boxes, and equipment enclosures are installed and are properly sized to accommodate conductors and cables in accordance with NFPA 70.
- D. Verify that raceway installation is complete and supported.
- E. Verify that field measurements are as shown on the drawings.
- F. Verify that conditions are satisfactory for installation prior to starting work.

#### **3.02 PREPARATION**

- A. Clean raceways thoroughly to remove foreign materials before installing conductors and cables.

#### **3.03 INSTALLATION**

- A. Circuiting Requirements:
  1. All exposed raceway shall be run in a neat organized fashion and shall be parallel with other building systems.
  2. Unless dimensioned, circuit routing indicated is diagrammatic.
  3. When circuit destination is indicated and routing is not shown, determine exact routing required.
  4. Arrange circuiting to minimize splices.
  5. Include circuit lengths required to install connected devices within 10 ft of location shown.
  6. Maintain separation of Class 1, Class 2, and Class 3 remote-control, signaling, and power-limited circuits in accordance with NFPA 70.
  7. Circuiting Adjustments: Unless otherwise indicated, when branch circuits are shown as separate, combining them together in a single raceway is not permitted.
  8. Common Neutrals: Unless otherwise indicated, sharing of neutral/grounded conductors among single phase branch circuits is not permitted. Provide dedicated neutral/grounded conductor for each individual branch circuit.
  9. Provide oversized neutral/grounded conductors where indicated and as specified below.
    - a. Provide 200 percent rated neutral for feeders serving panelboards with 200 percent rated neutral bus.
- B. Install products in accordance with manufacturer's instructions.
- C. Install conductors and cable in a neat and workmanlike manner in accordance with NECA 1.
- D. Installation in Raceway:
  1. Tape ends of conductors and cables to prevent infiltration of moisture and other contaminants.
  2. Pull all conductors and cables together into raceway at same time.

3. Do not damage conductors and cables or exceed manufacturer's recommended maximum pulling tension and sidewall pressure.
  4. Use suitable wire pulling lubricant where necessary, except when lubricant is not recommended by the manufacturer.
- E. Exposed Cable Installation (only where specifically permitted):
1. Route cables parallel or perpendicular to building structural members and surfaces.
  2. Protect cables from physical damage.
- F. Paralleled Conductors: Install conductors of the same length and terminate in the same manner.
- G. Secure and support conductors and cables in accordance with NFPA 70 using suitable supports and methods approved by the authority having jurisdiction. Provide independent support from building structure. Do not provide support from raceways, piping, ductwork, or other systems.
1. Installation Above Suspended Ceilings: Do not provide support from ceiling support system. Do not provide support from ceiling grid or allow conductors and cables to lay on ceiling tiles.
  2. Installation in Vertical Raceways: Provide supports where vertical rise exceeds permissible limits.
- H. Install conductors with a minimum of 12 inches of slack at each outlet.
- I. Where conductors are installed in enclosures for future termination by others, provide a minimum of 5 feet of slack.
- J. Neatly train and bundle conductors inside boxes, wireways, panelboards and other equipment enclosures.
- K. Make wiring connections using specified wiring connectors.
1. Make splices and taps only in accessible boxes. Do not pull splices into raceways or make splices in conduit bodies or wiring gutters.
  2. Remove appropriate amount of conductor insulation for making connections without cutting, nicking or damaging conductors.
  3. Do not remove conductor strands to facilitate insertion into connector.
  4. Clean contact surfaces on conductors and connectors to suitable remove corrosion, oxides, and other contaminants. Do not use wire brush on plated connector surfaces.
  5. Mechanical Connectors: Secure connections according to manufacturer's recommended torque settings.
  6. Compression Connectors: Secure connections using manufacturer's recommended tools and dies.
- L. Insulate splices and taps that are made with uninsulated connectors using methods suitable for the application, with insulation and mechanical strength at least equivalent to unspliced conductors.
1. Dry Locations: Use insulating covers specifically designed for the connectors, electrical tape, or heat shrink tubing.
    - a. For taped connections, first apply adequate amount of rubber splicing electrical tape or electrical filler tape, followed by outer covering of vinyl insulating electrical tape.
    - b. For taped connections likely to require re-entering, including motor leads, first apply varnished cambric electrical tape, followed by adequate amount of rubber splicing electrical tape, followed by outer covering of vinyl insulating electrical tape.
  2. Damp Locations: Use insulating covers specifically designed for the connectors, electrical tape, or heat shrink tubing.
    - a. For connections with insulating covers, apply outer covering of moisture sealing electrical tape.
    - b. For taped connections, follow same procedure as for dry locations but apply outer covering of moisture sealing electrical tape.

3. Wet Locations: Use heat shrink tubing.
- M. Insulate ends of spare conductors using vinyl insulating electrical tape.
- N. Field-Applied Color Coding: Where vinyl color coding electrical tape is used in lieu of integrally colored insulation as permitted in Part 2 under "Color Coding", apply half overlapping turns of tape at each termination and at each location conductors are accessible.
- O. Color Code Legend: Provide identification label identifying color code for ungrounded conductors at each piece of feeder or branch-circuit distribution equipment when premises has feeders or branch circuits served by more than one nominal voltage system.
- P. Install firestopping to preserve fire resistance rating of partitions and other elements, using materials and methods specified in Section 07 84 00.
- Q. Unless specifically indicated to be excluded, provide final connections to all equipment and devices, including those furnished by others, as required for a complete operating system.
- R. Install wire and cable securely, in a neat and workmanlike manner, as specified in NECA 1.
- S. Route wire and cable as required to meet project conditions.
  1. Wire and cable routing indicated is approximate unless dimensioned.
  2. Where wire and cable destination is indicated and routing is not shown, determine exact routing and lengths required.
- T. Use wiring methods indicated.
- U. Pull all conductors into raceway at same time.
- V. Use suitable wire pulling lubricant for building wire 4 AWG and larger.
- W. Protect exposed cable from damage.
- X. Support cables above accessible ceiling, using spring metal clips or metal cable ties to support cables from structure or ceiling suspension system. Do not rest cable on ceiling panels.
- Y. Use suitable cable fittings and connectors.
- Z. Neatly train and lace wiring inside boxes, equipment, and panelboards.
- AA. Clean conductor surfaces before installing lugs and connectors.
- AB. Make splices, taps, and terminations to carry full ampacity of conductors with no perceptible temperature rise.
- AC. Use split bolt connectors for copper conductor splices and taps, 6 AWG and larger. Tape uninsulated conductors and connector with electrical tape to 150 percent of insulation rating of conductor.
- AD. Use solderless pressure connectors with insulating covers for copper conductor splices and taps, 8 AWG and smaller.
- AE. Use insulated spring wire connectors with plastic caps for copper conductor splices and taps, 10 AWG and smaller.
- AF. Identify and color code wire and cable under provisions of Section 26 05 53. Identify each conductor with its circuit number or other designation indicated.

### 3.04 FIELD QUALITY CONTROL

- A. Perform inspection, testing, and adjusting in accordance with Section 01 40 00.
- B. Perform field inspection and testing in accordance with Section 01 40 00.

- C. Inspect and test in accordance with NETA STD ATS, except Section 4.
- D. Perform inspections and tests listed in NETA STD ATS, Section 7.3.2. The insulation resistance test is required for all conductors. The resistance test for parallel conductors listed as optional is not required.
  - 1. Disconnect surge protective devices (SPDs) prior to performing any high potential testing. Replace SPDs damaged by performing high potential testing with SPDs connected.
- E. Correct deficiencies and replace damaged or defective conductors and cables.
- F. Perform inspections and tests listed in NETA STD ATS, Section 7.3.2.

**END OF SECTION**

Not For Bidding Purposes

**SECTION 26 05 26**

**GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS**

**PART 1 GENERAL**

**1.01 SECTION INCLUDES**

- A. Grounding and bonding requirements.
- B. Conductors for grounding and bonding.
- C. Connectors for grounding and bonding.
- D. Ground rod electrodes.
- E. Chemically-enhanced ground electrodes.
- F. Ground enhancement material.
- G. Grounding and bonding components.
- H. Provide all components necessary to complete the grounding system(s) consisting of:
  - 1. Existing metal underground water pipe.
  - 2. Metal underground water pipe.
  - 3. Metal frame of the building.
  - 4. Rod electrodes.

**1.02 RELATED REQUIREMENTS**

- A. Section 26 05 19 - Low-Voltage Electrical Power Conductors and Cables: Additional requirements for conductors for grounding and bonding, including conductor color coding.
  - 1. Includes oxide inhibiting compound.
- B. Section 26 05 53 - Identification for Electrical Systems: Identification products and requirements.

**1.03 REFERENCE STANDARDS**

- A. IEEE 81 - Guide for Measuring Earth Resistivity, Ground Impedance, and Earth Surface Potentials of a Ground System; 1983.
- B. NECA 1 - Standard for Good Workmanship in Electrical Construction; National Electrical Contractors Association; 2010.
- C. NEMA GR 1 - Grounding Rod Electrodes and Grounding Rod Electrode Couplings; National Electrical Manufacturers Association; 2007.
- D. NETA STD ATS - Acceptance Testing Specifications for Electrical Power Distribution Equipment and Systems; International Electrical Testing Association; 2009.
- E. NFPA 70 - National Electrical Code; National Fire Protection Association; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- F. UL 467 - Grounding and Bonding Equipment; Current Edition, Including All Revisions.

**1.04 ADMINISTRATIVE REQUIREMENTS**

- A. Coordination:
  - 1. Verify exact locations of underground metal water service pipe entrances to building.
  - 2. Notify Delaware Engineering and Design Corporation of any conflicts with or deviations from the contract documents. Obtain direction before proceeding with work.

- B. Sequencing:
  - 1. Do not install ground rod electrodes until final backfill and compaction is complete.

#### **1.05 PERFORMANCE REQUIREMENTS**

- A. Grounding System Resistance: 5 ohms.

#### **1.06 SUBMITTALS**

- A. See Section 01 30 00 - Administrative Requirements for submittals procedures.
- B. Product Data: Provide manufacturer's standard catalog pages and data sheets for grounding and bonding system components.
- C. Test Reports: Indicate overall resistance to ground and resistance of each electrode.
- D. Project Record Documents: Record actual locations of grounding electrode system components and connections.

#### **1.07 QUALITY ASSURANCE**

- A. Conform to requirements of NFPA 70.
- B. Maintain at the project site a copy of each referenced document that prescribes execution requirements.
- C. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum three years documented experience.
- D. Installer Qualifications for Signal Reference Grids: Company with minimum five years documented experience with high frequency grounding systems.

#### **1.08 DELIVERY, STORAGE, AND HANDLING**

- A. Receive, inspect, handle, and store products in accordance with manufacturer's instructions.
- B. Products: Listed and classified by Underwriters Laboratories Inc. as suitable for the purpose specified and indicated.

### **PART 2 PRODUCTS**

#### **2.01 GROUNDING AND BONDING REQUIREMENTS**

- A. Do not use products for applications other than as permitted by NFPA 70 and product listing.
- B. Unless specifically indicated to be excluded, provide all required components, conductors, connectors, conduit, boxes, fittings, supports, accessories, etc. as necessary for a complete grounding and bonding system.
- C. Where conductor size is not indicated, size to comply with NFPA 70 but not less than applicable minimum size requirements specified.
- D. Grounding System Resistance:
  - 1. Achieve specified grounding system resistance under normally dry conditions unless otherwise approved by Delaware Engineering and Design Corporation. Precipitation within the previous 48 hours does not constitute normally dry conditions.
  - 2. Grounding Electrode System: Not greater than 5 ohms to ground, when tested according to IEEE 81 using "fall-of-potential" method.
  - 3. Between Grounding Electrode System and Major Electrical Equipment Frames, System Neutral, and Derived Neutral Points: Not greater than 0.5 ohms, when tested according to IEEE 81 using "point-to-point" methods.
- E. Grounding Electrode System:

1. Provide connection to required and supplemental grounding electrodes indicated to form grounding electrode system.
    - a. Provide continuous grounding electrode conductors without splice or joint.
    - b. Install grounding electrode conductors in raceway where exposed to physical damage. Bond grounding electrode conductor to metallic raceways at each end with bonding jumper.
  2. Metal Underground Water Pipe(s):
    - a. Provide connection to underground metal domestic and fire protection (where present) water service pipe(s) that are in direct contact with earth for at least 10 feet at an accessible location not more than 5 feet from the point of entrance to the building.
    - b. Provide bonding jumper(s) around insulating joints/pipes as required to make pipe electrically continuous.
    - c. Provide bonding jumper around water meter of sufficient length to permit removal of meter without disconnecting jumper.
  3. Metal Building or Structure Frame:
    - a. Provide connection to metal building or structure frame effectively grounded in accordance with NFPA 70 at nearest accessible location.
  4. Ground Rod Electrode(s):
    - a. Space electrodes not less than 10 feet from each other and any other ground electrode.
    - b. Where location is not indicated, locate electrode(s) at least 5 feet outside building perimeter foundation as near as possible to electrical service entrance; where possible, locate in softscape (uncovered) area.
    - c. Provide ground enhancement material around electrode.
  5. Provide additional ground electrode(s) as required to achieve specified grounding electrode system resistance.
- F. Service-Supplied System Grounding:
1. For each service disconnect, provide grounding electrode conductor to connect neutral (grounded) service conductor to grounding electrode system. Unless otherwise indicated, make connection at neutral (grounded) bus in service disconnect enclosure.
  2. For each service disconnect, provide main bonding jumper to connect neutral (grounded) bus to equipment ground bus where not factory-installed. Do not make any other connections between neutral (grounded) conductors and ground on load side of service disconnect.
- G. Bonding and Equipment Grounding:
1. Provide bonding for equipment grounding conductors, equipment ground busses, metallic equipment enclosures, metallic raceways and boxes, device grounding terminals, and other normally non-current-carrying conductive materials enclosing electrical conductors/equipment or likely to become energized as indicated and in accordance with NFPA 70.
  2. Provide insulated equipment grounding conductor in each feeder and branch circuit raceway. Do not use raceways as sole equipment grounding conductor.
  3. Where circuit conductor sizes are increased for voltage drop, increase size of equipment grounding conductor proportionally in accordance with NFPA 70.
  4. Unless otherwise indicated, connect wiring device grounding terminal to branch circuit equipment grounding conductor and to outlet box with bonding jumper.
  5. Terminate branch circuit equipment grounding conductors on solidly bonded equipment ground bus only. Do not terminate on neutral (grounded) or isolated/insulated ground bus.
  6. Provide bonding jumper across expansion or expansion/deflection fittings provided to accommodate conduit movement.
  7. Provide bonding for interior metal piping systems in accordance with NFPA 70. This includes, but is not limited to:

- a. Metal water piping where not already effectively bonded to metal underground water pipe used as grounding electrode.
- b. Metal gas piping.
- c. Metal process piping.
8. Provide bonding for interior metal air ducts.
9. Provide bonding for metal building frame where not used as a grounding electrode.
10. Provide bonding for metal siding not effectively bonded through attachment to metal building frame.

H. Pole-Mounted Luminaires: Also comply with Section 26 56 00.

## 2.02 GROUNDING AND BONDING COMPONENTS

- A. General Requirements:
1. Provide products listed, classified, and labeled by Underwriter's Laboratories Inc. (UL) or testing firm acceptable to authority having jurisdiction as suitable for the purpose indicated.
  2. Provide products listed and labeled as complying with UL 467 where applicable.
- B. Conductors for Grounding and Bonding, in addition to requirements of Section 26 05 19:
1. Use insulated copper conductors unless otherwise indicated.
    - a. Exceptions:
      - 1) Use bare copper conductors where installed underground in direct contact with earth.
      - 2) Use bare copper conductors where directly encased in concrete (not in raceway).
- C. Connectors for Grounding and Bonding:
1. Description: Connectors appropriate for the application and suitable for the conductors and items to be connected; listed and labeled as complying with UL 467.
  2. Unless otherwise indicated, use exothermic welded connections or compression connectors for underground, concealed and other inaccessible connections.
  3. Unless otherwise indicated, use mechanical connectors, compression connectors, or exothermic welded connections for accessible connections.
  4. Manufacturers - Mechanical and Compression Connectors:
    - a. Burndy: [www.burndy.com](http://www.burndy.com).
    - b. Harger Lightning & Grounding: [www.harger.com](http://www.harger.com).
    - c. Thomas & Betts Corporation: [www.tnb.com](http://www.tnb.com).
    - d. Substitutions: See Section 01 60 00 - Product Requirements.
  5. Manufacturers - Exothermic Welded Connections:
    - a. Burndy: [www.burndy.com](http://www.burndy.com).
    - b. Cadweld, a brand of Erico International Corporation: [www.erico.com](http://www.erico.com).
    - c. ThermOweld, a brand of Continental Industries, Inc: [www.thermoweld.com](http://www.thermoweld.com).
    - d. Substitutions: See Section 01 60 00 - Product Requirements.
- D. Ground Rod Electrodes:
1. Comply with NEMA GR 1.
  2. Material: Copper-bonded (copper-clad) steel.
  3. Size: 3/4 inch diameter by 10 feet length, unless otherwise indicated.
  4. Where rod lengths of greater than 10 feet are indicated or otherwise required, sectionalized ground rods may be used.
  5. Manufacturers:
    - a. Erico International Corporation: [www.erico.com](http://www.erico.com).
    - b. Galvan Industries, Inc: [www.galvanelectrical.com](http://www.galvanelectrical.com).
    - c. Harger Lightning & Grounding: [www.harger.com](http://www.harger.com).
    - d. Substitutions: See Section 01 60 00 - Product Requirements.
- E. Chemically-Enhanced Ground Electrodes:

1. Description: Copper tube factory-filled with electrolytic salts designed to provide a low-impedance ground in locations with high soil resistivity; straight (for vertical installations) or L-shaped (for horizontal installations) as indicated or as required.
  2. Length: 10 feet.
  3. Integral Pigtail: Factory-attached, sized not less than grounding electrode conductor to be attached.
  4. Backfill Material: Grounding enhancement material recommended by electrode manufacturer.
  5. Manufacturers:
    - a. Erico International Corporation: [www.erico.com](http://www.erico.com).
    - b. Harger Lightning & Grounding: [www.harger.com](http://www.harger.com).
    - c. ThermOweld, a brand of Continental Industries, Inc: [www.thermoweld.com](http://www.thermoweld.com).
    - d. Substitutions: See Section 01 60 00 - Product Requirements.
- F. Ground Enhancement Material:
1. Description: Factory-mixed conductive material designed for permanent and maintenance-free improvement of grounding effectiveness by lowering resistivity.
  2. Resistivity: Not more than 20 ohm-cm in final installed form.
  3. Manufacturers:
    - a. Erico International Corporation: [www.erico.com](http://www.erico.com).
    - b. Harger Lightning & Grounding: [www.harger.com](http://www.harger.com).
    - c. ThermOweld, a brand of Continental Industries, Inc: [www.thermoweld.com](http://www.thermoweld.com).
    - d. Substitutions: See Section 01 60 00 - Product Requirements.

### **PART 3 EXECUTION**

#### **3.01 EXAMINATION**

- A. Verify that work likely to damage grounding and bonding system components has been completed.
- B. Verify that field measurements are as shown on the drawings.
- C. Verify that conditions are satisfactory for installation prior to starting work.
- D. Verify existing conditions prior to beginning work.
- E. Verify that final backfill and compaction has been completed before driving rod electrodes.

#### **3.02 INSTALLATION**

- A. Install products in accordance with manufacturer's instructions.
- B. Install grounding and bonding system components in a neat and workmanlike manner in accordance with NECA 1.
- C. Ground Rod Electrodes: Unless otherwise indicated, install ground rod electrodes vertically. Where encountered rock prohibits vertical installation, install at 45 degree angle or bury horizontally in trench at least 30 inches (750 mm) deep in accordance with NFPA 70 or provide ground plates.
  1. Outdoor Installations: Unless otherwise indicated, install with top of rod 6 inches below finished grade.
  2. Indoor Installations: Unless otherwise indicated, install with 4 inches of top of rod exposed.
- D. Make grounding and bonding connections using specified connectors.
  1. Remove appropriate amount of conductor insulation for making connections without cutting, nicking or damaging conductors. Do not remove conductor strands to facilitate insertion into connector.

2. Remove nonconductive paint, enamel, or similar coating at threads, contact points, and contact surfaces.
  3. Exothermic Welds: Make connections using molds and weld material suitable for the items to be connected in accordance with manufacturer's recommendations.
  4. Mechanical Connectors: Secure connections according to manufacturer's recommended torque settings.
  5. Compression Connectors: Secure connections using manufacturer's recommended tools and dies.
- E. Identify grounding and bonding system components in accordance with Section 26 05 53.
- F. Install ground electrodes at locations indicated. Install additional rod electrodes as required to achieve specified resistance to ground.
- G. Provide bonding to meet requirements described in Quality Assurance.
- H. Equipment Grounding Conductor: Provide separate, insulated conductor within each feeder and branch circuit raceway. Terminate each end on suitable lug, bus, or bushing.

### **3.03 FIELD QUALITY CONTROL**

- A. Perform inspection in accordance with Section 01 40 00.
- B. Inspect and test in accordance with NETA STD ATS except Section 4.
- C. Perform inspections and tests listed in NETA STD ATS, Section 7.13.
- D. Perform ground electrode resistance tests under normally dry conditions. Precipitation within the previous 48 hours does not constitute normally dry conditions.
- E. Investigate and correct deficiencies where measured ground resistances do not comply with specified requirements.

**END OF SECTION**

**SECTION 26 05 29**

**HANGERS AND SUPPORTS FOR ELECTRICAL SYSTEMS**

**PART 1 GENERAL**

**1.01 SECTION INCLUDES**

- A. Support and attachment components for equipment, conduit, cable, boxes, and other electrical work.

**1.02 RELATED REQUIREMENTS**

- A. Section 26 05 34 - Conduit: Additional support and attachment requirements for conduits.
- B. Section 26 05 37 - Boxes: Additional support and attachment requirements for boxes.
- C. Conduit and equipment supports.
- D. Anchors and fasteners.

**1.03 REFERENCE STANDARDS**

- A. ASTM A123/A123M - Standard Specification for Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products; 2012.
- B. ASTM A153/A153M - Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware; 2009.
- C. ASTM B633 - Standard Specification for Electrodeposited Coatings of Zinc on Iron and Steel; 2011.
- D. MFMA-4 - Metal Framing Standards Publication; Metal Framing Manufacturers Association; 2004.
- E. ICC-ES AC01 - Acceptance Criteria for Expansion Anchors in Masonry Elements; 2009.
- F. ICC-ES AC193 - Acceptance Criteria for Mechanical Anchors in Concrete Elements; 2010
- G. ICC-ES AC308 - Acceptance Criteria for Post-Installed Adhesive Anchors in Concrete Elements; 2009.
- H. NECA 1 - Standard for Good Workmanship in Electrical Construction; National Electrical Contractors Association; 2010.
- I. NFPA 70 - National Electrical Code; National Fire Protection Association; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- J. UL 5B - Strut-Type Channel Raceways and Fittings; Current Edition, Including All Revisions.

**1.04 ADMINISTRATIVE REQUIREMENTS**

- A. Coordination:
  - 1. Coordinate sizes and arrangement of supports and bases with the actual equipment and components to be installed.
  - 2. Coordinate the work with other trades to provide additional framing and materials required for installation.
  - 3. Coordinate compatibility of support and attachment components with mounting surfaces at the installed locations.
  - 4. Coordinate the arrangement of supports with ductwork, piping, equipment and other potential conflicts installed under other sections or by others.

5. Notify Delaware Engineering and Design Corporation of any conflicts with or deviations from the contract documents. Obtain direction before proceeding with work.
- B. Sequencing:
1. Do not install products on or provide attachment to concrete surfaces until concrete has fully cured in accordance with Section 03 30 00.

#### **1.05 SUBMITTALS**

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide manufacturer's standard catalog pages and data sheets for metal channel (strut) framing systems, non-penetrating rooftop supports, and post-installed concrete and masonry anchors.
- C. Shop Drawings: Include details for fabricated hangers and supports where materials or methods other than those indicated are proposed for substitution.
- D. Product Data: Provide manufacturer's catalog data for fastening systems.

#### **1.06 QUALITY ASSURANCE**

- A. Comply with NFPA 70.
- B. Comply with applicable building code.
- C. Maintain at the project site a copy of each referenced document that prescribes execution requirements.

#### **1.07 DELIVERY, STORAGE, AND HANDLING**

- A. Receive, inspect, handle, and store products in accordance with manufacturer's instructions.
- B. Products: Listed and classified by Underwriters Laboratories Inc. as suitable for the purpose specified and indicated.

### **PART 2 PRODUCTS**

#### **2.01 SUPPORT AND ATTACHMENT COMPONENTS**

- A. General Requirements:
  1. Provide all required hangers, supports, anchors, fasteners, fittings, accessories, and hardware as necessary for the complete installation of electrical work.
  2. Provide products listed, classified, and labeled by Underwriter's Laboratories Inc. (UL) or testing firm acceptable to authority having jurisdiction as suitable for the purpose indicated, where applicable.
  3. Where support and attachment component types and sizes are not indicated, select in accordance with manufacturer's application criteria as required for the load to be supported with a minimum safety factor of \_\_\_\_\_. Include consideration for vibration, equipment operation, and shock loads where applicable.
  4. Do not use products for applications other than as permitted by NFPA 70 and product listing.
  5. Do not use wire, chain, perforated pipe strap, or wood for permanent supports unless specifically indicated or permitted.
  6. Steel Components: Use corrosion resistant materials suitable for the environment where installed.
    - a. Indoor Dry Locations: Use zinc-plated steel or approved equivalent unless otherwise indicated.
    - b. Outdoor and Damp or Wet Indoor Locations: Use galvanized steel, stainless steel, or approved equivalent unless otherwise indicated.

- c. Zinc-Plated Steel: Electroplated in accordance with ASTM B633.
  - d. Galvanized Steel: Hot-dip galvanized after fabrication in accordance with ASTM A123/A123M or ASTM A153/A153M.
- B. Conduit and Cable Supports: Straps, clamps, etc. suitable for the conduit or cable to be supported.
1. Conduit Straps: One-hole or two-hole type; steel or malleable iron.
  2. Conduit Clamps: Bolted type unless otherwise indicated.
  3. Manufacturers:
    - a. Cooper Crouse-Hinds, a division of Cooper Industries: [www.cooperindustries.com](http://www.cooperindustries.com).
    - b. Erico International Corporation: [www.erico.com](http://www.erico.com).
    - c. O-Z/Gedney, a brand of Emerson Industrial Automation: [www.emersonindustrial.com](http://www.emersonindustrial.com).
    - d. Thomas & Betts Corporation: [www.tnb.com](http://www.tnb.com).
    - e. Substitutions: See Section 01 60 00 - Product Requirements.
- C. Outlet Box Supports: Hangers, brackets, etc. suitable for the boxes to be supported.
1. Manufacturers:
    - a. Cooper Crouse-Hinds, a division of Cooper Industries: [www.cooperindustries.com](http://www.cooperindustries.com).
    - b. Erico International Corporation: [www.erico.com](http://www.erico.com).
    - c. O-Z/Gedney, a brand of Emerson Industrial Automation: [www.emersonindustrial.com](http://www.emersonindustrial.com).
    - d. Thomas & Betts Corporation: [www.tnb.com](http://www.tnb.com).
    - e. Substitutions: See Section 01 60 00 - Product Requirements.
- D. Metal Channel (Strut) Framing Systems: Factory-fabricated continuous-slot metal channel (strut) and associated fittings, accessories, and hardware required for field-assembly of supports.
1. Comply with MFMA-4.
  2. Channel Material:
    - a. Indoor Dry Locations: Use painted steel, zinc-plated steel, or galvanized steel.
    - b. Outdoor and Damp or Wet Indoor Locations: Use galvanized steel.
  3. Minimum Channel Thickness: 12 gauge.
  4. Minimum Channel Dimensions: 1-5/8 inch width by 13/16 inch height.
  5. Manufacturers:
    - a. Cooper B-Line, a division of Cooper Industries: [www.cooperindustries.com](http://www.cooperindustries.com).
    - b. Thomas & Betts Corporation: [www.tnb.com](http://www.tnb.com).
    - c. Unistrut, a brand of Atkore International Inc: [www.unistrut.com](http://www.unistrut.com).
    - d. Substitutions: See Section 01 60 00 - Product Requirements.
    - e. Source Limitations: Furnish channels (struts) and associated fittings, accessories, and hardware produced by a single manufacturer.
- E. Hanger Rods: Threaded zinc-plated steel unless otherwise indicated.
1. Minimum Size, Unless Otherwise Indicated or Required:
    - a. Equipment Supports: 1/2 inch diameter.
    - b. Single Conduit up to 1 inch (27mm) trade size: 1/4 inch diameter.
    - c. Single Conduit larger than 1 inch (27mm) trade size: 3/8 inch diameter.
    - d. Trapeze Support for Multiple Conduits: 3/8 inch diameter.
    - e. Outlet Boxes: 1/4 inch diameter.
    - f. Luminaires: 1/4 inch diameter.
- F. Anchors and Fasteners:
1. Unless otherwise indicated and where not otherwise restricted, use the anchor and fastener types indicated for the specified applications.
  2. Concrete: Use preset concrete inserts, expansion anchors, or screw anchors.
  3. Solid or Grout-Filled Masonry: Use expansion anchors or screw anchors.
  4. Hollow Masonry: Use toggle bolts.
  5. Hollow Stud Walls: Use toggle bolts.
  6. Steel: Use beam clamps, machine bolts, or welded threaded studs.

7. Sheet Metal: Use sheet metal screws.
8. Wood: Use wood screws.
9. Plastic and lead anchors are not permitted.
10. Preset Concrete Inserts: Continuous metal channel (strut) and spot inserts specifically designed to be cast in concrete ceilings, walls, and floors.
  - a. Comply with MFMA-4.
  - b. Channel Material: Use galvanized steel.
  - c. Minimum Channel Thickness: 12 gauge.
  - d. Manufacturer: Same as manufacturer of metal channel (strut) framing system.
11. Post-Installed Concrete and Masonry Anchors: Evaluated and recognized by ICC Evaluation Service, LLC (ICC-ES) for compliance with applicable building code.
12. Manufacturers - Mechanical Anchors:
  - a. Hilti, Inc: [www.us.hilti.com](http://www.us.hilti.com).
  - b. ITW Red Head, a division of Illinois Tool Works, Inc: [www.itwredhead.com](http://www.itwredhead.com).
  - c. Powers Fasteners, Inc: [www.powers.com](http://www.powers.com).
  - d. Simpson Strong-Tie Company Inc: [www.strongtie.com](http://www.strongtie.com).
  - e. Substitutions: See Section 01 60 00 - Product Requirements.

## 2.02 MANUFACTURERS

- A. Thomas & Betts Corporation: [www.tnb.com](http://www.tnb.com).
- B. Threaded Rod Company: [www.threadedrod.com](http://www.threadedrod.com).
- C. Substitutions: See Section 01 60 00 - Product Requirements.

## 2.03 MATERIALS

- A. Hangers, Supports, Anchors, and Fasteners - General: Corrosion-resistant materials of size and type adequate to carry the loads of equipment and conduit, including weight of wire in conduit.
- B. Supports: Fabricated of structural steel or formed steel members; galvanized.

State of Delaware  
 Supreme Court Building - Basement Level Sprinkler System  
 OMB/DFM Project # MC1002000170

C. Anchors and Fasteners:

1. Refer to the attached table:

	Drop-in Sleeve Anchors	Expansion Machine Bolt Anchors	Lag Shield Anchors	Nail-in Anchors	Toggle Bolts	Hollow Wall Anchors	Power Driven Studs
Brick	X	X	X	X			X
Concrete	X	X	X	X			X
Concrete Block	X		X	X	X		
Cinder Block		X			X	X	
Stone	X	X		X			X
Marble	X		X				
Building Tile		X			X	X	
Ceramic Tile		X			X		
Terrazzo		X		X			
Terra Cotta		X			X	X	
Plaster					X	X	
Drywall				X	X		
Slate		X			X		
Steel							X

ANCHOR HARDWARE TABLE

Not For Bidding Purposes

- D. Fastener Types:
1. Concrete Wedge Expansion Anchors: Complying with ICC-ES AC193.
  2. Masonry Wedge Expansion Anchors: Complying with ICC-ES AC01.
  3. Concrete Screw Type Anchors: Complying with ICC-ES AC193.
  4. Masonry Screw Type Anchors: Complying with ICC-ES AC106.
  5. Concrete Adhesive Type Anchors: Complying with ICC-ES AC308.
  6. Other Types: As required.

### **PART 3 EXECUTION**

#### **3.01 EXAMINATION**

- A. Verify that mounting surfaces are ready to receive support and attachment components.
- B. Verify that conditions are satisfactory for installation prior to starting work.

#### **3.02 INSTALLATION**

- A. Install products in accordance with manufacturer's instructions.
- B. Install support and attachment components in a neat and workmanlike manner in accordance with NECA 1.
- C. Install anchors and fasteners in accordance with ICC Evaluation Services, LLC (ICC-ES) evaluation report conditions of use where applicable.
- D. Provide independent support from building structure. Do not provide support from piping, ductwork, or other systems.
- E. Unless specifically indicated or approved by Delaware Engineering and Design Corporation, do not provide support from suspended ceiling support system or ceiling grid.
- F. Unless specifically indicated or approved by Delaware Engineering and Design Corporation, do not provide support from roof deck.
- G. Do not penetrate or otherwise notch or cut structural members without approval of Structural Engineer.
- H. Equipment Support and Attachment:
  1. Use metal fabricated supports or supports assembled from metal channel (strut) to support equipment as required.
  2. Use metal channel (strut) secured to studs to support equipment surface-mounted on hollow stud walls when wall strength is not sufficient to resist pull-out.
  3. Use metal channel (strut) to support surface-mounted equipment in wet or damp locations to provide space between equipment and mounting surface.
  4. Securely fasten floor-mounted equipment. Do not install equipment such that it relies on its own weight for support.
- I. Conduit Support and Attachment: Also comply with Section 26 05 34.
- J. Box Support and Attachment: Also comply with Section 26 05 37.
- K. Preset Concrete Inserts: Use manufacturer provided closure strips to inhibit concrete seepage during concrete pour.
- L. Secure fasteners according to manufacturer's recommended torque settings.
- M. Remove temporary supports.

**3.03 FIELD QUALITY CONTROL**

- A. See Section 01 40 00 - Quality Requirements, for additional requirements.
- B. Inspect support and attachment components for damage and defects.
- C. Repair cuts and abrasions in galvanized finishes using zinc-rich paint recommended by manufacturer. Replace components that exhibit signs of corrosion.
- D. Correct deficiencies and replace damaged or defective support and attachment components.
- E. Install hangers and supports as required to adequately and securely support electrical system components, in a neat and workmanlike manner, as specified in NECA 1.
  - 1. Do not fasten supports to pipes, ducts, mechanical equipment, or conduit.
  - 2. Do not drill or cut structural members.
- F. Rigidly weld support members or use hexagon-head bolts to present neat appearance with adequate strength and rigidity. Use spring lock washers under all nuts.
- G. Install surface-mounted cabinets and panelboards with minimum of four anchors.
- H. In wet and damp locations use steel channel supports to stand cabinets and panelboards 1-5/8" off wall.
- I. Use sheet metal channel to bridge studs above and below cabinets and panelboards recessed in hollow partitions.

**END OF SECTION**

Not For Bidding Purposes

**SECTION 26 05 34**

**CONDUIT**

**PART 1 GENERAL**

**1.01 SECTION INCLUDES**

- A. Galvanized steel rigid metal conduit (RMC).
- B. PVC-coated galvanized steel rigid metal conduit (RMC).
- C. Liquidtight flexible metal conduit (LFMC).
- D. Electrical metallic tubing (EMT).
- E. Rigid polyvinyl chloride (PVC) conduit.
- F. Conduit fittings.
- G. Accessories.
- H. Conduit, fittings and conduit bodies.

**1.02 RELATED REQUIREMENTS**

- A. Section 07 84 00 - Firestopping.
- B. Section 26 05 19 - Low-Voltage Electrical Power Conductors and Cables.
- C. Section 26 05 26 - Grounding and Bonding for Electrical Systems.
  - 1. Includes additional requirements for fittings for grounding and bonding.
- D. Section 26 05 29 - Hangers and Supports for Electrical Systems.
- E. Section 26 05 37 - Boxes.
- F. Section 26 05 53 - Identification for Electrical Systems: Identification products and requirements.
- G. Section 26 27 01 - Electrical Service Entrance: Additional requirements for electrical service conduits.

**1.03 REFERENCE STANDARDS**

- A. ANSI C80.1 - American National Standard for Electrical Rigid Steel Conduit (ERSC); 2005.
- B. ANSI C80.3 - American National Standard for Steel Electrical Metallic Tubing (EMT); 2005.
- C. NECA 1 - Standard for Good Workmanship in Electrical Construction; National Electrical Contractors Association; 2010.
- D. NECA 101 - Standard for Installing Steel Conduits (Rigid, IMC, EMT); National Electrical Contractors Association; 2006.
- E. NECA 111 - Standard for Installing Nonmetallic Raceways (RNC, ENT, LFNC); National Electrical Contractors Association; 2003.
- F. NEMA FB 1 - Fittings, Cast Metal Boxes, and Conduit Bodies for Conduit, Electrical Metallic Tubing, and Cable; National Electrical Manufacturers Association; 2012 (ANSI/NEMA FB 1).
- G. NEMA RN 1 - Polyvinyl-Chloride (PVC) Externally Coated Galvanized Rigid Steel Conduit and Intermediate Metal Conduit; National Electrical Manufacturers Association; 2005.

- H. NEMA TC 2 - Electrical Polyvinyl Chloride (PVC) Conduit; National Electrical Manufacturers Association; 2003.
- I. NEMA TC 3 - Polyvinyl Chloride (PVC) Fittings for Use with Rigid PVC Conduit and Tubing; National Electrical Manufacturers Association; 2004.
- J. NFPA 70 - National Electrical Code; National Fire Protection Association; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- K. UL 6 - Electrical Rigid Metal Conduit-Steel; Current Edition, Including All Revisions.
- L. UL 360 - Liquid-Tight Flexible Steel Conduit; Current Edition, Including All Revisions.
- M. UL 514B - Conduit, Tubing, and Cable Fittings; Current Edition, Including All Revisions.
- N. UL 651 - Schedule 40 and 80 Rigid PVC Conduit and Fittings; Current Edition, Including All Revisions.
- O. UL 797 - Electrical Metallic Tubing-Steel; Current Edition, Including All Revisions.

#### **1.04 ADMINISTRATIVE REQUIREMENTS**

- A. Coordination:
  - 1. Coordinate minimum sizes of conduits with the actual conductors to be installed, including adjustments for conductor sizes increased for voltage drop.
  - 2. Coordinate the arrangement of conduits with structural members, ductwork, piping, equipment and other potential conflicts installed under other sections or by others.
  - 3. Verify exact conduit termination locations required for boxes, enclosures, and equipment installed under other sections or by others.
  - 4. Coordinate the work with other trades to provide roof penetrations that preserve the integrity of the roofing system and do not void the roof warranty.
  - 5. Notify Delaware Engineering and Design Corporation of any conflicts with or deviations from the contract documents. Obtain direction before proceeding with work.
- B. Sequencing:
  - 1. Do not begin installation of conductors and cables until installation of conduit is complete between outlet, junction and splicing points.

#### **1.05 SUBMITTALS**

- A. See Section 01 30 00 - Administrative Requirements for submittals procedures.
- B. Product Data: Provide manufacturer's standard catalog pages and data sheets for conduits and fittings.
- C. Project Record Documents: Record actual routing for conduits installed underground and conduits 2 inch (53 mm) trade size and larger.

#### **1.06 QUALITY ASSURANCE**

- A. Conform to requirements of NFPA 70.
- B. Maintain at the project site a copy of each referenced document that prescribes execution requirements.
- C. Products: Listed and classified by Underwriters Laboratories Inc. as suitable for purpose specified and shown.

### 1.07 DELIVERY, STORAGE, AND HANDLING

- A. Receive, inspect, handle, and store conduit and fittings in accordance with manufacturer's instructions.
- B. Accept conduit on site. Inspect for damage.
- C. Protect conduit from corrosion and entrance of debris by storing above grade. Provide appropriate covering.

## PART 2 PRODUCTS

### 2.01 CONDUIT APPLICATIONS

- A. Do not use conduit and associated fittings for applications other than as permitted by NFPA 70 and product listing.
- B. Unless otherwise indicated and where not otherwise restricted, use the conduit types indicated for the specified applications. Where more than one listed application applies, comply with the most restrictive requirements. Where conduit type for a particular application is not specified, use galvanized steel rigid metal conduit.
- C. Underground:
  - 1. Under Slab on Grade: Use rigid PVC conduit.
  - 2. Exterior, Direct-Buried: Use rigid PVC conduit.
  - 3. Exterior, Embedded Within Concrete: Use rigid PVC conduit.
  - 4. Where rigid polyvinyl (PVC) conduit is provided, transition to galvanized steel rigid metal conduit where emerging from underground.
  - 5. Where rigid polyvinyl (PVC) conduit larger than 2 inch (53 mm) trade size is provided, use galvanized steel rigid metal conduit elbows for bends.
  - 6. Where steel conduit is installed in direct contact with earth where soil has a resistivity of less than 2000 ohm-centimeters or is characterized as severely corrosive based on soils report or local experience, use corrosion protection tape to provide supplementary corrosion protection or use PVC-coated galvanized steel rigid metal conduit.
  - 7. Where steel conduit emerges from concrete into soil, use corrosion protection tape to provide supplementary corrosion protection for a minimum of 4 inches on either side of where conduit emerges or use PVC-coated galvanized steel rigid metal conduit.
- D. Embedded Within Concrete:
  - 1. Within Slab Above Ground (within structural slabs only where approved by Structural Engineer): Use galvanized steel rigid metal conduit, PVC-coated galvanized steel rigid metal conduit, or rigid PVC conduit.
  - 2. Where rigid polyvinyl (PVC) conduit is provided, transition to galvanized steel rigid metal conduit where emerging from concrete.
- E. Concealed Within Masonry Walls: Use galvanized steel rigid metal conduit or electrical metallic tubing (EMT).
- F. Concealed Within Hollow Stud Walls: Use galvanized steel rigid metal conduit or electrical metallic tubing (EMT).
- G. Concealed Above Accessible Ceilings: Use galvanized steel rigid metal conduit or electrical metallic tubing (EMT).
- H. Interior, Damp or Wet Locations: Use galvanized steel rigid metal conduit.
- I. Exposed, Interior, Not Subject to Physical Damage: Use electrical metallic tubing (EMT).
- J. Exposed, Interior, Subject to Physical Damage: Use galvanized steel rigid metal conduit.

1. Locations subject to physical damage include, but are not limited to:
  - a. Where exposed below 8 feet, except within electrical and communication rooms or closets.
  - b. Where exposed below 20 feet in warehouse areas.
- K. Exposed, Exterior: Use galvanized steel rigid metal conduit.
- L. Corrosive Locations Above Ground: Use PVC-coated galvanized steel rigid metal conduit or aluminum rigid metal conduit.
- M. Connections to Vibrating Equipment:
  1. Dry Locations: Use liquidtight flexible metal conduit.
  2. Damp, Wet, or Corrosive Locations: Use liquidtight flexible metal conduit.
  3. Maximum Length: 18 inches unless otherwise indicated.
  4. Vibrating equipment includes, but is not limited to:
    - a. Transformers.
    - b. Motors.

## 2.02 CONDUIT REQUIREMENTS

- A. Electrical Service Conduits: Also comply with Section 26 27 01.
- B. Fittings for Grounding and Bonding: Also comply with Section 26 05 26.
- C. Provide all conduit, fittings, supports, and accessories required for a complete raceway system.
- D. Provide products listed, classified, and labeled by Underwriter's Laboratories Inc. (UL) or testing firm acceptable to authority having jurisdiction as suitable for the purpose indicated.
- E. Minimum Conduit Size, Unless Otherwise Indicated:
  1. Branch Circuits: 3/4 inch (21 mm) trade size.
  2. Branch Circuit Homeruns: 3/4 inch (21 mm) trade size.
  3. Control Circuits: 1/2 inch (16 mm) trade size.
  4. Underground, Interior: 3/4 inch (21 mm) trade size.
  5. Underground, Exterior: 1 inch (27 mm) trade size.
- F. Where conduit size is not indicated, size to comply with NFPA 70 but not less than applicable minimum size requirements specified.

## 2.03 GALVANIZED STEEL RIGID METAL CONDUIT (RMC)

- A. Manufacturers:
  1. Allied Tube & Conduit: [www.alliedeg.com](http://www.alliedeg.com).
  2. Republic Conduit: [www.republic-conduit.com](http://www.republic-conduit.com).
  3. Wheatland Tube Company: [www.wheatland.com](http://www.wheatland.com).
  4. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Description: NFPA 70, Type RMC galvanized steel rigid metal conduit complying with ANSI C80.1 and listed and labeled as complying with UL 6.
- C. Fittings:
  1. Manufacturers:
    - a. Bridgeport Fittings Inc: [www.bptfittings.com](http://www.bptfittings.com).
    - b. O-Z/Gedney, a brand of Emerson Industrial Automation: [www.emersonindustrial.com](http://www.emersonindustrial.com).
    - c. Thomas & Betts Corporation: [www.tnb.com](http://www.tnb.com).
    - d. Substitutions: See Section 01 60 00 - Product Requirements.
  2. Non-Hazardous Locations: Use fittings complying with NEMA FB 1 and listed and labeled as complying with UL 514B.
  3. Material: Use steel, malleable iron, or die cast zinc.
  4. Connectors and Couplings: Use threaded type fittings only. Threadless set screw and

State of Delaware  
Supreme Court Building - Basement Level Sprinkler System  
OMB/DFM Project # MC1002000170  
compression (gland) type fittings are not permitted.

Not For Bidding Purposes

#### **2.04 PVC-COATED GALVANIZED STEEL RIGID METAL CONDUIT (RMC)**

- A. Manufacturers:
  - 1. Thomas & Betts Corporation: [www.tnb.com](http://www.tnb.com).
  - 2. Robroy Industries: [www.robroy.com](http://www.robroy.com).
  - 3. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Description: NFPA 70, Type RMC galvanized steel rigid metal conduit with external polyvinyl chloride (PVC) coating complying with NEMA RN 1 and listed and labeled as complying with UL 6.
- C. Exterior Coating: Polyvinyl chloride (PVC), nominal thickness of 40 mil.
- D. PVC-Coated Fittings:
  - 1. Manufacturer: Same as manufacturer of PVC-coated conduit to be installed.
  - 2. Non-Hazardous Locations: Use fittings listed and labeled as complying with UL 514B.
  - 3. Material: Use steel or malleable iron.
  - 4. Exterior Coating: Polyvinyl chloride (PVC), minimum thickness of 40 mil.
- E. PVC-Coated Supports: Furnish with exterior coating of polyvinyl chloride (PVC), minimum thickness of 15 mil.

#### **2.05 LIQUIDTIGHT FLEXIBLE METAL CONDUIT (LFMC)**

- A. Manufacturers:
  - 1. AFC Cable Systems, Inc: [www.afcweb.com](http://www.afcweb.com).
  - 2. Electri-Flex Company: [www.electriflex.com](http://www.electriflex.com).
  - 3. International Metal Hose: [www.metalhose.com](http://www.metalhose.com).
  - 4. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Description: NFPA 70, Type LFMC polyvinyl chloride (PVC) jacketed steel flexible metal conduit listed and labeled as complying with UL 360.
- C. Fittings:
  - 1. Manufacturers:
    - a. Bridgeport Fittings Inc: [www.bptfittings.com](http://www.bptfittings.com).
    - b. O-Z/Gedney, a brand of Emerson Industrial Automation: [www.emersonindustrial.com](http://www.emersonindustrial.com).
    - c. Thomas & Betts Corporation: [www.tnb.com](http://www.tnb.com).
    - d. Substitutions: See Section 01 60 00 - Product Requirements.
  - 2. Description: Fittings complying with NEMA FB 1 and listed and labeled as complying with UL 514B.
  - 3. Material: Use steel, malleable iron, aluminum, or die cast zinc.
- D. Description: Interlocked steel construction with PVC jacket.
- E. Fittings: NEMA FB 1.

#### **2.06 ELECTRICAL METALLIC TUBING (EMT)**

- A. Manufacturers:
  - 1. Allied Tube & Conduit: [www.alliedeg.com](http://www.alliedeg.com).
  - 2. Republic Conduit: [www.republic-conduit.com](http://www.republic-conduit.com).
  - 3. Wheatland Tube Company: [www.wheatland.com](http://www.wheatland.com).
  - 4. Triangle
  - 5. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Description: NFPA 70, Type EMT steel electrical metallic tubing complying with ANSI C80.3 and listed and labeled as complying with UL 797.

- C. Fittings:
  - 1. Manufacturers:
    - a. Bridgeport Fittings Inc: [www.bptfittings.com](http://www.bptfittings.com).
    - b. O-Z/Gedney, a brand of Emerson Industrial Automation: [www.emersonindustrial.com](http://www.emersonindustrial.com).
    - c. Thomas & Betts Corporation: [www.tnb.com](http://www.tnb.com).
    - d. Substitutions: See Section 01 60 00 - Product Requirements.
  - 2. Description: Fittings complying with NEMA FB 1 and listed and labeled as complying with UL 514B.
  - 3. Material: Use steel or malleable iron.
  - 4. Connectors and Couplings: Use compression (gland) type.
    - a. Do not use indenter type connectors and couplings.
    - b. Do not use set-screw type connectors and couplings.
- D. Description: ANSI C80.3; galvanized tubing.
- E. Fittings and Conduit Bodies: NEMA FB 1; steel or malleable iron compression type.

## 2.07 RIGID POLYVINYL CHLORIDE (PVC) CONDUIT

- A. Manufacturers:
  - 1. Cantex Inc: [www.cantexinc.com](http://www.cantexinc.com).
  - 2. Carlon, a brand of Thomas & Betts Corporation: [www.carlon.com](http://www.carlon.com).
  - 3. JM Eagle: [www.jmeagle.com](http://www.jmeagle.com).
  - 4. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Description: NFPA 70, Type PVC rigid polyvinyl chloride conduit complying with NEMA TC 2 and listed and labeled as complying with UL 651; Schedule 40 unless otherwise indicated, Schedule 80 where subject to physical damage, rated for use with conductors rated 90 degrees C.
- C. Fittings:
  - 1. Manufacturer: Same as manufacturer of conduit to be connected.
  - 2. Description: Fittings complying with NEMA TC 3 and listed and labeled as complying with UL 651; material to match conduit.

## 2.08 ACCESSORIES

- A. Corrosion Protection Tape: PVC-based, minimum thickness of 20 mil.
- B. Conduit Joint Compound: Corrosion-resistant, electrically conductive; suitable for use with the conduit to be installed.
- C. Solvent Cement for PVC Conduit and Fittings: As recommended by manufacturer of conduit and fittings to be installed.
- D. Pull Strings: Use nylon cord with average breaking strength of not less than 200 pound-force.
- E. Sealing Compound for Sealing Fittings: Listed for use with the particular fittings to be installed.
- F. Modular Seals for Conduit Penetrations: Rated for minimum of 40 psig; Suitable for the conduits to be installed.

## PART 3 EXECUTION

### 3.01 EXAMINATION

- A. Verify that field measurements are as shown on drawings.
- B. Verify that mounting surfaces are ready to receive conduits.
- C. Verify that conditions are satisfactory for installation prior to starting work.

- D. Conduit routing is shown on drawings in approximate locations unless dimensioned. Route as required to complete wiring system.

### 3.02 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.
- B. Install conduit in a neat and workmanlike manner in accordance with NECA 1.
- C. Install galvanized steel rigid metal conduit (RMC) in accordance with NECA 101.
- D. Install PVC-coated galvanized steel rigid metal conduit (RMC) using only tools approved by the manufacturer.
- E. Install rigid polyvinyl chloride (PVC) conduit in accordance with NECA 111.
- F. Conduit Routing:
  - 1. Unless dimensioned, conduit routing indicated is diagrammatic.
  - 2. When conduit destination is indicated and routing is not shown, determine exact routing required.
  - 3. Conceal all conduits unless specifically indicated to be exposed.
  - 4. Conduits in the following areas may be exposed, unless otherwise indicated:
    - a. Electrical rooms.
    - b. Mechanical equipment rooms.
    - c. Within joists in areas with no ceiling.
  - 5. Unless otherwise approved, do not route conduits exposed:
    - a. Across floors.
    - b. Across roofs.
    - c. Across top of parapet walls.
    - d. Across building exterior surfaces.
  - 6. Conduits installed underground or embedded in concrete may be routed in the shortest possible manner unless otherwise indicated. Route all other conduits parallel or perpendicular to building structure and surfaces, following surface contours where practical.
  - 7. Arrange conduit to maintain adequate headroom, clearances, and access.
  - 8. Arrange conduit to provide no more than the equivalent of four 90 degree bends between pull points.
  - 9. Arrange conduit to provide no more than 150 feet between pull points.
  - 10. Route conduits above water and drain piping where possible.
  - 11. Arrange conduit to prevent moisture traps. Provide drain fittings at low points and at sealing fittings where moisture may collect.
  - 12. Maintain minimum clearance of 6 inches between conduits and piping for other systems.
  - 13. Maintain minimum clearance of 12 inches between conduits and hot surfaces. This includes, but is not limited to:
    - a. Heaters.
    - b. Hot water piping.
    - c. Flues.
  - 14. Group parallel conduits in the same area together on a common rack.
- G. Conduit Support:
  - 1. Secure and support conduits in accordance with NFPA 70 and Section 26 05 29 using suitable supports and methods approved by the authority having jurisdiction.
  - 2. Provide independent support from building structure. Do not provide support from piping, ductwork, or other systems.
  - 3. Installation Above Suspended Ceilings: Do not provide support from ceiling support system. Do not provide support from ceiling grid or allow conduits to lay on ceiling tiles.
  - 4. Use conduit strap to support single surface-mounted conduit.

- a. Use clamp back spacer with conduit strap for damp and wet locations to provide space between conduit and mounting surface.
  5. Use metal channel (strut) with accessory conduit clamps to support multiple parallel surface-mounted conduits.
  6. Use conduit clamp to support single conduit from beam clamp or threaded rod.
  7. Use trapeze hangers assembled from threaded rods and metal channel (strut) with accessory conduit clamps to support multiple parallel suspended conduits.
  8. Use of spring steel conduit clips for support of conduits is not permitted.
  9. Use of wire for support of conduits is not permitted.
  10. Where conduit support intervals specified in NFPA 70 and NECA standards differ, comply with the most stringent requirements.
- H. Connections and Terminations:
1. Use approved zinc-rich paint or conduit joint compound on field-cut threads of galvanized steel conduits prior to making connections.
  2. Where two threaded conduits must be joined and neither can be rotated, use three-piece couplings or split couplings. Do not use running threads.
  3. Use suitable adapters where required to transition from one type of conduit to another.
  4. Provide drip loops for liquidtight flexible conduit connections to prevent drainage of liquid into connectors.
  5. Terminate threaded conduits in boxes and enclosures using threaded hubs or double lock nuts for dry locations and raintight hubs for wet locations.
  6. Where spare conduits stub up through concrete floors and are not terminated in a box or enclosure, provide threaded couplings equipped with threaded plugs set flush with finished floor.
  7. Provide insulating bushings or insulated throats at all conduit terminations to protect conductors.
  8. Secure joints and connections to provide maximum mechanical strength and electrical continuity.
- I. Penetrations:
1. Do not penetrate or otherwise notch or cut structural members, including footings and grade beams, without approval of Structural Engineer.
  2. Make penetrations perpendicular to surfaces unless otherwise indicated.
  3. Provide sleeves for penetrations as indicated or as required to facilitate installation. Set sleeves flush with exposed surfaces unless otherwise indicated or required.
  4. Conceal bends for conduit risers emerging above ground.
  5. Seal interior of conduits entering the building from underground at first accessible point to prevent entry of moisture and gases.
  6. Provide suitable modular seal where conduits penetrate exterior wall below grade.
  7. Where conduits penetrate waterproof membrane, seal as required to maintain integrity of membrane.
  8. Make penetrations for roof-mounted equipment within associated equipment openings and curbs where possible to minimize roofing system penetrations. Where penetrations are necessary, seal as indicated or as required to preserve integrity of roofing system and maintain roof warranty. Include proposed locations of penetrations and methods for sealing with submittals.
  9. Provide metal escutcheon plates for conduit penetrations exposed to public view.
  10. Install firestopping to preserve fire resistance rating of partitions and other elements, using materials and methods specified in Section 07 84 00.
- J. Underground Installation:
1. Provide trenching and backfilling in accordance with Sections 31 23 16 and 31 2323.
  2. Minimum Cover, Unless Otherwise Indicated or Required:

- a. Underground, Exterior: 24 inches.
  - b. Under Slab on Grade: 24 inches to bottom of slab.
3. Provide underground warning tape in accordance with Section 26 05 53 along entire conduit length.
- K. Concrete Encasement: Where conduits not otherwise embedded within concrete are indicated to be concrete-encased, provide concrete in accordance with Section 03 30 00 with minimum concrete cover of 2 inches on all sides unless otherwise indicated.
- L. Conduit Movement Provisions: Where conduits are subject to movement, provide expansion and expansion/deflection fittings to prevent damage to enclosed conductors or connected equipment. This includes, but is not limited to:
1. Where conduits cross structural joints intended for expansion, contraction, or deflection.
  2. Where conduits are subject to earth movement by settlement or frost.
- M. Condensation Prevention: Where conduits cross barriers between areas of potential substantial temperature differential, provide sealing fitting or approved sealing compound at an accessible point near the penetration to prevent condensation. This includes, but is not limited to:
1. Where conduits pass from outdoors into conditioned interior spaces.
  2. Where conduits pass from unconditioned interior spaces into conditioned interior spaces.
- N. Provide pull string in all empty conduits and in conduits where conductors and cables are to be installed by others. Leave minimum slack of 12 inches at each end.
- O. Provide grounding and bonding in accordance with Section 26 05 26.
- P. Identify conduits in accordance with Section 26 05 53.

### 3.03 FIELD QUALITY CONTROL

- A. See Section 01 40 00 - Quality Requirements, for additional requirements.
- B. Repair cuts and abrasions in galvanized finishes using zinc-rich paint recommended by manufacturer. Replace components that exhibit signs of corrosion.
- C. Where coating of PVC-coated galvanized steel rigid metal conduit (RMC) contains cuts or abrasions, repair in accordance with manufacturer's instructions.
- D. Correct deficiencies and replace damaged or defective conduits.

### 3.04 CLEANING

- A. Clean interior of conduits to remove moisture and foreign matter.

### 3.05 PROTECTION

- A. Immediately after installation of conduit, use suitable manufactured plugs to provide protection from entry of moisture and foreign material and do not remove until ready for installation of conductors.
- B. Install conduit securely, in a neat and workmanlike manner, as specified in NECA 1.
- C. Install steel conduit as specified in NECA 101.
- D. Arrange supports to prevent misalignment during wiring installation.
- E. Support conduit using coated steel or malleable iron straps, lay-in adjustable hangers, clevis hangers, and split hangers.
- F. Group related conduits; support using conduit rack. Construct rack using steel channel.
- G. Fasten conduit supports to building structure and surfaces under provisions of Section 26 05 29.

- H. Do not support conduit with wire or perforated pipe straps. Remove wire used for temporary supports.
- I. Do not attach conduit to ceiling support wires.
- J. Arrange conduit to maintain headroom and present neat appearance.
- K. Route conduit parallel and perpendicular to walls.
- L. Route conduit installed above accessible ceilings parallel and perpendicular to walls.
- M. Route conduit in and under slab from point-to-point.
- N. Maintain adequate clearance between conduit and piping.
- O. Maintain 12 inch clearance between conduit and surfaces with temperatures exceeding 104 degrees F.
- P. Cut conduit square using saw or pipecutter; de-burr cut ends.
- Q. Bring conduit to shoulder of fittings; fasten securely.
- R. Use conduit hubs to fasten conduit to sheet metal boxes in damp and wet locations.
- S. Install no more than equivalent of three 90 degree bends between boxes. Use conduit bodies to make sharp changes in direction, as around beams. Use hydraulic one shot bender to fabricate bends in metal conduit larger than 2 inch size.
- T. Avoid moisture traps; provide junction box with drain fitting at low points in conduit system.
- U. Provide suitable fittings to accommodate expansion and deflection where conduit crosses seismic.
- V. Provide suitable pull string in each empty conduit except sleeves and nipples.
- W. Use suitable caps to protect installed conduit against entrance of dirt and moisture.
- X. Ground and bond conduit under provisions of Section 26 05 26.
- Y. Identify conduit under provisions of Section 26 05 53.

### **3.06 INTERFACE WITH OTHER PRODUCTS**

- A. Install conduit to preserve fire resistance rating of partitions and other elements, using materials and methods specified in Section 07 84 00.

**END OF SECTION**

## SECTION 26 05 37

### BOXES

#### PART 1 GENERAL

##### 1.01 SECTION INCLUDES

- A. Outlet and device boxes up to 100 cubic inches, including those used as junction and pull boxes.
- B. Cabinets and enclosures, including junction and pull boxes larger than 100 cubic inches.
- C. Wall and ceiling outlet boxes.
- D. Pull and junction boxes.

##### 1.02 RELATED REQUIREMENTS

- A. Section 07 84 00 - Firestopping.
- B. Section 08 31 00 - Access Doors and Panels: Panels for maintaining access to concealed boxes.
- C. Section 26 05 26 - Grounding and Bonding for Electrical Systems.
- D. Section 26 05 29 - Hangers and Supports for Electrical Systems.
- E. Section 26 05 34 - Conduit:
  - 1. Conduit bodies and other fittings.
  - 2. Additional requirements for locating boxes to limit conduit length and/or number of bends between pulling points.
- F. Section 26 05 35 - Surface Raceways:
  - 1. Accessory boxes designed specifically for surface raceway systems.
- G. Section 26 05 53 - Identification for Electrical Systems: Identification products and requirements.
- H. Section 26 27 26 - Wiring Devices: Wall plates in finished areas.

##### 1.03 REFERENCE STANDARDS

- A. NECA 1 - Standard for Good Workmanship in Electrical Construction; National Electrical Contractors Association; 2010.
- B. NECA 130 - Standard for Installing and Maintaining Wiring Devices; National Electrical Contractors Association; 2010.
- C. NEMA FB 1 - Fittings, Cast Metal Boxes, and Conduit Bodies for Conduit, Electrical Metallic Tubing, and Cable; National Electrical Manufacturers Association; 2012 (ANSI/NEMA FB 1).
- D. NEMA OS 1 - Sheet-Steel Outlet Boxes, Device Boxes, Covers, and Box Supports; National Electrical Manufacturers Association; 2008 (Revised 2010) (ANSI/NEMA OS 1).
- E. NEMA 250 - Enclosures for Electrical Equipment (1000 Volts Maximum); National Electrical Manufacturers Association; 2008.
- F. NFPA 70 - National Electrical Code; National Fire Protection Association; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- G. UL 50 - Enclosures for Electrical Equipment, Non-Environmental Considerations; Current Edition, Including All Revisions.

- H. UL 50E - Enclosures for Electrical Equipment, Environmental Considerations; Current Edition, Including All Revisions.
- I. UL 514A - Metallic Outlet Boxes; Current Edition, Including All Revisions.

#### **1.04 ADMINISTRATIVE REQUIREMENTS**

- A. Coordination:
  - 1. Coordinate the work with other trades to avoid placement of ductwork, piping, equipment, or other potential obstructions within the dedicated equipment spaces and working clearances for electrical equipment required by NFPA 70.
  - 2. Coordinate arrangement of electrical equipment with the dimensions and clearance requirements of the actual equipment to be installed.
  - 3. Coordinate minimum sizes of boxes with the actual installed arrangement of conductors, clamps, support fittings, and devices, calculated according to NFPA 70.
  - 4. Coordinate minimum sizes of pull boxes with the actual installed arrangement of connected conduits, calculated according to NFPA 70.
  - 5. Coordinate the placement of boxes with millwork, furniture, devices, equipment, etc. installed under other sections or by others.
  - 6. Coordinate the work with other trades to preserve insulation integrity.
  - 7. Coordinate the work with other trades to provide walls suitable for installation of flush-mounted boxes where indicated.
  - 8. Notify Delaware Engineering and Design Corporation of any conflicts with or deviations from the contract documents. Obtain direction before proceeding with work.

#### **1.05 SUBMITTALS**

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide manufacturer's standard catalog pages and data sheets for outlet and device boxes and junction and pull boxes.
- C. Project Record Documents: Record actual locations for outlet and device boxes, junction boxes, and pull boxes.

#### **1.06 QUALITY ASSURANCE**

- A. Conform to requirements of NFPA 70.
- B. Maintain at the project site a copy of each referenced document that prescribes execution requirements.

#### **1.07 DELIVERY, STORAGE, AND HANDLING**

- A. Receive, inspect, handle, and store products in accordance with manufacturer's instructions.
- B. Products: Provide products listed and classified by Underwriters Laboratories Inc., as suitable for the purpose specified and indicated.

### **PART 2 PRODUCTS**

#### **2.01 BOXES**

- A. General Requirements:
  - 1. Do not use boxes and associated accessories for applications other than as permitted by NFPA 70 and product listing.
  - 2. Provide all boxes, fittings, supports, and accessories required for a complete raceway system and to accommodate devices and equipment to be installed.
  - 3. Provide products listed, classified, and labeled by Underwriter's Laboratories Inc. (UL) or testing firm acceptable to authority having jurisdiction as suitable for the purpose indicated.

4. Where box size is not indicated, size to comply with NFPA 70 but not less than applicable minimum size requirements specified.
  5. Provide grounding terminals within boxes where equipment grounding conductors terminate.
- B. Outlet and Device Boxes Up to 100 cubic inches, Including Those Used as Junction and Pull Boxes:
1. Use sheet-steel boxes for dry locations unless otherwise indicated or required.
  2. Use cast iron boxes or cast aluminum boxes for damp or wet locations unless otherwise indicated or required; furnish with compatible weatherproof gasketed covers.
  3. Use cast iron boxes or cast aluminum boxes where exposed galvanized steel rigid metal conduit is used.
  4. Do not use "through-wall" boxes designed for access from both sides of wall.
  5. Sheet-Steel Boxes: Comply with NEMA OS 1, and list and label as complying with UL 514A.
  6. Cast Metal Boxes: Comply with NEMA FB 1, and list and label as complying with UL 514A; furnish with threaded hubs.
  7. Manufacturers:
    - a. Cooper Crouse-Hinds, a division of Cooper Industries: [www.cooperindustries.com](http://www.cooperindustries.com).
    - b. Hubbell Incorporated; Bell Products: [www.hubbell-bell.com](http://www.hubbell-bell.com).
    - c. Hubbell Incorporated; RACO Products: [www.hubbell-raco.com](http://www.hubbell-raco.com).
    - d. O-Z/Gedney, a brand of Emerson Industrial Automation: [www.emersonindustrial.com](http://www.emersonindustrial.com).
    - e. Thomas & Betts Corporation: [www.tnb.com](http://www.tnb.com).
    - f. Steel City.
    - g. Substitutions: See Section 01 60 00 - Product Requirements.
- C. Cabinets and Enclosures, Including Junction and Pull Boxes Larger Than 100 cubic inches:
1. Comply with NEMA 250, and list and label as complying with UL 50 and UL 50E, or UL 508A.
  2. NEMA 250 Environment Type, Unless Otherwise Indicated:
    - a. Indoor Clean, Dry Locations: Type 1, painted steel.
    - b. Outdoor Locations: Type 3R, painted steel.
  3. Junction and Pull Boxes Larger Than 100 cubic inches:
    - a. Provide screw-cover or hinged-cover enclosures unless otherwise indicated.
  4. Finish for Painted Steel Enclosures: Manufacturer's standard grey unless otherwise indicated.
  5. Manufacturers:
    - a. Cooper B-Line, a division of Cooper Industries: [www.cooperindustries.com](http://www.cooperindustries.com).
    - b. Hoffman, a brand of Pentair Technical Products: [www.hoffmanonline.com](http://www.hoffmanonline.com).
    - c. Hubbell Incorporated; Wiegmann Products: [www.hubbell-wiegmann.com](http://www.hubbell-wiegmann.com).
    - d. Substitutions: See Section 01 60 00 - Product Requirements.

## 2.02 PULL AND JUNCTION BOXES

- A. Sheet Metal Boxes: NEMA OS 1, galvanized steel.
- B. Hinged Enclosures: As specified in Section 26 27 16.
- C. Surface Mounted Cast Metal Box: NEMA 250, Type 4; flat-flanged, surface mounted junction box:
  1. Material: Galvanized cast iron.
  2. Cover: Furnish with ground flange, neoprene gasket, and stainless steel cover screws.

## PART 3 EXECUTION

### 3.01 EXAMINATION

- A. Verify that field measurements are as shown on drawings.

- B. Verify that mounting surfaces are ready to receive boxes.
- C. Verify that conditions are satisfactory for installation prior to starting work.
- D. Verify locations of floor boxes and outlets in offices and work areas prior to rough-in.

### 3.02 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.
- B. Perform work in a neat and workmanlike manner in accordance with NECA 1 and, where applicable, NECA 130, including mounting heights specified in those standards where mounting heights are not indicated.
- C. Arrange equipment to provide minimum clearances in accordance with manufacturer's instructions and NFPA 70.
- D. Unless otherwise indicated, provide separate boxes for line voltage and low voltage systems.
- E. Flush-mount boxes in finished areas unless specifically indicated to be surface-mounted.
- F. Unless otherwise indicated, boxes may be surface-mounted where exposed conduits are indicated or permitted.
- G. Box Locations:
  - 1. Locate boxes to be accessible. Provide access panels as required.
  - 2. Unless dimensioned, box locations indicated are approximate.
  - 3. Locate boxes so that wall plates do not span different building finishes.
  - 4. Locate boxes so that wall plates do not cross masonry joints.
  - 5. Unless otherwise indicated, where multiple outlet boxes are installed at the same location at different mounting heights, install along a common vertical center line.
  - 6. Locate junction and pull boxes as indicated, as required to facilitate installation of conductors, and to limit conduit length and/or number of bends between pulling points in accordance with Section 26 05 34.
  - 7. Locate junction and pull boxes in the following areas, unless otherwise indicated:
    - a. Concealed above accessible suspended ceilings.
    - b. Within joists in areas with no ceiling.
    - c. Electrical rooms.
    - d. Mechanical equipment rooms.
- H. Box Supports:
  - 1. Secure and support boxes in accordance with NFPA 70 and Section 26 05 29 using suitable supports and methods approved by the authority having jurisdiction.
  - 2. Provide independent support from building structure except for cast metal boxes (other than boxes used for fixture support) supported by threaded conduit connections in accordance with NFPA 70. Do not provide support from piping, ductwork, or other systems.
  - 3. Installation Above Suspended Ceilings: Do not provide support from ceiling grid or ceiling support system.
  - 4. Use far-side support to secure flush-mounted boxes supported from single stud in hollow stud walls. Repair or replace supports for boxes that permit excessive movement.
- I. Install boxes plumb and level.
- J. Install boxes as required to preserve insulation integrity.
- K. Install firestopping to preserve fire resistance rating of partitions and other elements, using materials and methods specified.
- L. Close unused box openings.

- M. Install blank wall plates on junction boxes and on outlet boxes with no devices or equipment installed or designated for future use.
- N. Provide grounding and bonding in accordance with Section 26 05 26.
- O. Identify boxes in accordance with Section 26 05 53.
- P. Install boxes securely, in a neat and workmanlike manner, as specified in NECA 1.
- Q. Install in locations as shown on Drawings, and as required for splices, taps, wire pulling, equipment connections, and as required by NFPA 70.
- R. Coordinate installation of outlet boxes for equipment connected under Section 26 27 17.
- S. Set wall mounted boxes at elevations to accommodate mounting heights indicated.
- T. Electrical boxes are shown on Drawings in approximate locations unless dimensioned.
  - 1. Adjust box locations up to 10 feet if required to accommodate intended purpose.
- U. Orient boxes to accommodate wiring devices oriented as specified in Section 26 27 26.
- V. Maintain headroom and present neat mechanical appearance.
- W. Install pull boxes and junction boxes above accessible ceilings and in unfinished areas only.
- X. Inaccessible Ceiling Areas: Install outlet and junction boxes no more than 6 inches from ceiling access panel or from removable recessed luminaire.
- Y. Install boxes to preserve fire resistance rating of partitions and other elements, using materials and methods specified in Section 07 84 00.
- Z. Coordinate mounting heights and locations of outlets mounted above counters, benches, and backsplashes.
- AA. Locate outlet boxes to allow luminaires to be positioned as shown on reflected ceiling plan.
- AB. Align adjacent wall mounted outlet boxes for switches, thermostats, and similar devices.
- AC. Unless otherwise indicated, provide separate boxes for line voltage and low voltage systems.
- AD. Locate outlet boxes so that wall plates do not cross masonry joints.
- AE. Do not fasten boxes to ceiling support wires.
- AF. Support boxes independently of conduit, except cast box that is connected to two rigid metal conduits both supported within 12 inches of box.
- AG. Use gang box where more than one device is mounted together. Do not use sectional box.
- AH. Use gang box with plaster ring for single device outlets.
- AI. Use cast outlet box in exterior locations exposed to the weather and wet locations.

### **3.03 ADJUSTING**

- A. Install knockout closures in unused box openings.

### **3.04 CLEANING**

- A. Clean interior of boxes to remove dirt, debris, plaster and other foreign material.

### **3.05 PROTECTION**

- A. Immediately after installation, protect boxes from entry of moisture and foreign material until ready for installation of conductors.

State of Delaware  
Supreme Court Building - Basement Level Sprinkler System  
OMB/DFM Project # MC1002000170

B. Clean exposed surfaces and restore finish.

**END OF SECTION**

Not For Bidding Purposes

**SECTION 26 05 53**

**IDENTIFICATION FOR ELECTRICAL SYSTEMS**

**PART 1 GENERAL**

**1.01 SECTION INCLUDES**

- A. Electrical identification requirements.
- B. Large Device Identification.
- C. Nameplates and Labels.
- D. Wire and cable markers.
- E. Voltage markers.
- F. Underground warning tape.
- G. Warning signs and labels.

**1.02 RELATED REQUIREMENTS**

- A. Section 26 05 19 - Low-Voltage Electrical Power Conductors and Cables: Color coding for power conductors and cables 600 V and less; vinyl color coding electrical tape.

**1.03 REFERENCE STANDARDS**

- A. ANSI Z535.2 - American National Standard for Environmental and Facility Safety Signs; 2007.
- B. ANSI Z535.4 - American National Standard for Product Safety Signs and Labels; 2007.
- C. NFPA 70 - National Electrical Code; National Fire Protection Association; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- D. NFPA 70E - Standard for Electrical Safety in the Workplace; 2012.
- E. UL 969 - Marking and Labeling Systems; Current Edition, Including All Revisions.

**1.04 ADMINISTRATIVE REQUIREMENTS**

- A. Coordination:
  - 1. Verify final designations for equipment, systems, and components to be identified prior to fabrication of identification products.
- B. Sequencing:
  - 1. Do not conceal items to be identified, in locations such as above suspended ceilings, until identification products have been installed.
  - 2. Do not install identification products until final surface finishes and painting are complete.

**1.05 SUBMITTALS**

- A. See Section 01 30 00 - Administrative Requirements for submittals procedures.
- B. Product Data: Provide manufacturer's standard catalog pages and data sheets for each product.
- C. Shop Drawings: Provide schedule of items to be identified indicating proposed designations, materials, legends, and formats.

**1.06 QUALITY ASSURANCE**

- A. Conform to requirements of NFPA 70.

### 1.07 FIELD CONDITIONS

- A. Do not install adhesive products when ambient temperature is lower than recommended by manufacturer.

## PART 2 PRODUCTS

### 2.01 IDENTIFICATION REQUIREMENTS

- A. Identification for Equipment:
  - 1. Use identification nameplate to identify each piece of electrical distribution and control equipment and associated sections, compartments, and components.
    - a. Enclosed circuit breakers and motor controllers:
      - 1) Identify voltage and phase.
      - 2) Identify power source and circuit number. Include location when not within sight of equipment.
      - 3) Identify load(s) served. Include location when not within sight of equipment.
  - 2. Service Equipment:
    - a. Use identification nameplate to identify each service disconnecting means.
    - b. Use identification nameplate at each piece of service equipment to identify the available fault current and the date calculations were performed.
  - 3. Use identification nameplate to identify equipment utilizing series ratings, where permitted, in accordance with NFPA 70.
  - 4. Use identification nameplate to identify disconnect location for equipment with remote disconnecting means.
  - 5. Arc Flash Hazard Warning Labels: Use warning labels to identify arc flash hazards for electrical equipment, such as switchboards, panelboards, industrial control panels, meter socket enclosures, and motor control centers that are likely to require examination, adjustment, servicing, or maintenance while energized.
    - a. Minimum Size: 3.5 by 5 inches.
    - b. Legend: Include orange header that reads "WARNING", followed by the word message "Arc Flash and Shock Hazard; Appropriate PPE Required; Do not operate controls or open covers without appropriate personal protection equipment; Failure to comply may result in injury or death; Refer to NFPA 70E for minimum PPE requirements" or approved equivalent.
  - 6. Use warning signs to identify electrical hazards for entrances to all rooms and other guarded locations that contain exposed live parts operating at 600 V nominal or less with the word message "DANGER; Electrical hazard; Authorized personnel only" or approved equivalent.
- B. Identification for Conductors and Cables:
  - 1. Color Coding for Power Conductors 600 V and Less: Comply with Section 26 05 19.
  - 2. Use wire and cable markers to identify circuit number or other designation indicated for power, control, and instrumentation conductors and cables at the following locations:
    - a. At each source and load connection.
    - b. Within boxes when more than one circuit is present.
    - c. Within equipment enclosures when conductors and cables enter or leave the enclosure.
  - 3. Use wire and cable markers to identify connected grounding electrode system components for grounding electrode conductors.
- C. Identification for Raceways:
  - 1. Use voltage markers or color-coded bands to identify systems other than normal power system for accessible conduits at maximum intervals of 20 feet.
    - a. Color-Coded Bands: Use field-painting or vinyl color coding electrical tape to mark bands 3 inches wide.

- 1) Color Code:
    - (a) Fire Alarm System: Red.
  - 2) Vinyl Color Coding Electrical Tape: Comply with Section 26 05 19.
  2. Use identification labels or plastic marker tags to identify circuits enclosed for accessible conduits at wall penetrations, at floor penetrations, at roof penetrations, and at equipment terminations when source is not within sight.
  3. Use identification labels or plastic marker tags to identify spare conduits at each end. Identify purpose and termination location.
  4. Use underground warning tape to identify underground raceways.
- D. Identification for Boxes:
1. Use voltage markers or color coded boxes to identify systems other than normal power system.
    - a. Color-Coded Boxes: Field-painted with the same color code used for raceways.
      - 1) Fire Alarm System: Red.
  2. Use identification labels to identify circuits enclosed.
- E. Identification for Devices:
1. Use identification label to identify fire alarm system devices.
    - a. For devices concealed above suspended ceilings, provide additional identification on ceiling tile below device location.
  2. Use identification label or engraved wallplate to identify load controlled for wall-mounted control devices controlling loads that are not visible from the control location and for multiple wall-mounted control devices installed at one location.

## 2.02 MANUFACTURERS

- A. Brady Corporation: [www.bradycorp.com](http://www.bradycorp.com).
- B. Substitutions: See Section 01 60 00 - Product Requirements.

## 2.03 LARGE DEVICE IDENTIFICATION

- A. Identify all disconnect switches, pull boxes, junction boxes (larger than 4" X 4") in unfinished areas with Brady voltage markers, catalog #B-498, series #44xxx (xxx indicates last 3 numbers of model number which vary based on voltage, size, etc. Contractor shall coordinate this information prior to ordering). Sizes for each label shall be as large as possible, style "A", "B" or "C" as the device permits.
- B. Identify all disconnect switches, pull boxes, junction boxes (larger than 4" X 4") finished with black engraved lamicoid self-adhesive labels, 1" X 4". The label shall state the power feed, circuit or section number, and the equipment identification number that the large device serves.

## 2.04 IDENTIFICATION NAMEPLATES AND LABELS

- A. Identification Nameplates:
  1. Manufacturers:
    - a. Brimar Industries, Inc: [www.brimar.com](http://www.brimar.com).
    - b. Kolbi Pipe Marker Co: [www.kolbipipemarkers.com](http://www.kolbipipemarkers.com).
    - c. Seton Identification Products: [www.seton.com](http://www.seton.com).
    - d. Substitutions: See Section 01 60 00 - Product Requirements.
  2. Materials:
    - a. Indoor Clean, Dry Locations: Use plastic nameplates.
    - b. Outdoor Locations: Use plastic, stainless steel, or aluminum nameplates suitable for exterior use.
  3. Plastic Nameplates: Two-layer or three-layer laminated acrylic or electrically non-conductive phenolic with beveled edges; minimum thickness of 1/16 inch; engraved text.

- a. Exception: Provide minimum thickness of 1/8 inch when any dimension is greater than 4 inches.
  4. Stainless Steel Nameplates: Minimum thickness of 1/32 inch; engraved or laser-etched text.
  5. Aluminum Nameplates: Anodized; minimum thickness of 1/32 inch; engraved or laser-etched text.
  6. Mounting Holes for Mechanical Fasteners: Two, centered on sides for sizes up to 1 inch high; Four, located at corners for larger sizes.
- B. Identification Labels:
1. Manufacturers:
    - a. Brady Corporation: [www.bradyid.com](http://www.bradyid.com).
    - b. Brother International Corporation: [www.brother-usa.com](http://www.brother-usa.com).
    - c. Panduit Corp: [www.panduit.com](http://www.panduit.com).
    - d. Substitutions: See Section 01 60 00 - Product Requirements.
  2. Materials: Use self-adhesive laminated plastic labels; UV, chemical, water, heat, and abrasion resistant.
    - a. Use only for indoor locations.
  3. Text: Use factory pre-printed or machine-printed text. Do not use handwritten text unless otherwise indicated.
- C. Format for Equipment Identification:
1. Minimum Size: 1 inch by 2.5 inches.
  2. Legend:
    - a. System designation where applicable:
      - 1) Fire Alarm System: Identify with text "FIRE ALARM".
    - b. Equipment designation or other approved description.
  3. Text: All capitalized unless otherwise indicated.
  4. Minimum Text Height:
    - a. System Designation: 1 inch.
    - b. Equipment Designation: 1/2 inch.
    - c. Other Information: 1/4 inch.
    - d. Exception: Provide minimum text height of 1 inch for equipment located more than 10 feet above floor or working platform.
  5. Color:
    - a. Normal Power System: White text on black background.
    - b. Fire Alarm System: White text on red background.
- D. Format for General Information and Operating Instructions:
1. Minimum Size: 1 inch by 2.5 inches.
  2. Legend: Include information or instructions indicated or as required for proper and safe operation and maintenance.
  3. Text: All capitalized unless otherwise indicated.
  4. Minimum Text Height: 1/4 inch.
  5. Color: Black text on white background unless otherwise indicated.
    - a. Exceptions:
      - 1) Provide white text on red background for general information or operational instructions for fire alarm systems.
- E. Format for Caution and Warning Messages:
1. Minimum Size: 2 inches by 4 inches.
  2. Legend: Include information or instructions indicated or as required for proper and safe operation and maintenance.
  3. Text: All capitalized unless otherwise indicated.
  4. Minimum Text Height: 1/2 inch.

5. Color: Black text on yellow background unless otherwise indicated.
- F. Format for Control Device Identification:
  1. Minimum Size: 3/8 inch by 1.5 inches.
  2. Legend: Load controlled or other designation indicated.
  3. Text: All capitalized unless otherwise indicated.
  4. Minimum Text Height: 3/16 inch.
  5. Color: Black text on clear background.
- G. Format for Fire Alarm Device Identification:
  1. Minimum Size: 3/8 inch by 1.5 inches.
  2. Legend: Designation indicated and device zone or address.
  3. Text: All capitalized unless otherwise indicated.
  4. Minimum Text Height: 3/16 inch.
  5. Color: Red text on white background.
- H. Nameplates: Engraved three-layer laminated plastic, black letters on white background, 2" by 6" in size
- I. Locations:
  1. Each electrical distribution and control equipment enclosure.
  2. Disconnect Switches
- J. Letter Size:
  1. Use 1/8 inch letters for identifying individual equipment and loads.
- K. Labels: Embossed adhesive tape, with 3/16 inch (5 mm) white letters on black background.  
Use only for identification of individual wall switches and receptacles, and control device stations.

## 2.05 WIRE AND CABLE MARKERS

- A. Manufacturers:
  1. Brady Corporation: [www.bradyid.com](http://www.bradyid.com).
  2. HellermannTyton: [www.hellermannityton.com](http://www.hellermannityton.com).
  3. Panduit Corp: [www.panduit.com](http://www.panduit.com).
  4. Brady, Bradysleeve, Catalog #B-320 PVC.
  5. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Markers for Conductors and Cables: Use wrap-around self-adhesive vinyl cloth, wrap-around self-adhesive vinyl self-laminating, heat-shrink sleeve, plastic sleeve, plastic clip-on, or vinyl split sleeve type markers suitable for the conductor or cable to be identified.
- C. Markers for Conductor and Cable Bundles: Use plastic marker tags secured by nylon cable ties.
- D. Legend: Power source and circuit number or other designation indicated.
- E. Text: Use factory pre-printed or machine-printed text, all capitalized unless otherwise indicated.
  1. Do not use handwritten text.
- F. Minimum Text Height: 1/8 inch.
- G. Color: Black text on white background unless otherwise indicated.
- H. Locations: Each conductor at pull boxes, junction boxes, and Termination or connection points including each load connection.
- I. Legend:
  1. Power and Lighting Circuits: Branch circuit or feeder number indicated on drawings.

## 2.06 VOLTAGE MARKERS

- A. Manufacturers:
  - 1. Brady Corporation: [www.bradyid.com](http://www.bradyid.com).
  - 2. Brimar Industries, Inc: [www.brimar.com](http://www.brimar.com).
  - 3. Seton Identification Products: [www.seton.com](http://www.seton.com).
  - 4. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Markers for Boxes and Equipment Enclosures: Use factory pre-printed self-adhesive vinyl or self-adhesive vinyl cloth type markers.
- C. Minimum Size:
  - 1. Markers for Equipment: 1 1/8 by 4 1/2 inches.
  - 2. Markers for Pull Boxes: 1 1/8 by 4 1/2 inches.
  - 3. Markers for Junction Boxes: 1/2 by 2 1/4 inches.
- D. Legend:
  - 1. Markers for System Identification:
    - a. Other Systems: Type of service.
- E. Color: Black text on orange background unless otherwise indicated.

## 2.07 UNDERGROUND WARNING TAPE

- A. Manufacturers:
  - 1. Brady Corporation: [www.bradyid.com](http://www.bradyid.com).
  - 2. Brimar Industries, Inc: [www.brimar.com](http://www.brimar.com).
  - 3. Seton Identification Products: [www.seton.com](http://www.seton.com).
  - 4. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Materials: Use foil-backed detectable type polyethylene tape suitable for direct burial, unless otherwise indicated.
- C. Foil-backed Detectable Type Tape: 3 inches wide, with minimum thickness of 5 mil, unless otherwise required for proper detection.
- D. Legend: Type of service, continuously repeated over full length of tape.
- E. Color:
  - 1. Tape for Buried Power Lines: Black text on red background.

## 2.08 WARNING SIGNS AND LABELS

- A. Manufacturers:
  - 1. Brimar Industries, Inc: [www.brimar.com](http://www.brimar.com).
  - 2. Clarion Safety Systems, LLC: [www.clarionsafety.com](http://www.clarionsafety.com).
  - 3. Seton Identification Products: [www.seton.com](http://www.seton.com).
  - 4. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Comply with ANSI Z535.2 or ANSI Z535.4 as applicable.
- C. Warning Signs:
  - 1. Materials:
    - a. Indoor Dry, Clean Locations: Use factory pre-printed rigid plastic or self-adhesive vinyl signs.
    - b. Outdoor Locations: Use factory pre-printed rigid aluminum signs.
  - 2. Rigid Signs: Provide four mounting holes at corners for mechanical fasteners.
  - 3. Minimum Size: 7 by 10 inches unless otherwise indicated.
- D. Warning Labels:

1. Materials: Use factory pre-printed or machine-printed self-adhesive polyester, or self-adhesive vinyl labels; UV, chemical, water, heat, and abrasion resistant; produced using materials recognized to UL 969.
  - a. Do not use labels designed to be completed using handwritten text.
2. Machine-Printed Labels: Use thermal transfer process printing machines and accessories recommended by label manufacturer.
3. Minimum Size: 2 by 4 inches unless otherwise indicated.

### **PART 3 EXECUTION**

#### **3.01 PREPARATION**

- A. Clean surfaces to receive adhesive products according to manufacturer's instructions.
- B. Degrease and clean surfaces to receive nameplates and labels.

#### **3.02 INSTALLATION**

- A. Install products in accordance with manufacturer's instructions.
- B. Install identification products to be plainly visible for examination, adjustment, servicing, and maintenance. Unless otherwise indicated, locate products as follows:
  1. Surface-Mounted Equipment: Enclosure front.
  2. Flush-Mounted Equipment: Inside of equipment door.
  3. Free-Standing Equipment: Enclosure front; also enclosure rear for equipment with rear access.
  4. Elevated Equipment: Legible from the floor or working platform.
  5. Interior Components: Legible from the point of access.
  6. Conduits: Legible from the floor.
  7. Boxes: Outside face of cover.
  8. Conductors and Cables: Legible from the point of access.
  9. Devices: Outside face of cover.
- C. Install identification products centered, level, and parallel with lines of item being identified.
- D. Secure nameplates to exterior surfaces of enclosures using stainless steel screws and to interior surfaces using self-adhesive backing, or epoxy cement.
- E. Install self-adhesive labels and markers to achieve maximum adhesion, with no bubbles or wrinkles and edges properly sealed.
- F. Install underground warning tape above buried lines with one tape per trench at 3 inches below finished grade.
- G. Secure rigid signs using stainless steel screws.

#### **3.03 FIELD QUALITY CONTROL**

- A. See Section 01 40 00 - Quality Requirements, for additional requirements.
- B. Replace self-adhesive labels and markers that exhibit bubbles, wrinkles, curling or other signs of improper adhesion.

**END OF SECTION**

**SECTION 26 27 01**

**ELECTRICAL SERVICE ENTRANCE**

**PART 1 GENERAL**

**1.01 SECTION INCLUDES**

- A. Meter bases.

**1.02 REFERENCE STANDARDS**

- A. NECA 1 - Standard for Good Workmanship in Electrical Construction; National Electrical Contractors Association; 2010.
- B. NFPA 70 - National Electrical Code; National Fire Protection Association; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.

**1.03 SYSTEM DESCRIPTION**

- A. System Characteristics: 208Y/120 volts, single phase, four-wire, 60 Hertz.

**1.04 ADMINISTRATIVE REQUIREMENTS**

- A. Preinstallation Meeting: Convene one week prior to commencing work of this section. Review service entrance requirements and details with Utility Company representative.

**1.05 SUBMITTALS**

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide ratings and dimensions of transformer cabinets and meter bases.
- C. Submit utility company-prepared drawings.

**1.06 QUALITY ASSURANCE**

- A. Utility Company:
- B. Perform work in accordance with utility company written requirements and NFPA 70.
  - 1. Maintain one copy of each document on site.
- C. Products: Listed and classified by Underwriters Laboratories Inc. as suitable for the purpose specified and indicated.

**PART 2 PRODUCTS**

**2.01 MANUFACTURERS**

- A. GE Industrial: [www.geindustrial.com](http://www.geindustrial.com).
- B. Milbank Manufacturing: [www.milbankmfg.com](http://www.milbankmfg.com).
- C. Square D: [www.squared.com](http://www.squared.com).
- D. Substitutions: See Section 01 60 00 - Product Requirements.

**2.02 COMPONENTS**

- A. Provide service entrance components as indicated on drawings. Coordinate all requirements with utility company.
- B. Other Components: As required by utility company.

**PART 3 EXECUTION**

**3.01 PREPARATION**

- A. Arrange with utility company to obtain permanent electric service to the Project.
- B. Verify that field measurements are as indicated on utility company drawings.

**3.02 INSTALLATION**

- A. Install meter base as required by utility company.
- B. Install securely, in a neat and workmanlike manner, as specified in NECA 1.

**END OF SECTION**

Not For Bidding Purposes

**SECTION 26 27 17**

**EQUIPMENT WIRING**

**PART 1 GENERAL**

**1.01 SECTION INCLUDES**

- A. Electrical connections to equipment.

**1.02 RELATED REQUIREMENTS**

- A. Section 26 05 34 - Conduit.
- B. Section 26 05 19 - Low-Voltage Electrical Power Conductors and Cables (600 V and Less).
- C. Section 26 05 37 - Boxes.

**1.03 REFERENCE STANDARDS**

- A. NFPA 70 - National Electrical Code; National Fire Protection Association; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.

**1.04 ADMINISTRATIVE REQUIREMENTS**

- A. Coordination:
  - 1. Obtain and review shop drawings, product data, manufacturer's wiring diagrams, and manufacturer's instructions for equipment furnished under other sections.
  - 2. Determine connection locations and requirements.
- B. Sequencing:
  - 1. Install rough-in of electrical connections before installation of equipment is required.
  - 2. Make electrical connections before required start-up of equipment.

**1.05 SUBMITTALS**

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide wiring device manufacturer's catalog information showing dimensions, configurations, and construction.

**1.06 QUALITY ASSURANCE**

- A. Conform to requirements of NFPA 70.
- B. Products: Listed and classified by Underwriters Laboratories Inc. as suitable for the purpose specified and indicated.

**PART 2 PRODUCTS**

**2.01 MATERIALS**

- A. Flexible Conduit: As specified in Section 26 05 34.
- B. Wire and Cable: As specified in Section 26 05 19.
- C. Boxes: As specified in Section 26 05 37.

**PART 3 EXECUTION**

**3.01 EXAMINATION**

- A. Verify that equipment is ready for electrical connection, wiring, and energization.

**3.02 ELECTRICAL CONNECTIONS**

- A. Make electrical connections in accordance with equipment manufacturer's instructions.
- B. Make conduit connections to equipment using liquidtight flexible metal conduit.
- C. Connect heat producing equipment using wire and cable with insulation suitable for temperatures encountered.
- D. Install disconnect switches, controllers, control stations, and control devices to complete equipment wiring requirements.
- E. Install terminal block jumpers to complete equipment wiring requirements.
- F. Install interconnecting conduit and wiring between devices and equipment to complete equipment wiring requirements.

**END OF SECTION**

Not For Bidding Purposes

**SECTION 26 28 17**

**ENCLOSED CIRCUIT BREAKERS**

**PART 1 GENERAL**

**1.01 SECTION INCLUDES**

- A. Molded case circuit breakers.

**1.02 RELATED REQUIREMENTS**

- A. Section 26 05 26 - Grounding and Bonding for Electrical Systems.
- B. Section 26 05 29 - Hangers and Supports for Electrical Systems.
- C. Section 26 05 53 - Identification for Electrical Systems: Identification products and requirements.

**1.03 REFERENCE STANDARDS**

- A. FS W-C-375 - Circuit Breakers, Molded Case; Branch Circuit and Service; Federal Specification; Revision D, 2006.
- B. NECA 1 - Standard for Good Workmanship in Electrical Construction; National Electrical Contractors Association; 2010.
- C. NETA STD ATS - Acceptance Testing Specifications for Electrical Power Distribution Equipment and Systems; International Electrical Testing Association; 2009.
- D. NFPA 70 - National Electrical Code; National Fire Protection Association; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- E. UL 489 - Molded-Case Circuit Breakers, Molded-Case Switches and Circuit Breaker Enclosures; Current Edition, Including All Revisions.

**1.04 SUBMITTALS**

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide manufacturer's standard catalog pages and data sheets for circuit breakers, enclosures, and other installed components and accessories.
- C. Shop Drawings: Indicate outline and support point dimensions, voltage and current ratings, short circuit current ratings, conduit entry locations, conductor terminal information, and installed features and accessories.

**1.05 QUALITY ASSURANCE**

- A. Conform to requirements of NFPA 70.
- B. Maintain at the project site a copy of each referenced document that prescribes execution requirements.
- C. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum three years documented experience.

**1.06 DELIVERY, STORAGE, AND HANDLING**

- A. Store in a clean, dry space. Maintain factory wrapping or provide an additional heavy canvas or heavy plastic cover to protect units from dirt, water, construction debris, and traffic.

- B. Handle carefully in accordance with manufacturer's written instructions to avoid damage to enclosed circuit breaker internal components, enclosure, and finish.

### **1.07 FIELD CONDITIONS**

- A. Maintain ambient temperature between 23 degrees F and 104 degrees F during and after installation of enclosed circuit breakers.

## **PART 2 PRODUCTS**

### **2.01 MANUFACTURERS**

- A. Schneider Electric; Square D Products: [www.schneider-electric.us](http://www.schneider-electric.us).

### **2.02 MOLDED CASE CIRCUIT BREAKERS**

- A. Description: Quick-make, quick-break, over center toggle, trip-free, trip-indicating circuit breakers listed and labeled as complying with UL 489, and complying with FS W-C-375 where applicable; ratings, configurations, and features as indicated on the drawings.
- B. Interrupting Capacity:
  - 1. Provide circuit breakers with interrupting capacity as required to provide the short circuit current rating indicated.
- C. Conductor Terminations:
  - 1. Provide mechanical lugs unless otherwise indicated.
  - 2. Lug Material: Aluminum, suitable for terminating aluminum or copper conductors.
- D. Multi-Pole Circuit Breakers: Furnish with common trip for all poles.

## **PART 3 EXECUTION**

### **3.01 EXAMINATION**

- A. Verify that field measurements are as shown on the drawings.
- B. Verify that the ratings of the enclosed circuit breakers are consistent with the indicated requirements.
- C. Verify that mounting surfaces are ready to receive enclosed circuit breakers.
- D. Verify that conditions are satisfactory for installation prior to starting work.

### **3.02 INSTALLATION**

- A. Install enclosed circuit breakers where indicated, in accordance with manufacturer's instructions.
- B. Install enclosed circuit breakers securely, in a neat and workmanlike manner in accordance with NECA 1.
- C. Provide grounding and bonding in accordance with Section 26 05 26.
- D. Identify enclosed circuit breakers in accordance with Section 26 05 53.

### **3.03 FIELD QUALITY CONTROL**

- A. Perform inspection and testing in accordance with Section 01 40 00.
- B. Inspect and test in accordance with manufacturer's instructions and NETA STD ATS, except Section 4.
- C. Perform inspections and tests listed in NETA STD ATS, Section 7.6.1.1. Tests listed as optional are not required.

- D. Correct deficiencies and replace damaged or defective enclosed circuit breakers.
- E. Inspect each circuit breaker visually.
- F. Perform several mechanical ON-OFF operations on each circuit breaker.
- G. Verify circuit continuity on each pole in closed position.
- H. Determine that circuit breaker will trip on overcurrent condition, with tripping time to NEMA AB 1 requirements.

#### **3.04 ADJUSTING**

- A. Adjust tightness of mechanical and electrical connections to manufacturer's recommended torque settings.

#### **3.05 CLEANING**

- A. Clean dirt and debris from circuit breaker enclosures and components according to manufacturer's instructions.
- B. Repair scratched or marred exterior surfaces to match original factory finish.

**END OF SECTION**

Not For Bidding Purposes