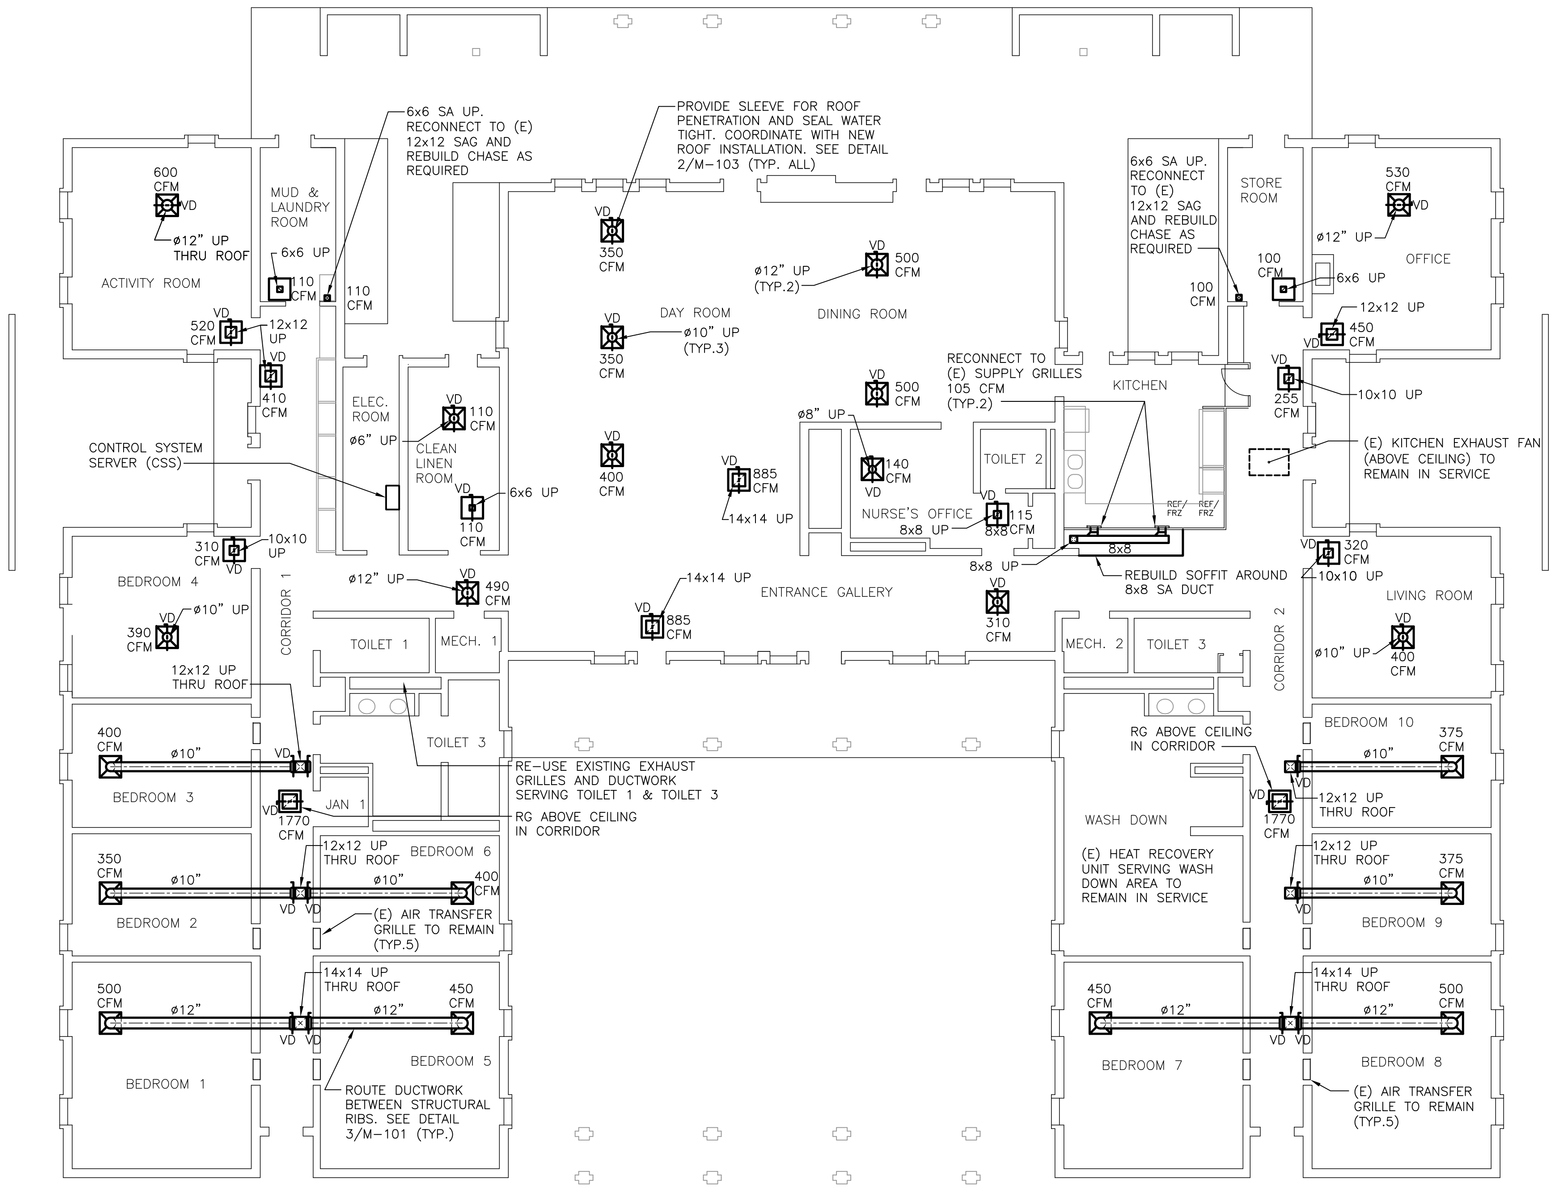

NOTE:

COORDINATE PLACEMENT OF NEW DIFFUSERS IN AREAS WITH EXISTING CEILINGS. REMOVE AND REINSTALL CEILING TILES AS REQUIRED TO INSTALL NEW DUCTWORK. COORDINATE WITH (E) SPRINKLER SYSTEM AND RECONFIGURE SPRINKLER SYSTEM AS REQUIRED TO ACCOMMODATE NEW HVAC INSTALLATION. REPLACE ALL CEILING TILES THAT HAVE BEEN DAMAGED DURING CONSTRUCTION WITH NEW TILES TO MATCH EXISTING.

1 M-101 FIRST FLOOR MECHANICAL PLAN

SCALE: 1/8"=1'-0"

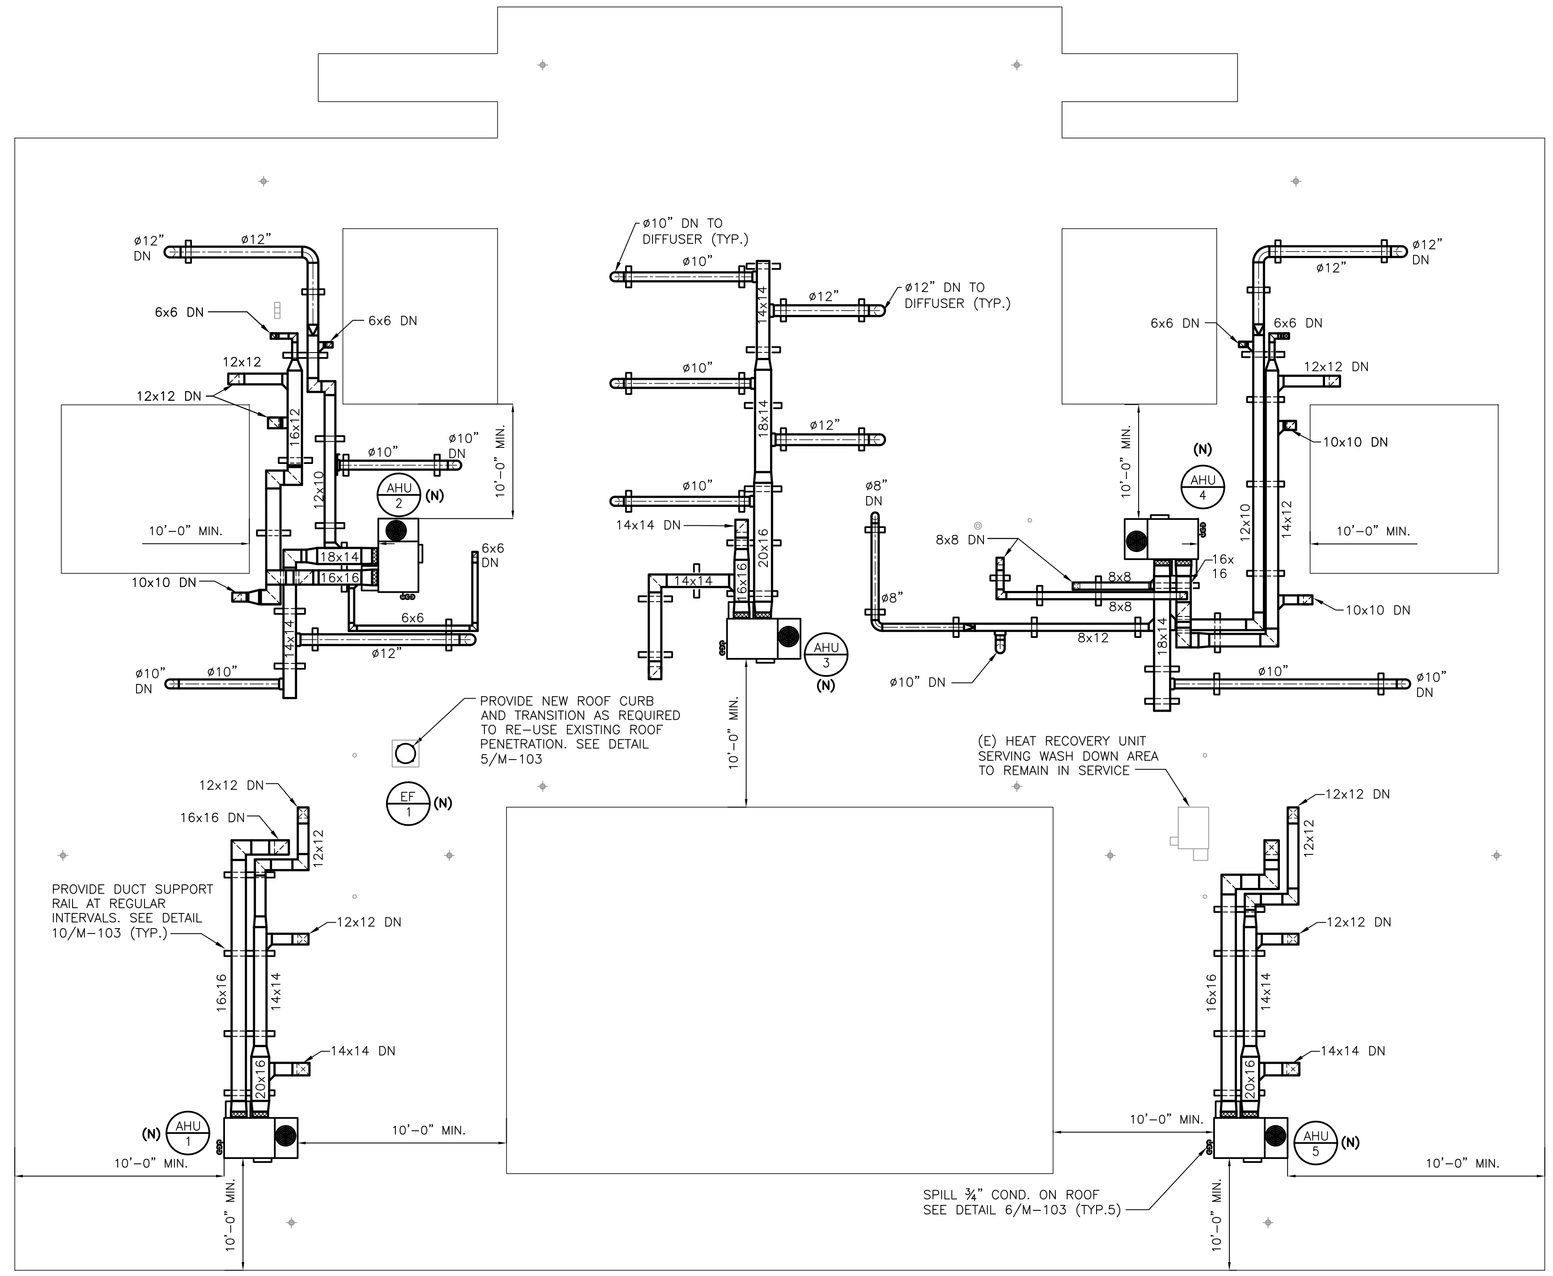

NOTES:

- ALL ROOF TOP EQUIPMENT MUST BE A MINIMUM OF 10'-0" FROM EDGE OF ROOF TO MAINTAIN ADEQUATE SPACE FOR SERVICING.
- CONDENSATE DRAINS AND TRAPS SHALL BE PROVIDED FOR ALL ROOF TOP AIR HANDLING UNITS. SPILL CONDENSATE ON ROOF.
- ALL ROOF WORK SHALL BE PERFORMED TO MAINTAIN ROOF WARRANTY

2 M-101 ROOF MECHANICAL PLAN

SCALE: 1/8"=1'-0"

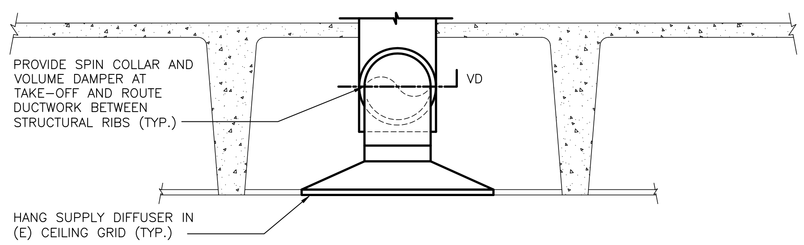

3 M-101 SUPPLY DUCTWORK DETAIL

SCALE: NONE

DEDC
ENGINEERING | DESIGN | CONSULTING
www.dedc-eng.com
315 South Chapel St.
Newark, DE 19711
Phone: (302)738-7172

STOCKLEY CENTER
102 WAPLES WAY
GEORGETOWN, DE 19947

DEDC PROJ.# 11P387

OMB/DFM# MC3511000007

PROJECT TITLE: 102 WAPLES WAY HVAC

REVISIONS

REV.	REVISIONS	RVSD	CHCKD	APRVD	DATE
A	ISSUED FOR 30% STATE REVIEW	DEF	PG	PG	07/13/12
B	ISSUED FOR 90% STATE REVIEW	DEF	PG	PG	08/27/12
0	ISSUED FOR BID	DEF	PG	PG	09/05/12

MECHANICAL
FIRST FLOOR AND ROOF
HVAC PLANS

SCALE	AS NOTED	DATE	REVISION NO. B
DRAWN BY	DEF	07/12/12	M-101
CHECKED BY	PG	07/12/12	
APPROVED BY	PG	07/12/12	

JOHN R. FARINA P.E.
DELAWARE PE# 13559