

*Michael R. Wigley, AIA, LEED®AP
W. Zachary Crouch, P.E.
Michael E. Wheedleton, AIA
Jason P. Loar, P.E.
Ring W. Lardner, P.E.
Jamie L. Sechler, P.E.*

**DELAWARE HOSPITAL FOR THE CHRONICALLY ILL
CANDEE BUILDING 200 WING
NURSES STATION RENVOATION
100 SUNNYSIDE ROAD, SMYRNA, DELAWARE 19977
DBF #586B037.I01 ❖ OMB/DFM #MC351400046**

JULY 8, 2019

ADDENDUM NO. 2

The following items shall become a part of the contract documents. Contractor must acknowledge receipt of this addendum on the Bid Form. Failure to do so may subject the Bidder to disqualification.

- Item No. 1 An allowance of \$10,000.00 has been added for telecommunications temporary services, permanent cabling, terminations and network connection programming, see attached revised specification sections 00 41 13 Bid Form and 01 21 00 Allowances. All work by the electrical contractor shall be included in the base bid.
- Item No. 2 Clarification to prebid meeting minutes, Item 18: Telecommunications will not be included on the bid form subcontractor list since this work is part of the project allowance.
- Item No. 3 A specification for new ceilings has been added. See attached section 09 51 53, Acoustical Tile Ceilings.
- Item No. 4 The fire alarm vendor for DHCI is Anaconda.
- Item No. 5 The glass block construction shall be silicone joints and the pattern shall be clear.
- Item No. 6 Clarification: The abatement contractor will remove the existing window and install the plywood, blocking and rods – see attached detail. The GC will be responsible to provide and install foam seal gasketing around perimeter to prevent air, water and insects from penetrating the space.

END OF ADDENDUM

STATE OF DELAWARE
DEPARTMENT OF HEALTH & SOCIAL SERVICES
CONTRACT #MC3514000046
NURSES STATION RENOVATIONS
AT
CANDEE BUILDING 200 WING
100 SUNNYSIDE ROAD
SMRYNA, DELAWARE 19977

SECTION 00 41 13

BID FORM

For Bids Due: _____

To: State of Delaware
Division of Facilities Management
Thomas Collins Building
540 S. DuPont Highway, Suite 1
Dover, DE 19901

Name of Bidder: _____

Delaware Business License No.: _____ **Taxpayer ID No.:** _____

(A copy of Bidder's Delaware Business License must be attached to this form.)

(Other License Nos.): _____

Phone No.: () _____ - _____ **Fax No.:** () _____ - _____

The undersigned, representing that he has read and understands the Bidding Documents and that this bid is made in accordance therewith, that he has visited the site and has familiarized himself with the local conditions under which the Work is to be performed, and that his bid is based upon the materials, systems and equipment described in the Bidding Documents without exception, hereby proposes and agrees to provide all labor, materials, plant, equipment, supplies, transport and other facilities required to execute the work described by the aforesaid documents for the lump sum itemized below:

\$ _____

(\$ _____)

ALLOWANCES

Allowances conform to applicable project specification Section 01 21 00 – Allowances.

ALLOWANCE No. 1: Provide an allowance of \$15,000.00 for unforeseen conditions.

ALLOWANCE No. 2: Provide an allowance of \$10,000.00 for telecommunications temporary services, permanent cabling, terminations and network connection programming.

ALTERNATES

Alternate prices conform to applicable project specification Section 01 23 00 – Alternates.

ALTERNATE No. 1: All costs associated with installing security glazing with support posts. Refer to drawing Sheet A3 and specification Section 08 88 53 – Security Glazing.

(ADD) \$ _____

STATE OF DELAWARE
DEPARTMENT OF HEALTH & SOCIAL SERVICES
CONTRACT #MC3514000046
NURSES STATION RENOVATIONS
AT
CANDEE BUILDING 200 WING
100 SUNNYSIDE ROAD
SMRYNA, DELAWARE 19977

BID FORM

I/We acknowledge Addendums numbered _____ and the price(s) submitted include any cost/schedule impact they may have.

This bid shall remain valid and cannot be withdrawn for thirty (30) days from the date of opening of bids (60 days for School Districts and Department of Education), and the undersigned shall abide by the Bid Security forfeiture provisions. Bid Security is attached to this Bid.

The Owner shall have the right to reject any or all bids, and to waive any informality or irregularity in any bid received.

This bid is based upon work being accomplished by the Sub-Contractors named on the list attached to this bid.

Should I/We be awarded this contract, I/We pledge to achieve substantial completion of all the work within ____ calendar days of the Notice to Proceed.

The undersigned represents and warrants that he has complied and shall comply with all requirements of local, state, and national laws; that no legal requirement has been or shall be violated in making or accepting this bid, in awarding the contract to him or in the prosecution of the work required; that the bid is legal and firm; that he has not, directly or indirectly, entered into any agreement, participated in any collusion, or otherwise taken action in restraint of free competitive bidding.

Upon receipt of written notice of the acceptance of this Bid, the Bidder shall, within twenty (20) calendar days, execute the agreement in the required form and deliver the Contract Bonds, and Insurance Certificates, required by the Contract Documents.

I am / We are an Individual / a Partnership / a Corporation

By _____ Trading as _____
(Individual's / General Partner's / Corporate Name)

(State of Corporation)

Business Address: _____

Witness: _____

By: _____
(Authorized Signature)

(SEAL)

(Title)

Date: _____

ATTACHMENTS

- Sub-Contractor List
- Non-Collusion Statement
- Affidavit of Employee Drug Testing Program
- Bid Security
- (Others as Required by Project Manuals)

STATE OF DELAWARE
 DEPARTMENT OF HEALTH & SOCIAL SERVICES
 CONTRACT #MC3514000046
 NURSES STATION RENOVATIONS
 AT
 CANDEE BUILDING 200 WING
 100 SUNNYSIDE ROAD
 SMRYNA, DELAWARE 19977

BID FORM

SUBCONTRACTOR LIST

In accordance with Title 29, Chapter 6962 (d)(10)b Delaware Code, the following sub-contractor listing must accompany the bid submittal. The name and address of the sub-contractor **must be listed for each category** where the bidder intends to use a sub-contractor to perform that category of work. In order to provide full disclosure and acceptance of the bid by the *Owner*, it is **required that bidders list themselves as being the sub-contractor for all categories where he/she is qualified and intends to perform such work**. This form must be filled out completely with no additions or deletions.

<u>Subcontractor Category</u>	<u>Subcontractor</u>	<u>Address (City & State)</u>	<u>Subcontractors tax payer ID # or Delaware Business license #</u>
1. Demolition	_____	_____	_____
2. Sealants	_____	_____	_____
3. Carpentry	_____	_____	_____
4. Flooring	_____	_____	_____
5. Painting	_____	_____	_____
6. Electrical	_____	_____	_____
7. Casework	_____	_____	_____
8. HVAC	_____	_____	_____
9. Sprinkler	_____	_____	_____
10. Fire Alarm	_____	_____	_____

STATE OF DELAWARE
DEPARTMENT OF HEALTH & SOCIAL SERVICES
CONTRACT #MC3514000046
NURSES STATION RENOVATIONS
AT
CANDEE BUILDING 200 WING
100 SUNNYSIDE ROAD
SMRYNA, DELAWARE 19977

BID FORM

NON-COLLUSION STATEMENT

This is to certify that the undersigned bidder has neither directly nor indirectly, entered into any agreement, participated in any collusion or otherwise taken any action in restraint of free competitive bidding in connection with this proposal submitted this date (*to the Office of Management and Budget, Division of Facilities Management*).

All the terms and conditions of MC3514000046 have been thoroughly examined and are understood.

NAME OF BIDDER: _____

**AUTHORIZED REPRESENTATIVE
(TYPED):** _____

**AUTHORIZED REPRESENTATIVE
(SIGNATURE):** _____

TITLE: _____

ADDRESS OF BIDDER: _____

E-MAIL: _____

PHONE NUMBER: _____

Sworn to and Subscribed before me this _____ day of _____ 20____.

My Commission expires _____. NOTARY PUBLIC _____.

THIS PAGE MUST BE SIGNED AND NOTARIZED FOR YOUR BID TO BE CONSIDERED.

**AFFIDAVIT
OF
EMPLOYEE DRUG TESTING PROGRAM**

4104 Regulations for the Drug Testing of Contractor and Subcontractor Employees Working on Large Public Works Projects requires that Contractors and Subcontractors implement a program of mandatory drug testing for Employees who work on Large Public Works Contracts funded all or in part with public funds.

We hereby certify that we have in place or will implement during the entire term of the contract a Mandatory Drug Testing Program for our employees on the jobsite, including subcontractors, that complies with this regulation:

Contractor/Subcontractor Name: _____

Contractor/Subcontractor Address: _____

Authorized Representative (typed or printed): _____

Authorized Representative (signature): _____

Title: _____

Sworn to and Subscribed before me this _____ day of _____ 20____.

My Commission expires _____. NOTARY PUBLIC _____.

THIS PAGE MUST BE SIGNED AND NOTARIZED FOR YOUR BID TO BE CONSIDERED.

SECTION 01 21 00

ALLOWANCES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section specifies administrative and procedural requirements for Allowances.
- B. Types of Allowances may include the following (Refer to "Schedule of Allowances" include at the end of this Section):
 - 1. Lump-sum Allowances.
 - 2. Unit-cost Allowances.
- C. Selection and Purchase:
 - 1. Purchase products, systems and labor specifically selected (in writing) by the Owner and/or as indicated in the Schedule of Allowances.
- D. Submittals:
 - 1. Submit invoices or delivery slips to show the actual quantities of materials delivered to the site and labor executed for use in fulfillment of each Allowance.
- E. Coordinate Allowance work with related work to ensure that each selection is completely integrated and interfaced with related work.
- F. Lump-Sum Allowances and Unit-Cost Allowances:
 - 1. These Allowances shall cover the cost to the Contractor, less any applicable trade discount, of the materials, labor and equipment required by the Allowance delivered at the site, and all applicable taxes.
 - 2. The Contractor's costs for unloading and handling on the site, labor, installation costs, overhead, profit and other expenses contemplated for the original Allowance shall be included separately in the Contract Sum and not in the Allowance.
 - 3. Whenever the cost is more than or less than the Allowance, the Contract Sum shall be adjusted accordingly by Change Order.

- a. Change Order Mark-up: The amount of each change order resulting from final selection of products and systems covered by an Allowance shall be the difference between the Contractor's purchase price amount and the Allowance, and shall not include Contractor's mark-up (or subcontractor's mark-up) except to the extent clearly demonstrated (by Contractor) that either scope of installation or nature of work required was changed from that which could have been foreseen from description of Allowance and other information in contract documents. No mark-up is permitted for selection of higher or lower priced materials or systems, of same scope and nature as originally indicated.
- b. Change Order Data: Where applicable, include in each change order proposal both the quantities of products being purchased and unit costs, along with total amount of purchase to be made. Where requested, furnish survey-of-requirements data to substantiate quantities. Indicate applicable taxes, delivery charges, and amounts of applicable trade discounts.

G. Unused Materials:

1. Return unused materials to the manufacturer or supplier for credit to the Owner, after installation has been completed and accepted.
 - a. When requested by the Owner, prepare unused material for storage by Owner where it is not economically practical to return the material for credit. When directed by the Owner, deliver unused material to the Owner's storage space. Otherwise, disposal of unused material is the Contractor's responsibility.

PART 2 - PRODUCTS (Not Applicable)

PART 3 – EXECUTION

3.1 EXAMINATION

- A. Examine products covered by an Allowance promptly upon delivery for damage or defects.

3.2 PREPARATION

- A. Coordinate materials and their installation for each Allowance with related materials and installations to ensure that each Allowance item is completely integrated and interfaced with related work. The general contractor shall be responsible for any necessary work that is not covered in each vendor's proposal indicated in the Schedule of Allowances.

3.3 SCHEDULE OF ALLOWANCES

- A. Allowance No. 1: Provide an allowance of \$15,000.00 for unforeseen conditions.
- B. Allowance No. 2: Provide an allowance of \$10,000.00 for telecommunications temporary services, permanent cabling, terminations and network connection programming.

END OF SECTION

SECTION 09 51 23

ACOUSTICAL TILE CEILINGS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes the following:
 - 1. Ceilings consisting of acoustical tiles and lay-in suspension systems.

1.3 SUBMITTALS

- A. Product Data: For each type of product specified.
- B. Product Test Reports: Indicate compliance of acoustical tile ceilings and components with requirements based on comprehensive testing of current products.

1.4 QUALITY ASSURANCE

- A. Installer Qualifications: Engage an experienced installer who has completed acoustical tile ceilings similar in material, design, and extent to that indicated for this Project and with a record of successful in-service performance.
- B. Source Limitations for Ceiling Units: Obtain each acoustical ceiling tile from one source with resources to provide products of consistent quality in appearance and physical properties without delaying the Work.
- C. Source Limitations for Suspension System: Obtain each suspension system from one source with resources to provide products of consistent quality in appearance and physical properties without delaying the Work.
 - 1. Obtain both acoustical ceiling tiles and suspension system from the same manufacturer.

1.5 DELIVERY, STORAGE, AND HANDLING

- A. Deliver acoustical tiles and suspension system components to Project site in original, unopened packages and store them in a fully enclosed space where they will be protected against damage from moisture, direct sunlight, surface contamination, and other causes.

- B. Before installing acoustical tiles, permit them to reach room temperature and a stabilized moisture content.
- C. Handle acoustical tiles carefully to avoid chipping edges or damaging units in any way.

1.6 PROJECT CONDITIONS

- A. Environmental Limitations: Do not install acoustical tile ceilings until spaces are enclosed and weatherproof, wet-work in spaces is complete and dry, work above ceilings is complete, and ambient temperature and humidity conditions are maintained at the levels indicated for Project when occupied for its intended use.

1.7 COORDINATION

- A. Coordinate layout and installation of acoustical tiles and suspension system with other construction that penetrates ceilings or is supported by them, including light fixtures, HVAC equipment, fire-suppression system, and partition assemblies.

1.8 EXTRA MATERIALS

- A. Furnish extra materials described below that match products installed, are packaged with protective covering for storage, and are identified with labels describing contents.
 - 1. Acoustical Ceiling Units: Full-size units equal to 2.0 percent of amount installed.
 - 2. Suspension System Components: Quantity of each grid and exposed component equal to 2.0 percent of amount installed.

PART 2 - PRODUCTS

2.1 ACOUSTICAL CEILING TILE TYPES

- A. Acoustical Ceiling Tile:
 - 1. Basis of Design: Armstrong Fine Fissured 2' x 2' Square lay-in (Item #1831)

2.2 MANUFACTURERS

- A. Available Products: Subject to compliance with requirements, products that may be incorporated into the Work include, but are not limited to the following:
 - 1. Armstrong World Industries, Inc.

2.3 ACOUSTICAL TILES, GENERAL

- A. Acoustical Tile Standard: Provide manufacturer's standard tiles of configuration indicated that comply with ASTM E 1264 classifications as designated by types, patterns, acoustical ratings, and light reflectances, unless otherwise indicated.

- B. Antimicrobial Treatment: Provide acoustical tiles treated with manufacturer's standard antimicrobial solution consisting of a synergistic blend of substituted ammonium salts of alkylated phosphoric acids admixed with free alkylated phosphoric acid that inhibits fungus, mold, mildew, and gram-positive and gram-negative bacteria.

2.4 METAL SUSPENSION SYSTEMS, GENERAL

- A. Metal Suspension System Standard: Provide manufacturer's standard metal suspension systems of types, structural classifications, and finishes indicated that comply with applicable ASTM C 635 requirements.
- B. Finishes and Colors, General: Comply with NAAMM's "Metal Finishes Manual for Architectural and Metal Products" for recommendations for applying and designating finishes. Provide manufacturer's standard factory-applied finish for type of system indicated.
- C. Attachment Devices: Size for five times design load indicated in ASTM C 635, Table 1, Direct Hung, unless otherwise indicated.
 - 1. Postinstalled Anchors in Existing Plaster Ceiling: Anchors of type and material indicated below, with holes or loops for attaching hangers of type indicated and with capability to sustain, without failure, a load equal to five times that imposed by ceiling construction, as determined by testing per ASTM E 488, conducted by a qualified testing and inspecting agency.
 - a. Type: Postinstalled expansion anchors.
 - b. Corrosion Protection: Stainless-steel components complying with ASTM F 593 and ASTM F 594, Group 1 alloy 304 or 316 for bolts; alloy 304 or 316 for anchor.
 - 2. Postinstalled Powder-Actuated Fasteners in Existing Plaster Ceiling: Fastener system of type suitable for application indicated, fabricated from corrosion-resistant materials, with clips or other accessory devices for attaching hangers of type indicated, and with capability to sustain, without failure, a load equal to 10 times that imposed by ceiling construction, as determined by testing per ASTM E 1190, conducted by a qualified testing and inspecting agency.
- D. Wire Hangers, Braces, and Ties: Provide wires complying with the following requirements:
 - 1. Zinc-Coated Carbon-Steel Wire: ASTM A 641/A 641M, Class 1 zinc coating, soft temper.
- E. Hanger Rods: Mild steel, zinc coated or protected with rust-inhibitive paint.
- F. Angle Hangers: Angles with legs not less than 7/8 inch (22 mm) wide; formed with 0.04-inch- (1-mm-) thick, galvanized steel sheet complying with ASTM A 653/A 653M, G90 (Z275) coating designation; with bolted connections and 5/16-inch- (8-mm-) diameter bolts.
- G. Extruded-Aluminum Edge Moldings and Trim: Where indicated, provide manufacturer's extruded-aluminum edge moldings and trim of profile indicated or referenced by manufacturer's product designations, including splice plates, corner pieces, and attachment and other clips, complying with the following requirements:

1. Aluminum Alloy: Alloy and temper recommended by aluminum producer and finisher for type of use and finish indicated, and with not less than the strength and durability properties of aluminum extrusions complying with ASTM B 221/B 221M for alloy and temper 6063-T5.
2. Baked-Enamel Finish: AA-C12C42R1x (Chemical Finish: cleaned with inhibited chemicals; Chemical Finish: acid-chromate-fluoride-phosphate conversion coating; Organic Coating: as specified below). Comply with paint manufacturer's written instructions for applying and baking and for minimum dry film thickness.
 - a. Organic Coating: Manufacturer's standard thermosetting coating system with a minimum dry film thickness of 0.8 to 1.2 mils (0.02 to 0.03 mm).
 - b. Color: As selected by Architect from manufacturer's standard colors.
3. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Armstrong World Industries, Inc.
 - b. Chicago Metallic Corporation.
 - c. USG Interiors, Inc.

2.5 ACOUSTICAL SEALANT

- A. Acoustical Sealant for Exposed and Concealed Joints: Manufacturer's standard nonsag, paintable, nonstaining latex sealant complying with ASTM C 834 and the following requirements:
 1. Product is effective in reducing airborne sound transmission through perimeter joints and openings in building construction as demonstrated by testing representative assemblies according to ASTM E 90.
- B. Available Products: Subject to compliance with requirements, products that may be incorporated into the Work include, but are not limited to, the following:
 1. Acoustical Sealant for Exposed and Concealed Joints:
 - a. PL Acoustical Sealant; ChemRex, Inc., Contech Brands.
 - b. AC-20 FTR Acoustical and Insulation Sealant; Pecora Corp.
 - c. SHEETROCK Acoustical Sealant; United States Gypsum Co.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine substrates and structural framing to which acoustical tile ceilings attach or abut, with Installer present, for compliance with requirements specified in this and other Sections that affect ceiling installation and anchorage, and other conditions affecting performance of acoustical tile ceilings.

1. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 PREPARATION

- A. Coordination: Furnish layouts for preset inserts, clips, and other ceiling anchors whose installation is specified in other Sections.
 1. Furnish concrete inserts and similar devices to other trades for installation well in advance of time needed for coordinating other work.
- B. Testing Substrates: Before installing adhesively applied tiles on wet-placed substrates such as cast-in-place concrete or plaster, test and verify that moisture level is below tile manufacturer's recommended limits.
- C. Measure each ceiling area and establish layout of acoustical tiles to balance border widths at opposite edges of each ceiling. Avoid using less-than-half-width units at borders, and comply with layout shown on reflected ceiling plans.

3.3 INSTALLATION


- A. General: Install acoustical tile ceilings to comply with publications referenced below per manufacturer's written instructions and CISCA's "Ceiling Systems Handbook."
 1. Standard for Ceiling Suspension System Installations: Comply with ASTM C 636.
- B. Suspend ceiling hangers from building's structural members and as follows:
 1. Install hangers plumb and free from contact with insulation or other objects within ceiling plenum that are not part of supporting structure or of ceiling suspension system.
 2. Splay hangers only where required to miss obstructions; offset resulting horizontal forces by bracing, countersplaying, or other equally effective means.
 3. Splay hangers only where required and, if permitted with fire-resistance rated ceilings, to miss obstructions; offset resulting horizontal forces by bracing, countersplaying, or other equally effective means.
 4. Where width of ducts and other construction within ceiling plenum produces hanger spacings that interfere with location of hangers at spacings required to support standard suspension system members, install supplemental suspension members and hangers in form of trapezes or equivalent devices. Size supplemental suspension members and hangers to support ceiling loads within performance limits established by referenced standards and publications.
 5. Secure wire hangers to ceiling suspension members and to supports above with a minimum of three tight turns. Connect hangers directly either to structures or to inserts, eye screws, or other devices that are secure; that are appropriate for substrate; and that will not deteriorate or otherwise fail due to age, corrosion, or elevated temperatures.
 6. Secure flat, angle, channel, and rod hangers to structure, including intermediate framing members, by attaching to inserts, eye screws, or other devices that are secure and appropriate for both structure to which hangers are attached and type of hanger involved. Install hangers in a manner that will not cause them to deteriorate or fail due to age, corrosion, or elevated temperatures.

7. Do not support ceilings directly from permanent metal forms or floor deck. Fasten hangers to cast-in-place hanger inserts, powder-actuated fasteners, or drilled-in anchors that extend through forms into concrete.
 8. Do not attach hangers to steel deck tabs.
 9. Do not attach hangers to steel roof deck. Attach hangers to structural members.
 10. Space hangers not more than 48 inches (1200 mm) o.c. along each member supported directly from hangers, unless otherwise indicated; and provide hangers not more than 8 inches (200 mm) from ends of each member.
- C. Secure bracing wires to ceiling suspension members and to supports with a minimum of four tight turns. Suspend bracing from building's structural members as required for hangers, without attaching to permanent metal forms, steel deck, or steel deck tabs. Fasten bracing wires into concrete with cast-in-place or post-installed anchors.
- D. Install suspension system runners so they are square and securely interlocked with one another. Remove and replace dented, bent, or kinked members.
- E. Arrange directionally patterned acoustical tiles as follows:
1. Install tiles with pattern running in one direction parallel to long axis of space.
- F. Install acoustical tiles in coordination with suspension system. Place splines or suspension system flanges into kerfed edges so tile-to-tile joints are closed by double lap of material.
1. Fit adjoining tile to form flush, tight joints. Scribe and cut tile for accurate fit at borders and around penetrations through tile.
 2. Hold tile field in compression by inserting leaf-type, spring-steel spacers between tile and moldings, spaced 12 inches (305 mm) o.c.
 3. Fabricate access units for special suspension system access members and tile units modified as required to allow for removal of access units.
 4. Protect lighting fixtures and air ducts to comply with requirements indicated for fire-resistance rated assembly.

3.4 CLEANING

- A. Clean exposed surfaces of acoustical tile ceilings, including trim, edge moldings, and suspension system members. Comply with manufacturer's written instructions for cleaning and touchup of minor finish damage. Remove and replace tiles and other ceiling components that cannot be successfully cleaned and repaired to permanently eliminate evidence of damage.

END OF SECTION

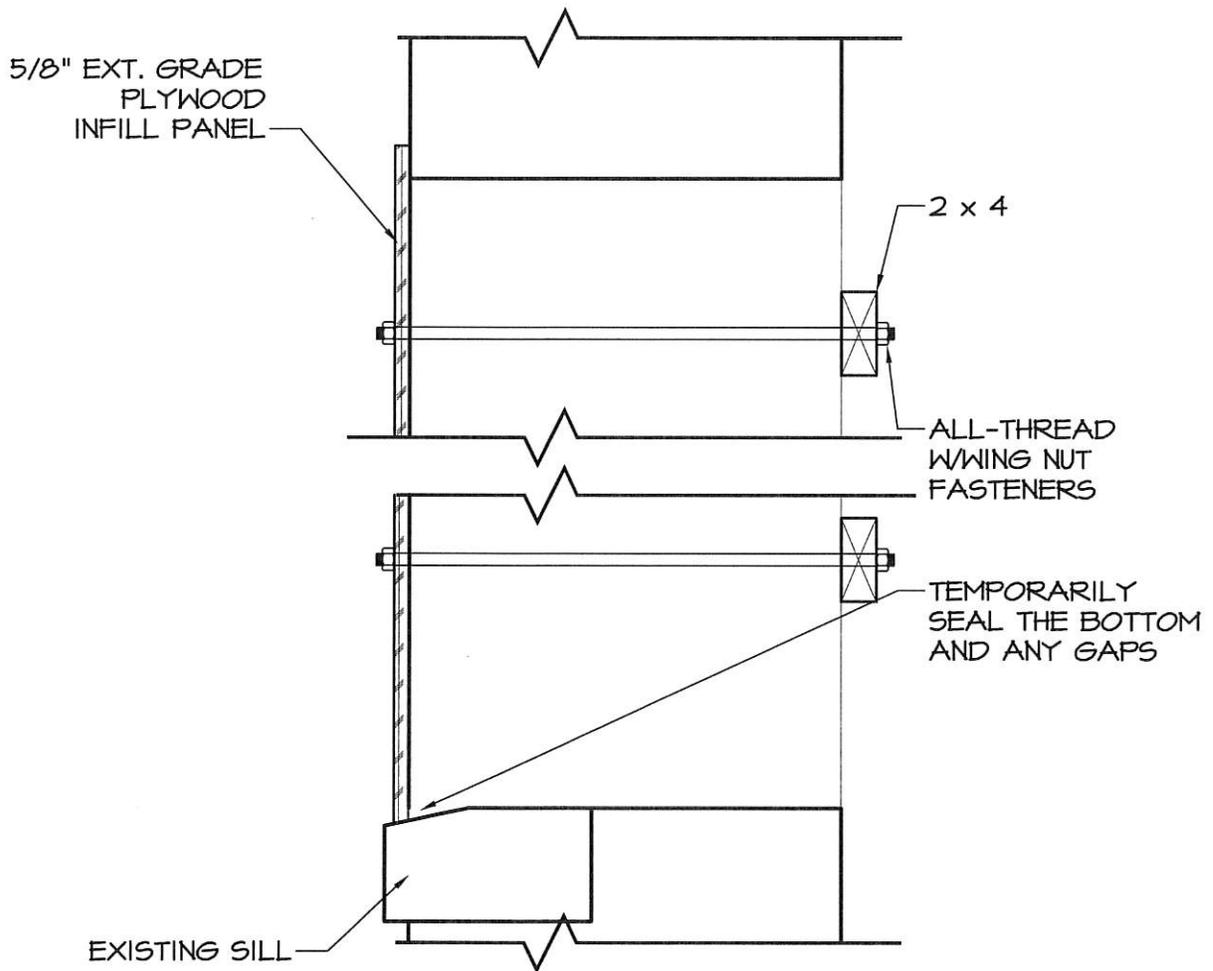

NOTE: GC SHALL VERIFY OPENING SIZE PRIOR TO CUTTING PLYWOOD AND WALL THICKNESS FOR THE ALL-THREAD BOLTS.

TEMPORARY INFILL DETAIL



DAVIS, BOWEN & FRIEDEL, INC.
ARCHITECTS, ENGINEERS & SURVEYORS

SALISBURY, MARYLAND 410-543-9091
MILFORD, DELAWARE 302-424-1441

PROJECT:
DELAWARE HOSPITAL FOR THE
CHRONICALLY ILL CANDEE BUILDING
200 WING NURSE STATION
RENOVATIONS
100 SUNNYSIDE ROAD
SMYRNA, DELAWARE 19977
OMB/DFM NO: MC3514000046

COPYRIGHT © 2015

Dwg.No.:

SK1

Date:
7-8-19

Scale:
NTS

Proj.No.: 586B037.101