

**SPECIFICATIONS
FOR
SEAFORD SCHOOL DISTRICT
FREDERICK DOUGLASS ELEMENTARY SCHOOL
CHILLER REPLACEMENT
BID DOCUMENTS**

NOT FOR BIDDING PURPOSES

Specifications Prepared By:	StudioJAED
Project Number:	14026
Project Manager:	Brian M. Zigmond, P.E., CEM

October 30, 2014

NOT FOR BIDDING PURPOSES

SECTION 00 01 10
TABLE OF CONTENTS

PROCUREMENT AND CONTRACTING REQUIREMENTS

1.01 DIVISION 00 -- PROCUREMENT AND CONTRACTING REQUIREMENTS

- A. 00 01 01 - Project Title Page
- B. 00 01 10 - Table of Contents
- C. 00 01 15 - List of Drawing Sheets
- D. 00 10 00 - Location and Description of Work
- E. 00 21 23 - Instructions to Bidders
- F. 00 40 10 - Bid Bond
- G. 00 40 20 - Payment Bond
- H. 00 40 30 - Performance Bond
- I. 00 41 10 - Non Collusion
- J. 00 41 50 - General Requirements

SPECIFICATIONS

2.01 DIVISION 01 -- GENERAL REQUIREMENTS

- A. 01 10 00 - Summary
- B. 01 20 00 - Price and Payment Procedures
- C. 01 35 53 - Security Procedures
- D. 01 40 00 - Quality Requirements
- E. 01 50 00 - Temporary Facilities and Controls
- F. 01 60 00 - Product Requirements
- G. 01 70 00 - Execution and Closeout Requirements
- H. 01 74 19 - Construction Waste Management and Disposal

2.02 DIVISION 02 -- EXISTING CONDITIONS

- A. 02 41 00 - Demolition

2.03 DIVISION 23 -- HEATING, VENTILATING, AND AIR-CONDITIONING (HVAC)

- A. 23 05 13 - Common Motor Requirements for HVAC Equipment
- B. 23 05 19 - Meters and Gages for HVAC Piping
- C. 23 05 48 - Vibration and Seismic Controls for HVAC Piping and Equipment
- D. 23 05 53 - Identification for HVAC Piping and Equipment
- E. 23 05 93 - Testing, Adjusting, and Balancing for HVAC
- F. 23 07 19 - HVAC Piping Insulation
- G. 23 09 13 - Instrumentation and Control Devices for HVAC
- H. 23 09 23 - Direct-Digital Control System for HVAC
- I. 23 09 93 - Sequence of Operations for HVAC Controls
- J. 23 25 00 - HVAC Water Treatment
- K. 23 64 26 - Rotary-Screw Water Chillers

2.04 DIVISION 26 -- ELECTRICAL

- A. 26 05 01 - Minor Electrical Demolition
- B. 26 05 34 - Conduit
- C. 26 05 37 - Boxes
- D. 26 05 53 - Identification for Electrical Systems
- E. 26 27 17 - Equipment Wiring
- F. 26 27 26 - Wiring Devices
- G. 26 28 13 - Fuses

2.05 DIVISION 31 -- EARTHWORK

- A. 31 22 00 - Grading
- B. 31 23 16 - Excavation
- C. 31 23 23 - Fill

END OF TABLE OF CONTENTS

NOT FOR BIDDING PURPOSES

SECTION 00 01 15

LIST OF DRAWING SHEETS

The following StudioJAED drawings are part of the design package and contain information essential to bidding the listed bid items.

<u>SHEET NO.</u>	<u>SHEET TITLE</u>
GENERAL:	
G 1.0	Cover
MECHANICAL:	
M 8.0	MECHANICAL COVER SHEET
M 8.1	MECHANICAL DEMOLITION AND NEW PLAN
ELECTRICAL:	
E 9.1	ELECTRICAL DEMOLITION AND NEW PLAN

END OF SECTION

NOT FOR BIDDING PURPOSES

NOT FOR BIDDING PURPOSES

SECTION 00 10 00

LOCATION, DESCRIPTION, AND SCHEDULE OF WORK

1.01 LOCATION OF WORK

- A. The work to be done under this Contract is located in the Seaford School District, at Seaford Frederick Douglass Elementary School, 1 Swain Road, Seaford DE 19973.

1.02 DESCRIPTION

- A. Without limiting the scope of work as shown on the Drawings and as required by the Specifications, the following specific mention of items of the included work is made:
1. Remove and dispose of existing chiller.
 2. Modify the existing fence as needed to remove old and install the new chiller.
 3. Extend the existing concrete pad as necessary to allow proper support of the new chiller.
 4. Modify the existing electrical and hydronic infrastructure as necessary to install the new chiller.
 5. Coordinate with the Owner's selected BAS contractor for the installation.

1.03 SCHEDULE OF WORK

- A. Time is of the essence for this project in order to meet the requirements of the students and staff at the school.
- B. The schedule below is to be considered when determining your bid for this project. No work will be permitted to be started earlier than indicated by this schedule. Purchase orders will be drawn in accordance with this schedule:
1. Completion of work by April 15th, 2015.
 2. Chiller delivery shall not be prior to March 1, 2015.
- C. Failure to comply with this schedule will result in liquidated damages being applied in the amount of \$500 / Day.

END OF SECTION

NOT FOR BIDDING PURPOSES

NOT FOR BIDDING PURPOSES

INVITATION TO BID
SEAFORD SCHOOL DISTRICT
FREDERICK DOUGLASS ES CHILLER REPLACEMENT

Sealed bids for the Seaford Frederick Douglass Elementary School Chiller Replacement will be received by the Seaford School District until **11:00 a.m.**, local time, on **Friday, December 5, 2014** at the Seaford School District Offices, 390 N. Market Street, Ext., at which time they will be publicly opened and read aloud in the Conference Room. Bidder bears the risk of late delivery. Any bids received after the stated time will be returned unopened.

The Project involves the replacement of the existing air cooled chiller.

Attention is called to the construction schedule as detailed in the Bid Documents (Section 00 10 00).

A mandatory pre-bid meeting will be held on **Wednesday, November 19th at 1:00 p.m.**, local time at the Seaford Buildings and Grounds Office, located behind the Seaford Middle School, for the purpose of establishing the listing of subcontractors, tour the facility, and to answer questions. Individuals may represent only one firm at this meeting. Representatives of each party to any Joint Venture must attend this meeting. **ATTENDANCE AT THIS MEETING IS A PREREQUISITE FOR BIDDING ON THIS CONTRACT.**

Sealed bids shall be addressed to the Seaford School District.

For further information please contact Brian M. Zigmond P.E., Project Manager, at StudioJAED Architects & Engineers, 2500 Wrangle Hill Road, Bear, DE 19701, Telephone: (302) 832-1652.

Prevailing Wage Rates, as described by Delaware Law, must be adhered to where applicable.

Contract documents can be obtained at Reprographics Center, Inc., 298 Churchmans Road, New Castle, DE, 19720, Phone: (302) 328-5019, Fax: (302) 328-5067, Email: rci1@rciplot.com on or after **Thursday, November 19th, 2014 at 1:00 p.m.** for a cost of **\$50.00**. Checks should be made payable to StudioJAED. Prints requested by mail will have an additional shipping charge attached.

The proposals may not be withdrawn for a period of sixty (60) calendar days after the scheduled closing time for receipt of bids.

Minority Business Enterprises (MBE), Disadvantaged Business Enterprises (DBE) and Women-Owned Business Enterprises (WBE) will be afforded full opportunity to submit bids on this contract and will not be subject to discrimination on the basis of race, color, national origin or sex in consideration of this award. Each bid must be accompanied by a bid security equivalent to ten percent (10%) of the bid amount and all additive alternates. The successful bidder must post a performance bond and payment bond in a sum equal to one hundred percent (100%) of the contract price upon execution of the contract. The Owner reserves the right to reject any or all bids and to waive any informalities therein. The Owner may extend the time and place for the opening of the bids from that described in the advertisement, with not less than two calendar days notice by certified delivery, facsimile machine or other electronic means to those bidders receiving plans.

Mr. Roy Whitaker
Chief of Buildings & Grounds
Seaford School District
390 N. Market Street, Ext.
Seaford, DE 19973

NOT FOR BIDDING PURPOSES

INSTRUCTIONS TO BIDDERS

TABLE OF ARTICLES

1. DEFINITIONS
2. BIDDER'S REPRESENTATION
3. BIDDING DOCUMENTS
4. BIDDING PROCEDURES
5. CONSIDERATION OF BIDS
6. POST-BID INFORMATION
7. PERFORMANCE BOND AND PAYMENT BOND
8. FORM OF AGREEMENT BETWEEN OWNER AND CONTRACTOR

NOT FOR BIDDING PURPOSES

ARTICLE 1: GENERAL

1.1 DEFINITIONS

1.1.1 Whenever the following terms are used, their intent and meaning shall be interpreted as follows:

1.2 STATE: The State of Delaware.

1.3 AGENCY: Contracting State Agency as noted on cover sheet.

1.4 DESIGNATED OFFICIAL: The agent authorized to act for the Agency.

1.5 BIDDING DOCUMENTS: Bidding Documents include the Bidding Requirements and the proposed Contract Documents. The Bidding Requirements consist of the Advertisement for Bid, Invitation to Bid, Instructions to Bidders, Supplementary Instructions to Bidders (if any), General Conditions, Supplementary General Conditions, General Requirements, Special Provisions (if any), the Bid Form (including the Non-collusion Statement), and other sample bidding and contract forms. The proposed Contract Documents consist of the form of Agreement between the Owner and Contractor, as well as the Drawings, Specifications (Project Manual) and all Addenda issued prior to execution of the Contract.

1.6 CONTRACT DOCUMENTS: The Contract Documents consist of the, Instructions to Bidders, Supplementary Instructions to Bidders (if any), General Conditions, Supplementary General Conditions, General Requirements, Special Provisions (if any), the form of agreement between the Owner and the Contractor, Drawings (if any), Specifications (Project Manual), and all addenda.

1.7 AGREEMENT: The form of the Agreement shall be AIA Document A101, Standard Form of Agreement between Owner and Contractor where the basis of payment is a STIPULATED SUM. In the case of conflict between the instructions contained therein and the General Requirements herein, these General Requirements shall prevail.

1.8 GENERAL REQUIREMENTS (or CONDITIONS): General Requirements (or conditions) are instructions pertaining to the Bidding Documents and to contracts in general. They contain, in summary, requirements of laws of the State; policies of the Agency and instructions to bidders.

1.9 SPECIAL PROVISIONS: Special Provisions are specific conditions or requirements peculiar to the bidding documents and to the contract under consideration and are supplemental to the General Requirements. Should the Special Provisions conflict with the General Requirements, the Special Provisions shall prevail.

1.10 ADDENDA: Written or graphic instruments issued by the Owner/Architect prior to the execution of the contract which modify or interpret the Bidding Documents by additions, deletions, clarifications or corrections.

1.11 BIDDER OR VENDOR: A person or entity who formally submits a Bid for the material or Work contemplated, acting directly or through a duly authorized representative who meets the requirements set forth in the Bidding Documents.

1.12 SUB-BIDDER: A person or entity who submits a Bid to a Bidder for materials or labor, or both for a portion of the Work.

1.13 BID: A complete and properly executed proposal to do the Work for the sums stipulated therein, submitted in accordance with the Bidding Documents.

- 1.14 BASE BID: The sum stated in the Bid for which the Bidder offers to perform the Work described in the Bidding Documents as the base, to which Work may be added or from which Work may be deleted for sums stated in Alternate Bids (if any are required to be stated in the bid).
- 1.15 ALTERNATE BID (or ALTERNATE): An amount stated in the Bid, where applicable, to be added to or deducted from the amount of the Base Bid if the corresponding change in the Work, as described in the Bidding Documents is accepted.
- 1.16 UNIT PRICE: An amount stated in the Bid, where applicable, as a price per unit of measurement for materials, equipment or services or a portion of the Work as described in the Bidding Documents.
- 1.17 SURETY: The corporate body which is bound with and for the Contract, or which is liable, and which engages to be responsible for the Contractor's payments of all debts pertaining to and for his acceptable performance of the Work for which he has contracted.
- 1.18 BIDDER'S DEPOSIT: The security designated in the Bid to be furnished by the Bidder as a guaranty of good faith to enter into a contract with the Agency if the Work to be performed or the material or equipment to be furnished is awarded to him.
- 1.19 CONTRACT: The written agreement covering the furnishing and delivery of material or work to be performed.
- 1.20 CONTRACTOR: Any individual, firm or corporation with whom a contract is made by the Agency.
- 1.21 SUBCONTRACTOR: An individual, partnership or corporation which has a direct contract with a contractor to furnish labor and materials at the job site, or to perform construction labor and furnish material in connection with such labor at the job site.
- 1.22 CONTRACT BOND: The approved form of security furnished by the contractor and his surety as a guaranty of good faith on the part of the contractor to execute the work in accordance with the terms of the contract.

ARTICLE 2: BIDDER'S REPRESENTATIONS

2.1 PRE-BID MEETING

2.1.1 A pre-bid meeting for this project will be held at the time and place designated. Attendance at this meeting is a pre-requisite for submitting a Bid, unless this requirement is specifically waived elsewhere in the Bid Documents.

2.2 By submitting a Bid, the Bidder represents that:

2.2.1 The Bidder has read and understands the Bidding Documents and that the Bid is made in accordance therewith.

2.2.2 The Bidder has visited the site, become familiar with existing conditions under which the Work is to be performed, and has correlated the Bidder's his personal observations with the requirements of the proposed Contract Documents.

2.2.3 The Bid is based upon the materials, equipment, and systems required by the Bidding Documents without exception.

2.3 JOINT VENTURE REQUIREMENTS

- 2.3.1 For Public Works Contracts, each Joint Venturer shall be qualified and capable to complete the Work with their own forces.
- 2.3.2 Included with the Bid submission, and as a requirement to bid, a copy of the executed Joint Venture Agreement shall be submitted and signed by all Joint Venturers involved.
- 2.3.3 All required Bid Bonds, Performance Bonds, Material and Labor Payment Bonds must be executed by both Joint Venturers and be placed in both of their names.
- 2.3.4 All required insurance certificates shall name both Joint Venturers.
- 2.3.5 Both Joint Venturers shall sign the Bid Form and shall submit a copy of a valid Delaware Business License with their Bid.
- 2.3.6 Both Joint Venturers shall include their Federal E.I. Number with the Bid.
- 2.3.7 In the event of a mandatory Pre-bid Meeting, each Joint Venturer shall have a representative in attendance.
- 2.3.8 Due to exceptional circumstances and for good cause shown, one or more of these provisions may be waived at the discretion of the State.

2.4 ASSIGNMENT OF ANTITRUST CLAIMS

- 2.4.1 As consideration for the award and execution by the Owner of this contract, the Contractor hereby grants, conveys, sells, assigns and transfers to the State of Delaware all of its right, title and interests in and to all known or unknown causes of action it presently has or may now or hereafter acquire under the antitrust laws of the United States and the State of Delaware, relating to the particular goods or services purchased or acquired by the Owner pursuant to this contract.

ARTICLE 3: BIDDING DOCUMENTS

3.1 COPIES OF BID DOCUMENTS

- 3.1.1 Bidders may obtain complete sets of the Bidding Documents from the Architectural/Engineering firm designated in the Advertisement or Invitation to Bid in the number and for the deposit sum, if any, stated therein.
- 3.1.2 Bidders shall use complete sets of Bidding Documents for preparation of Bids. The issuing Agency nor the Architect assumes no responsibility for errors or misinterpretations resulting from the use of incomplete sets of Bidding Documents.
- 3.1.3 Any errors, inconsistencies or omissions discovered shall be reported to the Architect immediately.
- 3.1.4 The Agency and Architect may make copies of the Bidding Documents available on the above terms for the purpose of obtaining Bids on the Work. No license or grant of use is conferred by issuance of copies of the Bidding Documents.

3.2 INTERPRETATION OR CORRECTION OF BIDDING DOCUMENTS

- 3.2.1 The Bidder shall carefully study and compare the Bidding Documents with each other, and with other work being bid concurrently or presently under construction to the extent that it relates to the Work for which the Bid is submitted, shall examine the site and local conditions, and shall report any errors, inconsistencies, or ambiguities discovered to the Architect.
- 3.2.2 Bidders or Sub-bidders requiring clarification or interpretation of the Bidding Documents shall make a written request to the Architect at least seven days prior to the date for receipt of Bids. Interpretations, corrections and changes to the Bidding Documents will be made by written Addendum. Interpretations, corrections, or changes to the Bidding Documents made in any other manner shall not be binding.
- 3.2.3 The apparent silence of the specifications as to any detail, or the apparent omission from it of detailed description concerning any point, shall be regarded as meaning that only the best commercial practice is to prevail and only material and workmanship of the first quality are to be used. Proof of specification compliance will be the responsibility of the Bidder.
- 3.2.4 Unless otherwise provided in the Contract Documents, the Contractor shall provide and pay for all permits, labor, materials, equipment, tools, construction equipment and machinery, water, heat, utilities, transportation, and other facilities and services necessary for the proper execution and completion of the Work.
- 3.2.5 The Owner will bear the costs for all impact and user fees associated with the project.

3.3 SUBSTITUTIONS

- 3.3.1 The materials, products and equipment described in the Bidding Documents establish a standard of quality, required function, dimension, and appearance to be met by any proposed substitution. The specification of a particular manufacturer or model number is not intended to be proprietary in any way. Substitutions of products for those named will be considered, providing that the Vendor certifies that the function, quality, and performance characteristics of the material offered is equal or superior to that specified. It shall be the Bidder's responsibility to assure that the proposed substitution will not affect the intent of the design, and to make any installation modifications required to accommodate the substitution.
- 3.3.2 Requests for substitutions shall be made in writing to the Architect at least ten days prior to the date of the Bid Opening. Such requests shall include a complete description of the proposed substitution, drawings, performance and test data, explanation of required installation modifications due the substitution, and any other information necessary for an evaluation. The burden of proof of the merit of the proposed substitution is upon the proposer. The Architect's decision of approval or disapproval shall be final. The Architect is to notify Owner prior to any approvals.
- 3.3.3 If the Architect approves a substitution prior to the receipt of Bids, such approval shall be set forth in an Addendum. Approvals made in any other manner shall not be binding.
- 3.3.4 The Architect shall have no obligation to consider any substitutions after the Contract award.
- 3.4 ADDENDA
- 3.4.1 Addenda will be mailed or delivered to all who are known by the Architect to have received a complete set of the Bidding Documents.

- 3.4.2 Copies of Addenda will be made available for inspection wherever Bidding Documents are on file for that purpose.
- 3.4.3 No Addenda will be issued later than 4 days prior to the date for receipt of Bids except an Addendum withdrawing the request for Bids or one which extends the time or changes the location for the opening of bids.
- 3.4.4 Each bidder shall ascertain prior to submitting his Bid that they have received all Addenda issued, and shall acknowledge their receipt in their Bid in the appropriate space. Not acknowledging an issued Addenda could be grounds for determining a bid to be non-responsive.

ARTICLE 4: BIDDING PROCEDURES

4.1 PREPARATION OF BIDS

- 4.1.1 Submit the bids on the Bid Forms included with the Bidding Documents.
- 4.1.2 Submit the original Bid Form for each bid. Bid Forms may be removed from the project manual for this purpose.
- 4.1.3 Execute all blanks on the Bid Form in a non-erasable medium (typewriter or manually in ink).
- 4.1.4 Where so indicated by the makeup on the Bid Form, express sums in both words and figures, in case of discrepancy between the two, the written amount shall govern.
- 4.1.5 Interlineations, alterations or erasures must be initialed by the signer of the Bid.
- 4.1.6 BID ALL REQUESTED ALTERNATES AND UNIT PRICES, IF ANY. If there is no change in the Base Bid for an Alternate, enter "No Change". The Contractor is responsible for verifying that they have received all addenda issued during the bidding period. Work required by Addenda shall automatically become part of the Contract.
- 4.1.7 Make no additional stipulations on the Bid Form and do not qualify the Bid in any other manner.
- 4.1.8 Each copy of the Bid shall include the legal name of the Bidder and a statement whether the Bidder is a sole proprietor, a partnership, a corporation, or any legal entity, and each copy shall be signed by the person or persons legally authorized to bind the Bidder to a contract. A Bid by a corporation shall further give the state of incorporation and have the corporate seal affixed. A Bid submitted by an agent shall have a current Power of Attorney attached, certifying agent's authority to bind the Bidder.
- 4.1.9 Bidder shall complete the Non-Collusion Statement form included with the Bid Forms and include it with their Bid.
- 4.1.10 In the construction of all Public Works projects for the State of Delaware or any agency thereof, preference in employment of laborers, workers or mechanics shall be given to bona fide legal citizens of the State who have established citizenship by residence of at least 90 days in the State.
- 4.1.11 Each bidder shall include in their bid a copy of a valid Delaware Business License.'

4.2 BID SECURITY

4.2.1 All bids shall be accompanied by a deposit of either a good and sufficient bond to the agency for the benefit of the agency, with corporate surety authorized to do business in this State, the form of the bond and the surety to be approved by the agency, or a security of the bidder assigned to the agency, for a sum equal to at least 10% of the bid plus all add alternates, or in lieu of the bid bond a security deposit in the form of a certified check, bank treasurer's check, cashier's check, money order, or other prior approved secured deposit assigned to the State. The bid bond need not be for a specific sum, but may be stated to be for a sum equal to 10% of the bid plus all add alternates to which it relates and not to exceed a certain stated sum, if said sum is equal to at least 10% of the bid. The Bid Bond form used shall be the standard OMB form (attached).

4.2.2 The Agency has the right to retain the bid security of Bidders to whom an award is being considered until either a formal contract has been executed and bonds have been furnished or the specified time has elapsed so the Bids may be withdrawn or all Bids have been rejected.

4.2.3 In the event of any successful Bidder refusing or neglecting to execute a formal contract and bond within 20 days of the awarding of the contract, the bid bond or security deposited by the successful bidder shall be forfeited.

4.3 SUBCONTRACTOR LIST

4.3.1 As required by Delaware Code, Title 29, section 6962(d)(10)b, each Bidder shall submit with their Bid a completed List of Sub-Contractors included with the Bid Form. NAME ONLY ONE SUBCONTRACTOR FOR EACH TRADE. A Bid will be considered non-responsive unless the completed list is included.

4.3.2 Provide the Name and Address for each listed subcontractor. Addresses by City, Town or Locality, plus State, will be acceptable.

4.3.3 It is the responsibility of the Contractor to ensure that their Subcontractors are in compliance with the provisions of this law. Also, if a Contractor elects to list themselves as a Subcontractor for any category, they must specifically name themselves on the Bid Form and be able to document their capability to act as Subcontractor in that category in accordance with this law.

4.4 EQUALITY OF EMPLOYMENT OPPORTUNITY ON PUBLIC WORKS

4.4.1 During the performance of this contract, the contractor agrees as follows:

- A. The Contractor will not discriminate against any employee or applicant for employment because of race, creed, sex, color, sexual orientation, gender identity or national origin. The Contractor will take affirmative action to ensure the applicants are employed, and that employees are treated during employment, without regard to their race, creed, sex, color, sexual orientation, gender identity or national origin. Such action shall include, but not be limited to, the following: Employment, upgrading, demotion or transfer; recruitment or recruitment advertising; layoff or termination; rates of pay or other forms of compensation; and selection for training, including apprenticeship. The Contractor agrees to post in conspicuous places available to employees and applicants for employment notices to be provided by the contracting agency setting forth this nondiscrimination clause.
- B. The Contractor will, in all solicitations or advertisements for employees placed by or on behalf of the Contractor, state that all qualified applicants will receive consideration for employment without regard to race, creed, sex, color, sexual orientation, gender identity or national origin."

4.5 PREVAILING WAGE REQUIREMENT

4.5.1 Wage Provisions: In accordance with Delaware Code, Title 29, Section 6960, renovation projects whose total cost shall exceed \$15,000, and \$100,000 for new construction, the minimum wage rates for various classes of laborers and mechanics shall be as determined by the Department of Labor, Division of Industrial Affairs of the State of Delaware.

4.5.2 The prevailing wage shall be the wage paid to a majority of employees performing similar work as reported in the Department's annual prevailing wage survey or in the absence of a majority, the average paid to all employees reported.

4.5.3 The employer shall pay all mechanics and labors employed directly upon the site of work, unconditionally and not less often than once a week and without subsequent deduction or rebate on any account, the full amounts accrued at time of payment, computed at wage rates not less than those stated in the specifications, regardless of any contractual relationship which may be alleged to exist between the employer and such laborers and mechanics.

4.5.4 The scale of the wages to be paid shall be posted by the employer in a prominent and easily accessible place at the site of the work.

4.5.5 Every contract based upon these specifications shall contain a stipulation that sworn payroll information, as required by the Department of Labor, be furnished weekly. The Department of Labor shall keep and maintain the sworn payroll information for a period of 6 months from the last day of the work week covered by the payroll.

4.6 SUBMISSION OF BIDS

4.6.1 Enclose the Bid, the Bid Security, and any other documents required to be submitted with the Bid in a sealed opaque envelope. Address the envelope to the party receiving the Bids. Identify with the project name, project number, and the Bidder's name and address. If the Bid is sent by mail, enclose the sealed envelope in a separate mailing envelope with the notation "BID ENCLOSED" on the face thereof. The State is not responsible for the opening of bids prior to bid opening date and time that are not properly marked.

4.6.2 Deposit Bids at the designated location prior to the time and date for receipt of bids indicated in the Advertisement for Bids. Bids received after the time and date for receipt of bids will be marked "LATE BID" and returned.

4.6.3 Bidder assumes full responsibility for timely delivery at location designated for receipt of bids.

4.6.4 Oral, telephonic or telegraphic bids are invalid and will not receive consideration.

4.6.5 Withdrawn Bids may be resubmitted up to the date and time designated for the receipt of Bids, provided that they are then fully in compliance with these Instructions to Bidders.

4.7 MODIFICATION OR WITHDRAW OF BIDS

4.7.1 Prior to the closing date for receipt of Bids, a Bidder may withdraw a Bid by personal request and by showing proper identification to the Architect. A request for withdraw by letter or fax, if the Architect is notified in writing prior to receipt of fax, is acceptable. A fax directing a modification in the bid price will render the Bid informal, causing it to be ineligible for consideration of award. Telephone directives for modification of the bid price shall not be permitted and will have no bearing on the submitted proposal in any manner.

4.7.2 Bidders submitting Bids that are late shall be notified as soon as practicable and the bid shall be returned.

4.7.3 A Bid may not be modified, withdrawn or canceled by the Bidder during a thirty (30) day period following the time and date designated for the receipt and opening of Bids, and Bidder so agrees in submitting their Bid. Bids shall be binding for 30 days after the date of the Bid opening.

ARTICLE 5: CONSIDERATION OF BIDS

5.1 OPENING/REJECTION OF BIDS

5.1.1 Unless otherwise stated, Bids received on time will be publicly opened and will be read aloud. An abstract of the Bids will be made available to Bidders.

5.1.2 The Agency shall have the right to reject any and all Bids. A Bid not accompanied by a required Bid Security or by other data required by the Bidding Documents, or a Bid which is in any way incomplete or irregular is subject to rejection.

5.1.3 If the Bids are rejected, it will be done within thirty (30) calendar day of the Bid opening.

5.2 COMPARISON OF BIDS

5.2.1 After the Bids have been opened and read, the bid prices will be compared and the result of such comparisons will be made available to the public. Comparisons of the Bids may be based on the Base Bid plus desired Alternates. The Agency shall have the right to accept Alternates in any order or combination.

5.2.2 The Agency reserves the right to waive technicalities, to reject any or all Bids, or any portion thereof, to advertise for new Bids, to proceed to do the Work otherwise, or to abandon the Work, if in the judgment of the Agency or its agent(s), it is in the best interest of the State.

5.2.3 An increase or decrease in the quantity for any item is not sufficient grounds for an increase or decrease in the Unit Price.

5.2.4 The prices quoted are to be those for which the material will be furnished F.O.B. Job Site and include all charges that may be imposed during the period of the Contract.

5.2.5 No qualifying letter or statements in or attached to the Bid, or separate discounts will be considered in determining the low Bid except as may be otherwise herein noted. Cash or separate discounts should be computed and incorporated into Unit Bid Price(s).

5.3 DISQUALIFICATION OF BIDDERS

5.3.1 An agency shall determine that each Bidder on any Public Works Contract is responsible before awarding the Contract. Factors to be considered in determining the responsibility of a Bidder include:

- A. The Bidder's financial, physical, personnel or other resources including Subcontracts;
- B. The Bidder's record of performance on past public or private construction projects, including, but not limited to, defaults and/or final adjudication or admission of violations of the Prevailing Wage Laws in Delaware or any other state;

- C. The Bidder's written safety plan;
 - D. Whether the Bidder is qualified legally to contract with the State;
 - E. Whether the Bidder supplied all necessary information concerning its responsibility; and,
 - F. Any other specific criteria for a particular procurement, which an agency may establish; provided however, that, the criteria be set forth in the Invitation to Bid and is otherwise in conformity with State and/or Federal law.
- 5.3.2 If an agency determines that a Bidder is nonresponsive and/or nonresponsible, the determination shall be in writing and set forth the basis for the determination. A copy of the determination shall be sent to the affected Bidder within five (5) working days of said determination.
- 5.3.3 In addition, any one or more of the following causes may be considered as sufficient for the disqualification of a Bidder and the rejection of their Bid or Bids.
- 5.3.3.1 More than one Bid for the same Contract from an individual, firm or corporation under the same or different names.
 - 5.3.3.2 Evidence of collusion among Bidders.
 - 5.3.3.3 Unsatisfactory performance record as evidenced by past experience.
 - 5.3.3.4 If the Unit Prices are obviously unbalanced either in excess or below reasonable cost analysis values.
 - 5.3.3.5 If there are any unauthorized additions, interlineation, conditional or alternate bids or irregularities of any kind which may tend to make the Bid incomplete, indefinite or ambiguous as to its meaning.
 - 5.3.3.6 If the Bid is not accompanied by the required Bid Security and other data required by the Bidding Documents.
 - 5.3.3.7 If any exceptions or qualifications of the Bid are noted on the Bid Form.
- 5.4 ACCEPTANCE OF BID AND AWARD OF CONTRACT
- 5.4.1 A formal Contract shall be executed with the successful Bidder within twenty (20) calendar days after the award of the Contract.
 - 5.4.2 Per Section 6962(d)(13) a., Title 29, Delaware Code, "The contracting agency shall award any public works contract within thirty (30) days of the bid opening to the lowest responsive and responsible Bidder, unless the Agency elects to award on the basis of best value, in which case the election to award on the basis of best value shall be stated in the Invitation To Bid."
 - 5.4.3 Each Bid on any Public Works Contract must be deemed responsive by the Agency to be considered for award. A responsive Bid shall conform in all material respects to the requirements and criteria set forth in the Contract Documents and specifications.
 - 5.4.4 The Agency shall have the right to accept Alternates in any order or combination, and to determine the low Bidder on the basis of the sum of the Base Bid, plus accepted Alternates.

- 5.4.5 The successful Bidder shall execute a formal contract, submit the required Insurance Certificate, and furnish good and sufficient bonds, unless specifically waived in the General Requirements, in accordance with the General Requirement, within twenty (20) days of official notice of contract award. Bonds shall be for the benefit of the Agency with surety in the amount of 100% of the total contract award. Said Bonds shall be conditioned upon the faithful performance of the contract. Bonds shall remain in affect for period of one year after the date of substantial completion.
- 5.4.6 If the successful Bidder fails to execute the required Contract and Bond, as aforesaid, within twenty (20) calendar days after the date of official Notice of the Award of the Contract, their Bid guaranty shall immediately be taken and become the property of the State for the benefit of the Agency as liquidated damages, and not as a forfeiture or as a penalty. Award will then be made to the next lowest qualified Bidder of the Work or readvertised, as the Agency may decide.
- 5.4.7 Each bidder shall supply with its bid its taxpayer identification number (i.e., federal employer identification number or social security number) and a copy of its Delaware business license, and should the vendor be awarded a contract, such vendor shall provide to the agency the taxpayer identification license numbers of such subcontractors. Such numbers shall be provided on the later of the date on which such subcontractor is required to be identified or the time the contract is executed. The successful Bidder shall provide to the agency to which it is contracting, within 30 days of entering into such public works contract, copies of all Delaware Business licenses of subcontractors and/or independent contractors that will perform work for such public works contract. However, if a subcontractor or independent contractor is hired or contracted more than 20 days after the Bidder entered the public works contract the Delaware Business license of such subcontractor or independent contractor shall be provided to the agency within 10 days of being contracted or hired.
- 5.4.8 The Bid Security shall be returned to the successful Bidder upon the execution of the formal contract. The Bid Securities of unsuccessful bidders shall be returned within thirty (30) calendar days after the opening of the Bids.

ARTICLE 6: POST-BID INFORMATION

- 6.1 CONTRACTOR'S QUALIFICATION STATEMENT
- 6.1.1 Bidders to whom award of a Contract is under consideration shall, if requested by the Agency, submit a properly executed AIA Document A305, Contractor's Qualification Statement, unless such a statement has been previously required and submitted.
- 6.2 BUSINESS DESIGNATION FORM
- 6.2.1 Successful bidder shall be required to accurately complete an Office of Management and Budget Business Designation Form for Subcontractors.

ARTICLE 7: PERFORMANCE BOND AND PAYMENT BOND

- 7.1 BOND REQUIREMENTS
- 7.1.1 The cost of furnishing the required Bonds, that are stipulated in the Bidding Documents, shall be included in the Bid.
- 7.1.2 If the Bidder is required by the Agency to secure a bond from other than the Bidder's usual sources, changes in cost will be adjusted as provide in the Contract Documents.
- 7.1.3 The Performance and Payment Bond forms used shall be the standard OMB forms (attached).

7.2 TIME OF DELIVERY AND FORM OF BONDS

7.2.1 The bonds shall be dated on or after the date of the Contract.

7.2.2 The Bidder shall require the attorney-in-fact who executes the required bonds on behalf of the surety to affix a certified and current copy of the power of attorney.

ARTICLE 8: FORM OF AGREEMENT BETWEEN AGENCY AND CONTRACTOR

8.1 Unless otherwise required in the Bidding Documents, the Agreement for the Work will be written on AIA Document A101, Standard Form of Agreement Between Owner and Contractor Where the Basis of Payment is a Stipulated Sum.

END OF INSTRUCTIONS TO BIDDERS

NOT FOR BIDDING PURPOSES

STATE OF DELAWARE
OFFICE OF MANAGEMENT AND BUDGET

00 40 10 - BID BOND

TO ACCOMPANY PROPOSAL

KNOW ALL MEN BY THESE PRESENTS That: _____
_____ of _____ in the County of _____
_____ and State of _____ as **Principal**, and _____
_____ of _____ in the County of _____
and State of _____ as **Surety**, legally authorized to do business in the State of Delaware
("State"), are held and firmly unto the **State** in the sum of _____
_____ Dollars (\$ _____), or _____ percent not to exceed _____
_____ Dollars (\$ _____)
of amount of bid on Contract No. _____, to be paid to the **State** for the use and benefit of the
Seaford School District for which payment well and truly to be made, we do bind ourselves, our and each of
our heirs, executors, administrators, and successors, jointly and severally for and in the whole firmly by these
presents.

NOW THE CONDITION OF THIS OBLIGATION IS SUCH That if the above bonded **Principal**
who has submitted to the Seaford School District a certain proposal to enter into this contract for the
furnishing of certain material and/or services within the **State**, shall be awarded this Contract, and if said
Principal shall well and truly enter into and execute this Contract as may be required by the terms of this
Contract and approved by the Seaford School District this Contract to be entered into within twenty days
after the date of official notice of the award thereof in accordance with the terms of said proposal, then this
obligation shall be void or else to be and remain in full force and virtue.

Sealed with _____ seal and dated this _____ day of _____ in the year of our Lord two
thousand and _____ (20____).

SEALED, AND DELIVERED IN THE
Presence of

Name of Bidder (Organization)

Corporate Seal By: _____
Authorized Signature

Attest _____
Title

Name of Surety

Witness: _____ By: _____
Title

NOT FOR BIDDING PURPOSES

STATE OF DELAWARE
OFFICE OF MANAGEMENT AND BUDGET

00 40 20 - PAYMENT BOND

Bond Number: _____

KNOW ALL PERSONS BY THESE PRESENTS, that we, _____, as principal (“**Principal**”), and _____, a _____ corporation, legally authorized to do business in the State of Delaware, as surety (“**Surety**”), are held and firmly bound unto the Seaford School District (“**Owner**”), in the amount of _____ (\$ _____), to be paid to **Owner**, for which payment well and truly to be made, we do bind ourselves, our and each and every of our heirs, executors, administrations, successors and assigns, jointly and severally, for and in the whole firmly by these presents.

Sealed with our seals and dated this _____ day of _____, 20__.

NOW THE CONDITION OF THIS OBLIGATION IS SUCH, that if **Principal**, who has been awarded by **Owner** that certain contract known as Contract No. _____ dated the _____ day of _____, 20__ (the “Contract”), which Contract is incorporated herein by reference, shall well and truly pay all and every person furnishing materials or performing labor or service in and about the performance of the work under the Contract, all and every sums of money due him, her, them or any of them, for all such materials, labor and service for which **Principal** is liable, shall make good and reimburse **Owner** sufficient funds to pay such costs in the completion of the Contract as **Owner** may sustain by reason of any failure or default on the part of **Principal**, and shall also indemnify and save harmless **Owner** from all costs, damages and expenses arising out of or by reason of the performance of the Contract and for as long as provided by the Contract; then this obligation shall be void, otherwise to be and remain in full force and effect.

Surety, for value received, for itself and its successors and assigns, hereby stipulates and agrees that the obligation of **Surety** and its bond shall be in no way impaired or affected by any extension of time, modification, omission, addition or change in or to the Contract or the work to be performed thereunder, or by any payment thereunder before the time required therein, or by any waiver of any provisions thereof, or by any assignment, subletting or other transfer thereof or of any work to be performed or any monies due or to become due thereunder; and **Surety** hereby waives notice of any and all such extensions, modifications, omissions, additions, changes, payments, waivers, assignments, subcontracts and transfers and hereby expressly stipulates and agrees that any and all things done and omitted to be done by and in relation to assignees, subcontractors, and other transferees shall have the same effect as to **Surety** as though done or omitted to be done by or in relation to **Principal**.

Surety hereby stipulates and agrees that no modifications, omission or additions in or to the terms of the Contract shall in any way whatsoever affect the obligation of **Surety** and its bond.

Any proceeding, legal or equitable, under this Bond may be brought in any court of competent jurisdiction in the State of Delaware. Notices to **Surety** or Contractor may be mailed or delivered to them at their respective addresses shown below.

IN WITNESS WHEREOF, **Principal** and **Surety** have hereunto set their hand and seals, and such of them as are corporations have caused their corporate seal to be hereto affixed and these presents to be signed by their duly authorized officers, the day and year first above written.

PRINCIPAL

Name: _____

Witness or Attest: Address: _____

Name:

(Corporate Seal)

By: _____ (SEAL)

Name:

Title:

SURETY

Name: _____

Witness or Attest: Address: _____

Name:

(Corporate Seal)

By: _____ (SEAL)

Name:

Title:

NOT FOR BIDDING PURPOSES

STATE OF DELAWARE
OFFICE OF MANAGEMENT AND BUDGET

00 40 30 - PERFORMANCE BOND

Bond Number: _____

KNOW ALL PERSONS BY THESE PRESENTS, that we, _____, as principal (“**Principal**”), and _____, a _____ corporation, legally authorized to do business in the State of Delaware, as surety (“**Surety**”), are held and firmly bound unto the Seaford School District (“**Owner**”), in the amount of _____ (\$ _____), to be paid to **Owner**, for which payment well and truly to be made, we do bind ourselves, our and each and every of our heirs, executors, administrations, successors and assigns, jointly and severally, for and in the whole, firmly by these presents.

Sealed with our seals and dated this _____ day of _____, 20__.

NOW THE CONDITION OF THIS OBLIGATION IS SUCH, that if **Principal**, who has been awarded by **Owner** that certain contract known as Contract No. _____ dated the _____ day of _____, 20__ (the “Contract”), which Contract is incorporated herein by reference, shall well and truly provide and furnish all materials, appliances and tools and perform all the work required under and pursuant to the terms and conditions of the Contract and the Contract Documents (as defined in the Contract) or any changes or modifications thereto made as therein provided, shall make good and reimburse **Owner** sufficient funds to pay the costs of completing the Contract that **Owner** may sustain by reason of any failure or default on the part of **Principal**, and shall also indemnify and save harmless **Owner** from all costs, damages and expenses arising out of or by reason of the performance of the Contract and for as long as provided by the Contract; then this obligation shall be void, otherwise to be and remain in full force and effect.

Surety, for value received, hereby stipulates and agrees, if requested to do so by **Owner**, to fully perform and complete the work to be performed under the Contract pursuant to the terms, conditions and covenants thereof, if for any cause **Principal** fails or neglects to so fully perform and complete such work.

Surety, for value received, for itself and its successors and assigns, hereby stipulates and agrees that the obligation of **Surety** and its bond shall be in no way impaired or affected by any extension of time, modification, omission, addition or change in or to the Contract or the work to be performed thereunder, or by any payment thereunder before the time required therein, or by any waiver of any provisions thereof, or by any assignment, subletting or other transfer thereof or of any work to be performed or any monies due or to become due thereunder; and **Surety** hereby waives notice of any and all such extensions, modifications, omissions, additions, changes, payments, waivers, assignments, subcontracts and transfers and hereby expressly stipulates and agrees that any and all things done and omitted to be done by and in relation to assignees, subcontractors, and other

transferees shall have the same effect as to **Surety** as though done or omitted to be done by or in relation to **Principal**.

Surety hereby stipulates and agrees that no modifications, omissions or additions in or to the terms of the Contract shall in any way whatsoever affect the obligation of **Surety** and its bond.

Any proceeding, legal or equitable, under this Bond may be brought in any court of competent jurisdiction in the State of Delaware. Notices to **Surety** or Contractor may be mailed or delivered to them at their respective addresses shown below.

IN WITNESS WHEREOF, **Principal** and **Surety** have hereunto set their hand and seals, and such of them as are corporations have caused their corporate seal to be hereto affixed and these presents to be signed by their duly authorized officers, the day and year first above written.

PRINCIPAL

Name: _____

Witness or Attest: Address: _____

Name:

(Corporate Seal)

By: _____ (SEAL)

Name:
Title:

SURETY

Name: _____

Witness or Attest: Address: _____

Name:

(Corporate Seal)

By: _____ (SEAL)

Name:
Title:

NOT FOR BIDDING PURPOSES

FREDERICK DOUGLASS E.S. CHILLER REPLACEMENT

BID FORM

For Bids Due: _____ (DATE) **To:** Seaford School District

Name of Bidder: _____

Delaware Business License No.: _____ **Taxpayer ID No.:** _____
(A copy of Bidder's Delaware Business License must be attached to this form.)

(Other License Nos.): _____

Phone No.: () _____ - _____ **Fax No.:** () _____ - _____

The undersigned, representing that he has read and understands the Bidding Documents and that this bid is made in accordance therewith, that he has visited the site and has familiarized himself with the local conditions under which the Work is to be performed, and that his bid is based upon the materials, systems and equipment described in the Bidding Documents without exception, hereby proposes and agrees to provide all labor, materials, plant, equipment, supplies, transport and other facilities required to execute the work described by the aforesaid documents for the lump sum itemized below:

\$ _____
(\$)

ALTERNATES

Alternate prices conform to applicable project specification section. Refer to specifications for a complete description of the following Alternates. An "ADD" or "DEDUCT" amount is indicated by the crossed out part that does not apply.

NONE

UNIT PRICES

Unit prices conform to applicable project specification section. Refer to the specifications for a complete description of the following Unit Prices:

NONE.

ALLOWANCES

The following allowance is set aside for predicted scope on the project, to be verified and billed as the project conditions dictate:

NONE.

FREDERICK DOUGLASS E.S. CHILLER REPLACEMENT

BID FORM

I/We acknowledge Addendums numbered _____ and the price(s) submitted include any cost/schedule impact they may have.

This bid shall remain valid and cannot be withdrawn for sixty (60) days from the date of opening of bids, and the undersigned shall abide by the Bid Security forfeiture provisions. Bid Security is attached to this Bid.

The Owner shall have the right to reject any or all bids, and to waive any informality or irregularity in any bid received.

This bid is based upon work being accomplished by the Sub-Contractors named on the list attached to this bid.

Should I/We be awarded this contract, I/We pledge to achieve substantial completion of all the work within _____ calendar days of the Notice to Proceed.

The undersigned represents and warrants that he has complied and shall comply with all requirements of local, state, and national laws; that no legal requirement has been or shall be violated in making or accepting this bid, in awarding the contract to him or in the prosecution of the work required; that the bid is legal and firm; that he has not, directly or indirectly, entered into any agreement, participated in any collusion, or otherwise taken action in restraint of free competitive bidding.

Upon receipt of written notice of the acceptance of this Bid, the Bidder shall, within twenty (20) calendar days, execute the agreement in the required form and deliver the Contract Bonds, and Insurance Certificates, required by the Contract Documents.

I am / We are an Individual / a Partnership / a Corporation

By _____ Trading as _____
(Individual's / General Partner's / Corporate Name)

(State of Corporation)

Business Address: _____

Witness: _____ By: _____
(SEAL) (Authorized Signature)

(Title)
Date: _____

ATTACHMENTS

- Sub-Contractor List
- Non-Collusion Statement
- Bid Security
- (Others as Required by Project Manuals)


FREDERICK DOUGLASS E.S. CHILLER REPLACEMENT

BID FORM

SUBCONTRACTOR LIST

In accordance with Title 29, Chapter 6962 (d)(10)b Delaware Code, the following sub-contractor listing must accompany the bid submittal. The name and address of the sub-contractor **must be listed for each category** where the bidder intends to use a sub-contractor to perform that category of work. In order to provide full disclosure and acceptance of the bid by the *Owner*, it is **required that bidders list themselves as being the sub-contractor for all categories where he/she is qualified and intends to perform such work.**

<u>Subcontractor Category</u>	<u>Subcontractor</u>	<u>Address (City & State)</u>	<u>Subcontractors tax payer ID # or Delaware Business license #</u>
1. Mechanical	_____	_____	_____
2. Electrical	_____	_____	_____

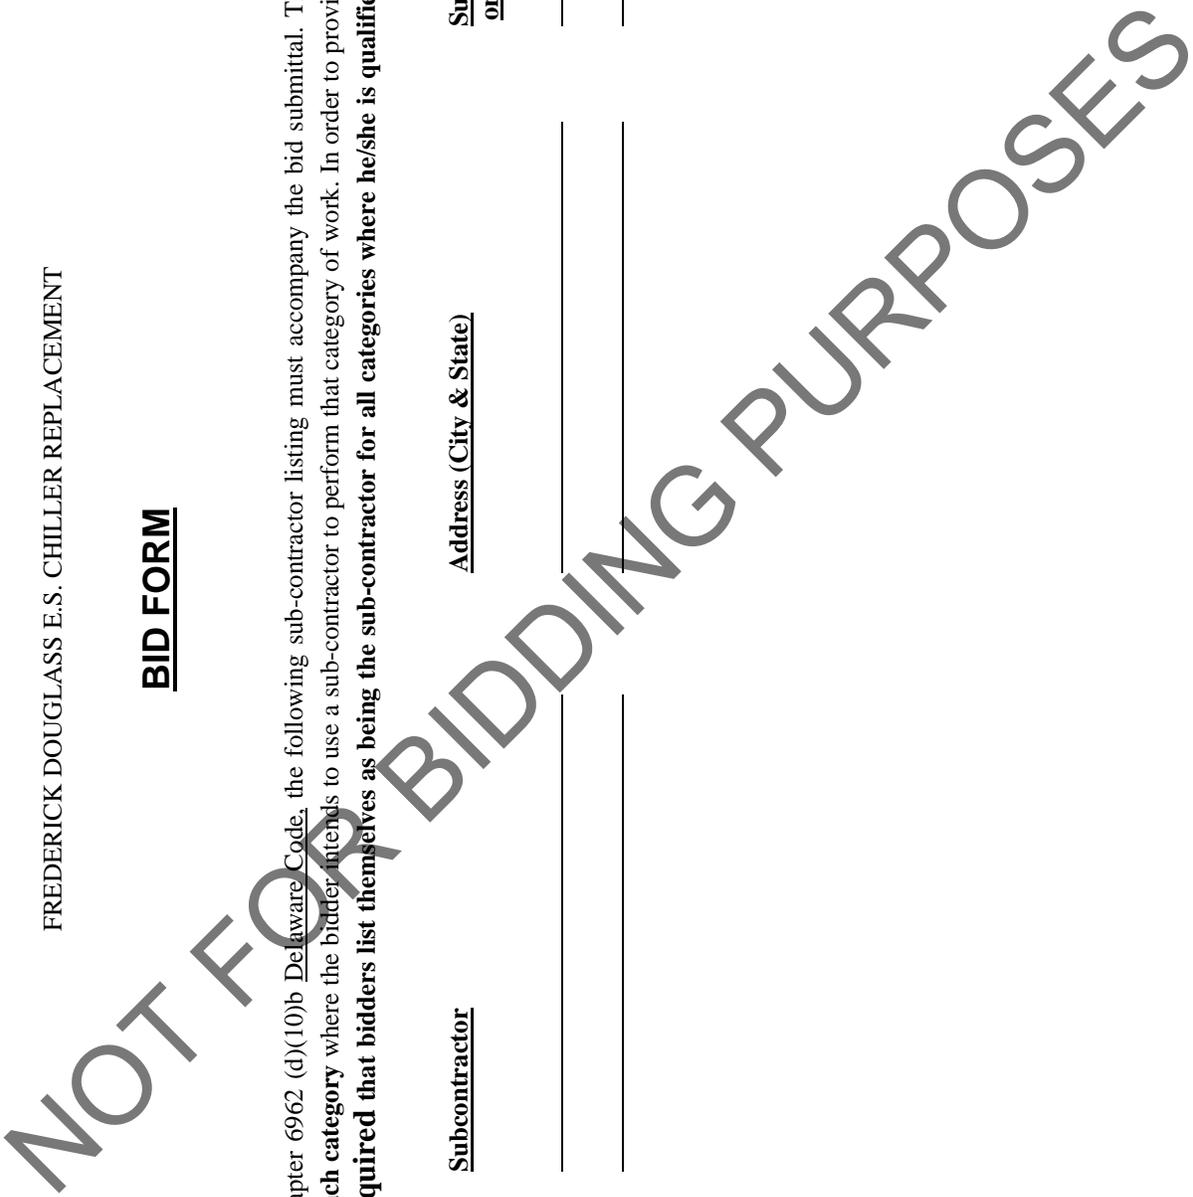

FREDERICK DOUGLASS E.S. CHILLER REPLACEMENT

BID FORM
NON-COLLUSION STATEMENT

This is to certify that the undersigned bidder has neither directly nor indirectly, entered into any agreement, participated in any collusion or otherwise taken any action in restraint of free competitive bidding in connection with this proposal submitted this date (*to the Office of Management and Budget, Division of Facilities Management*).

All the terms and conditions of (*Project or Contract Number*) have been thoroughly examined and are understood.

NAME OF BIDDER: _____

AUTHORIZED REPRESENTATIVE (TYPED): _____

AUTHORIZED REPRESENTATIVE (SIGNATURE): _____

TITLE: _____

ADDRESS OF BIDDER: _____

E-MAIL: _____

PHONE NUMBER: _____

Sworn to and Subscribed before me this _____ day of _____ 20____.

My Commission expires _____. NOTARY PUBLIC _____.

THIS PAGE MUST BE SIGNED AND NOTARIZED FOR YOUR BID TO BE CONSIDERED.

NON-COLLUSION STATEMENT

This is to certify that the undersigned bidder has neither directly nor indirectly, entered into any agreement, participated in any collusion or otherwise taken any action in restraint of free competitive bidding in connection with this proposal submitted this date to the Seaford School District.

All the terms and conditions of the Seaford Central Elementary School Auditorium Renovations (Job No. 13033) have been thoroughly examined and are understood.

NAME OF BIDDER: _____

AUTHORIZED REPRESENTATIVE (TYPED): _____

AUTHORIZED REPRESENTATIVE (SIGNATURE): _____

TITLE: _____

ADDRESS OF BIDDER: _____

PHONE NUMBER: _____

Sworn to and Subscribed before me this _____ day of _____ 20_____.

My Commission expires _____ NOTARY PUBLIC _____.

THIS PAGE MUST BE SIGNED AND NOTARIZED FOR YOUR BID TO BE CONSIDERED.

NOT FOR BIDDING PURPOSES

NOT FOR BIDDING PURPOSES

GENERAL REQUIREMENTS

TABLE OF ARTICLES

1. GENERAL PROVISIONS
2. OWNER
3. CONTRACTOR
4. ADMINISTRATION OF THE CONTRACT
5. SUBCONTRACTORS
6. CONSTRUCTION BY OWNER OR BY SEPARATE CONTRACTORS
7. CHANGES IN THE WORK
8. TIME
9. PAYMENTS AND COMPLETION
10. PROTECTION OF PERSONS AND PROPERTY
11. INSURANCE AND BONDS
12. UNCOVERING AND CORRECTION OF WORK
13. MISCELLANEOUS PROVISIONS
14. TERMINATION OR SUSPENSION OF THE CONTRACT

ARTICLE 1: GENERAL

1.1 CONTRACT DOCUMENTS

1.1.1 The intent of the Contract Documents is to include all items necessary for the proper execution and completion of the Work by the Contractor. The Contract Documents are complementary and what is required by one shall be as binding as if required by all. Performance by the Contractor shall be required to an extent consistent with the Contract Documents and reasonably inferable from them as being necessary to produce the intended results.

1.1.2 Work including material purchases shall not begin until the Contractor is in receipt of a bonafide State of Delaware Purchase Order. Any work performed or material purchases prior to the issuance of the Purchase Order is done at the Contractor's own risk and cost.

1.2 EQUALITY OF EMPLOYMENT OPPORTUNITY ON PUBLIC WORKS

1.2.1 For Public Works Projects financed in whole or in part by state appropriation the Contractor agrees that during the performance of this contract:

1. The Contractor will not discriminate against any employee or applicant for employment because of race, creed, sex, color, sexual orientation, gender identity or national origin. The Contractor will take positive steps to ensure that applicants are employed and that employees are treated during employment without regard to their race, creed, sex, color, sexual orientation, gender identity or national origin. Such action shall include, but not be limited to, the following: employment, upgrading, demotion or transfer; recruitment or recruitment advertising; layoff or termination; rates of pay or other forms of compensation; and selection for training, including apprenticeship. The Contractor agrees to post in conspicuous places available to employees and applicants for employment notices to be provided by the contracting agency setting forth this nondiscrimination clause.
2. The Contractor will, in all solicitations or advertisements for employees placed by or on behalf of the Contractor, state that all qualified applicants will receive consideration for employment without regard to race, creed, sex, color, sexual orientation, gender identity or national origin."

ARTICLE 2: OWNER

(NO ADDITIONAL GENERAL REQUIREMENTS – SEE SUPPLEMENTARY GENERAL CONDITIONS)

ARTICLE 3: CONTRACTOR

3.1 Schedule of Values: The successful Bidder shall within twenty (20) days after receiving notice to proceed with the work, furnish to the Owner a complete schedule of values on the various items comprising the work.

3.2 Subcontracts: Upon approval of Subcontractors, the Contractor shall award their Subcontracts as soon as possible after the signing of their own contract and see that all material, their own and those of their Subcontractors, are promptly ordered so that the work will not be delayed by failure of materials to arrive on time.

3.3 Before commencing any work or construction, the General Contractor is to consult with the Owner as to matters in connection with access to the site and the allocation of Ground Areas for the various features of hauling, storage, etc.

3.4 The Contractor shall supervise and direct the Work, using the Contractor's best skill and attention. The Contractor shall be solely responsible for and have control over construction means, methods, techniques, sequences and procedures and for coordinating all portions of the Work under the Contract, unless the Contract Documents give other specific instructions.

3.5 The Contractor shall enforce strict discipline and good order among the Contractor's employees and other persons carrying out the Contract. The Contractor shall not permit employment of unfit persons or persons not skilled in tasks assigned to them.

3.6 The Contractor warrants to the Owner that materials and equipment furnished will be new and of good quality, unless otherwise permitted, and that the work will be free from defects and in conformance with the Contract Documents. Work not conforming to these requirements, including substitutions not properly approved, may be considered defective. If required by the Owner, the Contractor shall furnish evidence as to the kind and quality of materials and equipment provided.

3.7 Unless otherwise provided, the Contractor shall pay all sales, consumer, use and other similar taxes, and shall secure and pay for required permits, fees, licenses, and inspections necessary for proper execution of the Work.

3.8 The Contractor shall comply with and give notices required by laws, ordinances, rules, regulations, and lawful orders of public authorities bearing on performance of the Work. The Contractor shall promptly notify the Owner if the Drawings and Specifications are observed to be at variance therewith.

3.9 The Contractor shall be responsible to the Owner for the acts and omissions of the Contractor's employees, Subcontractors and their agents and employees, and other persons performing portions of the Work under contract with the Contractor.

3.10 The Contractor shall keep the premises and surrounding area free from accumulation of waste materials or rubbish caused by operations under the Contract. At completion of the Work the Contractor shall remove from and about the Project all waste materials, rubbish, the Contractor's tools, construction equipment, machinery and surplus materials. The Contractor shall be responsible for returning all damaged areas to their original conditions.

3.11 STATE LICENSE AND TAX REQUIREMENTS

3.11.1 Each Contractor and Subcontractor shall be licensed to do business in the State of Delaware and shall pay all fees and taxes due under State laws. In conformance with Section 2503, Chapter 25, Title 30, Delaware Code, "the Contractor shall furnish the Delaware Department of Finance within ten (10) days after entering into any contract with a contractor or subcontractor not a resident of this State, a statement of total value of such contract or contracts together with the names and addresses of the contracting parties."

3.12. The Contractor shall comply with all requirements set forth in Section 6962, Chapter 69, Title 29 of the Delaware Code.

ARTICLE 4: ADMINISTRATION OF THE CONTRACT

4.1 CONTRACT SURETY

4.1.1 PERFORMANCE BOND AND LABOR AND MATERIAL PAYMENT BOND

- 4.1.2 All bonds will be required as follows unless specifically waived elsewhere in the Bidding Documents.
- 4.1.3 Contents of Performance Bonds – The bond shall be in the form approved by the Office of Management and Budget. The bond shall be conditioned upon the faithful compliance and performance by the successful bidder of each and every term and condition of the contract and the proposal, plans, specifications, and bid documents thereof. Each term and condition shall be met at the time and in the manner prescribed by the Contract, Bid documents and the specifications, including the payment in full to every person furnishing material or performing labor in the performance of the Contract, of all sums of money due the person for such labor and material. (The bond shall also contain the successful bidder's guarantee to indemnify and save harmless the State and the agency from all costs, damages and expenses growing out of or by reason of the Contract in accordance with the Contract.)
- 4.1.4 Invoking a Performance Bond – The agency may, when it considers that the interest of the State so require, cause judgement to be confessed upon the bond.
- 4.1.5 Within twenty (20) days after the date of notice of award of contract, the Bidder to whom the award is made shall furnish a Performance Bond and Labor and Material Payment Bond, each equal to the full amount of the Contract price to guarantee the faithful performance of all terms, covenants and conditions of the same. The bonds are to be issued by an acceptable Bonding Company licensed to do business in the State of Delaware and shall be issued in duplicate.
- 4.1.6 Performance and Payment Bonds shall be maintained in full force (warranty bond) for a period of two (2) years after the date of the Certificate for Final Payment. The Performance Bond shall guarantee the satisfactory completion of the Project and that the Contractor will make good any faults or defects in his work which may develop during the period of said guarantees as a result of improper or defective workmanship, material or apparatus, whether furnished by themselves or their Sub-Contractors. The Payment Bond shall guarantee that the Contractor shall pay in full all persons, firms or corporations who furnish labor or material or both labor and material for, or on account of, the work included herein. The bonds shall be paid for by this Contractor. The Owner shall have the right to demand that the proof parties signing the bonds are duly authorized to do so.
- 4.2 FAILURE TO COMPLY WITH CONTRACT
- 4.2.1 If any firm entering into a contract with the State, or Agency that neglects or refuses to perform or fails to comply with the terms thereof, the Agency which signed the Contract may terminate the Contract and proceed to award a new contract in accordance with this Chapter 69, Title 29 of the Delaware Code or may require the Surety on the Performance Bond to complete the Contract in accordance with the terms of the Performance Bond. Nothing herein shall preclude the Agency from pursuing additional remedies as otherwise provided by law.
- 4.3 CONTRACT INSURANCE AND CONTRACT LIABILITY
- 4.3.1 In addition to the bond requirements stated in the Bid Documents, each successful Bidder shall purchase adequate insurance for the performance of the Contract and, by submission of a Bid, agrees to indemnify and save harmless and to defend all legal or equitable actions brought against the State, any Agency, officer and/or employee of the State, for and from all claims of liability which is or may be the result of the successful Bidder's actions during the performance of the Contract.

4.3.2 The purchase or nonpurchase of such insurance or the involvement of the successful Bidder in any legal or equitable defense of any action brought against the successful Bidder based upon work performed pursuant to the Contract will not waive any defense which the State, its agencies and their respective officers, employees and agents might otherwise have against such claims, specifically including the defense of sovereign immunity, where applicable, and by the terms of this section, the State and all agencies, officers and employees thereof shall not be financially responsible for the consequences of work performed, pursuant to said contract.

4.4 RIGHT TO AUDIT RECORDS

4.4.1 The Owner shall have the right to audit the books and records of a Contractor or any Subcontractor under any Contract or Subcontract to the extent that the books and records relate to the performance of the Contract or Subcontract.

4.4.2 Said books and records shall be maintained by the Contractor for a period of seven (7) years from the date of final payment under the Prime Contract and by the Subcontractor for a period of seven (7) years from the date of final payment under the Subcontract.

ARTICLE 5: SUBCONTRACTORS

5.1 SUBCONTRACTING REQUIREMENTS

5.1.1 All contracts for the construction, reconstruction, alteration or repair of any public building (not a road, street or highway) shall be subject to the following provisions:

1. A contract shall be awarded only to a Bidder whose Bid is accompanied by a statement containing, for each Subcontractor category, the name and address (city or town and State only – street number and P.O. Box addresses not required) of the subcontractor whose services the Bidder intends to use in performing the Work and providing the material for such Subcontractor category.
2. A Bid will not be accepted nor will an award of any Contract be made to any Bidder which, as the Prime Contractor, has listed itself as the Subcontractor for any Subcontractor unless:
 - A. It has been established to the satisfaction of the awarding Agency that the Bidder has customarily performed the specialty work of such Subcontractor category by artisans regularly employed by the Bidder's firm;
 - B. That the Bidder is duly licensed by the State to engage in such specialty work, if the State requires licenses; and
 - C. That the Bidder is recognized in the industry as a bona fide Subcontractor or Contractor in such specialty work and Subcontractor category.

5.1.2 The decision of the awarding Agency as to whether a Bidder who list itself as the Subcontractor for a Subcontractor category shall be final and binding upon all Bidders, and no action of any nature shall lie against any awarding agency or its employees or officers because of its decision in this regard.

5.1.3 After such a Contract has been awarded, the successful Bidder shall not substitute another Subcontractor for any Subcontractor whose name was set forth in the statement which accompanied the Bid without the written consent of the awarding Agency.

5.1.4 No Agency shall consent to any substitution of Subcontractors unless the Agency is satisfied that the Subcontractor whose name is on the Bidders accompanying statement:

- A. Is unqualified to perform the work required;
- B. Has failed to execute a timely reasonable Subcontract;
- C. Has defaulted in the performance on the portion of the work covered by the Subcontract; or
- D. Is no longer engaged in such business.

5.1.5 Should a Bidder be awarded a contract, such successful Bidder shall provide to the agency the taxpayer identification license numbers of such subcontractors. Such numbers shall be provided on the later of the date on which such subcontractor is required to be identified or the time the contract is executed. The successful Bidder shall provide to the agency to which it is contracting, within 30 days of entering into such public works contract, copies of all Delaware Business licenses of subcontractors and/or independent contractors that will perform work for such public works contract. However, if a subcontractor or independent contractor is hired or contracted more than 20 days after the Bidder entered the public works contract the Delaware Business license of such subcontractor or independent contractor shall be provided to the agency within 10 days of being contracted or hired.

5.2 PENALTY FOR SUBSTITUTION OF SUBCONTRACTORS

5.2.1 Should the Contractor fail to utilize any or all of the Subcontractors in the Contractor's Bid statement in the performance of the Work on the public bidding, the Contractor shall be penalized in the amount of (project specific amount*). The Agency may determine to deduct payments of the penalty from the Contractor or have the amount paid directly to the Agency. Any penalty amount assessed against the Contractor may be remitted or refunded, in whole or in part, by the Agency awarding the Contract, only if it is established to the satisfaction of the Agency that the Subcontractor in question has defaulted or is no longer engaged in such business. No claim for the remission or refund of any penalty shall be granted unless an application is filed within one year after the liability of the successful Bidder accrues. All penalty amounts assessed and not refunded or remitted to the contractor shall be reverted to the State.

*one (1) percent of contract amount not to exceed \$10,000

5.3 ASBESTOS ABATEMENT

5.3.1 The selection of any Contractor to perform asbestos abatement for State-funded projects shall be approved by the Office of Management and Budget, Division of Facilities Management pursuant to Chapter 78 of Title 16.

5.4 STANDARDS OF CONSTRUCTION FOR THE PROTECTION OF THE PHYSICALLY HANDICAPPED

5.4.1 All Contracts shall conform with the standard established by the Delaware Architectural Accessibility Board unless otherwise exempted by the Board.

5.5 CONTRACT PERFORMANCE

- 5.5.1 Any firm entering into a Public Works Contract that neglects or refuses to perform or fails to comply with its terms, the Agency may terminate the Contract and proceed to award a new Contract or may require the Surety on the Performance Bond to complete the Contract in accordance with the terms of the Performance Bond.

ARTICLE 6: CONSTRUCTION BY OWNER OR SEPARATE CONTRACTORS

- 6.1 The Owner reserves the right to simultaneously perform other construction or operations related to the Project with the Owner's own forces, and to award separate contracts in connection with other portions of the Project or other Projects at the same site.
- 6.2 The Contractor shall afford the Owner and other Contractors reasonable opportunity for access and storage of materials and equipment, and for the performance of their activities, and shall connect and coordinate their activities with other forces as required by the Contract Documents.

ARTICLE 7: CHANGES IN THE WORK

- 7.1 The Owner, without invalidating the Contract, may order changes in the Work consisting of Additions, Deletions, Modifications or Substitutions, with the Contract Sum and Contract completion date being adjusted accordingly. Such changes in the Work shall be authorized by written Change Order signed by the Professional, as the duly authorized agent, the Contractor and the Owner.
- 7.2 The Contract Sum and Contract Completion Date shall be adjusted only by a fully executed Change Order.
- 7.3 The additional cost, or credit to the Owner resulting from a change in the Work shall be by mutual agreement of the Owner, Contractor and the Architect. In all cases, this cost or credit shall be based on the 'DPE' wages required and the "invoice price" of the materials/equipment needed.
- 7.3.1 "DPE" shall be defined to mean "direct personnel expense". Direct payroll expense includes direct salary plus customary fringe benefits (prevailing wage rates) and documented statutory costs such as workman's compensation insurance, Social Security/Medicare, and unemployment insurance (a maximum multiplier of 1.35 times DPE).
- 7.3.2 "Invoice price" of materials/equipment shall be defined to mean the actual cost of materials and/or equipment that is paid by the Contractor, (or subcontractor), to a material distributor, direct factory vendor, store, material provider, or equipment leasing entity. Rates for equipment that is leased and/or owned by the Contractor or subcontractor(s) shall not exceed those listed in the latest version of the "Means Building Construction Cost Data" publication.

- 7.3.3 In addition to the above, the General Contractor is allowed a fifteen percent (15%) markup for overhead and profit for additional work performed by the General Contractor's own forces. For additional subcontractor work, the Subcontractor is allowed a fifteen (15) percent overhead and profit on change order work above and beyond the direct costs stated previously. To this amount, the General Contractor will be allowed a mark-up not exceeding seven and one half percent (7.5%) on the subcontractors work. These mark-ups shall include all costs including, but not limited to: overhead, profit, bonds, insurance, supervision, etc. No markup is permitted on the work of the subcontractors subcontractor. No additional costs shall be allowed for changes related to the Contractor's onsite superintendent/staff, or project manager, unless a change in the work changes the project duration and is identified by the CPM schedule. There will be no other costs associated with the change order.

ARTICLE 8: TIME

- 8.1 Time limits, if any, are as stated in the Project Manual. By executing the Agreement, the Contractor confirms that the stipulated limits are reasonable, and that the Work will be completed within the anticipated time frame.

- 8.2 If progress of the Work is delayed at any time by changes ordered by the Owner, by labor disputes, fire, unusual delay in deliveries, abnormal adverse weather conditions, unavoidable casualties or other causes beyond the Contractor's control, the Contract Time shall be extended for such reasonable time as the Owner may determine.

- 8.3 Any extension of time beyond the date fixed for completion of the construction and acceptance of any part of the Work called for by the Contract, or the occupancy of the building by the Owner, in whole or in part, previous to the completion shall not be deemed a waiver by the Owner of his right to annul or terminate the Contract for abandonment or delay in the matter provided for, nor relieve the Contractor of full responsibility.

8.4 **SUSPENSION AND DEBARMENT**

- 8.4.1 Per Section 6962(d)(14), Title 29, Delaware Code, "Any Contractor who fails to perform a public works contract or complete a public works project within the time schedule established by the Agency in the Invitation To Bid, may be subject to Suspension or Debarment for one or more of the following reasons: a) failure to supply the adequate labor supply ratio for the project; b) inadequate financial resources; or, c) poor performance on the Project."

- 8.4.2 "Upon such failure for any of the above stated reasons, the Agency that contracted for the public works project may petition the Director of the Office of Management and Budget for Suspension or Debarment of the Contractor. The Agency shall send a copy of the petition to the Contractor within three (3) working days of filing with the Director. If the Director concludes that the petition has merit, the Director shall schedule and hold a hearing to determine whether to suspend the Contractor, debar the Contractor or deny the petition. The Agency shall have the burden of proving, by a preponderance of the evidence, that the Contractor failed to perform or complete the public works project within the time schedule established by the Agency and failed to do so for one or more of the following reasons: a) failure to supply the adequate labor supply ratio for the project; b) inadequate financial resources; or, c) poor performance on the project. Upon a finding in favor of the Agency, the Director may suspend a Contractor from Bidding on any project funded, in whole or in part, with public funds for up to 1 year for a first offense, up to 3 years for a second offense and permanently debar the Contractor for a third offense. The Director shall issue a written decision and shall send a copy to the Contractor and the Agency. Such decision may be appealed to the Superior Court within thirty (30) days for a review on the record."

8.5 RETAINAGE

8.5.1 Per Section 6962(d)(5) a.3, Title 29, Delaware Code: The Agency may at the beginning of each public works project establish a time schedule for the completion of the project. If the project is delayed beyond the completion date due to the Contractor's failure to meet their responsibilities, the Agency may forfeit, at its discretion, all or part of the Contractor's retainage.

8.5.2 This forfeiture of retainage also applies to the timely completion of the punchlist. A punchlist will only be prepared upon the mutual agreement of the Owner, Architect and Contractor. Once the punchlist is prepared, all three parties will by mutual agreement, establish a schedule for its completion. Should completion of the punchlist be delayed beyond the established date due to the Contractor's failure to meet their responsibilities, the Agency may hold permanently, at its discretion, all or part of the Contractor's retainage.

ARTICLE 9: PAYMENTS AND COMPLETION

9.1 APPLICATION FOR PAYMENT

9.1.1 Applications for payment shall be made upon AIA Document G702. There will be a five percent (5%) retainage on all Contractor's monthly invoices until completion of the project. This retainage may become payable upon receipt of all required closeout documentation, provided all other requirements of the Contract Documents have been met.

9.1.2 A date will be fixed for the taking of the monthly account of work done. Upon receipt of Contractor's itemized application for payment, such application will be audited, modified, if found necessary, and approved for the amount. Statement shall be submitted to the Owner.

9.1.3 Section 6516, Title 29 of the Delaware Code annualized interest is not to exceed 12% per annum beginning thirty (30) days after the "presentment" (as opposed to the date) of the invoice.

9.2 PARTIAL PAYMENTS

9.2.1 Any public works Contract executed by any Agency may provide for partial payments at the option of the Owner with respect to materials placed along or upon the sites or stored at secured locations, which are suitable for use in the performance of the contract.

9.2.2 When approved by the agency, partial payment may include the values of tested and acceptable materials of a nonperishable or noncontaminative nature which have been produced or furnished for incorporation as a permanent part of the work yet to be completed, provided acceptable provisions have been made for storage.

9.2.2.1 Any allowance made for materials on hand will not exceed the delivered cost of the materials as verified by invoices furnished by the Contractor, nor will it exceed the contract bid price for the material complete in place.

9.2.3 If requested by the Agency, receipted bills from all Contractors, Subcontractors, and material, men, etc., for the previous payment must accompany each application for payment. Following such a request, no payment will be made until these receipted bills have been received by the Owner.

9.3 SUBSTANTIAL COMPLETION

9.3.1 When the building has been made suitable for occupancy, but still requires small items of miscellaneous work, the Owner will determine the date when the project has been substantially completed.

9.3.2 If, after the Work has been substantially completed, full completion thereof is materially delayed through no fault of the Contractor, and without terminating the Contract, the Owner may make payment of the balance due for the portion of the Work fully completed and accepted. Such payment shall be made under the terms and conditions governing final payment that it shall not constitute a waiver of claims.

9.3.3 On projects where commissioning is included, the commissioning work as defined in the specifications must be complete prior to the issuance of substantial completion.

9.4 FINAL PAYMENT

9.4.1 Final payment, including the five percent (5%) retainage if determined appropriate, shall be made within thirty (30) days after the Work is fully completed and the Contract fully performed and provided that the Contractor has submitted the following closeout documentation (in addition to any other documentation required elsewhere in the Contract Documents):

9.4.1.1 Evidence satisfactory to the Owner that all payrolls, material bills, and other indebtedness connected with the work have been paid,

9.4.1.2 An acceptable RELEASE OF LIENS,

9.4.1.3 Copies of all applicable warranties,

9.4.1.4 As-built drawings,

9.4.1.5 Operations and Maintenance Manuals,

9.4.1.6 Instruction Manuals,

9.4.1.7 Consent of Surety to final payment.

9.4.1.8 The Owner reserves the right to retain payments, or parts thereof, for its protection until the foregoing conditions have been complied with, defective work corrected and all unsatisfactory conditions remedied.

ARTICLE 10: PROTECTION OF PERSONS AND PROPERTY

10.1 The Contractor shall be responsible for initiating, maintaining, and supervising all safety precautions and programs in connection with the performance of the Contract. The Contractor shall take all reasonable precautions to prevent damage, injury or loss to: workers, persons nearby who may be affected, the Work, materials and equipment to be incorporated, and existing property at the site or adjacent thereto. The Contractor shall give notices and comply with applicable laws ordinances, rules regulations, and lawful orders of public authorities bearing on the safety of persons and property and their protection from injury, damage, or loss. The Contractor shall promptly remedy damage and loss to property at the site caused in whole or in part by the Contractor, a Subcontractor, or anyone directly or indirectly employed by any of them, or by anyone for whose acts they may be liable.

10.2 The Contractor shall notify the Owner in the event any existing hazardous material such as lead, PCBs, asbestos, etc. is encountered on the project. The Owner will arrange with a qualified specialist for the identification, testing, removal, handling and protection against exposure or environmental pollution, to comply with applicable regulation laws and ordinances. The Contractor and Architect will not be required to participate in or to perform this operation. Upon completion of this work, the Owner will notify the Contractor and Architect in writing the area has been cleared and approved by the authorities in order for the work to proceed. The Contractor shall attach documentation from the authorities of said approval.

10.3 As required in the Hazardous Chemical Information Act of June 1984, all vendors supplying any materials that may be defined as hazardous, must provide Material Safety Data Sheets for those products. Any chemical product should be considered hazardous if it has a warning caution on the label relating to a potential physical or health hazard, if it is known to be present in the work place, and if employees may be exposed under normal conditions or in any foreseeable emergency situation. Material Safety Data Sheets must be provided directly to the Owner along with the shipping slips that include those products.

10.4 The Contractor shall certify to the Owner that materials incorporated into the Work are free of all asbestos. This certification may be in the form of Material Safety Data Sheet (MSDS) provided by the product manufacturer for the materials used in construction, as specified or as provided by the Contractor.

ARTICLE 11: INSURANCE AND BONDS

11.1 The Contractor shall carry all insurance required by law, such as Unemployment Insurance, etc. The Contractor shall carry such insurance coverage as they desire on their own property such as a field office, storage sheds or other structures erected upon the project site that belong to them and for their own use. The Subcontractors involved with this project shall carry whatever insurance protection they consider necessary to cover the loss of any of their personal property, etc.

11.2 Upon being awarded the Contract, the Contractor shall obtain a minimum of two (2) copies of all required insurance certificates called for herein, and submit one (1) copy of each certificate, to the Owner, within 20 days of contract award.

11.3 Bodily Injury Liability and Property Damage Liability Insurance shall, in addition to the coverage included herein, include coverage for injury to or destruction of any property arising out of the collapse of or structural injury to any building or structure due to demolition work and evidence of these coverages shall be filed with and approved by the Owner.

11.4 The Contractor's Property Damage Liability Insurance shall, in addition to the coverage noted herein, include coverage on all real and personal property in their care, custody and control damaged in any way by the Contractor or their Subcontractors during the entire construction period on this project.

11.5 Builders Risk (including Standard Extended Coverage Insurance) on the existing building during the entire construction period, shall not be provided by the Contractor under this contract. The Owner shall insure the existing building and all of its contents and all this new alteration work under this contract during entire construction period for the full insurable value of the entire work at the site. Note, however, that the Contractor and their Subcontractors shall be responsible for insuring building materials (installed and stored) and their tools and equipment whenever in use on the project, against fire damage, theft, vandalism, etc.

11.6 Certificates of the insurance company or companies stating the amount and type of coverage, terms of policies, etc., shall be furnished to the Owner, within 20 days of contract award.

11.7 The Contractor shall, at their own expense, (in addition to the above) carry the following forms of insurance:

11.7.1 Contractor's Contractual Liability Insurance

Minimum coverage to be:

Bodily Injury	\$500,000 \$1,000,000 \$1,000,000	for each person for each occurrence aggregate
Property Damage	\$500,000 \$1,000,000	for each occurrence aggregate

11.7.2 Contractor's Protective Liability Insurance

Minimum coverage to be:

Bodily Injury	\$500,000 \$1,000,000 \$1,000,000	for each person for each occurrence aggregate
Property Damage	\$500,000 \$500,000	for each occurrence aggregate

11.7.3 Automobile Liability Insurance

Minimum coverage to be:

Bodily Injury	\$1,000,000 \$1,000,000	for each person for each occurrence
Property Damage	\$500,000	per accident

11.7.4 Prime Contractor's and Subcontractors' policies shall include contingent and contractual liability coverage in the same minimum amounts as 11.7.1 above.

11.7.5 Workmen's Compensation (including Employer's Liability):

11.7.5.1 Minimum Limit on employer's liability to be as required by law.

11.7.5.2 Minimum Limit for all employees working at one site.

11.7.6 Certificates of Insurance must be filed with the Owner guaranteeing fifteen (15) days prior notice of cancellation, non-renewal, or any change in coverages and limits of liability shown as included on certificates.

11.7.7 Social Security Liability

11.7.7.1 With respect to all persons at any time employed by or on the payroll of the Contractor or performing any work for or on their behalf, or in connection with or arising out of the Contractor's business, the Contractor shall accept full and exclusive liability for the payment of any and all contributions or taxes or unemployment insurance, or old age retirement benefits, pensions or annuities now or hereafter imposed by the Government of the United States and the State or political subdivision thereof, whether the same be measured by wages, salaries or other remuneration paid to such persons or otherwise.

11.7.7.2 Upon request, the Contractor shall furnish Owner such information on payrolls or employment records as may be necessary to enable it to fully comply with the law imposing the aforesaid contributions or taxes.

11.7.7.3 If the Owner is required by law to and does pay any and/or all of the aforesaid contributions or taxes, the Contractor shall forthwith reimburse the Owner for the entire amount so paid by the Owner.

ARTICLE 12: UNCOVERING AND CORRECTION OF WORK

12.1 The Contractor shall promptly correct Work rejected by the Owner or failing to conform to the requirements of the Contract Documents, whether observed before or after Substantial Completion and whether or not fabricated, installed or completed, and shall correct any Work found to be not in accordance with the requirements of the Contract Documents within a period of two years from the date of Substantial Completion, or by terms of an applicable special warranty required by the Contract Documents. The provisions of this Article apply to work done by Subcontractors as well as to Work done by direct employees of the Contractor.

12.2 At any time during the progress of the work, or in any case where the nature of the defects shall be such that it is not expedient to have them corrected, the Owner, at their option, shall have the right to deduct such sum, or sums, of money from the amount of the contract as they consider justified to adjust the difference in value between the defective work and that required under contract including any damage to the structure.

ARTICLE 13: MISCELLANEOUS PROVISIONS

13.1 CUTTING AND PATCHING

13.1.1 The Contractor shall be responsible for all cutting and patching. The Contractor shall coordinate the work of the various trades involved.

13.2 DIMENSIONS

13.2.1 All dimensions shown shall be verified by the Contractor by actual measurements at the project site. Any discrepancies between the drawings and specifications and the existing conditions shall be referred to the Owner for adjustment before any work affected thereby has been performed.

13.3 LABORATORY TESTS

13.3.1 Any specified laboratory tests of material and finished articles to be incorporated in the work shall be made by bureaus, laboratories or agencies approved by the Owner and reports of such tests shall be submitted to the Owner. The cost of the testing shall be paid for by the Contractor.

13.3.2 The Contractor shall furnish all sample materials required for these tests and shall deliver same without charge to the testing laboratory or other designated agency when and where directed by the Owner.

13.4 ARCHAEOLOGICAL EVIDENCE

13.4.1 Whenever, in the course of construction, any archaeological evidence is encountered on the surface or below the surface of the ground, the Contractor shall notify the authorities of the Delaware Archaeological Board and suspend work in the immediate area for a reasonable time to permit those authorities, or persons designated by them, to examine the area and ensure the proper removal of the archaeological evidence for suitable preservation in the State Museum.

13.5 GLASS REPLACEMENT AND CLEANING

13.5.1 The General Contractor shall replace without expense to the Owner all glass broken during the construction of the project. If job conditions warrant, at completion of the job the General Contractor shall have all glass cleaned and polished.

13.6 WARRANTY

13.6.1 For a period of two (2) years from the date of substantial completion, as evidenced by the date of final acceptance of the work, the contractor warrants that work performed under this contract conforms to the contract requirements and is free of any defect of equipment, material or workmanship performed by the contractor or any of his subcontractors or suppliers. However, manufacturer's warranties and guarantees, if for a period longer than two (2) years, shall take precedence over the above warranties. The contractor shall remedy, at his own expense, any such failure to conform or any such defect. The protection of this warranty shall be included in the Contractor's Performance Bond.

ARTICLE 14: TERMINATION OF CONTRACT

14.1 If the Contractor defaults or persistently fails or neglects to carry out the Work in accordance with the Contract Documents or fails to perform a provision of the Contract, the Owner, after seven days written notice to the Contractor, may make good such deficiencies and may deduct the cost thereof from the payment then or thereafter due the Contractor. Alternatively, at the Owner's option, and the Owner may terminate the Contract and take possession of the site and of all materials, equipment, tools, and machinery thereon owned by the Contractor and may finish the Work by whatever method the Owner may deem expedient. If the costs of finishing the Work exceed any unpaid compensation due the Contractor, the Contractor shall pay the difference to the Owner.

14.2 "If the continuation of this Agreement is contingent upon the appropriation of adequate state, or federal funds, this Agreement may be terminated on the date beginning on the first fiscal year for which funds are not appropriated or at the exhaustion of the appropriation. The Owner may terminate this Agreement by providing written notice to the parties of such non-appropriation. All payment obligations of the Owner will cease upon the date of termination. Notwithstanding the foregoing, the Owner agrees that it will use its best efforts to obtain approval of necessary funds to continue the Agreement by taking appropriate action to request adequate funds to continue the Agreement."

END OF GENERAL REQUIREMENTS

SUPPLEMENTARY GENERAL CONDITIONS A201-2007

The following supplements modify the "General Conditions of the Contract for Construction," AIA Document A201-2007. Where a portion of the General Conditions is modified or deleted by the Supplementary Conditions, the unaltered portions of the General Conditions shall remain in effect.

TABLE OF ARTICLES

1. GENERAL PROVISIONS
2. OWNER
3. CONTRACTOR
4. ADMINISTRATION OF THE CONTRACT
5. SUBCONTRACTORS
6. CONSTRUCTION BY OWNER OR BY SEPARATE CONTRACTORS
7. CHANGES IN THE WORK
8. TIME
9. PAYMENTS AND COMPLETION
10. PROTECTION OF PERSONS AND PROPERTY
11. INSURANCE AND BONDS
12. UNCOVERING AND CORRECTION OF WORK
13. MISCELLANEOUS PROVISIONS
14. TERMINATION OR SUSPENSION OF THE CONTRACT

ARTICLE 1: GENERAL PROVISIONS

1.1 BASIC DEFINITIONS

1.1.1 THE CONTRACT DOCUMENTS

Delete the last sentence in its entirety and replace with the following:

“The Contract Documents also include Advertisement for Bid, Instructions to Bidder, sample forms, the Bid Form, the Contractor’s completed Bid and the Award Letter.”

Add the following Paragraph:

1.1.2 In the event of conflict or discrepancies among and/or within the Contract Documents, the more detailed, robust, or cost-intensive solution shall be considered as the design intent.

1.2 CORRELATION AND INTENT OF THE CONTRACT DOCUMENTS

Add the following Paragraphs:

1.2.4 In the case of an inconsistency between the Drawings and the Specifications, or within either document not clarified by addendum, the better quality or greater quantity of work shall be provided in accordance with the Architect’s interpretation.

1.2.5 The word “PROVIDE” as used in the Contract Documents shall mean “FURNISH AND INSTALL” and shall include, without limitation, all labor, materials, equipment, transportation, services and other items required to complete the Work.

1.2.6 The word “PRODUCT” as used in the Contract Documents means all materials, systems and equipment.

1.5 OWNERSHIP AND USE OF DRAWINGS, SPECIFICATIONS AND OTHER INSTRUMENTS OF SERVICE

Delete Paragraph 1.5.1 in its entirety and replace with the following:

“All pre-design studies, drawings, specifications and other documents, including those in electronic form, prepared by the Architect under this Agreement are, and shall remain, the property of the Owner whether the Project for which they are made is executed or not. Such documents may be used by the Owner to construct one or more like Projects without the approval of, or additional compensation to, the Architect. The Contractor, Subcontractors, Sub-subcontractors and Material or Equipment Suppliers are authorized to use and reproduce applicable portions of the Drawings, Specifications and other documents prepared by the Architect and the Architect’s consultants appropriate to and for use in the execution of their Work under the Contract Documents. They are not to be used by the Contractor or any Subcontractor, Sub-subcontractor or Material and Equipment Supplier on other Projects or for additions to this Project outside the scope of the Work without the specific written consent of the Owner, Architect and Architect’s consultants.

The Architect shall not be liable for injury or damage resulting from the re-use of drawings and specifications if the Architect is not involved in the re-use Project. Prior to re-use of construction documents for a Project in which the Architect is not also involved, the Owner will remove from such documents all identification of the original Architect, including name, address and professional seal or stamp.”

Delete Paragraph 1.5.2 in its entirety.

ARTICLE 2: OWNER

2.2 INFORMATION AND SERVICES REQUIRED OF THE OWNER

To Subparagraph 2.2.3 – Add the following sentence:

“The Contractor, at their expense shall bear the costs to accurately identify the location of all underground utilities in the area of their excavation and shall bear all cost for any repairs required, out of failure to accurately identify said utilities.”

Delete Subparagraph 2.2.5 in its entirety and substitute the following:

2.2.5 The Contractor shall be furnished free of charge up to five (5) sets of the Drawings and Project Manuals. Additional sets will be furnished at the cost of reproduction, postage and handling.

ARTICLE 3: CONTRACTOR

3.2 REVIEW OF CONTRACT DOCUMENTS AND FIELD CONDITIONS BY CONTRACTOR

Amend Paragraph 3.2.2 to state that any errors, inconsistencies or omissions discovered shall be reported to the Architect and Owner immediately.

Delete the third sentence in Paragraph 3.2.3.

3.3 SUPERVISION AND CONSTRUCTION PROCEDURES

Add the following Paragraphs:

3.3.2.1 The Contractor shall immediately remove from the Work, whenever requested to do so by the Owner, any person who is considered by the Owner or Architect to be incompetent or disposed to be so disorderly, or who for any reason is not satisfactory to the Owner, and that person shall not again be employed on the Work without the consent of the Owner or the Architect.

3.3.4 The Contractor must provide suitable storage facilities at the Site for the proper protection and safe storage of their materials. Consult the Owner and the Architect before storing any materials.

3.3.5 When any room is used as a shop, storeroom, office, etc., by the Contractor or Subcontractor(s) during the construction of the Work, the Contractor making use of these areas will be held responsible for any repairs, patching or cleaning arising from such use.

3.4 LABOR AND MATERIALS

Add the Following Paragraphs:

3.4.4 Before starting the Work, each Contractor shall carefully examine all preparatory Work that has been executed to receive their Work. Check carefully, by whatever means are required, to insure that its Work and adjacent, related Work, will finish to proper contours, planes and levels. Promptly notify the General Contractor/Construction Manager of any defects or imperfections in preparatory Work which will in any way affect satisfactory completion of its Work. Absence of such notification will be construed as an acceptance of preparatory Work and later claims of defects will not be recognized.

3.4.5 Under no circumstances shall the Contractor's Work proceed prior to preparatory Work proceed prior to preparatory Work having been completely cured, dried and/or otherwise made satisfactory to receive this Work. Responsibility for timely installation of all materials rests solely with the Contractor responsible for that Work, who shall maintain coordination at all times.

3.5 WARRANTY

Add the following Paragraphs:

3.5.1 The Contractor will guarantee all materials and workmanship against original defects, except injury from proper and usual wear when used for the purpose intended, for two years after Acceptance by the Owner, and will maintain all items in perfect condition during the period of guarantee.

3.5.2 Defects appearing during the period of guarantee will be made good by the Contractor at his expense upon demand of the Owner, it being required that all work will be in perfect condition when the period of guarantee will have elapsed.

3.5.3 In addition to the General Guarantee there are other guarantees required for certain items for different periods of time than the two years as above, and are particularly so stated in that part of the specifications referring to same. The said guarantees will commence at the same time as the General Guarantee.

3.5.4 If the Contractor fails to remedy any failure, defect or damage within a reasonable time after receipt of notice, the Owner will have the right to replace, repair, or otherwise remedy the failure, defect or damage at the Contractor's expense.

3.11 DOCUMENTS AND SAMPLES AT THE SITE

Add the following Paragraphs:

3.11.1 During the course of the Work, the Contractor shall maintain a record set of drawings on which the Contractor shall mark the actual physical location of all piping, valves, equipment, conduit, outlets, access panels, controls, actuators, including all appurtenances that will be concealed once construction is complete, etc., including all invert elevations.

3.11.2 At the completion of the project, the Contractor shall obtain a set of reproducible drawings from the Architect, and neatly transfer all information outlined in 3.11.1 to provide a complete record of the as-built conditions.

3.11.3 The Contractor shall provide two (2) prints of the as-built conditions, along with the reproducible drawings themselves, to the Owner and one (1) set to the Architect. In addition, attach one complete set to each of the Operating and Maintenance Instructions/Manuals.

3.17 In the first sentence of the paragraph, insert "indemnify" between "shall" and "hold".

ARTICLE 4: ADMINISTRATION OF THE CONTRACT

4.2 ADMINISTRATION OF THE CONTRACT

Delete the first sentence of Paragraph 4.2.7 and replace with the following:

The Architect will review and approve or take other appropriate action upon the Contractor's submittals such as Shop Drawings, Product Data and Samples for the purpose of checking for conformance with the Contract Documents.

Delete the second sentence of Paragraph 4.2.7 and replace with the following:

The Architect's action will be taken with such reasonable promptness as to cause no delay in the Work in the activities of the Owner, Contractor or separate Contractors, while allowing sufficient time in the Owner's professional judgment to permit adequate review.

Add the following Paragraph:

4.2.10.1 There will be no full-time project representative provided by the Owner or Architect on this project.

Add to Paragraph 4.2.13 "and in compliance with all local requirements." to the end of the sentence

ARTICLE 5: SUBCONTRACTORS

5.2 AWARD OF SUBCONTRACTS AND OTHER CONTRACTS FOR PORTIONS OF THE WORK

Delete Paragraph 5.2.3 in its entirety and replace with the following:

5.2.3 If the Owner or Architect has reasonable objection to a person or entity proposed by the Contractor, the Contractor shall propose another to whom the Owner or Architect has no reasonable objection, subject to the statutory requirements of 29 Delaware Code § 6962(d)(10)b.3 and 4.

ARTICLE 6: CONSTRUCTION BY OWNER OR BY SEPARATE CONTRACTORS

6.1 OWNER'S RIGHT TO PERFORM CONSTRUCTION AND TO AWARD SEPARATE CONTRACTS

Delete Paragraph 6.1.4 in its entirety.

6.2 MUTUAL RESPONSIBILITY

6.2.3 In the second sentence, strike the word "shall" and insert the word "may".

ARTICLE 7: CHANGES IN THE WORK

(SEE ARTICLE 7: CHANGES IN WORK IN THE GENERAL REQUIREMENTS)

ARTICLE 8: TIME

8.2 PROGRESS AND COMPLETION

Add the following Paragraphs:

8.2.1.1 Refer to Specification Section SUMMARY OF WORK for Contract time requirements.

8.2.4 If the Work falls behind the Progress Schedule as submitted by the Contractor, the Contractor shall employ additional labor and/or equipment necessary to bring the Work into compliance with the Progress Schedule at no additional cost to the Owner.

8.3 DELAYS AND EXTENSION OF TIME

8.3.1 Strike "arbitration" and insert "remedies at law or in equity".

Add the following Paragraph:

8.3.2.1 The Contractor shall update the status of the suspension, delay, or interruption of the Work with each Application for Payment. (The Contractor shall report the termination of such cause immediately upon the termination thereof.) Failure to comply with this procedure shall constitute a waiver for any claim for adjustment of time or price based upon said cause.

Delete Paragraph 8.3.3 in its entirety and replace with the following:

8.3.3 Except in the case of a suspension of the Work directed by the Owner, an extension of time under the provisions of Paragraph 8.3.1 shall be the Contractor's sole remedy in the progress of the Work and there shall be no payment or compensation to the Contractor for any expense or damage resulting from the delay.

Add the following Paragraph:

8.3.4 By permitting the Contractor to work after the expired time for completion of the project, the Owner does not waive their rights under the Contract.

ARTICLE 9: PAYMENTS AND COMPLETION

9.2 SCHEDULE OF VALUES

Add the following Paragraphs:

9.2.1 The Schedule of Values shall be submitted using AIA Document G702, Continuation Sheet to G703.

9.2.2 The Schedule of Values is to include a line item for Project Closeout Document Submittal. The value of this item is to be no less than 1% of the initial contract amount.

9.3 APPLICATIONS FOR PAYMENT

Add the following Paragraph:

9.3.1.3 Application for Payment shall be submitted on AIA Document G702 "Application and Certificate for Payment", supported by AIA Document G703 "Continuation Sheet". Said Applications shall be fully executed and notarized.

Add the following Paragraphs:

9.3.4 Until Closeout Documents have been received and outstanding items completed the Owner will pay 95% (ninety-five percent) of the amount due the Contractor on account of progress payments.

9.3.5 The Contractor shall provide a current and updated Progress Schedule to the Architect with each Application for Payment. Failure to provide Schedule will be just cause for rejection of Application for Payment.

9.5 DECISIONS TO WITHHOLD CERTIFICATION

Add the following to 9.5.1:

.8 failure to provide a current Progress Schedule;
.9 a lien or attachment is filed;
.10 failure to comply with mandatory requirements for maintaining Record Documents.

9.6 PROGRESS PAYMENTS

Delete Paragraph 9.6.1 in its entirety and replace with the following:

9.6.1 After the Architect has approved and issued a Certificate for Payment, payment shall be made by the Owner within 30 days after Owner's receipt of the Certificate for Payment.

9.7 FAILURE OF PAYMENT

In first sentence, strike "seven" and insert "thirty (30)". Also strike "binding dispute resolution" and insert "remedies at law or in equity".

9.8 SUBSTANTIAL COMPLETION

To Subparagraph 9.8.3- Add the following sentence:

"If the Architect is required to make more than 2 inspections of the same portion of work, the Contractor shall responsible for all costs associated with subsequent inspections including but not limited to any Architect's fees."

9.8.5 In the second sentence, strike "shall" and insert "may".

ARTICLE 10: PROTECTION OF PERSONS AND PROPERTY

10.1 SAFETY PRECAUTIONS AND PROGRAMS

Add the following Paragraphs:

10.1.1.1.1 Each Contractor shall develop a safety program in accordance with the Occupational Safety and Health Act of 1970. A copy of said plan shall be furnished to the Owner and Architect prior to the commencement of that Contractor's Work.

10.1.2 Each Contractor shall appoint a Safety Representative. Safety Representatives shall be someone who is on site on a full time basis. If deemed necessary by the Owner or Architect, Contractor Safety meetings will be scheduled. The attendance of all Safety Representatives will be required. Minutes will be recorded of said meetings by the Contractor and will be distributed to all parties as well as posted in all job offices/trailers etc.

10.2 SAFETY OF PERSONS AND PROPERTY

Add the following Paragraph:

10.2.4.1 As required in the Hazardous Chemical Act of June 1984, all vendors supplying any material that may be defined as hazardous must provide Material Safety Data Sheets for those products. Any chemical product should be considered hazardous if it has a caution warning on the label relating to a potential physical or health hazard, if it is known to be present in the work place, and if employees may be exposed under normal conditions or in foreseeable emergency situations. Material Safety Data Sheets shall be provided directly to the Owner, along with the shipping slips that include those products.

10.3 HAZARDOUS MATERIALS

Delete Paragraph 10.3.3 in its entirety.

10.5 Delete Paragraphs 10.3.6 in its entirety.

ARTICLE 11: INSURANCE AND BONDS

11.1 CONTRACTOR'S LIABILITY INSURANCE

11.1.4 Strike "the Owner" immediately following "(1)" and strike "and (2) the Owner as an additional insured for claims caused in whole or in part by the Contractor's negligent acts or omissions during the Contractor's completed operations."

11.2 OWNER'S LIABILITY INSURANCE

Delete Paragraph 11.2 in its entirety.

11.3 PROPERTY INSURANCE

Delete Paragraph 11.3 in its entirety and replace with the following:

- 11.3 The State will not provide Builder's All Risk Insurance for the Project. The Contractor and all Subcontractors shall provide property coverage for their tools and equipment, as necessary. Any mandatory deductible required by the Contractor's Insurance shall be the responsibility of the Contractor.

11.4 PERFORMANCE BOND AND PAYMENT BOND

Add the following sentence: "The bonds will conform to those forms approved by the Office of Management and Budget."

ARTICLE 12: UNCOVERING AND CORRECTION OF WORK

12.2.2 AFTER SUBSTANTIAL COMPLETION

Add the following Paragraph:

- 12.2.2.1.1 At any time during the progress of the Work, or in any case where the nature of the defects will be such that it is not expedient to have corrected, the Owner, at its option, will have the right to deduct such sum, or sums, of money from the amount of the Contract as it considers justified to adjust the difference in value between the defective work and that required under contract including any damage to the structure.

12.2.2.1 Strike "one" and insert "two".

12.2.2.2 Strike "one" and insert "two".

12.2.2.3 Strike "one" and insert "two".

12.2.5 In second sentence, strike "one" and insert "two".

ARTICLE 13: MISCELLANEOUS PROVISIONS

13.1 GOVERNING LAW

Strike "except that, if the parties have selected arbitration as the method of binding dispute resolution, the Federal Arbitration Act shall govern Section 15.4."

13.6 INTEREST

Strike "the date payment is due at such rate as the parties may agree upon in writing or, in the absence thereof, at the legal rate prevailing from time to time at the place where the Project is located." Insert "30 days of presentment of the authorized Certificate of Payment at the annual rate of 12% or 1% per month.

13.7 TIME LIMITS ON CLAIMS

Strike the last sentence.

Add the following Paragraph:

13.8 CONFLICTS WITH FEDERAL STATUTES OR REGULATIONS

- 13.8.1 If any provision, specifications or requirement of the Contract Documents conflict or is inconsistent with any statute, law or regulation of the government of the United State of America, the Contractor shall notify the Architect and Owner immediately upon discovery.

ARTICLE 14: TERMINATION OR SUSPENSION OF THE CONTRACT

14.4 TERMINATION BY THE OWNER FOR CONVENIENCE

Delete Paragraph 14.4.3 in its entirety and replace with the following:

- 14.4.3 In case of such termination for the Owner's convenience, the Contractor shall be entitled to receive payment for Work executed, and cost incurred by reason of such termination along with reasonable overhead.

ARTICLE 15: CLAIMS AND DISPUTES

- 15.1.2 Throughout the Paragraph strike "21" and insert "45".

15.1.6 CLAIMS FOR CONSEQUENTIAL DAMAGES

Delete Paragraph 15.1.6 in its entirety.

15.2 INITIAL DECISION

Delete Paragraph 15.2.5 in its entirety and replace with the following:

- 15.2.5 The Architect will approve or reject Claims by written decision, which shall state the reasons therefor and shall notify the parties of any change in the Contract Sum or Contract Time or both. The approval or rejection of a Claim by the Architect shall be subject to mediation and other remedies at law or in equity.

Delete Paragraph 15.2.6 and its subparagraphs in their entirety.

15.3 MEDIATION

- 15.3.1 Strike "binding dispute resolution" and insert "any or all remedies at law or in equity".

- 15.3.2 In the first sentence, delete "administered by the American Arbitration Association in accordance with its Construction Industry Mediation Procedure in effect on the date of the Agreement," Strike "binding dispute resolution" and insert "remedies at law and in equity".

15.4 ARBITRATION

Delete Paragraph 15.4 and its sub-sections in its entirety.

END OF SUPPLEMENTARY GENERAL CONDITIONS

SECTION 01 10 00

SUMMARY

PART 1 GENERAL

1.01 PROJECT

- A. Project Name: Frederick Douglass ES - Chiller Replacement.
- B. Owner's Name: Seaford School District.
- C. Architect's Name: StudioJAED Architects & Engineers.
- D. The Project consists of the alterations and additions for exterior improvements involved in replacing the existing air-cooled chiller..

1.02 CONTRACT DESCRIPTION

- A. Contract Type: A single prime contract based on a Stipulated Price.

1.03 DESCRIPTION OF ALTERATIONS WORK

- A. Scope of demolition and removal work is shown on drawings and specified in Section 02 41 00.
- B. Scope of new additions is shown on drawings.
- C. Scope of alterations work is shown on drawings.
- D. HVAC: Alter existing system and add new construction, keeping existing in operation.
- E. Electrical Power and Lighting: Alter existing system and add new construction, keeping existing in operation.

1.04 WORK BY OWNER

- A. Owner will award a contract for Building Automation System and Controls. It will be necessary to coordinate work with the contractor.
- B. Owner will supply the following for installation by Contractor:

1.05 OWNER OCCUPANCY

- A. Owner intends to continue to occupy adjacent portions of the existing building during the entire construction period.
- B. Owner intends to occupy the Project upon Substantial Completion.
- C. Cooperate with Owner to minimize conflict and to facilitate Owner's operations.
- D. Schedule the Work to accommodate Owner occupancy.

1.06 CONTRACTOR USE OF SITE AND PREMISES

- A. Construction Operations: Limited to areas noted on Drawings.
- B. Arrange use of site and premises to allow:
 - 1. Owner occupancy.
 - 2. Work by Others.
 - 3. Work by Owner.
 - 4. Use of site and premises by the public.
- C. Provide access to and from site as required by law and by Owner:
 - 1. Emergency Building Exits During Construction: Keep all exits required by code open during construction period; provide temporary exit signs if exit routes are temporarily altered.
 - 2. Do not obstruct roadways, sidewalks, or other public ways without permit.
- D. Existing building spaces may not be used for storage.
- E. Time Restrictions:

1. Limit conduct of especially noisy exterior work when school is in session .
 2. Limit conduct of especially noisy interior work when school is in session .
- F. Utility Outages and Shutdown:
1. Limit disruption of utility services to hours the building is unoccupied.
 2. Do not disrupt or shut down life safety systems, including but not limited to fire sprinklers and fire alarm system, without 7 days notice to Owner and authorities having jurisdiction.
 3. Limit shutdown of utility services to 2 hours at a time, arranged at least 24 hours in advance with Owner.
 4. Prevent accidental disruption of utility services to other facilities.

1.07 WORK SEQUENCE

- A. Coordinate construction schedule and operations with Owner.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION - NOT USED

END OF SECTION

NOT FOR BIDDING PURPOSES

SECTION 01 20 00
PRICE AND PAYMENT PROCEDURES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Procedures for preparation and submittal of applications for progress payments.
- B. Documentation of changes in Contract Price and Contract Time.
- C. Change procedures.
- D. Correlation of Contractor submittals based on changes.
- E. Procedures for preparation and submittal of application for final payment.

1.02 RELATED REQUIREMENTS

- A. Document 00 72 00 - General Conditions and Document 00 73 00 - Supplementary Conditions: Additional requirements for progress payments, final payment, changes in the Work.
- B. Document 00 73 00 - Supplementary Conditions: Percentage allowances for Contractor's overhead and profit.
- C. Section 01 21 00 - Allowances: Payment procedures relating to allowances.
- D. Section 01 22 00 - Unit Prices: Monetary values of unit prices, payment and modification procedures relating to unit prices.

1.03 SCHEDULE OF VALUES

- A. Submit a printed schedule on AIA Form G703 - Application and Certificate for Payment Continuation Sheet.
- B. Electronic media printout including equivalent information will be considered in lieu of standard form specified; submit sample to Architect for approval.
- C. Forms filled out by hand will not be accepted.
- D. Submit Schedule of Values in duplicate within 20 days after date of Owner-Contractor Agreement.
- E. Format: Utilize the Table of Contents of this Project Manual. Identify each line item with number and title of the specification Section. Identify site mobilization.
- F. Include separately from each line item, a direct proportional amount of contractor's overhead and profit.
- G. Revise schedule to list approved Change Orders, with each Application For Payment.

1.04 APPLICATIONS FOR PROGRESS PAYMENTS

- A. Submit a printed application on AIA G702 - Application and Certificate for Payment and AIA G703 - Continuation Sheet
- B. Payment Period: Submit at intervals stipulated in the Agreement.
- C. Electronic media printout including equivalent information will be considered in lieu of standard form specified; submit sample to Architect for approval.
- D. Forms filled out by hand will not be accepted.
- E. For each item, provide a column for listing each of the following:
 - 1. Item Number.
 - 2. Description of work.
 - 3. Scheduled Values.
 - 4. Previous Applications.
 - 5. Work in Place and Stored Materials under this Application.

6. Authorized Change Orders.
 7. Total Completed and Stored to Date of Application.
 8. Percentage of Completion.
 9. Balance to Finish.
 10. Retainage.
- F. Execute certification by signature of authorized officer.
- G. Use data from approved Schedule of Values. Provide dollar value in each column for each line item for portion of work performed and for stored products.
- H. List each authorized Change Order as a separate line item, listing Change Order number and dollar amount as for an original item of Work.
- I. Submit three copies of each Application for Payment.
- J. Include the following with the application:
1. Transmittal letter as specified for Submittals in Section 01 30 00.
 2. Construction progress schedule, revised and current as specified in Section 01 30 00.
 3. Current construction photographs specified in Section 01 30 00.
 4. Partial release of liens from major Subcontractors and vendors.
 5. Project record documents as specified in Section 01 78 00, for review by Owner which will be returned to the Contractor.
 6. Affidavits attesting to off-site stored products.
- K. When Architect requires substantiating information, submit data justifying dollar amounts in question. Provide one copy of data with cover letter for each copy of submittal. Show application number and date, and line item by number and description.

1.05 MODIFICATION PROCEDURES

- A. Submit name of the individual authorized to receive change documents and who will be responsible for informing others.
- B. For minor changes not involving an adjustment to the Contract Price or Contract Time, Architect will issue instructions directly to the contractor.
- C. For other required changes, Architect will issue a document signed by Owner instructing Contractor to proceed with the change, for subsequent inclusion in a Change Order.
1. The document will describe the required changes and will designate method of determining any change in Contract Price or Contract Time.
 2. Promptly execute the change.
- D. For changes for which advance pricing is desired, Architect will issue a document that includes a detailed description of a proposed change with supplementary or revised drawings and specifications. Contractor shall prepare and submit a fixed price quotation within 5 days.
- E. Contractor may propose a change by submitting a request for change to Architect, describing the proposed change and its full effect on the Work, with a statement describing the reason for the change, and the effect on the Contract Price and Contract Time with full documentation and a statement describing the effect on Work by separate or other contractors. Document any requested substitutions in accordance with Section 01 60 00.
- F. Computation of Change in Contract Amount: As specified in the Agreement and Conditions of the Contract.
1. For change requested by Contractor, the amount will be based on the Contractor's request for a Change Order as approved by Architect and the Red Clay Consolidated School District.
 2. For pre-determined unit prices and quantities, the amount will be based on the fixed unit prices.

3. For change ordered by Architect without a quotation from the contractor, the amount will be determined by Architect based on the contractor's substantiation of costs as specified for Time and Material work.
 - G. Substantiation of Costs: Provide full information required for evaluation.
 1. On request, provide following data:
 - a. Quantities of products, labor, and equipment.
 - b. Taxes, insurance, and bonds.
 - c. Overhead and profit.
 - d. Justification for any change in Contract Time.
 - e. Credit for deletions from Contract, similarly documented.
 2. Support each claim for additional costs with additional information:
 - a. Origin and date of claim.
 - b. Dates and times work was performed, and by whom.
 - c. Time records and wage rates paid.
 - d. Invoices and receipts for products, equipment, and subcontracts, similarly documented.
 3. For Time and Material work, submit itemized account and supporting data after completion of change, within time limits indicated in the Conditions of the Contract.
 - H. Execution of Change Orders: Architect will issue Change Orders for signatures of parties as provided in the Conditions of the Contract.
 - I. After execution of Change Order, promptly revise Schedule of Values and Application for Payment forms to record each authorized Change Order as a separate line item and adjust the Contract Price.
 - J. Promptly revise progress schedules to reflect any change in Contract Time, revise sub-schedules to adjust times for other items of work affected by the change, and resubmit.
 - K. Promptly enter changes in Project Record Documents.
- 1.06 APPLICATION FOR FINAL PAYMENT**
- A. Prepare Application for Final Payment as specified for progress payments, identifying total adjusted Contract Price, previous payments, and sum remaining due.
 - B. Application for Final Payment will not be considered until the following have been accomplished:
 1. All closeout procedures specified in Section 01 70 00.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION - NOT USED

END OF SECTION

NOT FOR BIDDING PURPOSES

SECTION 01 35 53
SECURITY PROCEDURES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Security measures including formal security program, entry control, personnel identification, and miscellaneous restrictions.

1.02 RELATED REQUIREMENTS

- A. Section 01 10 00 - Summary.
- B. Section 01 50 00 - Temporary Facilities and Controls.

1.03 SECURITY PROGRAM

- A. Protect Work, existing premises and Owner's operations from theft, vandalism, and unauthorized entry.
- B. Initiate program at project mobilization.
- C. Maintain program throughout construction period until Owner occupancy.

1.04 ENTRY CONTROL

- A. Restrict entrance of persons and vehicles into Project site and existing facilities.
- B. Allow entrance only to authorized persons with proper identification.
- C. Maintain log of workers and visitors, make available to Owner on request.
- D. Owner will control entrance of persons and vehicles related to Owner's operations.

1.05 PERSONNEL IDENTIFICATION

- A. Provide identification badge to each person authorized to enter premises.
- B. Badge To Include: Personal photograph, name, assigned number, expiration date and employer.
- C. Maintain a list of accredited persons, submit copy to Owner on request.
- D. Require return of badges at expiration of their employment on the Work.
- E. Follow state of DE Security Background Search requirements for all on-site personnell.

1.06 RESTRICTIONS

- A. Do not allow cameras on site or photographs taken except by written approval of Owner.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION - NOT USED

END OF SECTION

NOT FOR BIDDING PURPOSES

SECTION 01 40 00
QUALITY REQUIREMENTS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. References and standards.
- B. Quality assurance submittals.
- C. Mock-ups.
- D. Control of installation.
- E. Tolerances.
- F. Testing and inspection services.
- G. Manufacturers' field services.

1.02 RELATED REQUIREMENTS

- A. Section 01 30 00 - Administrative Requirements: Submittal procedures.
- B. Section 01 60 00 - Product Requirements: Requirements for material and product quality.

1.03 REFERENCE STANDARDS

- A. ASTM C1021 - Standard Practice for Laboratories Engaged in Testing of Building Sealants.
- B. ASTM C1077 - Standard Practice for Laboratories Testing Concrete and Concrete Aggregates for Use in Construction and Criteria for Laboratory Evaluation.
- C. ASTM C1093 - Standard Practice for Accreditation of Testing Agencies for Masonry.
- D. ASTM D3740 - Standard Practice for Minimum Requirements for Agencies Engaged in the Testing and/or Inspection of Soil and Rock as Used in Engineering Design and Construction.
- E. ASTM E329 - Standard Specification for Agencies Engaged Construction Inspection and/or Testing.
- F. ASTM E543 - Standard Specification for Agencies Performing Nondestructive Testing.

1.04 SUBMITTALS

- A. Design Data: Submit for Architect's knowledge as contract administrator for the limited purpose of assessing conformance with information given and the design concept expressed in the contract documents, or for Owner's information.
- B. Test Reports: After each test/inspection, promptly submit two copies of report to Architect and to Contractor.
 - 1. Include:
 - a. Date issued.
 - b. Project title and number.
 - c. Name of inspector.
 - d. Date and time of sampling or inspection.
 - e. Identification of product and specifications section.
 - f. Location in the Project.
 - g. Type of test/inspection.
 - h. Date of test/inspection.
 - i. Results of test/inspection.
 - j. Conformance with Contract Documents.
 - k. When requested by Architect, provide interpretation of results.

2. Test report submittals are for Architect's knowledge as contract administrator for the limited purpose of assessing conformance with information given and the design concept expressed in the contract documents, or for Owner's information.
- C. Certificates: When specified in individual specification sections, submit certification by the manufacturer and Contractor or installation/application subcontractor to Architect, in quantities specified for Product Data.
 1. Indicate material or product conforms to or exceeds specified requirements. Submit supporting reference data, affidavits, and certifications as appropriate.
 2. Certificates may be recent or previous test results on material or product, but must be acceptable to Architect.
- D. Manufacturer's Instructions: When specified in individual specification sections, submit printed instructions for delivery, storage, assembly, installation, start-up, adjusting, and finishing, for the Owner's information. Indicate special procedures, perimeter conditions requiring special attention, and special environmental criteria required for application or installation.
- E. Manufacturer's Field Reports: Submit reports for Architect's benefit as contract administrator or for Owner.
 1. Submit report in duplicate within 30 days of observation to Architect for information.
 2. Submit for information for the limited purpose of assessing conformance with information given and the design concept expressed in the contract documents.

1.05 REFERENCES AND STANDARDS

- A. For products and workmanship specified by reference to a document or documents not included in the Project Manual, also referred to as reference standards, comply with requirements of the standard, except when more rigid requirements are specified or are required by applicable codes.
- B. Conform to reference standard of date of issue current on date of Contract Documents, except where a specific date is established by applicable code.
- C. Obtain copies of standards where required by product specification sections.
- D. Maintain copy at project site during submittals, planning, and progress of the specific work, until Substantial Completion.
- E. Should specified reference standards conflict with Contract Documents, request clarification from Architect before proceeding.
- F. Neither the contractual relationships, duties, or responsibilities of the parties in Contract nor those of Architect shall be altered from the Contract Documents by mention or inference otherwise in any reference document.

1.06 TESTING AND INSPECTION AGENCIES

- A. Contractor shall employ and pay for services of an independent testing agency to perform specified testing and inspection.
- B. Employment of agency in no way relieves Contractor of obligation to perform Work in accordance with requirements of Contract Documents.
- C. Contractor Employed Agency:
 1. Testing agency: Comply with requirements of ASTM E329, ASTM E543, ASTM C1021, ASTM C1077, and ASTM C1093 ASTM D 3740.
 2. Inspection agency: Comply with requirements of ASTM D3740 and ASTM E329.
 3. Laboratory: Authorized to operate in the State in which the Project is located.
 4. Laboratory Staff: Maintain a full time registered Engineer or specialist on staff to review services.

5. Testing Equipment: Calibrated at reasonable intervals either by NIST or using an NIST established Measurement Assurance Program, under a laboratory measurement quality assurance program.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION

3.01 CONTROL OF INSTALLATION

- A. Monitor quality control over suppliers, manufacturers, products, services, site conditions, and workmanship, to produce Work of specified quality.
- B. Comply with manufacturers' instructions, including each step in sequence.
- C. Should manufacturers' instructions conflict with Contract Documents, request clarification from Architect before proceeding.
- D. Comply with specified standards as minimum quality for the Work except where more stringent tolerances, codes, or specified requirements indicate higher standards or more precise workmanship.
- E. Have Work performed by persons qualified to produce required and specified quality.
- F. Verify that field measurements are as indicated on shop drawings or as instructed by the manufacturer.
- G. Secure products in place with positive anchorage devices designed and sized to withstand stresses, vibration, physical distortion, and disfigurement.

3.02 MOCK-UPS

- A. Tests will be performed under provisions identified in this section and identified in the respective product specification sections.
- B. Assemble and erect specified items with specified attachment and anchorage devices, flashings, seals, and finishes.
- C. Accepted mock-ups shall be a comparison standard for the remaining Work.
- D. Where mock-up has been accepted by Architect and is specified in product specification sections to be removed, remove mock-up and clear area when directed to do so.

3.03 TOLERANCES

- A. Monitor fabrication and installation tolerance control of products to produce acceptable Work. Do not permit tolerances to accumulate.
- B. Comply with manufacturers' tolerances. Should manufacturers' tolerances conflict with Contract Documents, request clarification from Architect before proceeding.
- C. Adjust products to appropriate dimensions; position before securing products in place.

3.04 TESTING AND INSPECTION

- A. See individual specification sections for testing & inspection required.
- B. Testing Agency Duties:
 1. Provide qualified personnel at site. Cooperate with Architect and Contractor in performance of services.
 2. Perform specified sampling and testing of products in accordance with specified standards.
 3. Ascertain compliance of materials and mixes with requirements of Contract Documents.
 4. Promptly notify Architect and Contractor of observed irregularities or non-conformance of Work or products.
 5. Perform additional tests and inspections required by Architect.
 6. Submit reports of all tests/inspections specified.

- C. Limits on Testing/Inspection Agency Authority:
 - 1. Agency may not release, revoke, alter, or enlarge on requirements of Contract Documents.
 - 2. Agency may not approve or accept any portion of the Work.
 - 3. Agency may not assume any duties of Contractor.
 - 4. Agency has no authority to stop the Work.
- D. Contractor Responsibilities:
 - 1. Deliver to agency at designated location, adequate samples of materials proposed to be used that require testing, along with proposed mix designs.
 - 2. Cooperate with laboratory personnel, and provide access to the Work and to manufacturers' facilities.
 - 3. Provide incidental labor and facilities:
 - a. To provide access to Work to be tested/inspected.
 - b. To obtain and handle samples at the site or at source of Products to be tested/inspected.
 - c. To facilitate tests/inspections.
 - d. To provide storage and curing of test samples.
 - 4. Notify Architect and laboratory 24 hours prior to expected time for operations requiring testing/inspection services.
 - 5. Employ services of an independent qualified testing laboratory and pay for additional samples, tests, and inspections required by Contractor beyond specified requirements.
 - 6. Arrange with Owner's agency and pay for additional samples, tests, and inspections required by Contractor beyond specified requirements.
- E. Re-testing required because of non-conformance to specified requirements shall be performed by the same agency on instructions by Architect.
- F. Re-testing required because of non-conformance to specified requirements shall be paid for by Contractor.

3.05 MANUFACTURERS' FIELD SERVICES

- A. When specified in individual specification sections, require material or product suppliers or manufacturers to provide qualified staff personnel to observe site conditions, conditions of surfaces and installation, quality of workmanship, start-up of equipment, test, adjust and balance of equipment and fluid-applied flooring as applicable, and to initiate instructions when necessary.
- B. Submit qualifications of observer to Architect 30 days in advance of required observations.
 - 1. Observer subject to approval of Architect.
 - 2. Observer subject to approval of Owner.
- C. Report observations and site decisions or instructions given to applicators or installers that are supplemental or contrary to manufacturers' written instructions.

3.06 DEFECT ASSESSMENT

- A. Replace Work or portions of the Work not conforming to specified requirements.
- B. If, in the opinion of StudioJaed or the Seaford School District, it is not practical to remove and replace the Work, StudioJAED will direct an appropriate remedy or adjust payment.

END OF SECTION

SECTION 01 50 00
TEMPORARY FACILITIES AND CONTROLS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Temporary utilities.
- B. Temporary telecommunications services.
- C. Temporary sanitary facilities.
- D. Temporary Controls: Barriers and enclosures.
- E. Security requirements.
- F. Vehicular access and parking.
- G. Waste removal facilities and services.
- H. Project identification sign.
- I. Field offices.

1.02 RELATED REQUIREMENTS

- A. Section 01 35 53 - Security Procedures.

1.03 TEMPORARY UTILITIES

- A. Provide for all electrical power, lighting, water, heating and cooling, and ventilation required for construction purposes.
- B. Existing facilities may be used where possible.
- C. Use trigger-operated nozzles for water hoses, to avoid waste of water.

1.04 TELECOMMUNICATIONS SERVICES

- A. Provide, maintain, and pay for telecommunications services including telephone, internet and facsimile to field office at time of project mobilization.
- B. Telecommunications services shall include:
 - 1. Windows-based personal computer dedicated to project telecommunications, with necessary software and laser printer.
 - 2. Telephone Land Lines: One line, minimum; one handset per line.
 - 3. Internet Connections: Minimum of one; DSL modem or faster.
 - 4. Facsimile Service: Minimum of one dedicated fax machine/printer, with dedicated phone line.

1.05 TEMPORARY SANITARY FACILITIES

- A. Provide and maintain required facilities and enclosures. Provide at time of project mobilization.
- B. Use of existing facilities is not permitted.
- C. Maintain daily in clean and sanitary condition.

1.06 BARRIERS

- A. Provide barriers to prevent unauthorized entry to construction areas, to prevent access to areas that could be hazardous to workers or the public, to allow for owner's use of site and to protect existing facilities and adjacent properties from damage from construction operations and demolition.
- B. Provide barricades and covered walkways required by governing authorities for public rights-of-way and for public access to existing building.
- C. Provide protection for plants designated to remain. Replace damaged plants.

- D. Protect non-owned vehicular traffic, stored materials, site, and structures from damage.

1.07 EXTERIOR ENCLOSURES

- A. Provide temporary insulated weather tight closure of exterior openings to accommodate acceptable working conditions and protection for Products, to allow for temporary heating and maintenance of required ambient temperatures identified in individual specification sections, and to prevent entry of unauthorized persons. Provide access doors with self-closing hardware and locks.

1.08 INTERIOR ENCLOSURES

- A. Provide temporary partitions as indicated to separate work areas between Base Bid and Not In Contract Work
- B. Construction: Framing and reinforced polyethylene sheet materials with closed joints and sealed edges at intersections with existing surfaces:
- C. Paint surfaces exposed to view from Owner-occupied areas.

1.09 SECURITY - SEE SECTION 01 35 53

- A. Provide security and facilities to protect Work, existing facilities, and Owner's operations from unauthorized entry, vandalism, or theft.
- B. Coordinate with Owner's security procedures.

1.10 VEHICULAR ACCESS AND PARKING

- A. Coordinate access and haul routes with governing authorities and Owner.
- B. Provide and maintain access to fire hydrants, free of obstructions.
- C. Provide means of removing mud from vehicle wheels before entering streets.
- D. Designated existing on-site roads may be used for construction traffic.
- E. Provide temporary parking areas to accommodate construction personnel. When site space is not adequate, provide additional off-site parking.
- F. Existing parking areas located at Seaford High School may be used for construction parking with authorization from the Seaford School District. Coordinate with School District for designation of parking areas.
- G. Do not allow construction vehicle parking on existing pavement without explicit approval from the Owner.

1.11 WASTE REMOVAL

- A. See Section 01 74 19 - Waste Management, for additional requirements.
- B. Provide waste removal facilities and services as required to maintain the site in clean and orderly condition.
- C. Provide containers with lids. Remove trash from site periodically.
- D. If materials to be recycled or re-used on the project must be stored on-site, provide suitable non-combustible containers; locate containers holding flammable material outside the structure unless otherwise approved by the authorities having jurisdiction.
- E. Open free-fall chutes are not permitted. Terminate closed chutes into appropriate containers with lids.

1.12 PROJECT IDENTIFICATION

- A. Provide project identification sign of design and construction indicated on Drawings.
- B. Erect on site at location indicated.
- C. No other signs are allowed without Owner permission except those required by law.

1.13 FIELD OFFICES

- A. Office: Weathertight, with lighting, electrical outlets, heating, cooling equipment, and equipped with sturdy furniture, drawing rack and drawing display table.
- B. Provide space for Project meetings, with table and chairs to accommodate 10 persons.
- C. Locate offices a minimum distance of 30 feet from existing and new structures.

1.14 REMOVAL OF UTILITIES, FACILITIES, AND CONTROLS

- A. Remove temporary utilities, equipment, facilities, materials, prior to Substantial Completion inspection.
- B. Remove underground installations to a minimum depth of 2 feet. Grade site as indicated.
- C. Clean and repair damage caused by installation or use of temporary work.
- D. Restore existing facilities used during construction to original condition.
- E. Restore new permanent facilities used during construction to specified condition.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION - NOT USED

END OF SECTION

NOT FOR BIDDING PURPOSES

NOT FOR BIDDING PURPOSES

SECTION 01 60 00
PRODUCT REQUIREMENTS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. General product requirements.
- B. Re-use of existing products.
- C. Transportation, handling, storage and protection.
- D. Product option requirements.
- E. Substitution limitations and procedures.
- F. Maintenance materials, including extra materials, spare parts, tools, and software.

1.02 RELATED REQUIREMENTS

- A. Section 01 10 00 - Summary: Lists of products to be removed from existing building.
- B. Section 01 40 00 - Quality Requirements: Product quality monitoring.
- C. Section 01 61 16 - Volatile Organic Compound (VOC) Content Restrictions: Requirements for VOC-restricted product categories.
- D. Section 01 74 19 - Construction Waste Management and Disposal: Waste disposal requirements potentially affecting packaging and substitutions.

1.03 REFERENCE STANDARDS

- A. 16 CFR 260 - Guides for the Use of Environmental Marketing Claims; Federal Trade Commission.
- B. NFPA 70 - National Electrical Code; National Fire Protection Association.

1.04 SUBMITTALS

- A. Product Data Submittals: Submit manufacturer's standard published data. Mark each copy to identify applicable products, models, options, and other data. Supplement manufacturers' standard data to provide information specific to this Project.
- B. Shop Drawing Submittals: Prepared specifically for this Project; indicate utility and electrical characteristics, utility connection requirements, and location of utility outlets for service for functional equipment and appliances.
- C. Sample Submittals: Illustrate functional and aesthetic characteristics of the product, with integral parts and attachment devices. Coordinate sample submittals for interfacing work.
 - 1. For selection from standard finishes, submit samples of the full range of the manufacturer's standard colors, textures, and patterns.

PART 2 PRODUCTS

2.01 EXISTING PRODUCTS

- A. Do not use materials and equipment removed from existing premises unless specifically required or permitted by the Contract Documents.
- B. Unforeseen historic items encountered remain the property of the Owner; notify Owner promptly upon discovery; protect, remove, handle, and store as directed by Owner.
- C. Existing materials and equipment indicated to be removed, but not to be re-used, relocated, reinstalled, delivered to the Owner, or otherwise indicated as to remain the property of the Owner, become the property of the Contractor; remove from site.
- D. Reused Products: Reused products include materials and equipment previously used in this or other construction, salvaged and refurbished as specified.

- E. Specific Products to be Reused: The reuse of certain materials and equipment already existing on the project site is required.
 - 1. See drawings for list of items required to be salvaged for reuse and relocation.

2.02 NEW PRODUCTS

- A. Provide new products unless specifically required or permitted by the Contract Documents.
- B. Do not use products having any of the following characteristics:
 - 1. Made using or containing CFC's or HCFC's.
- C. Where all other criteria are met, Contractor shall give preference to products that:
 - 1. Are extracted, harvested, and/or manufactured closer to the location of the project.
 - 2. Have longer documented life span under normal use.
 - 3. Result in less construction waste.
 - 4. Are made of vegetable materials that are rapidly renewable.
- D. Motors: Refer to Section 22 05 13, NEMA MG 1 Type. Specific motor type is specified in individual specification sections.
- E. Wiring Terminations: Provide terminal lugs to match branch circuit conductor quantities, sizes, and materials indicated. Size terminal lugs to NFPA 70, include lugs for terminal box.
- F. Cord and Plug: Provide minimum 6 foot cord and plug including grounding connector for connection to electric wiring system. Cord of longer length is specified in individual specification sections.

2.03 PRODUCT OPTIONS

- A. Products Specified by Reference Standards or by Description Only: Use any product meeting those standards or description.
- B. Products Specified by Naming One or More Manufacturers with a Provision for Substitutions: Submit a request for substitution for any manufacturer not named.

2.04 MAINTENANCE MATERIALS

- A. Furnish extra materials, spare parts, tools, and software of types and in quantities specified in individual specification sections.
- B. Deliver to Project site; obtain receipt prior to final payment.

PART 3 EXECUTION

3.01 SUBSTITUTION PROCEDURES

- A. Instructions to Bidders specify time restrictions for submitting requests for substitutions during the bidding period. Comply with requirements specified in this section.
- B. Document each request with complete data substantiating compliance of proposed substitution with Contract Documents.
- C. A request for substitution constitutes a representation that the submitter:
 - 1. Has investigated proposed product and determined that it meets or exceeds the quality level of the specified product.
 - 2. Will provide the same warranty for the substitution as for the specified product.
 - 3. Will coordinate installation and make changes to other Work that may be required for the Work to be complete with no additional cost to Owner.
 - 4. Waives claims for additional costs or time extension that may subsequently become apparent.
- D. Substitutions will not be considered when they are indicated or implied on shop drawing or product data submittals, without separate written request, or when acceptance will require revision to the Contract Documents.

- E. Substitution Submittal Procedure:
1. Submit three copies of request for substitution for consideration. Limit each request to one proposed substitution.
 2. Submit shop drawings, product data, and certified test results attesting to the proposed product equivalence. Burden of proof is on proposer.
 3. The Architect will notify in writing of decision to accept or reject request.

3.02 TRANSPORTATION AND HANDLING

- A. Coordinate schedule of product delivery to designated prepared areas in order to minimize site storage time and potential damage to stored materials.
- B. Transport and handle products in accordance with manufacturer's instructions.
- C. Transport materials in covered trucks to prevent contamination of product and littering of surrounding areas.
- D. Promptly inspect shipments to ensure that products comply with requirements, quantities are correct, and products are undamaged.
- E. Provide equipment and personnel to handle products by methods to prevent soiling, disfigurement, or damage.
- F. Arrange for the return of packing materials, such as wood pallets, where economically feasible.

3.03 STORAGE AND PROTECTION

- A. Designate receiving/storage areas for incoming products so that they are delivered according to installation schedule and placed convenient to work area in order to minimize waste due to excessive materials handling and misapplication.
- B. Store and protect products in accordance with manufacturers' instructions.
- C. Store with seals and labels intact and legible.
- D. Store sensitive products in weather tight, climate controlled, enclosures in an environment favorable to product.
- E. For exterior storage of fabricated products, place on sloped supports above ground.
- F. Provide bonded off-site storage and protection when site does not permit on-site storage or protection.
- G. Cover products subject to deterioration with impervious sheet covering. Provide ventilation to prevent condensation and degradation of products.
- H. Store loose granular materials on solid flat surfaces in a well-drained area. Prevent mixing with foreign matter.
- I. Prevent contact with material that may cause corrosion, discoloration, or staining.
- J. Provide equipment and personnel to store products by methods to prevent soiling, disfigurement, or damage.
- K. Arrange storage of products to permit access for inspection. Periodically inspect to verify products are undamaged and are maintained in acceptable condition.

END OF SECTION

NOT FOR BIDDING PURPOSES

SECTION 01 70 00
EXECUTION AND CLOSEOUT REQUIREMENTS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Examination, preparation, and general installation procedures.
- B. Requirements for alterations work, including selective demolition.
- C. Pre-installation meetings.
- D. Cutting and patching.
- E. Surveying for laying out the work.
- F. Cleaning and protection.
- G. Starting of systems and equipment.
- H. Demonstration and instruction of Owner personnel.
- I. Closeout procedures, except payment procedures.
- J. General requirements for maintenance service.

1.02 RELATED REQUIREMENTS

- A. Section 01 10 00 - Summary: Limitations on working in existing building; continued occupancy; work sequence; identification of salvaged and relocated materials.
- B. Section 01 30 00 - Administrative Requirements: Submittals procedures.
- C. Section 01 40 00 - Quality Requirements: Testing and inspection procedures.
- D. Section 01 74 19 - Construction Waste Management and Disposal: Additional procedures for trash/waste removal, recycling, salvage, and reuse.
- E. Section 01 78 00 - Closeout Submittals: Project record documents, operation and maintenance data, warranties and bonds.
- F. Section 01 91 13 - General Commissioning Requirements: Contractor's responsibilities in regard to commissioning.
- G. Section 02 41 00 - Demolition: Demolition of whole structures and parts thereof; site utility demolition.
- H. Section 07 84 00 - Firestopping.

1.03 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Survey work: Submit name, address, and telephone number of Surveyor before starting survey work.
 - 1. On request, submit documentation verifying accuracy of survey work.
 - 2. Submit a copy of site drawing signed by the Land Surveyor, that the elevations and locations of the work are in conformance with Contract Documents.
 - 3. Submit surveys and survey logs for the project record.
- C. Demolition Plan: Submit demolition plan as specified by OSHA and local authorities.
 - 1. Indicate extent of demolition, removal sequence, bracing and shoring, and location and construction of barricades and fences. Include design drawings and calculations for bracing and shoring.
 - 2. Identify demolition firm and submit qualifications.
 - 3. Include a summary of safety procedures.
- D. Cutting and Patching: Submit written request in advance of cutting or alteration that affects:

1. Structural integrity of any element of Project.
2. Integrity of weather exposed or moisture resistant element.
3. Efficiency, maintenance, or safety of any operational element.
4. Visual qualities of sight exposed elements.
5. Work of Owner or separate Contractor.
6. Include in request:
 - a. Identification of Project.
 - b. Location and description of affected work.
 - c. Necessity for cutting or alteration.
 - d. Description of proposed work and products to be used.
 - e. Alternatives to cutting and patching.
 - f. Effect on work of Owner or separate Contractor.
 - g. Written permission of affected separate Contractor.
 - h. Date and time work will be executed.

E. Project Record Documents: Accurately record actual locations of capped and active utilities.

1.04 QUALIFICATIONS

- A. For demolition work, employ a firm specializing in the type of work required.
 1. Minimum of 5 years of documented experience.
- B. For survey work, employ a land surveyor registered in the State of Delaware and acceptable to the Owner & the Architect. Submit evidence of Surveyor's Errors and Omissions insurance coverage in the form of an Insurance Certificate.
- C. For field engineering, employ a professional engineer of the discipline required for specific service on Project, licensed in the State of Delaware.
- D. For design of temporary shoring and bracing, employ a Professional Engineer experienced in design of this type of work and licensed in the State in which the Project is located.

1.05 PROJECT CONDITIONS

- A. Grade site to drain. Maintain excavations free of water. Provide, operate, and maintain pumping equipment.
- B. Protect site from puddling or running water. Provide water barriers as required to protect site from soil erosion.
- C. Ventilate enclosed areas to assist cure of materials, to dissipate humidity, and to prevent accumulation of dust, fumes, vapors, or gases.
- D. Dust Control: Execute work by methods to minimize raising dust from construction operations. Provide positive means to prevent air-borne dust from dispersing into atmosphere and over adjacent property.
- E. Erosion and Sediment Control: Plan and execute work by methods outlined by Sussex Conservation District to control surface drainage from cuts and fills, from borrow and waste disposal areas. Prevent silt runoff from site, erosion and sedimentation.
 1. Minimize amount of bare soil exposed at one time.
 2. Provide temporary measures such as berms, dikes, and drains, to prevent water flow.
 3. Construct fill and waste areas by selective placement to avoid erosive surface silts or clays.
 4. Periodically inspect earthwork to detect evidence of erosion and sedimentation; promptly apply corrective measures.
- F. Noise Control: Provide methods, means, and facilities to minimize noise produced by construction operations.

- G. Pest and Rodent Control: Provide methods, means, and facilities to prevent pests and insects from damaging the work.
- H. Rodent Control: Provide methods, means, and facilities to prevent rodents from accessing or invading premises.
- I. Pollution Control: Provide methods, means, and facilities to prevent contamination of soil, water, and atmosphere from discharge of noxious, toxic substances, and pollutants produced by construction operations. Comply with federal, state, and local regulations.

1.06 COORDINATION

- A. See Section 01 10 00 for occupancy-related requirements.
- B. Coordinate scheduling, submittals, and work of the various sections of the Project Manual to ensure efficient and orderly sequence of installation of interdependent construction elements, with provisions for accommodating items installed later.
- C. Notify affected utility companies and comply with their requirements.
- D. Verify that utility requirements and characteristics of new operating equipment are compatible with building utilities. Coordinate work of various sections having interdependent responsibilities for installing, connecting to, and placing in service, such equipment.
- E. Coordinate space requirements, supports, and installation of mechanical and electrical work that are indicated diagrammatically on Drawings. Follow routing shown for pipes, ducts, and conduit, as closely as practicable; place runs parallel with lines of building. Utilize spaces efficiently to maximize accessibility for other installations, for maintenance, and for repairs.
- F. In finished areas except as otherwise indicated, conceal pipes, ducts, and wiring within the construction. Coordinate locations of fixtures and outlets with finish elements.
- G. Coordinate completion and clean-up of work of separate sections.
- H. After the Owner's occupancy of premises, coordinate access to site for correction of defective work and work not in accordance with Contract Documents, to minimize disruption of Owner's activities.

PART 2 PRODUCTS

2.01 PATCHING MATERIALS

- A. New Materials: As specified in product sections; match existing products and work for patching and extending work.
- B. Type and Quality of Existing Products: Determine by inspecting and testing products where necessary, referring to existing work as a standard.
- C. Product Substitution: For any proposed change in materials, submit request for substitution described in Section 01 60 00.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that existing site conditions and substrate surfaces are acceptable for subsequent work. Start of work means acceptance of existing conditions.
- B. Verify that existing substrate is capable of structural support or attachment of new work being applied or attached.
- C. Examine and verify specific conditions described in individual specification sections.
- D. Take field measurements before confirming product orders or beginning fabrication, to minimize waste due to over-ordering or misfabrication.
- E. Verify that utility services are available, of the correct characteristics, and in the correct locations.

- F. Prior to Cutting: Examine existing conditions prior to commencing work, including elements subject to damage or movement during cutting and patching. After uncovering existing work, assess conditions affecting performance of work. Beginning of cutting or patching means acceptance of existing conditions.

3.02 PREPARATION

- A. Clean substrate surfaces prior to applying next material or substance.
- B. Seal cracks or openings of substrate prior to applying next material or substance.
- C. Apply manufacturer required or recommended substrate primer, sealer, or conditioner prior to applying any new material or substance in contact or bond.

3.03 PREINSTALLATION MEETINGS

- A. When required in individual specification sections, convene a preinstallation meeting at the site prior to commencing work of the section.
- B. Require attendance of parties directly affecting, or affected by, work of the specific section.
- C. Notify the Architect 5 days in advance of meeting date.
- D. Prepare agenda and preside at meeting:
 - 1. Review conditions of examination, preparation and installation procedures.
 - 2. Review coordination with related work.
- E. Architect to record minutes and distribute copies within 3 days after meeting to participants, with copies to participants, and those affected by decisions made.

3.04 LAYING OUT THE WORK

- A. Verify locations of survey control points prior to starting work.
- B. Promptly notify the Architect of any discrepancies discovered.
- C. Control datum for survey is that indicated on Drawings.
- D. Protect survey control points prior to starting site work; preserve permanent reference points during construction.
- E. Promptly report to Architect the loss or destruction of any reference point or relocation required because of changes in grades or other reasons.
- F. Replace dislocated survey control points based on original survey control. Make no changes without prior written notice to Architect.
- G. Utilize recognized engineering survey practices.
- H. Establish elevations, lines and levels. Locate and lay out by instrumentation and similar appropriate means:
 - 1. Site improvements including pavements; stakes for grading, fill and topsoil placement; utility locations, slopes, and invert elevations.
 - 2. Grid or axis for structures.
 - 3. Building foundation, column locations, ground floor elevations.
- I. Periodically verify layouts by same means.
- J. Maintain a complete and accurate log of control and survey work as it progresses.
- K. On completion of foundation walls and major site improvements, prepare a certified survey illustrating dimensions, locations, angles, and elevations of construction and site work.

3.05 GENERAL INSTALLATION REQUIREMENTS

- A. Install products as specified in individual sections, in accordance with manufacturer's instructions and recommendations, and so as to avoid waste due to necessity for replacement.
- B. Make vertical elements plumb and horizontal elements level, unless otherwise indicated.

- C. Install equipment and fittings plumb and level, neatly aligned with adjacent vertical and horizontal lines, unless otherwise indicated.
- D. Make consistent texture on surfaces, with seamless transitions, unless otherwise indicated.
- E. Make neat transitions between different surfaces, maintaining texture and appearance.

3.06 RENOVATIONS

- A. Drawings showing existing construction and utilities are based on casual field observation and existing record documents only.
 - 1. Verify that construction and utility arrangements are as shown.
 - 2. Report discrepancies to Architect before disturbing existing installation.
 - 3. Beginning of alterations work constitutes acceptance of existing conditions.
- B. Keep areas in which alterations are being conducted separated from other areas that are still occupied.
 - 1. Provide, erect, and maintain temporary dustproof partitions of construction specified in Section 01 50 00 in locations indicated on drawings.
- C. Maintain weatherproof exterior building enclosure except for interruptions required for replacement or modifications; take care to prevent water and humidity damage.
 - 1. Where openings in exterior enclosure exist, provide construction to make exterior enclosure weatherproof.
 - 2. Insulate existing ducts or pipes that are exposed to outdoor ambient temperatures by alterations work.
- D. Remove existing work as indicated and as required to accomplish new work.
 - 1. Remove rotted wood, corroded metals, and deteriorated masonry and concrete; replace with new construction specified.
 - 2. Remove items indicated on drawings.
 - 3. Relocate items indicated on drawings.
 - 4. Where new surface finishes are to be applied to existing work, perform removals, patch, and prepare existing surfaces as required to receive new finish; remove existing finish if necessary for successful application of new finish.
 - 5. Where new surface finishes are not specified or indicated, patch holes and damaged surfaces to match adjacent finished surfaces as closely as possible.
- E. Services (Including but not limited to HVAC, Plumbing, Electrical, and Telecommunications): Provide new, remove, relocate, or extend existing systems to accommodate new construction as indicated on drawings.
 - 1. Maintain existing active systems that are to remain in operation; maintain access to equipment and operational components; if necessary, modify installation to allow access or provide access panel.
 - 2. Where existing systems or equipment are not active and Contract Documents require reactivation, put back into operational condition; repair supply, distribution, and equipment as required.
 - 3. Where existing active systems serve occupied facilities but are to be replaced with new services, maintain existing systems in service until new systems are complete and ready for service.
 - a. Disable existing systems only to make switchovers and connections; minimize duration of outages.
 - b. See Section 01 10 00 for other limitations on outages and required notifications.
 - c. Provide temporary connections as required to maintain existing systems in service.
 - 4. Verify that abandoned services serve only abandoned facilities.

5. Remove abandoned pipe, ducts, conduits, and equipment ; remove back to source of supply where possible, otherwise cap stub and tag with identification; patch holes left by removal using materials specified for new construction.
- F. Protect existing work to remain.
 1. Prevent movement of structure; provide shoring and bracing if necessary.
 2. Perform cutting to accomplish removals neatly and as specified for cutting new work.
 3. Repair adjacent construction and finishes damaged during removal work.
 4. Patch as specified for patching new work.
- G. Adapt existing work to fit new work: Make as neat and smooth transition as possible.
 1. When existing finished surfaces are cut so that a smooth transition with new work is not possible, terminate existing surface along a straight line at a natural line of division and make recommendation to Architect.
 2. Where removal of partitions or walls results in adjacent spaces becoming one, rework floors, walls, and ceilings to a smooth plane without breaks, steps, or bulkheads.
 3. Where a change of plane of 1/4 inch or more occurs in existing work, submit recommendation for providing a smooth transition for Architect review and request instructions.
 4. Trim existing wood doors as necessary to clear new floor finish. Refinish trim as required.
- H. Patching: Where the existing surface is not indicated to be refinished, patch to match the surface finish that existed prior to cutting. Where the surface is indicated to be refinished, patch so that the substrate is ready for the new finish.
- I. Refinish existing surfaces as indicated:
 1. Where rooms or spaces are indicated to be refinished, refinish all visible existing surfaces to remain to the specified condition for each material, with a neat transition to adjacent finishes.
 2. If mechanical or electrical work is exposed accidentally during the work, re-cover and refinish to match.
 3. Patch as specified for patching new work.
- J. Clean existing systems and equipment.
- K. Remove demolition debris and abandoned items from alterations areas and dispose of off-site; do not burn or bury.
- L. Do not begin new construction in alterations areas before demolition is complete.
- M. Comply with all other applicable requirements of this section.

3.07 CUTTING AND PATCHING

- A. Whenever possible, execute the work by methods that avoid cutting or patching.
- B. See Alterations article above for additional requirements.
- C. Perform whatever cutting and patching is necessary to:
 1. Complete the work.
 2. Fit products together to integrate with other work.
 3. Provide openings for penetration of mechanical, electrical, and other services.
 4. Match work that has been cut to adjacent work.
 5. Repair areas adjacent to cuts to required condition.
 6. Repair new work damaged by subsequent work.
 7. Remove samples of installed work for testing when requested.
 8. Remove and replace defective and non-conforming work.
- D. Execute cutting and patching including excavation and fill to complete the work, to uncover work in order to install improperly sequenced work, to remove and replace defective or non-conforming work, to remove samples of installed work for testing when requested, to

provide openings in the work for penetration of mechanical and electrical work, to execute patching to complement adjacent work, and to fit products together to integrate with other work.

- E. Execute work by methods that avoid damage to other work and that will provide appropriate surfaces to receive patching and finishing. In existing work, minimize damage and restore to original condition.
- F. Employ skilled and experienced installer to perform cutting for weather exposed and moisture resistant elements, and sight exposed surfaces.
- G. Cut rigid materials using masonry saw or core drill. Pneumatic tools not allowed without prior approval.
- H. Restore work with new products in accordance with requirements of Contract Documents.
- I. Fit work air tight to pipes, sleeves, ducts, conduit, and other penetrations through surfaces.
- J. At penetrations of fire rated walls, partitions, ceiling, or floor construction, completely seal voids with fire rated material, to full thickness of the penetrated element.
- K. Patching:
 - 1. Finish patched surfaces to match finish that existed prior to patching. On continuous surfaces, refinish to nearest intersection or natural break. For an assembly, refinish entire unit.
 - 2. Match color, texture, and appearance.
 - 3. Repair patched surfaces that are damaged, lifted, discolored, or showing other imperfections due to patching work. If defects are due to condition of substrate, repair substrate prior to repairing finish.
- L. Refinish surfaces to match adjacent finish. For continuous surfaces, refinish to nearest intersection or natural break. For an assembly, refinish entire unit.
- M. Make neat transitions. Patch work to match adjacent work in texture and appearance. Where new work abuts or aligns with existing, perform a smooth and even transition.
- N. Patch or replace surfaces that are damaged, lifted, discolored, or showing other imperfections due to patching work. Repair substrate prior to patching finish. Finish patches to produce uniform finish and texture over entire area. When finish cannot be matched, refinish entire surface to nearest intersections.

3.08 PROGRESS CLEANING

- A. Maintain areas free of waste materials, debris, and rubbish. Maintain site in a clean and orderly condition.
- B. Remove debris and rubbish from pipe chases, plenums, attics, crawl spaces, and other closed or remote spaces, prior to enclosing the space.
- C. Broom and vacuum clean interior areas prior to start of surface finishing, and continue cleaning to eliminate dust.
- D. Collect and remove waste materials, debris, and trash/rubbish from site periodically and dispose off-site; do not burn or bury.

3.09 PROTECTION OF INSTALLED WORK

- A. Protect installed work from damage by construction operations.
- B. Provide special protection where specified in individual specification sections.
- C. Provide temporary and removable protection for installed products. Control activity in immediate work area to prevent damage.
- D. Provide protective coverings at walls, projections, jambs, sills, and soffits of openings.
- E. Protect finished floors, stairs, and other surfaces from traffic, dirt, wear, damage, or movement of heavy objects, by protecting with durable sheet materials.

- F. Prohibit traffic or storage upon waterproofed or roofed surfaces. If traffic or activity is necessary, obtain recommendations for protection from waterproofing or roofing material manufacturer.
- G. Prohibit traffic from landscaped areas.
- H. Remove protective coverings when no longer needed; reuse or recycle plastic coverings if possible.

3.10 SYSTEM STARTUP

- A. Coordinate with requirements of Section 01 91 13 - General Commissioning Requirements.
- B. Coordinate schedule for start-up of various equipment and systems.
- C. Notify the Architect and owner seven days prior to start-up of each item.
- D. Verify that each piece of equipment or system has been checked for proper lubrication, drive rotation, belt tension, control sequence, and for conditions that may cause damage.
- E. Verify tests, meter readings, and specified electrical characteristics agree with those required by the equipment or system manufacturer.
- F. Verify that wiring and support components for equipment are complete and tested.
- G. Execute start-up under supervision of applicable Contractor personnel and manufacturer's representative in accordance with manufacturers' instructions.
- H. When specified in individual specification Sections, require manufacturer to provide authorized representative to be present at site to inspect, check, and approve equipment or system installation prior to start-up, and to supervise placing equipment or system in operation.
- I. Submit a written report that equipment or system has been properly installed and is functioning correctly.

3.11 DEMONSTRATION AND INSTRUCTION

- A. Demonstrate start-up, operation, control, adjustment, trouble-shooting, servicing, maintenance, and shutdown of each item of equipment at scheduled time, at equipment location.
- B. For equipment or systems requiring seasonal operation, perform demonstration for other season within six months.
- C. Provide a qualified person who is knowledgeable about the Project to perform demonstration and instruction of owner personnel.
- D. Utilize operation and maintenance manuals as basis for instruction. Review contents of manual with the Red Clay Consolidated School District personnel in detail to explain all aspects of operation and maintenance.
- E. Prepare and insert additional data in operations and maintenance manuals when need for additional data becomes apparent during instruction.
- F. The amount of time required for instruction on each item of equipment and system is that specified in individual sections.

3.12 ADJUSTING

- A. Adjust operating products and equipment to ensure smooth and unhindered operation.
- B. Testing, adjusting, and balancing HVAC systems: See Section 23 05 93 and 01 40 00.

3.13 FINAL CLEANING

- A. Execute final cleaning after Substantial Completion but before making final application for payment.
 - 1. Clean areas to be occupied by Owner prior to final completion before Owner occupancy.
- B. Use cleaning materials that are nonhazardous.

- C. Clean interior and exterior glass, surfaces exposed to view; remove temporary labels, stains and foreign substances, polish transparent and glossy surfaces, vacuum carpeted and soft surfaces.
- D. Remove all labels that are not permanent. Do not paint or otherwise cover fire test labels or nameplates on mechanical and electrical equipment.
- E. Clean equipment and fixtures to a sanitary condition with cleaning materials appropriate to the surface and material being cleaned.
- F. Replace filters of operating equipment.
- G. Clean debris from roofs, gutters, downspouts, and drainage systems.
- H. Clean site; sweep paved areas, rake clean landscaped surfaces.
- I. Remove waste, surplus materials, trash/rubbish, and construction facilities from the site; dispose of in legal manner; do not burn or bury.
- J. Clean Owner-occupied areas of work.

3.14 CLOSEOUT PROCEDURES

- A. Make submittals that are required by governing or other authorities.
 - 1. Provide copies to Architect and Owner.
- B. Accompany Owner Representative on preliminary inspection to determine items to be listed for completion or correction in Contractor's Notice of Substantial Completion.
- C. Notify the Architect when work is considered ready for Substantial Completion.
- D. Submit written certification that Contract Documents have been reviewed, work has been inspected, and that work is complete in accordance with Contract Documents and ready for StudioJAED's review.
- E. Correct items of work listed in executed Certificates of Substantial Completion and comply with requirements for access to Owner-occupied areas.
- F. Accompany Owner Representative on preliminary final inspection.
- G. Notify StudioJAED when work is considered finally complete.
- H. Complete items of work determined by Architect's final inspection.

3.15 MAINTENANCE

- A. Provide service and maintenance of components indicated in specification sections.
- B. Maintenance Period: As indicated in specification sections or, if not indicated, not less than one year from the Date of Substantial Completion or the length of the specified warranty, whichever is longer.
- C. Examine system components at a frequency consistent with reliable operation. Clean, adjust, and lubricate as required.
- D. Include systematic examination, adjustment, and lubrication of components. Repair or replace parts whenever required. Use parts produced by the manufacturer of the original component.
- E. Maintenance service shall not be assigned or transferred to any agent or subcontractor without prior written consent of the Owner.

END OF SECTION

NOT FOR BIDDING PURPOSES

SECTION 01 74 19

CONSTRUCTION WASTE MANAGEMENT AND DISPOSAL

PART 1 GENERAL

1.01 WASTE MANAGEMENT REQUIREMENTS

- A. Owner requires that this project generate the least amount of trash and waste possible.
- B. Employ processes that ensure the generation of as little waste as possible due to error, poor planning, breakage, mishandling, contamination, or other factors.
- C. Minimize trash/waste disposal in landfills; reuse, salvage, or recycle as much waste as economically feasible.
- D. This project is dependent on diversion of 75 percent, by weight, of potential landfill trash/waste by recycling and/or salvage.
- E. Contractor shall submit periodic Waste Disposal Reports; all landfill disposal, incineration, recycling, salvage, and reuse must be reported regardless of to whom the cost or savings accrues; use the same units of measure on all reports.
- F. Contractor shall develop and follow a Waste Management Plan designed to implement these requirements.
- G. Methods of trash/waste disposal that are not acceptable are:
 - 1. Burning on the project site.
 - 2. Burying on the project site.
 - 3. Dumping or burying on other property, public or private.
 - 4. Other illegal dumping or burying.
- H. Regulatory Requirements: Contractor is responsible for knowing and complying with regulatory requirements, including but not limited to Federal, state and local requirements, pertaining to legal disposal of all construction and demolition waste materials.

1.02 RELATED REQUIREMENTS

- A. Section 01 10 00 - Summary: List of items to be salvaged from the existing building for relocation in project or for Owner.
- B. Section 01 30 00 - Administrative Requirements: Additional requirements for project meetings, reports, submittal procedures, and project documentation.
- C. Section 01 50 00 - Temporary Facilities and Controls: Additional requirements related to trash/waste collection and removal facilities and services.
- D. Section 01 60 00 - Product Requirements: Waste prevention requirements related to delivery, storage, and handling.
- E. Section 01 70 00 - Execution and Closeout Requirements: Trash/waste prevention procedures related to demolition, cutting and patching, installation, protection, and cleaning.

1.03 DEFINITIONS

- A. Clean: Untreated and unpainted; not contaminated with oils, solvents, caulk, or the like.
- B. Construction and Demolition Waste: Solid wastes typically including building materials, packaging, trash, debris, and rubble resulting from construction, remodeling, repair and demolition operations.
- C. Hazardous: Exhibiting the characteristics of hazardous substances, i.e., ignitibility, corrosivity, toxicity or reactivity.
- D. Nonhazardous: Exhibiting none of the characteristics of hazardous substances, i.e., ignitibility, corrosivity, toxicity, or reactivity.

- E. Nontoxic: Neither immediately poisonous to humans nor poisonous after a long period of exposure.
- F. Recyclable: The ability of a product or material to be recovered at the end of its life cycle and remanufactured into a new product for reuse by others.
- G. Recycle: To remove a waste material from the project site to another site for remanufacture into a new product for reuse by others.
- H. Recycling: The process of sorting, cleansing, treating and reconstituting solid waste and other discarded materials for the purpose of using the altered form. Recycling does not include burning, incinerating, or thermally destroying waste.
- I. Return: To give back reusable items or unused products to vendors for credit.
- J. Reuse: To reuse a construction waste material in some manner on the project site.
- K. Salvage: To remove a waste material from the project site to another site for resale or reuse by others.
- L. Sediment: Soil and other debris that has been eroded and transported by storm or well production run-off water.
- M. Source Separation: The act of keeping different types of waste materials separate beginning from the first time they become waste.
- N. Toxic: Poisonous to humans either immediately or after a long period of exposure.
- O. Trash: Any product or material unable to be reused, returned, recycled, or salvaged.
- P. Waste: Extra material or material that has reached the end of its useful life in its intended use. Waste includes salvageable, returnable, recyclable, and reusable material.

1.04 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Waste Management Plan: Include the following information:
 - 1. Analysis of the trash and waste projected to be generated during the entire project construction cycle, including types and quantities.
 - 2. Landfill Options: The name, address, and telephone number of the landfill(s) where trash/waste will be disposed of, the applicable landfill tipping fee(s), and the projected cost of disposing of all project trash/waste in the landfill(s).
- C. Waste Disposal Reports: Submit at specified intervals, with details of quantities of trash and waste, means of disposal or reuse, and costs; show both totals to date and since last report.
 - 1. Submit updated Report with each Application for Progress Payment; failure to submit Report will delay payment.
 - 2. Submit Report on a form acceptable to Owner.
 - 3. Landfill Disposal: Include the following information:
 - a. Identification of material.
 - b. Amount, in tons or cubic yards, of trash/waste material from the project disposed of in landfills.
 - c. State the identity of landfills, total amount of tipping fees paid to landfill, and total disposal cost.
 - d. Include manifests, weight tickets, receipts, and invoices as evidence of quantity and cost.
 - 4. Incinerator Disposal: Include the following information:
 - a. Identification of material.
 - b. Amount, in tons or cubic yards, of trash/waste material from the project delivered to incinerators.

- c. State the identity of incinerators, total amount of fees paid to incinerator, and total disposal cost.
- d. Include manifests, weight tickets, receipts, and invoices as evidence of quantity and cost.
5. Recycled and Salvaged Materials: Include the following information for each:
 - a. Identification of material, including those retrieved by installer for use on other projects.
 - b. Amount, in tons or cubic yards, date removed from the project site, and receiving party.
 - c. Transportation cost, amount paid or received for the material, and the net total cost or savings of salvage or recycling each material.
 - d. Include manifests, weight tickets, receipts, and invoices as evidence of quantity and cost.
 - e. Certification by receiving party that materials will not be disposed of in landfills or by incineration.
6. Material Reused on Project: Include the following information for each:
 - a. Identification of material and how it was used in the project.
 - b. Amount, in tons or cubic yards.
 - c. Include weight tickets as evidence of quantity.
7. Other Disposal Methods: Include information similar to that described above, as appropriate to disposal method.

PART 2 PRODUCTS

2.01 PRODUCT SUBSTITUTIONS

- A. See Section 01 60 00 - Product Requirements for substitution submission procedures.

PART 3 EXECUTION

3.01 WASTE MANAGEMENT PROCEDURES

- A. See Section 01 30 00 for additional requirements for project meetings, reports, submittal procedures, and project documentation.
- B. See Section 01 50 00 for additional requirements related to trash/waste collection and removal facilities and services.
- C. See Section 01 60 00 for waste prevention requirements related to delivery, storage, and handling.
- D. See Section 01 70 00 for trash/waste prevention procedures related to demolition, cutting and patching, installation, protection, and cleaning.

3.02 WASTE MANAGEMENT PLAN IMPLEMENTATION

- A. Communication: Distribute copies of the Waste Management Plan to job site foreman, each subcontractor, Owner, and Architect.
- B. Instruction: Provide on-site instruction of appropriate separation, handling, and recycling, salvage, reuse, and return methods to be used by all parties at the appropriate stages of the project.
- C. Meetings: Discuss trash/waste management goals and issues at project meetings.
 1. Pre-construction meeting.
 2. Regular job-site meetings.
- D. Facilities: Provide specific facilities for separation and storage of materials for recycling, salvage, reuse, return, and trash disposal, for use by all contractors and installers.
 1. Provide containers as required.
 2. Provide adequate space for pick-up and delivery and convenience to subcontractors.

3. Keep recycling and trash/waste bin areas neat and clean and clearly marked in order to avoid contamination of materials.
- E. Hazardous Wastes: Separate, store, and dispose of hazardous wastes according to applicable regulations.
- F. Recycling: Separate, store, protect, and handle at the site identified recyclable waste products in order to prevent contamination of materials and to maximize recyclability of identified materials. Arrange for timely pickups from the site or deliveries to recycling facility in order to prevent contamination of recyclable materials.
- G. Salvage: Set aside, sort, and protect products to be salvaged for reuse off-site.

END OF SECTION

NOT FOR BIDDING PURPOSES

SECTION 02 41 00
DEMOLITION

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Selective demolition of building elements for alteration purposes.
- B. Legal disposal of demolished items.

1.02 RELATED REQUIREMENTS

- A. Section 01 10 00 - Summary: Limitations on Contractor's use of site and premises.
- B. Section 01 10 00 - Summary: Sequencing and staging requirements.
- C. Section 01 60 00 - Product Requirements: Handling and storage of items removed for salvage and relocation.
- D. Section 01 74 19 - Construction Waste Management and Disposal: Limitations on disposal of removed materials; requirements for recycling.

1.03 REFERENCE STANDARDS

- A. 29 CFR 1926 - U.S. Occupational Safety and Health Standards.
- B. NFPA 241 - Standard for Safeguarding Construction, Alteration, and Demolition Operations.

1.04 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Project Record Documents: Accurately record actual locations of capped and active utilities and subsurface construction.

1.05 PROJECT CONDITIONS

- A. Minimize production of dust due to demolition operations; do not use water if that will result in ice, flooding, sedimentation of public waterways or storm sewers, or other pollution.

PART 3 EXECUTION

2.01 SCOPE

- A. As indicated on Drawings.

2.02 GENERAL PROCEDURES AND PROJECT CONDITIONS

- A. Comply with other requirements specified in Section 01 70 00 Execution and Closeout Requirements.
- B. Comply with applicable codes and regulations for demolition operations and safety of the public.
 - 1. Obtain required permits.
 - 2. Take precautions to prevent catastrophic or uncontrolled collapse of structures to be removed; do not allow worker or public access within range of potential collapse of unstable structures.
 - 3. Provide, erect, and maintain temporary dust proof partitions/wall assembly barriers and security devices.
 - 4. Use adequate physical barriers and wall assemblies to prevent access to areas that could be hazardous to workers or the public.
 - 5. Conduct operations to minimize effects on and interference with adjacent construction and occupants.
 - 6. Do not close or obstruct means of egress corridors, roadways or sidewalks without permit.
 - 7. Conduct operations to minimize obstruction of public and private entrances and exits; do not obstruct required exits at any time; protect persons using entrances and exits from removal operations.

- C. Do not begin removal until built elements to be salvaged or relocated have been removed.
- D. If hazardous materials are discovered during removal operations, stop work and notify Architect and Owner; hazardous materials include regulated asbestos containing materials, lead, PCB's, and mercury.

2.03 EXISTING UTILITIES

- A. Coordinate work with utility companies; notify before starting work and comply with their requirements; obtain required permits.
- B. Protect existing utilities to remain from damage.
- C. Do not disrupt public utilities without permit from authority having jurisdiction.
- D. Do not close, shut off, or disrupt existing life safety systems that are in use without permission from the Owner.
- E. Do not close, shut off, or disrupt existing utility branches or take-offs that are in use without permission from the Owner.
- F. Locate and mark utilities to remain; mark using highly visible tags or flags, with identification of utility type; protect from damage due to subsequent construction, using substantial barricades if necessary.
- G. Remove exposed piping, valves, meters, equipment, supports, and foundations of disconnected and abandoned utilities.
- H. Prepare building demolition areas by disconnecting and capping utilities outside the demolition zone; identify and mark utilities to be subsequently reconnected, in same manner as other utilities to remain.

2.04 SELECTIVE DEMOLITION FOR ALTERATIONS

- A. Drawings showing existing construction and utilities are based on casual field observation and existing record documents only.
 - 1. Verify that construction and utility arrangements are as shown.
 - 2. Report discrepancies to Architect before disturbing existing installation.
 - 3. Beginning of demolition work constitutes acceptance of existing conditions that would be apparent upon examination prior to starting demolition.
- B. Separate areas in which demolition is being conducted from other areas that are still occupied.
 - 1. Provide, erect, and maintain temporary dustproof partitions and wall assemblies during demolition and construction.
- C. Maintain weatherproof exterior building enclosure except for interruptions required for replacement or modifications; take care to prevent water and humidity damage.
- D. Remove existing work as indicated and as required to accomplish new work.
 - 1. At areas of demolition and transition, remove materials and finishes including, but not limited to, rotted wood, corroded metals, and deteriorated masonry and concrete; replace with new construction specified.
 - 2. Remove items indicated on drawings and notes.
- E. Services (Including but not limited to HVAC, Plumbing, Fire Protection, Electrical, and Telecommunications): Remove existing systems and equipment as indicated.
 - 1. Maintain existing active systems that are to remain in operation; maintain access to equipment and operational components.
 - 2. Where existing active systems serve occupied facilities but are to be replaced with new services, maintain existing systems in service until new systems are complete and ready for service.
 - 3. Verify that abandoned services serve only abandoned facilities before removal.

4. Remove abandoned pipe, ducts, conduits, and equipment, including those above accessible ceilings; remove back to source of supply where possible, otherwise cap stub and tag with identification.
- F. Protect existing work to remain.
 1. Prevent movement of structure; provide shoring and bracing if necessary.
 2. Perform cutting to accomplish removal neatly and as specified for cutting new work.
 3. Repair adjacent construction and finishes damaged during removal work.
 4. Patch as specified for patching new work.
 5. Patch to match existing at areas of transition and demolition unless noted and/or scheduled otherwise.

2.05 DEBRIS AND WASTE REMOVAL

- A. Remove debris, and trash from site.
- B. Remove from site all materials not to be reused on site.
- C. Leave site in clean condition, ready for subsequent work.
- D. Clean up spillage and wind-blown debris from public and private lands.
- E. See Section 01 74 19 Construction Waste Management and Disposal.

END OF SECTION

NOT FOR BIDDING PURPOSES

NOT FOR BIDDING PURPOSES

SECTION 23 05 13

MOTOR REQUIREMENTS FOR HVAC AND PLUMBING EQUIP

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Single phase electric motors.
- B. Three phase electric motors.

1.02 RELATED REQUIREMENTS

- A. Section 26 27 17 - Equipment Wiring: Electrical characteristics and wiring connections.
- B. Section 26 29 13 - Enclosed Controllers.

1.03 REFERENCE STANDARDS

- A. ABMA STD 9 - Load Ratings and Fatigue Life for Ball Bearings; American Bearing Manufacturers Association, Inc..
- B. IEEE 112 - IEEE Standard Test Procedure for Polyphase Induction Motors and Generators; Institute of Electrical and Electronic Engineers.
- C. NEMA MG 1 - Motors and Generators; National Electrical Manufacturers Association.
- D. NFPA 70 - National Electrical Code; National Fire Protection Association.
- E. National Grid "Motor-Up" Rebate Program/Initiative.

1.04 SUBMITTALS

- A. Product Data: Provide wiring diagrams with electrical characteristics and connection requirements.
- B. Test Reports: Indicate test results verifying nominal efficiency and power factor for three phase motors larger than 1/2 horsepower.
- C. Manufacturer's Installation Instructions: Indicate setting, mechanical connections, lubrication, and wiring instructions.
- D. Operation Data: Include instructions for safe operating procedures.
- E. Maintenance Data: Include assembly drawings, bearing data including replacement sizes, and lubrication instructions.

1.05 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacture of electric motors for HVAC use, and their accessories, with minimum three years documented product development, testing, and manufacturing experience.
- B. Conform to applicable electrical code, NFPA 70 and local energy code.
- C. Provide certificate of compliance from authority having jurisdiction indicating approval of high efficiency motors.
- D. Products Requiring Electrical Connection: Listed and classified by Underwriters' Laboratories, Inc. or testing firm acceptable to the authority having jurisdiction as suitable for the purpose specified and indicated.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. Protect motors stored on site from weather and moisture by maintaining factory covers and suitable weather-proof covering. For extended outdoor storage, remove motors from equipment and store separately.

1.07 WARRANTY

- A. Provide five year manufacturer warranty for motors larger than 20 horsepower.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Lincoln Motors: www.lincolnmotors.com.
- B. A. O. Smith Electrical Products Company: www.aosmithmotors.com.
- C. Reliance Electric/Rockwell Automation: www.reliance.com.

2.02 GENERAL CONSTRUCTION AND REQUIREMENTS

- A. Electrical Service: Refer to Section 26 27 17 for required electrical characteristics.
- B. Electrical Service, General. See drawings for specific details:
 - 1. Motors 1/2 HP and Smaller: 115 volts, single phase, 60 Hz
 - 2. Motors Larger than 1/2 Horsepower: 460 volts, three phase, 60 Hz.
- C. Construction:
 - 1. Open drip-proof type except where specifically noted otherwise.
 - 2. Design for continuous operation in 40 degrees C environment.
 - 3. Design for temperature rise in accordance with NEMA MG 1 limits for insulation class, service factor, and motor enclosure type.
 - 4. Motors with frame sizes 254T and larger: Premium Efficiency Type.
- D. Explosion-Proof Motors: UL approved and labelled for hazard classification, with over temperature protection.
- E. Visible Nameplate: Indicating motor horsepower, voltage, phase, cycles, RPM, full load amps, locked rotor amps, frame size, manufacturer's name and model number, service factor, power factor.
- F. Wiring Terminations:
 - 1. Provide terminal lugs to match branch circuit conductor quantities, sizes, and materials indicated. Enclose terminal lugs in terminal box sized to NFPA 70, threaded for conduit.
 - 2. For fractional horsepower motors where connection is made directly, provide conduit connection in end frame.

2.03 APPLICATIONS

- A. Exception: Motors less than 250 watts, for intermittent service may be the equipment manufacturer's standard and need not conform to these specifications.
- B. Single phase motors for shaft mounted fans and centrifugal pumps: Split phase type.
- C. Single phase motors for shaft mounted fans or blowers: Permanent split capacitor type or electronically commutated (ECM) type. See schedules for requirements.
- D. Single phase motors for fans, pumps, and blowers: Capacitor start type.
- E. Single phase motors for fans, blowers, and pumps: Capacitor start, capacitor run type.
- F. Motors located in outdoors and in draw through cooling towers: Totally enclosed weatherproof epoxy-treated type.

2.04 SINGLE PHASE POWER - SPLIT PHASE MOTORS

- A. Starting Torque: Less than 150 percent of full load torque.
- B. Starting Current: Up to seven times full load current.
- C. Breakdown Torque: Approximately 200 percent of full load torque.
- D. Drip-proof Enclosure: Class A (50 degrees C temperature rise) insulation, NEMA Service Factor, prelubricated sleeve or ball bearings.
- E. Enclosed Motors: Class A (50 degrees C temperature rise) insulation, 1.0 Service Factor, prelubricated ball bearings.

2.05 SINGLE PHASE POWER - PERMANENT-SPLIT CAPACITOR MOTORS

- A. Starting Torque: Exceeding one fourth of full load torque.
- B. Starting Current: Up to six times full load current.
- C. Multiple Speed: Through tapped windings.
- D. Open Drip-proof or Enclosed Air Over Enclosure: Class A (50 degrees C temperature rise) insulation, minimum 1.0 Service Factor, prelubricated sleeve or ball bearings, automatic reset overload protector.

2.06 SINGLE PHASE POWER - CAPACITOR START MOTORS

- A. Starting Torque: Three times full load torque.
- B. Starting Current: Less than five times full load current.
- C. Pull-up Torque: Up to 350 percent of full load torque.
- D. Breakdown Torque: Approximately 250 percent of full load torque.
- E. Motors: Capacitor in series with starting winding; provide capacitor-start/capacitor-run motors with two capacitors in parallel with run capacitor remaining in circuit at operating speeds.
- F. Drip-proof Enclosure: Class A (50 degrees C temperature rise) insulation, NEMA Service Factor, prelubricated sleeve bearings.
- G. Enclosed Motors: Class A (50 degrees C temperature rise) insulation, 1.0 Service Factor, prelubricated ball bearings.

2.07 THREE PHASE POWER - SQUIRREL CAGE MOTORS

- A. Starting Torque: Between 1 and 1-1/2 times full load torque.
- B. Starting Current: Six times full load current.
- C. Power Output, Locked Rotor Torque, Breakdown or Pull Out Torque: NEMA Design B characteristics.
- D. Design, Construction, Testing, and Performance: Conform to NEMA MG 1 for Design B motors.
- E. Insulation System: NEMA Class B or better.
- F. Testing Procedure: In accordance with IEEE 112. Load test motors to determine free from electrical or mechanical defects in compliance with performance data.
- G. Motor Frames: NEMA Standard T-Frames of steel, aluminum, or cast iron with end brackets of cast iron or aluminum with steel inserts.
- H. Thermistor System (Motor Frame Sizes 254T and Larger): Three PTC thermistors embedded in motor windings and epoxy encapsulated solid state control relay for wiring into motor starter; refer to Section 26 29 13.
- I. Bearings: Grease lubricated anti-friction ball bearings with housings equipped with plugged provision for relubrication, rated for minimum ABMA STD 9, L-10 life of 20,000 hours. Calculate bearing load with NEMA minimum V-belt pulley with belt center line at end of NEMA standard shaft extension. Stamp bearing sizes on nameplate.
- J. Sound Power Levels: To NEMA MG 1.
- K. Part Winding Start Above 254T Frame Size: Use part of winding to reduce locked rotor starting current to approximately 60 percent of full winding locked rotor current while providing approximately 50 percent of full winding locked rotor torque.
- L. Weatherproof Epoxy Sealed Motors: Epoxy seal windings using vacuum and pressure with rotor and starter surfaces protected with epoxy enamel; bearings double shielded with waterproof non-washing grease.

- M. Nominal Efficiency: As scheduled at full load and rated voltage when tested in accordance with IEEE 112.
- N. Nominal Power Factor: As scheduled at full load and rated voltage when tested in accordance with IEEE 112.

PART 3 EXECUTION

3.01 INSTALLATION

- A. Install in accordance with manufacturer's instructions.
- B. Install securely on firm foundation. Mount ball bearing motors with shaft in any position.
- C. Check line voltage and phase and ensure agreement with nameplate.
- D. Provide detailed installation and purchase information for reimbursement by Utility for rebate program.

3.02 SCHEDULE - PREMIUM EFFICIENCY

- A. NEMA Open Motor Service Factors.
 - 1. 1/6-1/3 hp:
 - a. 3600 rpm: 1.35.
 - b. 1800 rpm: 1.35.
 - c. 1200 rpm: 1.35.
 - d. 900 rpm: 1.35.
 - 2. 1/2 hp:
 - a. 3600 rpm: 1.25.
 - b. 1800 rpm: 1.25.
 - c. 1200 rpm: 1.25.
 - d. 900 rpm: 1.15.
 - 3. 3/4 hp:
 - a. 3600 rpm: 1.25.
 - b. 1800 rpm: 1.25.
 - c. 1200 rpm: 1.15.
 - d. 900 rpm: 1.15.
 - 4. 1 hp:
 - a. 3600 rpm: 1.25.
 - b. 1800 rpm: 1.15.
 - c. 1200 rpm: 1.15.
 - d. 900 rpm: 1.15.
 - 5. 1.5-150 hp:
 - a. 3600 rpm: 1.15.
 - b. 1800 rpm: 1.15.
 - c. 1200 rpm: 1.15.
 - d. 900 rpm: 1.15.
- B. Three Phase - Premium Efficiency, Open Drip-Proof Performance:
 - 1. Ratings.
 - a. 1 hp:
 - 1) NEMA Frame: 145T.
 - 2) Minimum Percent Power Factor: 72.
 - 3) Minimum Percent Efficiency: 82.5% @ 1200 RPM, 85.5% @ 1800 RPM, 77% @ 3600 RPM
 - b. 1-1/2 hp:
 - 1) NEMA Frame: 182T.
 - 2) Minimum Percent Power Factor: 73.

- 3) Minimum Percent Efficiency: 86.5% @ 1200 RPM, 86.5% @ 1800 RPM, 84% @ 3600 RPM
- c. 2 hp:
- 1) NEMA Frame: 184T.
 - 2) Minimum Percent Power Factor: 75.
 - 3) Minimum Percent Efficiency: 87.5% @ 1200 RPM, 86.5% @ 1800 RPM, 85.5% @ 3600 RPM
- d. 3 hp:
- 1) NEMA Frame: 213T.
 - 2) Minimum Percent Power Factor: 60.
 - 3) Minimum Percent Efficiency: 88.5% @ 1200 RPM, 89.5% @ 1800 RPM, 85.5% @ 3600 RPM
- e. 5 hp:
- 1) NEMA Frame: 215T.
 - 2) Minimum Percent Power Factor: 65.
 - 3) Minimum Percent Efficiency: 89.5% @ 1200 RPM, 89.5% @ 1800 RPM, 86.5% @ 3600 RPM
- f. 7-1/2 hp:
- 1) NEMA Frame: 254T.
 - 2) Minimum Percent Power Factor: 73.
 - 3) Minimum Percent Efficiency: 90.2% @ 1200 RPM, 91% @ 1800 RPM, 88.5% @ 3600 RPM
- g. 10 hp:
- 1) NEMA Frame: 256T.
 - 2) Minimum Percent Power Factor: 74.
 - 3) Minimum Percent Efficiency: 91.7% @ 1200 RPM, 91.7% @ 1800 RPM, 89.5% @ 3600 RPM
- h. 15 hp:
- 1) NEMA Frame: 284T.
 - 2) Minimum Percent Power Factor: 77.
 - 3) Minimum Percent Efficiency: 91.7% @ 1200 RPM, 93% @ 1800 RPM, 90.2% @ 3600 RPM.
- i. 20 hp:
- 1) NEMA Frame: 286T.
 - 2) Minimum Percent Power Factor: 78.
 - 3) Minimum Percent Efficiency: 92.4% @ 1200 RPM, 93% @ 1800 RPM, 91% @ 3600 RPM
- j. 25 hp:
- 1) NEMA Frame: 324T.
 - 2) Minimum Percent Power Factor: 74.
 - 3) Minimum Percent Efficiency: 93% @ 1200 RPM, 93.6% @ 1800 RPM, 91.7% @ 3600 RPM
- k. 30 hp:
- 1) NEMA Frame: 326T.
 - 2) Minimum Percent Power Factor: 78.
 - 3) Minimum Percent Efficiency: 93.6% @ 1200 RPM, 94.1% @ 1800 RPM, 91.7% @ 3600 RPM
- l. 40 hp:
- 1) NEMA Frame: 364T.
 - 2) Minimum Percent Power Factor: 77.

- 3) Minimum Percent Efficiency: 94.1% @ 1200 RPM, 94.1 @ 1800 RPM, 92.4% @ 3600 RPM
- m. 50 hp:
 - 1) NEMA Frame: 365T.
 - 2) Minimum Percent Power Factor: 79.
 - 3) Minimum Percent Efficiency: 94.1% @ 1200 RPM, 94.5% @ 1800 RPM, 93% @ 3600 RPM
- n. 60 hp:
 - 1) NEMA Frame: 404T.
 - 2) Minimum Percent Power Factor: 82.
 - 3) Minimum Percent Efficiency: 93.
- o. 75 hp:
 - 1) NEMA Frame: 405T.
 - 2) Minimum Percent Power Factor: 80.
 - 3) Minimum Percent Efficiency: 93.
- p. 100 hp:
 - 1) NEMA Frame: 444T.
 - 2) Minimum Percent Power Factor: 80.
 - 3) Minimum Percent Efficiency: 93.
- C. Three Phase - Premium Efficiency, Totally Enclosed, Fan Cooled Performance:
 1. 1200 rpm.
 - a. 1 hp:
 - 1) NEMA Frame: 145T.
 - 2) Minimum Percent Power Factor: 72.
 - 3) Minimum Percent Efficiency: 82.5% @ 1200 RPM, 85.5% @ 1800 RPM, 77% @ 3600 RPM
 - b. 1-1/2 hp:
 - 1) NEMA Frame: 182T.
 - 2) Minimum Percent Power Factor: 73.
 - 3) Minimum Percent Efficiency: 87.5% @ 1200 RPM, 86.5% @ 1800 RPM, 84% @ 3600 RPM
 - c. 2 hp:
 - 1) NEMA Frame: 184T.
 - 2) Minimum Percent Power Factor: 68.
 - 3) Minimum Percent Efficiency: 88.5% @ 1200 RPM, 86.5% @ 1800 RPM, 85.5% @ 3600 RPM
 - d. 3 hp:
 - 1) NEMA Frame: 213T.
 - 2) Minimum Percent Power Factor: 63.
 - 3) Minimum Percent Efficiency: 89.5% @ 1200 RPM, 89.5% @ 1800 RPM, 86.5% @ 3600 RPM
 - e. 5 hp:
 - 1) NEMA Frame: 215T.
 - 2) Minimum Percent Power Factor: 66.
 - 3) Minimum Percent Efficiency: 89.5% @ 1200 RPM, 89.5% @ 1800 RPM, 88.5% @ 3600 RPM
 - f. 7-1/2 hp:
 - 1) NEMA Frame: 254T.
 - 2) Minimum Percent Power Factor: 68.
 - 3) Minimum Percent Efficiency: 91% @ 1200 RPM, 91.7% @ 1800 RPM, 89.5% @ 3600 RPM

- g. 10 hp:
 - 1) NEMA Frame: 256T.
 - 2) Minimum Percent Power Factor: 75.
 - 3) Minimum Percent Efficiency: 91% @ 1200 RPM, 91.7% @ 1800 RPM, 90.2% @ 3600 RPM
- h. 15 hp:
 - 1) NEMA Frame: 284T.
 - 2) Minimum Percent Power Factor: 72.
 - 3) Minimum Percent Efficiency: 91.7% @ 1200 RPM, 92.4% @ 1800 RPM, 91% @ 3600 RPM
- i. 20 hp:
 - 1) NEMA Frame: 286T.
 - 2) Minimum Percent Power Factor: 76.
 - 3) Minimum Percent Efficiency: 91.7% @ 1200 RPM, 93% @ 1800 RPM, 91% @ 3600 RPM
- j. 25 hp:
 - 1) NEMA Frame: 324T.
 - 2) Minimum Percent Power Factor: 71.
 - 3) Minimum Percent Efficiency: 93% @ 1200 RPM, 93.6% @ 1800 RPM, 91.7% @ 3600 RPM
- k. 30 hp:
 - 1) NEMA Frame: 326T.
 - 2) Minimum Percent Power Factor: 79.
 - 3) Minimum Percent Efficiency: 93% @ 1200 RPM, 93.6% @ 1800 RPM, 91.7% @ 3600 RPM.
- l. 40 hp:
 - 1) NEMA Frame: 364T.
 - 2) Minimum Percent Power Factor: 78.
 - 3) Minimum Percent Efficiency: 94.1% @ 1200 RPM, 94.1% @ 1800 RPM, 92.4% @ 3600 RPM
- m. 50 hp:
 - 1) NEMA Frame: 365T.
 - 2) Minimum Percent Power Factor: 81.
 - 3) Minimum Percent Efficiency: 94.1% @ 1200 RPM, 94.5% @ 1800 RPM, 93% @ 3600 RPM
- n. Over 50 HP - Refer to National Grid "Motor Up" Energy Efficiency requirements for reimbursement.

END OF SECTION

NOT FOR BIDDING PURPOSES

SECTION 23 05 19
METERS AND GAGES FOR HVAC PIPING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Positive displacement meters.
- B. Flow meters.
- C. Pressure gages and pressure gage taps.
- D. Thermometers and thermometer wells.
- E. Static pressure gages.
- F. Filter gages.

1.02 RELATED REQUIREMENTS

- A. Section 23 21 13 - Hydronic Piping.
- B. Section 23 09 23 - Direct-Digital Control System for HVAC.
- C. Section 23 09 93 - Sequence of Operations for HVAC Controls.

1.03 REFERENCE STANDARDS

- A. ASME B40.100 - Pressure Gauges and Gauge Attachments; The American Society of Mechanical Engineers.
- B. ASME MFC-3M - Measurement of Fluid Flow in Pipes Using Orifice, Nozzle and Venturi; The American Society of Mechanical Engineers.
- C. ASTM E1 - Standard Specification for ASTM Thermometers.
- D. ASTM E77 - Standard Test Method for Inspection and Verification of Thermometers.
- E. AWWA C700 - Cold Water Meters -- Displacement Type, Bronze Main Case; American Water Works Association (ANSI/AWWA C700).
- F. AWWA C701 - Cold Water Meters -- Turbine Type, for Customer Service; American Water Works Association.
- G. AWWA C702 - Cold Water Meters -- Compound Type; American Water Works Association.
- H. AWWA C706 - Direct-Reading, Remote-Registration Systems for Cold Water Meters; American Water Works Association (ANSI/AWWA C706).
- I. AWWA M6 - Water Meters -- Selection, Installation, Testing, and Maintenance; American Water Works Association.
- J. UL 393 - Indicating Pressure Gauges for Fire-Protection Service; Underwriters Laboratories Inc..
- K. UL 404 - Gages, Indicating Pressure, for Compressed Gas Service; Underwriters Laboratories Inc..

1.04 SUBMITTALS

- A. Product Data: Provide list that indicates use, operating range, total range and location for manufactured components.
- B. Project Record Documents: Record actual locations of components and instrumentation.
- C. Operation and Maintenance Data: Manufacturer's Standards and Operations and maintenance manuals and catalog cuts.

1.05 FIELD CONDITIONS

- A. Do not install instrumentation when areas are under construction, except for required rough-in, taps, supports and test plugs.

1.06 EXTRA MATERIALS

- A. Supply two bottles of red gage oil for static pressure gages.
- B. Supply two pressure gages with pulsation damper or dial thermometers.

PART 2 PRODUCTS

2.01 POSITIVE DISPLACEMENT METERS (LIQUID)

- A. Manufacturers:
 - 1. Dwyer Instruments, Inc: www.dwyer-inst.com.
 - 2. Venture Measurement Company: www.venturemeasurement.com.
 - 3. McCrometer: www.mccrometer.com.
 - 4. Substitutions: See Section 01 60 00 - Product Requirements.
- B. AWWA C700, positive displacement disc type suitable for fluid with bronze case and cast iron frost-proof, breakaway bottom cap, hermetically sealed register, remote reading to AWWA C706.
- C. Meter: Brass body turbine meter with magnetic drive register.
 - 1. Service: Cold water, 122 degrees F.
 - 2. Service: Hot water, 200 degrees F.
 - 3. Accuracy: 1-1/2 percent.
 - 4. Maximum Counter Reading: 10 million gallons.
 - 5. Size: 1/2 inch.

2.02 PRESSURE GAGES

- A. Manufacturers:
 - 1. Dwyer Instruments, Inc: www.dwyer-inst.com.
 - 2. Moeller Instrument Co., Inc: www.moellerinstrument.com.
 - 3. Omega Engineering, Inc: www.omega.com.
- B. Pressure Gages: ASME B40.100, UL 393 drawn steel case, phosphor bronze bourdon tube, rotary brass movement, brass socket, with front recalibration adjustment, black scale on white background.
 - 1. Case: Steel with brass bourdon tube.
 - 2. Size: 2-1/2 inch diameter.
 - 3. Mid-Scale Accuracy: One percent.
 - 4. Scale: Psi.

2.03 PRESSURE GAGE TAPPINGS

- A. Gage Cock: Tee or lever handle, brass for maximum 150 psi.
- B. Needle Valve: Brass or Stainless Steel, 1/4 inch NPT for minimum 150 psi.
- C. Pulsation Damper: Pressure snubber, brass with 1/4 inch connections.
- D. Syphon: Steel, Schedule 40 or Brass, 1/4 inch angle or straight pattern.

2.04 STEM TYPE THERMOMETERS

- A. Manufacturers:
 - 1. Dwyer Instruments, Inc: www.dwyer-inst.com.
 - 2. Omega Engineering, Inc: www.omega.com.
 - 3. Weksler Glass Thermometer Corp: www.wekslerglass.com.

- B. Thermometers - Fixed Mounting: Red- or blue-appearing non-toxic liquid in glass; ASTM E1; lens front tube, cast aluminum case with enamel finish.
 - 1. Size: 7 inch scale.
 - 2. Window: Clear glass or Lexan.
 - 3. Stem: Brass.
 - 4. Accuracy: 2 percent, per ASTM E77.
 - 5. Calibration: Degrees F.
- C. Thermometers - Adjustable Angle: Red- or blue-appearing non-toxic liquid in glass; ASTM E1; lens front tube, cast aluminum case with enamel finish, cast aluminum adjustable joint with positive locking device; adjustable 360 degrees in horizontal plane, 180 degrees in vertical plane.
 - 1. Size: 7 inch scale.
 - 2. Window: Clear glass or Lexan.
 - 3. Stem: 3/4 inch NPT brass.
 - 4. Accuracy: 2 percent, per ASTM E77.
 - 5. Calibration: Degrees F.

2.05 DIAL THERMOMETERS

- A. Manufacturers:
 - 1. Dwyer Instruments, Inc: www.dwyer-inst.com.
 - 2. Omega Engineering, Inc: www.omega.com.
 - 3. Weksler Glass Thermometer Corp: www.wekslerglass.com.
- B. Thermometers - Fixed Mounting: Dial type bimetallic actuated; ASTM E1; stainless steel case, silicone fluid damping, white with black markings and black pointer, hermetically sealed lens, stainless steel stem.
 - 1. Size: 2-1/2 inch diameter dial.
 - 2. Lens: Clear glass or Lexan.
 - 3. Accuracy: 1 percent.
 - 4. Calibration: Degrees F.
- C. Thermometer: ASTM E1, stainless steel case, adjustable angle with front recalibration, bimetallic helix actuated with silicone fluid damping, white with black markings and black pointer hermetically sealed lens, stainless steel stem.
 - 1. Size: 3 inch diameter dial.
 - 2. Lens: Clear glass or Lexan.
 - 3. Accuracy: 1 percent.
 - 4. Calibration: Degrees F.
- D. Thermometers: Dial type vapor or liquid actuated; ASTM E1; stainless steel case, with brass or copper bulb, copper or bronze braided capillary, white with black markings and black pointer, glass lens.
 - 1. Size: 2-1/2 inch diameter dial.
 - 2. Lens: Clear glass or Lexan.
 - 3. Length of Capillary: Minimum 5 feet.
 - 4. Accuracy: 2 percent.
 - 5. Calibration: Degrees F.

2.06 THERMOMETER SUPPORTS

- A. Socket: Brass separable sockets for thermometer stems with or without extensions as required, and with cap and chain.
- B. Flange: 3 inch outside diameter reversible flange, designed to fasten to sheet metal air ducts, with brass perforated stem.

2.07 TEST PLUGS

- A. Test Plug: 1/4 inch or 1/2 inch brass or stainless steel fitting and cap for receiving 1/8 inch outside diameter pressure or temperature probe with Nordel core for temperatures up to 350 degrees F.
- B. Test Kit: Carrying case, internally padded and fitted containing one 2-1/2 inch diameter pressure gages, one gage adapters with 1/8 inch probes, two 1 inch dial thermometers.

2.08 STATIC PRESSURE GAGES

- A. Manufacturers:
 - 1. Dwyer Instruments, Inc: www.dwyer-inst.com.
 - 2. Omega Engineering, Inc: www.omega.com.
 - 3. Weksler Glass Thermometer Corp: www.wekslerglass.com.
- B. 2-1/2 inch diameter dial in metal case, diaphragm actuated, black figures on white background, front recalibration adjustment, 2 percent of full scale accuracy.
- C. Inclined manometer, red liquid on white background with black figures, front recalibration adjustment, 3 percent of full scale accuracy.
- D. Accessories: Static pressure tips with compression fittings for bulkhead mounting, 1/4 inch diameter tubing.

PART 3 EXECUTION

3.01 INSTALLATION

- A. Install in accordance with manufacturer's instructions.
- B. Install positive displacement meters with isolating valves on inlet and outlet to AWWA M6. Provide full line size valved bypass with globe valve for liquid service meters.
- C. Provide one pressure gage per pump, installing taps before strainers and on suction and discharge of pump. Pipe to gage.
- D. Install pressure gages with pulsation dampers. Provide gage cock to isolate each gage. Provide siphon on gages in steam systems. Extend nipples and siphons to allow clearance from insulation.
- E. Install thermometers in piping systems in sockets in short couplings. Enlarge pipes smaller than 2-1/2 inch for installation of thermometer sockets. Ensure sockets allow clearance from insulation.
- F. Install thermometers in air duct systems on flanges.
- G. Install thermometer sockets adjacent to controls systems thermostat, transmitter, or sensor sockets. Refer to Section 23 09 43. Where thermometers are provided on local panels, duct or pipe mounted thermometers are provided on local panels, duct or pipe mounted thermometers are not required.
- H. Locate duct mounted thermometers minimum 10 feet downstream of mixing dampers, coils, or other devices causing air turbulence.
- I. Coil and conceal excess capillary on remote element instruments.
- J. Provide instruments with scale ranges selected according to service with largest appropriate scale.
- K. Install gages and thermometers in locations where they are easily read from normal operating level. Install vertical to 45 degrees off vertical.
- L. Adjust gages and thermometers to final angle, clean windows and lenses, and calibrate to zero.
- M. Locate test plugs adjacent thermometers and thermometer sockets, adjacent to pressure gages and pressure gage taps, adjacent to control device sockets or where indicated.

3.02 SCHEDULE

- A. Pressure Gages, Location:
1. Pumps.
 2. Expansion tanks.
 3. Pressure tanks.
 4. Standpipe, highest points.
 5. Standpipe and sprinkler water supply connection.
 6. Sprinkler system.
 7. Pressure reducing valves.
 8. Backflow preventers.
- B. Pressure Gage Tappings, Location:
1. Control valves 3/4 inch & larger - inlets and outlets.
 2. Major coils - inlets and outlets.
 3. Heat exchangers - inlets and outlets.
 4. Chiller - inlets and outlets.
 5. Boiler - inlets and outlets.
- C. Stem Type Thermometers, Location and Scale Range:
1. Headers to central equipment.
 2. Coil banks - inlets and outlets.
 3. Heat exchangers - inlets and outlets.
 4. Boilers - inlets and outlets.
 5. Chiller - inlets and outlets.
 6. Water zone supply and return.
 7. After major coils.
 8. Domestic hot water supply and recirculation.
- D. Thermometer Sockets, Location:
1. Control valves 1 inch & larger - inlets and outlets.
 2. Reheat coils - inlets and outlets.
 3. Cabinet heaters - inlets and outlets.
 4. Unit heaters - inlets and outlets.
- E. Dial Thermometers, Location and Scale Range:
1. ERV Outside air.
 2. ERV Return air.
 3. ERV Exhaust air.
 4. ERV Supply air.
- F. Static Pressure and Filter Gages, Location and Scale Range:
1. Built up filter banks.
 2. Unitary filter sections.
 3. Supply fan discharge.
 4. Building static.

END OF SECTION

NOT FOR BIDDING PURPOSES

SECTION 23 05 48
VIBRATION AND SEISMIC CON. FOR EQUIPMENT

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Equipment support bases.
- B. Vibration isolators.
- C. Inertia bases.
- D. Vibration isolators.
- E. Seismic restraints.

1.02 RELATED REQUIREMENTS

- A. Section 03 30 00 - Cast-in-Place Concrete.

1.03 SUBMITTALS

- A. Product Data: Provide schedule of vibration isolator type with location and load on each.
- B. Shop Drawings: Indicate inertia bases and locate vibration isolators, with static and dynamic load on each. Indicate seismic control measures.
- C. Manufacturer's Instructions: Indicate installation instructions with special procedures and setting dimensions.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Isolation Technology, Inc: www.isolationtech.com.
- B. Kinetics Noise Control, Inc: www.kineticsnoise.com.
- C. Mason Industries: www.mason-ind.com.

2.02 PERFORMANCE REQUIREMENTS

- A. General:
 - 1. All vibration isolators, base frames and inertia bases to conform to all uniform deflection and stability requirements under all operating loads.
 - 2. Steel springs to function without undue stress or overloading.

2.03 EQUIPMENT SUPPORT BASES

2.04 VIBRATION ISOLATORS

2.05 INERTIA BASES

- A. Concrete Inertia Bases:
 - 1. Construction: Structural steel channel perimeter frame, with gusseted brackets and anchor bolts, reinforcing; concrete filled.
 - 2. Mass: Minimum of 1.5 times weight of isolated equipment.
 - 3. Connecting Point: Reinforced to connect isolators and snubbers to base.
 - 4. Concrete: Minimum 3000 psi concrete.

2.06 VIBRATION ISOLATORS

- A. Open Spring Isolators:
 - 1. Springs: Minimum horizontal stiffness equal to 75 percent vertical stiffness, with working deflection between 0.3 and 0.6 of maximum deflection. Color code springs for load carrying capacity.
 - 2. Spring Mounts: Provide with leveling devices, minimum 0.25 inch thick neoprene sound pads, and zinc chromate plated hardware.

3. Sound Pads: Size for minimum deflection of 0.05 inch; meet requirements for neoprene pad isolators.
 4. For Exterior and Humid Areas: Hot dipped galvanized housings and neoprene coated springs.
- B. Restrained Open Spring Isolators:
1. Springs: Minimum horizontal stiffness equal to 75 percent vertical stiffness, with working deflection between 0.3 and 0.6 of maximum deflection. Color code springs for load carrying capacity.
 2. Spring Mounts: Provide with leveling devices, minimum 0.25 inch thick neoprene sound pads, and zinc chromate plated hardware.
 3. Sound Pads: Size for minimum deflection of 0.05 inch; meet requirements for neoprene pad isolators.
 4. Restraint: Provide heavy mounting frame and limit stops.
 5. For Exterior and Humid Areas: Hot dipped galvanized housings and neoprene coated springs.
- C. Closed Spring Isolators:
1. Type : Closed spring mount with top and bottom housing separated with neoprene rubber stabilizers.
 2. Springs: Minimum horizontal stiffness equal to 75 percent vertical stiffness, with working deflection between 0.3 and 0.6 of maximum deflection. Color code springs for load carrying capacity.
 3. Housings: Incorporate neoprene isolation pad meeting requirements for neoprene pad isolators, and neoprene side stabilizers with minimum 0.25 inch clearance.
 4. For Exterior and Humid Areas: Hot dipped galvanized housings and neoprene coated springs.
- D. Restrained Closed Spring Isolators:
1. Type : Closed spring mount with top and bottom housing separated with neoprene rubber stabilizers.
 2. Springs: Minimum horizontal stiffness equal to 75 percent vertical stiffness, with working deflection between 0.3 and 0.6 of maximum deflection. Color code springs for load carrying capacity.
 3. Housings: Incorporate neoprene isolation pad meeting requirements for neoprene pad isolators, and neoprene side stabilizers with minimum 0.25 inch clearance and limit stops.
 4. For Exterior and Humid Areas: Hot dipped galvanized housings and neoprene coated springs.
- E. Spring Hangers:
1. Springs: Minimum horizontal stiffness equal to 75 percent vertical stiffness, with working deflection between 0.3 and 0.6 of maximum deflection. Color code springs for load carrying capacity.
 2. Housings: Incorporate neoprene isolation pad meeting requirements for neoprene pad isolators.
 3. Misalignment: Capable of 20 degree hanger rod misalignment.
 4. For Exterior and Humid Areas: Hot dipped galvanized housings and neoprene coated springs.
- F. Neoprene Pad Isolators:
1. Rubber or neoprene waffle pads.
 - a. Hardness: 30 durometer.
 - b. Thickness: Minimum 1/2 inch.
 - c. Maximum Loading: 50 psi.
 - d. Rib Height: Maximum 0.7 times width.

2. Configuration: Single layer.
 3. Configuration: 1/2 inch thick waffle pads bonded each side of 1/4 inch thick steel plate.
- G. Rubber Mount or Hanger: Molded rubber designed for 0.4 inch deflection with threaded insert.
- H. Glass Fiber Pads: Neoprene jacketed pre-compressed molded glass fiber.
- I. Seismic Snubbers:
1. Type: Non-directional and double acting unit consisting of interlocking steel members restrained by neoprene elements.
 2. Elements: Replaceable neoprene, minimum of 0.75 inch thick with minimum 1/8 inch air gap.
 3. Capacity: 4 times load assigned to mount groupings at 0.4 inch deflection.
 4. Attachment Points and Fasteners: Capable of withstanding 3 times rated load capacity of seismic snubber.
- J. Roof Mounting Curb: 14 inches high with rigid steel lower section containing adjustable spring pockets with restrained spring isolators, steel upper section to support rooftop equipment, and continuous elastomeric membrane extending from upper section for counterflashing over roofing. Provide acoustical package consisting of interior perimeter angles and cross members to support up to two layers of gypsum board.

PART 3 EXECUTION

3.01 INSTALLATION - GENERAL

- A. Install in accordance with manufacturer's instructions.
- B. Bases:
1. Set steel bases for one inch clearance between housekeeping pad and base.
 2. Set concrete inertia bases for 2 inches clearance between housekeeping pad and base.
 3. Adjust equipment level.
- C. On closed spring isolators, adjust so side stabilizers are clear under normal operating conditions.
- D. Prior to making piping connections to equipment with operating weights substantially different from installed weights, block up equipment with temporary shims to final height. When full load is applied, adjust isolators to load to allow shim removal.
- E. Provide pairs of horizontal limit springs on fans with more than 6.0 inches WC static pressure, and on hanger supported, horizontally mounted axial fans.
- F. Provide seismic snubbers for all equipment, piping, and ductwork mounted on isolators. Each inertia base shall have minimum of four seismic snubbers located close to isolators. Snub equipment designated for post-disaster use to 0.05 inch maximum clearance. Other snubbers shall have clearance between 0.15 inch and 0.25 inch.
- G. Support piping connections to equipment mounted on isolators using isolators or resilient hangers as follows:
1. Up to 4 Inches Pipe Size: First three points of support.
 2. 5 to 8 Inches Pipe Size: First four points of support.
 3. 10 inches Pipe Size and Over: First six points of support.
 4. Select three hangers closest to vibration source for minimum 1.0 inch static deflection or static deflection of isolated equipment. Select remaining isolators for minimum 1.0 inch static deflection or 1/2 static deflection of isolated equipment.

3.02 FIELD QUALITY CONTROL

- A. Inspect isolated equipment after installation and submit report. Include static deflections.

3.03 SCHEDULE

- A. Pipe Isolation Schedule.
 - 1. 1 Inch Pipe Size: Isolate 120 diameters from equipment.
 - 2. 2 Inch Pipe Size: Isolate 90 diameters from equipment.
 - 3. 3 Inch Pipe Size: Isolate 80 diameters from equipment.
 - 4. 4 Inch Pipe Size: Isolate 75 diameters from equipment.
 - 5. 6 Inch Pipe Size: Isolate 60 diameters from equipment.
 - 6. 8 Inch Pipe Size: Isolate 60 diameters from equipment.
 - 7. 10 Inch Pipe Size: Isolate 54 diameters from equipment.
 - 8. 12 Inch Pipe Size: Isolate 50 diameters from equipment.
 - 9. 16 Inch Pipe Size: Isolate 45 diameters from equipment.
 - 10. 24 Inch Pipe Size: Isolate 38 diameters from equipment.
 - 11. Over 24 Inch Pipe Size: As indicated.
- B. Equipment Isolation Schedule.
 - 1. Pumps.

END OF SECTION

NOT FOR BIDDING PURPOSES

SECTION 23 05 53
IDENTIFICATION FOR HVAC PIPING AND EQUIPMENT

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Nameplates.
- B. Tags.
- C. Stencils.
- D. Pipe Markers.

1.02 RELATED REQUIREMENTS

- A. Section 09 90 00 - Painting and Coating: Identification painting.

1.03 REFERENCE STANDARDS

- A. ASME A13.1 - Scheme for the Identification of Piping Systems; The American Society of Mechanical Engineers.

1.04 SUBMITTALS

- A. List: Submit list of wording, symbols, letter size, and color coding for mechanical identification.
- B. Chart and Schedule: Submit valve chart and schedule, including valve tag number, location, function, and valve manufacturer's name and model number.
- C. Product Data: Provide manufacturers catalog literature for each product required.
- D. Samples: Submit two labels or tags 1/2 x 4 inch in size.
- E. Manufacturer's Installation Instructions: Indicate special procedures, and installation.
- F. Project Record Documents: Record actual locations of tagged valves.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Brady Corporation: www.bradycorp.com.
- B. Champion America, Inc: www.Champion-America.com.
- C. Seton Identification Products: www.seton.com/aec.

2.02 NAMEPLATES

- A. Description: Laminated three-layer plastic with engraved letters.
 - 1. Letter Color: White.
 - 2. Letter Height: 1/2 inch.
 - 3. Background Color: Black.

2.03 TAGS

- A. Plastic Tags: Laminated three-layer plastic with engraved black letters on light contrasting background color. Tag size minimum 1-1/2 inch diameter.
- B. Metal Tags: Aluminum with stamped letters; tag size minimum 1-1/2 inch diameter with smooth edges.
- C. Valve Tag Chart: Typewritten letter size list in anodized aluminum frame.

2.04 STENCILS

- A. Stencils: With clean cut symbols and letters of following size:
 - 1. 3/4 to 1-1/4 inch Outside Diameter of Insulation or Pipe: 8 inch long color field, 1/2 inch high letters.

2. 1-1/2 to 2 inch Outside Diameter of Insulation or Pipe: 8 inch long color field, 3/4 inch high letters.
 3. 2-1/2 to 6 inch Outside Diameter of Insulation or Pipe: 12 inch long color field, 1-1/4 inch high letters.
 4. 8 to 10 inch Outside Diameter of Insulation or Pipe: 24 inch long color field, 2-1/2 inch high letters.
 5. Over 10 inch Outside Diameter of Insulation or Pipe: 32 inch long color field, 3-1/2 inch high letters.
 6. Ductwork and Equipment: 2-1/2 inch high letters.
- B. Stencil Paint: As specified in Section 09 90 00, semi-gloss enamel, colors conforming to ASME A13.1.

2.05 PIPE MARKERS

- A. Color: Conform to ASME A13.1.
- B. Plastic Pipe Markers: Factory fabricated, flexible, semi-rigid plastic, preformed to fit around pipe or pipe covering; minimum information indicating flow direction arrow and identification of fluid being conveyed.
- C. Plastic Tape Pipe Markers: Flexible, vinyl film tape with pressure sensitive adhesive backing and printed markings.
- D. Underground Plastic Pipe Markers: Bright colored continuously printed plastic ribbon tape, minimum 6 inches wide by 4 mil thick, manufactured for direct burial service.

2.06 CEILING TACKS

- A. Description: Steel with 3/4 inch diameter color coded head.
- B. Color code as follows:
 1. HVAC Equipment: Yellow.
 2. Fire Dampers and Smoke Dampers: Red.
 3. Heating/Cooling Valves: Blue.

PART 3 EXECUTION

3.01 PREPARATION

- A. Degrease and clean surfaces to receive adhesive for identification materials.
- B. Prepare surfaces in accordance with Section 09 90 00 for stencil painting.

3.02 INSTALLATION

- A. Install nameplates with corrosive-resistant mechanical fasteners, or adhesive. Apply with sufficient adhesive to ensure permanent adhesion and seal with clear lacquer.
- B. Install tags with corrosion resistant chain.
- C. Apply stencil painting in accordance with Section 09 90 00.
- D. Install plastic pipe markers in accordance with manufacturer's instructions.
- E. Install plastic tape pipe markers complete around pipe in accordance with manufacturer's instructions.
- F. Install underground plastic pipe markers 6 to 8 inches below finished grade, directly above buried pipe.
- G. Identify air handling units, pumps, heat transfer equipment, tanks, and water treatment devices with plastic nameplates. Small devices, such as in-line pumps, may be identified with tags.
- H. Identify control panels and major control components outside panels with plastic nameplates.
- I. Identify thermostats relating to terminal boxes or valves with nameplates.

- J. Identify valves in main and branch piping with tags.
- K. Identify air terminal units and radiator valves with numbered tags.
- L. Tag automatic controls, instruments, and relays. Key to control schematic.
- M. Identify piping, concealed or exposed, with plastic pipe markers, plastic tape pipe markers or stencilled painting. Use tags on piping 3/4 inch diameter and smaller. Identify service, flow direction, and pressure. Install in clear view and align with axis of piping. Locate identification not to exceed 20 feet on straight runs including risers and drops, adjacent to each valve and Tee, at each side of penetration of structure or enclosure, and at each obstruction.
- N. Identify ductwork with plastic nameplates or stencilled painting. Identify with air handling unit identification number and area served. Locate identification at air handling unit, at each side of penetration of structure or enclosure, and at each obstruction.
- O. Locate ceiling tacks to locate valves, units, or dampers above lay-in panel ceilings. Locate in corner of panel closest to equipment.

END OF SECTION

NOT FOR BIDDING PURPOSES

NOT FOR BIDDING PURPOSES

SECTION 23 05 93
TESTING, ADJUSTING, AND BALANCING FOR HVAC

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Testing, adjustment, and balancing of air systems.
- B. Testing, adjustment, and balancing of hydronic and refrigerating systems.
- C. Measurement of final operating condition of HVAC systems.
- D. Sound measurement of equipment operating conditions.
- E. Vibration measurement of equipment operating conditions.

1.02 RELATED REQUIREMENTS

- A. Section 23 08 00 - Commissioning of HVAC.

1.03 REFERENCE STANDARDS

- A. AABC MN-1 - AABC National Standards for Total System Balance; Associated Air Balance Council.
- B. ASHRAE Std 111 - Practices for Measurement, Testing, Adjusting and Balancing of Building Heating, Ventilation, Air-Conditioning, and Refrigeration Systems; American Society of Heating, Refrigerating and Air-Conditioning Engineers, Inc..
- C. NEBB (TAB) - Procedural Standards for Testing Adjusting Balancing of Environmental Systems; National Environmental Balancing Bureau.
- D. SMACNA (TAB) - HVAC Systems Testing, Adjusting, and Balancing; Sheet Metal and Air Conditioning Contractors' National Association.

1.04 SUBMITTALS

- A. Qualifications: Submit name of adjusting and balancing agency and TAB supervisor for approval within 30 days after award of Contract.
- B. TAB Plan: Submit a written plan indicating the testing, adjusting, and balancing standard to be followed and the specific approach for each system and component.
 1. Submit to Architect.
 2. Submit to the Commissioning Authority, Construction Manager, and HVAC controls contractor.
 3. Submit six weeks prior to starting the testing, adjusting, and balancing work.
 4. Include certification that the plan developer has reviewed the contract documents, the equipment and systems, and the control system with the Architect and other installers to sufficiently understand the design intent for each system.
 5. Include at least the following in the plan:
 - a. Preface: An explanation of the intended use of the control system.
 - b. List of all air flow, water flow, sound level, system capacity and efficiency measurements to be performed and a description of specific test procedures, parameters, formulas to be used.
 - c. Copy of field checkout sheets and logs to be used, listing each piece of equipment to be tested, adjusted and balanced with the data cells to be gathered for each.
 - d. Identification and types of measurement instruments to be used and their most recent calibration date.
 - e. Discussion of what notations and markings will be made on the duct and piping drawings during the process.
 - f. Final test report forms to be used.
 - g. Detailed step-by-step procedures for TAB work for each system and issue, including:

- 1) Terminal flow calibration (for each terminal type).
- 2) Diffuser proportioning.
- 3) Branch/submain proportioning.
- 4) Total flow calculations.
- 5) Rechecking.
- 6) Diversity issues.
- h. Expected problems and solutions, etc.
- i. Criteria for using air flow straighteners or relocating flow stations and sensors .
- j. Details of how TOTAL flow will be determined; for example:
 - 1) Air: Sum of terminal flows via control system calibrated readings or via hood readings of all terminals, supply (SA) and return air (RA) pitot traverse, SA or RA flow stations.
 - 2) Water: Pump curves, circuit setter, flow station, ultrasonic, etc.
- k. Specific procedures that will ensure that both air and water side are operating at the lowest possible pressures and methods to verify this.
- l. Confirmation of understanding of the outside air ventilation criteria under all conditions.
- m. Method of verifying and setting minimum outside air flow rate will be verified and set and for what level (total building, zone, etc.).
- n. Method of checking building static and exhaust fan and/or relief damper capacity.
- o. Proposed selection points for sound measurements and sound measurement methods.
- p. Methods for making coil or other system plant capacity measurements, if specified.
- q. Time schedule for TAB work to be done in phases (by floor, etc.).
- r. Description of TAB work for areas to be built out later, if any.
- s. Time schedule for deferred or seasonal TAB work, if specified.
- t. False loading of systems to complete TAB work, if specified.
- u. Exhaust fan balancing and capacity verifications, including any required room pressure differentials.
- v. Interstitial cavity differential pressure measurements and calculations, if specified.
- w. Procedures for field technician logs of discrepancies, deficient or uncompleted work by others, contract interpretation requests and lists of completed tests (scope and frequency)
- x. Procedures for formal progress reports, including scope and frequency.
- y. Procedures for formal deficiency reports, including scope, frequency and distribution.
- C. Field Logs: Submit at least once a week to Commissioning Authority and Construction Manager.
- D. Control System Coordination Reports: Communicate in writing to the controls installer all setpoint and parameter changes made or problems and discrepancies identified during TAB that affect, or could affect, the control system setup and operation.
- E. Progress Reports.
- F. Final Report: Indicate deficiencies in systems that would prevent proper testing, adjusting, and balancing of systems and equipment to achieve specified performance.
 1. Submit to the HVAC controls contractor within two weeks after completion of testing, adjusting, and balancing.
 2. Revise TAB plan to reflect actual procedures and submit as part of final report.
 3. Submit draft copies of report for review prior to final acceptance of Project. Provide final copies for Architect and for inclusion in operating and maintenance manuals.
 4. Provide reports in soft cover, letter size, 3-ring binder manuals, complete with index page and indexing tabs, with cover identification at front and side. Include set of reduced

drawings with air outlets and equipment identified to correspond with data sheets, and indicating thermostat locations.

5. Include actual instrument list, with manufacturer name, serial number, and date of calibration.
 6. Form of Test Reports: Where the TAB standard being followed recommends a report format use that; otherwise, follow ASHRAE Std 111.
 7. Units of Measure: Report data in I-P (inch-pound) units only.
 8. Include the following on the title page of each report:
 - a. Name of Testing, Adjusting, and Balancing Agency.
 - b. Address of Testing, Adjusting, and Balancing Agency.
 - c. Telephone number of Testing, Adjusting, and Balancing Agency.
 - d. Project name.
 - e. Project location.
 - f. Project Architect.
 - g. Project Engineer.
 - h. Project Contractor.
 - i. Project altitude.
 - j. Report date.
- G. Project Record Documents: Record actual locations of flow measuring stations and balancing valves and rough setting.

1.05 QUALITY ASSURANCE (MOVED TO PART 3)

1.06 PRE-BALANCING MEETING (MOVED TO PART 3)

1.07 SEQUENCING AND SCHEDULING (MOVED TO PART 3)

1.08 WARRANTY (MOVED TO PART 3)

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION

3.01 GENERAL REQUIREMENTS

- A. Perform total system balance in accordance with one of the following:
 1. AABC MN-1, AABC National Standards for Total System Balance.
 2. ASHRAE Std 111, Practices for Measurement, Testing, Adjusting and Balancing of Building Heating, Ventilation, Air-Conditioning, and Refrigeration Systems.
 3. NEBB Procedural Standards for Testing Adjusting Balancing of Environmental Systems.
 4. SMACNA HVAC Systems Testing, Adjusting, and Balancing.
 5. Maintain at least one copy of the standard to be used at project site at all times.
- B. Begin work after completion of systems to be tested, adjusted, or balanced and complete work prior to Substantial Completion of the project.
- C. Where HVAC systems and/or components interface with life safety systems, including fire and smoke detection, alarm, and control, coordinate scheduling and testing and inspection procedures with the authorities having jurisdiction.
- D. TAB Agency Qualifications:
 1. Company specializing in the testing, adjusting, and balancing of systems specified in this section.
 2. Having minimum of three years documented experience.
 3. Certified by one of the following:
 - a. AABC, Associated Air Balance Council: www.aabchq.com; upon completion submit AABC National Performance Guaranty.
 - b. NEBB, National Environmental Balancing Bureau: www.nebb.org.

- c. TABB, The Testing, Adjusting, and Balancing Bureau of National Energy Management Institute: www.tabbcertified.org.
- E. TAB Supervisor and Technician Qualifications: Certified by same organization as TAB agency.
- F. TAB Supervisor Qualifications: Professional Engineer licensed in the State in which the Project is located.

3.02 EXAMINATION

- A. Verify that systems are complete and operable before commencing work. Ensure the following conditions:
 - 1. Systems are started and operating in a safe and normal condition.
 - 2. Temperature control systems are installed complete and operable.
 - 3. Proper thermal overload protection is in place for electrical equipment.
 - 4. Final filters are clean and in place. If required, install temporary media in addition to final filters.
 - 5. Duct systems are clean of debris.
 - 6. Fans are rotating correctly.
 - 7. Fire and volume dampers are in place and open.
 - 8. Air coil fins are cleaned and combed.
 - 9. Access doors are closed and duct end caps are in place.
 - 10. Air outlets are installed and connected.
 - 11. Duct system leakage is minimized.
 - 12. Hydronic systems are flushed, filled, and vented.
 - 13. Pumps are rotating correctly.
 - 14. Proper strainer baskets are clean and in place.
 - 15. Service and balance valves are open.
- B. Submit field reports. Report defects and deficiencies that will or could prevent proper system balance.
- C. Beginning of work means acceptance of existing conditions.

3.03 PREPARATION

- A. Hold a pre-balancing meeting at least one week prior to starting TAB work.
 - 1. Require attendance by all installers whose work will be tested, adjusted, or balanced.
- B. Provide instruments required for testing, adjusting, and balancing operations. Make instruments available to Architect to facilitate spot checks during testing.
- C. Provide additional balancing devices as required.

3.04 ADJUSTMENT TOLERANCES

- A. Air Handling Systems: Adjust to within plus or minus 10 percent of design for supply systems and plus or minus 10 percent of design for return and exhaust systems.
- B. Air Outlets and Inlets: Adjust total to within plus 10 percent and minus 10 percent of design to space. Adjust outlets and inlets in space to within plus or minus 10 percent of design.
- C. Hydronic Systems: Adjust to within plus or minus 10 percent of design.

3.05 RECORDING AND ADJUSTING

- A. Field Logs: Maintain written logs including:
 - 1. Running log of events and issues.
 - 2. Discrepancies, deficient or uncompleted work by others.
 - 3. Contract interpretation requests.
 - 4. Lists of completed tests.
- B. Ensure recorded data represents actual measured or observed conditions.

- C. Permanently mark settings of valves, dampers, and other adjustment devices allowing settings to be restored. Set and lock memory stops.
- D. Mark on the drawings the locations where traverse and other critical measurements were taken and cross reference the location in the final report.
- E. After adjustment, take measurements to verify balance has not been disrupted or that such disruption has been rectified.
- F. Leave systems in proper working order, replacing belt guards, closing access doors, closing doors to electrical switch boxes, and restoring thermostats to specified settings.
- G. At final inspection, recheck random selections of data recorded in report. Recheck points or areas as selected and witnessed by the Owner.
- H. Check and adjust systems approximately six months after final acceptance and submit report.

3.06 WATER SYSTEM PROCEDURE

- A. Adjust water systems to provide required or design quantities.
- B. Use calibrated Venturi tubes, orifices, or other metered fittings and pressure gauges to determine flow rates for system balance. Where flow metering devices are not installed, base flow balance on temperature difference across various heat transfer elements in the system.
- C. Adjust systems to provide specified pressure drops and flows through heat transfer elements prior to thermal testing. Perform balancing by measurement of temperature differential in conjunction with air balancing.
- D. Effect system balance with automatic control valves fully open to heat transfer elements.
- E. Effect adjustment of water distribution systems by means of balancing cocks, valves, and fittings. Do not use service or shut-off valves for balancing unless indexed for balance point.
- F. Where available pump capacity is less than total flow requirements or individual system parts, full flow in one part may be simulated by temporary restriction of flow to other parts.

3.07 SCOPE

- A. Test, adjust, and balance the following:
 - 1. HVAC Pumps
 - 2. Air Cooled Water Chillers

3.08 MINIMUM DATA TO BE REPORTED

- A. Electric Motors:
 - 1. Manufacturer
 - 2. Model/Frame
 - 3. HP/BHP
 - 4. Phase, voltage, amperage; nameplate, actual, no load
 - 5. RPM
 - 6. Service factor
 - 7. Starter size, rating, heater elements
 - 8. Sheave Make/Size/Bore
- B. V-Belt Drives:
 - 1. Identification/location
 - 2. Required driven RPM
 - 3. Driven sheave, diameter and RPM
 - 4. Belt, size and quantity
 - 5. Motor sheave diameter and RPM
 - 6. Center to center distance, maximum, minimum, and actual
- C. Pumps:

1. Identification/number
 2. Manufacturer
 3. Size/model
 4. Impeller
 5. Service
 6. Design flow rate, pressure drop, BHP
 7. Actual flow rate, pressure drop, BHP
 8. Discharge pressure
 9. Suction pressure
 10. Total operating head pressure
 11. Shut off, discharge and suction pressures
 12. Shut off, total head pressure
- D. Chillers:
1. Identification/number
 2. Manufacturer
 3. Capacity
 4. Model number
 5. Serial number
 6. Evaporator entering water temperature, design and actual
 7. Evaporator leaving water temperature, design and actual
 8. Evaporator pressure drop, design and actual
 9. Evaporator water flow rate, design and actual
 10. Condenser entering water temperature, design and actual
 11. Condenser pressure drop, design and actual
 12. Condenser water flow rate, design and actual
- E. Sound Level Reports:
1. Location
 2. Octave bands - equipment off
 3. Octave bands - equipment on

END OF SECTION

NOT FOR BIDDING PURPOSES

SECTION 23 07 19
HVAC PIPING INSULATION

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Piping insulation.
- B. Jackets and accessories.

1.02 RELATED REQUIREMENTS

- A. Section 01 61 16 - Volatile Organic Compound (VOC) Content Restrictions.
- B. Section 07 84 00 - Firestopping.
- C. Section 09 90 00 - Painting and Coating: Painting insulation jacket.
- D. Section 22 10 05 - Plumbing Piping: Placement of hangers and hanger inserts.
- E. Section 23 21 13 - Hydronic Piping: Placement of hangers and hanger inserts.
- F. Section 23 23 00 - Refrigerant Piping: Placement of inserts.

1.03 REFERENCE STANDARDS

- A. ASTM A666 - Standard Specification for Annealed or Cold-Worked Austenitic Stainless Steel Sheet, Strip, Plate, and Flat Bar.
- B. ASTM B209 - Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate.
- C. ASTM B209M - Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate [Metric].
- D. ASTM C177 - Standard Test Method for Steady-State Heat Flux Measurements and Thermal Transmission Properties by Means of the Guarded Hot Plate Apparatus.
- E. ASTM C195 - Standard Specification for Mineral Fiber Thermal Insulating Cement.
- F. ASTM C449 - Standard Specification for Mineral Fiber Hydraulic-Setting Thermal Insulating and Finishing Cement.
- G. ASTM C518 - Standard Test Method for Steady-State Thermal Transmission Properties by Means of the Heat Flow Meter Apparatus.
- H. ASTM C533 - Standard Specification for Calcium Silicate Block and Pipe Thermal Insulation.
- I. ASTM C534/C534M - Standard Specification for Preformed Flexible Elastomeric Cellular Thermal Insulation in Sheet and Tubular Form.
- J. ASTM C547 - Standard Specification for Mineral Fiber Pipe Insulation.
- K. ASTM C552 - Standard Specification for Cellular Glass Thermal Insulation.
- L. ASTM C578 - Standard Specification for Rigid, Cellular Polystyrene Thermal Insulation.
- M. ASTM C585 - Standard Practice for Inner and Outer Diameters of Rigid Thermal Insulation for Nominal Sizes of Pipe and Tubing (NPS System).
- N. ASTM C591 - Standard Specification for Unfaced Preformed Rigid Cellular Polyisocyanurate Thermal Insulation.
- O. ASTM C610 - Standard Specification for Molded Expanded Perlite Block and Pipe Thermal Insulation.
- P. ASTM C795 - Standard Specification for Thermal Insulation for Use in Contact with Austenitic Stainless Steel.
- Q. ASTM D1056 - Standard Specification for Flexible Cellular Materials--Sponge or Expanded Rubber.

- R. ASTM D2842 - Standard Test Method for Water Absorption of Rigid Cellular Plastics.
- S. ASTM E84 - Standard Test Method for Surface Burning Characteristics of Building Materials.
- T. ASTM E96/E96M - Standard Test Methods for Water Vapor Transmission of Materials.
- U. NFPA 255 - Standard Method of Test of Surface Burning Characteristics of Building Materials; National Fire Protection Association.
- V. UL 723 - Standard for Test for Surface Burning Characteristics of Building Materials; Underwriters Laboratories Inc..

1.04 SUBMITTALS

- A. Product Data: Provide product description, thermal characteristics, list of materials and thickness for each service, and locations.
- B. Manufacturer's Instructions: Indicate installation procedures that ensure acceptable workmanship and installation standards will be achieved.

1.05 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing the Products specified in this section with not less than three years of documented experience.
- B. Applicator Qualifications: Company specializing in performing the type of work specified in this section with minimum three years of experience.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. Accept materials on site, labeled with manufacturer's identification, product density, and thickness.

1.07 FIELD CONDITIONS

- A. Maintain ambient conditions required by manufacturers of each product.
- B. Maintain temperature before, during, and after installation for minimum of 24 hours.

PART 2 PRODUCTS

2.01 REQUIREMENTS FOR ALL PRODUCTS OF THIS SECTION

- A. Surface Burning Characteristics: Flame spread/Smoke developed index of 25/50, maximum, when tested in accordance with ASTM E84, NFPA 255, or UL 723.

2.02 GLASS FIBER

- A. Manufacturers:
 - 1. Knauf Insulation: www.knaufusa.com.
 - 2. Johns Manville Corporation: www.jm.com.
 - 3. Owens Corning Corp: www.owenscorning.com.
 - 4. CertainTeed Corporation: www.certainteed.com.
- B. Insulation: ASTM C547 and ASTM C795; rigid molded, noncombustible.
 - 1. 'K' value: ASTM C177, 0.24 at 75 degrees F.
 - 2. Maximum service temperature: 850 degrees F.
 - 3. Maximum moisture absorption: 0.2 percent by volume.
- C. Insulation: ASTM C547 and ASTM C795; semi-rigid, noncombustible, end grain adhered to jacket.
 - 1. 'K' value: ASTM C177, 0.24 at 75 degrees F.
 - 2. Maximum service temperature: 650 degrees F.
 - 3. Maximum moisture absorption: 0.2 percent by volume.

- D. Vapor Barrier Jacket: White kraft paper with glass fiber yarn, bonded to aluminized film; moisture vapor transmission when tested in accordance with ASTM E96/E96M of 0.02 perm-inches.
- E. Tie Wire: 0.048 inch stainless steel with twisted ends on maximum 12 inch centers.
- F. Vapor Barrier Lap Adhesive:
 - 1. Compatible with insulation.
- G. Insulating Cement/Mastic:
 - 1. ASTM C195; hydraulic setting on mineral wool.
- H. Fibrous Glass Fabric:
 - 1. Cloth: Untreated; 9 oz/sq yd weight.
 - 2. Blanket: 1.0 lb/cu ft density.
 - 3. Weave: 5x5.
- I. Indoor Vapor Barrier Finish:
 - 1. Cloth: Untreated; 9 oz/sq yd weight.
 - 2. Vinyl emulsion type acrylic, compatible with insulation, black color.
- J. Outdoor Vapor Barrier Mastic:
 - 1. Vinyl emulsion type acrylic or mastic, compatible with insulation, black color.
- K. Outdoor Breather Mastic:
 - 1. Vinyl emulsion type acrylic or mastic, compatible with insulation, black color.
- L. Insulating Cement:
 - 1. ASTM C449/C449M.

2.03 CELLULAR GLASS

- A. Manufacturers:
 - 1. Pittsburgh Corning Corporation: www.foamglasinsulation.com.
 - 2. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Insulation: ASTM C552, Grade 1.
 - 1. 'K' value: 0.37 at 100 degrees F.
 - 2. Service Temperature: Up to 900 degrees F.
 - 3. Water Vapor Permeability: 0.005 perm inch.
 - 4. Water Absorption: 0.2 percent by volume, maximum.

2.04 EXPANDED POLYSTYRENE

- A. Insulation: ASTM C578; rigid closed cell.
 - 1. 'K' value: 0.23 at 75 degrees F.
 - 2. Maximum service temperature: 165 degrees F.
 - 3. Maximum water vapor permeance: 5.0 perms

2.05 EXPANDED PERLITE

- A. Manufacturers:
 - 1. Schundler Company: www.schundler.com.
- B. Insulation: ASTM C610, molded.
 - 1. Maximum service temperature: 1200 degrees F.
 - 2. Maximum water vapor transmission: 0.1 perm.

2.06 HYDROUS CALCIUM SILICATE

- A. Manufacturers:
 - 1. Johns Manville Corporation: www.jm.com.
 - 2. Substitutions: See Section 01 60 00 - Product Requirements.

- B. Insulation: ASTM C533 and ASTM C795; rigid molded, asbestos free, gold color.
 - 1. 'K' value: ASTM C177 and C518; 0.40 at 300 degrees F, when tested in accordance with ASTM C177 or ASTM C518.
 - 2. Maximum service temperature: 1200 degrees F.
 - 3. Density: 15 lb/cu ft.
- C. Tie Wire: 0.048 inch stainless steel with twisted ends on maximum 12 inch centers.
- D. Insulating Cement:
 - 1. ASTM C449/C449M.

2.07 POLYISOCYANURATE CELLULAR PLASTIC

- A. Insulation Material: ASTM C591, rigid molded modified polyisocyanurate cellular plastic.
 - 1. Dimension: Comply with requirements of ASTM C585.
 - 2. 'K' value: 0.18 at 75 degrees F, when tested in accordance with ASTM C518.
 - 3. Minimum Service Temperature: -70 degrees F.
 - 4. Maximum Service Temperature: 300 degrees F.
 - 5. Water Absorption: 0.5 percent by volume, maximum, when tested in accordance with ASTM D2842..
 - 6. Moisture Vapor Transmission: 4.0 perm in.
 - 7. Connection: Waterproof vapor barrier adhesive.

2.08 POLYETHYLENE

- A. Manufacturers:
 - 1. Armacell International: www.armacell.com.
 - 2. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Insulation: Flexible closed-cell polyethylene tubing, slit lengthwise for installation, complying with applicable requirements of ASTM D1056.
 - 1. 'K' value: ASTM C177; 0.25 at 75 degrees F.
 - 2. Maximum Service Temperature: 200 degrees F.
 - 3. Density: 2 lb/cu ft.
 - 4. Maximum Moisture Absorption: 1.0 percent by volume.
 - 5. Moisture Vapor Permeability: 0.05 perm inch, when tested in accordance with ASTM E96/E96M.
 - 6. Connection: Contact adhesive.

2.09 FLEXIBLE ELASTOMERIC CELLULAR INSULATION

- A. Manufacturer:
 - 1. Armacell International: www.armacell.com.
 - 2. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Insulation: Preformed flexible elastomeric cellular rubber insulation complying with ASTM C534 Grade 3; use molded tubular material wherever possible.
 - 1. Minimum Service Temperature: -40 degrees F.
 - 2. Maximum Service Temperature: 220 degrees F.
 - 3. Connection: Waterproof vapor barrier adhesive.
- C. Elastomeric Foam Adhesive: Air dried, contact adhesive, compatible with insulation.

2.10 JACKETS

- A. PVC Plastic.
 - 1. Manufacturers:
 - a. Johns Manville Corporation: www.jm.com.
 - b. Substitutions: See Section 01 60 00 - Product Requirements.
 - 2. Jacket: One piece molded type fitting covers and sheet material, off-white color.

- a. Minimum Service Temperature: 0 degrees F.
- b. Maximum Service Temperature: 150 degrees F.
- c. Moisture Vapor Permeability: 0.002 perm inch, maximum, when tested in accordance with ASTM E96/E96M.
- d. Thickness: 10 mil.
- e. Connections: Brush on welding adhesive.
3. Covering Adhesive Mastic:
 - a. Compatible with insulation.
- B. ABS Plastic:
 1. Jacket: One piece molded type fitting covers and sheet material, off-white color.
 - a. Minimum Service Temperature: -40 degrees F.
 - b. Maximum Service Temperature of 180 degrees F.
 - c. Moisture Vapor Permeability: 0.012 perm inch, when tested in accordance with ASTM E96/E96M.
 - d. Thickness: 30 mil.
 - e. Connections: Brush on welding adhesive.
- C. Canvas Jacket: UL listed 6 oz/sq yd plain weave cotton fabric treated with dilute fire retardant lagging adhesive.
 1. Lagging Adhesive:
 - a. Compatible with insulation.
- D. Aluminum Jacket: ASTM B209 (ASTM B209M) formed aluminum sheet.
 1. Thickness: 0.016 inch sheet.
 2. Finish: Smooth.
 3. Joining: Longitudinal slip joints and 2 inch laps.
 4. Fittings: 0.016 inch thick die shaped fitting covers with factory attached protective liner.
 5. Metal Jacket Bands: 3/8 inch wide; 0.015 inch thick aluminum.
 6. Metal Jacket Bands: 3/8 inch wide; 0.010 inch thick stainless steel.
- E. Stainless Steel Jacket: ASTM A666, Type 302 stainless steel.
 1. Thickness: 0.010 inch.
 2. Finish: Smooth.
 3. Metal Jacket Bands: 3/8 inch wide; 0.010 inch thick stainless steel.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that piping has been tested before applying insulation materials.
- B. Verify that surfaces are clean and dry, with foreign material removed.

3.02 INSTALLATION

- A. Install in accordance with manufacturer's instructions.
- B. Install in accordance with NAIMA National Insulation Standards.
- C. Exposed Piping: Locate insulation and cover seams in least visible locations.
- D. Insulated pipes conveying fluids below ambient temperature: Insulate entire system including fittings, valves, unions, flanges, strainers, flexible connections, pump bodies, and expansion joints.
- E. Glass fiber insulated pipes conveying fluids below ambient temperature:
 1. Provide vapor barrier jackets, factory-applied or field-applied. Secure with self-sealing longitudinal laps and butt strips with pressure sensitive adhesive. Secure with outward clinch expanding staples and vapor barrier mastic.

2. Insulate fittings, joints, and valves with molded insulation of like material and thickness as adjacent pipe. Finish with glass cloth and vapor barrier adhesive or PVC fitting covers.
- F. For hot piping conveying fluids 140 degrees F or less, do not insulate flanges and unions at equipment, but bevel and seal ends of insulation.
- G. For hot piping conveying fluids over 140 degrees F, insulate flanges and unions at equipment.
- H. Glass fiber insulated pipes conveying fluids above ambient temperature:
 1. Provide standard jackets, with or without vapor barrier, factory-applied or field-applied. Secure with self-sealing longitudinal laps and butt strips with pressure sensitive adhesive. Secure with outward clinch expanding staples.
 2. Insulate fittings, joints, and valves with insulation of like material and thickness as adjoining pipe. Finish with glass cloth and adhesive or PVC fitting covers.
- I. Inserts and Shields:
 1. Application: Piping 1-1/2 inches diameter or larger.
 2. Shields: Galvanized steel between pipe hangers or pipe hanger rolls and inserts.
 3. Insert location: Between support shield and piping and under the finish jacket.
 4. Insert configuration: Minimum 6 inches long, of same thickness and contour as adjoining insulation; may be factory fabricated.
 5. Insert material: Hydrous calcium silicate insulation or other heavy density insulating material suitable for the planned temperature range.
- J. Continue insulation through walls, sleeves, pipe hangers, and other pipe penetrations. Finish at supports, protrusions, and interruptions. At fire separations, refer to Section 07 84 00.
- K. Pipe Exposed in Mechanical Equipment Rooms or Finished Spaces (less than 10 feet above finished floor): Finish with canvas jacket sized for finish painting.
- L. Exterior Applications: Provide vapor barrier jacket. Insulate fittings, joints, and valves with insulation of like material and thickness as adjoining pipe, and finish with glass mesh reinforced vapor barrier cement. Cover with aluminum jacket with seams located on bottom side of horizontal piping. Provide two coats of UV resistant finish for flexible elastomeric cellular insulation without jacketing.
- M. Buried Piping: Provide factory fabricated assembly with inner all-purpose service jacket with self-sealing lap, and asphalt impregnated open mesh glass fabric, with one mil thick aluminum foil sandwiched between three layers of bituminous compound; outer surface faced with a polyester film.
- N. Heat Traced Piping: Insulate fittings, joints, and valves with insulation of like material, thickness, and finish as adjoining pipe. Size large enough to enclose pipe and heat tracer. Cover with aluminum jacket with seams located on bottom side of horizontal piping.

3.03 SCHEDULE

- A. PIPING INSULATION SCHEDULES
 1. General: Abbreviations used in the following schedules include:
 - a. Field Applied Jackets: P - PVC, K-Foil and Paper, A - Aluminum, SS - Stainless Steel.
 - b. Piping Sizes: NPS - Nominal Pipe Size.
- B. EXTERIOR PIPING INSULATION APPLICATION SCHEDULE
 1. This application schedule is for aboveground insulation outside the building. Loose-fill insulation, for belowground piping, is specified in Division 2 piping distribution Sections.
 2. Schedules:
 - a. Service: Chilled-water and dual temperature supply and return.
 - 1) Operating Temperature: 35 to 250 deg F.
 - 2) Insulation Material: Cellular glass, with jacket.

- 3) Insulation Thickness: Apply the following insulation thicknesses:
 - (a) Pipe, Any pipe size: 2.0 inch.
- 4) Field-Applied Jacket: Aluminum.
- 5) Vapor Retarder Required: Yes.
- 6) Finish: None.

END OF SECTION

NOT FOR BIDDING PURPOSES

NOT FOR BIDDING PURPOSES

SECTION 23 09 13

INSTRUMENTATION AND CONTROL DEVICES FOR HVAC

SECTION PROVIDED FOR REFERENCE ONLY. BUILDING AUTOMATION SYSTEM/CONTROLS PACKAGE PURCHASED UNDER SEPARATE CONTRACT.

PART 1 GENERAL

2.01 SECTION INCLUDES

- A. Thermostats, Temperature Sensors.
- B. Control valves.
- C. Miscellaneous accessories.

2.02 RELATED REQUIREMENTS

- A. Section 23 21 13 - Hydronic Piping: Installation of control valves, flow switches, temperature sensor sockets, gage taps.
- B. Section 23 33 00 - Air Duct Accessories: Installation of automatic dampers.
- C. Section 23 09 23 - Direct-Digital Control System for HVAC.
- D. Section 23 09 93 - Sequence of Operations for HVAC Controls.

2.03 REFERENCE STANDARDS

- A. AMCA 500-D - Laboratory Methods for Testing Dampers for Rating; Air Movement and Control Association International, Inc..
- B. ASME B16.22 - Wrought Copper and Copper Alloy Solder Joint Pressure Fittings; The American Society of Mechanical Engineers.
- C. ASTM B32 - Standard Specification for Solder Metal.
- D. ASTM B88 - Standard Specification for Seamless Copper Water Tube.
- E. ASTM D1693 - Standard Test Method for Environmental Stress-Cracking of Ethylene Plastics.
- F. NEMA 250 - Enclosures for Electrical Equipment (1000 Volts Maximum); National Electrical Manufacturers Association.
- G. NFPA 90A - Standard for the Installation of Air-Conditioning and Ventilation Systems; National Fire Protection Association.

2.04 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide description and engineering data for each control system component. Include sizing as requested. Provide data for each system component and software module.
- C. Shop Drawings: Indicate complete operating data, system drawings, wiring diagrams, and written detailed operational description of sequences. Submit schedule of valves indicating size, flow, and pressure drop for each valve. For automatic dampers indicate arrangement, velocities, and static pressure drops for each system.
- D. Manufacturer's Instructions: Provide for all manufactured components.
- E. Project Record Documents: Record actual locations of control components, including panels, thermostats, and sensors. Accurately record actual location of control components, including panels, thermostats, and sensors.
 - 1. Revise shop drawings to reflect actual installation and operating sequences.
- F. Operation and Maintenance Data: Include inspection period, cleaning methods, recommended cleaning materials, and calibration tolerances.

- G. Warranty: Submit manufacturers warranty and ensure forms have been filled out in Owner s name and registered with manufacturer.
- H. Maintenance Materials: Furnish the following for Owner's use in maintenance of project.
 - 1. See Section 01 60 00 - Product Requirements, for additional provisions.

2.05 QUALITY ASSURANCE

- A. Designer Qualifications: Design system under direct supervision of a Professional Engineer experienced in design of this work and licensed in the State in which the Project is located.

PART 2 PRODUCTS

3.01 EQUIPMENT - GENERAL

- A. Products Requiring Electrical Connection: Listed and classified by Underwriters Laboratories Inc., as suitable for the purpose specified and indicated.

3.02 CONTROL VALVES

- A. Globe Pattern:
 - 1. Up to 2 inches: Bronze body, bronze trim, rising stem, renewable composition disc, screwed ends with backseating capacity repackable under pressure.
 - a. Product:
 - 1) Substitutions: See Section 01 60 00 - Product Requirements.
 - 2. Over 2 inches: Iron body, bronze trim, rising stem, plug-type disc, flanged ends, renewable seat and disc.
 - a. Product:
 - 1) Substitutions: See Section 01 60 00 - Product Requirements.
 - 3. Hydronic Systems:
 - a. Rate for service pressure of 125 psig at 250 degrees F.
 - b. Replaceable plugs and seats of stainless steel.
 - c. Size for 3 psig maximum pressure drop at design flow rate.
 - d. Two way valves shall have equal percentage characteristics, three way valves linear characteristics. Size two way valve operators to close valves against pump shut off head.
 - 4. Steam Systems:
 - a. Rate for service pressure of 125 psig at 250 degrees F.
 - b. Replaceable plugs and seats of stainless steel. Pressure drop across any steam valve at maximum flow shall be as shown on the Drawings.
 - c. Size for 10 psig inlet pressure and 5 psig pressure drop.
 - d. Valves shall have modified linear characteristics.
- B. Butterfly Pattern:
 - 1. Iron body, bronze disc, resilient replaceable seat for service to 180 degrees F wafer or lug ends, extended neck.
 - 2. Hydronic Systems:
 - a. Rate for service pressure of 125 psig at 250 degrees F.
 - b. Size for 1 psig maximum pressure drop at design flow rate.
- C. Electronic Actuators:
 - 1. 24 V powered, 4-20 mA proportional signal electronic actuator for valves and dampers.
 - 2. Actuators shall spring return to normal open position as indicated on freeze, fire, or temperature protection.
 - 3. Select operator for full shut off at maximum pump differential pressure.

3.03 INPUT/OUTPUT SENSORS

- A. Temperature Sensors:

1. Sensor range shall provide a resolution of no worse than .4°F (unless noted otherwise).
2. Liquid immersion temperature sensor shall include stainless steel thermowell, sensor and connection head for wiring connections.
 - a. Sensing element for chilled water applications - Platinum RTD, Thermistor, or integrated circuit, +/- 0.8°F accuracy at calibration point. Temperature range shall be as required for resolution indicated in paragraph A.
 - b. Sensing element for non-chilled water applications - Platinum RTD, +/- 0.2°F accuracy at calibration point. Temperature range shall be as required for resolution of no worse than 0.1°F.
- B. Equipment Operation Sensors:
 1. Status Inputs for Fans: Differential pressure switch with adjustable range of 0 to 5 inches wg.
 2. Status Inputs for Pumps: Differential pressure switch piped across pump with adjustable pressure differential range of 8 to 60 psi.
 3. Status Inputs for Electric Motors: Current sensing relay with current transformers, adjustable and set to 175 percent of rated motor current.
- C. Damper Position Indication: Potentiometer mounted in enclosure with adjustable crank arm assembly connected to damper to transmit 0 - 100 percent damper travel.
- D. Carbon Dioxide Level Sensors:
 1. Wall or duct-mounted as required by control sequence or plans.
 2. Demand-control ventilation sensor for measuring and transmitting CO2 levels ranging from 0-2,000 ppm.
 3. Single-beam, dual-wavelength design with five-year stability for calibration..
 4. Proportional output, 4-20 mA signal.

3.04 TRANSMITTERS

- A. Pressure Transmitters:
 1. One pipe direct acting indicating type for gas, liquid, or steam service, range suitable for system, proportional electronic output.
- B. Temperature Transmitters:
 1. One pipe, directly proportional output signal to measured variable, linearity within plus or minus 1/2 percent of range for 200 degree F span and plus or minus 1 percent for 50 degree F span, with 50 degrees F temperature range, compensated bulb, averaging capillary, or rod and tube operation on 20 psig input pressure and 3 to 15 psig output.

PART 3 EXECUTION

4.01 EXAMINATION

- A. Verify existing conditions before starting work.
- B. Verify that systems are ready to receive work.
- C. Beginning of installation means installer accepts existing conditions.
- D. Sequence work to ensure installation of components is complementary to installation of similar components in other systems.
- E. Coordinate installation of system components with installation of mechanical systems equipment such as air handling units and air terminal units.
- F. Ensure installation of components is complementary to installation of similar components.
- G. Coordinate installation of system components with installation of mechanical systems equipment such as air handling units and air terminal units.

4.02 INSTALLATION

- A. Install in accordance with manufacturer's instructions.
- B. Check and verify location of thermostats with plans and room details before installation. Locate 48 inches above floor. Align with lighting switches, CO2 sensors, and humidistats. Refer to Section 26 27 26.
- C. Mount freeze protection thermostats using flanges and element holders.
- D. Mount outdoor reset thermostats and outdoor sensors indoors, with sensing elements outdoors with sun shield.
- E. Provide separable sockets for liquids and flanges for air bulb elements.
- F. Provide thermostats in aspirating boxes in front entrances.
- G. Provide guards on thermostats in entrances.
- H. Provide valves with position indicators and with pilot positioners where sequenced with other controls.
- I. Provide mixing dampers of opposed blade construction arranged to mix streams. Provide separate minimum outside air damper section adjacent to return air dampers with separate damper motor.
- J. Provide isolation (two position) dampers of parallel blade construction.
- K. Install damper motors on outside of duct in warm areas. Do not install motors in locations at outdoor temperatures.
- L. Mount control panels adjacent to associated equipment on vibration free walls or free standing angle iron supports. One cabinet may accommodate more than one system in same equipment room. Provide engraved plastic nameplates for instruments and controls inside cabinet and engraved plastic nameplates on cabinet face.
- M. Install "hand/off/auto" selector switches to override automatic interlock controls when switch is in "hand" position.
- N. Provide conduit and electrical wiring in accordance with Section 26 27 17. Electrical material and installation shall be in accordance with appropriate requirements of Division 26.

4.03 MAINTENANCE

- A. See Section 01 70 00 - Execution Requirements, for additional requirements relating to maintenance service.
- B. Provide service and maintenance of control system for one year from Date of Substantial Completion.

END OF SECTION

SECTION 23 09 23

DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC

.01 SECTION PROVIDED FOR REFERENCE ONLY. BUILDING AUTOMATION SYSTEM/CONTROLS PACKAGE PURCHASED UNDER SEPARATE CONTRACT.

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. System Description
- B. Operator Interface
- C. Controllers
- D. Power Supplies and Line Filtering
- E. System Software
- F. Controller Software
- G. HVAC Control Programs
- H. Control equipment.
- I. Software.

1.02 RELATED REQUIREMENTS

- A. Section 28 31 00 - Fire Detection and Alarm.
- B. Section 23 09 13 - Instrumentation and Control Devices for HVAC.
- C. Section 23 09 93 - Sequence of Operations for HVAC Controls.
- D. Section 26 27 17 - Equipment Wiring: Electrical characteristics and wiring connections.
- E. Section 27 52 23.50 - Educational Intercommunications and Programs - Education For Sustainability Systems

1.03 REFERENCE STANDARDS

- A. NFPA 70 - National Electrical Code; National Fire Protection Association.

1.04 SYSTEM DESCRIPTION

- A. Automatic temperature control field monitoring and control system using field programmable micro-processor based units by Johnson Controls to interface with the existing District-Wide system. No other vendors are acceptable.
- B. Base system on distributed system of fully intelligent, stand-alone controllers, operating in a multi-tasking, multi-user environment on token passing network, with central and remote hardware, software, and interconnecting wire and conduit.
- C. Include computer software and all hardware, operator input/output devices, control units, local area networks (LAN), sensors, control devices, actuators.
- D. Controls for variable air volume terminals, radiation, reheat coils, unit heaters, fan coils, and the like when directly connected to the control units. Individual terminal unit control is specified in Section 23 09 13.
- E. Provide control systems consisting of thermostats, control valves, dampers and operators, indicating devices, interface equipment, power transformers and electrical feeds, and other apparatus and accessories required to operate mechanical systems, and to perform functions specified.
- F. Include installation and calibration, supervision, adjustments, and fine tuning necessary for complete and fully operational system.

1.05 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide data for each system component and software module.
- C. Shop Drawings:
 - 1. Indicate trunk cable schematic showing programmable control unit locations, and trunk data conductors.
 - 2. List connected data points, including connected control unit and input device.
 - 3. Indicate system graphics indicating monitored systems, data (connected and calculated) point addresses, and operator notations. Provide demonstration diskette containing graphics.
 - 4. Show system configuration with peripheral devices, batteries, power supplies, diagrams, modems, and interconnections.
 - 5. Indicate description and sequence of operation of operating, user, and application software.
- D. Manufacturer's Instructions: Indicate manufacturer's installation instructions for all manufactured components.
- E. Project Record Documents: Record actual locations of control components, including control units, thermostats, and sensors.
 - 1. Revise shop drawings to reflect actual installation and operating sequences.
 - 2. Include submittals data in final "Record Documents" form.
- F. Operation and Maintenance Data:
 - 1. Include interconnection wiring diagrams complete field installed systems with identified and numbered, system components and devices.
 - 2. Include keyboard illustrations and step-by-step procedures indexed for each operator function.
 - 3. Include inspection period, cleaning methods, cleaning materials recommended, and calibration tolerances.
- G. Warranty: Submit manufacturer's warranty and ensure forms have been filled out in Owner's name and registered with manufacturer.

1.06 QUALITY ASSURANCE

- A. Perform work in accordance with NFPA 70.
- B. Design system software under direct supervision of a Professional Engineer experienced in design of this Work and licensed at the State in which the Project is located.
- C. Manufacturer Qualifications: Company specializing in manufacturing the Products specified in this section with minimum 10 years documented experience.
- D. Installer Qualifications: Company specializing in performing the work of this section 5 years documented experience approved by manufacturer.
- E. Products Requiring Electrical Connection: Listed and classified by Underwriters Laboratories Inc., as suitable for the purpose specified and indicated.

1.07 PRE-INSTALLATION MEETING

- A. Convene one week before starting work of this Section.
- B. Require attendance of parties directly affecting the work of this Section.

1.08 WARRANTY

- A. See Section 01 78 00 - Closeout Submittals, for additional warranty requirements.
- B. Correct defective Work within a five year period after Substantial Completion.

- C. Provide five year manufacturer's warranty for field programmable micro-processor based units.

1.09 MAINTENANCE SERVICE

- A. Provide service and maintenance of energy management and control systems for one years from Date of Substantial Completion.
- B. Provide four complete inspections per year, two in each season, to inspect, calibrate, and adjust controls as required, and submit written reports.
- C. Provide complete service of systems, including call backs. Make minimum of 4 complete normal inspections of approximately 4 hours duration in addition to normal service calls to inspect, calibrate, and adjust controls, and submit written reports.

1.10 EXTRA MATERIALS

- A. See Section 01 60 00 - Product Requirements, for additional provisions.

1.11 PROTECTION OF SOFTWARE RIGHTS

- A. Prior to delivery of software, the Owner and the party providing the software will enter into a software license agreement with provisions for the following:
 - 1. Limiting use of software to equipment provided under these specifications.
 - 2. Limiting copying.
 - 3. Preserving confidentiality.
 - 4. Prohibiting transfer to a third party.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Johnson Controls, Inc: www.johnsoncontrols.com.
- B. Substitutions: Not Permitted.

2.02 SYSTEM DESCRIPTION

- A. Automatic temperature control field monitoring and control system using field programmable micro-processor based units with communications to Building Management System.
- B. Base system on distributed system of fully intelligent, stand-alone controllers, operating in a multi-tasking, multi-user environment on token passing network, with central and remote hardware, software, and interconnecting wire and conduit.
- C. Include computer software and hardware, operator input/output devices, control units, local area networks (LAN), sensors, control devices, actuators.
- D. Controls for variable air volume terminals, radiation, reheat coils, unit heaters, fan coils, and the like when directly connected to the control units. Individual terminal unit control is specified in Section 23 09 13.
- E. Provide control systems consisting of thermostats, control valves, dampers and operators, indicating devices, interface equipment and other apparatus and accessories required to operate mechanical systems, and to perform functions specified.
- F. Include installation and calibration, supervision, adjustments, and fine tuning necessary for complete and fully operational system.

2.03 CONTROLLERS

- A. BUILDING CONTROLLERS
 - 1. General:
 - a. Manage global strategies by one or more, independent, standalone, microprocessor based controllers.
 - b. Provide sufficient memory to support controller's operating system, database, and programming requirements.

- c. Share data between networked controllers.
 - d. Controller operating system manages input and output communication signals allowing distributed controllers to share real and virtual object information and allowing for central monitoring and alarms.
 - e. Utilize real-time clock for scheduling.
 - f. Continuously check processor status and memory circuits for abnormal operation.
 - g. Controller to assume predetermined failure mode and generate alarm notification upon detection of abnormal operation.
 - h. Communication with other network devices to be based on assigned protocol.
 2. Communication:
 - a. Controller to reside on a BACnet network using ISO 8802-3 (ETHERNET) Data Link/Physical layer protocol.
 - b. Perform routing when connected to a network of custom application and application specific controllers.
 - c. Provide service communication port for connection to a portable operator's terminal or hand held device with compatible protocol.
 3. Anticipated Environmental Ambient Conditions:
 - a. Outdoors and/or in Wet Ambient Conditions:
 - 1) Mount within waterproof enclosures.
 - 2) Rated for operation at 40 to 150 degrees F.
 - b. Conditioned Space:
 - 1) Mount within dustproof enclosures.
 - 2) Rated for operation at 32 to 120 degrees F.
 4. Provisions for Serviceability:
 - a. Diagnostic LEDs for power, communication, and processor.
 - b. Make all wiring connections to field removable, modular terminal strips, or to a termination card connected by a ribbon cable.
 5. Memory: In the event of a power loss, maintain all BIOS and programming information for a minimum of 72 hours.
 6. Power and Noise Immunity:
 - a. Maintain operation at 90 to 110 percent of nominal voltage rating.
 - b. Perform orderly shutdown below 80 percent of nominal voltage.
 - c. Operation protected against electrical noise of 5 to 120 Hz and from keyed radios up to 5 W. at 3 feet.
- B. INPUT/OUTPUT INTERFACE**
1. Hardwired inputs and outputs tie into the DDC system through building, custom application, or application specific controllers.
 2. All Input/Output Points:
 - a. Protect controller from damage resulting from any point short-circuiting or grounding and from voltage up to 24 volts of any duration.
 - b. Provide universal type for building and custom application controllers where input or output is software designated as either binary or analog type with appropriate properties.
 3. Binary Inputs:
 - a. Allow monitoring of On/Off signals from remote devices.
 - b. Provide wetting current of 12 mA minimum, compatible with commonly available control devices and protected against the effects of contact bounce and noise.
 - c. Sense dry contact closure with power provided only by the controller.
 4. Pulse Accumulation Input Objects: Conform to all requirements of binary input objects and accept up to 10 pulses per second.
 5. Analog Inputs:

- a. Allow for monitoring of low voltage 0 to 10 VDC, 4 to 20 mA current, or resistance signals (thermistor, RTD).
- b. Compatible with and field configurable to commonly available sensing devices.
6. Binary Outputs:
 - a. Used for On/Off operation or a pulsed low-voltage signal for pulse width modulation control.
 - b. Outputs provided with three position (On/Off/Auto) override switches.
 - c. Status lights for building and custom application controllers to be selectable for normally open or normally closed operation.
7. Analog Outputs:
 - a. Monitoring signal provides a 0 to 10 VDC or a 4 to 20 mA output signal for end device control.
 - b. Provide status lights and two position (AUTO/MANUAL) switch for building and custom application controllers with manually adjustable potentiometer for manual override on building and custom application controllers.
 - c. Drift to not exceed 0.4 percent of range per year.
8. Tri State Outputs:
 - a. Coordinate two binary outputs to control three point, floating type, electronic actuators without feedback.
 - b. Limit the use of three point, floating devices to the following zone and terminal unit control applications:
 - c. Control algorithms run the zone actuator to one end of its stroke once every 24 hours for verification of operator tracking.
9. System Object Capacity:
 - a. System size to be expandable to twice the number of input output objects required by providing additional controllers, including associated devices and wiring.
 - b. Hardware additions or software revisions for the installed operator interfaces are not to be required for future, system expansions.

2.04 POWER SUPPLIES AND LINE FILTERING

- A. Power Supplies:
 1. Provide UL listed control transformers with Class 2 current limiting type or over-current protection in both primary and secondary circuits for Class 2 service as required by the NEC.
 2. Limit connected loads to 80 percent of rated capacity.
 3. Match DC power supply to current output and voltage requirements.
 4. Unit to be full wave rectifier type with output ripple of 5.0 mV maximum peak to peak.
 5. Regulation to be 1 percent combined line and load with 100 microsecond response time for 50 percent load changes.
 6. Provide over-voltage and over-current protection to withstand a 150 percent current overload for 3 seconds minimum without trip-out or failure.
 7. Operational Ambient Conditions: 32 to 120 degrees F.
 8. EM/RF meets FCC Class B and VDE 0871 for Class B and MIL-STD 810 for shock and vibration.
 9. Line voltage units UL recognized and CSA approved.
- B. Power Line Filtering:
 1. Provide external or internal transient voltage and surge suppression component for all workstations and controllers.
 2. Minimum surge protection attributes:
 - a. Dielectric strength of 1000 volts minimum.
 - b. Response time of 10 nanoseconds or less.
 - c. Transverse mode noise attenuation of 65 dB or greater.

- d. Common mode noise attenuation of 150 dB or greater at 40 to 100 Hz.

2.05 CONTROL UNITS

- A. Units: Modular in design and consisting of processor board with programmable RAM memory, local operator access and display panel, and integral interface equipment.
- B. Battery Backup: For minimum of 48 hours for complete system including RAM without interruption, with automatic battery charger.
- C. Control Units Functions:
1. Monitor or control each input/output point.
 2. Completely independent with hardware clock/calendar and software to maintain control independently.
 3. Acquire, process, and transfer information to operator station or other control units on network.
 4. Accept, process, and execute commands from other control unit's or devices or operator stations.
 5. Access both data base and control functions simultaneously.
 6. Record, evaluate, and report changes of state or value that occur among associated points. Continue to perform associated control functions regardless of status of network.
 7. Perform in stand-alone mode:
 - a. Start/stop.
 - b. Duty cycling.
 - c. Automatic Temperature Control.
 - d. Demand control via a sliding window, predictive algorithm.
 - e. Event initiated control.
 - f. Calculated point.
 - g. Scanning and alarm processing.
 - h. Full direct digital control.
 - i. Trend logging.
 - j. Global communications.
 - k. Maintenance scheduling.
- D. Global Communications:
1. Broadcast point data onto network, making that information available to all other system control units.
 2. Transmit any or all input/output points onto network for use by other control units and utilize data from other control units.
- E. Input/Output Capability:
1. Discrete/digital input (contact status).
 2. Discrete/digital output.
 3. Analog input.
 4. Analog output.
 5. Pulse input (5 pulses/second).
 6. Pulse output (0-655 seconds in duration with 0.01 second resolution).
- F. Monitor, control, or address data points. Mix shall include analog inputs, analog outputs, pulse inputs, pulse outputs and discrete inputs/outputs, as required. Install control unit's with minimum 30 percent spare capacity.
- G. Point Scanning: Set scan or execution speed of each point to operator selected time from 1 to 250 seconds.
- H. Upload/Download Capability: Download from or upload to operator station. Upload/Download time for entire control unit database maximum 10 seconds on hard wired LAN, or 60 seconds over voice grade phone lines.

- I. Test Mode Operation: Place input/output points in test mode to allow testing and developing of control algorithms on line without disrupting field hardware and controlled environment. In test mode:
 1. Inhibit scanning and calculation of input points. Issue manual control to input points (set analog or digital input point to operator determined test value) from work station.
 2. Control output points but change only data base state or value; leave external field hardware unchanged.
 3. Enable control actions on output points but change only data base state or value.
- J. Local display and adjustment panel: Portable control unit, containing digital display, and numerical keyboard. Display and adjust:
 1. Input/output point information and status.
 2. Controller set points.
 3. Controller tuning constants.
 4. Program execution times.
 5. High and low limit values.
 6. Limit differential.
 7. Set/display date and time.
 8. Control outputs connected to the network.
 9. Automatic control outputs.
 10. Perform control unit diagnostic testing.
 11. Points in "Test" mode.

2.06 LOCAL AREA NETWORK (LAN)

- A. Provide communication between control units over local area network (LAN).
- B. LAN Capacity: Not less than 100 stations or nodes.
- C. Break in Communication Path: Alarm and automatically initiate LAN reconfiguration.
- D. LAN Data Speed: Minimum 19.2 Kb
- E. Communication Techniques: Allow interface into network by multiple operation stations and by auto-answer/auto-dial modems. Support communication over telephone lines utilizing modems.
- F. Transmission Median: Fiber optic or single pair of solid 24 gauge twisted, shielded copper cable.
- G. Network Support: Time for global point to be received by any station, shall be less than 3 seconds. Provide automatic reconfiguration if any station is added or lost. If transmission cable is cut, reconfigure two sections with no disruption to system's operation, without operator intervention.

2.07 SYSTEM SOFTWARE

- A. Operating System:
 1. Concurrent, multi-tasking capability.
 - a. Common Software Applications Supported: Microsoft Excel.
 2. System Graphics:
 - a. Allow up to 10 graphic screens, simultaneously displayed for comparison and monitoring of system status.
 - b. Animation displayed by shifting image files based on object status.
 - c. Provide method for operator with password to perform the following:
 - 1) Move between, change size, and change location of graphic displays.
 - 2) Modify on-line.
 - 3) Add, delete, or change dynamic objects consisting of:
 - (a) Analog and binary values.
 - (b) Dynamic text.

- (c) Static text.
 - (d) Animation files.
 - 3. Custom Graphics Generation Package:
 - a. Create, modify, and save graphic files and visio format graphics in PCX formats.
 - b. HTML graphics to support web browser compatible formats.
 - c. Capture or convert graphics from AutoCAD.
 - 4. Standard HVAC Graphics Library:
 - a. HVAC Equipment:
 - b. Ancillary Equipment:
- B. Workstation System Applications:
 - 1. Automatic System Database Save and Restore Functions:
 - a. Current database copy of each Building Controller is automatically stored on hard disk.
 - b. Automatic update occurs upon change in any system panel.
 - c. In the event of database loss in any system panel, the first workstation to detect the loss automatically restores the database for that panel unless disabled by the operator.
 - 2. Manual System Database Save and Restore Functions by Operator with Password Clearance:
 - a. Save database from any system panel.
 - b. Clear a panel database.
 - c. Initiate a download of a specified database to any system panel.
 - 3. Software provided allows system configuration and future changes or additions by operators under proper password protection.
 - 4. On-line Help:
 - a. Context-sensitive system assists operator in operation and editing.
 - b. Available for all applications.
 - c. Relevant screen data provided for particular screen display.
 - d. Additional help available via hypertext.
 - 5. Security:
 - a. Operator log-on requires user name and password to view, edit, add, or delete data.
 - b. System security selectable for each operator.
 - c. System supervisor sets passwords and security levels for all other operators.
 - d. Operator passwords to restrict functions accessible to viewing and/or changing system applications, editor, and object.
 - e. Automatic, operator log-off results from keyboard or mouse inactivity during user-adjustable, time period.
 - f. All system security data stored in encrypted format.
 - 6. System Diagnostics:
 - a. Operations Automatically Monitored:
 - 1) Workstations.
 - 2) Printers.
 - 3) Modems.
 - 4) Network connections.
 - 5) Building management panels.
 - 6) Controllers.
 - b. Device failure is annunciated to the operator.
 - 7. Alarm Processing:
 - a. All system objects are configurable to "alarm in" and "alarm out" of normal state.
 - b. Configurable Objects:
 - 1) Alarm limits.

- 2) Alarm limit differentials.
- 3) States.
- 4) Reactions for each object.
8. Alarm Messages:
 - a. Descriptor: English language.
 - b. Recognizable Features:
 - 1) Source.
 - 2) Location.
 - 3) Nature.
9. Configurable Alarm Reactions by Workstation and Time of Day:
 - a. Logging.
 - b. Printing.
 - c. Starting programs.
 - d. Displaying messages.
 - e. Dialing out to remote locations.
 - f. Paging.
 - g. Providing audible annunciation.
 - h. Displaying specific system graphics.
10. Custom Trend Logs:
 - a. Definable for any data object in the system including interval, start time, and stop time.
 - b. Trend Data:
 - 1) Sampled and stored on the building controller panel.
 - 2) Archivable on hard disk.
 - 3) Retrievable for use in reports, spreadsheets and standard database programs.
 - 4) Archival on LAN accessible storage media including hard disk, tape, Raid array drive, and virtual cloud environment.
 - 5) Protected and encrypted format to prevent manipulation, or editing of historical data and event logs.
11. Alarm and Event Log:
 - a. View all system alarms and change of states from any system location.
 - b. Events listed chronologically.
 - c. Operator with proper security acknowledges and clears alarms.
 - d. Alarms not cleared by operator are archived to the workstation hard disk.
12. Object, Property Status and Control:
 - a. Provide a method to view, edit if applicable, the status of any object and property in the system.
 - b. Status Available by the Following Methods:
 - 1) Menu.
 - 2) Graphics.
 - 3) Custom Programs.
13. Reports and Logs:
 - a. Reporting Package:
 - 1) Allows operator to select, modify, or create reports.
 - 2) Definable as to data content, format, interval, and date.
 - 3) Archivable to hard disk.
 - b. Real-time logs available by type or status such as alarm, lockout, normal, etc.
 - c. Stored on hard disk and readily accessible by standard software applications, including spreadsheets and word processing.
 - d. Set to be printed on operator command or specific time(s).
14. Reports:

- a. Standard:
 - 1) Objects with current values.
 - 2) Current alarms not locked out.
 - 3) Disabled and overridden objects, points and SNVTs.
 - 4) Objects in manual or automatic alarm lockout.
 - 5) Objects in alarm lockout currently in alarm.
 - 6) Logs:
 - (a) Alarm History.
 - (b) System messages.
 - (c) System events.
 - (d) Trends.
 - b. Custom:
 - 1) Daily.
 - 2) Weekly.
 - 3) Monthly.
 - 4) Annual.
 - 5) Time and date stamped.
 - 6) Title.
 - 7) Facility name.
 - c. Tenant Override:
 - 1) Monthly report showing total, requested, after-hours HVAC and lighting services on a daily basis for each tenant.
 - 2) Annual report showing override usage on a monthly basis.
 - d. Electrical, Fuel, and Weather:
 - 1) Electrical Meter(s):
 - (a) Monthly showing daily electrical consumption and peak electrical demand with time and date stamp for each meter.
 - (b) Annual summary showing monthly electrical consumption and peak demand with time and date stamp for each meter.
 - 2) Fuel Meter(s):
 - (a) Monthly showing daily natural gas consumption for each meter.
 - (b) Annual summary showing monthly consumption for each meter.
 - 3) Weather:
 - (a) Monthly showing minimum, maximum, average outdoor air temperature and heating/cooling degree-days for the month.
- C. Workstation Applications Editors:
- 1. Provide editing software for all system applications at the PC workstation.
 - 2. Downloaded application is executed at controller panel.
 - 3. Full screen editor for each application allows operator to view and change:
 - a. Configuration.
 - b. Name.
 - c. Control parameters.
 - d. Set-points.
 - 4. Scheduling:
 - a. Monthly calendar indicates schedules, holidays, and exceptions.
 - b. Allows several related objects to be scheduled and copied to other objects or dates.
 - c. Start and stop times adjustable from master schedule.
 - 5. Custom Application Programming:
 - a. Create, modify, debug, edit, compile, and download custom application programming during operation and without disruption of all other system applications.
 - b. Programming Features:

- 1) English oriented language, based on BASIC, FORTRAN, C, or PASCAL syntax allowing for free form programming.
- 2) Alternative language graphically based using appropriate function blocks suitable for all required functions and amenable to customizing or compounding.
- 3) Insert, add, modify, and delete custom programming code that incorporates word processing features such as cut/paste and find/replace.
- 4) Allows the development of independently, executing, program modules designed to enable and disable other modules.
- 5) Debugging/simulation capability that displays intermediate values and/or results including syntax/execution error messages.
- 6) Support for conditional statements (IF/THEN/ELSE/ELSE-F) using compound Boolean (AND, OR, and NOT) and/or relations (EQUAL, LESS THAN, GREATER THAN, NOT EQUAL) comparisons.
- 7) Support for floating-point arithmetic utilizing plus, minus, divide, times, square root operators; including absolute value; minimum/maximum value from a list of values for mathematical functions.
- 8) Language consisting of resettable, predefined, variables representing time of day, day of the week, month of the year, date; and elapsed time in seconds, minutes, hours, and days where the variable values can be used in IF/THEN comparisons, calculations, programming statement logic, etc.
- 9) Language having predefined variables representing status and results of the system software enables, disables, and changes the set points of the controller software.

2.08 CONTROLLER SOFTWARE

- A. All applications reside and operate in the system controllers and editing of all applications occurs at the operator workstation.
- B. System Security:
 1. User access secured via user passwords and user names.
 2. Passwords restrict user to the objects, applications, and system functions as assigned by the system manager.
 3. User Log On/Log Off attempts are recorded.
 4. Automatic Log Off occurs following the last keystroke after a user defined delay time.
- C. Object or Object Group Scheduling:
 1. Weekly Schedules Based on Separate, Daily Schedules:
 - a. Include start, stop, optimal stop, and night economizer.
 - b. 10 events maximum per schedule.
 - c. Start/stop times adjustable for each group object.
- D. Provide standard application for equipment coordination and grouping based on function and location to be used for scheduling and other applications.
- E. Alarms:
 1. Binary object is set to alarm based on the operator specified state.
 2. Analog object to have high/low alarm limits.
 3. All alarming is capable of being automatically and manually disabled.
 4. Alarm Reporting:
 - a. Operator determines action to be taken for alarm event.
 - b. Alarms to be routed to appropriate workstation.
 - c. Reporting Options:
- F. Maintenance Management: System monitors equipment status and generates maintenance messages based upon user-designated run-time limits.

- G. Sequencing: Application software based upon specified sequences of operation in Section 23 09 93.
- H. PID Control Characteristics:
 - 1. Direct or reverse action.
 - 2. Anti-windup.
 - 3. Calculated, time-varying, analog value, positions an output or stages a series of outputs.
 - 4. User selectable controlled variable, set-point, and PED gains.
- I. Staggered Start Application:
 - 1. Prevents all controlled equipment from simultaneously restarting after power outage.
 - 2. Order of equipment startup is user selectable.
- J. Energy Calculations:
 - 1. Accumulated instantaneous power or flow rates are converted to energy use data.
 - 2. Algorithm calculates a rolling average and allows window of time to be user specified in minute intervals.
 - 3. Algorithm calculates a fixed window average with a digital input signal from a utility meter defining the start of the window period that in turn synchronizes the fixed-window average with that used by the power company.
- K. Anti-Short Cycling:
 - 1. All binary output objects protected from short-cycling.
 - 2. Allows minimum on-time and off-time to be selected.
- L. On-Off Control with Differential:
 - 1. Algorithm allows binary output to be cycled based on a controlled variable and set-point.
 - 2. Algorithm to be direct-acting or reverse-acting incorporating an adjustable differential.
- M. Run-Time Totalization:
 - 1. Totalize run-times for all binary input objects.
 - 2. Provides operator with capability to assign high run-time alarm.

2.09 OPERATING SYSTEM SOFTWARE

- A. Input/Output Capability From Operator Station:
 - 1. Request display of current values or status in tabular or graphic format.
 - 2. Command selected equipment to specified state.
 - 3. Initiate logs and reports.
 - 4. Change analog limits.
 - 5. Add, delete, or change points within each control unit or application routine.
 - 6. Change point input/output descriptors, status, alarm descriptors, and engineering unit descriptors.
 - 7. Add new control units to system.
 - 8. Modify and set up maintenance scheduling parameters.
 - 9. Develop, modify, delete or display full range of color graphic displays.
 - 10. Automatically archive select data even when running third party software.
 - 11. Provide capability to sort and extract data from archived files and to generate custom reports.
 - 12. Support two printer operations.
 - a. Alarm printer: Print alarms, operator acknowledgements, action messages, system alarms, operator sign-on and sign-off.
 - b. Data printer: Print reports, page prints, and data base prints.
 - 13. Select daily, weekly or monthly as scheduled frequency to synchronize time and date in digital control units. Accommodate daylight savings time adjustments.
 - 14. Print selected control unit data base.

- B. Operator System Access: Via software password with minimum 30 access levels at work station and minimum 3 access levels at each control unit.
- C. Data Base Creation and Support: Changes shall utilize standard procedures. Control unit shall automatically check work station data base files upon connection and verify data base match. Minimum capability shall include:
1. Add and delete points.
 2. Modify any point parameter.
 3. Change, add, or delete English language descriptors.
 4. Add, modify, or delete alarm limits.
 5. Add, modify, or delete points in start/stop programs, trend logs, etc.
 6. Create custom relationship between points.
 7. Create or modify DDC loops and parameters.
 8. Create or modify override parameters.
 9. Add, modify, and delete any applications program.
 10. Add, delete, develop, or modify dynamic color graphic displays.
- D. Dynamic Color Graphic Displays:
1. Utilizes custom symbols or system supported library of symbols.
 2. Sixteen (16) colors.
 3. Sixty (60) outputs of real time, live dynamic data per graphic.
 4. Dynamic graphic data.
 5. 1,000 separate graphic pages.
 6. Modify graphic screen refresh rate between 1 and 60 seconds.
- E. Operator Station:
1. Accept data from LAN as needed without scanning entire network for updated point data.
 2. Interrogate LAN for updated point data when requested.
 3. Allow operator command of devices.
 4. Allow operator to place specific control units in or out of service.
 5. Allow parameter editing of control units.
 6. Store duplicate data base for every control unit and allow down loading while system is on line.
 7. Control or modify specific programs.
 8. Develop, store and modify dynamic color graphics.
 9. Provide data archiving of assigned points and support overlay graphing of this data utilizing up to four (4) variables.
- F. Alarm Processing:
1. Off normal condition: Cause alarm and appropriate message, including time, system, point descriptor, and alarm condition. Select alarm state/value and which alarms shall cause automatic dial-out.
 2. Critical alarm or change-of-state: Display message, stored on disk for review and sort, or print.
 3. Print on line changeable message, up to 100 characters in length, for each alarm point specified.
 4. Display alarm reports on video. Display multiple alarms in order of occurrence.
 5. Define time delay for equipment start-up or shutdown.
 6. Allow unique routing of specific alarms.
 7. Operator specifies if alarm requires acknowledgement.
 8. Continue to indicate unacknowledged alarms after return to normal.
 9. Alarm notification:
 - a. Automatic print.
 - b. Display indicating alarm condition.

- c. Selectable audible alarm indication.
- G. Event Processing: Automatically initiate commands, user defined messages, take specific control actions or change control strategy and application programs resulting from event condition. Event condition may be value crossing operator defined limit, change-of-state, specified state, or alarm occurrence or return to normal.
- H. Automatic Restart: Automatically restart field equipment on restoration of power. Provide time delay between individual equipment restart and time of day start/stop.
- I. Messages:
 - 1. Automatically display or print user-defined message subsequent to occurrence of selected events.
 - 2. Compose, change, or delete any message.
 - 3. Display or log any message at any time.
 - 4. Assign any message to any event.
- J. Reports:
 - 1. Manually requested with time and date.
 - 2. Long term data archiving to hard disk.
 - 3. Automatic directives to download to transportable media such as floppy diskettes for storage.
 - 4. Data selection methods to include data base search and manipulation.
 - 5. Data extraction with mathematical manipulation.
 - 6. Data reports shall allow development of XY curve plotting, tabular reports (both statistical and summary), and multi-point timed based plots with not less than four (4) variables displayed.
 - 7. Generating reports either normally at operator direction, or automatically under work station direction.
 - 8. Reports may either manually displayed or printed, or may be printed automatically on daily, weekly, monthly, yearly or scheduled basis.
 - 9. Include capability for statistical data manipulation and extraction.
 - 10. Provide capability to generate four types of reports: Statistical detail reports, summary reports, trend graphic plots, x-y graphic plots.
- K. Parameter Save/Restore: Store most current operating system, parameter changes, and modifications on disk or diskette.
- L. Data Collection:
 - 1. Automatically collect and store in disk files.
 - 2. Daily electrical energy consumption, peak demand, and time of peak demand for up to electrical meters over 2 year period.
 - 3. Daily consumption for up to 30 meters over a 2 year period.
 - 4. Daily billable electrical energy consumption and time for up to 1024 zones over a 10 year period.
 - 5. Provide archiving of stored data for use with system supplied custom reports.
- M. Graphic Display: Support graphic development on work station with software features:
 - 1. Page linking.
 - 2. Generate, store, and retrieve library symbols.
 - 3. Single or double height characters.
 - 4. Sixty (60) dynamic points of data per graphic page.
 - 5. Pixel level resolution.
 - 6. Animated graphics for discrete points.
 - 7. Analog bar graphs.
 - 8. Display real time value of each input or output line diagram fashion.

- N. Maintenance Management:
 - 1. Run time monitoring, per point.
 - 2. Maintenance scheduling targets with automatic annunciation, scheduling and shutdown.
 - 3. Equipment safety targets.
 - 4. Display of maintenance material and estimated labor.
 - 5. Target point reset, per point.
- O. Advisories:
 - 1. Summary which contains status of points in locked out condition.
 - 2. Continuous operational or not operational report of interrogation of system hardware and programmable control units for failure.
 - 3. Report of power failure detection, time and date.
 - 4. Report of communication failure with operator device, field interface unit, point, programmable control unit.

2.10 LOAD CONTROL PROGRAMS

- A. General: Support inch-pounds and SI (metric) units of measurement.
- B. Demand Limiting:
 - 1. Monitor total power consumption per power meter and shed associated loads automatically to reduce power consumption to an operator set maximum demand level.
 - 2. Input: Pulse count from incoming power meter connected to pulse accumulator in control unit.
 - 3. Forecast demand (kW): Predicted by sliding window method.
 - 4. Automatically shed loads throughout the demand interval selecting loads with independently adjustable on and off time of between one and 255 minutes.
 - 5. Demand Target: Minimum of 3 per demand meter; change targets based upon (1) time, (2) status of pre-selected points, or (3) temperature.
 - 6. Load: Assign load shed priority, minimum "ON" time and maximum "OFF" time.
 - 7. Limits: Include control band (upper and lower limits).
 - 8. Output advisory if loads are not available to satisfy required shed amount, advise shed requirements and requiring operator acknowledgement.
- C. Duty Cycling:
 - 1. Periodically stop and start loads, based on space temperature, and according to various On/Off patterns.
 - 2. Modify off portion of cycle based on operator specified comfort parameters. Maintain total cycle time by increasing on portion of cycle by same amount that off portion is reduced.
 - 3. Set and modify following parameters for each individual load.
 - a. Minimum and maximum Off time.
 - b. On/Off time in one minute increments.
 - c. Time period from beginning of interval until load can be cycled.
 - d. Manually override the DCC program and place a load in an On or Off state.
 - e. Cooling Target Temperature and Differential.
 - f. Heating Target Temperature and Differential.
 - g. Cycle off adjustment.
- D. Automatic Time Scheduling:
 - 1. Self-contained programs for automatic start/stop/scheduling of building loads.
 - 2. Support up to seven (7) normal day schedules, seven (7) "special day" schedules and two (2) temporary day schedules.
 - 3. Special days schedule shall support up to 30 unique date/duration combinations.
 - 4. Any number of loads assigned to any time program; each load can have individual time program.

5. Each load assigned at least 16 control actions per day with 1 minute resolution.
6. Time schedule operations may be:
 - a. Start.
 - b. Optimized Start.
 - c. Stop.
 - d. Optimized Stop.
 - e. Cycle.
 - f. Optimized Cycle.
7. Minimum of 30 holiday periods up to 100 days in length may be specified for the year.
8. Create temporary schedules.
9. Broadcast temporary "special day" date and duration.
- E. Start/Stop Time Optimization:
 1. Perform optimized start/stop as function of outside conditions, inside conditions, or both.
 2. Adaptive and self-tuning, adjusting to changing conditions unattended.
 3. For each point under control, establish and modify:
 - a. Occupancy period.
 - b. Desired temperature at beginning of occupancy period.
 - c. Desired temperature at end of occupancy period.
- F. Night Setback/Setup Program: Reduce heating space temperature setpoint or raise cooling space temperature setpoint during unoccupied hours; in conjunction with scheduled start/stop and optimum start/stop programs.
- G. Calculated Points: Define calculations and totalization computed from monitored points (analog/digital points), constants, or other calculated points.
 1. Employ arithmetic, algebraic, Boolean, and special function operations.
 2. Treat calculated values like any other analog value, use for any function that a "hard wired point" might be used.
- H. Event Initiated Programming: Event may be initiated by any data point, causing series of controls in a sequence.
 1. Define time interval between each control action between 0 to 3600 seconds.
 2. Output may be analog value.
 3. Provide for "skip" logic.
 4. Verify completion of one action before proceeding to next. If not verified, program shall be able to skip to next action.
- I. Direct Digital Control: Each control unit shall provide Direct Digital Control software so that the operator may customize control strategies and sequences of operation by defining the appropriate control loop algorithms and choosing the optimum loop parameters.
 1. Control loops: Defined using "modules" that are analogous to standard control devices.
 2. Output: Paired or individual digital outputs for pulse-width modulation, and analog outputs, as required.
 3. Firmware:
 - a. PID with analog or pulse-width modulation output.
 - b. Floating control with pulse-width modulated outputs.
 - c. Two-position control.
 - d. Primary and secondary reset schedule selector.
 - e. Hi/Lo signal selector.
 - f. Single pole double throw relay.
 - g. Single pole double throw time delay relay with delay before break, delay before make and interval time capabilities.
 4. Direct Digital Control loops: Downloaded upon creation or on operator request. On sensor failure, program shall execute user defined failsafe output.

5. Display: Value or state of each of the lines which interconnect DDC modules.
- J. Fine Tuning Direct Digital Control PID or floating loops:
 1. Display information:
 - a. Control loop being tuned
 - b. Input (process) variable
 - c. Output (control) variable
 - d. Setpoint of loop
 - e. Proportional band
 - f. Integral (reset) Interval
 - g. Derivative (rate) Interval
 2. Display format: Graphic, with automatic scaling; with input and output variable superimposed on graph of "time" vs "variable".
- K. Trend logging:
 1. Each control unit will store samples of control unit's data points.
 2. Update file continuously at discretely assignable intervals.
 3. Automatically initiate upload request and then store data on hard disk.
 4. Time synchronize sampling at operator specified times and intervals with sample resolution of one minute.
 5. Co-ordinate sampling with on/off state of specified point.
 6. Display trend samples on work station in graphic format. Automatically scale trend graph with minimum 60 samples of data in plot of time vs data.

2.11 HVAC CONTROL PROGRAMS

- A. General:
 1. Support Inch-pounds and SI (metric) units of measurement.
 2. Identify each HVAC Control system.
- B. Optimal Run Time:
 1. Control start-up and shutdown times of HVAC equipment for both heating and cooling.
 2. Base on occupancy schedules, outside air temperature, seasonal requirements, and interior room mass temperature.
 3. Start-up systems by using outside air temperature, room mass temperatures, and adaptive model prediction for how long building takes to warm up or cool down under different conditions.
 4. Use outside air temperature to determine early shut down with ventilation override.
 5. Analyze multiple building mass sensors to determine seasonal mode and worse case condition for each day.
 6. Operator commands:
 - a. Define term schedule
 - b. Add/delete fan status point.
 - c. Add/delete outside air temperature point.
 - d. Add/delete mass temperature point.
 - e. Define heating/cooling parameters.
 - f. Define mass sensor heating/cooling parameters.
 - g. Lock/unlock program.
 - h. Request optimal run time control summary.
 - i. Request optimal run time mass temperature summary.
 - j. Request HVAC point summary.
 - k. Request HVAC saving profile summary.
 7. Control Summary:
 - a. HVAC Control system begin/end status.
 - b. Optimal run time lock/unlock control status.

- c. Heating/cooling mode status.
- d. Optimal run time schedule.
- e. Start/Stop times.
- f. Selected mass temperature point ID.
- g. Optimal run time system normal start times.
- h. Occupancy and vacancy times.
- i. Optimal run time system heating/cooling mode parameters.
8. Mass temperature summary:
 - a. Mass temperature point type and ID.
 - b. Desired and current mass temperature values.
 - c. Calculated warm-up/cool-down time for each mass temperature.
 - d. Heating/cooling season limits.
 - e. Break point temperature for cooling mode analysis.
9. HVAC point summary:
 - a. Control system identifier and status.
 - b. Point ID and status.
 - c. Outside air temperature point ID and status.
 - d. Mass temperature point ID and point.
 - e. Calculated optimal start and stop times.
 - f. Period start.
- C. Supply Air Reset:
 1. Monitor heating and cooling loads in building spaces, terminal reheat systems, both hot deck and cold deck temperatures on dual duct and multizone systems, single zone unit discharge temperatures.
 2. Adjust discharge temperatures to most energy efficient levels satisfying measured load by:
 - a. Raising cooling temperatures to highest possible value.
 - b. Reducing heating temperatures to lowest possible level.
 3. Operator commands:
 - a. Add/delete fan status point.
 - b. Lock/unlock program.
 - c. Request HVAC point summary.
 - d. Add/Delete discharge controller point.
 - e. Define discharge controller parameters.
 - f. Add/delete air flow rate.
 - g. Define space load and load parameters.
 - h. Request space load summary.
 4. Control summary:
 - a. HVAC control system status (begin/end).
 - b. Supply air reset system status.
 - c. Optimal run time system status.
 - d. Heating and cooling loop.
 - e. High/low limits.
 - f. Deadband.
 - g. Response timer.
 - h. Reset times.
 5. Space load summary:
 - a. HVAC system status.
 - b. Optimal run time status.
 - c. Heating/cooling loop status.
 - d. Space load point ID.
 - e. Current space load point value.

- f. Control heat/cool limited.
 - g. Gain factor.
 - h. Calculated reset values.
 - i. Fan status point ID and status.
 - j. Control discharge temperature point ID and status.
 - k. Space load point ID and status.
 - l. Air flow rate point ID and status.
- D. Enthalpy Switchover:
- 1. Calculate outside and return air enthalpy using measured temperature and relative humidity; determine energy expended and control outside and return air dampers.
 - 2. Operator commands:
 - a. Add/delete fan status point.
 - b. Add/delete outside air temperature point.
 - c. Add/delete discharge controller point.
 - d. Define discharge controller parameters.
 - e. Add/delete return air temperature point.
 - f. Add/delete outside air dew point/humidity point.
 - g. Add/delete return air dew point/humidity point.
 - h. Add/delete damper switch.
 - i. Add/delete minimum outside air.
 - j. Add/delete atmospheric pressure.
 - k. Add/delete heating override switch.
 - l. Add/delete evaporative cooling switch.
 - m. Add/delete air flow rate.
 - n. Define enthalpy deadband.
 - o. Lock/unlock program.
 - p. Request control summary.
 - q. Request HVAC point summary.
 - 3. Control summary:
 - a. HVAC control system begin/end status.
 - b. Enthalpy switchover optimal system status.
 - c. Optimal return time system status.
 - d. Current outside air enthalpy.
 - e. Calculated mixed air enthalpy.
 - f. Calculated cooling coil enthalpy using outside air.
 - g. Calculated cooling coil enthalpy using mixed air.
 - h. Calculated enthalpy difference.
 - i. Enthalpy switchover deadband.
 - j. Status of damper mode switch.

2.12 PROGRAMMING APPLICATION FEATURES

- A. Trend Point:
- 1. Sample up to 150 points, real or computed, with each point capable of collecting 100 samples at intervals specified in minutes, hours, days, or month.
 - 2. Output trend logs as line graphs or bar graphs. Output graphic on terminal, with each point for line and bar graphs designated with a unique pattern, vertical scale either actual values or percent of range, and horizontal scale time base. Print trend logs up to 12 columns of one point/column.
- B. Alarm Messages:
- 1. Allow definition of minimum of 100 messages, each having minimum length of 100 characters for each individual message.

2. Assign alarm messages to system messages including point's alarm condition, point's off-normal condition, totalized point's warning limit, hardware elements advisories.
 3. Output assigned alarm with "message requiring acknowledgement".
 4. Operator commands include define, modify, or delete; output summary listing current alarms and assignments; output summary defining assigned points.
- C. Weekly Scheduling:
1. Automatically initiate equipment or system commands, based on preselected time schedule for points specified.
 2. Provide program times for each day of week, per point, with one minute resolution.
 3. Automatically generate alarm output for points not responding to command.
 4. Provide for holidays, minimum of 366 consecutive holidays.
 5. Operator commands:
 - a. System logs and summaries.
 - b. Start of stop point.
 - c. Lock or unlock control or alarm input.
 - d. Add, delete, or modify analog limits and differentials.
 - e. Adjust point operation position.
 - f. Change point operational mode.
 - g. Open or close point.
 - h. Enable/disable, lock/unlock, or execute interlock sequence or computation profile.
 - i. Begin or end point totalization.
 - j. Modify totalization values and limits.
 - k. Access or secure point.
 - l. Begin or end HVAC or load control system.
 - m. Modify load parameter.
 - n. Modify demand limiting and duty cycle targets.
 6. Output summary: Listing of programmed function points, associated program times, and respective day of week programmed points by software groups or time of day.
- D. Interlocking:
1. Permit events to occur, based on changing condition of one or more associated master points.
 2. Binary contact, high/low limit of analog point or computed point shall be capable of being utilized as master. Same master may monitor or command multiple slaves.
 3. Operator commands:
 - a. Define single master/multiple master interlock process.
 - b. Define logic interlock process.
 - c. Lock/unlock program.
 - d. Enable/disable interlock process.
 - e. Execute terminate interlock process.
 - f. Request interlock type summary.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify existing conditions before starting work.
- B. Verify that conditioned power supply is available to the control units and to the operator work station. Verify that field end devices, wiring, and pneumatic tubing is installed prior to installation proceeding.

3.02 INSTALLATION

- A. Install control units and other hardware in position on permanent walls where not subject to excessive vibration.

- B. Install software in control units and in operator work station. Implement all features of programs to specified requirements and appropriate to sequence of operation. Refer to Section 23 09 93.
- C. Provide with 120v AC, 15 amp dedicated emergency power circuit to each programmable control unit.
- D. Provide conduit and electrical wiring in accordance with Section 26 27 17. Electrical material and installation shall be in accordance with appropriate requirements of Division 26.
- E. Ensure that all components necessary to execute the sequences of operation are coordinated and installed by all contractors.
- F. Contractor shall demolish and remove all existing control components, including but not limited to thermostats, pneumatic tubing, compressors, panels, and devices unless otherwise noted on the drawings. Demolition shall be coordinated on phased projects to maintain the existing system where needed until complete charge-over has been accomplished.

3.03 MANUFACTURER'S FIELD SERVICES

- A. Start and commission systems. Allow sufficient time for start-up and commissioning prior to placing control systems in permanent operation.
- B. Provide service engineer to instruct Owner's representative in operation of systems plant and equipment for 2 day period.
- C. Provide basic operator training for 4 persons on data display, alarm and status descriptors, requesting data, execution of commands and request of logs. Include a minimum of 8 hours dedicated instructor time. Provide training on site.

3.04 DEMONSTRATION AND INSTRUCTIONS

- A. Demonstrate complete and operating system to Owner.

3.05 SCHEDULES

- A. Input/Output Schedule:
 - 1. Point Description:
 - 2. Digital Input:
 - a. Demand Meter (kW)
 - b. Auxiliary Contact:
 - c. Switches:
 - 1) Switch Closing:
 - 2) Flow Switch:
 - 3) Optical:
 - d. Current:
 - e. Pressure:
 - 3. Digital Output:
 - a. Control Relay:
 - b. Solenoid:
 - c. Contactor:
 - 4. Analog Input:
 - a. Temperature:
 - b. Relative Humidity:
 - c. Pressure/Vacuum:
 - d. Filter:
 - e. Flow:
 - f. Current:
 - g. Liquid Level:
 - h. Photocell:

5. Analog Output:
 - a. Pneumatic Transducer:
 - b. 4-20 ma Module:
 - c. 0-16 v DC:
6. Alarm:
- B. Input/Output Schedule:
 1. Point Description:
 2. Inputs:
 - a. Temperature:
 - b. Relative Humidity:
 - c. Pressure:
 - d. Flow:
 - e. Level:
 - f. Position:
 - g. Energy:
 - h. Power:
 3. Outputs:
 - a. Status:
 - b. Alarm:
 - c. Pneumatic Position:
 - d. Electronic Position:
 - e. Set Point Adjust:
 - f. Start/Stop:
 - g. Off/Low/High:
 4. Software Features:
 - a. PID Control (DDC):
 - b. High Limit:
 - c. Low Limit:
 - d. Run Time Totalization:
 - e. Consumption Totalization:
 - f. Program Start/Stop:
 - g. Load Shed:
 - h. Duty Cycle:
 - i. Enthalpy Switchover:
 - j. Optimal Run Time:
 - k. Supply Air Reset:
 - l. O.A. Interlock:
 - m. O.A. Temperature Reset:
 - n. Free Cooling Mode:
 - o. Warm-up Mode:
 - p. Boiler Interlock:
 - q. Chiller Sequencing:
 - r. Energy Calculation:
- C. Alarm Schedule:
 1. High Limit: A1.
 2. Low Limit: A2.
 3. Run Time: A3.
 4. Maintenance: A4.
 5. Status: A5.
 6. Override: A6.

NOT FOR BIDDING PURPOSES

7. Freeze: A7.
8. Low Pressure: A8.

END OF SECTION

NOT FOR BIDDING PURPOSES

NOT FOR BIDDING PURPOSES

SECTION 23 09 93

SEQUENCE OF OPERATIONS FOR HVAC CONTROLS

SECTION PROVIDED FOR REFERENCE ONLY. BUILDING AUTOMATION SYSTEM/CONTROLS PACKAGE PURCHASED UNDER SEPARATE CONTRACT.

1.01 PART 1 GENERAL

1.02 THIS SECTION DEFINES THE OPERATING PARAMETERS FOR THE BUILDIGN AUTOMATION SYSTEM EXPANSION, PURCHASED UNDER SEPARATE CONTRACT BY THE OWNER. CONTRACTOR SHALL ENSURE THAT ALL REQUIRED CONTROL POINTS ARE AVAILALBE AND THAT THE SEQUENCE OF OPERATION CAN BE EXECUTED IN THE EVENT THAT FACTORY-PROVIDED CONTROLLERS ARE USED ON ANY EQUIPMENT.

1.03 SECTION INCLUDES

- A. This section defines the manner and method by which controls function. Requirements for each type of control system operation are specified. Equipment, devices, and system components required for control systems are specified in other sections.
- B. Sequence of operation for:
 - 1. Chilled Water Water Generation

1.04 RELATED SECTIONS

- A. Section 23 09 23 - Direct-Digital Control System for HVAC.
- B. Section 23 09 13 - Instrumentation and Control Devices for HVAC.
- C. Section 26 27 17 - Equipment Wiring: Electrical characteristics and wiring connections.

1.05 SYSTEM DESCRIPTION

- A. This Section defines the manner and method by which controls function. Requirements for each type of control system operation are specified. Equipment, devices, and system components required for control systems are specified in other Sections.

1.06 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Sequence of Operation Documentation: Submit written sequence of operation for entire HVAC system and each piece of equipment.
 - 1. Preface: 1 or 2 paragraph overview narrative of the system describing its purpose, components and function.
 - 2. State each sequence in small segments and give each segment a unique number for referencing in Functional Test procedures; provide a complete description regardless of the completeness and clarity of the sequences specified in the contract documents.
 - 3. Include at least the following sequences:
 - a. Start-up.
 - b. Warm-up mode.
 - c. Normal operating mode.
 - d. Unoccupied mode.
 - e. Shutdown.
 - f. Capacity control sequences and equipment staging.
 - g. Temperature and pressure control, such as setbacks, setups, resets, etc.
 - h. Detailed sequences for all control strategies, such as economizer control, optimum start/stop, staging, optimization, demand limiting, etc.
 - i. Effects of power or equipment failure with all standby component functions.
 - j. Sequences for all alarms and emergency shut downs.
 - k. Seasonal operational differences and recommendations.

- I. Interactions and interlocks with other systems.
4. Include initial and recommended values for all adjustable settings, setpoints and parameters that are typically set or adjusted by operating staff; and any other control settings or fixed values, delays, etc. that will be useful during testing and operating the equipment.
5. For packaged controlled equipment, include manufacturer's furnished sequence of operation amplified as required to describe the relationship between the packaged controls and the control system, indicating which points are adjustable control points and which points are only monitored.
6. Include schedules, if known.
- C. Control System Diagrams: Submit graphic schematic of the control system showing each control component and each component controlled, monitored, or enabled.
 1. Label with settings, adjustable range of control and limits.
 2. Include flow diagrams for each control system, graphically depicting control logic.
 3. Include the system and component layout of all equipment that the control system monitors, enables or controls, even if the equipment is primarily controlled by packaged or integral controls.
 4. Include draft copies of graphic displays indicating mechanical system components, control system components, and controlled function status and value.
 5. Include all monitoring, control and virtual points specified in elsewhere.
 6. Include a key to all abbreviations.
- D. Points List: Submit list of all control points indicating at least the following for each point.
 1. Name of controlled system.
 2. Point abbreviation.
 3. Point description; such as dry bulb temperature, airflow, etc.
 4. Display unit.
 5. Control point or setpoint (Yes / No); i.e. a point that controls equipment and can have its setpoint changed.
 6. Monitoring point (Yes / No); i.e. a point that does not control or contribute to the control of equipment but is used for operation, maintenance, or performance verification.
 7. Intermediate point (Yes / No); i.e. a point whose value is used to make a calculation which then controls equipment, such as space temperatures that are averaged to a virtual point to control reset.
 8. Calculated point (Yes / No); i.e. a "virtual" point generated from calculations of other point values.
- E. Project Record Documents: Record actual locations of components and setpoints of controls, including changes to sequences made after submission of shop drawings.

1.07 QUALITY ASSURANCE

- A. Design system under direct supervision of a Professional Engineer experienced in design of this Work and licensed in the State in which the Project is located.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION

3.01 GENERAL SYSTEM DESIGN AND OPERATION STANDARDS

- A. The BAS shall control the new air cooled chiller to provide chilled water to the dual-temperature, variable-flow distribution system via a primary/secondary piping arrangement. A new DDC controller shall be installed to provide full integration of the chiller with the existing BAS.

3.02 CHILLED WATER SYSTEM

- A. General

1. The chilled water system shall be manually enabled based on the time of day, outdoor air conditions, and the system demand.
 2. Cooling lockout shall prevent chilled water system from operating if outdoor air temperature falls below 55 °F (adj.).
- B. Secondary (Building) Water Loop Pumps
1. Whenever the chiller is enabled, the primary chilled water pump shall be enabled to run continuously. The pump may also be manually enabled and disabled from the operator's terminal.
 2. On a loss of flow as detected by the chiller differential pressure switch, a "cooling water loop failure" shall be indicated at the operator's terminal.
- C. Air Cooled Chiller
1. Whenever the chiller is enabled, the primary chilled water pump shall be enabled to run continuously. The pump may also be manually enabled and disabled from the operator's terminal.
 2. The building automation system shall communicate directly with the chiller's factory installed BAS interface. At a minimum, the BAS shall monitor / control the following points:
 - a. Leaving water temperature setpoint adjustment.
 - b. VFD status and operating level.
 - c. All operating codes in English (numbered codes are not acceptable).
 - d. All diagnostic codes in English (numbered codes are not acceptable).
 - e. All monitoring information, including but not limited to supply water temperature (chilled water, condenser water, and heating water), return water temperature (chilled water, condenser water, and heating water), water setpoints, percentage of chiller capacity being used, refrigerant pressure alarms, operating alarms etc.
 3. The chiller's factory controls shall modulate and stage compressors to maintain the desired chilled water discharge temperature, 45 °F(adj.).
 4. When the chiller is disabled, the primary chilled water pump shall be de-energized.
- D. Chilled Water System Monitoring
1. In addition to the interface points listed above, the following points shall be monitored by the BAS via sensors, which are provided by the BAS contractor:
 2. Primary Loop Supply Temperature (Air Cooled Chiller Loop and Absorption Chiller Loop)
 3. Primary Loop Return Temperature (Air Cooled Chiller Loop and Absorption Chiller Loop)
 4. Secondary (Building) Loop Supply Temperature
 5. Secondary (Building) Loop Return Temperature
 6. Primary and secondary pumping flow status
 7. Secondary pump differential pressure
 8. Secondary pump differential pressure setpoint
 9. Make-up water system status
 10. Air cooled chiller status, errors, and alarm status
 11. Diagram showing the layout of the central plant, chilled water loop, CCHP loops, and building loop with major components and dynamic temperatures shown where temperature sensors exist in the system

END OF SECTION

NOT FOR BIDDING PURPOSES

SECTION 23 25 00
HVAC WATER TREATMENT

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Cleaning of piping systems.

1.02 RELATED REQUIREMENTS

- A. Section 23 21 13 - Hydronic Piping.
- B. Section 23 21 14 - Hydronic Specialties.
- C. Section 23 09 13 - Instrumentation and Control Devices for HVAC.
- D. Section 26 27 17 - Equipment Wiring: Electrical characteristics and wiring connections.

1.03 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide chemical treatment materials, chemicals, and equipment including electrical characteristics and connection requirements.
- C. Shop Drawings: Indicate system schematic, equipment locations, and controls schematics, electrical characteristics and connection requirements.
- D. Manufacturer's Installation Instructions: Indicate placement of equipment in systems, piping configuration, and connection requirements.
- E. Manufacturer's Field Reports: Indicate start-up of treatment systems when completed and operating properly. Indicate analysis of system water after cleaning and after treatment.
- F. Certificate: Submit certificate of compliance from authority having jurisdiction indicating approval of chemicals and their proposed disposal.
- G. Project Record Documents: Record actual locations of equipment and piping, including sampling points and location of chemical injectors.
- H. Operation and Maintenance Data: Include data on chemical feed pumps, agitators, and other equipment including spare parts lists, procedures, and treatment programs. Include step by step instructions on test procedures including target concentrations.

1.04 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing the type of products specified in this section, with minimum ten years of documented experience. Company shall have local representatives with water analysis laboratories and full time service personnel.
- B. Installer Qualifications: Company specializing in performing the type of work specified in this section, with minimum five years of documented experience and approved by manufacturer.

1.05 REGULATORY REQUIREMENTS

- A. Conform to applicable code for addition of non-potable chemicals to building mechanical systems and to public sewage systems.
- B. Products Requiring Electrical Connection: Listed and classified by UL as suitable for the purpose specified and indicated.

1.06 MAINTENANCE SERVICE

- A. Furnish service and maintenance of treatment systems for one year from Date of Substantial Completion.

- B. Provide monthly technical service visits to perform field inspections and make water analysis on site. Detail findings in writing on proper practices, chemical treating requirements, and corrective actions needed. Submit two copies of field service report after each visit.
- C. Provide laboratory and technical assistance services during this maintenance period.
- D. Include four hour training course for operating personnel, instructing them on installation, care, maintenance, testing, and operation of water treatment systems. Arrange course at start up of systems.
- E. Provide on site inspections of equipment during scheduled or emergency shutdown to properly evaluate success of water treatment program, and make recommendations in writing based upon these inspections.

1.07 MAINTENANCE MATERIALS

- A. See Section 01 60 00 - Product Requirements, for additional provisions.
- B. Supply sufficient chemicals for treatment and testing during warranty period.

PART 2 PRODUCTS

2.01 MATERIALS

- A. System Cleaner:
 - 1. Manufacturers:
 - a. AmSolv/Division of Amrep, Inc: www.amsolv.com.
 - b. GE Water Technologies: www.gewater.com.
 - c. Nalco Company: www.nalco.com.
 - d. Substitutions: See Section 01 60 00 - Product Requirements.
 - 2. Liquid alkaline compound with emulsifying agents and detergents to remove grease and petroleum products.
 - 3. Biocide chlorine release agents such as sodium hypochlorite or calcium hypochlorite or microbiocides such as quarternary ammonia compounds, tributyl tin oxide, methylene bis (thiocyanate).
 - 4. Ensure compatibility of chemicals with aluminum heat exchangers prior to use in the system.

PART 3 EXECUTION

3.01 PREPARATION

- A. Systems shall be operational, filled, started, and vented prior to cleaning. Use water meter to record capacity in each system.
- B. Place terminal control valves in open position during cleaning.
- C. Verify that electric power is available and of the correct characteristics.

3.02 CLEANING SEQUENCE

- A. Concentration:
 - 1. As recommended by manufacturer.
 - 2. One pound per 100 gallons of water contained in the system.
- B. Chilled Water Systems:
 - 1. Circulate for 48 hours, then drain systems as quickly as possible.
 - 2. Refill with clean water, circulate for 24 hours, then drain.
 - 3. Refill with clean water and repeat until system cleaner is removed.
- C. Use neutralizer agents on recommendation of system cleaner supplier and approval of Contruction Manager, Architect or Engineer of Record.
- D. Flush open systems with clean water for one hour minimum. Drain completely and refill.

- E. Remove, clean, and replace strainer screens.
- F. Inspect, remove sludge, and flush low points with clean water after cleaning process is completed. Include disassembly of components as required.

END OF SECTION

NOT FOR BIDDING PURPOSES

NOT FOR BIDDING PURPOSES

SECTION 23 64 26
ROTARY-SCREW WATER CHILLERS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Factory-assembled packaged chiller.
- B. Charge of refrigerant and oil.
- C. Controls and control connections.
- D. Chilled water connections.
- E. Variable frequency drives.
- F. Electrical power connections.

1.02 RELATED REQUIREMENTS

- A. Section 03 30 00 - Cast-in-Place Concrete: Concrete housekeeping pads.
- B. Section 23 05 13 - Common Motor Requirements for HVAC Equipment.
- C. Section 23 05 48 - Vibration and Seismic Controls for HVAC Piping and Equipment.
- D. Section 23 05 53 - Identification for HVAC Piping and Equipment.
- E. Section 23 05 93 - Testing, Adjusting, and Balancing for HVAC.
- F. Section 23 08 00 - Commissioning of HVAC.
- G. Section 23 09 23 - Direct-Digital Control System for HVAC.
- H. Section 23 09 93 - Sequence of Operations for HVAC Controls.
- I. Section 23 21 13 - Hydronic Piping.
- J. Section 23 21 14 - Hydronic Specialties.
- K. Section 26 27 17 - Equipment Wiring.

1.03 REFERENCE STANDARDS

- A. AHRI 550/590 - Standard for Performance Rating of Water-Chilling Packages Using the Vapor Compression Cycle; Air-Conditioning, Heating, and Refrigeration Institute.
- B. ASHRAE Std 15 - Safety Standard for Refrigeration Systems; American Society of Heating, Refrigerating and Air-Conditioning Engineers, Inc (ANSI/ASHRAE Std 15).
- C. ASME BPVC-VIII-1 - Boiler and Pressure Vessel Code, Section VIII, Division 1 - Rules for Construction of Pressure Vessels; The American Society of Mechanical Engineers.
- D. ASTM B117 - Standard Practice for Operating Salt Spray (Fog) Apparatus; The American Society for Testing and Materials.
- E. IEEE 519 - IEEE Recommended Practices and Requirements for Harmonic Control in Electric Power Systems.
- F. UL 1995 - Heating and Cooling Equipment; Underwriters Laboratories Inc.
- G. NEMA 250 - Enclosures for Electrical Equipment (1000 Volts Maximum).
- H. NEMA MG 1 - Motors and Generators; National Electrical Manufacturers Association.
- I. ASTM B117 - Standard Practice for Operating Salt Spray (Fog) Apparatus; The American Society for Testing and Materials.
- J. IEEE 519 - IEEE Recommended Practices and Requirements for Harmonic Control in Electric Power Systems.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination: Coordinate physical size, weight and location of major pieces of equipment to be installed. Notify Owner and Architect of any major deviations from the equipment originally specified prior to ordering equipment.

1.05 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide rated capacities, weights, specialties and accessories, electrical requirements and wiring diagrams.
- C. Shop Drawings: Indicate components, assembly, dimensions, weights and loadings, required clearances, and location and size of field connections. Indicate equipment, piping and connections, valves, strainers, and thermostatic valves required for complete system.
- D. Manufacturer's Performance Data: Indicate energy input versus cooling load output from 0 to 100 percent of full load at specified and minimum condenser water temperature for water-cooled chillers and at specified and minimum outdoor air temperature for air-cooled chillers.
- E. Manufacturer's Instructions: Submit manufacturer's complete installation instructions.
- F. Manufacturer's Certificate: Certify that components furnished but not produced by manufacturer meet or exceed manufacturer's requirements.
- G. Operation and Maintenance Data: Include start-up instructions, maintenance data, parts lists, controls, and accessories; include trouble-shooting guide.
- H. Warranty: Submit manufacturer's warranty and ensure forms have been filled out in Owner's name and registered with manufacturer.
- I. Maintenance Materials: Furnish the following for Owner's use in maintenance of project.
 - 1. See Section 01 60 00 - Product Requirements, for additional provisions.
 - 2. Extra Refrigerant: One container.
 - 3. Extra Lubricating Oil: One container.

1.06 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum three years of documented experience.
- B. When required, provide certification of inspection for conformance to requirements of authority having jurisdiction.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. Conform to manufacturer's written installation instructions for rigging, unloading, and transporting units.
- B. Deliver units to the job site completely assembled and charged with refrigerant and oil by manufacturer.

1.08 WARRANTY

- A. See Section 01 78 00 - Closeout Submittals, for additional warranty requirements.
- B. Manufacturer's Warranty: Provide minimum Five year warranty to include coverage for materials and labor for complete assembly.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Trane Inc : www.trane.com.
- B. York International Corporation/Johnson Controls, Inc: www.york.com.

- C. Substitutions: See Section 01 60 00 - Product Requirements.
1. The chilled water system has been designed based on specific capacities and characteristics of equipment specified in this section and other sections.
 2. When substitution of a different manufacturer or model number is desired, submit sufficient information to demonstrate to Architect that the substitute will have the same or better performance as that specified AND that the related equipment in the system will perform acceptably with the substitute.
 3. If the related equipment must be modified to perform acceptably with the substitute, the entity proposing the substitution is responsible for all additional costs due to re-design and provision of different related equipment.

2.02 CHILLER APPLICATIONS

2.03 CHILLERS

- A. Chillers: Factory assemble and test chiller consisting of compressor(s), compressor motor(s), motor starter(s) or variable frequency drives as indicated, evaporator, condenser, enclosure, refrigeration circuits(s), condenser fans, vibration isolation and specialties, interconnecting piping, microprocessor-based controls, readouts, and diagnostics.
1. Rating: AHRI 550/590.
 2. Safety: UL 1995.
 3. Safety: ASHRAE Std 15.
 4. Construction & Testing: ASME BPVC-VIII-1.
 5. Products Requiring Electrical Connection: Listed and classified by Underwriters Laboratories Inc. as suitable for the purpose specified and indicated.
 6. Energy Efficiency: ASHRAE Std 90.1.
 7. Enclosures:
 - a. Chiller Structural Framing:
 - 1) Mount structural steel on welded steel base.
 - 2) Factory apply hot-dip galvanized finish.
 - b. Steel Chiller Cabinets:
 - 1) Factory apply baked on enamel or baked on powder paint finish.
 - 2) Perform 500-hour salt spray test in accordance with ASTM B117 for outdoor applications.
 - c. Steel Control Panels:
 - 1) Factory apply baked on powder paint or applied corrosion resistant paint prior to assembly.
 - 2) Provide gasketing and weather-proofing to panels with fully opening doors containing starters or variable frequency drives, terminal blocks, through-the-door type disconnects and circuit breaker with lockable handles indicating "power-on" or "power-off".
 - 3) Provide door stays.
 - d. Electrical Equipment: NEMA 250.

2.04 COMPRESSORS AND EVAPORATOR

- A. Compressors: Rotary-screw type.
1. Unit: Semi-hermetic type with two direct drive compressors with multiple independent refrigeration circuit(s), internal muffler, discharge, check, and suction service valves.
 2. Oil Lubrication System: Positive pressure system, oil heater, oil separator, check valves, solenoid valves, and filtration devices.
 3. Valves: Check valves in compressor discharge.
 4. Capacity Reduction System: Load/unload valve control down to 20 percent of full load without the activation of hot gas by-pass.

5. Motor: 3600 rpm, suction gas-cooled, hermetically sealed, squirrel cage induction with variable frequency drive.
- B. Evaporator: Shell and tube type.
 1. Three pass type, with three independent refrigeration circuits.
 2. Shell, Removable Heads and Tube Support Sheets: Carbon steel.
 3. Tubes: Mechanically expand and fasten, seamless, externally or internally enhanced, copper tubes into intermediate tube support sheets along the length of shell to avoid contact and relative motion between tubes with the capability of being cleanable.
 4. Tube Size: 1.0 inches diameter.
 5. Conform with ASME BPVC-VIII-1 as applicable.
 6. Refrigerant Working-Side Pressure Rating: 200 psig.
 7. Water Working-Side Pressure Rating: 150 psig.
 8. Connections: Flanged and designed for 150 psig waterside working pressure.
- C. Insulation for All Cold Surfaces:
 1. Factory install on shell and all other cold surfaces.
 2. 0.75 inches minimum thick, closed cell, expanded polyvinyl chloride flexible foam insulation with a maximum K value of 0.28.
- D. Provide vents and water drain connections.
- E. Provide fittings for temperature control sensors.
- F. Freeze Protection: Provide evaporator heater with thermostat to protect from freezing at ambient temperatures down to minus 20 degrees F.

2.05 AIR-COOLED CONDENSER AND FANS

- A. Heat Exchanger:
 1. Tubes: Round.
 2. Arrangement: Two pass.
 3. Mechanically bond aluminum fins to internally enhanced, aluminum alloy tubing and protect with corrosion resistant materials or coatings.
 4. Clean, dehydrate and test.
 5. Leak Test: 506 psig.
 6. Seal: Nitrogen holding charge.
- B. Coil Guards: Provide expanded metal with lint screens. Provide coil protection for shipping by enclosing entire condenser coil with heavy plastic to prevent inadvertent damage to coil during shipping or rigging.
- C. Fans and Motors:
 1. Fans: Dynamically balanced low-sound propeller type, direct drive fans of reinforced polymer corrosion resistant construction and equip with sealed, permanently lubricated ball bearings.
 2. Discharge Fan Guards: PVC coated.
 3. Discharge Direction: Vertical.
 4. Motors: Totally enclosed, high efficiency, with each controlled by a variable-speed drive, suitable for outdoor use, three phase, totally enclosed air-over (TEAO), with internal overload protection.

2.06 REFRIGERATION CIRCUITS

- A. Provide two independent refrigeration circuit(s) with two compressors.
- B. Minimum Refrigerant Specialties per Circuit:
 1. Isolation and service valves for refrigerant removal and charging.
 2. Removable-core filter driers.
 3. ASHRAE Std 15 compliant relief valves.

4. Liquid line sight glass with moisture indicator.
5. Refrigerant expansion valves or metering devices.
6. Complete operating charge of both refrigerant and oil.

2.07 STARTERS AND DRIVES

- A. Variable Frequency Drives: Completely assemble, wire, pipe, and factory test, factory or field mounted variable frequency drive (VFD). Limit the field electrical connections for compressor motor power to the main power leads to the VFD, wiring of liquid pumps and tower fans to the control panel.
1. Characteristics:
 - a. Refrigerant cooled.
 - b. Microprocessor based pulse width modulation (PWM) with input/output power devices, DC voltage rectifier, and inverter/control regulator to convert DC voltage to sinusoidal PWM waveform.
 - c. Isolate low voltage control physically from main power sections.
 - d. Control motor speed by integrated controls over wide range of operating conditions.
 - e. Provide short circuit interrupt and withstand rating suitable for available current.
 2. Performance:
 - a. Do not exceed IEEE-519 requirements for voltage total harmonic distortion (THD) and harmonic current total demand distortion (TDD) using VFD circuit breaker input terminals as the point of common coupling (PCC).
 - b. Full Load Efficiency: Minimum 97 percent at 100 percent VFD rated capacity.
 - c. Unity Displacement Power Factor: 0.99 minimum.
 - d. Voltage Boost Capability: Full motor voltage at reduced line voltage conditions.
 - e. Soft start, linear acceleration, and coast to stop capabilities.
 - f. Base Motor Adjustable Frequency Range: Control to 15 percent capacity at nameplate voltage.
 - g. Torque Generation: 150 percent instantaneous.
 3. Heat Sink and Mating Flange:
 - a. Design for 185 psig waterside working pressure.
 - b. Meter to maintain temperature within acceptable limits.
 4. Suitable Ratings:
 - a. Operation at plus or minus 10 percent nameplate voltage.
 - b. Continuous Operation at:
 - 1) 100 percent of nameplate amperes and 5 seconds at 15 percent.
 - 2) Ambient temperature range of 40 to 122 degrees F, 95 percent humidity non-condensing for altitudes up to 6000 feet.
 - c. Comply with NEMA 250 and NEMA MG 1.
 5. User Interface for Programming and Display of the Following Parameters:
 - a. Operating, configuration and fault messages.
 - b. Hertz frequency.
 - c. VFD load, line side voltage, and current.
 - d. kW.
 - e. Input/output power devices temperature.
 6. Electrical Service (single point power):
 - a. Input Circuit Breaker: Suitable for the available current indicated.
 - b. Provide power for chiller oil pump via factory wired standard branch circuit breaker.
 - c. Provide power for oil heater, VFD and controls via 3 KVA control power transformer and factory wired circuit breaker.
 - d. Provide factory-mounted and installed disconnect switch.
 7. Discrete Contact Outputs (115 volt):
 - a. Circuit breaker shunt trip.

- b. Chilled water pump.
- c. Condenser water pump.
- d. Alarm status.
8. Analog Outputs: (4 to 20 mA) for head pressure reference and condenser water control valve as applicable.
9. Provide protection for under/over-voltage, phase loss/reversal/unbalance, ground fault, single cycle voltage loss, programmable auto restart after power loss, and motor overload/over temperature protection.

2.08 MICROPROCESSOR-BASED, PROPORTIONAL AND INTEGRAL CONTROLLER

- A. Control Components for Preventing Shutdown:
 1. Provide high pressure limit with indicating light for each compressor, set lower than factory pressure switch to automatically unload compressor and prevent nuisance high pressure condenser control trip.
 2. Provide one protector with indicating light for each compressor, with current limit set point of 120 percent of compressor running load amperage to automatically unload compressor preventing over-current trip.
 3. Provide low refrigerant limit to automatically unload each compressor preventing a low evaporator temperature trip.
- B. Chiller Operation in Abnormal Operating Conditions:
 1. Unloaded Running: Adequate chilled water production.
 2. Trip-out Limit Reached: Chiller goes off-line and manual reset is required for continued operation.
- C. Control Panel Display:
 1. Evaporator pressure.
 2. Condenser refrigerant pressure.
 3. Entering and leaving evaporator water temperature.
 4. Chilled water set-point.
 5. Electrical 3 phase current limit and percent RLA setpoint.
 6. Electrical 3 phase amp draw.
 7. Chiller operating mode.
 8. Condenser refrigerant temperature.
 9. Elapsed time and number of starts counter.
 10. Chiller compressor run status relay.
 11. Minimum of 20 diagnostics with time and date stamp.
 12. Identification of the fault, date, time and operating mode at time of occurrence, type of reset required, and help message.
- D. Points for BAS Control and Monitoring:
 1. Full BACnet native interface.
 2. Relay output energized upon detecting a fault requiring manual reset.
 3. Relay output energized whenever unit is operating in a limit mode for an extended period of time.
 4. Analog input to control leaving chilled water temperature set-point based upon a 4-20ma or 0-10 VDC signal from the building automation system.
 5. Programmable soft during pull-down period via ramped current limit or fully adjustable, temperature pull-down rate.
 6. Leaving chilled water reset based upon return water temperature.
 7. Provide RS-232 for printer interface.

PART 3 EXECUTION

3.01 INSTALLATION

- A. Install in accordance with manufacturer's instructions.
- B. Align chiller package on steel or concrete foundations.
- C. Install units on vibration isolators.
- D. Connect to electrical service.
- E. Connect to chilled water piping with flexible connections to prevent vibration transfer to piping.
- F. Provide isolation valves on the supply and return piping connections at the chiller.
- G. Arrange piping for easy dismantling to permit tube cleaning and removal.

3.02 MANUFACTURER'S FIELD SERVICES

- A. Perform factory startup of the chiller by factory trained and authorized servicing technicians confirming equipment has been correctly installed prior to equipment becoming operational and covered under the manufacturer's warranty.
- B. Supply initial charge of refrigerant and oil if not completely factory charged.
- C. Demonstrate system operations and verify specified performance.

3.03 CLOSEOUT ACTIVITIES

- A. See Section 01 78 00 - Closeout Submittals, for closeout submittals.
- B. See Section 01 79 00 - Demonstration and Training, for additional requirements.
- C. Demonstrate proper operation of equipment to Owner's designated representative.
- D. Demonstration: Demonstrate operation of system to Owner's personnel.
 - 1. Use operation and maintenance data as reference during demonstration.
 - 2. Briefly describe function, operation, and maintenance of each component.
- E. Training: Train Owner's personnel on operation and maintenance of system.
 - 1. Use operation and maintenance manual as training reference, supplemented with additional training materials as required.
 - 2. Provide minimum of two hours of training.
 - 3. Instructor: Manufacturer's training personnel.
 - 4. Location: At project site.

3.04 MAINTENANCE

- A. See Section 01 70 00 - Execution Requirements, or other applicable specification in the front end for additional requirements relating to maintenance service.

END OF SECTION

NOT FOR BIDDING PURPOSES

SECTION 26 05 01
MINOR ELECTRICAL DEMOLITION

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Electrical demolition.

1.02 RELATED REQUIREMENTS

- A. Section 01 70 00 - Execution and Closeout Requirements: Additional requirements for alterations work.

PART 2 PRODUCTS

2.01 MATERIALS AND EQUIPMENT

- A. Materials and equipment for patching and extending work: As specified in individual sections.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that abandoned wiring and equipment serve only abandoned facilities.
- B. Demolition drawings are based on casual field observation and existing record documents.
- C. Report discrepancies to Owner before disturbing existing installation.
- D. Beginning of demolition means installer accepts existing conditions.

3.02 PREPARATION

- A. Disconnect electrical systems in walls, floors, and ceilings to be removed.
- B. Coordinate utility service outages with utility company.
- C. Provide temporary wiring and connections to maintain existing systems in service during construction. When work must be performed on energized equipment or circuits, use personnel experienced in such operations.
- D. Existing Electrical Service: Maintain existing system in service until new system is complete and ready for service. Disable system only to make switchovers and connections. Minimize outage duration.
 - 1. Obtain permission from Owner at least 24 hours before partially or completely disabling system.
 - 2. Make temporary connections to maintain service in areas adjacent to work area.
- E. Existing Fire Alarm System: Maintain existing system in service until new system is accepted. Disable system only to make switchovers and connections. Minimize outage duration.
 - 1. Notify Owner before partially or completely disabling system.
 - 2. Notify local fire service.
 - 3. Make notifications at least 24 hours in advance.
 - 4. Make temporary connections to maintain service in areas adjacent to work area.
- F. Existing Telephone System: Maintain existing system in service until new system is complete and ready for service. Disable system only to make switchovers and connections. Minimize outage duration.
 - 1. Notify Owner at least 24 hours before partially or completely disabling system.
 - 2. Notify telephone utility company at least 24 hours before partially or completely disabling system.
 - 3. Make temporary connections to maintain service in areas adjacent to work area.

3.03 DEMOLITION AND EXTENSION OF EXISTING ELECTRICAL WORK

- A. Remove, relocate, and extend existing installations to accommodate new construction.

- B. Remove abandoned wiring to source of supply.
- C. Remove exposed abandoned conduit, including abandoned conduit above accessible ceiling finishes. Cut conduit flush with walls and floors, and patch surfaces.
- D. Disconnect abandoned outlets and remove devices. Remove abandoned outlets if conduit servicing them is abandoned and removed. Provide blank cover for abandoned outlets that are not removed.
- E. Repair adjacent construction and finishes damaged during demolition and extension work.
- F. Maintain access to existing electrical installations that remain active. Modify installation or provide access panel as appropriate.

3.04 CLEANING AND REPAIR

- A. Clean and repair existing materials and equipment that remain or that are to be reused.
- B. Panelboards: Clean exposed surfaces and check tightness of electrical connections. Replace damaged circuit breakers and provide closure plates for vacant positions. Provide typed circuit directory showing revised circuiting arrangement.
- C. Luminaires: Remove existing luminaires for cleaning. Use mild detergent to clean all exterior and interior surfaces; rinse with clean water and wipe dry. Replace lamps, ballasts and broken electrical parts.

END OF SECTION

NOT FOR BIDDING PURPOSES

SECTION 26 05 34

CONDUIT

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Flexible metal conduit (FMC).
- B. Conduit fittings.
- C. Conduit, fittings and conduit bodies.

1.02 RELATED REQUIREMENTS

- A. Section 07 84 00 - Firestopping.
- B. Section 26 05 26 - Grounding and Bonding for Electrical Systems.
- C. Section 26 05 29 - Hangers and Supports for Electrical Systems.
- D. Section 26 05 53 - Identification for Electrical Systems.
- E. Section 26 05 37 - Boxes.

1.03 REFERENCE STANDARDS

- A. ANSI C80.1 - American National Standard for Electrical Rigid Steel Conduit (ERSC).
- B. ANSI C80.3 - American National Standard for Steel Electrical Metallic Tubing (EMT).
- C. ANSI C80.5 - American National Standard for Electrical Rigid Aluminum Conduit (ERAC).
- D. NECA 1 - Standard for Good Workmanship in Electrical Construction; National Electrical Contractors Association.
- E. NECA 101 - Standard for Installing Steel Conduits (Rigid, IMC, EMT); National Electrical Contractors Association.
- F. NEMA FB 1 - Fittings, Cast Metal Boxes, and Conduit Bodies for Conduit, Electrical Metallic Tubing, and Cable; National Electrical Manufacturers Association (ANSI/NEMA FB 1).
- G. UL 1 - Flexible Metal Conduit.
- H. UL 514B - Conduit, Tubing, and Cable Fittings.

1.04 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements for submittals procedures.
- B. Product Data: Provide for metallic conduit and flexible metal conduit.
- C. Samples of Materials Actually Delivered to Site:
 - 1. Two pieces each of conduit, 2 feet long.
- D. Project Record Documents: Accurately record actual routing of conduits larger than 2 inches.

1.05 QUALITY ASSURANCE

- A. Conform to requirements of NFPA 70.
- B. Products: Listed and classified by Underwriters Laboratories Inc. as suitable for purpose specified and shown.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. Receive, inspect, handle, and store conduit and fittings in accordance with manufacturer's instructions.
- B. Accept conduit on site. Inspect for damage.
- C. Protect conduit from corrosion and entrance of debris by storing above grade. Provide appropriate covering.

- D. Protect PVC conduit from sunlight.

PART 2 PRODUCTS

2.01 CONDUIT REQUIREMENTS

- A. Provide all conduit, fittings, supports, and accessories required for a complete raceway system.
- B. Provide products listed, classified, and labeled by Underwriter's Laboratories Inc. (UL) or testing firm acceptable to authority having jurisdiction as suitable for the purpose indicated.
- C. Where conduit size is not indicated, size to comply with NFPA 70 but not less than applicable minimum size requirements specified.

2.02 METAL CONDUIT

- A. Manufacturers:
 - 1. Allied Tube & Conduit: www.alliedtube.com.
 - 2. Beck Manufacturing, Inc: www.beckmfg.com.
 - 3. Wheatland Tube Company: www.wheatland.com.
 - 4. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Rigid Steel Conduit: ANSI C80.1.
- C. Fittings and Conduit Bodies: NEMA FB 1; material to match conduit.

2.03 FLEXIBLE METAL CONDUIT (FMC)

- A. Manufacturers:
 - 1. AFC Cable Systems, Inc: www.afcweb.com.
 - 2. Electri-Flex Company: www.electriflex.com.
 - 3. International Metal Hose: www.metalhose.com.
 - 4. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Description: NFPA 70, Type FMC standard wall steel flexible metal conduit listed and labeled as complying with UL 1, and listed for use in classified firestop systems to be used.
- C. Fittings:
 - 1. Description: Fittings complying with NEMA FB 1 and listed and labeled as complying with UL 514B.
 - 2. Material: Use steel or malleable iron.
- D. Description: Interlocked steel construction.
- E. Fittings: NEMA FB 1.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field measurements are as shown on drawings.
- B. Verify that mounting surfaces are ready to receive conduits.
- C. Verify that conditions are satisfactory for installation prior to starting work.
- D. Verify routing and termination locations of conduit prior to rough-in.
- E. Conduit routing is shown on drawings in approximate locations unless dimensioned. Route as required to complete wiring system.

3.02 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.
- B. Install conduit in a neat and workmanlike manner in accordance with NECA 1.
- C. Conduit Support:

1. Secure and support conduits in accordance with NFPA 70 and Section 26 05 29 using suitable supports and methods approved by the authority having jurisdiction.
 2. Provide independent support from building structure. Do not provide support from piping, ductwork, or other systems.
- D. Connections and Terminations:
1. Use suitable adapters where required to transition from one type of conduit to another.
 2. Provide insulating bushings or insulated throats at all conduit terminations to protect conductors.
 3. Secure joints and connections to provide maximum mechanical strength and electrical continuity.
- E. Penetrations:
1. Do not penetrate or otherwise notch or cut structural members, including footings and grade beams, without approval of Structural Engineer.
 2. Make penetrations perpendicular to surfaces unless otherwise indicated.
 3. Provide sleeves for penetrations as indicated or as required to facilitate installation. Set sleeves flush with exposed surfaces unless otherwise indicated or required.
 4. Conceal bends for conduit risers emerging above ground.
 5. Seal interior of conduits entering the building from underground at first accessible point to prevent entry of moisture and gases.
 6. Where conduits penetrate waterproof membrane, seal as required to maintain integrity of membrane.
 7. Make penetrations for roof-mounted equipment within associated equipment openings and curbs where possible to minimize roofing system penetrations. Where penetrations are necessary, seal as indicated or as required to preserve integrity of roofing system and maintain roof warranty. Include proposed locations of penetrations and methods for sealing with submittals.
 8. Install firestopping to preserve fire resistance rating of partitions and other elements, using materials and methods specified in Section 07 84 00.
- F. Conduit Movement Provisions: Where conduits are subject to movement, provide expansion and expansion/deflection fittings to prevent damage to enclosed conductors or connected equipment. This includes, but is not limited to:
1. Where conduits cross structural joints intended for expansion, contraction, or deflection.
 2. Where conduits are subject to earth movement by settlement or frost.
- G. Condensation Prevention: Where conduits cross barriers between areas of potential substantial temperature differential, provide sealing fitting or approved sealing compound at an accessible point near the penetration to prevent condensation. This includes, but is not limited to:
1. Where conduits pass from outdoors into conditioned interior spaces.
 2. Where conduits pass from unconditioned interior spaces into conditioned interior spaces.
- H. Provide grounding and bonding in accordance with Section 26 05 26.

3.03 INTERFACE WITH OTHER PRODUCTS

- A. Install conduit to preserve fire resistance rating of partitions and other elements, using materials and methods specified in Section 07 84 00.
- B. Route conduit through roof openings for piping and ductwork wherever possible. Where separate roofing penetration is required, coordinate location and installation method with roofing installation specified in Section roofing section.

END OF SECTION

NOT FOR BIDDING PURPOSES

SECTION 26 05 37
BOXES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Outlet and device boxes up to 100 cubic inches, including those used as junction and pull boxes.
- B. Cabinets and enclosures, including junction and pull boxes larger than 100 cubic inches.
- C. Wall and ceiling outlet boxes.
- D. Floor boxes.
- E. Pull and junction boxes.

1.02 RELATED REQUIREMENTS

- A. Section 07 84 00 - Firestopping.
- B. Section 26 05 26 - Grounding and Bonding for Electrical Systems.
- C. Section 26 05 29 - Hangers and Supports for Electrical Systems.
- D. Section 26 27 26 - Wiring Devices:
 - 1. Wall plates.
- E. Section 26 27 16 - Electrical Cabinets and Enclosures.
- F. Section 26 27 26 - Wiring Devices: Wall plates in finished areas, floor box service fittings, fire-rated poke-through fittings, and access floor boxes.

1.03 REFERENCE STANDARDS

- A. NECA 1 - Standard for Good Workmanship in Electrical Construction; National Electrical Contractors Association.
- B. NECA 130 - Standard for Installing and Maintaining Wiring Devices; National Electrical Contractors Association.
- C. NEMA FB 1 - Fittings, Cast Metal Boxes, and Conduit Bodies for Conduit, Electrical Metallic Tubing, and Cable; National Electrical Manufacturers Association (ANSI/NEMA FB 1).
- D. NEMA OS 1 - Sheet Steel Outlet Boxes, Device Boxes, Covers, and Box Supports; National Electrical Manufacturers Association (ANSI/NEMA OS 1).
- E. NEMA OS 2 - Nonmetallic Outlet Boxes, Device Boxes, Covers and Box Supports; National Electrical Manufacturers Association (ANSI/NEMA OS 2).
- F. NEMA 250 - Enclosures for Electrical Equipment (1000 Volts Maximum); National Electrical Manufacturers Association.
- G. NFPA 70 - National Electrical Code; National Fire Protection Association.
- H. UL 50 - Enclosures for Electrical Equipment, Non-Environmental Considerations.
- I. UL 50E - Enclosures for Electrical Equipment, Environmental Considerations.
- J. UL 508A - Industrial Control Panels.
- K. UL 514A - Metallic Outlet Boxes.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Coordinate the work with other trades to avoid placement of ductwork, piping, equipment, or other potential obstructions within the dedicated equipment spaces and working clearances for electrical equipment required by NFPA 70.

2. Coordinate arrangement of electrical equipment with the dimensions and clearance requirements of the actual equipment to be installed.
3. Coordinate minimum sizes of boxes with the actual installed arrangement of conductors, clamps, support fittings, and devices, calculated according to NFPA 70.
4. Coordinate minimum sizes of pull boxes with the actual installed arrangement of connected conduits, calculated according to NFPA 70.
5. Coordinate the placement of boxes with millwork, furniture, devices, equipment, etc. installed under other sections or by others.
6. Coordinate the work with other trades to preserve insulation integrity.
7. Coordinate the work with other trades to provide walls suitable for installation of flush-mounted boxes where indicated.
8. Notify Architect of any conflicts with or deviations from the contract documents. Obtain direction before proceeding with work.

1.05 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Project Record Documents: Record actual locations and mounting heights of outlet, pull, and junction boxes on project record documents.

1.06 QUALITY ASSURANCE

- A. Conform to requirements of NFPA 70.

PART 2 PRODUCTS

2.01 BOXES

- A. General Requirements:
 1. Do not use boxes and associated accessories for applications other than as permitted by NFPA 70 and product listing.
 2. Provide all boxes, fittings, supports, and accessories required for a complete raceway system and to accommodate devices and equipment to be installed.
 3. Provide products listed, classified, and labeled by Underwriter's Laboratories Inc. (UL) or testing firm acceptable to authority having jurisdiction as suitable for the purpose indicated.
 4. Where box size is not indicated, size to comply with NFPA 70 but not less than applicable minimum size requirements specified.
 5. Provide grounding terminals within boxes where equipment grounding conductors terminate.
- B. Outlet and Device Boxes Up to 100 cubic inches, Including Those Used as Junction and Pull Boxes:
 1. Use sheet-steel boxes for dry locations unless otherwise indicated or required.
 2. Use cast iron boxes or cast aluminum boxes for damp or wet locations unless otherwise indicated or required; furnish with compatible weatherproof gasketed covers.
 3. Use suitable concrete type boxes where flush-mounted in concrete.
 4. Use suitable masonry type boxes where flush-mounted in masonry walls.
 5. Use raised covers suitable for the type of wall construction and device configuration where required.
 6. Use shallow boxes where required by the type of wall construction.
 7. Do not use "through-wall" boxes designed for access from both sides of wall.
 8. Sheet-Steel Boxes: Comply with NEMA OS 1, and list and label as complying with UL 514A.
 9. Cast Metal Boxes: Comply with NEMA FB 1, and list and label as complying with UL 514A; furnish with threaded hubs.

10. Boxes for Supporting Luminaires and Ceiling Fans: Listed as suitable for the type and weight of load to be supported; furnished with fixture stud to accommodate mounting of luminaire where required.
 11. Boxes for Ganged Devices: Use multigang boxes of single-piece construction. Do not use field-connected gangable boxes.
 12. Wall Plates: Comply with Section 26 27 26.
- C. Cabinets and Enclosures, Including Junction and Pull Boxes Larger Than 100 cubic inches.
1. Comply with NEMA 250, and list and label as complying with UL 50 and UL 50E, or UL 508A.
 2. NEMA 250 Environment Type, Unless Otherwise Indicated:
 3. Junction and Pull Boxes Larger Than 100 cubic inches:
 - a. Provide screw-cover or hinged-cover enclosures unless otherwise indicated.

2.02 MANUFACTURERS

- A. Appleton Electric: www.appletonelec.com.
- B. Steel City
- C. Substitutions: Reco, Inc. See Section 01 60 00 - Product Requirements.

2.03 OUTLET BOXES

- A. Sheet Metal Outlet Boxes: NEMA OS 1, galvanized steel.
 1. Luminaire and Equipment Supporting Boxes: Rated for weight of equipment supported; include 1/2 inch male fixture studs where required.
 2. Concrete Ceiling Boxes: Concrete type.
- B. Nonmetallic Outlet Boxes: NEMA OS 2.
- C. Cast Boxes: NEMA FB 1, Type FD, aluminum. Provide gasketed cover by box manufacturer. Provide threaded hubs.
- D. Wall Plates for Finished Areas: As specified in Section 26 27 26.

2.04 FLOOR BOXES

- A. Floor Boxes: NEMA OS 1, fully adjustable, _4 inches deep.
- B. Material: Cast metal.
- C. Shape: Rectangular.
- D. Service Fittings: As specified in Section 26 27 26.

2.05 PULL AND JUNCTION BOXES

- A. Sheet Metal Boxes: NEMA OS 1, galvanized steel.
- B. Hinged Enclosures: As specified in Section 26 27 16.
- C. Surface Mounted Cast Metal Box: NEMA 250, Type 4; flat-flanged, surface mounted junction box.
 1. Material: Galvanized cast iron; Cast Aluminum.
 2. Cover: Furnish with ground flange, neoprene gasket, and stainless steel cover screws.
- D. In-Ground Cast Metal Box: NEMA 250, Type 6, outside flanged, recessed cover box for flush mounting:
 1. Material: Galvanized cast iron; Cast Aluminum.
 2. Cover: Nonskid cover with neoprene gasket and stainless steel cover screws.
 3. Cover Legend: "ELECTRIC".

PART 3 EXECUTION

3.01 EXAMINATION

3.02

- A. Verify that field measurements are as shown on drawings.
- B. Verify that mounting surfaces are ready to receive boxes.
- C. Verify that conditions are satisfactory for installation prior to starting work.
- D. Verify locations of floor boxes and outlets in offices and work areas prior to rough-in.

3.03 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.
- B. Perform work in a neat and workmanlike manner in accordance with NECA 1 and, where applicable, NECA 130, including mounting heights specified in those standards where mounting heights are not indicated.
- C. Arrange equipment to provide minimum clearances in accordance with manufacturer's instructions and NFPA 70.
- D. Box Supports:
 - 1. Secure and support boxes in accordance with NFPA 70 and Section 26 05 29 using suitable supports and methods approved by the authority having jurisdiction.
 - 2. Provide independent support from building structure except for cast metal boxes (other than boxes used for fixture support) supported by threaded conduit connections in accordance with NFPA 70. Do not provide support from piping, ductwork, or other systems.
- E. Install boxes plumb and level.
- F. Flush-Mounted Boxes:
 - 1. Install boxes in noncombustible materials such as concrete, tile, gypsum, plaster, etc. so that front edge of box or associated raised cover is not set back from finished surface more than 1/4 inch or does not project beyond finished surface.
 - 2. Install boxes in combustible materials such as wood so that front edge of box or associated raised cover is flush with finished surface.
 - 3. Repair rough openings around boxes in noncombustible materials such as concrete, tile, gypsum, plaster, etc. so that there are no gaps or open spaces greater than 1/8 inch at the edge of the box.
- G. Install boxes as required to preserve insulation integrity.
- H. Install permanent barrier between ganged wiring devices when voltage between adjacent devices exceeds 300 V.
- I. Install firestopping to preserve fire resistance rating of partitions and other elements, using materials and methods specified in Section 07 84 00.
- J. Close unused box openings.
- K. Install blank wall plates on junction boxes and on outlet boxes with no devices or equipment installed or designated for future use.
- L. Provide grounding and bonding in accordance with Section 26 05 26.
- M. Install boxes securely, in a neat and workmanlike manner, as specified in NECA 1.
- N. Install in locations as shown on Drawings, and as required for splices, taps, wire pulling, equipment connections, and as required by NFPA 70.
- O. Coordinate installation of outlet boxes for equipment connected under Section 26 27 17.

- P. Set wall mounted boxes at elevations to accommodate mounting heights indicated.
- Q. Electrical boxes are shown on Drawings in approximate locations unless dimensioned.
 - 1. Adjust box locations up to 10 feet if required to accommodate intended purpose.
- R. Orient boxes to accommodate wiring devices oriented as specified in Section 26 27 26.
- S. Maintain headroom and present neat mechanical appearance.
- T. Install pull boxes and junction boxes above accessible ceilings and in unfinished areas only.
- U. Inaccessible Ceiling Areas: Install outlet and junction boxes no more than 6 inches from ceiling access panel or from removable recessed luminaire.
- V. Install boxes to preserve fire resistance rating of partitions and other elements, using materials and methods specified in Section 07 84 00.
- W. Coordinate mounting heights and locations of outlets mounted above counters, benches, and backsplashes.
- X. Locate outlet boxes to allow luminaires positioned as shown on reflected ceiling plan.
- Y. Align adjacent wall mounted outlet boxes for switches, thermostats, and similar devices.
- Z. Use flush mounting outlet box in finished areas.
- AA. Locate flush mounting box in masonry wall to require cutting of masonry unit corner only. Coordinate masonry cutting to achieve neat opening.
- AB. Do not install flush mounting box back-to-back in walls; provide minimum 6 inches separation. Provide minimum 24 inches separation in acoustic rated walls.
- AC. Secure flush mounting box to interior wall and partition studs. Accurately position to allow for surface finish thickness.
- AD. Use stamped steel bridges to fasten flush mounting outlet box between studs.
- AE. Install flush mounting box without damaging wall insulation or reducing its effectiveness.
- AF. Use adjustable steel channel fasteners for hung ceiling outlet box.
- AG. Do not fasten boxes to ceiling support wires.
- AH. Support boxes independently of conduit, except cast box that is connected to two rigid metal conduits both supported within 12 inches of box.
- AI. Use gang box where more than one device is mounted together. Do not use sectional box.
- AJ. Use gang box with plaster ring for single device outlets.
- AK. Use cast outlet box in exterior locations exposed to the weather and wet locations.
- AL. Use cast floor boxes for installations in slab on grade; formed steel boxes are acceptable for other installations.
- AM. Set floor boxes level.
- AN. Large Pull Boxes: Use hinged enclosure in interior dry locations, surface-mounted cast metal box in other locations.

3.04 ADJUSTING

- A. Adjust floor boxes flush with finish flooring material.
- B. Adjust flush-mounting outlets to make front flush with finished wall material.
- C. Install knockout closures in unused box openings.

3.05 CLEANING

- A. Clean interior of boxes to remove dirt, debris, plaster and other foreign material.

3.06 PROTECTION

- A. Immediately after installation, protect boxes from entry of moisture and foreign material until ready for installation of conductors.

END OF SECTION

NOT FOR BIDDING PURPOSES

SECTION 26 05 53
IDENTIFICATION FOR ELECTRICAL SYSTEMS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Electrical identification requirements.
- B. Identification nameplates and labels.
- C. Wire and cable markers.
- D. Voltage markers.
- E. Warning signs and labels.
- F. Field-painted identification of conduit.

1.02 RELATED REQUIREMENTS

- A. Section 09 90 00 - Painting and Coating.

1.03 REFERENCE STANDARDS

- A. ANSI Z535.2 - American National Standard for Environmental and Facility Safety Signs.
- B. ANSI Z535.4 - American National Standard for Product Safety Signs and Labels.
- C. NFPA 70 - National Electrical Code; National Fire Protection Association.
- D. UL 969 - Marking and Labeling Systems.

1.04 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements for submittals procedures.
- B. Product Data: Provide catalog data for nameplates, labels, and markers.
- C. Manufacturer's Instructions: Indicate application conditions and limitations of use stipulated by product testing agency. Include instructions for storage, handling, protection, examination, preparation and installation of product.

1.05 QUALITY ASSURANCE

- A. Conform to requirements of NFPA 70.

1.06 EXTRA MATERIALS

- A. See Section 01 60 00 - Product Requirements for additional requirements.

PART 2 PRODUCTS

2.01 IDENTIFICATION REQUIREMENTS

- A. Identification for Equipment:
 - 1. Use identification nameplate to identify each piece of electrical distribution and control equipment and associated sections, compartments, and components.
- B. Identification for Conductors and Cables:
 - 1. Color Coding for Power Conductors 600 V and Less: Comply with Section 26 05 19.
 - 2. Use identification nameplate or identification label to identify color code for ungrounded and grounded power conductors inside door or enclosure at each piece of feeder or branch-circuit distribution equipment when premises has feeders or branch circuits served by more than one nominal voltage system.

2.02 MANUFACTURERS

- A. Brady Corporation: www.bradycorp.com.
- B. Seton Identification Products: www.seton.com/aec.

- C. HellermannTyton: www.hellermanntyton.com.
- D. Substitutions: See Section 01 60 00 - Product Requirements.

2.03 IDENTIFICATION NAMEPLATES AND LABELS

- A. Identification Nameplates:
 - 1. Materials:
 - 2. Mounting Holes for Mechanical Fasteners: Two, centered on sides for sizes up to 1 inch high; Four, located at corners for larger sizes.
- B. Identification Labels:
 - 1. Materials: Use self-adhesive laminated plastic labels; UV, chemical, water, heat, and abrasion resistant.
 - 2. Text: Use factory pre-printed or machine-printed text. Do not use handwritten text unless otherwise indicated.
- C. Nameplates: Engraved three-layer laminated plastic, black letters on white background.
- D. Locations:
 - 1. Each electrical distribution and control equipment enclosure.
 - 2. Communication cabinets.
 - 3. Disconnect switches, and starters.
- E. Letter Size:
 - 1. Use 1/8 inch letters for identifying individual equipment and loads.
 - 2. Use 1/4 inch letters for identifying grouped equipment and loads.

2.04 WIRE AND CABLE MARKERS

- A. Manufacturers:
 - 1. Panduit Corp.
 - 2. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Markers for Conductors and Cables: Use wrap-around self-adhesive vinyl cloth, wrap-around self-adhesive vinyl self-laminating, heat-shrink sleeve, plastic sleeve, plastic clip-on, or vinyl split sleeve type markers suitable for the conductor or cable to be identified.
- C. Markers for Conductor and Cable Bundles: Use plastic marker tags secured by nylon cable ties.
- D. Legend: Power source and circuit number or other designation indicated.
- E. Text: Use factory pre-printed or machine-printed text, all capitalized unless otherwise indicated.
- F. Minimum Text Height: 1/8 inch.
- G. Color: Black text on white background unless otherwise indicated.
- H. Description: Vinyl cloth type self-adhesive wire markers.
- I. Description: split sleeve type wire markers.
- J. Locations: Each conductor at panelboard gutters, pull boxes, outlet boxes, and junction boxes each load connection.
- K. Legend:
 - 1. Power and Lighting Circuits: Branch circuit or feeder number indicated on drawings.
 - 2. Control Circuits: Control wire number indicated on shop drawings.

2.05 VOLTAGE MARKERS

- A. Manufacturers: Panduit Corp
 - 1. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Minimum Size:

1. Markers for Equipment: 1 1/8 by 4 1/2 inches.
 2. Markers for Conduits: As recommended by manufacturer for conduit size to be identified.
 3. Markers for Pull Boxes: 1 1/8 by 4 1/2 inches.
 4. Markers for Junction Boxes: 1/2 by 2 1/4 inches.
- C. Legend:
1. Markers for Voltage Identification: Highest voltage present.
 2. Markers for System Identification:
 - a. Emergency Power System: Text "EMERGENCY".
 - b. Other Systems: Type of service.
- D. Color: Black text on orange background unless otherwise indicated.
- E. Location: Furnish markers for each conduit longer than 6 feet.
- F. Spacing: 20 feet on center.
- G. Color:
1. 480 Volt System: Brown.
 2. 208 Volt System: Yellow.
 3. Fire Alarm System: Red.
- H. Legend:
1. 480 Volt System: brown.
 2. 208 Volt System: yellow.
 3. Fire Alarm System: red.

2.06 WARNING SIGNS AND LABELS

- A. Comply with ANSI Z535.2 or ANSI Z535.4 as applicable.
- B. Warning Signs:
1. Materials:
 2. Minimum Size: 7 by 10 inches unless otherwise indicated.
- C. Warning Labels:
1. Materials: Use factory pre-printed or machine-printed self-adhesive polyester or self-adhesive vinyl labels; UV, chemical, water, heat, and abrasion resistant; produced using materials recognized to UL 969.
 2. Machine-Printed Labels: Use thermal transfer process printing machines and accessories recommended by label manufacturer.
 3. Minimum Size: 2 by 4 inches unless otherwise indicated.

PART 3 EXECUTION

3.01 PREPARATION

- A. Clean surfaces to receive adhesive products according to manufacturer's instructions.
- B. Degrease and clean surfaces to receive nameplates and labels.

3.02 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.
- B. Install identification products to be plainly visible for examination, adjustment, servicing, and maintenance. Unless otherwise indicated, locate products as follows:
1. Surface-Mounted Equipment: Enclosure front.
 2. Flush-Mounted Equipment: Inside of equipment door.
 3. Free-Standing Equipment: Enclosure front; also enclosure rear for equipment with rear access.
 4. Elevated Equipment: Legible from the floor or working platform.
 5. Interior Components: Legible from the point of access.

- 6. Conductors and Cables: Legible from the point of access.
- C. Install identification products centered, level, and parallel with lines of item being identified.
- D. Secure nameplates to exterior surfaces of enclosures using stainless steel screws and to interior surfaces using self-adhesive backing or epoxy cement.
- E. Install self-adhesive labels and markers to achieve maximum adhesion, with no bubbles or wrinkles and edges properly sealed.

END OF SECTION

NOT FOR BIDDING PURPOSES

SECTION 26 27 17
EQUIPMENT WIRING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Electrical connections to equipment.

1.02 RELATED REQUIREMENTS

- A. Section 26 05 34 - Conduit.
- B. Section 26 05 19 - Low-Voltage Electrical Power Conductors and Cables (600 V and Less).
- C. Section 26 05 37 - Boxes.
- D. Section 26 27 26 - Wiring Devices.

1.03 REFERENCE STANDARDS

- A. NEMA WD 1 - General Color Requirements for Wiring Devices; National Electrical Manufacturers Association.
- B. NEMA WD 6 - Wiring Devices - Dimensional Requirements; National Electrical Manufacturers Association.
- C. NFPA 70 - National Electrical Code; National Fire Protection Association.

1.04 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide wiring device manufacturer's catalog information showing dimensions, configurations, and construction.
- C. Manufacturer's Instructions: Indicate application conditions and limitations of use stipulated by product testing agency. Include instructions for storage, handling, protection, examination, preparation, and installation of product.

1.05 QUALITY ASSURANCE

- A. Conform to requirements of NFPA 70.
- B. Products: Listed and classified by Underwriters Laboratories Inc. as suitable for the purpose specified and indicated.

1.06 COORDINATION

- A. Obtain and review shop drawings, product data, manufacturer's wiring diagrams, and manufacturer's instructions for equipment furnished under other sections.
- B. Determine connection locations and requirements.
- C. Sequence rough-in of electrical connections to coordinate with installation of equipment.
- D. Sequence electrical connections to coordinate with start-up of equipment.

PART 2 PRODUCTS

2.01 MATERIALS

- A. Cords and Caps: NEMA WD 6; match receptacle configuration at outlet provided for equipment.
 - 1. Colors: Conform to NEMA WD 1.
 - 2. Cord Construction: NFPA 70, Type SO, multiconductor flexible cord with identified equipment grounding conductor, suitable for use in damp locations.
 - 3. Size: Suitable for connected load of equipment, length of cord, and rating of branch circuit overcurrent protection.
 - 4. Product:

- 5. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Disconnect Switches: As specified in Section and in individual equipment sections.
- C. Wiring Devices: As specified in Section 26 27 26.
- D. Flexible Conduit: As specified in Section 26 05 34.
- E. Wire and Cable: As specified in Section 26 05 19.
- F. Boxes: As specified in Section 26 05 37.

2.02 EQUIPMENT CONNECTIONS

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that equipment is ready for electrical connection, wiring, and energization.

3.02 ELECTRICAL CONNECTIONS

- A. Make electrical connections in accordance with equipment manufacturer's instructions.
- B. Make conduit connections to equipment using flexible conduit. Use liquidtight flexible conduit with watertight connectors in damp or wet locations.
- C. Connect heat producing equipment using wire and cable with insulation suitable for temperatures encountered.
- D. Provide receptacle outlet to accommodate connection with attachment plug.
- E. Provide cord and cap where field-supplied attachment plug is required.
- F. Install suitable strain-relief clamps and fittings for cord connections at outlet boxes and equipment connection boxes.
- G. Install disconnect switches, controllers, control stations, and control devices to complete equipment wiring requirements.
- H. Install terminal block jumpers to complete equipment wiring requirements.
- I. Install interconnecting conduit and wiring between devices and equipment to complete equipment wiring requirements.
- J. Coolers and Freezers: Cut and seal conduit openings in freezer and cooler walls, floor, and ceilings.

END OF SECTION

SECTION 26 27 26
WIRING DEVICES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Wall switches.
- B. Wall dimmers.
- C. Receptacles.
- D. Wall plates.
- E. Floor box service fittings.

1.02 RELATED REQUIREMENTS

- A. Section 26 05 26 - Grounding and Bonding for Electrical Systems.
- B. Section 26 05 35 - Surface Raceways: Surface raceway systems, including multioutlet assemblies.
- C. Section 26 05 37 - Boxes.
- D. Section 26 05 53 - Identification for Electrical Systems: Identification products and requirements.
- E. Section 26 09 23 - Lighting Control Devices: Devices for automatic control of lighting, including occupancy sensors, in-wall time switches, and in-wall interval timers.
- F. Section 26 27 17 - Equipment Wiring: Cords and plugs for equipment.

1.03 REFERENCE STANDARDS

- A. FS W-C-596 - Connector, Electrical, Power, General Specification for; Federal Specification.
- B. FS W-S-896 - Switches, Toggle (Toggle and Lock), Flush-mounted (General Specification); Federal Specification.
- C. NECA 1 - Standard for Good Workmanship in Electrical Construction; National Electrical Contractors Association.
- D. NEMA WD 1 - General Color Requirements for Wiring Devices; National Electrical Manufacturers Association.
- E. NEMA WD 6 - Wiring Device -- Dimensional Requirements; National Electrical Manufacturers Association.
- F. NFPA 70 - National Electrical Code; National Fire Protection Association.
- G. UL 20 - General-Use Snap Switches.
- H. UL 498 - Attachment Plugs and Receptacles.
- I. UL 514D - Cover Plates for Flush-Mounted Wiring Devices.
- J. UL 943 - Ground-Fault Circuit-Interrupters.
- K. UL 1472 - Solid-State Dimming Controls.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Coordinate the placement of outlet boxes with millwork, furniture, equipment, etc. installed under other sections or by others.
 - 2. Coordinate wiring device ratings and configurations with the electrical requirements of actual equipment to be installed.
 - 3. Coordinate the installation and preparation of uneven surfaces, such as split face block, to provide suitable surface for installation of wiring devices.

4. Notify Architect of any conflicts or deviations from the contract documents to obtain direction prior to proceeding with work.

1.05 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide manufacturer's catalog information showing dimensions, colors, and configurations.
- C. Manufacturer's Installation Instructions: Indicate application conditions and limitations of use stipulated by product testing agency. Include instructions for storage, handling, protection, examination, preparation, and installation of product.

1.06 QUALITY ASSURANCE

- A. Conform to requirements of NFPA 70.
- B. Maintain at the project site a copy of each referenced document that prescribes execution requirements.
- C. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum three years documented experience.

1.07 DELIVERY, STORAGE, AND PROTECTION

- A. Store in a clean, dry space in original manufacturer's packaging until ready for installation.

1.08 EXTRA MATERIALS

- A. See Section 01 60 00 - Product Requirements, for additional provisions.
- B. Furnish two of each style, size, and finish wall plate.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Hubbell Incorporated; : www.hubbell-wiring.com.
- B. Leviton Manufacturing Company, Inc; : www.leviton.com.
- C. Lutron Electronics Company, Inc: www.lutron.com.
- D. Pass & Seymour, a brand of Legrand North America, Inc; : www.legrand.us
- E. Cooper Wiring Devices: www.cooperwiringdevices.com.
- F. Leviton Manufacturing, Inc: www.leviton.com.
- G. Substitutions: See Section 01 60 00 - Product Requirements.
- H. Source Limitations: Where possible, for each type of wiring device furnish products produced by a single manufacturer and obtained from a single supplier.

2.02 APPLICATIONS

- A. Provide wiring devices suitable for intended use and with ratings adequate for load served.
- B. For single receptacles installed on an individual branch circuit, provide receptacle with ampere rating not less than that of the branch circuit.
- C. Provide weather resistant GFI receptacles with specified weatherproof covers for all receptacles installed outdoors or in damp or wet locations.
- D. Provide GFI protection for all receptacles installed within 6 feet of sinks.
- E. Unless noted otherwise, do not use combination switch/receptacle devices.
- F. For flush floor service fittings, use carpet flanges for installations in carpeted floors.

2.03 ALL WIRING DEVICES

- A. Provide products listed and classified by Underwriters Laboratories Inc. as suitable for the purpose specified and indicated.

2.04 WALL SWITCHES

- A. Manufacturers:
 - 1. Hubbell Incorporated; : www.hubbell-wiring.com.
 - 2. Leviton Manufacturing Company, Inc; : www.leviton.com.
 - 3. Pass & Seymour, a brand of Legrand North America, Inc; : www.legrand.us
 - 4. Substitutions: See Section 01 60 00 - Product Requirements.
- B. All Wall Switches: AC only, quiet operating, general-use snap switches with silver alloy contacts, complying with NEMA WD 1 and NEMA WD 6, and listed as complying with UL 20 and where applicable, FS W-S-896; types as indicated on the drawings.
 - 1. Wiring Provisions: Terminal screws for side wiring and screw actuated binding clamp for back wiring with separate ground terminal screw.
- C. Standard Wall Switches: Commercial specification grade, 20 A, 120/277 V with standard toggle type switch actuator and maintained contacts; single pole single throw, double pole single throw, three way, or four way as indicated on the drawings.
- D. Wall Switches: Heavy Duty, AC only general-use snap switch, complying with NEMA WD 6 and WD 1.
 - 1. Body and Handle: White plastic with toggle handle.
 - 2. Ratings:
 - a. Voltage: 120 - 277 volts, AC.
 - b. Current: 20 amperes.
 - 3. Ratings: Match branch circuit and load characteristics.
- E. Switch Types: Single pole, double pole, 3-way, and 4-way.

2.05 WALL DIMMERS

- A. Manufacturers:
 - 1. Leviton Manufacturing Company, Inc; _____: www.leviton.com.
 - 2. Lutron Electronics Company, Inc; Maestro Series: www.lutron.com.
 - 3. Pass & Seymour, a brand of Legrand North America, Inc; _____: www.legrand.us
 - 4. Substitutions: See Section 01 60 00 - Product Requirements.
- B. All Wall Dimmers: Solid-state with continuous full-range even control following square law dimming curve, integral radio frequency interference filtering, power failure preset memory, air gap switch accessible without removing wall plate, complying with NEMA WD 1 and NEMA WD 6, and listed as complying with UL 1472; types and ratings suitable for load controlled as indicated on the drawings.
- C. Control: Slide control type with separate on/off switch.

2.06 RECEPTACLES

- A. Manufacturers:
 - 1. Hubbell Incorporated; : www.hubbell-wiring.com.
 - 2. Leviton Manufacturing Company, Inc; : www.leviton.com.
 - 3. Pass & Seymour, a brand of Legrand North America, Inc; : www.legrand.us
 - 4. Substitutions: See Section 01 60 00 - Product Requirements.
- B. All Receptacles: Self-grounding, complying with NEMA WD 1 and NEMA WD 6, and listed as complying with UL 498, and where applicable, FS W-C-596; types as indicated on the drawings.
 - 1. Wiring Provisions: Terminal screws for side wiring or screw actuated binding clamp for back wiring with separate ground terminal screw.

2. NEMA configurations specified are according to NEMA WD 6.
- C. GFI Receptacles:
 1. All GFI Receptacles: Provide with feed-through protection, light to indicate ground fault tripped condition and loss of protection, and list as complying with UL 943, class A.
- D. Receptacles: Heavy duty, complying with NEMA WD 6 and WD 1.
 1. Device Body: Black plastic.
 2. Configuration: NEMA WD 6, type as specified and indicated.
- E. Convenience Receptacles: Type 5 - 20.
- F. Single Convenience Receptacles.
- G. Duplex Convenience Receptacles.
- H. GFCI Receptacles: Convenience receptacle with integral ground fault circuit interrupter to meet regulatory requirements.

2.07 TELEPHONE JACKS

- A. Product: AMP manufacturing
- B. Substitutions: See Section 01 60 00 - Product Requirements.

2.08 WALL PLATES

- A. Manufacturers:
 1. Hubbell Incorporated; : www.hubbell-wiring.com.
 2. Leviton Manufacturing Company, Inc; : www.leviton.com.
 3. Pass & Seymour, a brand of Legrand North America, Inc; : www.legrand.us
 4. Substitutions: See Section 01 60 00 - Product Requirements.
- B. All Wall Plates: Comply with UL 514D.
 1. Configuration: One piece cover as required for quantity and types of corresponding wiring devices.
 2. Size: Standard; .
 3. Screws: Metal with slotted heads finished to match wall plate finish.
- C. Stainless Steel Wall Plates: Brushed satin finish, Type 302 stainless steel.
- D. Decorative Cover Plates: stainless steel.
- E. Jumbo Cover Plates: stainless steel.
- F. Weatherproof Cover Plates: Gasketed cast metal with hinged cover.

2.09 FLOOR BOX SERVICE FITTINGS

- A. Manufacturers:
 1. Hubbell Incorporated; : www.hubbell-wiring.com.
 2. Thomas & Betts Corporation; : www.tnb.com.
 3. Wiremold, a brand of Legrand North America, Inc; : www.legrand.us
 4. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Description: Service fittings compatible with floor boxes provided under Section 26 05 37 with all components, adapters, and trims required for complete installation.
- C. Flush Floor Service Fittings:
 1. Dual Service Flush Combination Outlets:
 - a. Cover: Rectangular.
 - b. Configuration:
 - 1) Power: One standard convenience duplex receptacle(s) with duplex flap opening(s).
 - 2) Communications: _____.

2. Accessories:
 - a. Carpet Flanges: Finish to match covers; configuration as required to accommodate specified covers.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field measurements are as shown on the drawings.
- B. Verify that outlet boxes are installed in proper locations and at proper mounting heights and are properly sized to accommodate devices and conductors in accordance with NFPA 70.
- C. Verify that wall openings are neatly cut and will be completely covered by wall plates.
- D. Verify that final surface finishes are complete, including painting.
- E. Verify that floor boxes are adjusted properly.
- F. Verify that branch circuit wiring installation is completed, tested, and ready for connection to wiring devices.
- G. Verify that openings in access floor are in proper locations.
- H. Verify that conditions are satisfactory for installation prior to starting work.

3.02 PREPARATION

- A. Provide extension rings to bring outlet boxes flush with finished surface.
- B. Clean dirt, debris, plaster, and other foreign materials from outlet boxes.

3.03 INSTALLATION

- A. Perform work in a neat and workmanlike manner in accordance with NECA 1 and, where applicable, NECA 130, including mounting heights specified in those standards unless otherwise indicated.
- B. Perform work in a neat and workmanlike manner in accordance with NECA 1, including mounting heights specified in that standard unless otherwise indicated.
- C. Coordinate locations of outlet boxes provided under Section 26 05 37 as required for installation of wiring devices provided under this section.
- D. Install wiring devices in accordance with manufacturer's instructions.
- E. Install permanent barrier between ganged wiring devices when voltage between adjacent devices exceeds 300 V.
- F. Where required, connect wiring devices using pigtails not less than 6 inches long. Do not connect more than one conductor to wiring device terminals.
- G. Connect wiring devices by wrapping conductor clockwise 3/4 turn around screw terminal and tightening to proper torque specified by the manufacturer. Where present, do not use push-in pressure terminals that do not rely on screw-actuated binding.
- H. Unless otherwise indicated, connect wiring device grounding terminal to branch circuit equipment grounding conductor and to outlet box with bonding jumper.
- I. Install securely, in a neat and workmanlike manner, as specified in NECA 1.
- J. Install wiring devices plumb and level with mounting yoke held rigidly in place.
- K. Install wall switches with OFF position down.
- L. Do not share neutral conductor on branch circuits utilizing wall dimmers.
- M. Install vertically mounted receptacles with grounding pole on top and horizontally mounted receptacles with grounding pole on left.

- N. Install wall plates to fit completely flush to wall with no gaps and rough opening completely covered without strain on wall plate. Repair or reinstall improperly installed outlet boxes or improperly sized rough openings. Do not use oversized wall plates in lieu of meeting this requirement.
- O. Install blank wall plates on junction boxes and on outlet boxes with no wiring devices installed or designated for future use.
- P. Install receptacles with grounding pole on top.
- Q. Connect wiring device grounding terminal to outlet box with bonding jumper.
- R. Install decorative plates on switch, receptacle, and blank outlets in finished areas.
- S. Connect wiring devices by wrapping conductor around screw terminal.
- T. Use jumbo size plates for outlets installed in masonry walls.
- U. Install galvanized steel plates on outlet boxes and junction boxes in unfinished areas, above accessible ceilings, and on surface mounted outlets.

3.04 INTERFACE WITH OTHER PRODUCTS

- A. Coordinate locations of outlet boxes provided under Section 26 05 37 to obtain mounting heights.
- B. Install wall switch 48 inches above finished floor.
- C. Install convenience receptacle 18 inches above finished floor.
- D. Install convenience receptacle 6 inches above backsplash of counter.
- E. Install telephone jack 18 inches above finished floor.
- F. Install telephone jack for side-reach wall telephone to position top of telephone at 54 inches above finished floor.
- G. Install telephone jack for forward-reach wall telephone to position top of telephone at 48 inches above finished floor.
- H. Coordinate installation of access floor boxes with access floor system provided under Section 09 69 00.
- I. Coordinate the installation of wiring devices with underfloor duct service fittings provided under Section 26 05 40.

3.05 FIELD QUALITY CONTROL

- A. Perform field inspection, testing, adjusting, and balancing in accordance with Section 01 40 00.
- B. Inspect each wiring device for damage and defects.
- C. Operate each wall switch, wall dimmer, and fan speed controller with circuit energized to verify proper operation.
- D. Operate each wall switch with circuit energized and verify proper operation.
- E. Verify that each receptacle device is energized.
- F. Test each receptacle to verify operation and proper polarity.
- G. Test each GFCI receptacle for proper tripping operation according to manufacturer's instructions.
- H. Correct wiring deficiencies and replace damaged or defective wiring devices.
- I. Verify that each telephone jack is properly connected and circuit is operational.

3.06 ADJUSTING

- A. Adjust devices and wall plates to be flush and level.

3.07 CLEANING

- A. Clean exposed surfaces to remove dirt, paint, or other foreign material and restore to match original factory finish.

END OF SECTION

NOT FOR BIDDING PURPOSES

NOT FOR BIDDING PURPOSES

SECTION 26 28 13

FUSES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Fuses.

1.02 REFERENCE STANDARDS

- A. NEMA FU 1 - Low Voltage Cartridge Fuses; National Electrical Manufacturers Association.
- B. NFPA 70 - National Electrical Code; National Fire Protection Association.
- C. UL 248-1 - Low-Voltage Fuses - Part 1: General Requirements.

1.03 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide manufacturer's standard data sheets including voltage and current ratings, interrupting ratings, time-current curves, and current limitation curves.

1.04 QUALITY ASSURANCE

- A. Conform to requirements of NFPA 70.
- B. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum three years documented experience and with service facilities within 100 miles of Project.
- C. Products: Listed and classified by Underwriters Laboratories Inc. as suitable for the purpose specified and indicated.

1.05 MAINTENANCE MATERIALS

- A. See Section 01 60 00 - Product Requirements, for additional provisions.
- B. Furnish two fuse pullers.
- C. Furnish three of each size and type fuse installed.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Cooper Bussmann, a division of Cooper Industries: www.cooperindustries.com.
- B. Mersen (formerly Ferraz Shawmut): ferrazshawmut.mersen.com.
- C. Littelfuse, Inc: www.littelfuse.com.
- D. Substitutions: See Section 01 60 00 - Product Requirements.

2.02 FUSES

- A. Provide products listed and classified by Underwriters Laboratories Inc. as suitable for the purpose indicated.
- B. Unless specifically indicated to be excluded, provide fuses for all fusible equipment as required for a complete operating system.
- C. Provide fuses of the same type, rating, and manufacturer within the same switch.
- D. Comply with UL 248-1.
- E. Unless otherwise indicated, provide cartridge type fuses complying with NEMA FU 1, Class and ratings as indicated.
- F. Voltage Rating: Suitable for circuit voltage.
- G. Power Load Feeder Switches: Class RK1 (time delay).

- H. Motor Load Feeder Switches: Class RK1 (time delay).
- I. Other Feeder Switches: Class RK1 (time delay).
- J. General Purpose Branch Circuits: Class RK1 (time delay).
- K. Motor Branch Circuits: Class L time delay.
- L. Lighting Branch Circuits: Class G.

2.03 CLASS RK1 (TIME DELAY) FUSES

- A. Manufacturers:
 - 1. Bussman Corp.
 - 2. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Construction: Current limiting, dual-element fuse, 10 seconds minimum at 500% rated amps, with copper fuse element.

2.04 CLASS G FUSES

PART 3 EXECUTION

3.01 INSTALLATION

- A. Do not install fuses until circuits are ready to be energized.
- B. Install fuses with label oriented such that manufacturer, type, and size are easily read.

END OF SECTION

NOT FOR BIDDING PURPOSES

SECTION 31 22 00
GRADING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Removal of topsoil.
- B. Rough grading the site for site structures and equipment pads.
- C. Finish grading .

1.02 RELATED REQUIREMENTS

- A. Section 31 23 16 - Excavation.
- B. Section 31 23 23 - Fill: Filling and compaction.
- C. Section 31 23 16.13 - Trenching: Trenching and backfilling for utilities.
- D. Section 32 92 19 - Seeding: Finish ground cover.

1.03 SUBMITTALS

- A. Project Record Documents: Accurately record actual locations of utilities remaining by horizontal dimensions, elevations or inverts, and slope gradients.

1.04 QUALITY ASSURANCE

- A. Perform Work in accordance with State of Delaware, Highway Department standards.
 - 1. Maintain one copy on site.

PART 2 PRODUCTS

2.01 MATERIALS

- A. Topsoil: Topsoil excavated on-site.
 - 1. Graded.
 - 2. Free of roots, rocks larger than 1/2 inch, subsoil, debris, large weeds and foreign matter.
- B. Other Fill Materials: See Section 31 23 23.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that survey bench mark and intended elevations for the Work are as indicated.

3.02 PREPARATION

- A. Identify required lines, levels, contours, and datum.
- B. Stake and flag locations of known utilities.
- C. Locate, identify, and protect from damage above- and below-grade utilities to remain.
- D. Protect site features to remain, including but not limited to bench marks, survey control points, existing structures, fences, sidewalks, paving, and curbs, from damage by grading equipment and vehicular traffic.
- E. Protect plants, lawns, rock outcroppings, and other features to remain as a portion of final landscaping.

3.03 ROUGH GRADING

- A. Remove topsoil from areas to be further excavated, re-landscaped, or re-graded, without mixing with foreign materials.
- B. Do not remove topsoil when wet.
- C. Remove subsoil from areas to be further excavated, re-landscaped, or re-graded.

- D. Do not remove wet subsoil, unless it is subsequently processed to obtain optimum moisture content.
- E. When excavating through roots, perform work by hand and cut roots with sharp axe.
- F. Stability: Replace damaged or displaced subsoil to same requirements as for specified fill.

3.04 SOIL REMOVAL

- A. Stockpile excavated topsoil on site.
- B. Stockpiles: Use areas designated on site; pile depth not to exceed 8 feet; protect from erosion.

3.05 FINISH GRADING

- A. Before Finish Grading:
 - 1. Verify building and trench backfilling have been inspected.
 - 2. Verify subgrade has been contoured and compacted.
- B. Remove debris, roots, branches, stones, in excess of 1/2 inch in size. Remove soil contaminated with petroleum products.
- C. In areas where vehicles or equipment have compacted soil, scarify surface to depth of 3 inches.
- D. Place topsoil where required to level finish grade.
- E. Place topsoil to the following compacted thicknesses:
 - 1. Areas to be Seeded with Grass: 6 inches.
- F. Place topsoil during dry weather.
- G. Remove roots, weeds, rocks, and foreign material while spreading.
- H. Near plants spread topsoil manually to prevent damage.
- I. Fine grade topsoil to eliminate uneven areas and low spots. Maintain profiles and contour of subgrade.
- J. Lightly compact placed topsoil.

3.06 REPAIR AND RESTORATION

- A. Existing Facilities, Utilities, and Site Features to Remain: If damaged due to this work, repair or replace to original condition.
- B. Other Existing Vegetation to Remain: If damaged due to this work, replace with vegetation of equivalent species and size.

3.07 FIELD QUALITY CONTROL

- A. See Section 31 23 23 for compaction density testing.

3.08 CLEANING

- A. Remove unused stockpiled topsoil. Grade stockpile area to prevent standing water.

END OF SECTION

SECTION 31 23 16
EXCAVATION

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Trenching for utilities outside the building to utility main connections and equipment pad construction.

1.02 RELATED REQUIREMENTS

- A. Section 01 70 00 - Execution and Closeout Requirements: General requirements for dewatering of excavations and water control.
- B. Section 31 22 00 - Grading: Soil removal from surface of site.
- C. Section 31 22 00 - Grading: Grading.
- D. Section 31 23 23 - Fill: Fill materials, filling, and compacting.

1.03 PROJECT CONDITIONS

- A. Verify that survey bench mark and intended elevations for the Work are as indicated.
- B. Protect plants, lawns, rock outcroppings, and other features to remain.
- C. Protect permanent structures and underground utilities from excavating equipment and vehicular traffic.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that survey bench mark and intended elevations for the work are as indicated.

3.02 PREPARATION

- A. Identify required lines, levels, contours, and datum locations.
- B. See Section 31 22 00 for additional requirements.
- C. Locate, identify, and protect utilities that remain and protect from damage.

3.03 EXCAVATING

- A. Underpin adjacent structures that could be damaged by excavating work.
- B. Excavate to accommodate new structures and construction operations.
- C. Notify Architect of unexpected subsurface conditions and discontinue affected Work in area until notified to resume work.
- D. Slope banks of excavations deeper than 4 feet to angle of repose or less until shored.
- E. Do not interfere with 45 degree bearing splay of foundations.
- F. Cut utility trenches wide enough to allow inspection of installed utilities.
- G. Hand trim excavations. Remove loose matter.
- H. Remove lumped subsoil, boulders, and rock up to 1/3 cu yd measured by volume.
- I. Correct areas that are over-excavated and load-bearing surfaces that are disturbed; see Section 31 23 23.
- J. Grade top perimeter of excavation to prevent surface water from draining into excavation.
- K. Remove excavated material that is unsuitable for re-use from site.
- L. Stockpile excavated material to be re-used in area designated on site in accordance with Section 31 22 00.

- M. Remove excess excavated material from site.

3.04 FIELD QUALITY CONTROL

- A. See Section 01 40 00 - Quality Requirements, for general requirements for field inspection and testing.
- B. Provide for visual inspection of load-bearing excavated surfaces before placement of foundations.

3.05 PROTECTION

- A. Prevent displacement of banks and keep loose soil from falling into excavation, maintain soil stability.
- B. Protect bottom of excavations and soil adjacent to and beneath foundation from freezing.

END OF SECTION

NOT FOR BIDDING PURPOSES

SECTION 31 23 23

FILL

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Filling, backfilling, and compacting for building volume below grade.

1.02 RELATED REQUIREMENTS

- A. Section 31 22 00 - Grading: Removal and handling of soil to be re-used.
- B. Section 31 22 00 - Grading: Site grading.
- C. Section 31 23 16 - Excavation: Removal and handling of soil to be re-used.
- D. Section 31 23 16.13 - Trenching: Excavating for utility trenches outside the building to utility main connections.

1.03 DEFINITIONS

- A. Finish Grade Elevations: Match existing.

1.04 REFERENCE STANDARDS

- A. AASHTO T 180 - Standard Specification for Moisture-Density Relations of Soils Using a 4.54 kg (10-lb) Rammer and a 457 mm (18 in.) Drop; American Association of State Highway and Transportation Officials
- B. ASTM D698 - Standard Test Methods for Laboratory Compaction Characteristics of Soil Using Standard Effort (12,400 ft-lbf/ft³ (600 kN-m/m³)).
- C. ASTM D1556 - Standard Test Method for Density and Unit Weight of Soil in Place by the Sand-Cone Method.
- D. ASTM D1557 - Standard Test Methods for Laboratory Compaction Characteristics of Soil Using Modified Effort (56,000 ft-lbf/ft³ (2,700 kN m/m³)).
- E. ASTM D2167 - Standard Test Method for Density and Unit Weight of Soil in Place by the Rubber Balloon Method.
- F. ASTM D 2922 - Standard Test Methods for Density of Soil and Soil-Aggregate in Place by Nuclear Methods (Shallow Depth).
- G. ASTM D3017 - Standard Test Method for Water Content of Soil and Rock in Place by Nuclear Methods (Shallow Depth).

1.05 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Compaction Density Test Reports.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. When necessary, store materials on site in advance of need.

PART 2 PRODUCTS

2.01 FILL MATERIALS

- A. General Fill: Subsoil excavated on-site.
 - 1. Graded.
 - 2. Free of lumps larger than 3 inches, rocks larger than 2 inches, and debris.
- B. Granular Fill: Coarse aggregate, conforming to State of Delaware Highway Department standard.
- C. Sand: Conforming to State of Delaware Highway Department standard.

- D. Topsoil: See Section 31 22 00.

2.02 SOURCE QUALITY CONTROL

- A. See Section 01 40 00 - Quality Requirements, for general requirements for testing and analysis of soil material.
- B. If tests indicate materials do not meet specified requirements, change material and retest.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Identify required lines, levels, contours, and datum locations.
- B. See Section 31 22 00 for additional requirements.

3.02 PREPARATION

- A. Scarify subgrade surface to a depth of 6 inches to identify soft spots.
- B. Cut out soft areas of subgrade not capable of compaction in place. Backfill with general fill.
- C. Compact subgrade to density equal to or greater than requirements for subsequent fill material.
- D. Until ready to fill, maintain excavations and prevent loose soil from falling into excavation.

3.03 FILLING

- A. Fill to contours and elevations indicated using unfrozen materials.
- B. Employ a placement method that does not disturb or damage other work.
- C. Systematically fill to allow maximum time for natural settlement. Do not fill over porous, wet, frozen or spongy subgrade surfaces.
- D. Maintain optimum moisture content of fill materials to attain required compaction density.
- E. Slope grade away from building minimum 2 inches in 10 ft, unless noted otherwise. Make gradual grade changes. Blend slope into level areas.
- F. Correct areas that are over-excavated.
1. Other areas: Use general fill, flush to required elevation, compacted to minimum 97 percent of maximum dry density.
- G. Compaction Density Unless Otherwise Specified or Indicated:
- H. Reshape and re-compact fills subjected to vehicular traffic.

3.04 FILL AT SPECIFIC LOCATIONS

- A. Pervious Structural Fill at equipment pads:
1. Use granular fill.
2. Maximum depth per lift: 6 inches, compacted.
3. Compact to minimum 95 percent of maximum dry density.
- B. Over Buried Utility Piping, Conduits, and Duct Bank in Trenches :
1. Cover with general fill.
2. Fill up to subgrade elevation.
3. Compact in maximum 8 inch lifts to 95 percent of maximum dry density.

3.05 FIELD QUALITY CONTROL

- A. See Section 01 40 00 - Quality Requirements, for general requirements for field inspection and testing.
- B. Perform compaction density testing on compacted fill in accordance with ASTM D1556, ASTM D2167, ASTM D2922, or ASTM D3017.

- C. Evaluate results in relation to compaction curve determined by testing uncompacted material in accordance with ASTM D698 ("standard Proctor"), ASTM D1557 ("modified Proctor"), or AASHTO T 180.
- D. If tests indicate work does not meet specified requirements, remove work, replace and retest.

3.06 CLEANING

- A. Remove unused stockpiled materials, leave area in a clean and neat condition. Grade stockpile area to prevent standing surface water.
- B. Leave borrow areas in a clean and neat condition. Grade to prevent standing surface water.

END OF SECTION

NOT FOR BIDDING PURPOSES