

ADDENDUM NO. 5

New Castle County Vocational Technical School District
Hodgson Vo-Tech High School
Bid Package E - Fieldhouse, Athletic Fields, and Storage Buildings

January 12, 2026

Page 1

THE BID DUE DATE HAS BEEN EXTENDED**Bids will be received until 3:00 PM local time on Tuesday, January 20, 2026.**

NOTICE: Attach this addendum to the project manual for this project. It modifies and becomes a part of the contract documents. Work or materials not specifically mentioned herein are to be described in the main body of the specifications and as shown in the drawings. Bidders shall acknowledge receipt of this addendum on the space provided on the Bid Form. Failure to do so may subject the bidder to disqualification.

Whenever this Addendum modifies a portion of the Project Manual added information is shown as **Bold** and deleted information is shown as ~~striketrough~~.

The contract documents for the above-mentioned project, Project Manual dated November 4, 2025, are amended as follows:

GENERAL CLARIFICATIONS:

1. Bid Documents may be viewed and downloaded at EDiS' FTP site. To obtain access to the FTP site, please submit your request via email to Jackie McKee at jmckee@ediscompany.com.
2. Physical copies of bids will be received at the office of New Castle County Vo-Tech School District, 1417 Newport Road, Wilmington, DE 19804 until **3:00 PM local time on Tuesday, January 20, 2026**. The outer envelope should clearly indicate: "NEW CASTLE COUNTY VOCATIONAL TECHNICAL SCHOOL DISTRICT - HODGSON VO-TECH BID PACKAGE E - FIELDHOUSE, ATHLETIC FIELDS, AND STORAGE BUILDINGS CONTRACT BPE-_____ SEALED BID – DO NOT OPEN." Bids may be hand delivered or mailed/shipped. Electronic bids will not be accepted. Bidder assumes full responsibility for timely delivery at location designated for receipt of bids. Any bids received after the stated time will be returned unopened.
3. PAC CLAD 7.2 is approved as an equal to the specified metal roof and wall panels, Section 074213.13. Material is to be .050 aluminum as specified. See attached spec sheet.
4. The irrigation well flow reports are attached to this addendum for your use. Based on the results we anticipate installing a 35 GPM pump in the well at the school in Phase 1 and a 75 GPM pump at the well in the parking area for the baseball and softball fields in Phase 2.



**ADDENDUM NO. 5**

New Castle County Vocational Technical School District
Hodgson Vo-Tech High School
Bid Package E - Fieldhouse, Athletic Fields, and Storage Buildings

January 12, 2026

Page 2

QUESTIONS AND ANSWERS:

1. See attached Pre-bid RFI log for revised responses.

MODIFICATIONS TO SPECIFICATIONS:

1. SECTION 004100 - BID FORM AND ATTACHMENTS CONTRACT NO: E-04 - STRUCTURAL STEEL JOISTS, DECK AND MISC. METALS
 - a. DELETE Contract E-04 Bid Form in its entirety and INSERT revised Contract E-04 Bid Form, annotated Addendum No. 5 and dated January 10, 2026.

MODIFICATIONS TO DRAWINGS:

N/A

LIST OF ATTACHMENTS:

Pre-bid RFI Log
Approved Substitution - PAC CLAD 7.2 Spec Sheet
Well Flow Report
Section 004100 - Bid Form Contract No: E-04 - Structural Steel Joists, Deck and Misc. Metals

End of Addendum No. 5



7.2 PANEL

MATERIALS

.032 aluminum	24 gauge steel
.040 aluminum	22 gauge steel
.050 aluminum	Galvalume Plus

SPECS

36" Wide 1-1/2" High

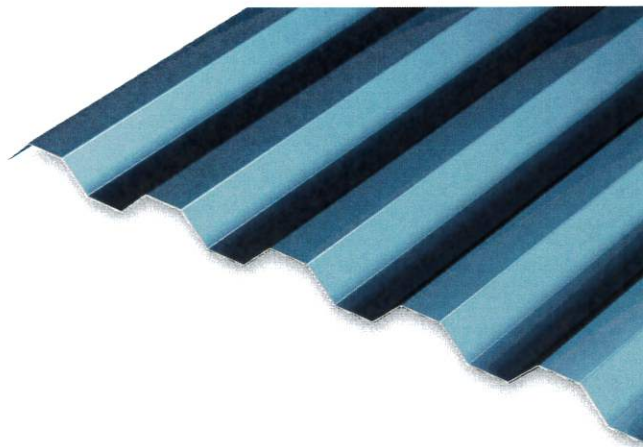

PRODUCT FEATURES

- ▶ 35-year non-prorated finish warranty
- ▶ Matching screws and rivets
- ▶ Closure strips available
- ▶ Precut short lengths (5'-0" minimum) (3'-0" on the M-42)
- ▶ Panel lengths up to 30' on steel and 22' on aluminum

MATERIAL

- ▶ 24 gauge steel
- ▶ 22 gauge steel
- ▶ .032 aluminum
- ▶ .040 aluminum
- ▶ .050 aluminum
- ▶ Galvalume Plus available

FLORIDA BUILDING PRODUCT APPROVALS

Please refer to pac-clad.com or your local factory for specific product approval numbers for exposed fastener panels.

A.C. SCHULTES OF DELAWARE, INC.
PUMPING TEST REPORT

CUSTOMER: EDIS - HODGSON VO TECH

JOB #: 9162

DATE: 9/5/2025

WELL NO: TW#1

Well by Building Phase I

WELL DIA: 4"

WELL DEPTH: 71'

PERMIT TAG #: 289436

STATIC: 19.58'

DISTANCE PUMPED TO WELL: 0 FEET

STATIC LEVEL AT START: 19.58 FEET

PUMPING RATE: 54.4 GPM

SPECIFIC CAPACITY: 1.41 GPM/FT DD

TEST TIME (GPM)	CAPACITY (GPM)	PUMPING LEVEL (FEET)	DRAWDOWN (FEET)
0.00	54.4	19.44	-0.14
0.73	54.4	31.28	11.70
0.77	54.4	26.39	6.81
0.80	54.4	29.30	9.72
0.84	54.4	31.78	12.20
0.88	54.4	33.97	14.39
0.92	54.4	35.84	16.26
0.97	54.4	37.37	17.79
1.01	54.4	38.73	19.15
1.06	54.4	40.00	20.42
1.12	54.4	41.18	21.60
1.17	54.4	42.28	22.70
1.23	54.4	42.97	23.39
1.29	54.4	44.13	24.55
1.36	54.4	45.42	25.84
1.43	54.4	46.24	26.66
1.50	54.4	47.06	27.48
1.58	54.4	47.79	28.21
1.67	54.4	48.41	28.83
1.75	54.4	49.01	29.43
1.86	54.4	49.54	29.96
1.95	54.4	50.13	30.55
2.05	54.4	50.56	30.98
2.16	54.4	51.00	31.42
2.28	54.4	51.48	31.90
2.41	54.4	51.91	32.33
2.54	54.4	51.98	32.40
2.68	54.4	50.38	30.80
2.83	54.4	49.71	30.13
2.99	54.4	49.50	29.92

TEST TIME (GPM)	CAPACITY (GPM)	PUMPING LEVEL (FEET)	DRAWDOWN (FEET)
3.15	54.4	49.33	29.75
3.33	54.4	49.40	29.82
3.53	54.4	49.50	29.92
3.72	54.4	49.62	30.04
3.93	54.4	49.70	30.12
4.15	54.4	49.95	30.37
4.39	54.4	50.11	30.53
4.64	54.4	50.28	30.70
4.90	54.4	50.50	30.92
5.18	54.4	50.66	31.08
5.48	54.4	50.84	31.26
5.79	54.4	51.02	31.44
6.13	54.4	51.20	31.62
6.48	54.4	51.48	31.90
6.85	54.4	51.64	32.06
7.25	54.4	51.76	32.18
7.67	54.4	52.03	32.45
8.12	54.4	52.21	32.63
8.58	54.4	52.42	32.84
9.08	54.4	52.57	32.99
9.61	54.4	52.77	33.19
10.17	54.4	52.90	33.32
10.77	54.4	53.11	33.53
11.37	54.4	53.38	33.80
12.07	54.4	53.64	34.06
12.77	54.4	53.82	34.24
13.47	54.4	54.05	34.47
14.27	54.4	54.16	34.58
15.17	54.4	54.30	34.72
15.97	54.4	54.64	35.06
16.97	54.4	54.83	35.25
17.97	54.4	54.92	35.34
18.97	54.4	55.09	35.51
20.07	54.4	53.10	33.52
21.27	54.4	52.28	32.70
22.57	54.4	52.20	32.62
23.87	54.4	52.20	32.62
25.27	54.4	52.20	32.62
26.77	54.4	52.31	32.73
28.37	54.4	52.42	32.84
29.97	54.4	52.49	32.91
31.77	54.4	52.56	32.98
33.67	54.4	52.74	33.16
35.67	54.4	52.86	33.28
37.77	54.4	52.93	33.35
39.97	54.4	53.13	33.55
42.37	54.4	53.13	33.55
44.87	54.4	53.28	33.70
47.47	54.4	53.40	33.82
50.27	54.4	53.62	34.04
53.27	54.4	53.78	34.20

TEST TIME (GPM)	CAPACITY (GPM)	PUMPING LEVEL (FEET)	DRAWDOWN (FEET)
56.37	54.4	53.88	34.30
59.77	54.4	54.08	34.50
63.27	54.4	54.26	34.68
66.97	54.4	54.30	34.72
70.98	54.4	54.56	34.98
75.17	54.4	54.77	35.19
79.57	54.4	54.90	35.32
84.27	54.4	55.04	35.46
89.27	54.4	55.10	35.52
94.57	54.4	55.10	35.52
100.17	54.4	55.26	35.68
106.17	54.4	55.66	36.08
112.17	54.4	55.75	36.17
119.17	54.4	55.90	36.32
126.17	54.4	56.04	36.46
133.17	54.4	56.25	36.67
141.17	54.4	56.44	36.86
150.17	54.4	56.55	36.97
158.17	54.4	56.77	37.19
168.17	54.4	56.97	37.39
178.17	54.4	57.10	37.52
188.17	54.4	57.31	37.73
198.17	54.4	57.45	37.87
208.17	54.4	57.57	37.99
218.17	54.4	57.70	38.12
228.17	54.4	57.80	38.22
238.17	54.4	57.96	38.38
248.17	54.4	58.02	38.44
258.17	54.4	58.13	38.55

A.C. SCHULTES OF DELAWARE, INC.
PUMPING TEST REPORT

CUSTOMER: EDIS - HODGSON VO TECH
JOB #: 9162
DATE: 9/3/2025
WELL NO: TW#2 Well by Parking Area Phase II
WELL DIA: 4"
WELL DEPTH: 90'
PERMIT TAG #: 289437
STATIC: 21.72'

DISTANCE PUMPED TO WELL: 0 FEET
STATIC LEVEL AT START: 21.72 FEET
PUMPING RATE: 114 GPM
SPECIFIC CAPACITY: 1.97 GPM/FT DD

TEST TIME (GPM)	CAPACITY (GPM)	PUMPING LEVEL (FEET)	DRAWDOWN (FEET)
0.00	114	21.61	-0.11
0.67	114	25.44	3.72
0.71	114	29.20	7.48
0.75	114	32.30	10.58
0.79	114	34.24	12.52
0.84	114	35.57	13.85
0.89	114	36.41	14.69
0.94	114	37.09	15.37
1.00	114	37.58	15.86
1.06	114	37.82	16.10
1.12	114	38.14	16.42
1.19	114	38.51	16.79
1.26	114	38.73	17.01
1.33	114	38.99	17.27
1.41	114	39.12	17.40
1.50	114	39.36	17.64
1.58	114	39.54	17.82
1.68	114	39.77	18.05
1.78	114	39.96	18.24
1.88	114	40.12	18.40
1.99	114	40.22	18.50
2.11	114	40.46	18.74
2.24	114	40.61	18.89

TEST TIME (GPM)	CAPACITY (GPM)	PUMPING LEVEL (FEET)	DRAWDOWN (FEET)
2.37	114	40.81	19.09
2.51	114	40.91	19.19
2.66	114	41.04	19.32
2.82	114	41.16	19.44
2.98	114	41.37	19.65
3.16	114	41.53	19.81
3.35	114	41.65	19.93
3.55	114	41.76	20.04
3.76	114	42.01	20.29
3.98	114	42.02	20.30
4.22	114	42.17	20.45
4.47	114	42.29	20.57
4.73	114	42.43	20.71
5.01	114	42.66	20.94
5.31	114	42.78	21.06
5.62	114	42.86	21.14
5.96	114	43.07	21.35
6.31	114	43.20	21.48
6.68	114	43.32	21.60
7.08	114	43.44	21.72
7.50	114	43.49	21.77
7.94	114	43.66	21.94
8.41	114	43.82	22.10
8.91	114	43.94	22.22
9.44	114	44.14	22.42
10.00	114	44.23	22.51
10.60	114	44.39	22.67
11.20	114	44.53	22.81
11.90	114	44.65	22.93
12.60	114	44.82	23.10
13.30	114	44.94	23.22
14.10	114	45.06	23.34
15.00	114	45.18	23.46
15.80	114	45.28	23.56
16.80	114	45.51	23.79
17.80	114	45.65	23.93
18.80	114	45.78	24.06
19.90	114	45.84	24.12
21.10	114	46.08	24.36
22.40	114	45.97	24.25
23.70	114	46.27	24.55
25.10	114	46.40	24.68
26.60	114	46.51	24.79
28.20	114	46.69	24.97

TEST TIME (GPM)	CAPACITY (GPM)	PUMPING LEVEL (FEET)	DRAWDOWN (FEET)
29.80	114	46.89	25.17
31.61	114	46.95	25.23
33.50	114	47.15	25.43
35.50	114	47.34	25.62
37.60	114	47.47	25.75
39.80	114	47.68	25.96
42.20	114	47.80	26.08
44.71	114	48.01	26.29
47.30	114	48.21	26.49
50.10	114	48.29	26.57
53.10	114	48.57	26.85
56.20	114	48.79	27.07
59.60	114	48.95	27.23
63.10	114	49.14	27.42
66.80	114	49.41	27.69
70.80	114	49.54	27.82
75.00	114	49.76	28.04
79.40	114	49.96	28.24
84.10	114	50.16	28.44
89.10	114	50.44	28.72
94.40	114	50.52	28.80
100.00	114	50.86	29.14
106.00	114	51.00	29.28
112.00	114	51.28	29.56
119.00	114	51.42	29.70
126.00	114	51.66	29.94
133.00	114	51.81	30.09
141.00	114	52.13	30.41
150.00	114	52.37	30.65
158.00	114	52.60	30.88
168.00	114	52.79	31.07
178.00	114	53.08	31.36
188.00	114	53.27	31.55
198.00	114	53.40	31.68
208.00	114	53.68	31.96
218.00	114	53.93	32.21
228.00	114	54.05	32.33
238.00	114	54.25	32.53
248.00	114	54.40	32.68
258.00	114	54.55	32.83
268.00	114	53.21	31.49
278.00	114	79.62	57.90
288.00	114	79.54	57.82
298.00	114	79.60	57.88

TEST TIME (GPM)	CAPACITY (GPM)	PUMPING LEVEL (FEET)	DRAWDOWN (FEET)
308.00	114	79.58	57.86

RFI No.	Date	Submitted By	Sheet No.	Detail/Section	Question	EDiS Response	Design Team Response	Addendum
040	12/15/25	Worth & Company			Who will own bringing in the fire protection service?	Contract E-14 Fire Protection shall coordinate with the site contractors installation to pick up the fire line five feet from the building and install in to the building. Contract E-14 Fire Protection to provide a registered plumbing contractor licensed to perform the tie in as part of their base bid.		5
052	12/20/25	RE Pierson			According to the spec this project requires a 7% DBE requirement. Since the federal government has stop the DBE program for now, who qualifies as a DBE? Does the State of Delaware still see those listed on the Civil Rights Compliance Reporting as DBE qualified?	For this Pilot Program, the DBE requirements remain as described in the documents. A contractor would need to be certified as a DBE by either OSD (state of DE) or DNREC De IDOT. Since DNREC De IDOT must follow USDOT requirements; many of the previously certified DBE contractors would need to get re-certified with DNREC De IDOT or go to OSD and register for DBE certification. If you are a DBE contractor and are not registered with DeIDOT or the Office of Supply Diversity State of Delaware, you can contact Shavonne White at OSD and she will help you understand the procedure and work to get you certified. Shavonne can be reached at 302-577-8497 or shavonne.white@delaware.gov.		5
073	12/22/25	Assurance Media	FA-T500		Drawing FA-T500, Detail #2 Wireless Access Points, Note #8 has the following: PROVIDE AND INSTALL A WIRELESS ACCESS POINT ON EACH SITE LIGHT POLE WITH A CCTV CAMERA FOR A TOTAL OF SEVEN LIGHT POLE WAPS. Please provide Exterior Wap locations on drawing FA-T100 Technology Site Drawing. Please specify what specific cabling is to go to each of these WAP locations. If fiber is to be utilized to these locations will others be providing some sort of cabinet or NEMA enclosure for network equipment and fiber terminations etc...?	Per NCCVT Gamechanger copper cable is acceptable for site cameras over 90 meters. Gamechanger copper cable in "NOT" acceptable for use per NCCVT. Fiber shall be utilized to all poles.	There are two light poles with WAPs noted on Sheet FA-T100. Disregard Note 8, Detail 2 on Sheet FA-T500. Owner shall provide input if Gamechanger Copper cable is acceptable to light poles or if the specified powered fiber should be used. All equipment should be included for a complete and active installation. (Copper cables, powered fiber, modules, enclosures, etc.,)	5
089	12/30/25	Joseph Rizzo			RFI #17 in addendum 1 was us asking for a wall section for the dumpster enclosure built into building E-1. EDiS responded say that the dumpster pad was already provided. Does that mean the dumpster enclosure walls have already been built even though building E-1, which is part of the dumpster enclosure, has not?	The dumpster wall that is part of the E-1 building has not been built. It remains as part of the scope for BP-E		5
171	1/5/26	Assurance Media			Addendum #2 Question #73 awaiting confirmation - Will Game Changer cable be approved for cameras at pole locations?	See RFI response #073		5

CONTRACT NO: E-04 - STRUCTURAL STEEL, JOISTS, DECK AND MISC. METALS

BID FORM

For Bids Due: _____

To: NCCVT School District
1417 Newport Road
Wilmington, DE 19804

Name of Bidder: _____

Bidder Address: _____

Contact Name: _____ E-Mail Address: _____

Delaware Business License No.: _____ Taxpayer ID No.: _____

(Other License Nos.): _____

(A copy of Bidder's Licenses must be attached to this form.)

Phone No.: (____) _____ - _____

Fax No.: (____) _____ - _____

The undersigned, representing that he has read and understands the Bidding Documents and that this bid is made in accordance therewith, that he has visited the site and has familiarized himself with the local conditions under which the Work is to be performed, and that his bid is based upon the materials, systems and equipment described in the Bidding Documents without exception, hereby proposes and agrees to provide all labor, materials, plant, equipment, supplies, transport and other facilities required to execute the work described by the aforesaid documents for the lump sum itemized below:

\$ _____ (\$ _____)

ALTERNATES

Alternate prices conform to applicable project specification section. Refer to specifications for a complete description of the following Alternates. An "ADD" or "DEDUCT" amount is indicated by the crossed out part that does not apply.

Alternate No. 3: Provide Building E1 work associated with your contract scope.

Add/Deduct _____ (\$ _____)

Alternate No. 4: Provide Building E5 work associated with your contract scope.

Add/Deduct _____ (\$ _____)

ALLOWANCES

We/I confirm that an Allowances in the amount of \$20,000 have been included in the Base Bid price listed above. This allowance is to be used at the Owner and Construction Manager's discretion. All remaining allowance shall be returned to the Owner at completion.

I/We acknowledge Addendums numbered _____ and the price(s) submitted include any cost/schedule impact they may have.

This bid shall remain valid and cannot be withdrawn for sixty (60) days from the date of opening of bids, and the undersigned shall abide by the Bid Security forfeiture provisions. Bid Security is attached to this Bid (if required).

The Owner shall have the right to reject any or all bids, and to waive any informality or irregularity in any bid received.

This bid is based upon work being accomplished by the Sub-Contractors named on the list attached to this bid.

Should I/We be awarded this contract, I/We pledge to achieve substantial completion of all the work within the durations included in the bid schedule provided and Section 013216 Const. Schedule.

The undersigned represents and warrants that he has complied and shall comply with all requirements of local, state, and national laws; that no legal requirement has been or shall be violated in making or accepting this bid, in awarding the contract to him or in the prosecution of the work required; that the bid is legal and firm; that he has not, directly or indirectly, entered into any agreement, participated in any collusion, or otherwise taken action in restraint of free competitive bidding.

Upon receipt of written notice of the acceptance of this Bid, the Bidder shall, within twenty (20) calendar days, execute the agreement in the required form and deliver the Contract Bonds, and Insurance Certificates, required by the Contract Documents.

I am/We are an Individual/a Partnership/a Corporation

By _____ Trading as _____
(Individual's / General Partner's / Corporate Name)

(State of Corporation)

Business Address:

Witness: _____ By: _____

(SEAL)

(Authorized Signature)

(Title)

Date: _____

ATTACHMENTS

Sub-Contractor List

Non-Collusion Statement

Bid Bond

Consent of Surety

Affidavit of Employee Drug Testing Program

Affidavit of Contractor Qualifications

DBE Subcontractor List

New Castle County Contractor License

(Others as Required by Project Manuals)

SUBCONTRACTOR LIST

In accordance with Title 29, Chapter 69, Section 6962(d)(10)b of the Delaware Code, the following subcontractor listing must accompany any bid submittal. The bidder must list in **each category** the full name and address (City & State) of the sub-contractor that the bidder will be using to perform the work and provide material for that subcontractor category. Should the bidder's listed subcontractor intend to provide any of their subcontractor category of work through a third-tier contractor, the bidder shall list that third-tier contractor's full name and address (City & State). **If the bidder intends to perform any category of work itself, it must list its full name and address.** For clarification, if the bidder intends to perform the work themselves, the bidder **may not** insert "not applicable", "N/A", "self" or anything other than its own full name and address (City & State). To do so shall cause the bid to be rejected. In addition, the failure to produce a completed subcontractor list with the bid submittal shall cause the bid to be rejected. If you have more than three (3) third-tier contractors to report in any subcontractor category, print out additional page(s) containing the appropriate category, complete the rest of your list of third-tier contractors for that category, notate the addition in parentheses as (CONTINUATION) next to the subcontractor category and an asterisk (*) next to any additional third-tier contractors, and submit it with your bid.

<u>Subcontractor Category</u>	<u>Subcontractor</u>	<u>Address (City & State)</u>	<u>Subcontractors tax-payer ID # or Delaware Business license #</u>
1. <u>Structural Steel</u>	_____	_____	_____
2. <u>Miscellaneous Metals</u>	_____	_____	_____
3. _____	_____	_____	_____
4. _____	_____	_____	_____
5. _____	_____	_____	_____
6. <u>NO ADDITIONAL ENTRIES REQUIRED</u>			

NON-COLLUSION STATEMENT

This is to certify that the undersigned bidder has neither directly nor indirectly, entered into any agreement, participated in any collusion or otherwise taken any action in restraint of free competitive bidding in connection with this proposal submitted this date _____.

All the terms and conditions of Contract: _____ have been thoroughly examined and are understood.

NAME OF BIDDER: _____

AUTHORIZED REPRESENTATIVE
(TYPED): _____

AUTHORIZED REPRESENTATIVE
(SIGNATURE): _____

TITLE: _____

ADDRESS OF BIDDER: _____

E-MAIL: _____

PHONE NUMBER: _____

Sworn to and Subscribed before me this _____ day of _____ 20____.

My Commission expires _____. NOTARY PUBLIC _____.

THIS PAGE MUST BE SIGNED AND NOTARIZED FOR YOUR BID TO BE CONSIDERED.

CONSENT OF SURETY

DATE _____

To: NCC Vocational Technical School District
1417 Newport Road
Wilmington, DE 19804

Gentlemen:

We, the _____

(Surety Company's Address)

a Surety Company authorized to do business in the State of Delaware hereby agrees that if

(Contractor)

(Address)

is awarded the Contract No. _____

We will write the required Performance and/or Labor and Material Bond required by Paragraph 9 of the Instructions to Bidders.

(Surety Company)

By _____
(Attorney-in-Fact)

AFFIDAVIT
OF
EMPLOYEE DRUG TESTING PROGRAM

4104 Regulations for the Drug Testing of Contractor and Subcontractor Employees Working on Large Public Works Projects requires that Contractors and Subcontractors implement a program of mandatory drug testing for Employees who work on Large Public Works Contracts funded all or in part with public funds.

We hereby certify that we have in place or will implement during the entire term of the contract a Mandatory Drug Testing Program for our employees on the jobsite, including subcontractors, that complies with this regulation:

Contractor/Subcontractor Name: _____

Contractor/Subcontractor Address: _____

Authorized Representative (typed or printed): _____

Authorized Representative (signature): _____

Title: _____

Sworn to and Subscribed before me this _____ day of _____ 20_____.

My Commission expires _____. NOTARY PUBLIC _____.

THIS PAGE MUST BE SIGNED AND NOTARIZED FOR YOUR BID TO BE CONSIDERED.

**AFFIDAVIT
OF
CONTRACTOR QUALIFICATIONS**

We hereby certify that we will abide by the contractor's qualifications outlined in the construction bid specifications for the duration of the contract term.

In accordance with Title 29, Chapter 69, Section 6962(d)(10)b.3 of the Delaware Code, after a contract has been awarded the successful bidder shall not substitute another subcontractor whose name was submitted on the Subcontractor Form except for the reasons in the statute and not without written consent from the awarding agency. Failure to utilize the subcontractors on the list will subject the successful bidder to penalties as outlined in the General Requirements Section 5.2 of the contract.

Contractor Name: _____

Contractor Address: _____

Authorized Representative (typed or printed): _____

Authorized Representative (signature): _____

Title: _____

Sworn to and Subscribed before me this _____ day of _____, 20____.

My Commission expires _____. NOTARY PUBLIC _____.

THIS PAGE MUST BE SIGNED AND NOTARIZED FOR YOUR BID TO BE CONSIDERED.

DBE SUBCONTRACTOR LIST

DBE Name	DBE Address	DBE Phone Number	DBE Email address	DelDOT or OSD Registration Number	DBE % of Contract	Description of Work

Total DBEs on project: _____

END OF SECTION