

STATE OF DELAWARE
OMB/DIVISION OF FACILITIES MANAGEMENT
OMB/DFM PROJECT #MC1002001114

**SPECIFICATIONS
FOR**

HVAC UNIT REPLACEMENT

IN

DELAWARE STATE POLICE CRIME LAB
1441 N DUPONT HIGHWAY
DOVER, DELAWARE, 19901

PREPARED BY



ISSUED FOR BID
SEPTEMBER 2026
DEDC PROJECT # 25P269

NOT FOR BIDDING PURPOSES

STATE OF DELAWARE
OMB/DIVISION OF FACILITIES MANAGEMENT
OMB/DFM PROJECT #MC1002001114

SPECIFICATIONS
FOR
HVAC UNIT REPLACEMENT

IN
DELAWARE STATE POLICE CRIME LAB
1441 N DUPONT HIGHWAY
DOVER, DELAWARE, 19901

PREPARED BY



ISSUED FOR BID
SEPTEMBER 2026
DEDC PROJECT # 25P269

NOT FOR BIDDING PURPOSES

THIS PAGE INTENTIONALLY LEFT BLANK

SEALS PAGE

1.1 DESIGN PROFESSIONALS OF RECORD


SEAL

A. HVAC/Electrical Engineer:

1. **Matt Lano P.E.**
2. **Delaware P.E. # 24393**
3. **Mechanical Engineer**
4. **DEDC, LLC**
5. **315 South Chapel Street
Newark, Delaware, 19711**
6. **Phone: 302-738-7172, Fax: 302-738-7175**
7. **mlano@dedc-eng.com, 302-738-7172**
8. **Responsible for Div 00-48 Sections except where
indicated as prepared by other design professionals of record.**

B. Architect:

- 1 **Brenden Frederick**
- 2 **License No. 8204**
- 3 **Architect**
- 4 **Becker Morgan Group, Inc.**
- 5 **312 West Main Street, Suite 300
Salisbury, MD 21801**
- 6 **Phone: 410-546-9100, Fax: 410-546-5824**
- 7 **bffrederick@beckermorgan.com, 267-253-5596**
- 8 **Responsible for Div 02, 04, 06, 07, 08, 09 Sections.**

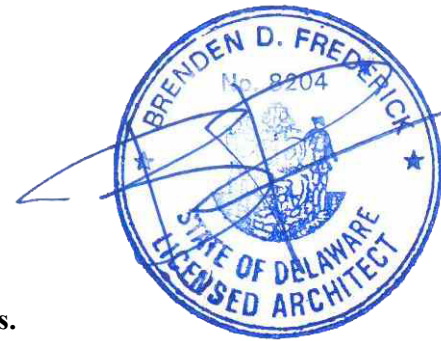

THIS PAGE INTENTIONALLY LEFT BLANK

NOT FOR BIDDING PURPOSES

**SECTION 00 01 10
TABLE OF CONTENTS**

- A. Specifications for this project are arranged in accordance with the Construction Specification Institute numbering system and format. Section numbering is discontinuous and all numbers not appearing in the Table of Contents are not used for this Project.
- B. DOCUMENTS BOUND HERewith

DIVISION 00 - PROCUREMENT AND CONTRACT REQUIREMENTS

INTRODUCTORY INFORMATION

00 01 01 - PROJECT TITLE PAGE
00 01 07 – SEALS PAGE
00 01 10 - TABLE OF CONTENTS
00 01 15 - LIST OF DRAWING SHEETS

PROCUREMENT REQUIREMENTS

00 11 16 - INVITATION TO BID
00 21 13 - INSTRUCTIONS TO BIDDERS
00 41 13 - BID FORM
00 43 13 - BID BOND

CONTRACTING REQUIREMENTS

00 52 13 - STANDARD FORM OF AGREEMENT BETWEEN OWNER AND CONTRACTOR
(SAMPLE AIA A101-2017)
(SAMPLE AIA A101-2017 EXHIBIT A)
00 54 13 - SUPPLEMENT TO AGREEMENT BETWEEN OWNER & CONTRACTOR A101-2017
00 54 14 – SUPPLEMENT TO A101-2017 – EXHIBIT A INSURANCE AND BONDS
00 61 13.13 - PERFORMANCE BOND
00 61 13.16 - PAYMENT BOND
00 62 76 - APPLICATION AND CERTIFICATE FOR PAYMENT FORMS
(SAMPLE AIA G702 & G703)
00 63 73 - ALLOWANCE AUTHORIZATION
00 65 00 – CLOSEOUT FORMS
(SAMPLE AIA G704-2017)
(SAMPLE AIA G706-1994)
(SAMPLE AIA G706A-1994)
(SAMPLE AIA G707-1994)
00 72 13 - GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION A201-2017

(SAMPLE AIA A201-2017)

00 73 13 - SUPPLEMENTARY GENERAL CONDITIONS A201-2017

00 73 46 - WAGE DETERMINATION SCHEDULE

00 81 13 - GENERAL REQUIREMENTS

00 81 14 - DRUG TESTING FORMS

00 81 15 – AFFIDAVIT OF CRAFT TRAINING COMPLIANCE

DIVISION 01 - GENERAL REQUIREMENTS

01 10 00 - SUMMARY

01 20 00 - PRICE AND PAYMENT PROCEDURES

01 21 00 - ALLOWANCES

01 26 00 - CONTRACT MODIFICATION PROCEDURES

01 30 00 - ADMINISTRATIVE REQUIREMENTS

01 40 00 - QUALITY REQUIREMENTS

01 50 00 - TEMPORARY FACILITIES AND CONTROL

01 60 00 - PRODUCT REQUIREMENTS

01 70 00 - EXECUTION AND CLOSEOUT REQUIREMENTS

01 74 19 - CONSTRUCTION WASTE MANAGEMENT AND DISPOSAL

01 78 00 - CLOSEOUT SUBMITTALS

01 79 00 - DEMONSTRATION AND TRAINING

01 91 13 - GENERAL COMMISSIONING REQUIREMENTS

DIVISION 02 – EXISTING CONDITIONS

02 41 00 - DEMOLITION

DIVISION 03 - CONCRETE

03 30 00 - CAST-IN PLACE CONCRETE

DIVISION 04 - MASONRY

04 20 00 – UNIT MASONRY

DIVISION 06 – WOODS, PLASTICS, AND DEPOSITS

06 10 00 – ROUGH CARPENTRY

06 20 00 – FINISH CARPENTRY

DIVISION 07 – THERMAL AND MOISTURE PROTECTION

TABLE OF CONTENTS

00 01 10 - 2

DEDC, LLC
25P269

07 11 13 – BITUMINIOUS DAMPPROOFING
07 21 00 – THERMAL INSULATION
07 27 00 – AIR BARRIERS
07 31 13 – ASPHALT SHINGLES
07 42 13 – METAL WALL PANELS
07 71 23 – MANUFACTURED GUTTERS AND DOWNSPOUTS
07 84 00 – FIRESTOPPING
07 92 00 – JOINT SEALENTS

DIVISION 08 – OPENINGS

08 06 71 – DOOR HARDWARE SCHEDULE
08 11 13 – HOLLOW METAL DOORS AND FRAMES
08 71 00 – DOOR HARDWARE

DIVISION 09 – FINISHES

09 21 16 – GYPSUM BOARD ASSEMBLIES
09 51 00 – ACOUSTICAL CEILINGS
09 65 00 – RESILIENT FLOORING
09 91 13 – EXTERIOR PAINTING
09 91 23 – INTERIOR PAINTING

DIVISION 23 - HEATING, VENTILATING, AND AIR-CONDITIONING (HVAC)

23 05 13 - COMMON MOTOR REQUIREMENTS FOR HVAC EQUIPMENT
23 05 17 – SLEEVES AND SLEEVE SEALS FOR HVAC PIPING
23 05 19 – METERS AND GAUGES FOR HVAC PIPING
23 05 23 – GENERAL DUTY VALVES FOR HVAC PIPING
23 05 48 - VIBRATION AND SEISMIC CONTROLS
23 05 53 - IDENTIFICATION FOR HVAC PIPING AND EQUIPMENT
23 05 93 - TESTING, ADJUSTING, AND BALANCING FOR HVAC
23 07 13 - DUCT INSULATION
23 07 16 – HVAC EQUIPMENT INSULATION
23 08 00 - COMMISSIONING OF HVAC
23 09 50 - BUILDING AUTOMATION SYSTEM (BAS) GENERAL
23 09 51 - BAS BASIC MATERIALS, INTERFACE DEVICES, AND SENSORS
23 09 53 - BAS FIELD PANELS

23 09 54 - BAS COMMUNICATION DEVICES
23 09 55 - BAS SOFTWARE AND PROGRAMMING
23 09 58 - SEQUENCE OF OPERATION
23 09 59 - BAS SYSTEM COMMISSIONING
23 09 69 - VARIABLE FREQUENCY CONTROLLERS
23 11 23 – FACILITY NATURAL GAS PIPING
23 31 00 – HVAC DUCTS AND CASINGS
23 34 23 – HVAC POWER VENTILATORS
23 36 00 – AIR TERMINAL UNITS
23 74 13 – PACKAGED OUTDOOR CENTRAL STATION AIR HANDLING UNITS

DIVISION 26 – ELECTRICAL

26 05 05 - SELECTIVE DEMOLITION FOR ELECTRICAL
26 05 19 - LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES
26 05 26 - GROUNDING AND BONDING
26 05 29 - HANGERS AND SUPPORTS
26 05 33.13 - CONDUIT FOR ELECTRICAL SYSTEMS
26 05 33.16 - BOXES FOR ELECTRICAL SYSTEMS
26 05 53 - IDENTIFICATION FOR ELECTRICAL SYSTEMS
26 05 73 – POWER SYSTEM STUDIES
26 05 83 - WIRING CONNECTIONS
26 27 26 – WIRING DEVICES
26 28 13 – FUSES
26 29 13 – ENCLOSED CONTROLLERS
26 43 00 – SURGE PROTECTION DEVICES

END OF SECTION

**SECTION 00 01 15
LIST OF DRAWING SHEETS**

S100	COVER SHEET
A001	STRUCTURAL NOTES, PLANS & DETAILS
AD100	ABBREVIATIONS, SYMBOLS, DRAWING KEYS, GENERAL NOTES
A101	DEMO PLANS, DEMO ELEVATIONS, DEMO SECTIONS
A501	NEW WORK PLANS, ELEVATIONS, SECTIONS
PH100	ROOF DETAILS, HEAD JAMB, SILL
MP000	PHASING PLAN
MPD100	MECHANICAL PIPING - NOTES, LEGENDS, & ABBREVIATIONS
MP100	MECHANICAL PIPING - DEMOLITION PLAN
M500	MECHANICAL PIPING - NEW WORK PLAN
M700	MECHANICAL - DETAILS AND DIAGRAMS
P100	MECHANICAL - CONTROLS DIAGRAM
E000	PLUMBING - DEMOLITION & NEW WORK PLAN
E100	ELECTRICAL - NOTES, LEGENDS, & ABBREVIATIONS
E200	ELECTRICAL - DEMOLITION & NEW WORK PLAN
	ELECTRICAL - DEMOLITION AND NEW PANEL SCHEDULES

END OF SECTION

NOT FOR BIDDING PURPOSES

THIS PAGE INTENTIONALLY LEFT BLANK

**SECTION 00 11 16
INVITATION TO BID**

Sealed bids for **OMB/DFM Contract No. MC1002001114, Delaware State Police Crime Lab HVAC Unit Replacement**, will be received by the State of Delaware, Office of Management and Budget, Division of Facilities Management, by way of the Bonfire Portal at <https://DFM.bonfirehub.com> until **1:00 PM local time on October 15th, 2026**. Bidder bears the risk of late submission.

Bids will be opened and read aloud at **2:00 PM local time on October 15th, 2026**, at the Haslet Armory, 122 Martin Luther King Blvd. S., Dover, DE 19901.

The project involves the replacement of the existing make-up unit and exhaust fan at the Delaware State Police Crime Lab, located in Dover, Delaware.

A **MANDATORY** Pre-Bid Meeting will be held on **September 24th, 2026 at 10:00 AM local time at 1441 N Dupont Highway Dover, Delaware 19901**, for the purpose of establishing the list of subcontractors and to answer questions. Upon arrival, attendees are to check in at front desk for directions to pre-bid meeting room. Representatives of each party to any Joint Venture must attend this meeting. **ATTENDANCE OF THIS MEETING IS A PREREQUISITE FOR BIDDING ON THIS CONTRACT.**

Contract documents may be obtained at the office of DEDC, LLC, 315 S. Chapel Street, Newark, DE 19711, phone: (302) 738-7172, upon receipt of \$100 per paper set and/or \$25.00 per electronic set, both non-refundable. Checks are to be made payable to "DEDC, LLC".

Bidders will not be subject to discrimination on the basis of race, creed, color, sex, sexual orientation, gender identity or national origin in consideration of this award, and Minority Business Enterprises, Disadvantaged Business Enterprises, Women-Owned Business Enterprises and Veteran-Owned Business Enterprises will be afforded full opportunity to submit bids on this contract. Each bid must be accompanied by a bid security equivalent to ten percent of the bid amount and all additive alternates. The successful bidder must post a performance bond and payment bond in a sum equal to 100 percent of the contract price upon execution of the contract. The Owner reserves the right to reject any or all bids and to waive any informalities therein. The Owner may extend the time and place for the opening of the bids from that described in the advertisement, with not less than two calendar days' notice by certified delivery, facsimile machine or other electronic means to those bidders' receiving plans.

END OF SECTION

NOT FOR BIDDING PURPOSES

THIS PAGE INTENTIONALLY LEFT BLANK

SECTION 00 21 13

INSTRUCTIONS TO BIDDERS

TABLE OF ARTICLES

1. GENERAL
2. BIDDER'S REPRESENTATION
3. BIDDING DOCUMENTS
4. BIDDING PROCEDURES
5. CONSIDERATION OF BIDS
6. POST-BID INFORMATION
7. PERFORMANCE BOND AND PAYMENT BOND
8. FORM OF AGREEMENT BETWEEN OWNER AND CONTRACTOR

ARTICLE 1: GENERAL

1.1 DEFINITIONS

1.1.1 Whenever the following terms are used, their intent and meaning shall be interpreted as follows:

1.2 STATE: The State of Delaware.

1.3 AGENCY: Contracting State Agency as noted on cover sheet.

1.4 DESIGNATED OFFICIAL: The agent authorized to act for the Agency.

1.5 BIDDING DOCUMENTS: Bidding Documents include the Bidding Requirements and the proposed Contract Documents. The Bidding Requirements consist of the Advertisement for Bid, Invitation to Bid, Instructions to Bidders, Supplementary Instructions to Bidders (if any), General Conditions, Supplementary General Conditions, General Requirements, Special Provisions (if any), the Bid Form (including the Non-commission Statement), and other sample bidding and contract forms. The proposed Contract Documents consist of the form of Agreement between the Owner and Contractor, as well as the Drawings, Specifications (Project Manual) and all Addenda issued prior to execution of the Contract.

1.6 CONTRACT DOCUMENTS: The Contract Documents consist of the, Instructions to Bidders, Supplementary Instructions to Bidders (if any), General Conditions, Supplementary General Conditions, General Requirements, Special Provisions (if any), the form of agreement between the Owner and the Contractor, Drawings (if any), Specifications (Project Manual), and all addenda.

1.7 AGREEMENT: The form of the Agreement shall be AIA Document A101, Standard Form of Agreement between Owner and Contractor where the basis of payment is a STIPULATED SUM. In the case of conflict between the instructions contained therein and the General Requirements herein, these General Requirements shall prevail.

1.8 GENERAL REQUIREMENTS (or CONDITIONS): General Requirements (or conditions) are instructions pertaining to the Bidding Documents and to contracts in general. They contain, in summary, requirements of laws of the State; policies of the Agency and instructions to bidders.

1.9 SPECIAL PROVISIONS: Special Provisions are specific conditions or requirements peculiar to the bidding documents and to the contract under consideration and are supplemental to the General Requirements. Should the Special Provisions conflict with the General Requirements, the Special Provisions shall prevail.

1.10 ADDENDA: Written or graphic instruments issued by the Owner/Architect prior to the execution of the contract which modify or interpret the Bidding Documents by additions, deletions, clarifications or corrections.

1.11 BIDDER OR VENDOR: A person or entity who formally submits a Bid for the material or Work contemplated, acting directly or through a duly authorized representative who meets the requirements set forth in the Bidding Documents.

1.12 SUB-BIDDER: A person or entity who submits a Bid to a Bidder for materials or labor, or both for a portion of the Work.

1.13 BID: A complete and properly executed proposal to do the Work for the sums stipulated therein, submitted in accordance with the Bidding Documents.

- 1.14 BASE BID: The sum stated in the Bid for which the Bidder offers to perform the Work described in the Bidding Documents as the base, to which Work may be added or from which Work may be deleted for sums stated in Alternate Bids (if any are required to be stated in the bid).
- 1.15 ALTERNATE BID (or ALTERNATE): An amount stated in the Bid, where applicable, to be added to or deducted from the amount of the Base Bid if the corresponding change in the Work, as described in the Bidding Documents is accepted.
- 1.16 UNIT PRICE: An amount stated in the Bid, where applicable, as a price per unit of measurement for materials, equipment or services or a portion of the Work as described in the Bidding Documents.
- 1.17 SURETY: The corporate body which is bound with and for the Contract, or which is liable, and which engages to be responsible for the Contractor's payments of all debts pertaining to and for his acceptable performance of the Work for which he has contracted.
- 1.18 BIDDER'S DEPOSIT: The security designated in the Bid to be furnished by the Bidder as a guaranty of good faith to enter into a contract with the Agency if the Work to be performed or the material or equipment to be furnished is awarded to him.
- 1.19 CONTRACT: The written agreement covering the furnishing and delivery of material or work to be performed.
- 1.20 CONTRACTOR: Any individual, firm or corporation with whom a contract is made by the Agency.
- 1.21 SUBCONTRACTOR: An individual, partnership or corporation which has a direct contract with a contractor to furnish labor and materials at the job site, or to perform construction labor and furnish material in connection with such labor at the job site.
- 1.22 CONTRACT BOND: The approved form of security furnished by the contractor and his surety as a guaranty of good faith on the part of the contractor to execute the work in accordance with the terms of the contract.
- 1.23 CUSTOM FABRICATION: As defined in 29 Del. C. § 6902, the term "custom fabrication" means the offsite fabrication, assembly, or other production of non-standard goods or materials, including components, fixtures or parts thereof, specifically for a public works project. Such goods and materials shall include those used in the following trades or systems: (1) Plumbing or pipe fitting systems, including heating, ventilating, air-conditioning, refrigeration systems, sheet metal or other duct systems; (2) Electrical systems; (3) Mechanical insulation work; (4) Ornamental iron work; and (5) Commercial signage that does not attempt or appear to direct the movement of traffic on highways or roadways or interfere with, imitate, or resemble any official traffic sign, signal or device.

ARTICLE 2: BIDDER'S REPRESENTATION

- 2.1 PRE-BID MEETING
- 2.1.1 A pre-bid meeting for this project will be held at the time and place designated. Attendance at this meeting is a pre-requisite for submitting a Bid, unless this requirement is specifically waived elsewhere in the Bid Documents.
- 2.2 By submitting a Bid, the Bidder represents that:

- 2.2.1 The Bidder has read and understands the Bidding Documents and that the Bid is made in accordance therewith.
- 2.2.2 The Bidder has visited the site, become familiar with existing conditions under which the Work is to be performed, and has correlated the Bidder's personal observations with the requirements of the proposed Contract Documents.
- 2.2.3 The Bid is based upon the materials, equipment, and systems required by the Bidding Documents without exception.
- 2.2.4 Bidder has accounted for the possibility of price increases due to the direct and indirect effect of tariffs, other international events, inflation, and supply chain interruptions. Change Orders will be denied if they are based upon any of these events. Bidder is expected to account for these possibilities and include them in the bid.
- 2.3 JOINT VENTURE REQUIREMENTS
- 2.3.1 For Public Works Contracts, each Joint Venturer shall be qualified and capable to complete the Work with their own forces.
- 2.3.2 Included with the Bid submission, and as a requirement to bid, a copy of the executed Joint Venture Agreement shall be submitted and signed by all Joint Venturers involved.
- 2.3.3 All required Bid Bonds, Performance Bonds, Material and Labor Payment Bonds must be executed by both Joint Venturers and be placed in both of their names.
- 2.3.4 All required insurance certificates shall name both Joint Venturers.
- 2.3.5 Both Joint Venturers shall sign the Bid Form.
- 2.3.6 Both Joint Venturers shall include their Federal E.I. Number with the Bid.
- 2.3.7 In the event of a mandatory Pre-bid Meeting, each Joint Venturer shall have a representative in attendance.
- 2.3.8 Due to exceptional circumstances and for good cause shown, one or more of these provisions may be waived at the discretion of the State.
- 2.4 ASSIGNMENT OF ANTITRUST CLAIMS
- 2.4.1 As consideration for the award and execution by the Owner of this contract, the Contractor hereby grants, conveys, sells, assigns and transfers to the State of Delaware all of its right, title and interests in and to all known or unknown causes of action it presently has or may now or hereafter acquire under the antitrust laws of the United States and the State of Delaware, relating to the particular goods or services purchased or acquired by the Owner pursuant to this contract.

ARTICLE 3: BIDDING DOCUMENTS

- 3.1 COPIES OF BID DOCUMENTS
- 3.1.1 Bidders may obtain complete sets of the Bidding Documents from the Architectural/Engineering firm designated in the Advertisement or Invitation to Bid in the number and for the deposit sum, if any, stated therein.

- 3.1.2 Bidders shall use complete sets of Bidding Documents for preparation of Bids. The issuing Agency nor the Architect assumes no responsibility for errors or misinterpretations resulting from the use of incomplete sets of Bidding Documents.
- 3.1.3 Any errors, inconsistencies or omissions discovered shall be reported to the Architect immediately.
- 3.1.4 The Agency and Architect may make copies of the Bidding Documents available on the above terms for the purpose of obtaining Bids on the Work. No license or grant of use is conferred by issuance of copies of the Bidding Documents.
- 3.2 INTERPRETATION OR CORRECTION OF BIDDING DOCUMENTS
- 3.2.1 The Bidder shall carefully study and compare the Bidding Documents with each other, and with other work being bid concurrently or presently under construction to the extent that it relates to the Work for which the Bid is submitted, shall examine the site and local conditions, and shall report any errors, inconsistencies or ambiguities discovered to the Architect.
- 3.2.2 Bidders or Sub-bidders requiring clarification or interpretation of the Bidding Documents shall make a written request to the Architect at least seven days prior to the date for receipt of Bids. Interpretations, corrections and changes to the Bidding Documents will be made by written Addendum. Interpretations, corrections, or changes to the Bidding Documents made in any other manner shall not be binding.
- 3.2.3 The apparent silence of the specifications as to any detail, or the apparent omission from it of detailed description concerning any point, shall be regarded as meaning that only the best commercial practice is to prevail and only material and workmanship of the first quality are to be used. Proof of specification compliance will be the responsibility of the Bidder.
- 3.2.4 Unless otherwise provided in the Contract Documents, the Contractor shall provide and pay for all permits, labor, materials, equipment, tools, construction equipment and machinery, water, heat, utilities, transportation, and other facilities and services necessary for the proper execution and completion of the Work.
- 3.2.5 The Owner will bear the costs for all impact and user fees associated with the project.
- 3.3 SUBSTITUTIONS
- 3.3.1 The materials, products and equipment described in the Bidding Documents establish a standard of quality, required function, dimension, and appearance to be met by any proposed substitution. The specification of a particular manufacturer or model number is not intended to be proprietary in any way. Substitutions of products for those named will be considered, providing that the Vendor certifies that the function, quality, and performance characteristics of the material offered is equal or superior to that specified. It shall be the Bidder's responsibility to assure that the proposed substitution will not affect the intent of the design, and to make any installation modifications required to accommodate the substitution.
- 3.3.2 Requests for substitutions shall be made in writing to the Architect at least ten days prior to the date of the Bid Opening. Such requests shall include a complete description of the proposed substitution, drawings, performance and test data, explanation of required installation modifications due the substitution, and any other information necessary for an evaluation. The burden of proof of the merit of the proposed substitution is upon the proposer. The Architect's decision of approval or disapproval shall be final. The Architect is to notify Owner prior to any approvals.

- 3.3.3 If the Architect approves a substitution prior to the receipt of Bids, such approval shall be set forth in an Addendum. Approvals made in any other manner shall not be binding.
- 3.3.4 The Architect shall have no obligation to consider any substitutions after the Contract award.
- 3.4 ADDENDA
- 3.4.1 Addenda will be mailed or delivered to all who are known by the Architect to have received a complete set of the Bidding Documents.
- 3.4.2 Copies of Addenda will be made available for inspection wherever Bidding Documents are on file for that purpose.
- 3.4.3 No Addenda will be issued later than 2 calendar days prior to the date for receipt of Bids except an Addendum withdrawing the request for Bids or one which extends the time or changes the location for the opening of bids.
- 3.4.4 Each bidder shall ascertain prior to submitting his Bid that they have received all Addenda issued, and shall acknowledge their receipt in their Bid in the appropriate space. Not acknowledging an issued Addenda could be grounds for determining a bid to be non-responsive.

ARTICLE 4: BIDDING PROCEDURES

- 4.1 PREPARATION OF BIDS
- 4.1.1 Submit the bids on the Bid Forms included with the Bidding Documents.
- 4.1.2 Submit the original Bid Form for each bid. Bid Forms may be removed from the project manual for this purpose.
- 4.1.3 Execute all blanks on the Bid Form.
- 4.1.4 Where so indicated by the makeup on the Bid Form, express sums in both words and figures, in case of discrepancy between the two, the written amount shall govern.
- 4.1.5 BID ALL REQUESTED ALTERNATES AND UNIT PRICES, IF ANY. If there is no change in the Base Bid for an Alternate, enter "No Change". The Contractor is responsible for verifying that they have received all addenda issued during the bidding period. Work required by Addenda shall automatically become part of the Contract.
- 4.1.6 Make no additional stipulations on the Bid Form and do not qualify the Bid in any other manner.
- 4.1.7 Each copy of the Bid shall include the legal name of the Bidder and a statement whether the Bidder is a sole proprietor, a partnership, a corporation, or any legal entity, and each copy shall be signed by the person or persons legally authorized to bind the Bidder to a contract. A Bid by a corporation shall further give the state of incorporation and have the corporate seal affixed. A Bid submitted by an agent shall have a current Power of Attorney attached, certifying agent's authority to bind the Bidder.
- 4.1.8 Bidder shall complete the Non-Collusion Statement form included with the Bid Forms and include it with their Bid.

- 4.1.9 In the construction of all Public Works projects for the State of Delaware or any agency thereof, preference in employment of laborers, workers or mechanics shall be given to bona fide legal citizens of the State who have established citizenship by residence of at least 90 days in the State.
- 4.1.10 Each bidder shall include a signed Affidavit for the Bidder certifying compliance with OMB Regulation 4104 - "Regulations for the Drug Testing of Contractor and Subcontractor Employees Working on "Large Public Works Projects." "Large Public Works" is based upon the current threshold required for bidding Public Works as set by the Purchasing and Contracting Advisory Council.
- 4.2 BID SECURITY
- 4.2.1 All bids shall be accompanied by a deposit of either a good and sufficient bond to the agency for the benefit of the agency, with corporate surety authorized to do business in this State, the form of the bond and the surety to be approved by the agency, or a security of the bidder assigned to the agency, for a sum equal to at least 10% of the bid plus all add alternates, or in lieu of the bid bond a security deposit in the form of a certified check, bank treasurer's check, cashier's check, money order, or other prior approved secured deposit assigned to the State. The bid bond need not be for a specific sum, but may be stated to be for a sum equal to 10% of the bid plus all add alternates to which it relates and not to exceed a certain stated sum, if said sum is equal to at least 10% of the bid. The Bid Bond form used shall be the standard OMB form (attached). The bid bond may be an electronic bond and need not be transmitted as a paper document.
- 4.2.2 The Agency has the right to retain the bid security of Bidders to whom an award is being considered until either a formal contract has been executed and bonds have been furnished or the specified time has elapsed so the Bids may be withdrawn or all Bids have been rejected.
- 4.2.3 In the event of any successful Bidder refusing or neglecting to execute a formal contract and bond within 20 days of the awarding of the contract, the bid bond or security deposited by the successful bidder shall be forfeited.
- 4.3 SUBCONTRACTOR LIST
- 4.3.1 In accordance with Title 29, Chapter 69, Section 6962(d)(10)b of the Delaware Code, each Bidder shall submit with their Bid a completed List of Sub-Contractors included with the Bid Form. **NAME ONLY ONE SUBCONTRACTOR FOR EACH TRADE.** The bidder must list **in each category** the full name and address (City & State) of the sub-contractor that the Bidder will be using to perform the work and provide material for that subcontractor category. Should the Bidder's listed subcontractor intend to provide any of their subcontractor category of work through a third-tier contractor, the Bidder shall list that third-tier contractor's full name and address (City & State). **If the Bidder intends to perform any category of work itself, it must list its full name and address.** For clarification, if the Bidder intends to perform the work themselves, the Bidder **may not** insert "not applicable", "N/A", "self" or anything other than its own full name and address (City & State). To do so shall cause the bid to be rejected. In addition, the failure to produce a completed subcontractor list with the bid submittal shall cause the bid to be rejected. If you have more than three (3) third-tier contractors to report in any subcontractor category, print out additional page(s) containing the appropriate category, complete the rest of your list of third-tier contractors for that category, notate the addition in parentheses as (CONTINUATION) next to the subcontractor category and an asterisk (*) next to any additional third-tier contractors, and submit it with your bid.

- 4.3.2 It is the responsibility of the Contractor to ensure that their Subcontractors are in compliance with the provisions of this law. Also, if a Contractor elects to list themselves as a Subcontractor for any category, they must specifically name themselves on the Bid Form and be able to document their capability to act as Subcontractor in that category in accordance with this law.

4.4 AFFIDAVIT OF CONTRACTOR QUALIFICATIONS

- 4.4.1 In accordance with Title 29, Chapter 69, Section 6962(d)(10)b.3 of the Delaware Code, each Bidder shall submit with their Bid the Affidavit of Contractor Qualifications certifying that the Bidder will abide by the contractor's qualifications outlined in the construction bid specifications for the duration of the contract term. After a contract has been awarded the successful bidder shall not substitute another subcontractor whose name was submitted on the Subcontractor Form except for the reasons in the statute and not without written consent from the awarding agency. Failure to utilize the subcontractors on the list will subject the successful bidder to penalties as outlined in the General Requirements Section 5.2 of the contract.

4.5 AFFIDAVIT OF CRAFT TRAINING COMPLIANCE

- 4.5.1 In accordance with Title 29, Chapter 69, Section 6962(c)(13) of the Delaware Code, contractors and subcontractors must provide craft training for journeyman and apprentice levels if all of the following apply:

- A. A project meets the prevailing wage requirement under Title 29, Chapter 69, Section 6960 of the Delaware Code.
- B. The contractor employs 10 or more total employees.
- C. The project is not a federal highway project

Failure to provide required craft training on the project may subject the successful contractor and/or subcontractor(s) to penalties as outlined in Title 29, Chapter 69, Section 6962(c)(13) of the Delaware Code.

Bidders shall submit the Affidavit of Craft Training Compliance prior to contract execution.

4.6 EQUALITY OF EMPLOYMENT OPPORTUNITY ON PUBLIC WORKS

- 4.6.1 During the performance of this contract, the contractor agrees as follows:

- A. The Contractor will not discriminate against any employee or applicant for employment because of race, creed, sex, color, sexual orientation, gender identity or national origin. The Contractor will take affirmative action to ensure the applicants are employed, and that employees are treated during employment, without regard to their race, creed, sex, color, sexual orientation, gender identity or national origin. Such action shall include, but not be limited to, the following: Employment, upgrading, demotion or transfer; recruitment or recruitment advertising; layoff or termination; rates of pay or other forms of compensation; and selection for training, including apprenticeship. The Contractor agrees to post in conspicuous places available to employees and applicants for employment notices to be provided by the contracting agency setting forth this nondiscrimination clause.
- B. The Contractor will, in all solicitations or advertisements for employees placed by or on behalf of the Contractor, state that all qualified applicants will receive consideration for employment without regard to race, creed, sex, color, sexual orientation, gender identity or national origin."

4.7 PREVAILING WAGE REQUIREMENT

4.7.1 Wage Provisions: For renovation and new construction projects whose costs exceed the thresholds contained in Delaware Code, Title 29, Section 6960, the minimum wage rates for various classes of laborers and mechanics shall be as determined by the Department of Labor, Division of Industrial Affairs of the State of Delaware.

4.7.2 The employer shall pay all mechanics and labors employed directly upon the site of work, or engaged in custom fabrication work, as that term is defined in Article 1.23 herein and as also as defined in 29 Del. C. § 6902 and described in 29 Del. C. § 6960(b), regardless of where the work is performed, unconditionally and not less often than once a week; and without subsequent deduction or rebate on any account, the full amounts accrued at time of payment, computed at wage rates not less than those stated in the specifications, regardless of any contractual relationship which may be alleged to exist between the employer and such laborers and mechanics.

4.7.3 As per 29 Del. C. § 6960(b), the scale of the wages to be paid must be posted by the employer in a prominent and easily accessible place at the site of the work. There may be withheld from the employer so much of accrued payments as may be considered necessary by the Department of Labor to pay laborers and mechanics employed by the employer the difference between the rates of wages required by the contract to be paid laborers and mechanics on the work and rates of wages received by such laborers and mechanics to be remitted to the Department of Labor for distribution upon resolution of any claims.

4.7.4 Every contract based upon these specifications shall contain a stipulation that sworn payroll information, as required by the Department of Labor, be furnished weekly. The Department of Labor shall keep and maintain the sworn payroll information for a period of 6 months from the last day of the work week covered by the payroll.

4.8 SUBMISSION OF BIDS

4.8.1 Enclose the Bid, the Bid Security, and any other documents required to be submitted with the Bid.

4.8.2 Deposit Bids at the designated location prior to the time and date for receipt of bids indicated in the Advertisement for Bids. Bids received after the time and date for receipt of bids will be marked "LATE BID" and returned.

4.8.3 Bidder assumes full responsibility for timely delivery at location designated for receipt of bids.

4.8.4 Oral, telephonic, paper or telegraphic bids are invalid and will not receive consideration.

4.8.5 Withdrawn Bids may be resubmitted up to the date and time designated for the receipt of Bids, provided that they are then fully in compliance with these Instructions to Bidders.

4.8.6 Compliance with Federal Bureau of Investigation rules mandates training for Contractors, Subcontractors, their employees, and custodial workers with access to locations that have access to Criminal Justice Information Services (CJIS). The contract awardee must have fingerprinting and background checks done for all Subcontractors and employees.

4.9 MODIFICATION OR WITHDRAW OF BIDS

4.9.1 Prior to the closing date for receipt of Bids, a Bidder may withdraw a Bid by personal request and by showing proper identification to the Architect. A request for withdraw by letter or fax, if the Architect is notified in writing prior to receipt of fax, is acceptable. A fax directing a

modification in the bid price will render the Bid informal, causing it to be ineligible for consideration of award. Telephone directives for modification of the bid price shall not be permitted and will have no bearing on the submitted proposal in any manner.

4.9.2 Bidders submitting Bids that are late shall be notified as soon as practicable and the bid shall be returned.

4.9.3 A Bid may not be modified, withdrawn or canceled by the Bidder during a thirty (30) day period following the time and date designated for the receipt and opening of Bids, and Bidder so agrees in submitting their Bid. Bids shall be binding for 30 days after the date of the Bid opening.

ARTICLE 5: CONSIDERATION OF BIDS

5.1 OPENING/REJECTION OF BIDS

5.1.1 Unless otherwise stated, Bids received on time will be publicly opened and will be read aloud. An abstract of the Bids will be made available to Bidders.

5.1.2 The Agency shall have the right to reject any and all Bids. A Bid not accompanied by a required Bid Security or by other data required by the Bidding Documents, or a Bid which is in any way incomplete or irregular is subject to rejection.

5.1.3 If the Bids are rejected, it will be done within thirty (30) calendar days of the Bid opening.

5.2 COMPARISON OF BIDS

5.2.1 After the Bids have been opened and read, the bid prices will be compared and the result of such comparisons will be made available to the public. Comparisons of the Bids may be based on the Base Bid plus desired Alternates. The Agency shall have the right to accept Alternates in any order or combination.

5.2.2 The Agency reserves the right to waive technicalities, to reject any or all Bids, or any portion thereof, to advertise for new Bids, to proceed to do the Work otherwise, or to abandon the Work, if in the judgment of the Agency or its agent(s), it is in the best interest of the State.

5.2.3 An increase or decrease in the quantity for any item is not sufficient grounds for an increase or decrease in the Unit Price.

5.2.4 The prices quoted are to be those for which the material will be furnished F.O.B. Job Site and include all charges that may be imposed during the period of the Contract.

5.2.5 No qualifying letter or statements in or attached to the Bid, or separate discounts will be considered in determining the low Bid except as may be otherwise herein noted. Cash or separate discounts should be computed and incorporated into Unit Bid Price(s).

5.2.6 Bidder must account for the possibility of price increases due to the direct and indirect effect of tariffs or other international events, inflation, and supply chain interruptions. Change Orders will be denied if they are based upon any of these events. Bidder is expected to account for these possibilities and include them in the bid.

5.3 DISQUALIFICATION OF BIDDERS

5.3.1 An agency shall determine that each Bidder on any Public Works Contract is responsible before awarding the Contract. Factors to be considered in determining the responsibility of a Bidder include:

- A. The Bidder's financial, physical, personnel or other resources including Subcontracts;
- B. The Bidder's record of performance on past public or private construction projects, including, but not limited to, defaults and/or final adjudication or admission of violations of the Prevailing Wage Laws in Delaware or any other state;
- C. The Bidder's written safety plan;
- D. Whether the Bidder is qualified legally to contract with the State;
- E. Whether the Bidder supplied all necessary information concerning its responsibility; and,
- F. Any other specific criteria for a particular procurement, which an agency may establish; provided however, that, the criteria be set forth in the Invitation to Bid and is otherwise in conformity with State and/or Federal law.
- G. Any Bidder who is debarred in another State and/or by the United States Government is also debarred in Delaware.

5.3.2 If an agency determines that a Bidder is nonresponsive and/or nonresponsible, the determination shall be in writing and set forth the basis for the determination. A copy of the determination shall be sent to the affected Bidder within five (5) working days of said determination.

5.3.3 In addition, any one or more of the following causes may be considered as sufficient for the disqualification of a Bidder and the rejection of their Bid or Bids.

5.3.3.1 More than one Bid for the same Contract from an individual, firm or corporation under the same or different names.

5.3.3.2 Evidence of collusion among Bidders.

5.3.3.3 Unsatisfactory performance record as evidenced by past experience.

5.3.3.4 If the Unit Prices are obviously unbalanced either in excess or below reasonable cost analysis values.

5.3.3.5 If there are any unauthorized additions, interlineation, conditional or alternate bids or irregularities of any kind which may tend to make the Bid incomplete, indefinite or ambiguous as to its meaning.

5.3.3.6 If the Bid is not accompanied by the required Bid Security and other data required by the Bidding Documents.

5.3.3.7 If any exceptions or qualifications of the Bid are noted on the Bid Form.

5.4 ACCEPTANCE OF BID AND AWARD OF CONTRACT

5.4.1 A formal Contract shall be executed with the successful Bidder within twenty (20) calendar days after the award of the Contract.

- 5.4.2 Per Section 6962(d)(13)a., Title 29, Delaware Code, "The contracting agency shall award any public works contract within thirty (30) days of the bid opening to the lowest responsive and responsible Bidder, unless the Agency elects to award on the basis of best value, in which case the election to award on the basis of best value shall be stated in the Invitation To Bid. Any public school district and its board shall award public works contracts in accordance with this section's requirements except it shall award the contract within 60 days of the bid opening."
- 5.4.3 Each Bid on any Public Works Contract must be deemed responsive by the Agency to be considered for award. A responsive Bid shall conform in all material respects to the requirements and criteria set forth in the Contract Documents and specifications.
- 5.4.4 The Agency shall have the right to accept Alternates in any order or combination, and to determine the low Bidder on the basis of the sum of the Base Bid, plus accepted Alternates.
- 5.4.5 The successful Bidder shall execute a formal contract, submit the required Insurance Certificate, and furnish good and sufficient bonds, unless specifically waived in the General Requirements, in accordance with the General Requirement, within twenty (20) days of official notice of contract award. The successful Bidder shall provide, at least two business days prior to contract execution, copies of the Employee Drug Testing Program for the Bidder and all listed Subcontractors. Bonds shall be for the benefit of the Agency with surety in the amount of 100% of the total contract award. Said Bonds shall be conditioned upon the faithful performance of the contract. Bonds shall remain in affect for period of two (2) years after the date of the Certificate of Final Payment.
- 5.4.6 If the successful Bidder fails to execute the required Contract, Bond and all required information, as aforesaid, within twenty (20) calendar days after the date of official Notice of the Award of the Contract, their Bid guaranty shall immediately be taken and become the property of the State for the benefit of the Agency as liquidated damages, and not as a forfeiture or as a penalty. Award will then be made to the next lowest qualified Bidder of the Work or readvertised, as the Agency may decide.
- 5.4.7 Each bidder shall supply with its bid its taxpayer identification number (i.e., federal employer identification number or social security number) and should the vendor be awarded a contract, such vendor shall provide to the agency the taxpayer identification license numbers of such subcontractors. Such numbers shall be provided on the later of the date on which such subcontractor is required to be identified or the time the contract is executed. The successful Bidder shall provide to the agency to which it is contracting, within 30 days of entering into such public works contract, copies of all Delaware Business licenses of subcontractors and/or independent contractors that will perform work for such public works contract. However, if a subcontractor or independent contractor is hired or contracted more than 20 days after the Bidder entered the public works contract the Delaware Business license of such subcontractor or independent contractor shall be provided to the agency within 10 days of being contracted or hired.
- 5.4.8 The Bid Security shall be returned to the successful Bidder upon the execution of the formal contract. The Bid Securities of unsuccessful bidders shall be returned within thirty (30) calendar days after the opening of the Bids.

ARTICLE 6: POST-BID INFORMATION

6.1 CONTRACTOR'S QUALIFICATION STATEMENT

- 6.1.1 Bidders to whom an award of a Contract is under consideration shall, if requested by the Agency, submit a properly executed AIA Document A305, Contractor's Qualification Statement, unless such a statement has been previously required and submitted.

- 6.2 Bidders to whom an award of a Contract has been made must produce their Delaware Business License before the Contract can be executed.

ARTICLE 7: PERFORMANCE BOND AND PAYMENT BOND

7.1 BOND REQUIREMENTS

- 7.1.1 The cost of furnishing the required Bonds, that are stipulated in the Bidding Documents, shall be included in the Bid.
- 7.1.2 If the Bidder is required by the Agency to secure a bond from other than the Bidder's usual sources, changes in cost will be adjusted as provide in the Contract Documents.
- 7.1.3 The Performance and Payment Bond forms used shall be the standard OMB forms (attached).

7.2 TIME OF DELIVERY AND FORM OF BONDS

- 7.2.1 The bonds shall be dated on or after the date of the Contract.
- 7.2.2 The Bidder shall require the attorney-in-fact who executes the required bonds on behalf of the surety to affix a certified and current copy of the power of attorney.
- 7.2.3 The Performance Bond and/or the Payment Bond may be electronic bonds and need not be transmitted as paper documents.

ARTICLE 8: FORM OF AGREEMENT BETWEEN OWNER AND CONTRACTOR

- 8.1 Unless otherwise required in the Bidding Documents, the Agreement for the Work will be written on AIA Document A101, Standard Form of Agreement Between Owner and Contractor Where the Basis of Payment is a Stipulated Sum.

END OF SECTION

NOT FOR BIDDING PURPOSES

THIS PAGE INTENTIONALLY LEFT BLANK

BID FORM

BID FORM
00 41 13 - 1

ALTERNATE No. 3: _____ (BRIEF DESCRIPTION) _____

Add/Deduct: _____
(\$ _____)

NOT FOR BIDDING PURPOSES

BID FORM

I/We acknowledge Addendums numbered _____ and the price(s) submitted include any cost/schedule impact they may have.

This bid shall remain valid and cannot be withdrawn for thirty (30) days from the date of opening of bids (60 days for School Districts and Department of Education), and the undersigned shall abide by the Bid Security forfeiture provisions. Bid Security is attached to this Bid.

The Owner shall have the right to reject any or all bids, and to waive any informality or irregularity in any bid received.

This bid is based upon work being accomplished by the Sub-Contractors named on the list attached to this bid.

Should I/We be awarded this contract, I/We pledge to achieve substantial completion of all the work within _____ calendar days of the Notice to Proceed.

The undersigned represents and warrants that he has complied and shall comply with all requirements of local, state, and national laws; that no legal requirement has been or shall be violated in making or accepting this bid, in awarding the contract to him or in the prosecution of the work required; that the bid is legal and firm; that he has not, directly or indirectly, entered into any agreement, participated in any collusion, or otherwise taken action in restraint of free competitive bidding.

Upon receipt of written notice of the acceptance of this Bid, the Bidder shall, within twenty (20) calendar days, execute the agreement in the required form and deliver the Contract Bonds, and Insurance Certificates, required by the Contract Documents.

I am / We are an Individual / a Partnership / a Corporation

By _____ Trading as _____
(Individual's / General Partner's / Corporate Name)

(State of Corporation)

Business Address: _____

Witness: _____ By: _____
(SEAL) (Authorized Signature)

(Title)
Date: _____

ATTACHMENTS

Sub-Contractor List
Non-Collusion Statement
Affidavit of Employee Drug Testing Program
Affidavit of Contractor Qualifications
Bid Security
(Others as Required by Project Manuals)

BID FORM

SUBCONTRACTOR LIST

In accordance with Title 29, Chapter 69, Section 6962(d)(10)b of the Delaware Code, the following subcontractor listing must accompany any bid submittal. The bidder must list **in each category** the full name and address (City & State) of the sub-contractor that the bidder will be using to perform the work and provide material for that subcontractor category. Should the bidder's listed subcontractor intend to provide any of their subcontractor category of work through a third-tier contractor, the bidder shall list that third-tier contractor's full name and address (City & State). **If the bidder intends to perform any category of work itself, it must list its full name and address.** For clarification, if the bidder intends to perform the work themselves, the bidder **may not** insert "not applicable", "N/A", "self" or anything other than its own full name and address (City & State). To do so shall cause the bid to be rejected. In addition, the failure to produce a completed subcontractor list with the bid submittal shall cause the bid to be rejected. If you have more than three (3) third-tier contractors to report in any subcontractor category, print out additional page(s) containing the appropriate category, complete the rest of your list of third-tier contractors for that category, notate the addition in parentheses as (CONTINUATION) next to the subcontractor category and an asterisk (*) next to any additional third-tier contractors, and submit it with your bid.

<u>Subcontractor Category</u>	<u>Subcontractor</u>	<u>Address (City & State)</u>	<u>Subcontractors tax-payer ID # or Delaware Business license #</u>
1.			
A.			
B.			
C.			
2.			
A.			
B.			
C.			

BID FORM (Continued)

3.			
A.			
B.			
C.			
4.			
A.			
B.			
C.			
5.			
A.			
B.			
C.			

NOT FOR BIDDING PURPOSES

BID FORM
NON-COLLUSION STATEMENT

This is to certify that the undersigned bidder has neither directly nor indirectly, entered into any agreement, participated in any collusion or otherwise taken any action in restraint of free competitive bidding in connection with this proposal submitted this date to the Office of Management and Budget, Division of Facilities Management.

All the terms and conditions of OMB/DFM# MC1002001114 have been thoroughly examined and are understood.

NAME OF BIDDER: _____

**AUTHORIZED REPRESENTATIVE
(TYPED):** _____

**AUTHORIZED REPRESENTATIVE
(SIGNATURE):** _____

TITLE: _____

ADDRESS OF BIDDER: _____

E-MAIL: _____

PHONE NUMBER: _____

Sworn to and Subscribed before me this _____ day of _____, 20____.

My Commission expires _____. NOTARY PUBLIC _____.

THIS PAGE MUST BE SIGNED AND NOTARIZED FOR YOUR BID TO BE CONSIDERED.

**AFFIDAVIT
OF
EMPLOYEE DRUG TESTING PROGRAM**

4104 Regulations for the Drug Testing of Contractor and Subcontractor Employees Working on Large Public Works Projects requires that Contractors and Subcontractors implement a program of mandatory drug testing for Employees who work on Large Public Works Contracts funded all or in part with public funds.

We hereby certify that we have in place or will implement during the entire term of the contract a Mandatory Drug Testing Program for our employees on the jobsite, including subcontractors, that complies with this regulation:

Contractor/Subcontractor Name: _____

Contractor/Subcontractor Address: _____

Authorized Representative (typed or printed): _____

Authorized Representative (signature): _____

Title: _____

Sworn to and Subscribed before me this _____ day of _____, 20____.

My Commission expires _____. NOTARY PUBLIC _____.

THIS PAGE MUST BE SIGNED AND NOTARIZED FOR YOUR BID TO BE CONSIDERED.

**AFFIDAVIT
OF
CONTRACTOR QUALIFICATIONS**

We hereby certify that we will abide by the contractor's qualifications outlined in the construction bid specifications for the duration of the contract term.

In accordance with Title 29, Chapter 69, Section 6962(d)(10)b.3 of the Delaware Code, after a contract has been awarded the successful bidder shall not substitute another subcontractor whose name was submitted on the Subcontractor Form except for the reasons in the statute and not without written consent from the awarding agency. Failure to utilize the subcontractors on the list will subject the successful bidder to penalties as outlined in the General Requirements Section 5.2 of the contract.

Contractor Name:

Contractor Address:

Authorized Representative (typed or printed):

Authorized Representative (signature):

Title:

Sworn to and Subscribed before me this _____ day of _____, 20____.

My Commission expires _____. NOTARY PUBLIC _____.

THIS PAGE MUST BE SIGNED AND NOTARIZED FOR YOUR BID TO BE CONSIDERED.

STATE OF DELAWARE
OFFICE OF MANAGEMENT AND BUDGET

SECTION 00 43 13
BID BOND

TO ACCOMPANY PROPOSAL
(Not necessary if security is used)

KNOW ALL MEN BY THESE PRESENTS That: _____
_____ of _____ in the County of _____
_____ and State of _____ as **Principal**, and _____
_____ of _____ in the County of _____
and State of _____ as **Surety**, legally authorized to do business in the State of Delaware
("State"), are held and firmly unto the State in the sum of _____
Dollars (\$ _____), or _____ percent not to exceed _____
Dollars (\$ _____)
of amount of bid on Contract No. OMB/DFM# MC1002001114 to be paid to the State for the use and
benefit of the Office of Management and Budget for which payment well and truly to be made, we do bind
ourselves, our and each of our heirs, executors, administrators, and successors, jointly and severally for and
in the whole firmly by these presents.

NOW THE CONDITION OF THIS OBLIGATION IS SUCH That if the above bonded **Principal**
who has submitted to the Office of Management and Budget a certain proposal to enter into this contract for
the furnishing of certain material and/or services within the State, shall be awarded this Contract, and if said
Principal shall well and truly enter into and execute this Contract as may be required by the terms of this
Contract and approved by the Office of Management and Budget this Contract to be entered into within
twenty days after the date of official notice of the award thereof in accordance with the terms of said
proposal, then this obligation shall be void or else to be and remain in full force and virtue.

Sealed with _____ seal and dated this _____ day of _____ in the year of our Lord two
thousand and _____ (20____).

SEALED, AND DELIVERED IN THE
Presence of

Corporate
Seal

By:

Name of Bidder (Organization)

Authorized Signature

Attest _____

Title

Name of Surety

Witness: _____

By:

Title

END OF SECTION

NOT FOR BIDDING PURPOSES

THIS PAGE INTENTIONALLY LEFT BLANK

SECTION 00 52 13

**STANDARD FORM OF AGREEMENT BETWEEN OWNER AND CONTRACTOR
A101-2017**

The contract to be utilized on this project shall be the "Standard Form of Agreement Between Owner and Contractor" AIA Document A101-2017, including AIA Document A101 – 2017 Exhibit A, as well as Supplements to A101-2017 and Exhibit A and the State of Delaware's General Requirements.

NOT FOR BIDDING PURPOSES

THIS PAGE INTENTIONALLY LEFT BLANK

NOT FOR BIDDING PURPOSES

DRAFT AIA® Document A101™ – 2017

Standard Form of Agreement Between Owner and Contractor where the basis of payment is a Stipulated Sum

AGREEMENT made as of the « » day of « » in the year « »
(In words, indicate day, month and year.)

BETWEEN the Owner:
(Name, legal status, address and other information)

« »
« »
« »
« »

and the Contractor:
(Name, legal status, address and other information)

« »
« »
« »
« »

for the following Project:
(Name, location and detailed description)

«testing»
«»
«»

The Architect:
(Name, legal status, address and other information)

« »
« »
« »
« »

The Owner and Contractor agree as follows.

ADDITIONS AND DELETIONS: The author of this document has added information needed for its completion. The author may also have revised the text of the original AIA standard form. An *Additions and Deletions Report* that notes added information as well as revisions to the standard form text is available from the author and should be reviewed.

This document has important legal consequences. Consultation with an attorney is encouraged with respect to its completion or modification.

The parties should complete A101™-2017, Exhibit A, Insurance and Bonds, contemporaneously with this Agreement. AIA Document A201™-2017, General Conditions of the Contract for Construction, is adopted in this document by reference. Do not use with other general conditions unless this document is modified.

ELECTRONIC COPYING of any portion of this AIA® Document to another electronic file is prohibited and constitutes a violation of copyright laws as set forth in the footer of this document.

TABLE OF ARTICLES

- 1 THE CONTRACT DOCUMENTS
- 2 THE WORK OF THIS CONTRACT
- 3 DATE OF COMMENCEMENT AND SUBSTANTIAL COMPLETION
- 4 CONTRACT SUM
- 5 PAYMENTS
- 6 DISPUTE RESOLUTION
- 7 TERMINATION OR SUSPENSION
- 8 MISCELLANEOUS PROVISIONS
- 9 ENUMERATION OF CONTRACT DOCUMENTS

EXHIBIT A INSURANCE AND BONDS

ARTICLE 1 THE CONTRACT DOCUMENTS

The Contract Documents consist of this Agreement, Conditions of the Contract (General, Supplementary, and other Conditions), Drawings, Specifications, Addenda issued prior to execution of this Agreement, other documents listed in this Agreement, and Modifications issued after execution of this Agreement, all of which form the Contract, and are as fully a part of the Contract as if attached to this Agreement or repeated herein. The Contract represents the entire and integrated agreement between the parties hereto and supersedes prior negotiations, representations, or agreements, either written or oral. An enumeration of the Contract Documents, other than a Modification, appears in Article 9.

ARTICLE 2 THE WORK OF THIS CONTRACT

The Contractor shall fully execute the Work described in the Contract Documents, except as specifically indicated in the Contract Documents to be the responsibility of others.

ARTICLE 3 DATE OF COMMENCEMENT AND SUBSTANTIAL COMPLETION

§ 3.1 The date of commencement of the Work shall be:

(Check one of the following boxes.)

☐ The date of this Agreement.

☐ A date set forth in a notice to proceed issued by the Owner.

☐ Established as follows:

(Insert a date or a means to determine the date of commencement of the Work.)

« »

If a date of commencement of the Work is not selected, then the date of commencement shall be the date of this Agreement.

§ 3.2 The Contract Time shall be measured from the date of commencement of the Work.

§ 3.3 Substantial Completion

§ 3.3.1 Subject to adjustments of the Contract Time as provided in the Contract Documents, the Contractor shall achieve Substantial Completion of the entire Work:

(Check one of the following boxes and complete the necessary information.)

☐ Not later than « » (« ») calendar days from the date of commencement of the Work.

[« »] By the following date: « »

§ 3.3.2 Subject to adjustments of the Contract Time as provided in the Contract Documents, if portions of the Work are to be completed prior to Substantial Completion of the entire Work, the Contractor shall achieve Substantial Completion of such portions by the following dates:

Portion of Work	Substantial Completion Date

§ 3.3.3 If the Contractor fails to achieve Substantial Completion as provided in this Section 3.3, liquidated damages, if any, shall be assessed as set forth in Section 4.5.

ARTICLE 4 CONTRACT SUM

§ 4.1 The Owner shall pay the Contractor the Contract Sum in current funds for the Contractor's performance of the Contract. The Contract Sum shall be «Zero Dollars and Zero Cents» (\$ «0.00»), subject to additions and deductions as provided in the Contract Documents.

§ 4.2 Alternates

§ 4.2.1 Alternates, if any, included in the Contract Sum:

Item	Price

§ 4.2.2 Subject to the conditions noted below, the following alternates may be accepted by the Owner following execution of this Agreement. Upon acceptance, the Owner shall issue a Modification to this Agreement. (Insert below each alternate and the conditions that must be met for the Owner to accept the alternate.)

Item	Price	Conditions for Acceptance

§ 4.3 Allowances, if any, included in the Contract Sum: (Identify each allowance.)

Item	Price

§ 4.4 Unit prices, if any: (Identify the item and state the unit price and quantity limitations, if any, to which the unit price will be applicable.)

Item	Units and Limitations	Price per Unit (\$0.00)

§ 4.5 Liquidated damages, if any: (Insert terms and conditions for liquidated damages, if any.)

« »

§ 4.6 Other: (Insert provisions for bonus or other incentives, if any, that might result in a change to the Contract Sum.)

« »

ARTICLE 5 PAYMENTS

§ 5.1 Progress Payments

§ 5.1.1 Based upon Applications for Payment submitted to the Architect by the Contractor and Certificates for Payment issued by the Architect, the Owner shall make progress payments on account of the Contract Sum to the Contractor as provided below and elsewhere in the Contract Documents.

§ 5.1.2 The period covered by each Application for Payment shall be one calendar month ending on the last day of the month, or as follows:

« »

§ 5.1.3 Provided that an Application for Payment is received by the Architect not later than the « » day of a month, the Owner shall make payment of the amount certified to the Contractor not later than the « » day of the « » month. If an Application for Payment is received by the Architect after the application date fixed above, payment of the amount certified shall be made by the Owner not later than « » (« ») days after the Architect receives the Application for Payment.

(Federal, state or local laws may require payment within a certain period of time.)

§ 5.1.4 Each Application for Payment shall be based on the most recent schedule of values submitted by the Contractor in accordance with the Contract Documents. The schedule of values shall allocate the entire Contract Sum among the various portions of the Work. The schedule of values shall be prepared in such form, and supported by such data to substantiate its accuracy, as the Architect may require. This schedule of values shall be used as a basis for reviewing the Contractor's Applications for Payment.

§ 5.1.5 Applications for Payment shall show the percentage of completion of each portion of the Work as of the end of the period covered by the Application for Payment.

§ 5.1.6 In accordance with AIA Document A201™-2017, General Conditions of the Contract for Construction, and subject to other provisions of the Contract Documents, the amount of each progress payment shall be computed as follows:

§ 5.1.6.1 The amount of each progress payment shall first include:

- .1 That portion of the Contract Sum properly allocable to completed Work;
- .2 That portion of the Contract Sum properly allocable to materials and equipment delivered and suitably stored at the site for subsequent incorporation in the completed construction, or, if approved in advance by the Owner, suitably stored off the site at a location agreed upon in writing; and
- .3 That portion of Construction Change Directives that the Architect determines, in the Architect's professional judgment, to be reasonably justified.

§ 5.1.6.2 The amount of each progress payment shall then be reduced by:

- .1 The aggregate of any amounts previously paid by the Owner;
- .2 The amount, if any, for Work that remains uncorrected and for which the Architect has previously withheld a Certificate for Payment as provided in Article 9 of AIA Document A201-2017;
- .3 Any amount for which the Contractor does not intend to pay a Subcontractor or material supplier, unless the Work has been performed by others the Contractor intends to pay;
- .4 For Work performed or defects discovered since the last payment application, any amount for which the Architect may withhold payment, or nullify a Certificate of Payment in whole or in part, as provided in Article 9 of AIA Document A201-2017; and
- .5 Retainage withheld pursuant to Section 5.1.7.

§ 5.1.7 Retainage

§ 5.1.7.1 For each progress payment made prior to Substantial Completion of the Work, the Owner may withhold the following amount, as retainage, from the payment otherwise due:

(Insert a percentage or amount to be withheld as retainage from each Application for Payment. The amount of retainage may be limited by governing law.)

« »

§ 5.1.7.1.1 The following items are not subject to retainage:

(Insert any items not subject to the withholding of retainage, such as general conditions, insurance, etc.)

<< >>

§ 5.1.7.2 Reduction or limitation of retainage, if any, shall be as follows:

(If the retainage established in Section 5.1.7.1 is to be modified prior to Substantial Completion of the entire Work, including modifications for Substantial Completion of portions of the Work as provided in Section 3.3.2, insert provisions for such modifications.)

<< >>

§ 5.1.7.3 Except as set forth in this Section 5.1.7.3, upon Substantial Completion of the Work, the Contractor may submit an Application for Payment that includes the retainage withheld from prior Applications for Payment pursuant to this Section 5.1.7. The Application for Payment submitted at Substantial Completion shall not include retainage as follows:

(Insert any other conditions for release of retainage upon Substantial Completion.)

<< >>

§ 5.1.8 If final completion of the Work is materially delayed through no fault of the Contractor, the Owner shall pay the Contractor any additional amounts in accordance with Article 9 of AIA Document A201–2017.

§ 5.1.9 Except with the Owner's prior approval, the Contractor shall not make advance payments to suppliers for materials or equipment which have not been delivered and stored at the site.

§ 5.2 Final Payment

§ 5.2.1 Final payment, constituting the entire unpaid balance of the Contract Sum, shall be made by the Owner to the Contractor when

- .1 the Contractor has fully performed the Contract except for the Contractor's responsibility to correct Work as provided in Article 12 of AIA Document A201–2017, and to satisfy other requirements, if any, which extend beyond final payment; and
- .2 a final Certificate for Payment has been issued by the Architect.

§ 5.2.2 The Owner's final payment to the Contractor shall be made no later than 30 days after the issuance of the Architect's final Certificate for Payment, or as follows:

<< >>

§ 5.3 Interest

Payments due and unpaid under the Contract shall bear interest from the date payment is due at the rate stated below, or in the absence thereof, at the legal rate prevailing from time to time at the place where the Project is located.

(Insert rate of interest agreed upon, if any.)

<< >> % << >>

ARTICLE 6 DISPUTE RESOLUTION

§ 6.1 Initial Decision Maker

The Architect will serve as the Initial Decision Maker pursuant to Article 15 of AIA Document A201–2017, unless the parties appoint below another individual, not a party to this Agreement, to serve as the Initial Decision Maker.

(If the parties mutually agree, insert the name, address and other contact information of the Initial Decision Maker, if other than the Architect.)

<< >>

<< >>

<< >>

<< >>

§ 6.2 Binding Dispute Resolution

For any Claim subject to, but not resolved by, mediation pursuant to Article 15 of AIA Document A201–2017, the method of binding dispute resolution shall be as follows:

(Check the appropriate box.)

☐ Arbitration pursuant to Section 15.4 of AIA Document A201–2017

☐ Litigation in a court of competent jurisdiction

☐ Other *(Specify)*

« »

If the Owner and Contractor do not select a method of binding dispute resolution, or do not subsequently agree in writing to a binding dispute resolution method other than litigation, Claims will be resolved by litigation in a court of competent jurisdiction.

ARTICLE 7 TERMINATION OR SUSPENSION

§ 7.1 The Contract may be terminated by the Owner or the Contractor as provided in Article 14 of AIA Document A201–2017.

§ 7.1.1 If the Contract is terminated for the Owner’s convenience in accordance with Article 14 of AIA Document A201–2017, then the Owner shall pay the Contractor a termination fee as follows:

(Insert the amount of, or method for determining, the fee, if any, payable to the Contractor following a termination for the Owner’s convenience.)

« »

§ 7.2 The Work may be suspended by the Owner as provided in Article 14 of AIA Document A201–2017.

ARTICLE 8 MISCELLANEOUS PROVISIONS

§ 8.1 Where reference is made in this Agreement to a provision of AIA Document A201–2017 or another Contract Document, the reference refers to that provision as amended or supplemented by other provisions of the Contract Documents.

§ 8.2 The Owner’s representative:
(Name, address, email address, and other information)

« »
« »
« »
« »
« »
« »

§ 8.3 The Contractor’s representative:
(Name, address, email address, and other information)

« »
« »
« »
« »
« »
« »

§ 8.4 Neither the Owner’s nor the Contractor’s representative shall be changed without ten days’ prior notice to the other party.

§ 8.5 Insurance and Bonds

§ 8.5.1 The Owner and the Contractor shall purchase and maintain insurance as set forth in AIA Document A101™–2017, Standard Form of Agreement Between Owner and Contractor where the basis of payment is a Stipulated Sum, Exhibit A, Insurance and Bonds, and elsewhere in the Contract Documents.

§ 8.5.2 The Contractor shall provide bonds as set forth in AIA Document A101™–2017 Exhibit A, and elsewhere in the Contract Documents.

§ 8.6 Notice in electronic format, pursuant to Article 1 of AIA Document A201–2017, may be given in accordance with AIA Document E203™–2013, Building Information Modeling and Digital Data Exhibit, if completed, or as otherwise set forth below:

(If other than in accordance with AIA Document E203–2013, insert requirements for delivering notice in electronic format such as name, title, and email address of the recipient and whether and how the system will be required to generate a read receipt for the transmission.)

« »

§ 8.7 Other provisions:

« »

ARTICLE 9 ENUMERATION OF CONTRACT DOCUMENTS

§ 9.1 This Agreement is comprised of the following documents:

- .1 AIA Document A101™–2017, Standard Form of Agreement Between Owner and Contractor
- .2 AIA Document A101™–2017, Exhibit A, Insurance and Bonds
- .3 AIA Document A201™–2017, General Conditions of the Contract for Construction
- .4 AIA Document E203™–2013, Building Information Modeling and Digital Data Exhibit, dated as indicated below:

(Insert the date of the E203-2013 incorporated into this Agreement.)

« »

- .5 Drawings

Number	Title	Date

- .6 Specifications

Section	Title	Date	Pages

- .7 Addenda, if any:

Number	Date	Pages

Portions of Addenda relating to bidding or proposal requirements are not part of the Contract Documents unless the bidding or proposal requirements are also enumerated in this Article 9.

- .8 Other Exhibits:

(Check all boxes that apply and include appropriate information identifying the exhibit where required.)

[« »] AIA Document E204™–2017, Sustainable Projects Exhibit, dated as indicated below:
(Insert the date of the E204-2017 incorporated into this Agreement.)

« »

[« »] The Sustainability Plan:

Title	Date	Pages

[« »] Supplementary and other Conditions of the Contract:

Document	Title	Date	Pages

.9 Other documents, if any, listed below:

(List here any additional documents that are intended to form part of the Contract Documents. AIA Document A201™-2017 provides that the advertisement or invitation to bid, Instructions to Bidders, sample forms, the Contractor's bid or proposal, portions of Addenda relating to bidding or proposal requirements, and other information furnished by the Owner in anticipation of receiving bids or proposals, are not part of the Contract Documents unless enumerated in this Agreement. Any such documents should be listed here only if intended to be part of the Contract Documents.)

« »

This Agreement entered into as of the day and year first written above.

OWNER (Signature)

« »« »

(Printed name and title)

CONTRACTOR (Signature)

« »« »

(Printed name and title)

DRAFT AIA® Document A101™ – 2017

Exhibit A

Insurance and Bonds

This Insurance and Bonds Exhibit is part of the Agreement, between the Owner and the Contractor, dated the « » day of « » in the year « »
(In words, indicate day, month and year.)

for the following **PROJECT**:
(Name and location or address)

« »
« »

THE OWNER:
(Name, legal status and address)

« »
« »

THE CONTRACTOR:
(Name, legal status and address)

« »
« »

TABLE OF ARTICLES

- A.1 GENERAL
- A.2 OWNER'S INSURANCE
- A.3 CONTRACTOR'S INSURANCE AND BONDS
- A.4 SPECIAL TERMS AND CONDITIONS

ARTICLE A.1 GENERAL

The Owner and Contractor shall purchase and maintain insurance, and provide bonds, as set forth in this Exhibit. As used in this Exhibit, the term General Conditions refers to AIA Document A201™–2017, General Conditions of the Contract for Construction.

ARTICLE A.2 OWNER'S INSURANCE

§ A.2.1 General

Prior to commencement of the Work, the Owner shall secure the insurance, and provide evidence of the coverage, required under this Article A.2 and, upon the Contractor's request, provide a copy of the property insurance policy or policies required by Section A.2.3. The copy of the policy or policies provided shall contain all applicable conditions, definitions, exclusions, and endorsements.

§ A.2.2 Liability Insurance

The Owner shall be responsible for purchasing and maintaining the Owner's usual general liability insurance.

§ A.2.3 Required Property Insurance

AIA Document A101™ – 2017 Exhibit A. Copyright © 2017 by The American Institute of Architects. All rights reserved. **WARNING: This AIA® Document is protected by U.S. Copyright Law and International Treaties. Unauthorized reproduction or distribution of this AIA® Document, or any portion of it, may result in severe civil and criminal penalties, and will be prosecuted to the maximum extent possible under the law.** This draft was produced by AIA software at 15:53:16 ET on 11/08/2018 under Order No.5521013211 which expires on 07/19/2019, and is not for resale.
User Notes: (1933659252)

ADDITIONS AND DELETIONS: The author of this document has added information needed for its completion. The author may also have revised the text of the original AIA standard form. An *Additions and Deletions Report* that notes added information as well as revisions to the standard form text is available from the author and should be reviewed.

This document has important legal consequences. Consultation with an attorney is encouraged with respect to its completion or modification.

This document is intended to be used in conjunction with AIA Document A201™–2017, General Conditions of the Contract for Construction. Article 11 of A201™–2017 contains additional insurance provisions.

ELECTRONIC COPYING of any portion of this AIA® Document to another electronic file is prohibited and constitutes a violation of copyright laws as set forth in the footer of this document.

§ A.2.3.1 Unless this obligation is placed on the Contractor pursuant to Section A.3.3.2.1, the Owner shall purchase and maintain, from an insurance company or insurance companies lawfully authorized to issue insurance in the jurisdiction where the Project is located, property insurance written on a builder's risk "all-risks" completed value or equivalent policy form and sufficient to cover the total value of the entire Project on a replacement cost basis. The Owner's property insurance coverage shall be no less than the amount of the initial Contract Sum, plus the value of subsequent Modifications and labor performed and materials or equipment supplied by others. The property insurance shall be maintained until Substantial Completion and thereafter as provided in Section A.2.3.1.3, unless otherwise provided in the Contract Documents or otherwise agreed in writing by the parties to this Agreement. This insurance shall include the interests of the Owner, Contractor, Subcontractors, and Sub-subcontractors in the Project as insureds. This insurance shall include the interests of mortgagees as loss payees.

§ A.2.3.1.1 Causes of Loss. The insurance required by this Section A.2.3.1 shall provide coverage for direct physical loss or damage, and shall not exclude the risks of fire, explosion, theft, vandalism, malicious mischief, collapse, earthquake, flood, or windstorm. The insurance shall also provide coverage for ensuing loss or resulting damage from error, omission, or deficiency in construction methods, design, specifications, workmanship, or materials. Sub-limits, if any, are as follows:

(Indicate below the cause of loss and any applicable sub-limit.)

Causes of Loss	Sub-Limit

§ A.2.3.1.2 Specific Required Coverages. The insurance required by this Section A.2.3.1 shall provide coverage for loss or damage to falsework and other temporary structures, and to building systems from testing and startup. The insurance shall also cover debris removal, including demolition occasioned by enforcement of any applicable legal requirements, and reasonable compensation for the Architect's and Contractor's services and expenses required as a result of such insured loss, including claim preparation expenses. Sub-limits, if any, are as follows:

(Indicate below type of coverage and any applicable sub-limit for specific required coverages.)

Coverage	Sub-Limit

§ A.2.3.1.3 Unless the parties agree otherwise, upon Substantial Completion, the Owner shall continue the insurance required by Section A.2.3.1 or, if necessary, replace the insurance policy required under Section A.2.3.1 with property insurance written for the total value of the Project that shall remain in effect until expiration of the period for correction of the Work set forth in Section 12.2.2 of the General Conditions.

§ A.2.3.1.4 Deductibles and Self-Insured Retentions. If the insurance required by this Section A.2.3 is subject to deductibles or self-insured retentions, the Owner shall be responsible for all loss not covered because of such deductibles or retentions.

§ A.2.3.2 Occupancy or Use Prior to Substantial Completion. The Owner's occupancy or use of any completed or partially completed portion of the Work prior to Substantial Completion shall not commence until the insurance company or companies providing the insurance under Section A.2.3.1 have consented in writing to the continuance of coverage. The Owner and the Contractor shall take no action with respect to partial occupancy or use that would cause cancellation, lapse, or reduction of insurance, unless they agree otherwise in writing.

§ A.2.3.3 Insurance for Existing Structures

If the Work involves remodeling an existing structure or constructing an addition to an existing structure, the Owner shall purchase and maintain, until the expiration of the period for correction of Work as set forth in Section 12.2.2 of the General Conditions, "all-risks" property insurance, on a replacement cost basis, protecting the existing structure against direct physical loss or damage from the causes of loss identified in Section A.2.3.1, notwithstanding the undertaking of the Work. The Owner shall be responsible for all co-insurance penalties.

§ A.2.4 Optional Extended Property Insurance.

The Owner shall purchase and maintain the insurance selected and described below.

(Select the types of insurance the Owner is required to purchase and maintain by placing an X in the box(es) next to the description(s) of selected insurance. For each type of insurance selected, indicate applicable limits of coverage or other conditions in the fill point below the selected item.)

- [☐] **§ A.2.4.1 Loss of Use, Business Interruption, and Delay in Completion Insurance**, to reimburse the Owner for loss of use of the Owner's property, or the inability to conduct normal operations due to a covered cause of loss.

<< >>

- [☐] **§ A.2.4.2 Ordinance or Law Insurance**, for the reasonable and necessary costs to satisfy the minimum requirements of the enforcement of any law or ordinance regulating the demolition, construction, repair, replacement or use of the Project.

<< >>

- [☐] **§ A.2.4.3 Expediting Cost Insurance**, for the reasonable and necessary costs for the temporary repair of damage to insured property, and to expedite the permanent repair or replacement of the damaged property.

<< >>

- [☐] **§ A.2.4.4 Extra Expense Insurance**, to provide reimbursement of the reasonable and necessary excess costs incurred during the period of restoration or repair of the damaged property that are over and above the total costs that would normally have been incurred during the same period of time had no loss or damage occurred.

<< >>

- [☐] **§ A.2.4.5 Civil Authority Insurance**, for losses or costs arising from an order of a civil authority prohibiting access to the Project, provided such order is the direct result of physical damage covered under the required property insurance.

<< >>

- [☐] **§ A.2.4.6 Ingress/Egress Insurance**, for loss due to the necessary interruption of the insured's business due to physical prevention of ingress to, or egress from, the Project as a direct result of physical damage.

<< >>

- [☐] **§ A.2.4.7 Soft Costs Insurance**, to reimburse the Owner for costs due to the delay of completion of the Work, arising out of physical loss or damage covered by the required property insurance: including construction loan fees; leasing and marketing expenses; additional fees, including those of architects, engineers, consultants, attorneys and accountants, needed for the completion of the construction, repairs, or reconstruction; and carrying costs such as property taxes, building permits, additional interest on loans, realty taxes, and insurance premiums over and above normal expenses.

<< >>

§ A.2.5 Other Optional Insurance.

The Owner shall purchase and maintain the insurance selected below.

(Select the types of insurance the Owner is required to purchase and maintain by placing an X in the box(es) next to the description(s) of selected insurance.)

- [« »] **§ A.2.5.1 Cyber Security Insurance** for loss to the Owner due to data security and privacy breach, including costs of investigating a potential or actual breach of confidential or private information. *(Indicate applicable limits of coverage or other conditions in the fill point below.)*

« »

- [« »] **§ A.2.5.2 Other Insurance**
(List below any other insurance coverage to be provided by the Owner and any applicable limits.)

Coverage

Limits

ARTICLE A.3 CONTRACTOR'S INSURANCE AND BONDS

§ A.3.1 General

§ A.3.1.1 Certificates of Insurance. The Contractor shall provide certificates of insurance acceptable to the Owner evidencing compliance with the requirements in this Article A.3 at the following times: (1) prior to commencement of the Work; (2) upon renewal or replacement of each required policy of insurance; and (3) upon the Owner's written request. An additional certificate evidencing continuation of commercial liability coverage, including coverage for completed operations, shall be submitted with the final Application for Payment and thereafter upon renewal or replacement of such coverage until the expiration of the periods required by Section A.3.2.1 and Section A.3.3.1. The certificates will show the Owner as an additional insured on the Contractor's Commercial General Liability and excess or umbrella liability policy or policies.

§ A.3.1.2 Deductibles and Self-Insured Retentions. The Contractor shall disclose to the Owner any deductible or self-insured retentions applicable to any insurance required to be provided by the Contractor.

§ A.3.1.3 Additional Insured Obligations. To the fullest extent permitted by law, the Contractor shall cause the commercial general liability coverage to include (1) the Owner, the Architect, and the Architect's consultants as additional insureds for claims caused in whole or in part by the Contractor's negligent acts or omissions during the Contractor's operations; and (2) the Owner as an additional insured for claims caused in whole or in part by the Contractor's negligent acts or omissions for which loss occurs during completed operations. The additional insured coverage shall be primary and non-contributory to any of the Owner's general liability insurance policies and shall apply to both ongoing and completed operations. To the extent commercially available, the additional insured coverage shall be no less than that provided by Insurance Services Office, Inc. (ISO) forms CG 20 10 07 04, CG 20 37 07 04, and, with respect to the Architect and the Architect's consultants, CG 20 32 07 04.

§ A.3.2 Contractor's Required Insurance Coverage

§ A.3.2.1 The Contractor shall purchase and maintain the following types and limits of insurance from an insurance company or insurance companies lawfully authorized to issue insurance in the jurisdiction where the Project is located. The Contractor shall maintain the required insurance until the expiration of the period for correction of Work as set forth in Section 12.2.2 of the General Conditions, unless a different duration is stated below:

(If the Contractor is required to maintain insurance for a duration other than the expiration of the period for correction of Work, state the duration.)

« »

§ A.3.2.2 Commercial General Liability

§ A.3.2.2.1 Commercial General Liability insurance for the Project written on an occurrence form with policy limits of not less than « » (\$ « ») each occurrence, « » (\$ « ») general aggregate, and « » (\$ « ») aggregate for products-completed operations hazard, providing coverage for claims including

- .1 damages because of bodily injury, sickness or disease, including occupational sickness or disease, and death of any person;
- .2 personal injury and advertising injury;
- .3 damages because of physical damage to or destruction of tangible property, including the loss of use of such property;
- .4 bodily injury or property damage arising out of completed operations; and

.5 the Contractor's indemnity obligations under Section 3.18 of the General Conditions.

§ A.3.2.2.2 The Contractor's Commercial General Liability policy under this Section A.3.2.2 shall not contain an exclusion or restriction of coverage for the following:

- .1 Claims by one insured against another insured, if the exclusion or restriction is based solely on the fact that the claimant is an insured, and there would otherwise be coverage for the claim.
- .2 Claims for property damage to the Contractor's Work arising out of the products-completed operations hazard where the damaged Work or the Work out of which the damage arises was performed by a Subcontractor.
- .3 Claims for bodily injury other than to employees of the insured.
- .4 Claims for indemnity under Section 3.18 of the General Conditions arising out of injury to employees of the insured.
- .5 Claims or loss excluded under a prior work endorsement or other similar exclusionary language.
- .6 Claims or loss due to physical damage under a prior injury endorsement or similar exclusionary language.
- .7 Claims related to residential, multi-family, or other habitational projects, if the Work is to be performed on such a project.
- .8 Claims related to roofing, if the Work involves roofing.
- .9 Claims related to exterior insulation finish systems (EIFS), synthetic stucco or similar exterior coatings or surfaces, if the Work involves such coatings or surfaces.
- .10 Claims related to earth subsidence or movement, where the Work involves such hazards.
- .11 Claims related to explosion, collapse and underground hazards, where the Work involves such hazards.

§ A.3.2.3 Automobile Liability covering vehicles owned, and non-owned vehicles used, by the Contractor, with policy limits of not less than « » (\$ « ») per accident, for bodily injury, death of any person, and property damage arising out of the ownership, maintenance and use of those motor vehicles along with any other statutorily required automobile coverage.

§ A.3.2.4 The Contractor may achieve the required limits and coverage for Commercial General Liability and Automobile Liability through a combination of primary and excess or umbrella liability insurance, provided such primary and excess or umbrella insurance policies result in the same or greater coverage as the coverages required under Section A.3.2.2 and A.3.2.3, and in no event shall any excess or umbrella liability insurance provide narrower coverage than the primary policy. The excess policy shall not require the exhaustion of the underlying limits only through the actual payment by the underlying insurers.

§ A.3.2.5 Workers' Compensation at statutory limits.

§ A.3.2.6 Employers' Liability with policy limits not less than « » (\$ « ») each accident, « » (\$ « ») each employee, and « » (\$ « ») policy limit.

§ A.3.2.7 Jones Act, and the Longshore & Harbor Workers' Compensation Act, as required, if the Work involves hazards arising from work on or near navigable waterways, including vessels and docks

§ A.3.2.8 If the Contractor is required to furnish professional services as part of the Work, the Contractor shall procure Professional Liability insurance covering performance of the professional services, with policy limits of not less than « » (\$ « ») per claim and « » (\$ « ») in the aggregate.

§ A.3.2.9 If the Work involves the transport, dissemination, use, or release of pollutants, the Contractor shall procure Pollution Liability insurance, with policy limits of not less than « » (\$ « ») per claim and « » (\$ « ») in the aggregate.

§ A.3.2.10 Coverage under Sections A.3.2.8 and A.3.2.9 may be procured through a Combined Professional Liability and Pollution Liability insurance policy, with combined policy limits of not less than « » (\$ « ») per claim and « » (\$ « ») in the aggregate.

§ A.3.2.11 Insurance for maritime liability risks associated with the operation of a vessel, if the Work requires such activities, with policy limits of not less than « » (\$ « ») per claim and « » (\$ « ») in the aggregate.

§ A.3.2.12 Insurance for the use or operation of manned or unmanned aircraft, if the Work requires such activities, with policy limits of not less than « » (\$ « ») per claim and « » (\$ « ») in the aggregate.

§ A.3.3 Contractor's Other Insurance Coverage

§ A.3.3.1 Insurance selected and described in this Section A.3.3 shall be purchased from an insurance company or insurance companies lawfully authorized to issue insurance in the jurisdiction where the Project is located. The Contractor shall maintain the required insurance until the expiration of the period for correction of Work as set forth in Section 12.2.2 of the General Conditions, unless a different duration is stated below:

(If the Contractor is required to maintain any of the types of insurance selected below for a duration other than the expiration of the period for correction of Work, state the duration.)

« »

§ A.3.3.2 The Contractor shall purchase and maintain the following types and limits of insurance in accordance with Section A.3.3.1.

(Select the types of insurance the Contractor is required to purchase and maintain by placing an X in the box(es) next to the description(s) of selected insurance. Where policy limits are provided, include the policy limit in the appropriate fill point.)

- [« »] § A.3.3.2.1 Property insurance of the same type and scope satisfying the requirements identified in Section A.2.3, which, if selected in this section A.3.3.2.1, relieves the Owner of the responsibility to purchase and maintain such insurance except insurance required by Section A.2.3.1.3 and Section A.2.3.3. The Contractor shall comply with all obligations of the Owner under Section A.2.3 except to the extent provided below. The Contractor shall disclose to the Owner the amount of any deductible, and the Owner shall be responsible for losses within the deductible. Upon request, the Contractor shall provide the Owner with a copy of the property insurance policy or policies required. The Owner shall adjust and settle the loss with the insurer and be the trustee of the proceeds of the property insurance in accordance with Article 11 of the General Conditions unless otherwise set forth below:
- (Where the Contractor's obligation to provide property insurance differs from the Owner's obligations as described under Section A.2.3, indicate such differences in the space below. Additionally, if a party other than the Owner will be responsible for adjusting and settling a loss with the insurer and acting as the trustee of the proceeds of property insurance in accordance with Article 11 of the General Conditions, indicate the responsible party below.)*

« »

- [« »] § A.3.3.2.2 Railroad Protective Liability Insurance, with policy limits of not less than « » (\$ « ») per claim and « » (\$ « ») in the aggregate, for Work within fifty (50) feet of railroad property.

- [« »] § A.3.3.2.3 Asbestos Abatement Liability Insurance, with policy limits of not less than « » (\$ « ») per claim and « » (\$ « ») in the aggregate, for liability arising from the encapsulation, removal, handling, storage, transportation, and disposal of asbestos-containing materials.

- [« »] § A.3.3.2.4 Insurance for physical damage to property while it is in storage and in transit to the construction site on an "all-risks" completed value form.

- [« »] § A.3.3.2.5 Property insurance on an "all-risks" completed value form, covering property owned by the Contractor and used on the Project, including scaffolding and other equipment.

- [« »] § A.3.3.2.6 Other Insurance
(List below any other insurance coverage to be provided by the Contractor and any applicable limits.)

Coverage

Limits

§ A.3.4 Performance Bond and Payment Bond

The Contractor shall provide surety bonds, from a company or companies lawfully authorized to issue surety bonds in the jurisdiction where the Project is located, as follows:

(Specify type and penal sum of bonds.)

Type

Penal Sum (\$0.00)

Payment Bond

Performance Bond

Payment and Performance Bonds shall be AIA Document A312™, Payment Bond and Performance Bond, or contain provisions identical to AIA Document A312™, current as of the date of this Agreement.

ARTICLE A.4 SPECIAL TERMS AND CONDITIONS

Special terms and conditions that modify this Insurance and Bonds Exhibit, if any, are as follows:

<< >>

NOT FOR BIDDING PURPOSES

THIS PAGE INTENTIONALLY LEFT BLANK

SECTION 00 54 13

SUPPLEMENT TO AGREEMENT BETWEEN OWNER AND CONTRACTOR A101-2017

The following supplements modify the "Standard Form of Agreement Between Owner and Contractor," AIA Document A101-2017. Where a portion of the Standard Form of Agreement is modified or deleted by the following, the unaltered portions of the Standard Form of Agreement shall remain in effect.

ARTICLE 3: DATE OF COMMENCEMENT AND SUBSTANTIAL COMPLETION

3.1 Delete paragraph 3.1 in its entirety and replace with the following:

"The date of Commencement of the Work shall be a date set forth in a notice to proceed issued by the Owner."

ARTICLE 5: PAYMENTS

5.1 PROGRESS PAYMENTS

5.1.3 Delete paragraph 5.1.3 in its entirety and replace with the following:

"Provided that a valid Application for Payment is received by the Architect that meets all requirements of the Contract, payment shall be made by the Owner not later than 30 days after the Owner receives the valid Application for Payment."

5.3 Insert the interest rate of "1% per month not to exceed 12% per annum."

ARTICLE 6: DISPUTE RESOLUTION

6.2 BINDING DISPUTE RESOLUTION

Check the box "Other" – and add the following sentence:

"Any remedies available in law or in equity."

ARTICLE 7: TERMINATION or SUSPENSION

7.1.1.1 Delete paragraph 7.1.1.1 in its entirety.

ARTICLE 8: MISCELLANEOUS PROVISIONS

8.4 Delete paragraph 8.4 in its entirety and replace with the following:

"The Contractor's representative shall not be changed without ten days written notice to the Owner."

END OF SECTION

NOT FOR BIDDING PURPOSES

THIS PAGE INTENTIONALLY LEFT BLANK

SECTION 00 54 14

SUPPLEMENT TO A101-2017 – EXHIBIT A - INSURANCE & BONDS

The following supplements modify the "Standard Form of Agreement Between Owner and Contractor," AIA Document A101-2017 Exhibit A Insurance and Bonds. Where a portion of the Standard Form of Agreement is modified or deleted by the following, the unaltered portions of the Standard Form of Agreement shall remain in effect.

ARTICLE A.2 OWNER'S INSURANCE

A.2.1 General

Delete paragraph A.2.1 in its entirety.

A.2.2 Liability Insurance

Delete paragraph A.2.2 in its entirety, except in the case of school projects this paragraph shall remain.

A.2.3 Required Property Insurance

Delete paragraph A.2.3 in its entirety.

A.2.4 Optional Extended Property Insurance

Delete paragraph A.2.4 in its entirety.

A.2.5 Other Optional Insurance

Delete paragraph A.2.5 in its entirety.

ARTICLE A.3 CONTRACTORS INSURANCE AND BONDS

A.3.1.1 Strike the last sentence of the paragraph.

A.3.1.3 Additional Insured Obligations

In the first sentence after "coverage to include (1)" delete "(1) the Owner,".

Strike the remainder of the first sentence beginning at the semicolon "; and (2) the Owner" through the end of the sentence.

Delete the second sentence in its entirety.

A.3.2.2.1 Insert "\$1,000,000.00" in the blank for each occurrence.
Insert "\$3,000,000.00" in the blank for general aggregate.
Insert "\$3,000,000.00" in the blank for aggregate for products-completed operations hazard.

A.3.2.3 Insert "\$1,000,000.00" in the blank for per accident.

A.3.2.6 Insert "\$500,000.00" in the blank for each accident.
Insert "\$500,000.00" in the blank for each employee.

Insert "\$500,000.00" in the blank for policy limit.

A.3.2.8 Insert "\$1,000,000.00" in the blank for per claim.
Insert "\$3,000,000.00" in the blank for in the aggregate.

A.3.2.9 Insert "\$1,000,000.00" in the blank for per claim.
Insert "\$3,000,000.00" in the blank for in the aggregate.

A.3.2.10 Insert "\$2,000,000.00" in the blank for per claim.
Insert "\$4,000,000.00" in the blank for in the aggregate.

A.3.2.11 Strike in its entirety.

A.3.2.12 Strike in its entirety.

A.3.3.2.1 Delete paragraph 3.3.2.1 in its entirety

A.3.3.2.2 Strike in its entirety.

A.3.3.2.3 Insert "\$1,000,000.00" in the blanks for per claim.
Insert "\$3,000,000.00" in the blanks for in the aggregate.

A.3.4 Insert the actual contract price in both the Payment Bond and the Performance Bond Penal Sum blanks. It must be 100% of the contract price.

Strike the last sentence in this section and replace with "Payment and Performance Bonds shall be in the standard form issued by the Delaware Office of Management and Budget."

END OF SECTION

STATE OF DELAWARE
OFFICE OF MANAGEMENT AND BUDGET

**SECTION 00 61 13.13
PERFORMANCE BOND**

Bond Number: _____

KNOW ALL PERSONS BY THESE PRESENTS, that we, _____, as principal ("**Principal**"), and _____, a _____ corporation, legally authorized to do business in the State of Delaware, as surety ("**Surety**"), are held and firmly bound unto the Office of Management and Budget ("**Owner**"), in the amount of _____ (\$ _____), to be paid to **Owner**, for which payment well and truly to be made, we do bind ourselves, our and each and every of our heirs, executors, administrations, successors and assigns, jointly and severally, for and in the whole, firmly by these presents.

Sealed with our seals and dated this _____ day of _____, 20__.

NOW THE CONDITION OF THIS OBLIGATION IS SUCH, that if **Principal**, who has been awarded by **Owner** that certain contract known as Contract No. MC1002001114 dated the _____ day of _____, 20__ (the "Contract"), which Contract is incorporated herein by reference, shall well and truly provide and furnish all materials, appliances and tools and perform all the work required under and pursuant to the terms and conditions of the Contract and the Contract Documents (as defined in the Contract) or any changes or modifications thereto made as therein provided, shall make good and reimburse **Owner** sufficient funds to pay the costs of completing the Contract that **Owner** may sustain by reason of any failure or default on the part of **Principal**, and shall also indemnify and save harmless **Owner** from all costs, damages and expenses arising out of or by reason of the performance of the Contract and for as long as provided by the Contract; then this obligation shall be void otherwise to be and remain in full force and effect.

Surety, for value received, hereby stipulates and agrees, if requested to do so by **Owner**, to fully perform and complete the work to be performed under the Contract pursuant to the terms, conditions and covenants thereof, if for any cause **Principal** fails or neglects to so fully perform and complete such work.

Surety, for value received, for itself and its successors and assigns, hereby stipulates and agrees that the obligation of **Surety** and its bond shall be in no way impaired or affected by any extension of time, modification, omission, addition or change in or to the Contract or the work to be performed thereunder, or by any payment thereunder before the time required therein, or by any waiver of any provisions thereof, or by any assignment, subletting or other transfer thereof or of any work to be performed or any monies due or to become due thereunder; and **Surety** hereby waives notice of any and all such extensions, modifications, omissions, additions, changes, payments, waivers, assignments, subcontracts and transfers and hereby expressly stipulates and agrees that any and all things done and omitted to be done by and in relation to assignees, subcontractors, and other transferees shall have the same effect as to **Surety** as though done or omitted to be done by or in relation to **Principal**.

Surety hereby stipulates and agrees that no modifications, omissions or additions in or to the terms of the Contract shall in any way whatsoever affect the obligation of **Surety** and its bond.

Any proceeding, legal or equitable, under this Bond may be brought in any court of competent jurisdiction in the State of Delaware. Notices to **Surety** or Contractor may be mailed or delivered to them at their respective addresses shown below.

IN WITNESS WHEREOF, **Principal** and **Surety** have hereunto set their hand and seals, and such of them as are corporations have caused their corporate seal to be hereto affixed and these presents to be signed by their duly authorized officers, the day and year first above written.

PRINCIPAL

Name: _____

Witness or Attest: Address: _____

Name: _____ By: _____ (SEAL)
Name: _____
Title: _____
(Corporate Seal)

SURETY

Name: _____

Witness or Attest: Address: _____

Name: _____ By: _____ (SEAL)
Name: _____
Title: _____
(Corporate Seal)

END OF SECTION

STATE OF DELAWARE
OFFICE OF MANAGEMENT AND BUDGET

SECTION 00 61 13.16
PAYMENT BOND

Bond Number: _____

KNOW ALL PERSONS BY THESE PRESENTS, that we, _____, as principal ("**Principal**"), and _____, a _____ corporation, legally authorized to do business in the State of Delaware, as surety ("**Surety**"), are held and firmly bound unto the Office of Management and Budget ("**Owner**"), in the amount of _____ (\$_____), to be paid to **Owner**, for which payment well and truly to be made, we do bind ourselves, our and each and every of our heirs, executors, administrations, successors and assigns, jointly and severally, for and in the whole firmly by these presents.

Sealed with our seals and dated this _____ day of _____, 20__.

NOW THE CONDITION OF THIS OBLIGATION IS SUCH, that if **Principal**, who has been awarded by **Owner** that certain contract known as Contract No. MC1002001114 dated the _____ day of _____, 20__ (the "Contract"), which Contract is incorporated herein by reference, shall well and truly pay all and every person furnishing materials or performing labor or service in and about the performance of the work under the Contract, all and every sums of money due him, her, them or any of them, for all such materials, labor and service for which **Principal** is liable, shall make good and reimburse **Owner** sufficient funds to pay such costs in the completion of the Contract as **Owner** may sustain by reason of any failure or default on the part of **Principal**, and shall also indemnify and save harmless **Owner** from all costs, damages and expenses arising out of or by reason of the performance of the Contract and for as long as provided by the Contract; then this obligation shall be void, otherwise to be and remain in full force and effect.

Surety, for value received, for itself and its successors and assigns, hereby stipulates and agrees that the obligation of **Surety** and its bond shall be in no way impaired or affected by any extension of time, modification, omission, addition or change in or to the Contract or the work to be performed thereunder, or by any payment thereunder before the time required therein, or by any waiver of any provisions thereof, or by any assignment, subletting or other transfer thereof or of any work to be performed or any monies due or to become due thereunder; and **Surety** hereby waives notice of any and all such extensions, modifications, omissions, additions, changes, payments, waivers, assignments, subcontracts and transfers and hereby expressly stipulates and agrees that any and all things done and omitted to be done by and in relation to assignees, subcontractors, and other transferees shall have the same effect as to **Surety** as though done or omitted to be done by or in relation to **Principal**.

Surety hereby stipulates and agrees that no modifications, omission or additions in or to the terms of the Contract shall in any way whatsoever affect the obligation of **Surety** and its bond.

Any proceeding, legal or equitable, under this Bond may be brought in any court of competent jurisdiction in the State of Delaware. Notices to **Surety** or Contractor may be mailed or delivered to them at their respective addresses shown below.

IN WITNESS WHEREOF, **Principal** and **Surety** have hereunto set their hand and seals, and such of them as are corporations have caused their corporate seal to be hereto affixed and these presents to be signed by their duly authorized officers, the day and year first above written.

PRINCIPAL

Name: _____

Witness or Attest: Address: _____

Name:

(Corporate Seal)

By: _____(SEAL)

Name:

Title:

SURETY

Name: _____

Witness or Attest: Address: _____

Name:

(Corporate Seal)

By: _____(SEAL)

Name:

Title:

END OF SECTION

**SECTION 00 62 76
APPLICATION AND CERTIFICATE FOR PAYMENT**

The Application and Certificate for Payment are as stated in the American Institute of Architects Document AIA G702 & AIA G703 (1992 version) entitled Application and Certificate for Payment and is part of this project manual as if herein written in full. A draft sample has been included for reference.

END OF SECTION

THIS PAGE INTENTIONALLY LEFT BLANK

Application and Certificate for Payment

TO OWNER: State of Delaware

PROJECT:

APPLICATION NO: 001

Distribution to:OWNER: ☒FROM
CONTRACTOR:VIA
ARCHITECT: DEDC, LLC
315 S. Chapel Street
Newark, DE 19711

PERIOD TO:

CONTRACT FOR:

CONTRACT DATE:

PROJECT NOS: / /

ARCHITECT: ☐CONTRACTOR: ☒FIELD: ☐OTHER: ☐**CONTRACTOR'S APPLICATION FOR PAYMENT**

Application is made for payment, as shown below, in connection with the Contract.
Continuation Sheet, AIA Document G703, is attached.

1. ORIGINAL CONTRACT SUM \$ 0.00
2. Net change by Change Orders \$ 0.00
3. CONTRACT SUM TO DATE (Line 1 ± 2) \$ 0.00
4. TOTAL COMPLETED & STORED TO DATE (Column G on G703) \$ 0.00
5. RETAINAGE:
- a. 0 % of Completed Work
(Column D + E on G703) \$ 0.00
- b. 0 % of Stored Material
(Column F on G703) \$ 0.00
- Total Retainage (Lines 5a + 5b or Total in Column I of G703) \$ 0.00
6. TOTAL EARNED LESS RETAINAGE \$ 0.00
(Line 4 Less Line 5 Total)
7. LESS PREVIOUS CERTIFICATES FOR PAYMENT \$ 0.00
(Line 6 from prior Certificate)
8. CURRENT PAYMENT DUE \$ 0.00
9. BALANCE TO FINISH, INCLUDING RETAINAGE
(Line 3 less Line 6) \$ 0.00

CHANGE ORDER SUMMARY	ADDITIONS	DEDUCTIONS
Total changes approved in previous month by Owner	\$ 0.00	\$ 0.00
Total approved this Month	\$ 0.00	\$ 0.00
TOTALS	\$ 0.00	\$ 0.00
NET CHANGES by Change Order	\$	0.00

The undersigned Contractor certifies that to the best of the Contractor's knowledge, information and belief the Work covered by this Application for Payment has been completed in accordance with the Contract Documents, that all amounts have been paid by the Contractor for Work for which previous Certificates for Payment were issued and payments received from the Owner, and that current payment shown herein is now due.

CONTRACTOR:

By: _____

Date: _____

State of: _____

County of: _____

Subscribed and sworn to before
me this _____ day of _____

Notary Public:

My Commission expires: _____

ARCHITECT'S CERTIFICATE FOR PAYMENT

In accordance with the Contract Documents, based on on-site observations and the data comprising this application, the Architect certifies to the Owner that to the best of the Architect's knowledge, information and belief the Work has progressed as indicated, the quality of the Work is in accordance with the Contract Documents, and the Contractor is entitled to payment of the AMOUNT CERTIFIED.

AMOUNT CERTIFIED \$ 0.00

(Attach explanation if amount certified differs from the amount applied. Initial all figures on this Application and on the Continuation Sheet that are changed to conform with the amount certified.)

ARCHITECT:

By: _____

Date: _____

This Certificate is not negotiable. The AMOUNT CERTIFIED is payable only to the Contractor named herein. Issuance, payment and acceptance of payment are without prejudice to any rights of the Owner or Contractor under this Contract

DRAFT AIA[®] Document G703[™] - 1992

Continuation Sheet

AIA Document G702, APPLICATION AND CERTIFICATION FOR PAYMENT, containing Contractor's signed certification is attached.

In tabulations below, amounts are stated to the nearest dollar.

Use Column I on Contracts where variable retainage for line items may apply.

APPLICATION NO: 001

APPLICATION DATE: --/--/--

PERIOD TO:

ARCHITECT'S PROJECT NO: N/A

A	B	C	D	E	F	G		H	I
ITEM NO.	DESCRIPTION OF WORK	SCHEDULED VALUE	WORK COMPLETED		MATERIALS PRESENTLY STORED (NO. IN D OR E)	TOTAL COMPLETED AND STORED TO DATE (D+E+F)	%(G ÷ C)	BALANCE TO FINISH (C - G)	RETAINAGE (IF VARIABLE RATE)
			FROM PREVIOUS APPLICATION (D + E)	THIS PERIOD					
	GRAND TOTAL	\$ 0.00	\$ 0.00	\$ 0.00	\$ 0.00	\$ 0.00	0.00 %	\$ 0.00	\$ 0.00

ALLOWANCE AUTHORIZATION

Project:

Architect:

Project No.

Contractor:

AAA No.:

Initiation Date:

The Allowance is allocated as follows:

Total original Contract Allowance was:

\$

Amount of Contract Allowance Access previously authorized:

\$

Adjusted Contract Allowance prior to this authorization is:

\$

The amount of available Allowance will Decrease by this Access Authorization:

\$

The remaining Contract Allowance, after this Access Authorization will be:

\$

Recommended by:

Architect

By (Signature): _____

Date: _____

Accepted by:

Contractor

By (Signature): _____

Date: _____

Approved by:

Owner

By (Signature): _____

Date: _____

THIS PAGE INTENTIONALLY LEFT BLANK

NOT FOR BIDDING PURPOSES

CLOSEOUT FORMS

The Contract Closeout Forms to be used for this Contract are listed below. Draft samples of the AIA forms indicated have been included for reference.

—	00 65 16	Certificate of Substantial Completion Form	(AIA G704-2017)
—	00 65 19.13	Affidavit of Payment of Debts and Claims Form	(AIA G706-1994)
—	00 65 19.16	Affidavit of Release of Liens Form	(AIA G706A-1994)
—	00 65 19.19	Consent of Surety to Final Payment Form	(AIA G707-1994)

END OF SECTION

THIS PAGE INTENTIONALLY LEFT BLANK

DRAFT AIA® Document G704™ – 2017

Certificate of Substantial Completion

PROJECT: *(name and address)*
testing

CONTRACT INFORMATION:
Contract For: General Construction
Date:

CERTIFICATE INFORMATION:
Certificate Number:
Date:

OWNER: *(name and address)*

ARCHITECT: *(name and address)*

CONTRACTOR: *(name and address)*

The Work identified below has been reviewed and found, to the Architect's best knowledge, information, and belief, to be substantially complete. Substantial Completion is the stage in the progress of the Work when the Work or designated portion is sufficiently complete in accordance with the Contract Documents so that the Owner can occupy or utilize the Work for its intended use. The date of Substantial Completion of the Project or portion designated below is the date established by this Certificate.

(Identify the Work, or portion thereof, that is substantially complete.)

ARCHITECT *(Firm Name)*

SIGNATURE

PRINTED NAME AND TITLE

DATE OF SUBSTANTIAL COMPLETION

WARRANTIES

The date of Substantial Completion of the Project or portion designated above is also the date of commencement of applicable warranties required by the Contract Documents, except as stated below.

(Identify warranties that do not commence on the date of Substantial Completion, if any, and indicate their date of commencement.)

WORK TO BE COMPLETED OR CORRECTED

A list of items to be completed or corrected is attached hereto, or transmitted as agreed upon by the parties, and identified as follows:

(Identify the list of Work to be completed or corrected.)

The failure to include any items on such list does not alter the responsibility of the Contractor to complete all Work in accordance with the Contract Documents. Unless otherwise agreed to in writing, the date of commencement of warranties for items on the attached list will be the date of issuance of the final Certificate of Payment or the date of final payment, whichever occurs first.

The Contractor will complete or correct the Work on the list of items attached hereto within () days from the above date of Substantial Completion.

Cost estimate of Work to be completed or corrected: \$

The responsibilities of the Owner and Contractor for security, maintenance, heat, utilities, damage to the Work, insurance, and other items identified below shall be as follows:

(Note: Owner's and Contractor's legal and insurance counsel should review insurance requirements and coverage.)

The Owner and Contractor hereby accept the responsibilities assigned to them in this Certificate of Substantial Completion:

CONTRACTOR *(Firm Name)*

SIGNATURE

PRINTED NAME AND TITLE

DATE

OWNER *(Firm Name)*

SIGNATURE

PRINTED NAME AND TITLE

DATE

NOT FOR BIDDING PURPOSES

THIS PAGE INTENTIONALLY LEFT BLANK

DRAFT AIA® Document G706™ – 1994

Contractor's Affidavit of Payment of Debts and Claims

PROJECT: (Name and address)
testing

ARCHITECT'S PROJECT NUMBER:

TO OWNER: (Name and address)

CONTRACT FOR: General Construction

CONTRACT DATED:

OWNER: ☐
ARCHITECT: ☐
CONTRACTOR: ☐
SURETY: ☐
OTHER: ☐

STATE OF:
COUNTY OF:

The undersigned hereby certifies that, except as listed below, payment has been made in full and all obligations have otherwise been satisfied for all materials and equipment furnished, for all work, labor, and services performed, and for all known indebtedness and claims against the Contractor for damages arising in any manner in connection with the performance of the Contract referenced above for which the Owner or Owner's property might in any way be held responsible or encumbered.

EXCEPTIONS:

SUPPORTING DOCUMENTS ATTACHED HERETO:

CONTRACTOR: (Name and address)

1. Consent of Surety to Final Payment. When a Surety is involved, Consent of Surety is required. AIA Document G707, Consent of Surety, may be used for this purpose.

Indicate Attachment ☐ Yes ☐ No

The following supporting documents should be attached hereto if required by the Owner:

1. Contractor's Release or Waiver of Liens, conditional upon receipt of final payment.
2. Separate Releases or Waivers of Liens from Subcontractors and material and equipment supplier, to the extent required by the Owner, accompanied by a list thereof.
3. Contractor's Affidavit of Release of Liens (AIA Document G706A).

BY:

(Signature of authorized representative)

(Printed name and title)

Subscribed and sworn to before me on this date:

Notary Public:

My Commission Expires:

NOT FOR BIDDING PURPOSES

THIS PAGE INTENTIONALLY LEFT BLANK

DRAFT AIA[®] Document G706A[™] - 1994

Contractor's Affidavit of Release of Liens

PROJECT: (Name and address)
testing

ARCHITECT'S PROJECT NUMBER:

CONTRACT FOR: General
Construction

CONTRACT DATED:

TO OWNER: (Name and address)

OWNER: ☐

ARCHITECT: ☐

CONTRACTOR: ☐

SURETY: ☐

OTHER: ☐

STATE OF:
COUNTY OF:

The undersigned hereby certifies that to the best of the undersigned's knowledge, information and belief, except as listed below, the Releases or Waivers of Lien attached hereto include the Contractor, all Subcontractors, all suppliers of materials and equipment, and all performers of Work, labor or services who have or may have liens or encumbrances or the right to assert liens or encumbrances against any property of the Owner arising in any manner out of the performance of the Contract referenced above.

EXCEPTIONS:

SUPPORTING DOCUMENTS ATTACHED HERETO:

1. Contractor's Release or Waiver of Liens conditional upon receipt of final payment.
2. Separate Releases or Waivers of Liens from Subcontractors and material and equipment suppliers, to the extent required by the Owner, accompanied by a list thereof.

CONTRACTOR: (Name and address)

BY:

(Signature of authorized
representative)

(Printed name and title)

Subscribed and sworn to before me on this date:

Notary Public:

My Commission Expires:

NOT FOR BIDDING PURPOSES

THIS PAGE INTENTIONALLY LEFT BLANK

DRAFT AIA® Document G707™ – 1994

Consent Of Surety to Final Payment

PROJECT: (Name and address) testing	ARCHITECT'S PROJECT NUMBER: CONTRACT FOR: General Construction	OWNER: ☐ ARCHITECT: ☐ CONTRACTOR: ☐ SURETY: ☐ OTHER: ☐
TO OWNER: (Name and address)	CONTRACT DATED:	

In accordance with the provisions of the Contract between the Owner and the Contractor as indicated above, the
(Insert name and address of Surety)

on bond of
(Insert name and address of Contractor)

hereby approves of the final payment to the Contractor and agrees that final payment to the Contractor shall not relieve the Surety of any of its obligations to
(Insert name and address of Owner)

as set forth in said Surety's bond.

IN WITNESS WHEREOF the Surety has hereunto set its hand on this date:
(Insert in writing the month followed by the numeric date and year.)

(Surety)

(Signature of authorized representative)

(Printed name and title)

Attest:
(Seal):

NOT FOR BIDDING PURPOSES

THIS PAGE INTENTIONALLY LEFT BLANK

SECTION 00 72 13
GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION
A201 - 2017

The General Conditions of this Contract are as stated in the American Institute of Architects Document AIA A201 (2017 Edition) entitled General Conditions of the Contract for Construction as revised by the Supplementary General Conditions and is part of this project manual as is herein written in full.

END OF SECTION

NOT FOR BIDDING PURPOSES

THIS PAGE INTENTIONALLY LEFT BLANK

DRAFT AIA® Document A201™ – 2017

General Conditions of the Contract for Construction

for the following PROJECT:

(Name and location or address)

«testing»

«»

THE OWNER:

(Name, legal status and address)

« »« »

« »

THE ARCHITECT:

(Name, legal status and address)

« »« »

« »

TABLE OF ARTICLES

- | | |
|----|--|
| 1 | GENERAL PROVISIONS |
| 2 | OWNER |
| 3 | CONTRACTOR |
| 4 | ARCHITECT |
| 5 | SUBCONTRACTORS |
| 6 | CONSTRUCTION BY OWNER OR BY SEPARATE CONTRACTORS |
| 7 | CHANGES IN THE WORK |
| 8 | TIME |
| 9 | PAYMENTS AND COMPLETION |
| 10 | PROTECTION OF PERSONS AND PROPERTY |
| 11 | INSURANCE AND BONDS |
| 12 | UNCOVERING AND CORRECTION OF WORK |
| 13 | MISCELLANEOUS PROVISIONS |
| 14 | TERMINATION OR SUSPENSION OF THE CONTRACT |
| 15 | CLAIMS AND DISPUTES |

ADDITIONS AND DELETIONS: The author of this document has added information needed for its completion. The author may also have revised the text of the original AIA standard form. An *Additions and Deletions Report* that notes added information as well as revisions to the standard form text is available from the author and should be reviewed.

This document has important legal consequences. Consultation with an attorney is encouraged with respect to its completion or modification.

For guidance in modifying this document to include supplementary conditions, see AIA Document A503™, Guide for Supplementary Conditions.

ELECTRONIC COPYING of any portion of this AIA® Document to another electronic file is prohibited and constitutes a violation of copyright laws as set forth in the footer of this document.

INDEX

(Topics and numbers in bold are Section headings.)

Acceptance of Nonconforming Work

9.6.6, 9.9.3, **12.3**

Acceptance of Work

9.6.6, 9.8.2, 9.9.3, 9.10.1, 9.10.3, **12.3**

Access to Work

3.16, 6.2.1, **12.1**

Accident Prevention

10

Acts and Omissions

3.2, 3.3.2, 3.12.8, 3.18, 4.2.3, 8.3.1, 9.5.1, 10.2.5,
10.2.8, 13.3.2, 14.1, 15.1.2, **15.2**

Addenda

1.1.1

Additional Costs, Claims for

3.7.4, 3.7.5, 10.3.2, **15.1.5**

Additional Inspections and Testing

9.4.2, 9.8.3, 12.2.1, **13.4**

Additional Time, Claims for

3.2.4, 3.7.4, 3.7.5, 3.10.2, 8.3.2, **15.1.6**

Administration of the Contract

3.1.3, **4.2**, 9.4, 9.5

Advertisement or Invitation to Bid

1.1.1

Aesthetic Effect

4.2.13

Allowances

3.8

Applications for Payment

4.2.5, 7.3.9, 9.2, **9.3**, 9.4, 9.5.1, 9.5.4, 9.6.3, 9.7, 9.10

Approvals

2.1.1, 2.3.1, 2.5, 3.1.3, 3.10.2, 3.12.8, 3.12.9,
3.12.10.1, 4.2.7, 9.3.2, **13.4.1**

Arbitration

8.3.1, 15.3.2, **15.4**

ARCHITECT

4

Architect, Definition of

4.1.1

Architect, Extent of Authority

2.5, 3.12.7, 4.1.2, 4.2, 5.2, 6.3, 7.1.2, 7.3.4, 7.4, 9.2,
9.3.1, 9.4, 9.5, 9.6.3, 9.8, 9.10.1, 9.10.3, 12.1, 12.2.1,
13.4.1, 13.4.2, 14.2.2, 14.2.4, 15.1.4, **15.2.1**

Architect, Limitations of Authority and Responsibility

2.1.1, 3.12.4, 3.12.8, 3.12.10, 4.1.2, 4.2.1, 4.2.2, 4.2.3,
4.2.6, 4.2.7, 4.2.10, 4.2.12, 4.2.13, 5.2.1, 7.4, 9.4.2,
9.5.4, 9.6.4, 15.1.4, **15.2**

Architect's Additional Services and Expenses

2.5, 12.2.1, 13.4.2, 13.4.3, **14.2.4**

Architect's Administration of the Contract

3.1.3, 3.7.4, **15.2**, 9.4.1, 9.5

Architect's Approvals

2.5, 3.1.3, 3.5, 3.10.2, 4.2.7

Architect's Authority to Reject Work

3.5, 4.2.6, 12.1.2, **12.2.1**

Architect's Copyright

1.1.7, **1.5**

Architect's Decisions

3.7.4, 4.2.6, 4.2.7, 4.2.11, 4.2.12, 4.2.13, 4.2.14, 6.3,
7.3.4, 7.3.9, 8.1.3, 8.3.1, 9.2, 9.4.1, 9.5, 9.8.4, 9.9.1,
13.4.2, **15.2**

Architect's Inspections

3.7.4, 4.2.2, 4.2.9, 9.4.2, 9.8.3, 9.9.2, 9.10.1, **13.4**

Architect's Instructions

3.2.4, 3.3.1, 4.2.6, 4.2.7, **13.4.2**

Architect's Interpretations

4.2.11, 4.2.12

Architect's Project Representative

4.2.10

Architect's Relationship with Contractor

1.1.2, 1.5, 2.3.3, 3.1.3, 3.2.2, 3.2.3, 3.2.4, 3.3.1, 3.4.2,
3.5, 3.7.4, 3.7.5, 3.9.2, 3.9.3, 3.10, 3.11, 3.12, 3.16,
3.18, 4.1.2, 4.2, 5.2, 5.2.2, 7, 8.3.1, 9.2, 9.3, 9.4, 9.5,
9.7, 9.8, 9.9, 10.2.6, 10.3, 11.3, 12, 13.3.2, 13.4, **15.2**

Architect's Relationship with Subcontractors

1.1.2, 4.2.3, 4.2.4, 4.2.6, 9.6.3, 9.6.4, **11.3**

Architect's Representations

9.4.2, 9.5.1, 9.10.1

Architect's Site Visits

3.7.4, 4.2.2, 4.2.9, 9.4.2, 9.5.1, 9.9.2, 9.10.1, **13.4**

Asbestos

10.3.1

Attorneys' Fees

3.18.1, 9.6.8, 9.10.2, **10.3.3**

Award of Separate Contracts

6.1.1, 6.1.2

Award of Subcontracts and Other Contracts for Portions of the Work

5.2

Basic Definitions

1.1

Bidding Requirements

1.1.1

Binding Dispute Resolution

8.3.1, 9.7, 11.5, 13.1, 15.1.2, 15.1.3, 15.2.1, 15.2.5,
15.2.6.1, 15.3.1, 15.3.2, 15.3.3, **15.4.1**

Bonds, Lien

7.3.4.4, 9.6.8, 9.10.2, 9.10.3

Bonds, Performance, and Payment

7.3.4.4, 9.6.7, 9.10.3, **11.1.2**, 11.1.3, **11.5**

Building Information Models Use and Reliance

1.8

Building Permit

3.7.1

Capitalization

1.3

Certificate of Substantial Completion

9.8.3, 9.8.4, 9.8.5

Certificates for Payment

4.2.1, 4.2.5, 4.2.9, 9.3.3, **9.4**, 9.5, 9.6.1, 9.6.6, 9.7,
9.10.1, 9.10.3, 14.1.1.3, 14.2.4, **15.1.4**

Certificates of Inspection, Testing or Approval

13.4.4

Certificates of Insurance

9.10.2

Change Orders

1.1.1, 3.4.2, 3.7.4, 3.8.2.3, 3.11, 3.12.8, 4.2.8, 5.2.3, 7.1.2, 7.1.3, **7.2**, 7.3.2, 7.3.7, 7.3.9, 7.3.10, 8.3.1, 9.3.1.1, 9.10.3, 10.3.2, 11.2, 11.5, 12.1.2

Change Orders, Definition of

7.2.1

CHANGES IN THE WORK

2.2.2, 3.11, 4.2.8, 7, 7.2.1, 7.3.1, 7.4, 8.3.1, 9.3.1.1, 11.5

Claims, Definition of

15.1.1

Claims, Notice of

1.6.2, 15.1.3

CLAIMS AND DISPUTES

3.2.4, 6.1.1, 6.3, 7.3.9, 9.3.3, 9.10.4, 10.3.3, **15**, 15.4

Claims and Timely Assertion of Claims

15.4.1

Claims for Additional Cost

3.2.4, 3.3.1, 3.7.4, 7.3.9, 9.5.2, 10.2.5, 10.3.2, **15.1.5**

Claims for Additional Time

3.2.4, 3.3.1, 3.7.4, 6.1.1, 8.3.2, 9.5.2, 10.3.2, **15.1.6**

Concealed or Unknown Conditions, Claims for

3.7.4

Claims for Damages

3.2.4, 3.18, 8.3.3, 9.5.1, 9.6.7, 10.2.5, 10.3.3, 11.3, 11.3.2, 14.2.4, 15.1.7

Claims Subject to Arbitration

15.4.1

Cleaning Up

3.15, 6.3

Commencement of the Work, Conditions Relating to

2.2.1, 3.2.2, 3.4.1, 3.7.1, 3.10.1, 3.12.8, 5.2.1, 5.2.3,

6.2.2, 8.1.2, 8.2.2, 8.3.1, 11.1, 11.2, **15.1.5**

Commencement of the Work, Definition of

8.1.2

Communications

3.9.1, **4.2.4**

Completion, Conditions Relating to

3.4.1, 3.11, 3.15, 4.2.2, 4.2.9, 8.2, 9.4.2, 9.8, 9.9.1, 9.10, 12.2, 14.1.3, 15.1.2

COMPLETION, PAYMENTS AND

9

Completion, Substantial

3.10.1, 4.2.9, 8.1.1, 8.1.3, 8.2.3, 9.4.2, 9.8, 9.9.1,

9.10.3, 12.2, 15.1.2

Compliance with Laws

2.3.2, 3.2.3, 3.6, 3.7, 3.12.10, 3.13, 9.6.4, 10.2.2, 13.1, 13.3, 13.4.1, 13.4.2, 13.5, 14.1.1, 14.2.1.3, 15.2.8,

15.4.2, 15.4.3

Concealed or Unknown Conditions

3.7.4, 4.2.8, 8.3.1, 10.3

Conditions of the Contract

1.1.1, 6.1.1, 6.1.4

Consent, Written

3.4.2, 3.14.2, 4.1.2, 9.8.5, 9.9.1, 9.10.2, 9.10.3, 13.2,

15.4.4.2

Consolidation or Joinder

15.4.4

CONSTRUCTION BY OWNER OR BY SEPARATE CONTRACTORS

1.1.4, **6**

Construction Change Directive, Definition of

7.3.1

Construction Change Directives

1.1.1, 3.4.2, 3.11, 3.12.8, 4.2.8, 7.1.1, 7.1.2, 7.1.3, **7.3**,

9.3.1.1

Construction Schedules, Contractor's

3.10, 3.11, 3.12.1, 3.12.2, 6.1.3, 15.1.6.2

Contingent Assignment of Subcontracts

5.4, 14.2.2.2

Continuing Contract Performance

15.1.4

Contract, Definition of

1.1.2

CONTRACT, TERMINATION OR SUSPENSION OF THE

5.4.1.1, 5.4.2, 11.5, **14**

Contract Administration

3.1.3, 4, 9.4, 9.5

Contract Award and Execution, Conditions Relating to

3.7.1, 3.10, 5.2, 6.1

Contract Documents, Copies Furnished and Use of

1.5.2, 2.3.6, 5.3

Contract Documents, Definition of

1.1.1

Contract Sum

2.2.2, 2.2.4, 3.7.4, 3.7.5, 3.8, 3.10.2, 5.2.3, 7.3, 7.4, **9.1**, 9.2, 9.4.2, 9.5.1.4, 9.6.7, 9.7, 10.3.2, 11.5, 12.1.2,

12.3, 14.2.4, 14.3.2, 15.1.4.2, **15.1.5**, **15.2.5**

Contract Sum, Definition of

9.1

Contract Time

1.1.4, 2.2.1, 2.2.2, 3.7.4, 3.7.5, 3.10.2, 5.2.3, 6.1.5, 7.2.1.3, 7.3.1, 7.3.5, 7.3.6, 7, 7, 7.3.10, 7.4, 8.1.1,

8.2.1, 8.2.3, 8.3.1, 9.5.1, 9.7, 10.3.2, 12.1.1, 12.1.2, 14.3.2, 15.1.4.2, 15.1.6.1, 15.2.5

Contract Time, Definition of

8.1.1

CONTRACTOR

3

Contractor, Definition of

3.1, **6.1.2**

Contractor's Construction and Submittal Schedules

3.10, 3.12.1, 3.12.2, 4.2.3, 6.1.3, 15.1.6.2

Contractor's Employees

2.2.4, 3.3.2, 3.4.3, 3.8.1, 3.9, 3.18.2, 4.2.3, 4.2.6, 10.2, 10.3, 11.3, 14.1, 14.2.1.1

Contractor's Liability Insurance

11.1

Contractor's Relationship with Separate Contractors and Owner's Forces

3.12.5, 3.14.2, 4.2.4, 6, 11.3, 12.2.4

Contractor's Relationship with Subcontractors
1.2.2, 2.2.4, 3.3.2, 3.18.1, 3.18.2, 4.2.4, 5, 9.6.2, 9.6.7, 9.10.2, 11.2, 11.3, 11.4

Contractor's Relationship with the Architect
1.1.2, 1.5, 2.3.3, 3.1.3, 3.2.2, 3.2.3, 3.2.4, 3.3.1, 3.4.2, 3.5.1, 3.7.4, 3.10, 3.11, 3.12, 3.16, 3.18, 4.2, 5.2, 6.2.2, 7, 8.3.1, 9.2, 9.3, 9.4, 9.5, 9.7, 9.8, 9.9, 10.2.6, 10.3, 11.3, 12, 13.4, 15.1.3, 15.2.1

Contractor's Representations
3.2.1, 3.2.2, 3.5, 3.12.6, 6.2.2, 8.2.1, 9.3.3, 9.8.2

Contractor's Responsibility for Those Performing the Work
3.3.2, 3.18, 5.3, 6.1.3, 6.2, 9.5.1, 10.2.8

Contractor's Review of Contract Documents
3.2

Contractor's Right to Stop the Work
2.2.2, 9.7

Contractor's Right to Terminate the Contract
14.1

Contractor's Submittals
3.10, 3.11, 3.12, 4.2.7, 5.2.1, 5.2.3, 9.2, 9.3, 9.8.2, 9.8.3, 9.9.1, 9.10.2, 9.10.3

Contractor's Superintendent
3.9, 10.2.6

Contractor's Supervision and Construction Procedures
1.2.2, 3.3, 3.4, 3.12.10, 4.2.2, 4.2.7, 6.1.3, 6.2.4, 7.1.3, 7.3.4, 7.3.6, 8.2, 10, 12, 14, 15.1.4

Coordination and Correlation
1.2, 3.2.1, 3.3.1, 3.10, 3.12.6, 6.1.3, 6.2.1

Copies Furnished of Drawings and Specifications
1.5, 2.3.6, 3.11

Copyrights
1.5, **3.17**

Correction of Work
2.5, 3.7.3, 9.4.2, 9.8.2, 9.8.3, 9.9.1, 12.1.2, **12.2**, 12.3, 15.1.3.1, 15.1.3.2, 15.2.1

Correlation and Intent of the Contract Documents
1.2

Cost, Definition of
7.3.4

Costs
2.5, 3.2.4, 3.7.3, 5.8.2, 3.15.2, 5.4.2, 6.1.1, 6.2.3, 7.3.3.2, 7.3.4, 7.3.8, 7.3.9, 9.10.2, 10.3.2, 10.3.6, 11.2, 12.1.2, 12.2.1, 12.2.4, 13.4, 14

Cutting and Patching
3.14, 6.2.5

Damage to Construction of Owner or Separate Contractors
3.14.2, 6.2.4, 10.2.1.2, 10.2.5, 10.4, 12.2.4

Damage to the Work
3.14.2, 9.9.1, 10.2.1.2, 10.2.5, 10.4, 12.2.4

Damages, Claims for
3.2.4, 3.18, 6.1.1, 8.3.3, 9.5.1, 9.6.7, 10.3.3, 11.3.2, 11.3, 14.2.4, 15.1.7

Damages for Delay
6.2.3, 8.3.3, 9.5.1.6, 9.7, 10.3.2, 14.3.2

Date of Commencement of the Work, Definition of
8.1.2

Date of Substantial Completion, Definition of
8.1.3

Day, Definition of
8.1.4

Decisions of the Architect
3.7.4, 4.2.6, 4.2.7, 4.2.11, 4.2.12, 4.2.13, 6.3, 7.3.4, 7.3.9, 8.1.3, 8.3.1, 9.2, 9.4, 9.5.1, 9.8.4, 9.9.1, 13.4.2, 14.2.2, 14.2.4, 15.1, 15.2

Decisions to Withhold Certification
9.4.1, **9.5**, 9.7, 14.1.1.3

Defective or Nonconforming Work, Acceptance, Rejection and Correction of
2.5, 3.5, 4.2.6, 6.2.3, 9.5.1, 9.5.3, 9.6.6, 9.8.2, 9.9.3, 9.10.4, 12.2.1

Definitions
1.1, 2.1.1, 3.1.1, 3.5, 3.12.1, 3.12.2, 3.12.3, 4.1.1, 5.1, 6.1.2, 7.2.1, 7.3.1, 8.1, 9.1, 9.8.1, 15.1.1

Delays and Extensions of Time
3.2, **3.7.4**, **5.2.3**, 7.2.1, 7.3.1, **7.4**, **8.3**, 9.5.1, **9.7**, 10.3.2, **10.4**, 14.3.2, **15.1.6**, 15.2.5

Digital Data Use and Transmission
1.7

Disputes
6.3, 7.3.9, 15.1, 15.2

Documents and Samples at the Site
3.11

Drawings, Definition of
1.1.5

Drawings and Specifications, Use and Ownership of
3.11

Effective Date of Insurance
8.2.2

Emergencies
10.4, 14.1.1.2, **15.1.5**

Employees, Contractor's
3.3.2, 3.4.3, 3.8.1, 3.9, 3.18.2, 4.2.3, 4.2.6, 10.2, 10.3.3, 11.3, 14.1, 14.2.1.1

Equipment, Labor, or Materials
1.1.3, 1.1.6, 3.4, 3.5, 3.8.2, 3.8.3, 3.12, 3.13, 3.15.1, 4.2.6, 4.2.7, 5.2.1, 6.2.1, 7.3.4, 9.3.2, 9.3.3, 9.5.1.3, 9.10.2, 10.2.1, 10.2.4, 14.2.1.1, 14.2.1.2

Execution and Progress of the Work
1.1.3, 1.2.1, 1.2.2, 2.3.4, 2.3.6, 3.1, 3.3.1, 3.4.1, 3.7.1, 3.10.1, 3.12, 3.14, 4.2, 6.2.2, 7.1.3, 7.3.6, 8.2, 9.5.1, 9.9.1, 10.2, 10.3, 12.1, 12.2, 14.2, 14.3.1, 15.1.4

Extensions of Time
3.2.4, 3.7.4, 5.2.3, 7.2.1, 7.3, 7.4, 9.5.1, 9.7, 10.3.2, 10.4, 14.3, 15.1.6, **15.2.5**

Failure of Payment
9.5.1.3, **9.7**, 9.10.2, 13.5, 14.1.1.3, 14.2.1.2

Faulty Work
(See Defective or Nonconforming Work)

Final Completion and Final Payment
4.2.1, 4.2.9, 9.8.2, **9.10**, 12.3, 14.2.4, 14.4.3

Financial Arrangements, Owner's
2.2.1, 13.2.2, 14.1.1.4

GENERAL PROVISIONS

1

Governing Law

13.1

Guarantees (See Warranty)

Hazardous Materials and Substances

10.2.4, 10.3

Identification of Subcontractors and Suppliers
5.2.1

Indemnification

3.17, 3.18, 9.6.8, 9.10.2, 10.3.3, 11.3

Information and Services Required of the Owner

2.1.2, 2.2, 2.3, 3.2.2, 3.12.10.1, 6.1.3, 6.1.4, 6.2.5,
9.6.1, 9.9.2, 9.10.3, 10.3.3, 11.2, 13.4.1, 13.4.2,
14.1.1.4, 14.1.4, 15.1.4

Initial Decision

15.2

Initial Decision Maker, Definition of

1.1.8

Initial Decision Maker, Decisions

14.2.4, 15.1.4.2, 15.2.1, 15.2.2, 15.2.3, 15.2.4, 15.2.5

Initial Decision Maker, Extent of Authority

14.2.4, 15.1.4.2, 15.2.1, 15.2.2, 15.2.3, 15.2.4, 15.2.5

Injury or Damage to Person or Property

10.2.8, 10.4

Inspections

3.1.3, 3.3.3, 3.7.1, 4.2.2, 4.2.6, 4.2.9, 9.4.2, 9.8.3,
9.9.2, 9.10.1, 12.2.1, 13.4

Instructions to Bidders

1.1.1

Instructions to the Contractor

3.2.4, 3.3.1, 3.8.1, 5.2.1, 7, 8.2.2, 12, 13.4.2

Instruments of Service, Definition of

1.1.7

Insurance

6.1.1, 7.3.4, 8.2.2, 9.3.2, 9.8.4, 9.9.1, 9.10.2, 10.2.5, 11

Insurance, Notice of Cancellation or Expiration

11.1.4, 11.2.3

Insurance, Contractor's Liability

11.1

Insurance, Effective Date of

8.2.2, 14.4.2

Insurance, Owner's Liability

11.2

Insurance, Property

10.2.5, 11.2, 11.4, 11.5

Insurance, Stored Materials

9.3.2

INSURANCE AND BONDS

11

Insurance Companies, Consent to Partial Occupancy
9.9.1

Insured loss, Adjustment and Settlement of
11.5

Intent of the Contract Documents

1.2.1, 4.2.7, 4.2.12, 4.2.13

Interest

13.5

Interpretation

1.1.8, 1.2.3, 1.4, 4.1.1, 5.1, 6.1.2, 15.1.1

Interpretations, Written

4.2.11, 4.2.12

Judgment on Final Award

15.4.2

Labor and Materials, Equipment

1.1.3, 1.1.6, 3.4, 3.5, 3.8.2, 3.8.3, 3.12, 3.13, 3.15.1,
5.2.1, 6.2.1, 7.3.4, 9.3.2, 9.3.3, 9.5.1.3, 9.10.2, 10.2.1,
10.2.4, 14.2.1.1, 14.2.1.2

Labor Disputes

8.3.1

Laws and Regulations

1.5, 2.3.2, 3.2.3, 3.2.4, 3.6, 3.7, 3.12.10, 3.13, 9.6.4,
9.9.1, 10.2.2, 13.1, 13.3.1, 13.4.2, 13.5, 14, 15.2.8,
15.4

Liens

2.1.2, 9.3.1, 9.3.3, 9.6.8, 9.10.2, 9.10.4, 15.2.8

Limitations, Statutes of

12.2.5, 15.1.2, 15.1.1

Limitations of Liability

3.2.2, 3.5, 3.12.10, 3.12.10.1, 3.17, 3.18.1, 4.2.6,
4.2.7, 6.2.2, 9.4.2, 9.6.4, 9.6.7, 9.6.8, 10.2.5, 10.3.3,
11.3, 12.2.5, 13.3.1

Limitations of Time

2.1.2, 2.2, 2.5, 3.2.2, 3.10, 3.11, 3.12.5, 3.15.1, 4.2.7,
5.2, 5.3, 5.4.1, 6.2.4, 7.3, 7.4, 8.2, 9.2, 9.3.1, 9.3.3,
9.4.1, 9.5, 9.6, 9.7, 9.8, 9.9, 9.10, 12.2, 13.4, 14, 15,
15.1.2, 15.1.3, 15.1.5

Materials, Hazardous

10.2.4, 10.3

Materials, Labor, Equipment and

1.1.3, 1.1.6, 3.4.1, 3.5, 3.8.2, 3.8.3, 3.12, 3.13, 3.15.1,
5.2.1, 6.2.1, 7.3.4, 9.3.2, 9.3.3, 9.5.1.3, 9.10.2,
10.2.1.2, 10.2.4, 14.2.1.1, 14.2.1.2

Means, Methods, Techniques, Sequences and
Procedures of Construction

3.3.1, 3.12.10, 4.2.2, 4.2.7, 9.4.2

Mechanic's Lien

2.1.2, 9.3.1, 9.3.3, 9.6.8, 9.10.2, 9.10.4, 15.2.8

Mediation

8.3.1, 15.1.3.2, 15.2.1, 15.2.5, 15.2.6, 15.3, 15.4.1,
15.4.1.1

Minor Changes in the Work

1.1.1, 3.4.2, 3.12.8, 4.2.8, 7.1, 7.4

MISCELLANEOUS PROVISIONS

13

Modifications, Definition of

1.1.1

Modifications to the Contract

1.1.1, 1.1.2, 2.5, 3.11, 4.1.2, 4.2.1, 5.2.3, 7, 8.3.1, 9.7,
10.3.2

Mutual Responsibility

6.2

Nonconforming Work, Acceptance of

9.6.6, 9.9.3, 12.3

Nonconforming Work, Rejection and Correction of
2.4, 2.5, 3.5, 4.2.6, 6.2.4, 9.5.1, 9.8.2, 9.9.3, 9.10.4,
12.2

Notice

1.6, 1.6.1, 1.6.2, 2.1.2, 2.2.2., 2.2.3, 2.2.4, 2.5, 3.2.4,
3.3.1, 3.7.4, 3.7.5, 3.9.2, 3.12.9, 3.12.10, 5.2.1, 7.4,
8.2.2 9.6.8, 9.7, 9.10.1, 10.2.8, 10.3.2, 11.5, 12.2.2.1,
13.4.1, 13.4.2, 14.1, 14.2.2, 14.4.2, 15.1.3, 15.1.5,
15.1.6, 15.4.1

Notice of Cancellation or Expiration of Insurance
11.1.4, 11.2.3

Notice of Claims

1.6.2, 2.1.2, 3.7.4, 9.6.8, 10.2.8, **15.1.3**, 15.1.5, 15.1.6,
15.2.8, 15.3.2, 15.4.1

Notice of Testing and Inspections
13.4.1, 13.4.2

Observations, Contractor's
3.2, 3.7.4

Occupancy
2.3.1, 9.6.6, 9.8

Orders, Written
1.1.1, 2.4, 3.9.2, 7, 8.2.2, 11.5, 12.1, 12.2.2.1, 13.4.2,
14.3.1

OWNER

2

Owner, Definition of

2.1.1

Owner, Evidence of Financial Arrangements
2.2, 13.2.2, 14.1.1.4

Owner, Information and Services Required of the
2.1.2, **2.2**, 2.3, 3.2.2, 3.12.10, 6.1.3, 6.1.4, 6.2.5, 9.3.2,
9.6.1, 9.6.4, 9.9.2, 9.10.3, 10.3.3, 11.2, 13.4.1, 13.4.2,
14.1.1.4, 14.1.4, 15.1.4

Owner's Authority
1.5, 2.1.1, 2.3.32.4, 2.5, 3.4.2, 3.6.1, 3.12.10, 3.14.2,
4.1.2, 4.2.4, 4.2.9, 5.2.1, 5.2.4, 5.4.1, 6.1, 6.3, 7.2.1,
7.3.1, 8.2.2, 8.3.1, 9.3.2, 9.5.1, 9.6.4, 9.9.1, 9.10.2,
10.3.2, 11.4, 11.5, 12.2.2, 12.3, 13.2.2, 14.3, 14.4,
15.2.7

Owner's Insurance

11.2

Owner's Relationship with Subcontractors
1.1.2, 5.2, 5.3, 5.4, 9.6.4, 9.10.2, 14.2.2

Owner's Right to Carry Out the Work
2.5, 14.2.2

Owner's Right to Clean Up
6.3

**Owner's Right to Perform Construction and to
Award Separate Contracts**

6.1

Owner's Right to Stop the Work
2.4

Owner's Right to Suspend the Work
14.3

Owner's Right to Terminate the Contract
14.2, 14.4

Ownership and Use of Drawings, Specifications and Other Instruments of Service

1.1.1, 1.1.6, 1.1.7, **1.5**, 2.3.6, 3.2.2, 3.11, 3.17, 4.2.12,
5.3

Partial Occupancy or Use

9.6.6, **9.9**

Patching, Cutting and

3.14, 6.2.5

Patents

3.17

Payment, Applications for

4.2.5, 7.3.9, 9.2, **9.3**, 9.4, 9.5, 9.6.3, 9.7, 9.8.5, 9.10.1,
14.2.3, 14.2.4, 14.4.3

Payment, Certificates for

4.2.5, 4.2.9, 9.3.3, **9.4**, 9.5, 9.6.4, 9.6.6, 9.7, 9.10.1,
9.10.3, 14.1.1.3, 14.2.4

Payment, Failure of

9.5.1.3, **9.7**, 9.10.2, 13.5, 14.1.1.3, 14.2.1.2

Payment, Final

4.2.1, 4.2.9, **9.10**, 12.3, 14.2.4, 14.4.3

Payment Bond, Performance Bond and

7.3.4.4, 9.6.7, 9.10.3, **11.1.2**

Payments, Progress

9.3, **9.6**, 9.8.5, 9.10.3, 14.2.3, 15.1.4

PAYMENTS AND COMPLETION

9

Payments to Subcontractors

5.4.2, 9.5.1.3, 9.6.2, 9.6.3, 9.6.4, 9.6.7, 14.2.1.2

PCB

10.3.1

Performance Bond and Payment Bond

7.3.4.4, 9.6.7, 9.10.3, **11.1.2**

Permits, Fees, Notices and Compliance with Laws

2.3.1, **3.7**, 3.13, 7.3.4.4, 10.2.2

PERSONS AND PROPERTY, PROTECTION OF 10

Polychlorinated Biphenyl

10.3.1

Product Data, Definition of
3.12.2

Product Data and Samples, Shop Drawings

3.11, **3.12**, 4.2.7

Progress and Completion

4.2.2, **8.2**, 9.8, 9.9.1, 14.1.4, 15.1.4

Progress Payments

9.3, **9.6**, 9.8.5, 9.10.3, 14.2.3, 15.1.4

Project, Definition of

1.1.4

Project Representatives

4.2.10

Property Insurance

10.2.5, **11.2**

Proposal Requirements

1.1.1

PROTECTION OF PERSONS AND PROPERTY 10

Regulations and Laws

1.5, 2.3.2, 3.2.3, 3.6, 3.7, 3.12.10, 3.13, 9.6.4, 9.9.1, 10.2.2, 13.1, 13.3, 13.4.1, 13.4.2, 13.5, 14, 15.2.8, 15.4

Rejection of Work

4.2.6, 12.2.1

Releases and Waivers of Liens

9.3.1, 9.10.2

Representations

3.2.1, 3.5, 3.12.6, 8.2.1, 9.3.3, 9.4.2, 9.5.1, 9.10.1

Representatives

2.1.1, 3.1.1, 3.9, 4.1.1, 4.2.10, 13.2.1

Responsibility for Those Performing the Work

3.3.2, 3.18, 4.2.2, 4.2.3, 5.3, 6.1.3, 6.2, 6.3, 9.5.1, 10

Retainage

9.3.1, 9.6.2, 9.8.5, 9.9.1, 9.10.2, 9.10.3

Review of Contract Documents and Field

Conditions by Contractor

3.2, 3.12.7, 6.1.3

Review of Contractor's Submittals by Owner and Architect

3.10.1, 3.10.2, 3.11, 3.12, 4.2, 5.2, 6.1.3, 9.2, 9.8.2

Review of Shop Drawings, Product Data and Samples by Contractor

3.12

Rights and Remedies

1.1.2, 2.4, 2.5, 3.5, 3.7.4, 3.15.2, 4.2.6, 5.3, 5.4, 6.1, 6.3, 7.3.1, 8.3, 9.5.1, 9.7, 10.2.5, 10.3, 12.2.1, 12.2.2, 12.2.4, 13.3, 14, 15.4

Royalties, Patents and Copyrights

3.17

Rules and Notices for Arbitration

15.4.1

Safety of Persons and Property

10.2, 10.4

Safety Precautions and Programs

3.3.1, 4.2.2, 4.2.7, 5.3, 10.1, 10.2, 10.4

Samples, Definition of

3.12.3

Samples, Shop Drawings, Product Data and

3.11, 3.12, 4.2.7

Samples at the Site, Documents and

3.11

Schedule of Values

9.2, 9.3.1

Schedule of Construction

3.10, 3.12.1, 3.12.2, 6.1.3, 15.1.6.2

Separate Contracts and Contractors

1.1.4, 3.12.5, 3.14.2, 4.2.4, 4.2.7, 6, 8.3.1, 12.1.2

Separate Contractors, Definition of

6.1.1

Shop Drawings, Definition of

3.12.1

Shop Drawings, Product Data and Samples

3.11, 3.12, 4.2.7

Site, Use of

3.13, 6.1.1, 6.2.1

Site Inspections

3.2.2, 3.3.3, 3.7.1, 3.7.4, 4.2, 9.9.2, 9.4.2, 9.10.1, 13.4

Site Visits, Architect's

3.7.4, 4.2.2, 4.2.9, 9.4.2, 9.5.1, 9.9.2, 9.10.1, 13.4

Special Inspections and Testing

4.2.6, 12.2.1, 13.4

Specifications, Definition of

1.1.6

Specifications

1.1.1, 1.1.6, 1.2.2, 1.5, 3.12.10, 3.17, 4.2.14

Statute of Limitations

15.1.2, 15.4.1.1

Stopping the Work

2.2.2, 2.4, 9.7, 10.3, 14.1

Stored Materials

6.2.1, 9.3.2, 10.2.1.2, 10.2.4

Subcontractor, Definition of

5.1.1

SUBCONTRACTORS

5

Subcontractors, Work by

1.2.2, 3.3.2, 3.12.1, 3.18, 4.2.3, 5.2.3, 5.3, 5.4, 9.3.1.2, 9.6.7

Subcontractual Relations

5.3, 5.4, 9.3.1.2, 9.6, 9.10, 10.2.1, 14.1, 14.2.1

Submittals

3.10, 3.11, 3.12, 4.2.7, 5.2.1, 5.2.3, 7.3.4, 9.2, 9.3, 9.8, 9.9.1, 9.10.2, 9.10.3

Submittal Schedule

3.10.2, 3.12.5, 4.2.7

Subrogation, Waivers of

6.1.1, 11.3

Substances, Hazardous

10.3

Substantial Completion

4.2.9, 8.1.1, 8.1.3, 8.2.3, 9.4.2, 9.8, 9.9.1, 9.10.3, 12.2, 15.1.2

Substantial Completion, Definition of

9.8.1

Substitution of Subcontractors

5.2.3, 5.2.4

Substitution of Architect

2.3.3

Substitutions of Materials

3.4.2, 3.5, 7.3.8

Sub-subcontractor, Definition of

5.1.2

Subsurface Conditions

3.7.4

Successors and Assigns

13.2

Superintendent

3.9, 10.2.6

Supervision and Construction Procedures

1.2.2, 3.3, 3.4, 3.12.10, 4.2.2, 4.2.7, 6.1.3, 6.2.4, 7.1.3, 7.3.4, 8.2, 8.3.1, 9.4.2, 10, 12, 14, 15.1.4

Suppliers

1.5, 3.12.1, 4.2.4, 4.2.6, 5.2.1, 9.3, 9.4.2, 9.5.4, 9.6, 9.10.5, 14.2.1

Surety
5.4.1.2, 9.6.8, 9.8.5, 9.10.2, 9.10.3, 11.1.2, 14.2.2,
15.2.7

Surety, Consent of
9.8.5, 9.10.2, 9.10.3

Surveys
1.1.7, 2.3.4

Suspension by the Owner for Convenience 14.3

Suspension of the Work
3.7.5, 5.4.2, 14.3

Suspension or Termination of the Contract
5.4.1.1, 14

Taxes
3.6, 3.8.2.1, 7.3.4.4

**Termination by the Contractor
14.1, 15.1.7**

**Termination by the Owner for Cause
5.4.1.1, 14.2, 15.1.7**

**Termination by the Owner for Convenience
14.4**

Termination of the Architect
2.3.3

Termination of the Contractor Employment
14.2.2

TERMINATION OR SUSPENSION OF THE CONTRACT 14

Tests and Inspections

3.1.3, 3.3.3, 3.7.1, 4.2.2, 4.2.6, 4.2.9, 9.4.2, 9.8.5,
9.9.2, 9.10.1, 10.3.2, 12.2.1, **13.4**

TIME

8

Time, Delays and Extensions of
3.2.4, 3.7.4, 5.2.3, 7.2.1, 7.3.1, 7.4, **8.3**, 9.5.1, 9.7,
10.3.2, 10.4, 14.3.2, 15.1.6, 15.2.5

Time Limits
2.1.2, 2.2, 2.5, 3.2.2, 3.10, 3.11, 3.12.5, 3.15.1, 4.2,
5.2, 5.3, 5.4, 6.2.4, 7.3, 7.4, 8.2, 9.2, 9.3.1, 9.3.3, 9.4.1,
9.5, 9.6, 9.7, 9.8, 9.9, 9.10, 12.2, 13.4, 14, 15.1.2,
15.1.3, 15.4

Time Limit on Claims
3.7.4, 10.2.4, 15.1.2, 15.1.3

Title to Work
9.3.2, 9.3.3

UNCOVERING AND CORRECTION OF WORK 12

Uncovering of Work 12.1

Unforeseen Conditions, Concealed or Unknown
3.7.4, 8.3.1, 10.3

Unit Prices
7.3.3.2, 9.1.2

Use of Documents
1.1.1, 1.5, 2.3.6, 3.12.6, 5.3

**Use of Site
3.13, 6.1.1, 6.2.1**

**Values, Schedule of
9.2, 9.3.1**

Waiver of Claims by the Architect
13.3.2

Waiver of Claims by the Contractor
9.10.5, 13.3.2, **15.1.7**

Waiver of Claims by the Owner
9.9.3, 9.10.3, 9.10.4, 12.2.2.1, 13.3.2, 14.2.4, **15.1.7**

Waiver of Consequential Damages
14.2.4, 15.1.7

Waiver of Liens
9.3, 9.10.2, 9.10.4

**Waivers of Subrogation
6.1.1, 11.3**

**Warranty
3.5, 4.2.9, 9.3.3, 9.8.4, 9.9.1, 9.10.2, 9.10.4, 12.2.2,
15.1.2**

Weather Delays
8.3, 15.1.6.2

**Work, Definition of
1.1.3**

Written Consent
1.5.2, 3.4.2, 3.7.4, 3.12.8, 3.14.2, 4.1.2, 9.3.2, 9.10.3,
13.2, 13.3.2, 15.4.4.2

Written Interpretations
4.2.11, 4.2.12

Written Orders
1.1.1, 2.4, 3.9, 7, 8.2.2, 12.1, 12.2, 13.4.2, 14.3.1

ARTICLE 1 GENERAL PROVISIONS

§ 1.1 Basic Definitions

§ 1.1.1 The Contract Documents

The Contract Documents are enumerated in the Agreement between the Owner and Contractor (hereinafter the Agreement) and consist of the Agreement, Conditions of the Contract (General, Supplementary and other Conditions), Drawings, Specifications, Addenda issued prior to execution of the Contract, other documents listed in the Agreement, and Modifications issued after execution of the Contract. A Modification is (1) a written amendment to the Contract signed by both parties, (2) a Change Order, (3) a Construction Change Directive, or (4) a written order for a minor change in the Work issued by the Architect. Unless specifically enumerated in the Agreement, the Contract Documents do not include the advertisement or invitation to bid, Instructions to Bidders, sample forms, other information furnished by the Owner in anticipation of receiving bids or proposals, the Contractor's bid or proposal, or portions of Addenda relating to bidding or proposal requirements.

§ 1.1.2 The Contract

The Contract Documents form the Contract for Construction. The Contract represents the entire and integrated agreement between the parties hereto and supersedes prior negotiations, representations, or agreements, either written or oral. The Contract may be amended or modified only by a Modification. The Contract Documents shall not be construed to create a contractual relationship of any kind (1) between the Contractor and the Architect or the Architect's consultants, (2) between the Owner and a Subcontractor or a Sub-subcontractor, (3) between the Owner and the Architect or the Architect's consultants, or (4) between any persons or entities other than the Owner and the Contractor. The Architect shall, however, be entitled to performance and enforcement of obligations under the Contract intended to facilitate performance of the Architect's duties.

§ 1.1.3 The Work

The term "Work" means the construction and services required by the Contract Documents, whether completed or partially completed, and includes all other labor, materials, equipment, and services provided or to be provided by the Contractor to fulfill the Contractor's obligations. The Work may constitute the whole or a part of the Project.

§ 1.1.4 The Project

The Project is the total construction of which the Work performed under the Contract Documents may be the whole or a part and which may include construction by the Owner and by Separate Contractors.

§ 1.1.5 The Drawings

The Drawings are the graphic and pictorial portions of the Contract Documents showing the design, location and dimensions of the Work, generally including plans, elevations, sections, details, schedules, and diagrams.

§ 1.1.6 The Specifications

The Specifications are that portion of the Contract Documents consisting of the written requirements for materials, equipment, systems, standards and workmanship for the Work, and performance of related services.

§ 1.1.7 Instruments of Service

Instruments of Service are representations, in any medium of expression now known or later developed, of the tangible and intangible creative work performed by the Architect and the Architect's consultants under their respective professional services agreements. Instruments of Service may include, without limitation, studies, surveys, models, sketches, drawings, specifications, and other similar materials.

§ 1.1.8 Initial Decision Maker

The Initial Decision Maker is the person identified in the Agreement to render initial decisions on Claims in accordance with Section 15.2. The Initial Decision Maker shall not show partiality to the Owner or Contractor and shall not be liable for results of interpretations or decisions rendered in good faith.

§ 1.2 Correlation and Intent of the Contract Documents

§ 1.2.1 The intent of the Contract Documents is to include all items necessary for the proper execution and completion of the Work by the Contractor. The Contract Documents are complementary, and what is required by one shall be as binding as if required by all; performance by the Contractor shall be required only to the extent consistent with the Contract Documents and reasonably inferable from them as being necessary to produce the indicated results.

§ 1.2.1.1 The invalidity of any provision of the Contract Documents shall not invalidate the Contract or its remaining provisions. If it is determined that any provision of the Contract Documents violates any law, or is otherwise invalid or unenforceable, then that provision shall be revised to the extent necessary to make that provision legal and enforceable. In such case the Contract Documents shall be construed, to the fullest extent permitted by law, to give effect to the parties' intentions and purposes in executing the Contract.

§ 1.2.2 Organization of the Specifications into divisions, sections and articles, and arrangement of Drawings shall not control the Contractor in dividing the Work among Subcontractors or in establishing the extent of Work to be performed by any trade.

§ 1.2.3 Unless otherwise stated in the Contract Documents, words that have well-known technical or construction industry meanings are used in the Contract Documents in accordance with such recognized meanings.

§ 1.3 Capitalization

Terms capitalized in these General Conditions include those that are (1) specifically defined, (2) the titles of numbered articles, or (3) the titles of other documents published by the American Institute of Architects.

§ 1.4 Interpretation

In the interest of brevity the Contract Documents frequently omit modifying words such as "all" and "any" and articles such as "the" and "an," but the fact that a modifier or an article is absent from one statement and appears in another is not intended to affect the interpretation of either statement.

§ 1.5 Ownership and Use of Drawings, Specifications, and Other Instruments of Service

§ 1.5.1 The Architect and the Architect's consultants shall be deemed the authors and owners of their respective Instruments of Service, including the Drawings and Specifications, and retain all common law, statutory, and other reserved rights in their Instruments of Service, including copyrights. The Contractor, Subcontractors, Sub-subcontractors, and suppliers shall not own or claim a copyright in the Instruments of Service. Submittal or distribution to meet official regulatory requirements or for other purposes in connection with the Project is not to be construed as publication in derogation of the Architect's or Architect's consultants' reserved rights.

§ 1.5.2 The Contractor, Subcontractors, Sub-subcontractors, and suppliers are authorized to use and reproduce the Instruments of Service provided to them, subject to any protocols established pursuant to Sections 1.7 and 1.8, solely and exclusively for execution of the Work. All copies made under this authorization shall bear the copyright notice, if any, shown on the Instruments of Service. The Contractor, Subcontractors, Sub-subcontractors, and suppliers may not use the Instruments of Service on other projects or for additions to the Project outside the scope of the Work without the specific written consent of the Owner, Architect, and the Architect's consultants.

§ 1.6 Notice

§ 1.6.1 Except as otherwise provided in Section 1.6.2, where the Contract Documents require one party to notify or give notice to the other party, such notice shall be provided in writing to the designated representative of the party to whom the notice is addressed and shall be deemed to have been duly served if delivered in person, by mail, by courier, or by electronic transmission if a method for electronic transmission is set forth in the Agreement.

§ 1.6.2 Notice of Claims as provided in Section 15.1.3 shall be provided in writing and shall be deemed to have been duly served only if delivered to the designated representative of the party to whom the notice is addressed by certified or registered mail, or by courier providing proof of delivery.

§ 1.7 Digital Data Use and Transmission

The parties shall agree upon protocols governing the transmission and use of Instruments of Service or any other information or documentation in digital form. The parties will use AIA Document E203™-2013, Building Information Modeling and Digital Data Exhibit, to establish the protocols for the development, use, transmission, and exchange of digital data.

§ 1.8 Building Information Models Use and Reliance

Any use of, or reliance on, all or a portion of a building information model without agreement to protocols governing the use of, and reliance on, the information contained in the model and without having those protocols set forth in AIA Document E203™-2013, Building Information Modeling and Digital Data Exhibit, and the requisite AIA Document G202™-2013, Project Building Information Modeling Protocol Form, shall be at the using or relying party's sole risk

and without liability to the other party and its contractors or consultants, the authors of, or contributors to, the building information model, and each of their agents and employees.

ARTICLE 2 OWNER

§ 2.1 General

§ 2.1.1 The Owner is the person or entity identified as such in the Agreement and is referred to throughout the Contract Documents as if singular in number. The Owner shall designate in writing a representative who shall have express authority to bind the Owner with respect to all matters requiring the Owner's approval or authorization. Except as otherwise provided in Section 4.2.1, the Architect does not have such authority. The term "Owner" means the Owner or the Owner's authorized representative.

§ 2.1.2 The Owner shall furnish to the Contractor, within fifteen days after receipt of a written request, information necessary and relevant for the Contractor to evaluate, give notice of, or enforce mechanic's lien rights. Such information shall include a correct statement of the record legal title to the property on which the Project is located, usually referred to as the site, and the Owner's interest therein.

§ 2.2 Evidence of the Owner's Financial Arrangements

§ 2.2.1 Prior to commencement of the Work and upon written request by the Contractor, the Owner shall furnish to the Contractor reasonable evidence that the Owner has made financial arrangements to fulfill the Owner's obligations under the Contract. The Contractor shall have no obligation to commence the Work until the Owner provides such evidence. If commencement of the Work is delayed under this Section 2.2.1, the Contract Time shall be extended appropriately.

§ 2.2.2 Following commencement of the Work and upon written request by the Contractor, the Owner shall furnish to the Contractor reasonable evidence that the Owner has made financial arrangements to fulfill the Owner's obligations under the Contract only if (1) the Owner fails to make payments to the Contractor as the Contract Documents require; (2) the Contractor identifies in writing a reasonable concern regarding the Owner's ability to make payment when due; or (3) a change in the Work materially changes the Contract Sum. If the Owner fails to provide such evidence, as required, within fourteen days of the Contractor's request, the Contractor may immediately stop the Work and, in that event, shall notify the Owner that the Work has stopped. However, if the request is made because a change in the Work materially changes the Contract Sum under (3) above, the Contractor may immediately stop only that portion of the Work affected by the change until reasonable evidence is provided. If the Work is stopped under this Section 2.2.2, the Contract Time shall be extended appropriately and the Contract Sum shall be increased by the amount of the Contractor's reasonable costs of shutdown, delay and start-up, plus interest as provided in the Contract Documents.

§ 2.2.3 After the Owner furnishes evidence of financial arrangements under this Section 2.2, the Owner shall not materially vary such financial arrangements without prior notice to the Contractor.

§ 2.2.4 Where the Owner has designated information furnished under this Section 2.2 as "confidential," the Contractor shall keep the information confidential and shall not disclose it to any other person. However, the Contractor may disclose "confidential" information, after seven (7) days' notice to the Owner, where disclosure is required by law, including a subpoena or other form of compulsory legal process issued by a court or governmental entity, or by court or arbitrator's order. The Contractor may also disclose "confidential" information to its employees, consultants, sureties, Subcontractors and their employees, Sub-subcontractors, and others who need to know the content of such information solely and exclusively for the Project and who agree to maintain the confidentiality of such information.

§ 2.3 Information and Services Required of the Owner

§ 2.3.1 Except for permits and fees that are the responsibility of the Contractor under the Contract Documents, including those required under Section 3.7.1, the Owner shall secure and pay for necessary approvals, easements, assessments and charges required for construction, use or occupancy of permanent structures or for permanent changes in existing facilities.

§ 2.3.2 The Owner shall retain an architect lawfully licensed to practice architecture, or an entity lawfully practicing architecture, in the jurisdiction where the Project is located. That person or entity is identified as the Architect in the Agreement and is referred to throughout the Contract Documents as if singular in number.

§ 2.3.3 If the employment of the Architect terminates, the Owner shall employ a successor to whom the Contractor has no reasonable objection and whose status under the Contract Documents shall be that of the Architect.

§ 2.3.4 The Owner shall furnish surveys describing physical characteristics, legal limitations and utility locations for the site of the Project, and a legal description of the site. The Contractor shall be entitled to rely on the accuracy of information furnished by the Owner but shall exercise proper precautions relating to the safe performance of the Work.

§ 2.3.5 The Owner shall furnish information or services required of the Owner by the Contract Documents with reasonable promptness. The Owner shall also furnish any other information or services under the Owner's control and relevant to the Contractor's performance of the Work with reasonable promptness after receiving the Contractor's written request for such information or services.

§ 2.3.6 Unless otherwise provided in the Contract Documents, the Owner shall furnish to the Contractor one copy of the Contract Documents for purposes of making reproductions pursuant to Section 1.5.2.

§ 2.4 Owner's Right to Stop the Work

If the Contractor fails to correct Work that is not in accordance with the requirements of the Contract Documents as required by Section 12.2 or repeatedly fails to carry out Work in accordance with the Contract Documents, the Owner may issue a written order to the Contractor to stop the Work, or any portion thereof, until the cause for such order has been eliminated; however, the right of the Owner to stop the Work shall not give rise to a duty on the part of the Owner to exercise this right for the benefit of the Contractor or any other person or entity, except to the extent required by Section 6.1.3.

§ 2.5 Owner's Right to Carry Out the Work

If the Contractor defaults or neglects to carry out the Work in accordance with the Contract Documents and fails within a ten-day period after receipt of notice from the Owner to commence and continue correction of such default or neglect with diligence and promptness, the Owner may, without prejudice to other remedies the Owner may have, correct such default or neglect. Such action by the Owner and amounts charged to the Contractor are both subject to prior approval of the Architect and the Architect may, pursuant to Section 9.5.1, withhold or nullify a Certificate for Payment in whole or in part, to the extent reasonably necessary to reimburse the Owner for the reasonable cost of correcting such deficiencies, including Owner's expenses and compensation for the Architect's additional services made necessary by such default, neglect, or failure. If current and future payments are not sufficient to cover such amounts, the Contractor shall pay the difference to the Owner. If the Contractor disagrees with the actions of the Owner or the Architect, or the amounts claimed as costs to the Owner, the Contractor may file a Claim pursuant to Article 15.

ARTICLE 3 CONTRACTOR

§ 3.1 General

§ 3.1.1 The Contractor is the person or entity identified as such in the Agreement and is referred to throughout the Contract Documents as if singular in number. The Contractor shall be lawfully licensed, if required in the jurisdiction where the Project is located. The Contractor shall designate in writing a representative who shall have express authority to bind the Contractor with respect to all matters under this Contract. The term "Contractor" means the Contractor or the Contractor's authorized representative.

§ 3.1.2 The Contractor shall perform the Work in accordance with the Contract Documents.

§ 3.1.3 The Contractor shall not be relieved of its obligations to perform the Work in accordance with the Contract Documents either by activities or duties of the Architect in the Architect's administration of the Contract, or by tests, inspections or approvals required or performed by persons or entities other than the Contractor.

§ 3.2 Review of Contract Documents and Field Conditions by Contractor

§ 3.2.1 Execution of the Contract by the Contractor is a representation that the Contractor has visited the site, become generally familiar with local conditions under which the Work is to be performed, and correlated personal observations with requirements of the Contract Documents.

§ 3.2.2 Because the Contract Documents are complementary, the Contractor shall, before starting each portion of the Work, carefully study and compare the various Contract Documents relative to that portion of the Work, as well as the information furnished by the Owner pursuant to Section 2.3.4, shall take field measurements of any existing conditions related to that portion of the Work, and shall observe any conditions at the site affecting it. These

obligations are for the purpose of facilitating coordination and construction by the Contractor and are not for the purpose of discovering errors, omissions, or inconsistencies in the Contract Documents; however, the Contractor shall promptly report to the Architect any errors, inconsistencies or omissions discovered by or made known to the Contractor as a request for information in such form as the Architect may require. It is recognized that the Contractor's review is made in the Contractor's capacity as a contractor and not as a licensed design professional, unless otherwise specifically provided in the Contract Documents.

§ 3.2.3 The Contractor is not required to ascertain that the Contract Documents are in accordance with applicable laws, statutes, ordinances, codes, rules and regulations, or lawful orders of public authorities, but the Contractor shall promptly report to the Architect any nonconformity discovered by or made known to the Contractor as a request for information in such form as the Architect may require.

§ 3.2.4 If the Contractor believes that additional cost or time is involved because of clarifications or instructions the Architect issues in response to the Contractor's notices or requests for information pursuant to Sections 3.2.2 or 3.2.3, the Contractor shall submit Claims as provided in Article 15. If the Contractor fails to perform the obligations of Sections 3.2.2 or 3.2.3, the Contractor shall pay such costs and damages to the Owner, subject to Section 15.1.7, as would have been avoided if the Contractor had performed such obligations. If the Contractor performs those obligations, the Contractor shall not be liable to the Owner or Architect for damages resulting from errors, inconsistencies or omissions in the Contract Documents, for differences between field measurements or conditions and the Contract Documents, or for nonconformities of the Contract Documents to applicable laws, statutes, ordinances, codes, rules and regulations, and lawful orders of public authorities.

§ 3.3 Supervision and Construction Procedures

§ 3.3.1 The Contractor shall supervise and direct the Work, using the Contractor's best skill and attention. The Contractor shall be solely responsible for, and have control over, construction means, methods, techniques, sequences, and procedures, and for coordinating all portions of the Work under the Contract. If the Contract Documents give specific instructions concerning construction means, methods, techniques, sequences, or procedures, the Contractor shall evaluate the jobsite safety thereof and shall be solely responsible for the jobsite safety of such means, methods, techniques, sequences, or procedures. If the Contractor determines that such means, methods, techniques, sequences or procedures may not be safe, the Contractor shall give timely notice to the Owner and Architect, and shall propose alternative means, methods, techniques, sequences, or procedures. The Architect shall evaluate the proposed alternative solely for conformance with the design intent for the completed construction. Unless the Architect objects to the Contractor's proposed alternative, the Contractor shall perform the Work using its alternative means, methods, techniques, sequences, or procedures.

§ 3.3.2 The Contractor shall be responsible to the Owner for acts and omissions of the Contractor's employees, Subcontractors and their agents and employees, and other persons or entities performing portions of the Work for, or on behalf of, the Contractor or any of its Subcontractors.

§ 3.3.3 The Contractor shall be responsible for inspection of portions of Work already performed to determine that such portions are in proper condition to receive subsequent Work.

§ 3.4 Labor and Materials

§ 3.4.1 Unless otherwise provided in the Contract Documents, the Contractor shall provide and pay for labor, materials, equipment, tools, construction equipment and machinery, water, heat, utilities, transportation, and other facilities and services necessary for proper execution and completion of the Work, whether temporary or permanent and whether or not incorporated or to be incorporated in the Work.

§ 3.4.2 Except in the case of minor changes in the Work approved by the Architect in accordance with Section 3.12.8 or ordered by the Architect in accordance with Section 7.4, the Contractor may make substitutions only with the consent of the Owner, after evaluation by the Architect and in accordance with a Change Order or Construction Change Directive.

§ 3.4.3 The Contractor shall enforce strict discipline and good order among the Contractor's employees and other persons carrying out the Work. The Contractor shall not permit employment of unfit persons or persons not properly skilled in tasks assigned to them.

§ 3.5 Warranty

§ 3.5.1 The Contractor warrants to the Owner and Architect that materials and equipment furnished under the Contract will be of good quality and new unless the Contract Documents require or permit otherwise. The Contractor further warrants that the Work will conform to the requirements of the Contract Documents and will be free from defects, except for those inherent in the quality of the Work the Contract Documents require or permit. Work, materials, or equipment not conforming to these requirements may be considered defective. The Contractor's warranty excludes remedy for damage or defect caused by abuse, alterations to the Work not executed by the Contractor, improper or insufficient maintenance, improper operation, or normal wear and tear and normal usage. If required by the Architect, the Contractor shall furnish satisfactory evidence as to the kind and quality of materials and equipment.

§ 3.5.2 All material, equipment, or other special warranties required by the Contract Documents shall be issued in the name of the Owner, or shall be transferable to the Owner, and shall commence in accordance with Section 9.8.4.

§ 3.6 Taxes

The Contractor shall pay sales, consumer, use and similar taxes for the Work provided by the Contractor that are legally enacted when bids are received or negotiations concluded, whether or not yet effective or merely scheduled to go into effect.

§ 3.7 Permits, Fees, Notices and Compliance with Laws

§ 3.7.1 Unless otherwise provided in the Contract Documents, the Contractor shall secure and pay for the building permit as well as for other permits, fees, licenses, and inspections by government agencies necessary for proper execution and completion of the Work that are customarily secured after execution of the Contract and legally required at the time bids are received or negotiations concluded.

§ 3.7.2 The Contractor shall comply with and give notices required by applicable laws, statutes, ordinances, codes, rules and regulations, and lawful orders of public authorities applicable to performance of the Work.

§ 3.7.3 If the Contractor performs Work knowing it to be contrary to applicable laws, statutes, ordinances, codes, rules and regulations, or lawful orders of public authorities, the Contractor shall assume appropriate responsibility for such Work and shall bear the costs attributable to correction.

§ 3.7.4 Concealed or Unknown Conditions

If the Contractor encounters conditions at the site that are (1) subsurface or otherwise concealed physical conditions that differ materially from those indicated in the Contract Documents or (2) unknown physical conditions of an unusual nature that differ materially from those ordinarily found to exist and generally recognized as inherent in construction activities of the character provided for in the Contract Documents, the Contractor shall promptly provide notice to the Owner and the Architect before conditions are disturbed and in no event later than 14 days after first observance of the conditions. The Architect will promptly investigate such conditions and, if the Architect determines that they differ materially and cause an increase or decrease in the Contractor's cost of, or time required for, performance of any part of the Work, will recommend that an equitable adjustment be made in the Contract Sum or Contract Time, or both. If the Architect determines that the conditions at the site are not materially different from those indicated in the Contract Documents and that no change in the terms of the Contract is justified, the Architect shall promptly notify the Owner and Contractor, stating the reasons. If either party disputes the Architect's determination or recommendation, that party may submit a Claim as provided in Article 15.

§ 3.7.5 If, in the course of the Work, the Contractor encounters human remains or recognizes the existence of burial markers, archaeological sites or wetlands not indicated in the Contract Documents, the Contractor shall immediately suspend any operations that would affect them and shall notify the Owner and Architect. Upon receipt of such notice, the Owner shall promptly take any action necessary to obtain governmental authorization required to resume the operations. The Contractor shall continue to suspend such operations until otherwise instructed by the Owner but shall continue with all other operations that do not affect those remains or features. Requests for adjustments in the Contract Sum and Contract Time arising from the existence of such remains or features may be made as provided in Article 15.

§ 3.8 Allowances

§ 3.8.1 The Contractor shall include in the Contract Sum all allowances stated in the Contract Documents. Items covered by allowances shall be supplied for such amounts and by such persons or entities as the Owner may direct, but the Contractor shall not be required to employ persons or entities to whom the Contractor has reasonable objection.

§ 3.8.2 Unless otherwise provided in the Contract Documents,

- .1 allowances shall cover the cost to the Contractor of materials and equipment delivered at the site and all required taxes, less applicable trade discounts;
- .2 Contractor's costs for unloading and handling at the site, labor, installation costs, overhead, profit, and other expenses contemplated for stated allowance amounts shall be included in the Contract Sum but not in the allowances; and
- .3 whenever costs are more than or less than allowances, the Contract Sum shall be adjusted accordingly by Change Order. The amount of the Change Order shall reflect (1) the difference between actual costs and the allowances under Section 3.8.2.1 and (2) changes in Contractor's costs under Section 3.8.2.2.

§ 3.8.3 Materials and equipment under an allowance shall be selected by the Owner with reasonable promptness.

§ 3.9 Superintendent

§ 3.9.1 The Contractor shall employ a competent superintendent and necessary assistants who shall be in attendance at the Project site during performance of the Work. The superintendent shall represent the Contractor, and communications given to the superintendent shall be as binding as if given to the Contractor.

§ 3.9.2 The Contractor, as soon as practicable after award of the Contract, shall notify the Owner and Architect of the name and qualifications of a proposed superintendent. Within 14 days of receipt of the information, the Architect may notify the Contractor, stating whether the Owner or the Architect (1) has reasonable objection to the proposed superintendent or (2) requires additional time for review. Failure of the Architect to provide notice within the 14-day period shall constitute notice of no reasonable objection.

§ 3.9.3 The Contractor shall not employ a proposed superintendent to whom the Owner or Architect has made reasonable and timely objection. The Contractor shall not change the superintendent without the Owner's consent, which shall not unreasonably be withheld or delayed.

§ 3.10 Contractor's Construction and Submittal Schedules

§ 3.10.1 The Contractor, promptly after being awarded the Contract, shall submit for the Owner's and Architect's information a Contractor's construction schedule for the Work. The schedule shall contain detail appropriate for the Project, including (1) the date of commencement of the Work, interim schedule milestone dates, and the date of Substantial Completion; (2) an apportionment of the Work by construction activity; and (3) the time required for completion of each portion of the Work. The schedule shall provide for the orderly progression of the Work to completion and shall not exceed time limits current under the Contract Documents. The schedule shall be revised at appropriate intervals as required by the conditions of the Work and Project.

§ 3.10.2 The Contractor, promptly after being awarded the Contract and thereafter as necessary to maintain a current submittal schedule, shall submit a submittal schedule for the Architect's approval. The Architect's approval shall not be unreasonably delayed or withheld. The submittal schedule shall (1) be coordinated with the Contractor's construction schedule, and (2) allow the Architect reasonable time to review submittals. If the Contractor fails to submit a submittal schedule, or fails to provide submittals in accordance with the approved submittal schedule, the Contractor shall not be entitled to any increase in Contract Sum or extension of Contract Time based on the time required for review of submittals.

§ 3.10.3 The Contractor shall perform the Work in general accordance with the most recent schedules submitted to the Owner and Architect.

§ 3.11 Documents and Samples at the Site

The Contractor shall make available, at the Project site, the Contract Documents, including Change Orders, Construction Change Directives, and other Modifications, in good order and marked currently to indicate field changes and selections made during construction, and the approved Shop Drawings, Product Data, Samples, and similar required submittals. These shall be in electronic form or paper copy, available to the Architect and Owner, and delivered to the Architect for submittal to the Owner upon completion of the Work as a record of the Work as constructed.

§ 3.12 Shop Drawings, Product Data and Samples

§ 3.12.1 Shop Drawings are drawings, diagrams, schedules, and other data specially prepared for the Work by the Contractor or a Subcontractor, Sub-subcontractor, manufacturer, supplier, or distributor to illustrate some portion of the Work.

§ 3.12.2 Product Data are illustrations, standard schedules, performance charts, instructions, brochures, diagrams, and other information furnished by the Contractor to illustrate materials or equipment for some portion of the Work.

§ 3.12.3 Samples are physical examples that illustrate materials, equipment, or workmanship, and establish standards by which the Work will be judged.

§ 3.12.4 Shop Drawings, Product Data, Samples, and similar submittals are not Contract Documents. Their purpose is to demonstrate how the Contractor proposes to conform to the information given and the design concept expressed in the Contract Documents for those portions of the Work for which the Contract Documents require submittals. Review by the Architect is subject to the limitations of Section 4.2.7. Informational submittals upon which the Architect is not expected to take responsive action may be so identified in the Contract Documents. Submittals that are not required by the Contract Documents may be returned by the Architect without action.

§ 3.12.5 The Contractor shall review for compliance with the Contract Documents, approve, and submit to the Architect, Shop Drawings, Product Data, Samples, and similar submittals required by the Contract Documents, in accordance with the submittal schedule approved by the Architect or, in the absence of an approved submittal schedule, with reasonable promptness and in such sequence as to cause no delay in the Work or in the activities of the Owner or of Separate Contractors.

§ 3.12.6 By submitting Shop Drawings, Product Data, Samples, and similar submittals, the Contractor represents to the Owner and Architect that the Contractor has (1) reviewed and approved them, (2) determined and verified materials, field measurements and field construction criteria related thereto, or will do so, and (3) checked and coordinated the information contained within such submittals with the requirements of the Work and of the Contract Documents.

§ 3.12.7 The Contractor shall perform no portion of the Work for which the Contract Documents require submittal and review of Shop Drawings, Product Data, Samples, or similar submittals, until the respective submittal has been approved by the Architect.

§ 3.12.8 The Work shall be in accordance with approved submittals except that the Contractor shall not be relieved of responsibility for deviations from the requirements of the Contract Documents by the Architect's approval of Shop Drawings, Product Data, Samples, or similar submittals, unless the Contractor has specifically notified the Architect of such deviation at the time of submittal and (1) the Architect has given written approval to the specific deviation as a minor change in the Work, or (2) a Change Order or Construction Change Directive has been issued authorizing the deviation. The Contractor shall not be relieved of responsibility for errors or omissions in Shop Drawings, Product Data, Samples, or similar submittals, by the Architect's approval thereof.

§ 3.12.9 The Contractor shall direct specific attention, in writing or on resubmitted Shop Drawings, Product Data, Samples, or similar submittals, to revisions other than those requested by the Architect on previous submittals. In the absence of such notice, the Architect's approval of a resubmission shall not apply to such revisions.

§ 3.12.10 The Contractor shall not be required to provide professional services that constitute the practice of architecture or engineering unless such services are specifically required by the Contract Documents for a portion of the Work or unless the Contractor needs to provide such services in order to carry out the Contractor's responsibilities for construction means, methods, techniques, sequences, and procedures. The Contractor shall not be required to provide professional services in violation of applicable law.

§ 3.12.10.1 If professional design services or certifications by a design professional related to systems, materials, or equipment are specifically required of the Contractor by the Contract Documents, the Owner and the Architect will specify all performance and design criteria that such services must satisfy. The Contractor shall be entitled to rely upon the adequacy and accuracy of the performance and design criteria provided in the Contract Documents. The Contractor shall cause such services or certifications to be provided by an appropriately licensed design professional, whose signature and seal shall appear on all drawings, calculations, specifications, certifications, Shop Drawings, and other submittals prepared by such professional. Shop Drawings, and other submittals related to the Work, designed or

certified by such professional, if prepared by others, shall bear such professional's written approval when submitted to the Architect. The Owner and the Architect shall be entitled to rely upon the adequacy and accuracy of the services, certifications, and approvals performed or provided by such design professionals, provided the Owner and Architect have specified to the Contractor the performance and design criteria that such services must satisfy. Pursuant to this Section 3.12.10, the Architect will review and approve or take other appropriate action on submittals only for the limited purpose of checking for conformance with information given and the design concept expressed in the Contract Documents.

§ 3.12.10.2 If the Contract Documents require the Contractor's design professional to certify that the Work has been performed in accordance with the design criteria, the Contractor shall furnish such certifications to the Architect at the time and in the form specified by the Architect.

§ 3.13 Use of Site

The Contractor shall confine operations at the site to areas permitted by applicable laws, statutes, ordinances, codes, rules and regulations, lawful orders of public authorities, and the Contract Documents and shall not unreasonably encumber the site with materials or equipment.

§ 3.14 Cutting and Patching

§ 3.14.1 The Contractor shall be responsible for cutting, fitting, or patching required to complete the Work or to make its parts fit together properly. All areas requiring cutting, fitting, or patching shall be restored to the condition existing prior to the cutting, fitting, or patching, unless otherwise required by the Contract Documents.

§ 3.14.2 The Contractor shall not damage or endanger a portion of the Work or fully or partially completed construction of the Owner or Separate Contractors by cutting, patching, or otherwise altering such construction, or by excavation. The Contractor shall not cut or otherwise alter construction by the Owner or a Separate Contractor except with written consent of the Owner and of the Separate Contractor. Consent shall not be unreasonably withheld. The Contractor shall not unreasonably withhold, from the Owner or a Separate Contractor, its consent to cutting or otherwise altering the Work.

§ 3.15 Cleaning Up

§ 3.15.1 The Contractor shall keep the premises and surrounding area free from accumulation of waste materials and rubbish caused by operations under the Contract. At completion of the Work, the Contractor shall remove waste materials, rubbish, the Contractor's tools, construction equipment, machinery, and surplus materials from and about the Project.

§ 3.15.2 If the Contractor fails to clean up as provided in the Contract Documents, the Owner may do so and the Owner shall be entitled to reimbursement from the Contractor.

§ 3.16 Access to Work

The Contractor shall provide the Owner and Architect with access to the Work in preparation and progress wherever located.

§ 3.17 Royalties, Patents and Copyrights

The Contractor shall pay all royalties and license fees. The Contractor shall defend suits or claims for infringement of copyrights and patent rights and shall hold the Owner and Architect harmless from loss on account thereof, but shall not be responsible for defense or loss when a particular design, process, or product of a particular manufacturer or manufacturers is required by the Contract Documents, or where the copyright violations are contained in Drawings, Specifications, or other documents prepared by the Owner or Architect. However, if an infringement of a copyright or patent is discovered by, or made known to, the Contractor, the Contractor shall be responsible for the loss unless the information is promptly furnished to the Architect.

§ 3.18 Indemnification

§ 3.18.1 To the fullest extent permitted by law, the Contractor shall indemnify and hold harmless the Owner, Architect, Architect's consultants, and agents and employees of any of them from and against claims, damages, losses, and expenses, including but not limited to attorneys' fees, arising out of or resulting from performance of the Work, provided that such claim, damage, loss, or expense is attributable to bodily injury, sickness, disease or death, or to injury to or destruction of tangible property (other than the Work itself), but only to the extent caused by the negligent acts or omissions of the Contractor, a Subcontractor, anyone directly or indirectly employed by them, or anyone for

whose acts they may be liable, regardless of whether or not such claim, damage, loss, or expense is caused in part by a party indemnified hereunder. Such obligation shall not be construed to negate, abridge, or reduce other rights or obligations of indemnity that would otherwise exist as to a party or person described in this Section 3.18.

§ 3.18.2 In claims against any person or entity indemnified under this Section 3.18 by an employee of the Contractor, a Subcontractor, anyone directly or indirectly employed by them, or anyone for whose acts they may be liable, the indemnification obligation under Section 3.18.1 shall not be limited by a limitation on amount or type of damages, compensation, or benefits payable by or for the Contractor or a Subcontractor under workers' compensation acts, disability benefit acts, or other employee benefit acts.

ARTICLE 4 ARCHITECT

§ 4.1 General

§ 4.1.1 The Architect is the person or entity retained by the Owner pursuant to Section 2.3.2 and identified as such in the Agreement.

§ 4.1.2 Duties, responsibilities, and limitations of authority of the Architect as set forth in the Contract Documents shall not be restricted, modified, or extended without written consent of the Owner, Contractor, and Architect. Consent shall not be unreasonably withheld.

§ 4.2 Administration of the Contract

§ 4.2.1 The Architect will provide administration of the Contract as described in the Contract Documents and will be an Owner's representative during construction until the date the Architect issues the final Certificate for Payment. The Architect will have authority to act on behalf of the Owner only to the extent provided in the Contract Documents.

§ 4.2.2 The Architect will visit the site at intervals appropriate to the stage of construction, or as otherwise agreed with the Owner, to become generally familiar with the progress and quality of the portion of the Work completed, and to determine in general if the Work observed is being performed in a manner indicating that the Work, when fully completed, will be in accordance with the Contract Documents. However, the Architect will not be required to make exhaustive or continuous on-site inspections to check the quality or quantity of the Work. The Architect will not have control over, charge of, or responsibility for the construction means, methods, techniques, sequences or procedures, or for the safety precautions and programs in connection with the Work, since these are solely the Contractor's rights and responsibilities under the Contract Documents.

§ 4.2.3 On the basis of the site visits, the Architect will keep the Owner reasonably informed about the progress and quality of the portion of the Work completed, and promptly report to the Owner (1) known deviations from the Contract Documents, (2) known deviations from the most recent construction schedule submitted by the Contractor, and (3) defects and deficiencies observed in the Work. The Architect will not be responsible for the Contractor's failure to perform the Work in accordance with the requirements of the Contract Documents. The Architect will not have control over or charge of, and will not be responsible for acts or omissions of, the Contractor, Subcontractors, or their agents or employees, or any other persons or entities performing portions of the Work.

§ 4.2.4 Communications

The Owner and Contractor shall include the Architect in all communications that relate to or affect the Architect's services or professional responsibilities. The Owner shall promptly notify the Architect of the substance of any direct communications between the Owner and the Contractor otherwise relating to the Project. Communications by and with the Architect's consultants shall be through the Architect. Communications by and with Subcontractors and suppliers shall be through the Contractor. Communications by and with Separate Contractors shall be through the Owner. The Contract Documents may specify other communication protocols.

§ 4.2.5 Based on the Architect's evaluations of the Contractor's Applications for Payment, the Architect will review and certify the amounts due the Contractor and will issue Certificates for Payment in such amounts.

§ 4.2.6 The Architect has authority to reject Work that does not conform to the Contract Documents. Whenever the Architect considers it necessary or advisable, the Architect will have authority to require inspection or testing of the Work in accordance with Sections 13.4.2 and 13.4.3, whether or not the Work is fabricated, installed or completed. However, neither this authority of the Architect nor a decision made in good faith either to exercise or not to exercise such authority shall give rise to a duty or responsibility of the Architect to the Contractor, Subcontractors, suppliers, their agents or employees, or other persons or entities performing portions of the Work.

§ 4.2.7 The Architect will review and approve, or take other appropriate action upon, the Contractor's submittals such as Shop Drawings, Product Data, and Samples, but only for the limited purpose of checking for conformance with information given and the design concept expressed in the Contract Documents. The Architect's action will be taken in accordance with the submittal schedule approved by the Architect or, in the absence of an approved submittal schedule, with reasonable promptness while allowing sufficient time in the Architect's professional judgment to permit adequate review. Review of such submittals is not conducted for the purpose of determining the accuracy and completeness of other details such as dimensions and quantities, or for substantiating instructions for installation or performance of equipment or systems, all of which remain the responsibility of the Contractor as required by the Contract Documents. The Architect's review of the Contractor's submittals shall not relieve the Contractor of the obligations under Sections 3.3, 3.5, and 3.12. The Architect's review shall not constitute approval of safety precautions or of any construction means, methods, techniques, sequences, or procedures. The Architect's approval of a specific item shall not indicate approval of an assembly of which the item is a component.

§ 4.2.8 The Architect will prepare Change Orders and Construction Change Directives, and may order minor changes in the Work as provided in Section 7.4. The Architect will investigate and make determination and recommendations regarding concealed and unknown conditions as provided in Section 3.7.4.

§ 4.2.9 The Architect will conduct inspections to determine the date or dates of Substantial Completion and the date of final completion; issue Certificates of Substantial Completion pursuant to Section 9.8; receive and forward to the Owner, for the Owner's review and records, written warranties and related documents required by the Contract and assembled by the Contractor pursuant to Section 9.10; and issue a final Certificate for Payment pursuant to Section 9.10.

§ 4.2.10 If the Owner and Architect agree, the Architect will provide one or more Project representatives to assist in carrying out the Architect's responsibilities at the site. The Owner shall notify the Contractor of any change in the duties, responsibilities and limitations of authority of the Project representatives.

§ 4.2.11 The Architect will interpret and decide matters concerning performance under, and requirements of, the Contract Documents on written request of either the Owner or Contractor. The Architect's response to such requests will be made in writing within any time limits agreed upon or otherwise with reasonable promptness.

§ 4.2.12 Interpretations and decisions of the Architect will be consistent with the intent of, and reasonably inferable from, the Contract Documents and will be in writing or in the form of drawings. When making such interpretations and decisions, the Architect will endeavor to secure faithful performance by both Owner and Contractor, will not show partiality to either, and will not be liable for results of interpretations or decisions rendered in good faith.

§ 4.2.13 The Architect's decisions on matters relating to aesthetic effect will be final if consistent with the intent expressed in the Contract Documents.

§ 4.2.14 The Architect will review and respond to requests for information about the Contract Documents. The Architect's response to such requests will be made in writing within any time limits agreed upon or otherwise with reasonable promptness. If appropriate, the Architect will prepare and issue supplemental Drawings and Specifications in response to the requests for information.

ARTICLE 5 SUBCONTRACTORS

§ 5.1 Definitions

§ 5.1.1 A Subcontractor is a person or entity who has a direct contract with the Contractor to perform a portion of the Work at the site. The term "Subcontractor" is referred to throughout the Contract Documents as if singular in number and means a Subcontractor or an authorized representative of the Subcontractor. The term "Subcontractor" does not include a Separate Contractor or the subcontractors of a Separate Contractor.

§ 5.1.2 A Sub-subcontractor is a person or entity who has a direct or indirect contract with a Subcontractor to perform a portion of the Work at the site. The term "Sub-subcontractor" is referred to throughout the Contract Documents as if singular in number and means a Sub-subcontractor or an authorized representative of the Sub-subcontractor.

§ 5.2 Award of Subcontracts and Other Contracts for Portions of the Work

§ 5.2.1 Unless otherwise stated in the Contract Documents, the Contractor, as soon as practicable after award of the Contract, shall notify the Owner and Architect of the persons or entities proposed for each principal portion of the Work, including those who are to furnish materials or equipment fabricated to a special design. Within 14 days of receipt of the information, the Architect may notify the Contractor whether the Owner or the Architect (1) has reasonable objection to any such proposed person or entity or (2) requires additional time for review. Failure of the Architect to provide notice within the 14-day period shall constitute notice of no reasonable objection.

§ 5.2.2 The Contractor shall not contract with a proposed person or entity to whom the Owner or Architect has made reasonable and timely objection. The Contractor shall not be required to contract with anyone to whom the Contractor has made reasonable objection.

§ 5.2.3 If the Owner or Architect has reasonable objection to a person or entity proposed by the Contractor, the Contractor shall propose another to whom the Owner or Architect has no reasonable objection. If the proposed but rejected Subcontractor was reasonably capable of performing the Work, the Contract Sum and Contract Time shall be increased or decreased by the difference, if any, occasioned by such change, and an appropriate Change Order shall be issued before commencement of the substitute Subcontractor's Work. However, no increase in the Contract Sum or Contract Time shall be allowed for such change unless the Contractor has acted promptly and responsively in submitting names as required.

§ 5.2.4 The Contractor shall not substitute a Subcontractor, person, or entity for one previously selected if the Owner or Architect makes reasonable objection to such substitution.

§ 5.3 Subcontractual Relations

By appropriate written agreement, the Contractor shall require each Subcontractor, to the extent of the Work to be performed by the Subcontractor, to be bound to the Contractor by terms of the Contract Documents, and to assume toward the Contractor all the obligations and responsibilities, including the responsibility for safety of the Subcontractor's Work that the Contractor, by these Contract Documents, assumes toward the Owner and Architect. Each subcontract agreement shall preserve and protect the rights of the Owner and Architect under the Contract Documents with respect to the Work to be performed by the Subcontractor so that subcontracting thereof will not prejudice such rights, and shall allow to the Subcontractor, unless specifically provided otherwise in the subcontract agreement, the benefit of all rights, remedies, and redress against the Contractor that the Contractor, by the Contract Documents, has against the Owner. Where appropriate, the Contractor shall require each Subcontractor to enter into similar agreements with Sub-subcontractors. The Contractor shall make available to each proposed Subcontractor, prior to the execution of the subcontract agreement, copies of the Contract Documents to which the Subcontractor will be bound, and, upon written request of the Subcontractor, identify to the Subcontractor terms and conditions of the proposed subcontract agreement that may be at variance with the Contract Documents. Subcontractors will similarly make copies of applicable portions of such documents available to their respective proposed Sub-subcontractors.

§ 5.4 Contingent Assignment of Subcontracts

§ 5.4.1 Each subcontract agreement for a portion of the Work is assigned by the Contractor to the Owner, provided that

1. assignment is effective only after termination of the Contract by the Owner for cause pursuant to Section 14.2 and only for those subcontract agreements that the Owner accepts by notifying the Subcontractor and Contractor; and
2. assignment is subject to the prior rights of the surety, if any, obligated under bond relating to the Contract.

When the Owner accepts the assignment of a subcontract agreement, the Owner assumes the Contractor's rights and obligations under the subcontract.

§ 5.4.2 Upon such assignment, if the Work has been suspended for more than 30 days, the Subcontractor's compensation shall be equitably adjusted for increases in cost resulting from the suspension.

§ 5.4.3 Upon assignment to the Owner under this Section 5.4, the Owner may further assign the subcontract to a successor contractor or other entity. If the Owner assigns the subcontract to a successor contractor or other entity, the Owner shall nevertheless remain legally responsible for all of the successor contractor's obligations under the subcontract.

ARTICLE 6 CONSTRUCTION BY OWNER OR BY SEPARATE CONTRACTORS

§ 6.1 Owner's Right to Perform Construction and to Award Separate Contracts

§ 6.1.1 The term "Separate Contractor(s)" shall mean other contractors retained by the Owner under separate agreements. The Owner reserves the right to perform construction or operations related to the Project with the Owner's own forces, and with Separate Contractors retained under Conditions of the Contract substantially similar to those of this Contract, including those provisions of the Conditions of the Contract related to insurance and waiver of subrogation.

§ 6.1.2 When separate contracts are awarded for different portions of the Project or other construction or operations on the site, the term "Contractor" in the Contract Documents in each case shall mean the Contractor who executes each separate Owner-Contractor Agreement.

§ 6.1.3 The Owner shall provide for coordination of the activities of the Owner's own forces and of each Separate Contractor with the Work of the Contractor, who shall cooperate with them. The Contractor shall participate with any Separate Contractors and the Owner in reviewing their construction schedules. The Contractor shall make any revisions to its construction schedule deemed necessary after a joint review and mutual agreement. The construction schedules shall then constitute the schedules to be used by the Contractor, Separate Contractors, and the Owner until subsequently revised.

§ 6.1.4 Unless otherwise provided in the Contract Documents, when the Owner performs construction or operations related to the Project with the Owner's own forces or with Separate Contractors, the Owner or its Separate Contractors shall have the same obligations and rights that the Contractor has under the Conditions of the Contract, including, without excluding others, those stated in Article 3, this Article 6, and Articles 10, 11, and 12.

§ 6.2 Mutual Responsibility

§ 6.2.1 The Contractor shall afford the Owner and Separate Contractors reasonable opportunity for introduction and storage of their materials and equipment and performance of their activities, and shall connect and coordinate the Contractor's construction and operations with theirs as required by the Contract Documents.

§ 6.2.2 If part of the Contractor's Work depends for proper execution or results upon construction or operations by the Owner or a Separate Contractor, the Contractor shall, prior to proceeding with that portion of the Work, promptly notify the Architect of apparent discrepancies or defects in the construction or operations by the Owner or Separate Contractor that would render it unsuitable for proper execution and results of the Contractor's Work. Failure of the Contractor to notify the Architect of apparent discrepancies or defects prior to proceeding with the Work shall constitute an acknowledgment that the Owner's or Separate Contractor's completed or partially completed construction is fit and proper to receive the Contractor's Work. The Contractor shall not be responsible for discrepancies or defects in the construction or operations by the Owner or Separate Contractor that are not apparent.

§ 6.2.3 The Contractor shall reimburse the Owner for costs the Owner incurs that are payable to a Separate Contractor because of the Contractor's delays, improperly timed activities or defective construction. The Owner shall be responsible to the Contractor for costs the Contractor incurs because of a Separate Contractor's delays, improperly timed activities, damage to the Work or defective construction.

§ 6.2.4 The Contractor shall promptly remedy damage that the Contractor wrongfully causes to completed or partially completed construction or to property of the Owner or Separate Contractor as provided in Section 10.2.5.

§ 6.2.5 The Owner and each Separate Contractor shall have the same responsibilities for cutting and patching as are described for the Contractor in Section 3.14.

§ 6.3 Owner's Right to Clean Up

If a dispute arises among the Contractor, Separate Contractors, and the Owner as to the responsibility under their respective contracts for maintaining the premises and surrounding area free from waste materials and rubbish, the Owner may clean up and the Architect will allocate the cost among those responsible.

ARTICLE 7 CHANGES IN THE WORK

§ 7.1 General

§ 7.1.1 Changes in the Work may be accomplished after execution of the Contract, and without invalidating the Contract, by Change Order, Construction Change Directive or order for a minor change in the Work, subject to the limitations stated in this Article 7 and elsewhere in the Contract Documents.

§ 7.1.2 A Change Order shall be based upon agreement among the Owner, Contractor, and Architect. A Construction Change Directive requires agreement by the Owner and Architect and may or may not be agreed to by the Contractor. An order for a minor change in the Work may be issued by the Architect alone.

§ 7.1.3 Changes in the Work shall be performed under applicable provisions of the Contract Documents. The Contractor shall proceed promptly with changes in the Work, unless otherwise provided in the Change Order, Construction Change Directive, or order for a minor change in the Work.

§ 7.2 Change Orders

§ 7.2.1 A Change Order is a written instrument prepared by the Architect and signed by the Owner, Contractor, and Architect stating their agreement upon all of the following:

- .1 The change in the Work;
- .2 The amount of the adjustment, if any, in the Contract Sum; and
- .3 The extent of the adjustment, if any, in the Contract Time.

§ 7.3 Construction Change Directives

§ 7.3.1 A Construction Change Directive is a written order prepared by the Architect and signed by the Owner and Architect, directing a change in the Work prior to agreement on adjustment, if any, in the Contract Sum or Contract Time, or both. The Owner may by Construction Change Directive, without invalidating the Contract, order changes in the Work within the general scope of the Contract consisting of additions, deletions, or other revisions, the Contract Sum and Contract Time being adjusted accordingly.

§ 7.3.2 A Construction Change Directive shall be used in the absence of total agreement on the terms of a Change Order.

§ 7.3.3 If the Construction Change Directive provides for an adjustment to the Contract Sum, the adjustment shall be based on one of the following methods:

- .1 Mutual acceptance of a lump sum properly itemized and supported by sufficient substantiating data to permit evaluation;
- .2 Unit prices stated in the Contract Documents or subsequently agreed upon;
- .3 Cost to be determined in a manner agreed upon by the parties and a mutually acceptable fixed or percentage fee; or
- .4 As provided in Section 7.3.4.

§ 7.3.4 If the Contractor does not respond promptly or disagrees with the method for adjustment in the Contract Sum, the Architect shall determine the adjustment on the basis of reasonable expenditures and savings of those performing the Work attributable to the change, including, in case of an increase in the Contract Sum, an amount for overhead and profit as set forth in the Agreement, or if no such amount is set forth in the Agreement, a reasonable amount. In such case, and also under Section 7.3.3.3, the Contractor shall keep and present, in such form as the Architect may prescribe, an itemized accounting together with appropriate supporting data. Unless otherwise provided in the Contract Documents, costs for the purposes of this Section 7.3.4 shall be limited to the following:

- .1 Costs of labor, including applicable payroll taxes, fringe benefits required by agreement or custom, workers' compensation insurance, and other employee costs approved by the Architect;
- .2 Costs of materials, supplies, and equipment, including cost of transportation, whether incorporated or consumed;
- .3 Rental costs of machinery and equipment, exclusive of hand tools, whether rented from the Contractor or others;
- .4 Costs of premiums for all bonds and insurance, permit fees, and sales, use, or similar taxes, directly related to the change; and
- .5 Costs of supervision and field office personnel directly attributable to the change.

§ 7.3.5 If the Contractor disagrees with the adjustment in the Contract Time, the Contractor may make a Claim in accordance with applicable provisions of Article 15.

§ 7.3.6 Upon receipt of a Construction Change Directive, the Contractor shall promptly proceed with the change in the Work involved and advise the Architect of the Contractor's agreement or disagreement with the method, if any, provided in the Construction Change Directive for determining the proposed adjustment in the Contract Sum or Contract Time.

§ 7.3.7 A Construction Change Directive signed by the Contractor indicates the Contractor's agreement therewith, including adjustment in Contract Sum and Contract Time or the method for determining them. Such agreement shall be effective immediately and shall be recorded as a Change Order.

§ 7.3.8 The amount of credit to be allowed by the Contractor to the Owner for a deletion or change that results in a net decrease in the Contract Sum shall be actual net cost as confirmed by the Architect. When both additions and credits covering related Work or substitutions are involved in a change, the allowance for overhead and profit shall be figured on the basis of net increase, if any, with respect to that change.

§ 7.3.9 Pending final determination of the total cost of a Construction Change Directive to the Owner, the Contractor may request payment for Work completed under the Construction Change Directive in Applications for Payment. The Architect will make an interim determination for purposes of monthly certification, for payment for those costs and certify for payment the amount that the Architect determines, in the Architect's professional judgment, to be reasonably justified. The Architect's interim determination of cost shall adjust the Contract Sum on the same basis as a Change Order, subject to the right of either party to disagree and assert a Claim in accordance with Article 15.

§ 7.3.10 When the Owner and Contractor agree with a determination made by the Architect concerning the adjustments in the Contract Sum and Contract Time, or otherwise reach agreement upon the adjustments, such agreement shall be effective immediately and the Architect will prepare a Change Order. Change Orders may be issued for all or any part of a Construction Change Directive.

§ 7.4 Minor Changes in the Work

The Architect may order minor changes in the Work that are consistent with the intent of the Contract Documents and do not involve an adjustment in the Contract Sum or an extension of the Contract Time. The Architect's order for minor changes shall be in writing. If the Contractor believes that the proposed minor change in the Work will affect the Contract Sum or Contract Time, the Contractor shall notify the Architect and shall not proceed to implement the change in the Work. If the Contractor performs the Work set forth in the Architect's order for a minor change without prior notice to the Architect that such change will affect the Contract Sum or Contract Time, the Contractor waives any adjustment to the Contract Sum or extension of the Contract Time.

ARTICLE 8 TIME

§ 8.1 Definitions

§ 8.1.1 Unless otherwise provided, Contract Time is the period of time, including authorized adjustments, allotted in the Contract Documents for Substantial Completion of the Work.

§ 8.1.2 The date of commencement of the Work is the date established in the Agreement.

§ 8.1.3 The date of Substantial Completion is the date certified by the Architect in accordance with Section 9.8.

§ 8.1.4 The term "day" as used in the Contract Documents shall mean calendar day unless otherwise specifically defined.

§ 8.2 Progress and Completion

§ 8.2.1 Time limits stated in the Contract Documents are of the essence of the Contract. By executing the Agreement, the Contractor confirms that the Contract Time is a reasonable period for performing the Work.

§ 8.2.2 The Contractor shall not knowingly, except by agreement or instruction of the Owner in writing, commence the Work prior to the effective date of insurance required to be furnished by the Contractor and Owner.

§ 8.2.3 The Contractor shall proceed expeditiously with adequate forces and shall achieve Substantial Completion within the Contract Time.

§ 8.3 Delays and Extensions of Time

§ 8.3.1 If the Contractor is delayed at any time in the commencement or progress of the Work by (1) an act or neglect of the Owner or Architect, of an employee of either, or of a Separate Contractor; (2) by changes ordered in the Work; (3) by labor disputes, fire, unusual delay in deliveries, unavoidable casualties, adverse weather conditions documented in accordance with Section 15.1.6.2, or other causes beyond the Contractor's control; (4) by delay authorized by the Owner pending mediation and binding dispute resolution; or (5) by other causes that the Contractor asserts, and the Architect determines, justify delay, then the Contract Time shall be extended for such reasonable time as the Architect may determine.

§ 8.3.2 Claims relating to time shall be made in accordance with applicable provisions of Article 15.

§ 8.3.3 This Section 8.3 does not preclude recovery of damages for delay by either party under other provisions of the Contract Documents.

ARTICLE 9 PAYMENTS AND COMPLETION

§ 9.1 Contract Sum

§ 9.1.1 The Contract Sum is stated in the Agreement and, including authorized adjustments, is the total amount payable by the Owner to the Contractor for performance of the Work under the Contract Documents.

§ 9.1.2 If unit prices are stated in the Contract Documents or subsequently agreed upon, and if quantities originally contemplated are materially changed so that application of such unit prices to the actual quantities causes substantial inequity to the Owner or Contractor, the applicable unit prices shall be equitably adjusted.

§ 9.2 Schedule of Values

Where the Contract is based on a stipulated sum or Guaranteed Maximum Price, the Contractor shall submit a schedule of values to the Architect before the first Application for Payment, allocating the entire Contract Sum to the various portions of the Work. The schedule of values shall be prepared in the form, and supported by the data to substantiate its accuracy, required by the Architect. This schedule, unless objected to by the Architect, shall be used as a basis for reviewing the Contractor's Applications for Payment. Any changes to the schedule of values shall be submitted to the Architect and supported by such data to substantiate its accuracy as the Architect may require, and unless objected to by the Architect, shall be used as a basis for reviewing the Contractor's subsequent Applications for Payment.

§ 9.3 Applications for Payment

§ 9.3.1 At least ten days before the date established for each progress payment, the Contractor shall submit to the Architect an itemized Application for Payment prepared in accordance with the schedule of values, if required under Section 9.2, for completed portions of the Work. The application shall be notarized, if required, and supported by all data substantiating the Contractor's right to payment that the Owner or Architect require, such as copies of requisitions and releases and waivers of liens from Subcontractors and suppliers, and shall reflect retainage if provided for in the Contract Documents.

§ 9.3.1.1 As provided in Section 7.3.9, such applications may include requests for payment on account of changes in the Work that have been properly authorized by Construction Change Directives, or by interim determinations of the Architect, but not yet included in Change Orders.

§ 9.3.1.2 Applications for Payment shall not include requests for payment for portions of the Work for which the Contractor does not intend to pay a Subcontractor or supplier, unless such Work has been performed by others whom the Contractor intends to pay.

§ 9.3.2 Unless otherwise provided in the Contract Documents, payments shall be made on account of materials and equipment delivered and suitably stored at the site for subsequent incorporation in the Work. If approved in advance by the Owner, payment may similarly be made for materials and equipment suitably stored off the site at a location agreed upon in writing. Payment for materials and equipment stored on or off the site shall be conditioned upon compliance by the Contractor with procedures satisfactory to the Owner to establish the Owner's title to such materials

and equipment or otherwise protect the Owner's interest, and shall include the costs of applicable insurance, storage, and transportation to the site, for such materials and equipment stored off the site.

§ 9.3.3 The Contractor warrants that title to all Work covered by an Application for Payment will pass to the Owner no later than the time of payment. The Contractor further warrants that upon submittal of an Application for Payment all Work for which Certificates for Payment have been previously issued and payments received from the Owner shall, to the best of the Contractor's knowledge, information, and belief, be free and clear of liens, claims, security interests, or encumbrances, in favor of the Contractor, Subcontractors, suppliers, or other persons or entities that provided labor, materials, and equipment relating to the Work.

§ 9.4 Certificates for Payment

§ 9.4.1 The Architect will, within seven days after receipt of the Contractor's Application for Payment, either (1) issue to the Owner a Certificate for Payment in the full amount of the Application for Payment, with a copy to the Contractor; or (2) issue to the Owner a Certificate for Payment for such amount as the Architect determines is properly due, and notify the Contractor and Owner of the Architect's reasons for withholding certification in part as provided in Section 9.5.1; or (3) withhold certification of the entire Application for Payment, and notify the Contractor and Owner of the Architect's reason for withholding certification in whole as provided in Section 9.5.1.

§ 9.4.2 The issuance of a Certificate for Payment will constitute a representation by the Architect to the Owner, based on the Architect's evaluation of the Work and the data in the Application for Payment, that, to the best of the Architect's knowledge, information, and belief, the Work has progressed to the point indicated, the quality of the Work is in accordance with the Contract Documents, and that the Contractor is entitled to payment in the amount certified. The foregoing representations are subject to an evaluation of the Work for conformance with the Contract Documents upon Substantial Completion, to results of subsequent tests and inspections, to correction of minor deviations from the Contract Documents prior to completion, and to specific qualifications expressed by the Architect. However, the issuance of a Certificate for Payment will not be a representation that the Architect has (1) made exhaustive or continuous on-site inspections to check the quality or quantity of the Work; (2) reviewed construction means, methods, techniques, sequences, or procedures; (3) reviewed copies of requisitions received from Subcontractors and suppliers and other data requested by the Owner to substantiate the Contractor's right to payment; or (4) made examination to ascertain how or for what purpose the Contractor has used money previously paid on account of the Contract Sum.

§ 9.5 Decisions to Withhold Certification

§ 9.5.1 The Architect may withhold a Certificate for Payment in whole or in part, to the extent reasonably necessary to protect the Owner, if in the Architect's opinion the representations to the Owner required by Section 9.4.2 cannot be made. If the Architect is unable to certify payment in the amount of the Application, the Architect will notify the Contractor and Owner as provided in Section 9.4.1. If the Contractor and Architect cannot agree on a revised amount, the Architect will promptly issue a Certificate for Payment for the amount for which the Architect is able to make such representations to the Owner. The Architect may also withhold a Certificate for Payment or, because of subsequently discovered evidence, may nullify the whole or a part of a Certificate for Payment previously issued, to such extent as may be necessary in the Architect's opinion to protect the Owner from loss for which the Contractor is responsible, including loss resulting from acts and omissions described in Section 3.3.2, because of

1. defective Work not remedied;
2. third party claims filed or reasonable evidence indicating probable filing of such claims, unless security acceptable to the Owner is provided by the Contractor;
3. failure of the Contractor to make payments properly to Subcontractors or suppliers for labor, materials or equipment;
4. reasonable evidence that the Work cannot be completed for the unpaid balance of the Contract Sum;
5. damage to the Owner or a Separate Contractor;
6. reasonable evidence that the Work will not be completed within the Contract Time, and that the unpaid balance would not be adequate to cover actual or liquidated damages for the anticipated delay; or
7. repeated failure to carry out the Work in accordance with the Contract Documents.

§ 9.5.2 When either party disputes the Architect's decision regarding a Certificate for Payment under Section 9.5.1, in whole or in part, that party may submit a Claim in accordance with Article 15.

§ 9.5.3 When the reasons for withholding certification are removed, certification will be made for amounts previously withheld.

§ 9.5.4 If the Architect withholds certification for payment under Section 9.5.1.3, the Owner may, at its sole option, issue joint checks to the Contractor and to any Subcontractor or supplier to whom the Contractor failed to make payment for Work properly performed or material or equipment suitably delivered. If the Owner makes payments by joint check, the Owner shall notify the Architect and the Contractor shall reflect such payment on its next Application for Payment.

§ 9.6 Progress Payments

§ 9.6.1 After the Architect has issued a Certificate for Payment, the Owner shall make payment in the manner and within the time provided in the Contract Documents, and shall so notify the Architect.

§ 9.6.2 The Contractor shall pay each Subcontractor, no later than seven days after receipt of payment from the Owner, the amount to which the Subcontractor is entitled, reflecting percentages actually retained from payments to the Contractor on account of the Subcontractor's portion of the Work. The Contractor shall, by appropriate agreement with each Subcontractor, require each Subcontractor to make payments to Sub-subcontractors in a similar manner.

§ 9.6.3 The Architect will, on request, furnish to a Subcontractor, if practicable, information regarding percentages of completion or amounts applied for by the Contractor and action taken thereon by the Architect and Owner on account of portions of the Work done by such Subcontractor.

§ 9.6.4 The Owner has the right to request written evidence from the Contractor that the Contractor has properly paid Subcontractors and suppliers amounts paid by the Owner to the Contractor for subcontracted Work. If the Contractor fails to furnish such evidence within seven days, the Owner shall have the right to contact Subcontractors and suppliers to ascertain whether they have been properly paid. Neither the Owner nor Architect shall have an obligation to pay, or to see to the payment of money to, a Subcontractor or supplier, except as may otherwise be required by law.

§ 9.6.5 The Contractor's payments to suppliers shall be treated in a manner similar to that provided in Sections 9.6.2, 9.6.3 and 9.6.4.

§ 9.6.6 A Certificate for Payment, a progress payment or partial or entire use or occupancy of the Project by the Owner shall not constitute acceptance of Work not in accordance with the Contract Documents.

§ 9.6.7 Unless the Contractor provides the Owner with a payment bond in the full penal sum of the Contract Sum, payments received by the Contractor for Work properly performed by Subcontractors or provided by suppliers shall be held by the Contractor for those Subcontractors or suppliers who performed Work or furnished materials, or both, under contract with the Contractor, for which payment was made by the Owner. Nothing contained herein shall require money to be placed in a separate account and not commingled with money of the Contractor, create any fiduciary liability or tort liability on the part of the Contractor for breach of trust, or entitle any person or entity to an award of punitive damages against the Contractor for breach of the requirements of this provision.

§ 9.6.8 Provided the Owner has fulfilled its payment obligations under the Contract Documents, the Contractor shall defend and indemnify the Owner from all loss, liability, damage or expense, including reasonable attorney's fees and litigation expenses, arising out of any lien claim or other claim for payment by any Subcontractor or supplier of any tier. Upon receipt of notice of a lien claim or other claim for payment, the Owner shall notify the Contractor. If approved by the applicable court, when required, the Contractor may substitute a surety bond for the property against which the lien or other claim for payment has been asserted.

§ 9.7 Failure of Payment

If the Architect does not issue a Certificate for Payment, through no fault of the Contractor, within seven days after receipt of the Contractor's Application for Payment, or if the Owner does not pay the Contractor within seven days after the date established in the Contract Documents, the amount certified by the Architect or awarded by binding dispute resolution, then the Contractor may, upon seven additional days' notice to the Owner and Architect, stop the Work until payment of the amount owing has been received. The Contract Time shall be extended appropriately and the Contract Sum shall be increased by the amount of the Contractor's reasonable costs of shutdown, delay and start-up, plus interest as provided for in the Contract Documents.

§ 9.8 Substantial Completion

§ 9.8.1 Substantial Completion is the stage in the progress of the Work when the Work or designated portion thereof is sufficiently complete in accordance with the Contract Documents so that the Owner can occupy or utilize the Work for its intended use.

§ 9.8.2 When the Contractor considers that the Work, or a portion thereof which the Owner agrees to accept separately, is substantially complete, the Contractor shall prepare and submit to the Architect a comprehensive list of items to be completed or corrected prior to final payment. Failure to include an item on such list does not alter the responsibility of the Contractor to complete all Work in accordance with the Contract Documents.

§ 9.8.3 Upon receipt of the Contractor's list, the Architect will make an inspection to determine whether the Work or designated portion thereof is substantially complete. If the Architect's inspection discloses any item, whether or not included on the Contractor's list, which is not sufficiently complete in accordance with the Contract Documents so that the Owner can occupy or utilize the Work or designated portion thereof for its intended use, the Contractor shall, before issuance of the Certificate of Substantial Completion, complete or correct such item upon notification by the Architect. In such case, the Contractor shall then submit a request for another inspection by the Architect to determine Substantial Completion.

§ 9.8.4 When the Work or designated portion thereof is substantially complete, the Architect will prepare a Certificate of Substantial Completion that shall establish the date of Substantial Completion, establish responsibilities of the Owner and Contractor for security, maintenance, heat, utilities, damage to the Work and insurance; and fix the time within which the Contractor shall finish all items on the list accompanying the Certificate. Warranties required by the Contract Documents shall commence on the date of Substantial Completion of the Work or designated portion thereof unless otherwise provided in the Certificate of Substantial Completion.

§ 9.8.5 The Certificate of Substantial Completion shall be submitted to the Owner and Contractor for their written acceptance of responsibilities assigned to them in the Certificate. Upon such acceptance, and consent of surety if any, the Owner shall make payment of retainage applying to the work or designated portion thereof. Such payment shall be adjusted for Work that is incomplete or not in accordance with the requirements of the Contract Documents.

§ 9.9 Partial Occupancy or Use

§ 9.9.1 The Owner may occupy or use any completed or partially completed portion of the Work at any stage when such portion is designated by separate agreement with the Contractor, provided such occupancy or use is consented to by the insurer and authorized by public authorities having jurisdiction over the Project. Such partial occupancy or use may commence whether or not the portion is substantially complete, provided the Owner and Contractor have accepted in writing the responsibilities assigned to each of them for payments, retainage, if any, security, maintenance, heat, utilities, damage to the Work and insurance, and have agreed in writing concerning the period for correction of the Work and commencement of warranties required by the Contract Documents. When the Contractor considers a portion substantially complete, the Contractor shall prepare and submit a list to the Architect as provided under Section 9.8.2. Consent of the Contractor to partial occupancy or use shall not be unreasonably withheld. The stage of the progress of the Work shall be determined by written agreement between the Owner and Contractor or, if no agreement is reached, by decision of the Architect.

§ 9.9.2 Immediately prior to such partial occupancy or use, the Owner, Contractor, and Architect shall jointly inspect the area to be occupied or portion of the Work to be used in order to determine and record the condition of the Work.

§ 9.9.3 Unless otherwise agreed upon, partial occupancy or use of a portion or portions of the Work shall not constitute acceptance of Work not complying with the requirements of the Contract Documents.

§ 9.10 Final Completion and Final Payment

§ 9.10.1 Upon receipt of the Contractor's notice that the Work is ready for final inspection and acceptance and upon receipt of a final Application for Payment, the Architect will promptly make such inspection. When the Architect finds the Work acceptable under the Contract Documents and the Contract fully performed, the Architect will promptly issue a final Certificate for Payment stating that to the best of the Architect's knowledge, information and belief, and on the basis of the Architect's on-site visits and inspections, the Work has been completed in accordance with the Contract Documents and that the entire balance found to be due the Contractor and noted in the final Certificate is due and payable. The Architect's final Certificate for Payment will constitute a further representation that conditions listed in Section 9.10.2 as precedent to the Contractor's being entitled to final payment have been fulfilled.

§ 9.10.2 Neither final payment nor any remaining retained percentage shall become due until the Contractor submits to the Architect (1) an affidavit that payrolls, bills for materials and equipment, and other indebtedness connected with the Work for which the Owner or the Owner's property might be responsible or encumbered (less amounts withheld by Owner) have been paid or otherwise satisfied, (2) a certificate evidencing that insurance required by the Contract Documents to remain in force after final payment is currently in effect, (3) a written statement that the Contractor knows of no reason that the insurance will not be renewable to cover the period required by the Contract Documents, (4) consent of surety, if any, to final payment, (5) documentation of any special warranties, such as manufacturers' warranties or specific Subcontractor warranties, and (6) if required by the Owner, other data establishing payment or satisfaction of obligations, such as receipts and releases and waivers of liens, claims, security interests, or encumbrances arising out of the Contract, to the extent and in such form as may be designated by the Owner. If a Subcontractor refuses to furnish a release or waiver required by the Owner, the Contractor may furnish a bond satisfactory to the Owner to indemnify the Owner against such lien, claim, security interest, or encumbrance. If a lien, claim, security interest, or encumbrance remains unsatisfied after payments are made, the Contractor shall refund to the Owner all money that the Owner may be compelled to pay in discharging the lien, claim, security interest, or encumbrance, including all costs and reasonable attorneys' fees.

§ 9.10.3 If, after Substantial Completion of the Work, final completion thereof is materially delayed through no fault of the Contractor or by issuance of Change Orders affecting final completion, and the Architect so confirms, the Owner shall, upon application by the Contractor and certification by the Architect and without terminating the Contract, make payment of the balance due for that portion of the Work fully completed, corrected, and accepted. If the remaining balance for Work not fully completed or corrected is less than retainer stipulated in the Contract Documents, and if bonds have been furnished, the written consent of the surety to payment of the balance due for that portion of the Work fully completed and accepted shall be submitted by the Contractor to the Architect prior to certification of such payment. Such payment shall be made under terms and conditions governing final payment, except that it shall not constitute a waiver of Claims.

§ 9.10.4 The making of final payment shall constitute a waiver of Claims by the Owner except those arising from

- .1 liens, Claims, security interests, or encumbrances arising out of the Contract and unsettled;
- .2 failure of the Work to comply with the requirements of the Contract Documents;
- .3 terms of special warranties required by the Contract Documents; or
- .4 audits performed by the Owner, if permitted by the Contract Documents, after final payment.

§ 9.10.5 Acceptance of final payment by the Contractor, a Subcontractor, or a supplier, shall constitute a waiver of claims by that payee except those previously made in writing and identified by that payee as unsettled at the time of final Application for Payment.

ARTICLE 10 PROTECTION OF PERSONS AND PROPERTY

§ 10.1 Safety Precautions and Programs

The Contractor shall be responsible for initiating, maintaining, and supervising all safety precautions and programs in connection with the performance of the Contract.

§ 10.2 Safety of Persons and Property

§ 10.2.1 The Contractor shall take reasonable precautions for safety of, and shall provide reasonable protection to prevent damage, injury, or loss to

- .1 employees on the Work and other persons who may be affected thereby;
- .2 the Work and materials and equipment to be incorporated therein, whether in storage on or off the site, under care, custody, or control of the Contractor, a Subcontractor, or a Sub-subcontractor; and
- .3 other property at the site or adjacent thereto, such as trees, shrubs, lawns, walks, pavements, roadways, structures, and utilities not designated for removal, relocation, or replacement in the course of construction.

§ 10.2.2 The Contractor shall comply with, and give notices required by applicable laws, statutes, ordinances, codes, rules and regulations, and lawful orders of public authorities, bearing on safety of persons or property or their protection from damage, injury, or loss.

§ 10.2.3 The Contractor shall implement, erect, and maintain, as required by existing conditions and performance of the Contract, reasonable safeguards for safety and protection, including posting danger signs and other warnings

against hazards; promulgating safety regulations; and notifying the owners and users of adjacent sites and utilities of the safeguards.

§ 10.2.4 When use or storage of explosives or other hazardous materials or equipment, or unusual methods are necessary for execution of the Work, the Contractor shall exercise utmost care and carry on such activities under supervision of properly qualified personnel.

§ 10.2.5 The Contractor shall promptly remedy damage and loss (other than damage or loss insured under property insurance required by the Contract Documents) to property referred to in Sections 10.2.1.2 and 10.2.1.3 caused in whole or in part by the Contractor, a Subcontractor, a Sub-subcontractor, or anyone directly or indirectly employed by any of them, or by anyone for whose acts they may be liable and for which the Contractor is responsible under Sections 10.2.1.2 and 10.2.1.3. The Contractor may make a Claim for the cost to remedy the damage or loss to the extent such damage or loss is attributable to acts or omissions of the Owner or Architect or anyone directly or indirectly employed by either of them, or by anyone for whose acts either of them may be liable, and not attributable to the fault or negligence of the Contractor. The foregoing obligations of the Contractor are in addition to the Contractor's obligations under Section 3.18.

§ 10.2.6 The Contractor shall designate a responsible member of the Contractor's organization at the site whose duty shall be the prevention of accidents. This person shall be the Contractor's superintendent unless otherwise designated by the Contractor in writing to the Owner and Architect.

§ 10.2.7 The Contractor shall not permit any part of the construction or site to be loaded so as to cause damage or create an unsafe condition.

§ 10.2.8 Injury or Damage to Person or Property

If either party suffers injury or damage to person or property because of an act or omission of the other party, or of others for whose acts such party is legally responsible, notice of the injury or damage, whether or not insured, shall be given to the other party within a reasonable time not exceeding 21 days after discovery. The notice shall provide sufficient detail to enable the other party to investigate the matter.

§ 10.3 Hazardous Materials and Substances

§ 10.3.1 The Contractor is responsible for compliance with any requirements included in the Contract Documents regarding hazardous materials or substances. If the Contractor encounters a hazardous material or substance not addressed in the Contract Documents and if reasonable precautions will be inadequate to prevent foreseeable bodily injury or death to persons resulting from a material or substance, including but not limited to asbestos or polychlorinated biphenyl (PCB), encountered on the site by the Contractor, the Contractor shall, upon recognizing the condition, immediately stop Work in the affected area and notify the Owner and Architect of the condition.

§ 10.3.2 Upon receipt of the Contractor's notice, the Owner shall obtain the services of a licensed laboratory to verify the presence or absence of the material or substance reported by the Contractor and, in the event such material or substance is found to be present, to cause it to be rendered harmless. Unless otherwise required by the Contract Documents, the Owner shall furnish in writing to the Contractor and Architect the names and qualifications of persons or entities who are to perform tests verifying the presence or absence of the material or substance or who are to perform the task of removal or safe containment of the material or substance. The Contractor and the Architect will promptly reply to the Owner in writing stating whether or not either has reasonable objection to the persons or entities proposed by the Owner. If either the Contractor or Architect has an objection to a person or entity proposed by the Owner, the Owner shall propose another to whom the Contractor and the Architect have no reasonable objection. When the material or substance has been rendered harmless, Work in the affected area shall resume upon written agreement of the Owner and Contractor. By Change Order, the Contract Time shall be extended appropriately and the Contract Sum shall be increased by the amount of the Contractor's reasonable additional costs of shutdown, delay, and start-up.

§ 10.3.3 To the fullest extent permitted by law, the Owner shall indemnify and hold harmless the Contractor, Subcontractors, Architect, Architect's consultants, and agents and employees of any of them from and against claims, damages, losses, and expenses, including but not limited to attorneys' fees, arising out of or resulting from performance of the Work in the affected area if in fact the material or substance presents the risk of bodily injury or death as described in Section 10.3.1 and has not been rendered harmless, provided that such claim, damage, loss, or expense is attributable to bodily injury, sickness, disease or death, or to injury to or destruction of tangible property

(other than the Work itself), except to the extent that such damage, loss, or expense is due to the fault or negligence of the party seeking indemnity.

§ 10.3.4 The Owner shall not be responsible under this Section 10.3 for hazardous materials or substances the Contractor brings to the site unless such materials or substances are required by the Contract Documents. The Owner shall be responsible for hazardous materials or substances required by the Contract Documents, except to the extent of the Contractor's fault or negligence in the use and handling of such materials or substances.

§ 10.3.5 The Contractor shall reimburse the Owner for the cost and expense the Owner incurs (1) for remediation of hazardous materials or substances the Contractor brings to the site and negligently handles, or (2) where the Contractor fails to perform its obligations under Section 10.3.1, except to the extent that the cost and expense are due to the Owner's fault or negligence.

§ 10.3.6 If, without negligence on the part of the Contractor, the Contractor is held liable by a government agency for the cost of remediation of a hazardous material or substance solely by reason of performing Work as required by the Contract Documents, the Owner shall reimburse the Contractor for all cost and expense thereby incurred.

§ 10.4 Emergencies

In an emergency affecting safety of persons or property, the Contractor shall act, at the Contractor's discretion, to prevent threatened damage, injury, or loss. Additional compensation or extension of time claimed by the Contractor on account of an emergency shall be determined as provided in Article 15 and Article 7.

ARTICLE 11 INSURANCE AND BONDS

§ 11.1 Contractor's Insurance and Bonds

§ 11.1.1 The Contractor shall purchase and maintain insurance of the types and limits of liability, containing the endorsements, and subject to the terms and conditions, as described in the Agreement or elsewhere in the Contract Documents. The Contractor shall purchase and maintain the required insurance from an insurance company or insurance companies lawfully authorized to issue insurance in the jurisdiction where the Project is located. The Owner, Architect, and Architect's consultants shall be named as additional insureds under the Contractor's commercial general liability policy or as otherwise described in the Contract Documents.

§ 11.1.2 The Contractor shall provide surety bonds of the types, for such penal sums, and subject to such terms and conditions as required by the Contract Documents. The Contractor shall purchase and maintain the required bonds from a company or companies lawfully authorized to issue surety bonds in the jurisdiction where the Project is located.

§ 11.1.3 Upon the request of any person or entity appearing to be a potential beneficiary of bonds covering payment of obligations arising under the Contract, the Contractor shall promptly furnish a copy of the bonds or shall authorize a copy to be furnished.

§ 11.1.4 Notice of Cancellation or Expiration of Contractor's Required Insurance. Within three (3) business days of the date the Contractor becomes aware of an impending or actual cancellation or expiration of any insurance required by the Contract Documents, the Contractor shall provide notice to the Owner of such impending or actual cancellation or expiration. Upon receipt of notice from the Contractor, the Owner shall, unless the lapse in coverage arises from an act or omission of the Owner, have the right to stop the Work until the lapse in coverage has been cured by the procurement of replacement coverage by the Contractor. The furnishing of notice by the Contractor shall not relieve the Contractor of any contractual obligation to provide any required coverage.

§ 11.2 Owner's Insurance

§ 11.2.1 The Owner shall purchase and maintain insurance of the types and limits of liability, containing the endorsements, and subject to the terms and conditions, as described in the Agreement or elsewhere in the Contract Documents. The Owner shall purchase and maintain the required insurance from an insurance company or insurance companies lawfully authorized to issue insurance in the jurisdiction where the Project is located.

§ 11.2.2 Failure to Purchase Required Property Insurance. If the Owner fails to purchase and maintain the required property insurance, with all of the coverages and in the amounts described in the Agreement or elsewhere in the Contract Documents, the Owner shall inform the Contractor in writing prior to commencement of the Work. Upon receipt of notice from the Owner, the Contractor may delay commencement of the Work and may obtain insurance that will protect the interests of the Contractor, Subcontractors, and Sub-Subcontractors in the Work. When the failure to

provide coverage has been cured or resolved, the Contract Sum and Contract Time shall be equitably adjusted. In the event the Owner fails to procure coverage, the Owner waives all rights against the Contractor, Subcontractors, and Sub-subcontractors to the extent the loss to the Owner would have been covered by the insurance to have been procured by the Owner. The cost of the insurance shall be charged to the Owner by a Change Order. If the Owner does not provide written notice, and the Contractor is damaged by the failure or neglect of the Owner to purchase or maintain the required insurance, the Owner shall reimburse the Contractor for all reasonable costs and damages attributable thereto.

§ 11.2.3 Notice of Cancellation or Expiration of Owner's Required Property Insurance. Within three (3) business days of the date the Owner becomes aware of an impending or actual cancellation or expiration of any property insurance required by the Contract Documents, the Owner shall provide notice to the Contractor of such impending or actual cancellation or expiration. Unless the lapse in coverage arises from an act or omission of the Contractor: (1) the Contractor, upon receipt of notice from the Owner, shall have the right to stop the Work until the lapse in coverage has been cured by the procurement of replacement coverage by either the Owner or the Contractor; (2) the Contract Time and Contract Sum shall be equitably adjusted; and (3) the Owner waives all rights against the Contractor, Subcontractors, and Sub-subcontractors to the extent any loss to the Owner would have been covered by the insurance had it not expired or been cancelled. If the Contractor purchases replacement coverage, the cost of the insurance shall be charged to the Owner by an appropriate Change Order. The furnishing of notice by the Owner shall not relieve the Owner of any contractual obligation to provide required insurance.

§ 11.3 Waivers of Subrogation

§ 11.3.1 The Owner and Contractor waive all rights against (1) each other and any of their subcontractors, sub-subcontractors, agents, and employees, each of the other; (2) the Architect and Architect's consultants; and (3) Separate Contractors, if any, and any of their subcontractors, sub-subcontractors, agents, and employees, for damages caused by fire, or other causes of loss, to the extent those losses are covered by property insurance required by the Agreement or other property insurance applicable to the Project, except such rights as they have to proceeds of such insurance. The Owner or Contractor, as appropriate, shall require similar written waivers in favor of the individuals and entities identified above from the Architect, Architect's consultants, Separate Contractors, subcontractors, and sub-subcontractors. The policies of insurance purchased and maintained by each person or entity agreeing to waive claims pursuant to this section 11.3.1 shall not prohibit this waiver of subrogation. This waiver of subrogation shall be effective as to a person or entity (1) even though that person or entity would otherwise have a duty of indemnification, contractual or otherwise, (2) even though that person or entity did not pay the insurance premium directly or indirectly, or (3) whether or not the person or entity had an insurable interest in the damaged property.

§ 11.3.2 If during the Project construction period the Owner insures properties, real or personal or both, at or adjacent to the site by property insurance under policies separate from those insuring the Project, or if after final payment property insurance is to be provided on the completed Project through a policy or policies other than those insuring the Project during the construction period, to the extent permissible by such policies, the Owner waives all rights in accordance with the terms of Section 11.3.1 for damages caused by fire or other causes of loss covered by this separate property insurance.

§ 11.4 Loss of Use, Business Interruption, and Delay in Completion Insurance

The Owner, at the Owner's option, may purchase and maintain insurance that will protect the Owner against loss of use of the Owner's property, or the inability to conduct normal operations, due to fire or other causes of loss. The Owner waives all rights of action against the Contractor and Architect for loss of use of the Owner's property, due to fire or other hazards however caused.

§ 11.5 Adjustment and Settlement of Insured Loss

§ 11.5.1 A loss insured under the property insurance required by the Agreement shall be adjusted by the Owner as fiduciary and made payable to the Owner as fiduciary for the insureds, as their interests may appear, subject to requirements of any applicable mortgagee clause and of Section 11.5.2. The Owner shall pay the Architect and Contractor their just shares of insurance proceeds received by the Owner, and by appropriate agreements the Architect and Contractor shall make payments to their consultants and Subcontractors in similar manner.

§ 11.5.2 Prior to settlement of an insured loss, the Owner shall notify the Contractor of the terms of the proposed settlement as well as the proposed allocation of the insurance proceeds. The Contractor shall have 14 days from receipt of notice to object to the proposed settlement or allocation of the proceeds. If the Contractor does not object, the Owner shall settle the loss and the Contractor shall be bound by the settlement and allocation. Upon receipt, the Owner

shall deposit the insurance proceeds in a separate account and make the appropriate distributions. Thereafter, if no other agreement is made or the Owner does not terminate the Contract for convenience, the Owner and Contractor shall execute a Change Order for reconstruction of the damaged or destroyed Work in the amount allocated for that purpose. If the Contractor timely objects to either the terms of the proposed settlement or the allocation of the proceeds, the Owner may proceed to settle the insured loss, and any dispute between the Owner and Contractor arising out of the settlement or allocation of the proceeds shall be resolved pursuant to Article 15. Pending resolution of any dispute, the Owner may issue a Construction Change Directive for the reconstruction of the damaged or destroyed Work.

ARTICLE 12 UNCOVERING AND CORRECTION OF WORK

§ 12.1 Uncovering of Work

§ 12.1.1 If a portion of the Work is covered contrary to the Architect's request or to requirements specifically expressed in the Contract Documents, it must, if requested in writing by the Architect, be uncovered for the Architect's examination and be replaced at the Contractor's expense without change in the Contract Time.

§ 12.1.2 If a portion of the Work has been covered that the Architect has not specifically requested to examine prior to its being covered, the Architect may request to see such Work and it shall be uncovered by the Contractor. If such Work is in accordance with the Contract Documents, the Contractor shall be entitled to an equitable adjustment to the Contract Sum and Contract Time as may be appropriate. If such Work is not in accordance with the Contract Documents, the costs of uncovering the Work, and the cost of correction, shall be at the Contractor's expense.

§ 12.2 Correction of Work

§ 12.2.1 Before Substantial Completion

The Contractor shall promptly correct Work rejected by the Architect or failing to conform to the requirements of the Contract Documents, discovered before Substantial Completion and whether or not fabricated, installed or completed. Costs of correcting such rejected Work, including additional testing and inspections, the cost of uncovering and replacement, and compensation for the Architect's services and expenses made necessary thereby, shall be at the Contractor's expense.

§ 12.2.2 After Substantial Completion

§ 12.2.2.1 In addition to the Contractor's obligations under Section 3.5, if, within one year after the date of Substantial Completion of the Work or designated portion thereof or after the date for commencement of warranties established under Section 9.9.1, or by terms of any applicable special warranty required by the Contract Documents, any of the Work is found to be not in accordance with the requirements of the Contract Documents, the Contractor shall correct it promptly after receipt of notice from the Owner to do so, unless the Owner has previously given the Contractor a written acceptance of such condition. The Owner shall give such notice promptly after discovery of the condition. During the one-year period for correction of Work, if the Owner fails to notify the Contractor and give the Contractor an opportunity to make the correction, the Owner waives the rights to require correction by the Contractor and to make a claim for breach of warranty. If the Contractor fails to correct nonconforming Work within a reasonable time during that period after receipt of notice from the Owner or Architect, the Owner may correct it in accordance with Section 2.5.

§ 12.2.2.2 The one-year period for correction of Work shall be extended with respect to portions of Work first performed after Substantial Completion by the period of time between Substantial Completion and the actual completion of that portion of the Work.

§ 12.2.2.3 The one-year period for correction of Work shall not be extended by corrective Work performed by the Contractor pursuant to this Section 12.2.

§ 12.2.3 The Contractor shall remove from the site portions of the Work that are not in accordance with the requirements of the Contract Documents and are neither corrected by the Contractor nor accepted by the Owner.

§ 12.2.4 The Contractor shall bear the cost of correcting destroyed or damaged construction of the Owner or Separate Contractors, whether completed or partially completed, caused by the Contractor's correction or removal of Work that is not in accordance with the requirements of the Contract Documents.

§ 12.2.5 Nothing contained in this Section 12.2 shall be construed to establish a period of limitation with respect to other obligations the Contractor has under the Contract Documents. Establishment of the one-year period for

correction of Work as described in Section 12.2.2 relates only to the specific obligation of the Contractor to correct the Work, and has no relationship to the time within which the obligation to comply with the Contract Documents may be sought to be enforced, nor to the time within which proceedings may be commenced to establish the Contractor's liability with respect to the Contractor's obligations other than specifically to correct the Work.

§ 12.3 Acceptance of Nonconforming Work

If the Owner prefers to accept Work that is not in accordance with the requirements of the Contract Documents, the Owner may do so instead of requiring its removal and correction, in which case the Contract Sum will be reduced as appropriate and equitable. Such adjustment shall be effected whether or not final payment has been made.

ARTICLE 13 MISCELLANEOUS PROVISIONS

§ 13.1 Governing Law

The Contract shall be governed by the law of the place where the Project is located, excluding that jurisdiction's choice of law rules. If the parties have selected arbitration as the method of binding dispute resolution, the Federal Arbitration Act shall govern Section 15.4.

§ 13.2 Successors and Assigns

§ 13.2.1 The Owner and Contractor respectively bind themselves, their partners, successors, assigns, and legal representatives to covenants, agreements, and obligations contained in the Contract Documents. Except as provided in Section 13.2.2, neither party to the Contract shall assign the Contract as a whole without written consent of the other. If either party attempts to make an assignment without such consent, that party shall nevertheless remain legally responsible for all obligations under the Contract.

§ 13.2.2 The Owner may, without consent of the Contractor, assign the Contract to a lender providing construction financing for the Project, if the lender assumes the Owner's rights and obligations under the Contract Documents. The Contractor shall execute all consents reasonably required to facilitate the assignment.

§ 13.3 Rights and Remedies

§ 13.3.1 Duties and obligations imposed by the Contract Documents and rights and remedies available thereunder shall be in addition to and not a limitation of duties, obligations, rights, and remedies otherwise imposed or available by law.

§ 13.3.2 No action or failure to act by the Owner, Architect, or Contractor shall constitute a waiver of a right or duty afforded them under the Contract, nor shall such action or failure to act constitute approval of or acquiescence in a breach thereunder, except as may be specifically agreed upon in writing.

§ 13.4 Tests and Inspections

§ 13.4.1 Tests, inspections, and approvals of portions of the Work shall be made as required by the Contract Documents and by applicable laws, statutes, ordinances, codes, rules, and regulations or lawful orders of public authorities. Unless otherwise provided, the Contractor shall make arrangements for such tests, inspections, and approvals with an independent testing laboratory or entity acceptable to the Owner, or with the appropriate public authority, and shall bear all related costs of tests, inspections, and approvals. The Contractor shall give the Architect timely notice of when and where tests and inspections are to be made so that the Architect may be present for such procedures. The Owner shall bear costs of tests, inspections, or approvals that do not become requirements until after bids are received or negotiations concluded. The Owner shall directly arrange and pay for tests, inspections, or approvals where building codes or applicable laws or regulations so require.

§ 13.4.2 If the Architect, Owner, or public authorities having jurisdiction determine that portions of the Work require additional testing, inspection, or approval not included under Section 13.4.1, the Architect will, upon written authorization from the Owner, instruct the Contractor to make arrangements for such additional testing, inspection, or approval, by an entity acceptable to the Owner, and the Contractor shall give timely notice to the Architect of when and where tests and inspections are to be made so that the Architect may be present for such procedures. Such costs, except as provided in Section 13.4.3, shall be at the Owner's expense.

§ 13.4.3 If procedures for testing, inspection, or approval under Sections 13.4.1 and 13.4.2 reveal failure of the portions of the Work to comply with requirements established by the Contract Documents, all costs made necessary by such failure, including those of repeated procedures and compensation for the Architect's services and expenses, shall be at the Contractor's expense.

§ 13.4.4 Required certificates of testing, inspection, or approval shall, unless otherwise required by the Contract Documents, be secured by the Contractor and promptly delivered to the Architect.

§ 13.4.5 If the Architect is to observe tests, inspections, or approvals required by the Contract Documents, the Architect will do so promptly and, where practicable, at the normal place of testing.

§ 13.4.6 Tests or inspections conducted pursuant to the Contract Documents shall be made promptly to avoid unreasonable delay in the Work.

§ 13.5 Interest

Payments due and unpaid under the Contract Documents shall bear interest from the date payment is due at the rate the parties agree upon in writing or, in the absence thereof, at the legal rate prevailing from time to time at the place where the Project is located.

ARTICLE 14 TERMINATION OR SUSPENSION OF THE CONTRACT

§ 14.1 Termination by the Contractor

§ 14.1.1 The Contractor may terminate the Contract if the Work is stopped for a period of 30 consecutive days through no act or fault of the Contractor, a Subcontractor, a Sub-subcontractor, their agents or employees, or any other persons or entities performing portions of the Work, for any of the following reasons:

- .1 Issuance of an order of a court or other public authority having jurisdiction that requires all Work to be stopped;
- .2 An act of government, such as a declaration of national emergency, that requires all Work to be stopped;
- .3 Because the Architect has not issued a Certificate for Payment and has not notified the Contractor of the reason for withholding certification as provided in Section 9.4.1, or because the Owner has not made payment on a Certificate for Payment within the time stated in the Contract Documents; or
- .4 The Owner has failed to furnish to the Contractor reasonable evidence as required by Section 2.2.

§ 14.1.2 The Contractor may terminate the Contract if, through no act or fault of the Contractor, a Subcontractor, a Sub-subcontractor, their agents or employees, or any other persons or entities performing portions of the Work, repeated suspensions, delays, or interruptions of the entire Work by the Owner as described in Section 14.3, constitute in the aggregate more than 100 percent of the total number of days scheduled for completion, or 120 days in any 365-day period, whichever is less.

§ 14.1.3 If one of the reasons described in Section 14.1.1 or 14.1.2 exists, the Contractor may, upon seven days' notice to the Owner and Architect, terminate the Contract and recover from the Owner payment for Work executed, as well as reasonable overhead and profit on Work not executed, and costs incurred by reason of such termination.

§ 14.1.4 If the Work is stopped for a period of 60 consecutive days through no act or fault of the Contractor, a Subcontractor, a Sub-subcontractor, or their agents or employees or any other persons or entities performing portions of the Work because the Owner has repeatedly failed to fulfill the Owner's obligations under the Contract Documents with respect to matters important to the progress of the Work, the Contractor may, upon seven additional days' notice to the Owner and the Architect, terminate the Contract and recover from the Owner as provided in Section 14.1.3.

§ 14.2 Termination by the Owner for Cause

§ 14.2.1 The Owner may terminate the Contract if the Contractor

- .1 repeatedly refuses or fails to supply enough properly skilled workers or proper materials;
- .2 fails to make payment to Subcontractors or suppliers in accordance with the respective agreements between the Contractor and the Subcontractors or suppliers;
- .3 repeatedly disregards applicable laws, statutes, ordinances, codes, rules and regulations, or lawful orders of a public authority; or
- .4 otherwise is guilty of substantial breach of a provision of the Contract Documents.

§ 14.2.2 When any of the reasons described in Section 14.2.1 exist, and upon certification by the Architect that sufficient cause exists to justify such action, the Owner may, without prejudice to any other rights or remedies of the Owner and after giving the Contractor and the Contractor's surety, if any, seven days' notice, terminate employment of the Contractor and may, subject to any prior rights of the surety:

- .1 Exclude the Contractor from the site and take possession of all materials, equipment, tools, and construction equipment and machinery thereon owned by the Contractor;
- .2 Accept assignment of subcontracts pursuant to Section 5.4; and
- .3 Finish the Work by whatever reasonable method the Owner may deem expedient. Upon written request of the Contractor, the Owner shall furnish to the Contractor a detailed accounting of the costs incurred by the Owner in finishing the Work.

§ 14.2.3 When the Owner terminates the Contract for one of the reasons stated in Section 14.2.1, the Contractor shall not be entitled to receive further payment until the Work is finished.

§ 14.2.4 If the unpaid balance of the Contract Sum exceeds costs of finishing the Work, including compensation for the Architect's services and expenses made necessary thereby, and other damages incurred by the Owner and not expressly waived, such excess shall be paid to the Contractor. If such costs and damages exceed the unpaid balance, the Contractor shall pay the difference to the Owner. The amount to be paid to the Contractor or Owner, as the case may be, shall be certified by the Initial Decision Maker, upon application, and this obligation for payment shall survive termination of the Contract.

§ 14.3 Suspension by the Owner for Convenience

§ 14.3.1 The Owner may, without cause, order the Contractor in writing to suspend, delay or interrupt the Work, in whole or in part for such period of time as the Owner may determine.

§ 14.3.2 The Contract Sum and Contract Time shall be adjusted for increases in the cost and time caused by suspension, delay, or interruption under Section 14.3.1. Adjustment of the Contract Sum shall include profit. No adjustment shall be made to the extent

- .1 that performance is, was, or would have been so suspended, delayed, or interrupted, by another cause for which the Contractor is responsible; or
- .2 that an equitable adjustment is made or denied under another provision of the Contract.

§ 14.4 Termination by the Owner for Convenience

§ 14.4.1 The Owner may, at any time, terminate the Contract for the Owner's convenience and without cause.

§ 14.4.2 Upon receipt of notice from the Owner of such termination for the Owner's convenience, the Contractor shall

- .1 cease operations as directed by the Owner in the notice;
- .2 take actions necessary, or that the Owner may direct, for the protection and preservation of the Work; and
- .3 except for Work directed to be performed prior to the effective date of termination stated in the notice, terminate all existing subcontracts and purchase orders and enter into no further subcontracts and purchase orders.

§ 14.4.3 In case of such termination for the Owner's convenience, the Owner shall pay the Contractor for Work properly executed; costs incurred by reason of the termination, including costs attributable to termination of Subcontracts; and the termination fee, if any, set forth in the Agreement.

ARTICLE 15 CLAIMS AND DISPUTES

§ 15.1 Claims

§ 15.1.1 Definition

A Claim is a demand or assertion by one of the parties seeking, as a matter of right, payment of money, a change in the Contract Time, or other relief with respect to the terms of the Contract. The term "Claim" also includes other disputes and matters in question between the Owner and Contractor arising out of or relating to the Contract. The responsibility to substantiate Claims shall rest with the party making the Claim. This Section 15.1.1 does not require the Owner to file a Claim in order to impose liquidated damages in accordance with the Contract Documents.

§ 15.1.2 Time Limits on Claims

The Owner and Contractor shall commence all Claims and causes of action against the other and arising out of or related to the Contract, whether in contract, tort, breach of warranty or otherwise, in accordance with the requirements of the binding dispute resolution method selected in the Agreement and within the period specified by applicable law, but in any case not more than 10 years after the date of Substantial Completion of the Work. The Owner and Contractor waive all Claims and causes of action not commenced in accordance with this Section 15.1.2.

§ 15.1.3 Notice of Claims

§ 15.1.3.1 Claims by either the Owner or Contractor, where the condition giving rise to the Claim is first discovered prior to expiration of the period for correction of the Work set forth in Section 12.2.2, shall be initiated by notice to the other party and to the Initial Decision Maker with a copy sent to the Architect, if the Architect is not serving as the Initial Decision Maker. Claims by either party under this Section 15.1.3.1 shall be initiated within 21 days after occurrence of the event giving rise to such Claim or within 21 days after the claimant first recognizes the condition giving rise to the Claim, whichever is later.

§ 15.1.3.2 Claims by either the Owner or Contractor, where the condition giving rise to the Claim is first discovered after expiration of the period for correction of the Work set forth in Section 12.2.2, shall be initiated by notice to the other party. In such event, no decision by the Initial Decision Maker is required.

§ 15.1.4 Continuing Contract Performance

§ 15.1.4.1 Pending final resolution of a Claim, except as otherwise agreed in writing or as provided in Section 9.7 and Article 14, the Contractor shall proceed diligently with performance of the Contract and the Owner shall continue to make payments in accordance with the Contract Documents.

§ 15.1.4.2 The Contract Sum and Contract Time shall be adjusted in accordance with the Initial Decision Maker's decision, subject to the right of either party to proceed in accordance with this Article 15. The Architect will issue Certificates for Payment in accordance with the decision of the Initial Decision Maker.

§ 15.1.5 Claims for Additional Cost

If the Contractor wishes to make a Claim for an increase in the Contract Sum, notice as provided in Section 15.1.3 shall be given before proceeding to execute the portion of the Work that is the subject of the Claim. Prior notice is not required for Claims relating to an emergency endangering life or property arising under Section 10.4.

§ 15.1.6 Claims for Additional Time

§ 15.1.6.1 If the Contractor wishes to make a Claim for an increase in the Contract Time, notice as provided in Section 15.1.3 shall be given. The Contractor's Claim shall include an estimate of cost and of probable effect of delay on progress of the Work. In the case of a continuing delay, only one Claim is necessary.

§ 15.1.6.2 If adverse weather conditions are the basis for a Claim for additional time, such Claim shall be documented by data substantiating that weather conditions were abnormal for the period of time, could not have been reasonably anticipated, and had an adverse effect on the scheduled construction.

§ 15.1.7 Waiver of Claims for Consequential Damages

The Contractor and Owner waive Claims against each other for consequential damages arising out of or relating to this Contract. This mutual waiver includes

1. damages incurred by the Owner for rental expenses, for losses of use, income, profit, financing, business and reputation, and for loss of management or employee productivity or of the services of such persons; and
2. damages incurred by the Contractor for principal office expenses including the compensation of personnel stationed there, for losses of financing, business and reputation, and for loss of profit, except anticipated profit arising directly from the Work.

This mutual waiver is applicable, without limitation, to all consequential damages due to either party's termination in accordance with Article 14. Nothing contained in this Section 15.1.7 shall be deemed to preclude assessment of liquidated damages, when applicable, in accordance with the requirements of the Contract Documents.

§ 15.2 Initial Decision

§ 15.2.1 Claims, excluding those where the condition giving rise to the Claim is first discovered after expiration of the period for correction of the Work set forth in Section 12.2.2 or arising under Sections 10.3, 10.4, and 11.5, shall be referred to the Initial Decision Maker for initial decision. The Architect will serve as the Initial Decision Maker, unless otherwise indicated in the Agreement. Except for those Claims excluded by this Section 15.2.1, an initial decision shall be required as a condition precedent to mediation of any Claim. If an initial decision has not been rendered within 30 days after the Claim has been referred to the Initial Decision Maker, the party asserting the Claim may demand mediation and binding dispute resolution without a decision having been rendered. Unless the Initial Decision Maker

and all affected parties agree, the Initial Decision Maker will not decide disputes between the Contractor and persons or entities other than the Owner.

§ 15.2.2 The Initial Decision Maker will review Claims and within ten days of the receipt of a Claim take one or more of the following actions: (1) request additional supporting data from the claimant or a response with supporting data from the other party, (2) reject the Claim in whole or in part, (3) approve the Claim, (4) suggest a compromise, or (5) advise the parties that the Initial Decision Maker is unable to resolve the Claim if the Initial Decision Maker lacks sufficient information to evaluate the merits of the Claim or if the Initial Decision Maker concludes that, in the Initial Decision Maker's sole discretion, it would be inappropriate for the Initial Decision Maker to resolve the Claim.

§ 15.2.3 In evaluating Claims, the Initial Decision Maker may, but shall not be obligated to, consult with or seek information from either party or from persons with special knowledge or expertise who may assist the Initial Decision Maker in rendering a decision. The Initial Decision Maker may request the Owner to authorize retention of such persons at the Owner's expense.

§ 15.2.4 If the Initial Decision Maker requests a party to provide a response to a Claim or to furnish additional supporting data, such party shall respond, within ten days after receipt of the request, and shall either (1) provide a response on the requested supporting data, (2) advise the Initial Decision Maker when the response or supporting data will be furnished, or (3) advise the Initial Decision Maker that no supporting data will be furnished. Upon receipt of the response or supporting data, if any, the Initial Decision Maker will either reject or approve the Claim in whole or in part.

§ 15.2.5 The Initial Decision Maker will render an initial decision approving or rejecting the Claim, or indicating that the Initial Decision Maker is unable to resolve the Claim. This initial decision shall (1) be in writing; (2) state the reasons therefor; and (3) notify the parties and the Architect, if the Architect is not serving as the Initial Decision Maker, of any change in the Contract Sum or Contract Time or both. The initial decision shall be final and binding on the parties but subject to mediation and, if the parties fail to resolve their dispute through mediation, to binding dispute resolution.

§ 15.2.6 Either party may file for mediation of an initial decision at any time, subject to the terms of Section 15.2.6.1.

§ 15.2.6.1 Either party may, within 30 days from the date of receipt of an initial decision, demand in writing that the other party file for mediation. If such a demand is made and the party receiving the demand fails to file for mediation within 30 days after receipt thereof, then both parties waive their rights to mediate or pursue binding dispute resolution proceedings with respect to the initial decision.

§ 15.2.7 In the event of a Claim against the Contractor, the Owner may, but is not obligated to, notify the surety, if any, of the nature and amount of the Claim. If the Claim relates to a possibility of a Contractor's default, the Owner may, but is not obligated to, notify the surety and request the surety's assistance in resolving the controversy.

§ 15.2.8 If a Claim relates to or is the subject of a mechanic's lien, the party asserting such Claim may proceed in accordance with applicable law to comply with the lien notice or filing deadlines.

§ 15.3 Mediation

§ 15.3.1 Claims, disputes, or other matters in controversy arising out of or related to the Contract, except those waived as provided for in Sections 9.10.4, 9.10.5, and 15.1.7, shall be subject to mediation as a condition precedent to binding dispute resolution.

§ 15.3.2 The parties shall endeavor to resolve their Claims by mediation which, unless the parties mutually agree otherwise, shall be administered by the American Arbitration Association in accordance with its Construction Industry Mediation Procedures in effect on the date of the Agreement. A request for mediation shall be made in writing, delivered to the other party to the Contract, and filed with the person or entity administering the mediation. The request may be made concurrently with the filing of binding dispute resolution proceedings but, in such event, mediation shall proceed in advance of binding dispute resolution proceedings, which shall be stayed pending mediation for a period of 60 days from the date of filing, unless stayed for a longer period by agreement of the parties or court order. If an arbitration is stayed pursuant to this Section 15.3.2, the parties may nonetheless proceed to the selection of the arbitrator(s) and agree upon a schedule for later proceedings.

§ 15.3.3 Either party may, within 30 days from the date that mediation has been concluded without resolution of the dispute or 60 days after mediation has been demanded without resolution of the dispute, demand in writing that the other party file for binding dispute resolution. If such a demand is made and the party receiving the demand fails to file for binding dispute resolution within 60 days after receipt thereof, then both parties waive their rights to binding dispute resolution proceedings with respect to the initial decision.

§ 15.3.4 The parties shall share the mediator's fee and any filing fees equally. The mediation shall be held in the place where the Project is located, unless another location is mutually agreed upon. Agreements reached in mediation shall be enforceable as settlement agreements in any court having jurisdiction thereof.

§ 15.4 Arbitration

§ 15.4.1 If the parties have selected arbitration as the method for binding dispute resolution in the Agreement, any Claim subject to, but not resolved by, mediation shall be subject to arbitration which, unless the parties mutually agree otherwise, shall be administered by the American Arbitration Association in accordance with its Construction Industry Arbitration Rules in effect on the date of the Agreement. The Arbitration shall be conducted in the place where the Project is located, unless another location is mutually agreed upon. A demand for arbitration shall be made in writing, delivered to the other party to the Contract, and filed with the person or entity administering the arbitration. The party filing a notice of demand for arbitration must assert in the demand all Claims then known to that party on which arbitration is permitted to be demanded.

§ 15.4.1.1 A demand for arbitration shall be made no earlier than concurrently with the filing of a request for mediation, but in no event shall it be made after the date when the institution of legal or equitable proceedings based on the Claim would be barred by the applicable statute of limitations. For statute of limitations purposes, receipt of a written demand for arbitration by the person or entity administering the arbitration shall constitute the institution of legal or equitable proceedings based on the Claim.

§ 15.4.2 The award rendered by the arbitrator or arbitrators shall be final, and judgment may be entered upon it in accordance with applicable law in any court having jurisdiction thereof.

§ 15.4.3 The foregoing agreement to arbitrate and other agreements to arbitrate with an additional person or entity duly consented to by parties to the Agreement, shall be specifically enforceable under applicable law in any court having jurisdiction thereof.

§ 15.4.4 Consolidation or Joinder

§ 15.4.4.1 Subject to the rules of the American Arbitration Association or other applicable arbitration rules, either party may consolidate an arbitration conducted under this Agreement with any other arbitration to which it is a party provided that (1) the arbitration agreement governing the other arbitration permits consolidation, (2) the arbitrations to be consolidated substantially involve common questions of law or fact, and (3) the arbitrations employ materially similar procedural rules and methods for selecting arbitrator(s).

§ 15.4.4.2 Subject to the rules of the American Arbitration Association or other applicable arbitration rules, either party may include by joinder persons or entities substantially involved in a common question of law or fact whose presence is required if complete relief is to be accorded in arbitration, provided that the party sought to be joined consents in writing to such joinder. Consent to arbitration involving an additional person or entity shall not constitute consent to arbitration of any claim, dispute or other matter in question not described in the written consent.

§ 15.4.4.3 The Owner and Contractor grant to any person or entity made a party to an arbitration conducted under this Section 15.4, whether by joinder or consolidation, the same rights of joinder and consolidation as those of the Owner and Contractor under this Agreement.

SECTION 00 73 13
SUPPLEMENTARY GENERAL CONDITIONS A201-2017

The following supplements modify the "General Conditions of the Contract for Construction," AIA Document A201-2017. Where a portion of the General Conditions is modified or deleted by the Supplementary Conditions, the unaltered portions of the General Conditions shall remain in effect.

TABLE OF ARTICLES

1. GENERAL PROVISIONS
2. OWNER
3. CONTRACTOR
4. ADMINISTRATION OF THE CONTRACT
5. SUBCONTRACTORS
6. CONSTRUCTION BY OWNER OR BY SEPARATE CONTRACTORS
7. CHANGES IN THE WORK
8. TIME
9. PAYMENTS AND COMPLETION
10. PROTECTION OF PERSONS AND PROPERTY
11. INSURANCE AND BONDS
12. UNCOVERING AND CORRECTION OF WORK
13. MISCELLANEOUS PROVISIONS
14. TERMINATION OR SUSPENSION OF THE CONTRACT
15. CLAIMS AND DISPUTES

ARTICLE 1: GENERAL PROVISIONS

1.1 BASIC DEFINITIONS

1.1.1 THE CONTRACT DOCUMENTS

Strike the last sentence of Section 1.1.1 in its entirety and replace with the following:

"The Contract Documents also include Advertisement for Bid, Instructions to Bidder, sample forms, the Bid Form, the Contractor's completed Bid and the Award Letter."

Add the following Section:

"1.1.1.1 In the event of conflict or discrepancies among the Contract Documents, the Documents prepared by the State of Delaware, Division of Facilities Management shall take precedence over all other documents."

1.1.8 INITIAL DECISION MAKER

Strike the last sentence of Section 1.1.8 in its entirety and add the following to the end of the remaining sentence:

" and certify termination of the Agreement under Section 14.2.2."

1.2 CORRELATION AND INTENT OF THE CONTRACT DOCUMENTS

1.2.1.1 Insert "if possible" at the end of the second sentence.

Add the following Sections:

"1.2.4 In the case of an inconsistency between the Drawings and the Specifications, or within either document not clarified by addendum, the better quality or greater quantity of work shall be provided in accordance with the Architect's interpretation."

"1.2.5 The word "PROVIDE" as used in the Contract Documents shall mean "FURNISH AND INSTALL" and shall include, without limitation, all labor, materials, equipment, transportation, services and other items required to complete the Work."

"1.2.6 The word "PRODUCT" as used in the Contract Documents means all materials, systems and equipment."

1.5 OWNERSHIP AND USE OF DRAWINGS, SPECIFICATIONS AND OTHER INSTRUMENTS OF SERVICE

Strike Section 1.5.1 in its entirety and replace with the following:

"All pre-design studies, drawings, specifications and other documents, including those in electronic form, prepared by the Architect under this Agreement are, and shall remain, the property of the Owner whether the Project for which they are made is executed or not. Such documents may be used by the Owner to construct one or more like Projects without the approval of, or additional compensation to, the Architect. The Contractor, Subcontractors, Sub-subcontractors, and Material or Equipment Suppliers are authorized to use and reproduce applicable portions of the Drawings, Specifications and other

documents prepared by the Architect and the Architect's consultants appropriate to and for use in the execution of their Work under the Contract Documents. They are not to be used by the Contractor or any Subcontractor, Sub-subcontractor or Material and Equipment Supplier on other Projects or for additions to this Project outside the scope of the Work without the specific written consent of the Owner, Architect and Architect's consultants.

The Architect shall not be liable for injury or damage resulting from the re-use of drawings and specifications if the Architect is not involved in the re-use Project. Prior to re-use of construction documents for a Project in which the Architect is not also involved, the Owner will remove from such documents all identification of the original Architect, including name, address and professional seal or stamp."

Strike Section 1.5.2 in its entirety.

1.7 DIGITAL DATA USE AND TRANSMISSION

Strike Section 1.7 in its entirety and replace with the following:

"The parties shall agree upon protocols governing transmission and use of Instruments of Service or any other information or documentation in digital form."

1.8 BUILDING INFORMATION MODELS USE AND RELIANCE

Strike Section 1.8 in its entirety.

ARTICLE 2: OWNER

2.2 EVIDENCE OF THE OWNERS FINANCIAL ARRANGEMENTS

Strike Section 2.2 in its entirety.

2.3 INFORMATION AND SERVICES REQUIRED OF THE OWNER

2.3.3 Strike 2.3.3 in its entirety.

2.3.4 Add the following sentence at the end of the paragraph:

"The Contractor, at their expense shall bear the costs to accurately identify the location of all underground utilities in the area of their excavation and shall bear all cost for any repairs required, out of failure to accurately identify said utilities."

Strike Section 2.3.6 in its entirety and replace with the following:

"2.3.6 The Contractor shall be furnished free of charge (1) electronic set of the Drawings and Project Manuals. Additional sets will be furnished at the cost of reproduction, postage and handling."

2.5 OWNER'S RIGHT TO CARRY OUT THE WORK

Add ", except as outlined in Section 3.15" after the reference to "Article 15" at the end of the last sentence of the Section.

ARTICLE 3: CONTRACTOR

3.2 REVIEW OF CONTRACT DOCUMENTS AND FIELD CONDITIONS BY CONTRACTOR

3.2.2 Add "and Owner" after "report to the Architect" in the second sentence.

3.2.4 Strike "subject to Section 15.1.7" in the second sentence.

3.2.4 Strike the third sentence.

3.3 SUPERVISION AND CONSTRUCTION PROCEDURES

Add the following Sections:

"3.3.2.1 The Contractor shall immediately remove from the Work, whenever requested to do so by the Owner, any person who is considered by the Owner or Architect to be incompetent or disposed to be so disorderly, or who for any reason is not satisfactory to the Owner, and that person shall not again be employed on the Work without the consent of the Owner or the Architect."

"3.3.4 The Contractor must provide suitable storage facilities at the Site for the proper protection and safe storage of their materials, or as otherwise identified by the specifications. Consult the Owner and the Architect before storing any materials."

"3.3.5 When any room is used as a shop, storeroom, office, etc., by the Contractor or Subcontractor(s) during the construction of the Work, the Contractor making use of these areas will be held responsible for any repairs, patching or cleaning arising from such use."

3.4 LABOR AND MATERIALS

Add the Following Sections:

"3.4.4 Before starting the Work, each Contractor shall carefully examine all preparatory Work that has been executed to receive their Work. Check carefully, by whatever means are required, to insure that its Work and adjacent, related Work, will finish to proper contours, planes and levels. Promptly notify the Architect & Owner of any defects or imperfections in preparatory Work which will in any way affect satisfactory completion of its Work. Absence of such notification will be construed as an acceptance of preparatory Work and later claims of defects will not be recognized."

"3.4.5 Under no circumstances shall the Contractor's Work proceed prior to preparatory Work having been completely cured, dried and/or otherwise made satisfactory to receive this Work. Responsibility for timely installation of all materials rests solely with the Contractor responsible for that Work, who shall maintain coordination at all times."

3.5 WARRANTY

Add the following Sections:

"3.5.3 The Contractor will guarantee all materials and workmanship against original defects, except injury from proper and usual wear when used for the purpose intended,

for two years after Acceptance by the Owner, and will maintain all items in perfect condition during the period of warranty.”

“3.5.4 Defects appearing during the period of warranty will be made good by the Contractor at his expense upon demand of the Owner, it being required that all work will be in perfect condition when the period of warranty will have elapsed.”

“3.5.5 Upon notification by the Owner of a defect covered by the Contractor’s warranty, the Contractor shall respond within 4 hours of the notification.”

“3.5.6 In addition to the General Warranty there are other warranties required for certain items for different periods of time than the two years as above, and are particularly so stated in that part of the specifications referring to same. The said warranties will commence at the same time as the General Warranty.”

“3.5.7 If the Contractor fails to remedy any failure, defect or damage within a reasonable time after receipt of notice, the Owner will have the right to replace, repair, or otherwise remedy the failure, defect or damage at the Contractor’s expense.”

3.8 ALLOWANCES

Add the following Section:

“3.8.1.1 For costs to be covered under a project allowance, (included in the schedule of values) the Contractor shall submit a summary of those costs anticipated and an Allowance Access Authorization Form to the Architect and Owner, reflecting the projected costs. The Allowance Access Authorization Form must be signed by the Owner prior to initiating any work associated with the allowance.”

3.10 CONTRACTOR’S CONSTRUCTION AND SUBMITTAL SCHEDULES

3.10.1 Add “estimated” after “and the” and before “date of” in the second sentence.

3.10.2 Strike “and thereafter as necessary to maintain a current submittal schedule” in the first sentence.

3.11 DOCUMENTS AND SAMPLES AT THE SITE

Add the following Sections:

“3.11.1 During the course of the Work, the Contractor shall maintain a record set of drawings on which the Contractor shall mark the actual physical location of all piping, valves, equipment, conduit, outlets, access panels, controls, actuators, including all appurtenances that will be concealed once construction is complete, etc., including all invert elevations.”

“3.11.2 At the completion of the project, the Contractor shall obtain a set of the conformed contract drawings from the Architect, and neatly transfer all information outlined in 3.11.1 to provide a complete record of the as-built conditions.”

“3.11.3 Upon completion of the work noted in 3.11.2 the contractor shall schedule a meeting with the Architect/Engineer and Owner to review the final record drawings and closeout documents prior to submission. After this meeting the Contractor shall make adjustments per the review, and submit one (1) original markup and (2) copies of the red line drawings (as-built conditions, to the Owner and one (1) print to the Architect. In addition, attach one complete set of the as-built documents to each of the Operating and Maintenance Instructions/Manuals. The Contractor will include (2) USB drives, each

containing all "red line drawings (as-built) and Closeout Documents properly tabbed in accordance with closeout requirements as defined elsewhere in the contract documents."

3.12 SHOP DRAWINGS, PRODUCT DATA AND SAMPLES

3.12.10.2 Strike "If the Contract Documents require" from the beginning of the sentence.

3.12.10.2 Strike "to" between "professional" and certify" and replace with "shall".

3.17 Insert "indemnify and" between "shall" and "hold" in the second sentence.

ARTICLE 4: ADMINISTRATION OF THE CONTRACT

4.2 ADMINISTRATION OF THE CONTRACT

4.2.7 Strike the first sentence and replace with the following:

"The Architect will review and approve or take other appropriate action upon the Contractor's submittals such as Shop Drawings, Product Data and Samples for the purpose of checking for conformance with the Contract Documents."

4.2.7 Strike the second sentence and replace with the following:

"The Architect's action will be taken with such reasonable promptness as to cause no delay in the Work in the activities of the Owner, Contractor or separate Contractors, while allowing sufficient time in the Owner's professional judgment to permit adequate review."

Add the following Section:

"4.2.10.1 There will be no full-time Project Representative provided by the Owner or Architect on this project."

"4.2.13 Add "and in compliance with all local requirements." to the end of the sentence."

ARTICLE 5: SUBCONTRACTORS

5.2 AWARD OF SUBCONTRACTS AND OTHER CONTRACTS FOR PORTIONS OF THE WORK

5.2.3 Strike Section 5.2.3 in its entirety and replace with the following:

"If the Owner or Architect has reasonable objection to a person or entity proposed by the Contractor, the Contractor shall propose another to whom the Owner or Architect has no reasonable objection, subject to the statutory requirements of 29 Delaware Code § 6962(d)(10)b.3 and 4."

5.2.4 Strike Section 5.2.4 in its entirety and replace with the following:

"The Contractor may not substitute any Subcontractor listed in its Bid unless the Contractor complies with the requirements of 29 Delaware Code § 6962(d)(10)b.3 and 4. Failure to comply with this requirement shall subject the Contractor to a penalty as outlined in Section 5.2 of the Owner's General Requirements."

Add the following Section:

"5.2.5 The Contractor shall comply and shall ensure all Subcontractors comply with all requirements for drug testing as set forth in TITLE 19 LABOR DELAWARE ADMINISTRATIVE CODE 4000 Office of Management and Budget 4100 Division of Facilities Management **4104 Regulations for the Drug Testing of Contractor and Subcontractor Employees Working on Large Public Works Projects.**"

ARTICLE 6: CONSTRUCTION BY OWNER OR BY SEPARATE CONTRACTORS

6.1 OWNER'S RIGHT TO PERFORM CONSTRUCTION AND TO AWARD SEPARATE CONTRACTS

6.1.1 Strike "and waiver of subrogation" from the end of the second sentence.

6.1.4 Strike Section 6.1.4 in its entirety.

6.2 MUTUAL RESPONSIBILITY

6.2.3 Strike "shall" and replace with "may" in the second sentence.

ARTICLE 7: CHANGES IN THE WORK

(SEE ARTICLE 7: CHANGES IN WORK IN THE STATE OF DELAWARE DIVISION OF FACILITIES MANAGEMENT GENERAL REQUIREMENTS)

7.2 CHANGE ORDERS

7.2.2 In addition to the above:

7.2.2.1 The General Contractor is allowed a fifteen percent (15%) markup for overhead and profit for additional work performed by the General Contractor's own forces

7.2.2.2 For additional subcontractor work, the Subcontractor is allowed a fifteen (15) percent overhead and profit on change order work above and beyond the direct costs stated previously. To this amount, the General Contractor will be allowed a mark-up not exceeding seven- and one-half percent (7.5%) on the subcontractor's work.

7.2.2.3 Where the Third Tier Contractor is going to be completing the additional work, the Third-Tier contractor will be allowed a markup of fifteen percent (15%) overhead and profit on changes order work above and beyond the direct costs stated previously. To this amount, the Subcontractor will be allowed a markup not to exceed seven and one-half percent (7.5%) on the Third-Tier Contractor's work and the General Contractor will be allowed a markup not to exceed seven and one-half percent (7.5%) of the amount of the Subcontractor's markup.

7.2.2.4 No additional costs shall be allowed for changes related to the Contractor's onsite superintendent/staff, or project manager, unless a change in the work changes the project duration and is identified by the CPM schedule. There will be no other costs associated with the change order.

7.2.2.5 These markups shall include all costs including, but not limited to: overhead, profit, bonds, insurance, supervision, etc."

- 7.3.4.1 Strike “and other employee costs approved by the Architect” after “worker’s compensation insurance,”
- 7.3.4.4 Add “work attributable to the” before “change” at the end of the sentence.
- 7.4 MINOR CHANGES IN WORK
Add “unless such changes are approved” at the end of the third sentence.

ARTICLE 8: TIME

8.2 PROGRESS AND COMPLETION

8.2.1 Add the following Section:

“8.2.1.1 Refer to Project Specifications Section SUMMARY OF WORK for Contract time requirements.”

8.2.2 After “by the Contractor” strike “and” and insert “to”.

8.2.4 Add the following Section:

“8.2.4 If the Work falls behind the Progress Schedule as submitted by the Contractor, the Contractor shall employ additional labor and/or equipment necessary to bring the Work into compliance with the Progress Schedule at no additional cost to the Owner.”

8.3 DELAYS AND EXTENSION OF TIME

8.3.1 Strike “binding dispute resolution” and insert “any and all remedies at law or in equity”.

Add the following Section:

“8.3.2.1 The Contractor shall update the status of the suspension, delay, or interruption of the Work with each Application for Payment. (The Contractor shall report the termination of such cause immediately upon the termination thereof.) Failure to comply with this procedure shall constitute a waiver for any claim for adjustment of time or price based upon said cause.”

Strike Section 8.3.3 in its entirety and replace with the following:

8.3.3 “Except in the case of a suspension of the Work directed by the Owner, an extension of time under the provisions of Section 8.3.1 shall be the Contractor’s sole remedy in the progress of the Work and there shall be no payment or compensation to the Contractor for any expense or damage resulting from the delay.”

Add the following Section:

“8.3.4 By permitting the Contractor to work after the expired time for completion of the project, the Owner does not waive their rights under the Contract.”

ARTICLE 9: PAYMENTS AND COMPLETION

9.2 SCHEDULE OF VALUES

Add the following Sections:

"9.2.1 The Schedule of Values shall be submitted using AIA Document G703, Continuation Sheet to G702."

"9.2.2 The Schedule of Values is to include a line item for Project Closeout Document Submittal. The value of this item is to be no less than 1.5% of the initial contract amount."

9.3 APPLICATIONS FOR PAYMENT

9.3.1 Strike Section 9.3.1 in its entirety and replace with the following:

"At least ten days before the date established for each progress payment, the Contractor shall submit to the Architect an itemized Application for Payment prepared in accordance with the schedule of values for completed portions of the Work. The application shall be notarized, and supported by all data substantiating the Contractor's right to payment that the Owner or Architect require, such as copies of requisitions, and releases and waivers of liens from Subcontractors and suppliers, and shall reflect retainage."

Add the following Sections:

"9.3.1.3 Application for Payment shall be submitted on AIA Document G702 "Application and Certificate for Payment", supported by AIA Document G703 "Continuation Sheet". Said Applications shall be fully executed and notarized."

"9.3.4 Until Closeout Documents have been received and outstanding items completed the Owner will pay 95% (ninety-five percent) of the amount due the Contractor on account of progress payments."

"9.3.5 The Contractor shall provide a current and updated Progress Schedule to the Architect with each Application for Payment. Failure to provide Schedule will be just cause for rejection of Application for Payment."

9.5 DECISIONS TO WITHHOLD CERTIFICATION

Add the following Subsections to 9.5.1:

- .8 failure to provide a current Progress Schedule;
- .9 a lien or attachment is filed;
- .10 failure to comply with mandatory requirements for maintaining Record Documents.

9.6 PROGRESS PAYMENTS

9.6.1 Strike Section 9.6.1 in its entirety and replace with the following:

"9.6.1 After the Architect has approved and issued a Certificate for Payment, payment shall be made by the Owner within 30 days after Owner's receipt of the Certificate for Payment."

9.6.8 Strike "Provided the Owner has fulfilled its payment obligations under the Contract Documents," in the first sentence.

9.7 FAILURE OF PAYMENT

Strike Section 9.7 in its entirety and replace with the following:

"If the Architect does not issue a Certificate for Payment, through no fault of the Contractor, within fourteen days after receipt of the Contractor's Application for Payment, or if the Owner does not pay the Contractor within thirty days after the date established in the Contract Documents, the amount certified by the Architect, then the Contractor may, upon thirty additional days' notice to the Owner and Architect, stop the Work until payment of the amount owing has been received. The Contract Time shall be extended appropriately and the Contract Sum shall be increased by the amount of the Contractor's reasonable costs of shutdown, delay and start-up, plus interest as provided for in the Contract Documents."

9.8 SUBSTANTIAL COMPLETION

9.8.3 At the end of Section 9.8.3, add the following sentence:

"If the Architect is required to make more than 2 inspections of the same portion of work, the Contractor shall be responsible for all costs associated with subsequent inspections including but not limited to any Architect's fees."

9.8.5 Strike "shall" and insert "may" in the second sentence.

9.8.5 Insert "1/2 of the" after "make payment of" in the second sentence.

9.9 PARTIAL OCCUPANCY OR USE

9.9.1 Strike the first sentence and replace with the following (the remainder of the Section remains as written):

"The Owner may occupy or use any completed or partially completed portion of the Work at any stage when such portion is designated by separate agreement with the Contractor, provided such occupancy or use authorized by public authorities having jurisdiction over the Project."

9.10.2 Strike "to remain in force after final payment is currently in effect" after "required by the Contract Documents" and replace with "shall remain in force until final payment is completed" in the first sentence.

9.10.4.4 Strike "if permitted by the Contract Documents,"

ARTICLE 10: PROTECTION OF PERSONS AND PROPERTY

10.1 SAFETY PRECAUTIONS AND PROGRAMS

Add the following Sections:

10.1.1 Each Contractor shall develop a safety program in accordance with the Occupational Safety and Health Act of 1970. A copy of said plan shall be furnished to the Owner and Architect prior to the commencement of that Contractor's Work.

10.1.2 Each Contractor shall appoint a Safety Representative. Safety Representatives shall be someone who is on site on a full time basis. If deemed necessary by the Owner or Architect, Contractor Safety meetings will be scheduled. The attendance of all Safety Representatives will be required. Minutes will be recorded of said meetings by the Contractor and will be distributed to all parties as well as posted in all job offices/trailers etc.

10.2 SAFETY OF PERSONS AND PROPERTY

Add the following Section:

10.2.4.1 As required in the Hazardous Chemical Act of June 1984, all vendors supplying any material that may be defined as hazardous must provide Material Safety Data Sheets for those products. Any chemical product should be considered hazardous if it has a caution warning on the label relating to a potential physical or health hazard, if it is known to be present in the work place, and if employees may be exposed under normal conditions or in foreseeable emergency situations. Material Safety Data Sheets shall be provided directly to the Owner, along with the shipping slips that include those products.

10.2.5 Strike the second sentence in its entirety.

10.3 HAZARDOUS MATERIALS AND SUBSTANCES

10.3.3 Strike Section 10.3.3 in its entirety.

10.3.4 Insert "hazardous" in the last sentence after "handling of such".

10.3.6 Strike Section 10.3.6 in its entirety.

ARTICLE 11: INSURANCE AND BONDS

11.1 CONTRACTOR'S INSURANCE AND BONDS

11.1.1 Strike "Owner" from the third sentence.

11.2 OWNER'S LIABILITY INSURANCE

Strike 11.2 in its entirety, except that in the case of school projects in which case Section 11.2 shall remain.

11.3 WAIVERS OF SUBROGATION

Delete Section 11.3 in its entirety

11.4 LOSS OF USE, BUSINESS INTERRUPTION, AND DELAY IN COMPLETION
INSURANCE

Delete Section 11.4 in its entirety

ARTICLE 12: UNCOVERING AND CORRECTION OF WORK

12.2.2 AFTER SUBSTANTIAL COMPLETION

Add the following Section:

“12.2.2.1.1 At any time during the progress of the Work, or in any case where the nature of the defects will be such that it is not expedient to have corrected, the Owner, at its option, will have the right to deduct such sum, or sums, of money from the amount of the Contract as it considers justified to adjust the difference in value between the non-conforming work and that required under contract including any damage to the structure.”

12.2.2.1 Strike all references to “one year” or “one-year” and replace with “two years”.

12.2.2.2 Strike “one-year” and replace with “two years”.

12.2.2.3 Strike “one-year” and replace with “two years”.

12.2.5 Strike “one-year” and replaced with “two years”.

ARTICLE 13: MISCELLANEOUS PROVISIONS

13.1 GOVERNING LAW

Strike the last sentence.

13.4 TESTS AND INSPECTIONS

13.4.1 Strike the last sentence and replace with the following:

“The Owner shall pay for tests, inspections, or approvals where building codes or applicable laws or regulations prohibit the Owner from delegating their cost to the Contractor.”

13.5 INTEREST

Strike “the date payment is due at such rate as the parties may agree upon in writing or, in the absence thereof, at the legal rate prevailing from time to time at the place where the Project is located” and replace with “30 days of presentment of the authorized Certificate of Payment at the annual rate of 12% or 1% per month.”

Insert the following Section:

“13.6 CONFLICTS WITH FEDERAL STATUTES OR REGULATIONS

13.6.1 If any provision, specifications or requirement of the Contract Documents conflict or is inconsistent with any statute, law or regulation of the government of the United State of America, the Contractor shall notify the Architect and Owner immediately upon discovery.”

ARTICLE 14: TERMINATION OR SUSPENSION OF THE CONTRACT

14.1 TERMINATION BY THE CONTRACTOR

14.1.1.4 Insert “, upon the Contractors’ request,” after “furnish to the Contractor”.

14.1.3 Strike “and profit on Work not executed, and” after “as well as reasonable overhead” and replace with “, profit, and reasonable”

14.3 SUSPENSION BY OWNER FOR CONVENIENCE

14.3.2 Strike "Adjustment of the Contract Sum shall include profit".

14.4 TERMINATION BY THE OWNER FOR CONVENIENCE

14.4.3 Strike Section 14.4.3 in its entirety and replace with the following:

"In case of such termination for the Owner's convenience, the Contractor shall be entitled to receive payment for Work executed, and reasonable costs incurred by reason of such termination along with reasonable overhead."

ARTICLE 15: CLAIMS AND DISPUTES

15.1 CLAIMS

15.1.2 TIME LIMITS ON CLAIMS

Strike the last sentence.

15.1.3 NOTICE OF CLAIM

Strike all references to "21" and replace with "45".

15.1.5 CLAIMS FOR ADDITIONAL COSTS

Strike the first sentence and replace with the following:

"Contractor shall not proceed to execute any portion of the Work that is subject to the Claim without prior approval of the costs or method of payment for the costs associated with the Claim as determined by the Architect and approved by the Owner."

15.1.7 WAIVER OF CLAIMS FOR CONSEQUENTIAL DAMAGES

Strike Section 15.1.7 in its entirety.

15.2 INITIAL DECISION

15.2.1 Strike "and binding dispute resolution" in the fourth sentence and replace with "or any and all remedies at law or in equity".

15.2.5 Strike Section 15.2.5 in its entirety and replace with the following:

"The Architect will approve or reject Claims by written decision, which shall state the reasons therefore and shall notify the parties of any change in the Contract Sum or Contract Time or both. The approval or rejection of a Claim by the Architect shall be subject to mediation and any or all remedies at law or in equity."

15.2.6 Strike Section 15.2.6 and its sub-Sections in their entirety.

15.3 MEDIATION

15.3.1 Strike "binding dispute resolution" and replace with "any or all remedies at law or in equity".

- 15.3.2 Strike “, shall be administered by the American Arbitration Association in accordance with its Construction Industry Mediation Procedure in effect on the date of the Agreement,” in the first sentence.
- 15.3.2 Strike all references to “binding dispute resolution” and replace with “any or all remedies at law and in equity”.
- 15.3.3 Strike Section 15.3.3 in its entirety.
- 15.4 ARBITRATION
Strike Section 15.4 and its Subsections in their entirety.

END OF SECTION

NOT FOR BIDDING PURPOSES

SECTION 00 73 46
WAGE DETERMINATION SCHEDULE

The Delaware Department of Labor Division of Industrial Affairs has established the category and associated prevailing wage rate for this project. The project approved prevailing wage rate determination schedule follows:

NOT FOR BIDDING PURPOSES

STATE OF DELAWARE
DEPARTMENT OF LABOR
DIVISION OF INDUSTRIAL AFFAIRS
OFFICE OF LABOR LAW ENFORCEMENT
PHONE: (302) 318-2769

Mailing Address:
252 Chapman Road
Suite 210
Newark, DE 19702

Located at:
252 Chapman Road
Suite 210
Newark, DE 19702

PREVAILING WAGES FOR BUILDING CONSTRUCTION EFFECTIVE MARCH 13, 2026

CLASSIFICATION	NEW CASTLE	KENT	SUSSEX
ASBESTOS WORKERS	30.70	31.78	55.01
BOILERMAKERS	91.87	96.81	68.52
BRICKLAYERS	68.29	68.29	68.29
CARPENTERS	64.06	64.06	52.30
CEMENT FINISHERS	96.91	68.92	53.44
ELECTRICAL LINE WORKERS	61.02	52.34	39.90
ELECTRICIANS	86.87	86.87	86.87
ELEVATOR CONSTRUCTORS	121.74	86.57	109.37
GLAZIERS	88.42	88.42	76.04
INSULATORS	71.54	71.54	71.54
IRON WORKERS	79.33	79.33	79.33
LABORERS	59.65	59.65	59.65
MILLWRIGHTS	91.00	91.00	73.10
PAINTERS	61.53	61.53	61.53
PILEDRIVERS	93.37	52.83	42.72
PLASTERERS	40.06	40.06	29.69
PLUMBERS/PIPEFITTERS/STEAMFITTERS	82.05	85.29	78.26
POWER EQUIPMENT OPERATORS	85.29	85.29	85.29
ROOFERS-COMPOSITION	36.41	31.28	33.64
ROOFERS-SHINGLE/SLATE/TILE	24.68	29.36	23.08
SHEET METAL WORKERS	87.84	87.84	87.84
SOFT FLOOR LAYERS	63.69	63.69	50.43
SPRINKLER FITTERS	77.63	77.63	77.63
TERRAZZO/MARBLE/TILE FNRS	73.75	73.75	84.10
TERRAZZO/MARBLE/TILE STRS	81.93	81.93	93.27
TRUCK DRIVERS	58.41	36.83	28.66

CERTIFIED: 6/11/26

BY: [Signature] For Fran Chudzick
ADMINISTRATOR, OFFICE OF LABOR LAW ENFORCEMENT

NOTE: THESE RATES ARE PROMULGATED AND ENFORCED PURSUANT TO THE PREVAILING WAGE REGULATIONS ADOPTED BY THE DEPARTMENT OF LABOR ON APRIL 3, 1992.

CLASSIFICATIONS OF WORKERS ARE DETERMINED BY THE DEPARTMENT OF LABOR. ASSISTANCE IN CLASSIFYING WORKERS, OR FOR A COPY OF THE REGULATIONS CLASSIFICATIONS, PHONE (302) 318-2769.

NON-REGISTERED APPRENTICES MUST BE PAID THE MECHANIC'S RATE.

PROJECT: DSP Crime Lab HVAC Unit Replacement, Kent County



**SECTION 00 81 13
GENERAL REQUIREMENTS**

TABLE OF ARTICLES

1. GENERAL
2. OWNER
3. CONTRACTOR
4. ADMINISTRATION OF THE CONTRACT
5. SUBCONTRACTORS
6. CONSTRUCTION BY OWNER OR SEPARATE CONTRACTORS
7. CHANGES IN THE WORK
8. TIME
9. PAYMENTS AND COMPLETION
10. PROTECTION OF PERSONS AND PROPERTY
11. INSURANCE AND BONDS
12. UNCOVERING AND CORRECTION OF WORK
13. MISCELLANEOUS PROVISIONS
14. TERMINATION OR SUSPENSION OF THE CONTRACT

ARTICLE 1: GENERAL

1.1 CONTRACT DOCUMENTS

1.1.1 The intent of the Contract Documents is to include all items necessary for the proper execution and completion of the Work by the Contractor. The Contract Documents are complementary and what is required by one shall be as binding as if required by all. Performance by the Contractor shall be required to an extent consistent with the Contract Documents and reasonably inferable from them as being necessary to produce the intended results.

1.1.2 Work including material purchases shall not begin until the Contractor is in receipt of a bonafide State of Delaware Purchase Order. Any work performed or material purchases prior to the issuance of the Purchase Order is done at the Contractor's own risk and cost.

1.2 EQUALITY OF EMPLOYMENT OPPORTUNITY ON PUBLIC WORKS

1.2.1 For Public Works Projects financed in whole or in part by state appropriation the Contractor agrees that during the performance of this contract:

1. The Contractor will not discriminate against any employee or applicant for employment because of race, creed, sex, color, sexual orientation, gender identity or national origin. The Contractor will take positive steps to ensure that applicants are employed and that employees are treated during employment without regard to their race, creed, sex, color, sexual orientation, gender identity or national origin. Such action shall include, but not be limited to, the following: employment, upgrading, demotion or transfer; recruitment or recruitment advertising; layoff or termination; rates or pay or other forms of compensation; and selection for training, including apprenticeship. The Contractor agrees to post in conspicuous places available to employees and applicants for employment notices to be provided by the contracting agency setting forth this nondiscrimination clause.
2. The Contractor will, in all solicitations or advertisements for employees placed by or on behalf of the Contractor, state that all qualified applicants will receive consideration for employment without regard to race, creed, sex, color, sexual orientation, gender identity or national origin."

ARTICLE 2: OWNER

(NO ADDITIONAL GENERAL REQUIREMENTS – SEE SUPPLEMENTARY GENERAL CONDITIONS)

ARTICLE 3: CONTRACTOR

3.1 Schedule of Values: The successful Bidder shall within twenty (20) days after receiving notice to proceed with the work, furnish to the Owner a complete schedule of values on the various items comprising the work.

3.2 Subcontracts: Upon approval of Subcontractors, the Contractor shall award their Subcontracts as soon as possible after the signing of their own contract and see that all material, their own and those of their Subcontractors, are promptly ordered so that the work will not be delayed by failure of materials to arrive on time.

- 3.3 Before commencing any work or construction, the General Contractor is to consult with the Owner as to matters in connection with access to the site and the allocation of Ground Areas for the various features of hauling, storage, etc.
- 3.4 The Contractor shall supervise and direct the Work, using the Contractor's best skill and attention. The Contractor shall be solely responsible for and have control over construction means, methods, techniques, sequences and procedures and for coordinating all portions of the Work under the Contract, unless the Contract Documents give other specific instructions.
- 3.5 The Contractor shall enforce strict discipline and good order among the Contractor's employees and other persons carrying out the Contract. The Contractor shall not permit employment of unfit persons or persons not skilled in tasks assigned to them.
- 3.6 The Contractor warrants to the Owner that materials and equipment furnished will be new and of good quality, unless otherwise permitted, and that the work will be free from defects and in conformance with the Contract Documents. Work not conforming to these requirements, including substitutions not properly approved, may be considered defective. If required by the Owner, the Contractor shall furnish evidence as to the kind and quality of materials and equipment provided.
- 3.7 Unless otherwise provided, the Contractor shall pay all sales, consumer, use and other similar taxes, and shall secure and pay for required permits, fees, licenses, and inspections necessary for proper execution of the Work.
- 3.8 The Contractor shall comply with and give notices required by laws, ordinances, rules, regulations, and lawful orders of public authorities bearing on performance of the Work. The Contractor shall promptly notify the Owner if the Drawings and Specifications are observed to be at variance therewith.
- 3.9 The Contractor shall be responsible to the Owner for the acts and omissions of the Contractor's employees, Subcontractors and their agents and employees, and other persons performing portions of the Work under contract with the Contractor.
- 3.10 The Contractor shall keep the premises and surrounding area free from accumulation of waste materials or rubbish caused by operations under the Contract. At completion of the Work the Contractor shall remove from and about the Project all waste materials, rubbish, the Contractor's tools, construction equipment, machinery and surplus materials. The Contractor shall be responsible for returning all damaged areas to their original conditions.
- 3.11 STATE LICENSE AND TAX REQUIREMENTS
- 3.11.1 Each Contractor and Subcontractor shall be licensed to do business in the State of Delaware and shall pay all fees and taxes due under State laws. In conformance with Section 2503, Chapter 25, Title 30, Delaware Code, "the Contractor shall furnish the Delaware Department of Finance within ten (10) days after entering into any contract with a contractor or subcontractor not a resident of this State, a statement of total value of such contract or contracts together with the names and addresses of the contracting parties."
- 3.12 The Contractor shall comply with all requirements set forth in Section 6962, Chapter 69, Title 29 of the Delaware Code.
- 3.13 During the contract Work, the Contractor and each Subcontractor, shall implement an Employee Drug Testing Program in accordance with OMB Regulation 4104 -

"Regulations for the Drug Testing of Contractor and Subcontractor Employees Working on "Large Public Works Projects". "Large Public Works" is based upon the current threshold required for bidding Public Works as set by the Purchasing and Contracting Advisory Council.

ARTICLE 4: ADMINISTRATION OF THE CONTRACT

4.1 CONTRACT SURETY

4.1.1 PERFORMANCE BOND AND LABOR AND MATERIAL PAYMENT BOND

4.1.2 All bonds will be required as follows unless specifically waived elsewhere in the Bidding Documents.

4.1.3 Contents of Performance Bonds – The bond shall be in the form approved by the Office of Management and Budget. The bond shall be conditioned upon the faithful compliance and performance by the successful bidder of each and every term and condition of the contract and the proposal, plans, specifications, and bid documents thereof. Each term and condition shall be met at the time and in the manner prescribed by the Contract, Bid documents and the specifications, including the payment in full to every person furnishing material or performing labor in the performance of the Contract, of all sums of money due the person for such labor and material. (The bond shall also contain the successful bidder's guarantee to indemnify and save harmless the State and the agency from all costs, damages and expenses growing out of or by reason of the Contract in accordance with the Contract.)

4.1.4 Invoking a Performance Bond – The agency may, when it considers that the interest of the State so requires, cause judgement to be confessed upon the bond.

4.1.5 Within twenty (20) days after the date of notice of award of contract, the Bidder to whom the award is made shall furnish a Performance Bond and Labor and Material Payment Bond, each equal to the full amount of the Contract price to guarantee the faithful performance of all terms, covenants and conditions of the same. The bonds are to be issued by an acceptable Bonding Company licensed to do business in the State of Delaware and shall be issued in duplicate.

4.1.6 Performance and Payment Bonds shall be maintained in full force (warranty bond) for a period of two (2) years after the date of the Certificate for Final Payment. The Performance Bond shall guarantee the satisfactory completion of the Project and that the Contractor will make good any faults or defects in his work which may develop during the period of said guarantees as a result of improper or defective workmanship, material or apparatus, whether furnished by themselves or their Sub-Contractors. The Payment Bond shall guarantee that the Contractor shall pay in full all persons, firms or corporations who furnish labor or material or both labor and material for, or on account of, the work included herein. The bonds shall be paid for by this Contractor. The Owner shall have the right to demand that the proof parties signing the bonds are duly authorized to do so.

4.2 FAILURE TO COMPLY WITH CONTRACT

4.2.1 If any firm entering into a contract with the State, or Agency that neglects or refuses to perform or fails to comply with the terms thereof, the Agency which signed the Contract may terminate the Contract and proceed to award a new contract in accordance with this Chapter 69, Title 29 of the Delaware Code or may require the Surety on the Performance Bond to complete the Contract in accordance with the terms of the Performance Bond.

Nothing herein shall preclude the Agency from pursuing additional remedies as otherwise provided by law.

NOT FOR BIDDING PURPOSES

4.3 CONTRACT INSURANCE AND CONTRACT LIABILITY

4.3.1 In addition to the bond requirements stated in the Bid Documents, each successful Bidder shall purchase adequate insurance for the performance of the Contract and, by submission of a Bid, agrees to indemnify and save harmless and to defend all legal or equitable actions brought against the State, any Agency, officer and/or employee of the State, for and from all claims of liability which is or may be the result of the successful Bidder's actions during the performance of the Contract.

4.3.2 The purchase or nonpurchase of such insurance or the involvement of the successful Bidder in any legal or equitable defense of any action brought against the successful Bidder based upon work performed pursuant to the Contract will not waive any defense which the State, its agencies and their respective officers, employees and agents might otherwise have against such claims, specifically including the defense of sovereign immunity, where applicable, and by the terms of this section, the State and all agencies, officers and employees thereof shall not be financially responsible for the consequences of work performed, pursuant to said contract.

4.4 RIGHT TO AUDIT RECORDS

4.4.1 The Owner shall have the right to audit the books and records of a Contractor or any Subcontractor under any Contract or Subcontract to the extent that the books and records relate to the performance of the Contract or Subcontract.

4.4.2 Said books and records shall be maintained by the Contractor for a period of seven (7) years from the date of final payment under the Prime Contract and by the Subcontractor for a period of seven (7) years from the date of final payment under the Subcontract.

ARTICLE 5: SUBCONTRACTORS

5.1 SUBCONTRACTING REQUIREMENTS

5.1.1 All contracts for the construction, reconstruction, alteration or repair of any public building (not a road, street or highway) shall be subject to the following provisions:

1. A contract shall be awarded only to a Bidder whose Bid is accompanied by a statement containing, for each Subcontractor category, the name and address (city or town and State only – street number and P.O. Box addresses not required) of the subcontractor whose services the Bidder intends to use in performing the Work and providing the material for such Subcontractor category.
2. A Bid will not be accepted nor will an award of any Contract be made to any Bidder which, as the Prime Contractor, has listed itself as the Subcontractor for any Subcontractor unless:
 - A. It has been established to the satisfaction of the awarding Agency that the Bidder has customarily performed the specialty work of such Subcontractor category by artisans regularly employed by the Bidder's firm;
 - B. That the Bidder is duly licensed by the State to engage in such specialty work, if the State requires licenses; and

- C. That the Bidder is recognized in the industry as a bona fide Subcontractor or Contractor in such specialty work and Subcontractor category.

- 5.1.2 The decision of the awarding Agency as to whether a Bidder who list itself as the Subcontractor for a Subcontractor category shall be final and binding upon all Bidders, and no action of any nature shall lie against any awarding agency or its employees or officers because of its decision in this regard.
- 5.1.3 After such a Contract has been awarded, the successful Bidder shall not substitute another Subcontractor for any Subcontractor whose name was set forth in the statement which accompanied the Bid without the written consent of the awarding Agency.
- 5.1.4 No Agency shall consent to any substitution of Subcontractors unless the Agency is satisfied that the Subcontractor whose name is on the Bidders accompanying statement:
- A. Is unqualified to perform the work required;
 - B. Has failed to execute a timely reasonable Subcontract;
 - C. Has defaulted in the performance on the portion of the work covered by the Subcontract; or
 - D. Is no longer engaged in such business.
- 5.1.5 Should a Bidder be awarded a contract, such successful Bidder shall provide to the agency the taxpayer identification license numbers of such subcontractors. Such numbers shall be provided on the later of the date on which such subcontractor is required to be identified or the time the contract is executed. The successful Bidder shall provide to the agency to which it is contracting within 30 days of entering into such public works contract, copies of all Delaware Business licenses of subcontractors and/or independent contractors that will perform work for such public works contract. However, if a subcontractor or independent contractor is hired or contracted more than 20 days after the Bidder entered the public works contract the Delaware Business license of such subcontractor or independent contractor shall be provided to the agency within 10 days of being contracted or hired.
- 5.1.6 The Contractor may employ additional Subcontractors on the jobsite only after submitting a copy of the Subcontractor's Employee Drug Testing Program to the Owner for approval. A Contractor or Subcontractor shall not commence work until the Owner has concluded its review and determined that the submitted Employee Drug Testing Program complies with OMB Regulation 4104.

5.2 PENALTY FOR SUBSTITUTION OF SUBCONTRACTORS

- 5.2.1 Should the Contractor fail to utilize any or all of the Subcontractors in the Contractor's Bid statement in the performance of the Work on the public bidding, the Contractor shall be penalized in the amount of (project specific amount*). The Agency may determine to deduct payments of the penalty from the Contractor or have the amount paid directly to the Agency. Any penalty amount assessed against the Contractor may be remitted or refunded, in whole or in part, by the Agency awarding the Contract, only if it is established to the satisfaction of the Agency that the Subcontractor in question has defaulted or is no longer engaged in such business. No claim for the remission or refund of any penalty shall be granted unless an application is filed within one year after the liability of the successful Bidder accrues. All

penalty amounts assessed and not refunded or remitted to the contractor shall be reverted to the State.

*one (1) percent of contract amount not to exceed \$10,000

5.3 ASBESTOS ABATEMENT

5.3.1 The selection of any Contractor to perform asbestos abatement for State-funded projects shall be approved by the Office of Management and Budget, Division of Facilities Management pursuant to Chapter 78 of Title 16.

5.4 STANDARDS OF CONSTRUCTION FOR THE PROTECTION OF THE PHYSICALLY HANDICAPPED

5.4.1 All Contracts shall conform with the standard established by the Delaware Architectural Accessibility Board unless otherwise exempted by the Board.

5.5 CONTRACT PERFORMANCE

5.5.1 Any firm entering into a Public Works Contract that neglects or refuses to perform or fails to comply with its terms, the Agency may terminate the Contract and proceed to award a new Contract or may require the Surety on the Performance Bond to complete the Contract in accordance with the terms of the Performance Bond.

ARTICLE 6: CONSTRUCTION BY OWNER OR SEPARATE CONTRACTORS

6.1 The Owner reserves the right to simultaneously perform other construction or operations related to the Project with the Owner's own forces, and to award separate contracts in connection with other portions of the Project or other Projects at the same site.

6.2 The Contractor shall afford the Owner and other Contractors reasonable opportunity for access and storage of materials and equipment, and for the performance of their activities, and shall connect and coordinate their activities with other forces as required by the Contract Documents.

ARTICLE 7: CHANGES IN THE WORK

7.1 The Owner, without invalidating the Contract, may order changes in the Work consisting of Additions, Deletions, Modifications or Substitutions, with the Contract Sum and Contract completion date being adjusted accordingly. Such changes in the Work shall be authorized by written Change Order signed by the Professional, as the duly authorized agent, the Contractor and the Owner.

7.2 The Contract Sum and Contract Completion Date shall be adjusted only by a fully executed Change Order.

7.3 The additional cost, or credit to the Owner resulting from a change in the Work shall be by mutual agreement of the Owner, Contractor and the Architect. In all cases, this cost or credit shall be based on the 'DPE' wages required and the "invoice price" of the materials/equipment needed.

7.3.1 "DPE" shall be defined to mean "direct personnel expense". Direct payroll expense includes prevailing wage rates plus a maximum multiplier of 1.35 times DPE. For example, if the prevailing wage rate is \$50/hour, the DPE would be \$67.50/hour (50 x 1.35).

- 7.3.2 "Invoice price" of materials/equipment shall be defined to mean the actual cost of materials and/or equipment that is paid by the Contractor, (or subcontractor), to a material distributor, direct factory vendor, store, material provider, or equipment leasing entity. Rates for equipment that is leased and/or owned by the Contractor or subcontractor(s) shall not exceed those listed in the latest version of the "Means Building Construction Cost Data" publication.
- 7.3.3 In addition to the above:
- 7.3.3.1 The General Contractor is allowed a fifteen percent (15%) markup for overhead and profit for additional work performed by the General Contractor's own forces
- 7.3.3.2 For additional subcontractor work, the Subcontractor is allowed a fifteen (15) percent overhead and profit on change order work above and beyond the direct costs stated previously. To this amount, the General Contractor will be allowed a mark-up not exceeding seven- and one-half percent (7.5%) on the subcontractor's work.
- 7.3.3.3 Where the Third Tier Contractor is going to be completing the additional work, the Third-Tier contractor will be allowed a markup of fifteen percent (15%) overhead and profit on changes order work above and beyond the direct costs stated previously. To this amount, the Subcontractor will be allowed a markup not to exceed seven and one-half percent (7.5%) on the Third-Tier Contractor's work and the General Contractor will be allowed a markup not to exceed seven and one-half percent (7.5%) of the amount of the Subcontractor's markup.
- 7.3.3.4 No additional costs shall be allowed for changes related to the Contractor's onsite superintendent/staff, or project manager, unless a change in the work changes the project duration and is identified by the CPM schedule. There will be no other costs associated with the change order.
- 7.3.3.5 These markups shall include all costs including, but not limited to: overhead, profit, bonds, insurance, supervision, etc.

ARTICLE 8: TIME

- 8.1 Time limits, if any, are as stated in the Project Manual. By executing the Agreement, the Contractor confirms that the stipulated limits are reasonable, and that the Work will be completed within the anticipated time frame.
- 8.2 If progress of the Work is delayed at any time by changes ordered by the Owner, by labor disputes, fire, unusual delay in deliveries, abnormal adverse weather conditions, unavoidable casualties or other causes beyond the Contractor's control, the Contract Time shall be extended for such reasonable time as the Owner may determine.
- 8.3 Any extension of time beyond the date fixed for completion of the construction and acceptance of any part of the Work called for by the Contract, or the occupancy of the building by the Owner, in whole or in part, previous to the completion shall not be deemed a waiver by the Owner of his right to annul or terminate the Contract for abandonment or delay in the matter provided for, nor relieve the Contractor of full responsibility
- 8.4 **SUSPENSION AND DEBARMENT**

- 8.4.1 Per Section 6962(d)(14), Title 29, Delaware Code, "Any Contractor who fails to perform a public works contract or complete a public works project within the time schedule established by the Agency in the Invitation To Bid, may be subject to Suspension or Debarment for one or more of the following reasons: a) failure to supply the adequate labor supply ratio for the project; b) inadequate financial resources; or, c) poor performance on the Project."
- 8.4.2 "Upon such failure for any of the above stated reasons, the Agency that contracted for the public works project may petition the Director of the Office of Management and Budget for Suspension or Debarment of the Contractor. The Agency shall send a copy of the petition to the Contractor within three (3) working days of filing with the Director. If the Director concludes that the petition has merit, the Director shall schedule and hold a hearing to determine whether to suspend the Contractor, debar the Contractor or deny the petition. The Agency shall have the burden of proving, by a preponderance of the evidence, that the Contractor failed to perform or complete the public works project within the time schedule established by the Agency and failed to do so for one or more of the following reasons: a) failure to supply the adequate labor supply ratio for the project; b) inadequate financial resources; or, c) poor performance on the project. Upon a finding in favor of the Agency, the Director may suspend a Contractor from Bidding on any project funded, in whole or in part, with public funds for up to 1 year for a first offense, up to 3 years for a second offense and permanently debar the Contractor for a third offense. The Director shall issue a written decision and shall send a copy to the Contractor and the Agency. Such decision may be appealed to the Superior Court within thirty (30) days for a review on the record."
- 8.5 RETAINAGE
- 8.5.1 Per Section 6962(d)(5) a.3 Title 29, Delaware Code: The Agency may at the beginning of each public works project establish a time schedule for the completion of the project. If the project is delayed beyond the completion date due to the Contractor's failure to meet their responsibilities, the Agency may forfeit, at its discretion, all or part of the Contractor's retainage.
- 8.5.2 This forfeiture of retainage also applies to the timely completion of the punchlist. A punchlist will only be prepared upon the mutual agreement of the Owner, Architect and Contractor. Once the punchlist is prepared, all three parties will by mutual agreement, establish a schedule for its completion. Should completion of the punchlist be delayed beyond the established date due to the Contractor's failure to meet their responsibilities, the Agency may hold permanently, at its discretion, all or part of the Contractor's retainage.

ARTICLE 3: PAYMENTS AND COMPLETION

- 9.1 APPLICATION FOR PAYMENT
- 9.1.1 Applications for payment shall be made upon AIA Document G702. There will be a five percent (5%) retainage on all Contractor's monthly invoices until completion of the project. This retainage may become payable upon receipt of all required closeout documentation, provided all other requirements of the Contract Documents have been met.
- 9.1.2 A date will be fixed for the taking of the monthly account of work done. Upon receipt of Contractor's itemized application for payment, such application will be audited, modified, if found necessary, and approved for the amount. Statement shall be submitted to the Owner.

- 9.1.3 Section 6516, Title 29 of the Delaware Code annualized interest is not to exceed 12% per annum beginning thirty (30) days after the "presentment" (as opposed to the date) of the invoice.
- 9.2 PARTIAL PAYMENTS
- 9.2.1 Any public works Contract executed by any Agency may provide for partial payments at the option of the Owner with respect to materials placed along or upon the sites or stored at secured locations, which are suitable for use in the performance of the contract.
- 9.2.2 When approved by the agency, partial payment may include the values of tested and acceptable materials of a nonperishable or noncontaminative nature which have been produced or furnished for incorporation as a permanent part of the work yet to be completed, provided acceptable provisions have been made for storage.
- 9.2.2.1 Any allowance made for materials on hand will not exceed the delivered cost of the materials as verified by invoices furnished by the Contractor, nor will it exceed the contract bid price for the material complete in place.
- 9.2.3 If requested by the Agency, receipted bills from all Contractors, Subcontractors, and material, men, etc., for the previous payment must accompany each application for payment. Following such a request, no payment will be made until these receipted bills have been received by the Owner.
- 9.3 SUBSTANTIAL COMPLETION
- 9.3.1 When the building has been made suitable for occupancy, but still requires small items of miscellaneous work, the Owner will determine the date when the project has been substantially completed.
- 9.3.2 If, after the Work has been substantially completed, full completion thereof is materially delayed through no fault of the Contractor, and without terminating the Contract, the Owner may make payment of the balance due for the portion of the Work fully completed and accepted. Such payment shall be made under the terms and conditions governing final payment that it shall not constitute a waiver of claims.
- 9.3.3 On projects where commissioning is included, the commissioning work as defined in the specifications must be complete prior to the issuance of substantial completion.
- 9.4 FINAL PAYMENT
- 9.4.1 Final payment, including the five percent (5%) retainage if determined appropriate, shall be made within thirty (30) days after the Work is fully completed and the Contract fully performed and provided that the Contractor has submitted the following closeout documentation (in addition to any other documentation required elsewhere in the Contract Documents):
- 9.4.1.1 Evidence satisfactory to the Owner that all payrolls, material bills, and other indebtedness connected with the work have been paid,
- 9.4.1.2 An acceptable RELEASE OF LIENS,
- 9.4.1.3 Copies of all applicable warranties,

- 9.4.1.4 As-built drawings,
- 9.4.1.5 Operations and Maintenance Manuals,
- 9.4.1.6 Instruction Manuals,
- 9.4.1.7 Consent of Surety to final payment.
- 9.4.1.8 The Owner reserves the right to retain payments, or parts thereof, for its protection until the foregoing conditions have been complied with, defective work corrected and all unsatisfactory conditions remedied.

ARTICLE 10: PROTECTION OF PERSONS AND PROPERTY

- 10.1 The Contractor shall be responsible for initiating, maintaining, and supervising all safety precautions and programs in connection with the performance of the Contract. The Contractor shall take all reasonable precautions to prevent damage, injury or loss to: workers, persons nearby who may be affected, the work, materials and equipment to be incorporated, and existing property at the site or adjacent thereto. The Contractor shall give notices and comply with applicable laws ordinances, rules regulations, and lawful orders of public authorities bearing on the safety of persons and property and their protection from injury, damage, or loss. The Contractor shall promptly remedy damage and loss to property at the site caused in whole or in part by the Contractor, a Subcontractor, or anyone directly or indirectly employed by any of them, or by anyone for whose acts they may be liable.
- 10.2 The Contractor shall notify the Owner in the event any previously unknown hazardous material such as PCBs, asbestos, etc. is encountered on the project. The Owner will arrange with a qualified specialist for the identification, testing, removal, handling and protection against exposure or environmental pollution, to comply with applicable regulation laws and ordinances. The Contractor and Architect will not be required to participate in or to perform this operation. Upon completion of this work, the Owner will notify the Contractor and Architect in writing the area has been cleared and approved by the authorities in order for the work to proceed. The Contractor shall attach documentation from the authorities of said approval to the closeout documents to be submitted at the end of the project.
- 10.2.1 Any activities with the potential to disturb lead-based materials should be performed by the Contractor in accordance with OSHA regulations pertaining to Lead in Construction, 29 CFR 1926.62, Lead.
- 10.2.1.1 The Contractor shall notify the Owner in the event they encounter previously unknown material that they suspect may contain "lead". The Owner will arrange with a qualified specialist for identification and testing and advise the Contractor of the results. In the case that testing identifies potential lead based materials, the contractor shall continue performance of the work that has the potential to disturb associated in accordance with OSHA regulations pertaining to Lead in Construction, 29 CFR 1926.62, Lead.
- 10.3 As required in the Hazardous Chemical Information Act of June 1984, all vendors supplying any materials that may be defined as hazardous, must provide Material Safety Data Sheets for those products. Any chemical product should be considered hazardous if it has a warning caution on the label relating to a potential physical or health hazard, if it is known to be present in the work place, and if employees may be exposed under normal conditions or in any foreseeable emergency situation. Material Safety Data Sheets must be provided directly to the Owner along with the shipping slips that include those products.

- 10.4 The Contractor shall certify to the Owner that materials incorporated into the Work are free of all asbestos. This certification may be in the form of Material Safety Data Sheet (MSDS) provided by the product manufacturer for the materials used in construction, as specified or as provided by the Contractor.

ARTICLE 11: INSURANCE AND BONDS

- 11.1 The Contractor shall carry all insurance required by law, such as Unemployment Insurance, etc. The Contractor shall carry such insurance coverage as they desire on their own property such as a field office, storage sheds or other structures erected upon the project site that belong to them and for their own use. The Subcontractors involved with this project shall carry whatever insurance protection they consider necessary to cover the loss of any of their personal property, etc.
- 11.2 Upon being awarded the Contract, the Contractor shall obtain a minimum of two (2) copies of all required insurance certificates called for herein, and submit one (1) copy of each certificate, to the Owner, within 20 days of contract award.
- 11.3 Bodily Injury Liability and Property Damage Liability Insurance shall, in addition to the coverage included herein, include coverage for injury to or destruction of any property arising out of the collapse of or structural injury to any building or structure due to demolition work and evidence of these coverages shall be filed with and approved by the Owner.
- 11.4 The Contractor's Property Damage Liability Insurance shall, in addition to the coverage noted herein, include coverage on all real and personal property in their care, custody and control damaged in any way by the Contractor or their Subcontractors during the entire construction period on this project.
- 11.5 Builders Risk (including Standard Extended Coverage Insurance) on the existing building during the entire construction period, may be provided by the Contractor under this contract. The Owner shall insure the existing building and all of its contents and all this new alteration work under this contract during entire construction period for the full insurable value of the entire work at the site. Note, however, that the Contractor and their Subcontractors shall be responsible for insuring building materials (installed and stored) and their tools and equipment whenever in use on the project, against fire damage, theft, vandalism, etc.
- 11.6 Certificates of the insurance company or companies stating the amount and type of coverage, terms of policies, etc., shall be furnished to the Owner, within 20 days of contract award.
- 11.7 The Contractor shall, at their own expense, (in addition to the above) carry the following forms of insurance:

11.7.1 Contractor's Contractual Liability Insurance

Minimum coverage to be:

Bodily Injury	\$1,000,000	for each occurrence
	\$3,000,000	aggregate
Property Damage	\$1,000,000	for each occurrence
	\$3,000,000	aggregate

11.7.2 Contractor's Protective Liability Insurance

Minimum coverage to be:

Bodily Injury	\$1,000,000 \$3,000,000	for each occurrence aggregate
Property Damage	\$1,000,000 \$3,000,000	for each occurrence aggregate

11.7.3 Automobile Liability Insurance

Minimum coverage to be:

Bodily Injury	\$1,000,000 \$1,000,000	for each person for each occurrence
Property Damage	\$500,000	per accident

11.7.4 Prime Contractor's and Subcontractors' policies shall include contingent and contractual liability coverage in the same minimum amounts as 11.7.1 above.

11.7.5 Workmen's Compensation (including Employer's Liability):

11.7.5.1 Minimum Limit on employer's liability to be as required by law.

11.7.5.2 Minimum Limit for all employees working at one site.

11.7.6 Certificates of Insurance must be filed with the Owner guaranteeing fifteen (15) days prior notice of cancellation, non-renewal, or any change in coverages and limits of liability shown as included on certificates.

11.7.7 Social Security Liability

11.7.7.1 With respect to all persons at any time employed by or on the payroll of the Contractor or performing any work for or on their behalf, or in connection with or arising out of the Contractor's business, the Contractor shall accept full and exclusive liability for the payment of any and all contributions or taxes or unemployment insurance, or old age retirement benefits, pensions or annuities now or hereafter imposed by the Government of the United States and the State or political subdivision thereof, whether the same be measured by wages, salaries or other remuneration paid to such persons or otherwise.

11.7.7.2 Upon request, the Contractor shall furnish Owner such information on payrolls or employment records as may be necessary to enable it to fully comply with the law imposing the aforesaid contributions or taxes.

11.7.7.3 If the Owner is required by law to and does pay any and/or all of the aforesaid contributions or taxes, the Contractor shall forthwith reimburse the Owner for the entire amount so paid by the Owner.

ARTICLE 12: UNCOVERING AND CORRECTION OF WORK

12.1 The Contractor shall promptly correct Work rejected by the Owner or failing to conform to the requirements of the Contract Documents, whether observed before or after Substantial Completion and whether or not fabricated, installed or completed, and shall correct any

Work found to be not in accordance with the requirements of the Contract Documents within a period of two years from the date of Substantial Completion, or by terms of an applicable special warranty required by the Contract Documents. The provisions of this Article apply to work done by Subcontractors as well as to Work done by direct employees of the Contractor.

- 12.2 At any time during the progress of the work, or in any case where the nature of the defects shall be such that it is not expedient to have them corrected, the Owner, at their option, shall have the right to deduct such sum, or sums, of money from the amount of the contract as they consider justified to adjust the difference in value between the defective work and that required under contract including any damage to the structure.

ARTICLE 13: MISCELLANEOUS PROVISIONS

13.1 CUTTING AND PATCHING

- 13.1.1 The Contractor shall be responsible for all cutting and patching. The Contractor shall coordinate the work of the various trades involved.

13.2 DIMENSIONS

- 13.2.1 All dimensions shown shall be verified by the Contractor by actual measurements at the project site. Any discrepancies between the drawings and specifications and the existing conditions shall be referred to the Owner for adjustment before any work affected thereby has been performed.

13.3 LABORATORY TESTS

- 13.3.1 Any specified laboratory tests of material and finished articles to be incorporated in the work shall be made by bureaus, laboratories or agencies approved by the Owner and reports of such tests shall be submitted to the Owner. The cost of the testing shall be paid for by the Contractor.

- 13.3.2 The Contractor shall furnish all sample materials required for these tests and shall deliver same without charge to the testing laboratory or other designated agency when and where directed by the Owner.

13.4 ARCHAEOLOGICAL EVIDENCE

- 13.4.1 Whenever, in the course of construction, any archaeological evidence is encountered on the surface or below the surface of the ground, the Contractor shall notify the authorities of the State Historic Preservation Office and suspend work in the immediate area for a reasonable time to permit those authorities, or persons designated by them, to examine the area and ensure the proper removal of the archaeological evidence for suitable preservation by the Division of Historical and Cultural Affairs.

13.5 GLASS REPLACEMENT AND CLEANING

- 13.5.1 The General Contractor shall replace without expense to the Owner all glass broken during the construction of the project. If job conditions warrant, at completion of the job the General Contractor shall have all glass cleaned and polished.

13.6 WARRANTY

- 13.6.1 For a period of two (2) years from the date of substantial completion, as evidenced by the date of final acceptance of the work, the contractor warrants that work performed under this contract conforms to the contract requirements and is free of any defect of equipment, material or workmanship performed by the contractor or any of his subcontractors or suppliers. However, manufacturer's warranties and guarantees, if for a period longer than two (2) years, shall take precedence over the above warranties. The contractor shall remedy, at his own expense, any such failure to conform or any such defect. The protection of this warranty shall be included in the Contractor's Performance Bond.

ARTICLE 14: TERMINATION OR SUSPENSION OF THE CONTRACT

- 14.1 If the Contractor defaults or persistently fails or neglects to carry out the Work in accordance with the Contract Documents or fails to perform a provision of the Contract, the Owner, after seven days written notice to the Contractor, may make good such deficiencies and may deduct the cost thereof from the payment then or thereafter due the Contractor. Alternatively, at the Owner's option, and the Owner may terminate the Contract and take possession of the site and of all materials, equipment, tools, and machinery thereon owned by the Contractor and may finish the Work by whatever method the Owner may deem expedient. If the costs of finishing the Work exceed any unpaid compensation due the Contractor, the Contractor shall pay the difference to the Owner.
- 14.2 "If the continuation of this Agreement is contingent upon the appropriation of adequate state, or federal funds, this Agreement may be terminated on the date beginning on the first fiscal year for which funds are not appropriated or at the exhaustion of the appropriation. The Owner may terminate this Agreement by providing written notice to the parties of such non-appropriation. All payment obligations of the Owner will cease upon the date of termination. Notwithstanding the foregoing, the Owner agrees that it will use its best efforts to obtain approval of necessary funds to continue the Agreement by taking appropriate action to request adequate funds to continue the Agreement."

END OF SECTION

00 81 14
EMPLOYEE DRUG TESTING REPORT FORM
Period Ending: _____

4104 Regulations for the Drug Testing of Contractor and Subcontractor Employees Working on Large Public Works Projects requires that Contractors and Subcontractors who work on Large Public Works Contracts funded all or in part with public funds maintain testing data that includes but is not limited to the data elements below.

Project Number: _____

Project Name: _____

Contractor/Subcontractor Name: _____

Contractor/Subcontractor Address: _____

Number of employees who worked on the jobsite during the report period: _____

Number of employees subject to random testing during the report period: _____

Number of Negative Results _____ Number of Positive Results _____

Action taken on employee(s) in response to a failed or positive random test:

Date: _____

This form is not required to be submitted to the Owner. Included as a reference to show information required to be maintained by the Contractor. The Owner shall have the right to periodically audit all Contractor and Subcontractor test results at the Contractor's or Subcontractor's offices (or by other means to make the data available for inspection by the Owner).

**EMPLOYEE DRUG TESTING
REPORT OF POSITIVE RESULTS**

4104 Regulations for the Drug Testing of Contractor and Subcontractor Employees Working on Large Public Works Projects requires that Contractors and Subcontractors who work on Large Public Works Contracts funded all or in part with public funds to notify the Owner in writing of a positive random drug test.

Project Number: _____

Project Name: _____

Contractor/Subcontractor Name: _____

Contractor/Subcontractor Address: _____

Name of employee with positive test result: _____

Last 4 digits of employee SSN: _____

Date test results received: _____

Action taken on employee in response to a positive test result:

Authorized Representative of Contractor/Subcontractor: _____
(typed or printed)

Authorized Representative of Contractor/Subcontractor: _____
(signature)

Date: _____

This form shall be sent by mail to the Owner within 24 hours of receipt of test results.

Enclose this test results form in a sealed envelope with the notation "Drug Testing Form – DO NOT OPEN" on the face thereof and place in a separate mailing envelope.

**AFFIDAVIT OF
CRAFT TRAINING COMPLIANCE**

We, the contractor, hereby certify that we and all applicable subcontractors will abide by the contractor and subcontractor craft training requirements outlined below for the duration of the contract. Craft training must be provided by a contractor and/or subcontractor for each craft on a project for which there are Delaware Department of Labor approved and registered training programs or, if the contractor and/or subcontractor meets the requirements under Title 29, Chapter 69, Section 6960A.(b)(1)c.1.-3., payment may be made in accordance with Title 29, Chapter 69, Section 6960A.(b)(1)d. A list of crafts for which there are approved and registered training programs is maintained by the Delaware Department of Labor and can be found at:

<https://laborfiles.delaware.gov/main/det/apprenticeship/DE%20Craft%20Training%20Occupation%20List%20Effective%20March%201%202022.pdf>. If you have questions regarding craft training programs, please submit all questions in writing to the Delaware Department of Labor at: apprenticeship@delaware.gov. ***This Affidavit of Craft Training Compliance must be submitted prior to contract execution.***

In accordance with Title 29, Chapter 69, Section 6960A.(a)(1), a contract relating to a public works project under § 6962 of Title 29 must include a craft training program for each craft in the project if at the time the contractor executes a public works contract, all of the following apply:

- a. A project meets the prevailing wage requirement under Section 6960 of Title 29.
- b. The contractor employs 10 or more total employees.
- c. The project is not a federal highway project, except for the project under Section 6962(c)(11) of Title 29.
- d. There is an apprenticeship program for a craft in the project on the list of crafts under Section 204(b)(2) of Title 19.

Pursuant to Title 29, Chapter 69, Section 6960A.(a)(2), ***a contractor must commit that all subcontractors provide craft training*** if paragraph (a)(1) of this section applies to the subcontractor. Failure to provide required craft training or payment on the project may subject the successful contractor and/or subcontractor(s) to penalties as outlined in Title 29, Chapter 69, Section 6960A.(d)(1)-(3).

Craft(s):

Contractor Name:

Contractor Address:

**Contractor Program
Registration Number(s)**

On this line also indicate whether DE, Other State (identify) or US Registration Number

Or

☐ A payment has been made in the amount established under Section 204(b)(2)b.2. of Title 19, for the craft into the Delaware Department of Labor's Apprenticeship and Training Fund.

Or

☐ Craft Training requirements are not applicable because:

Authorized Representative (typed or printed): _____

Authorized Representative (signature): _____

Title: _____

State of Delaware)

County of _____)

ss:

Before me, a notary public in and for said county and state, personally appeared, _____, who acknowledged to me that she/he did execute the foregoing instrument on behalf of _____.

IN TESTIMONY WHEREOF, I have subscribed my name and affixed my official seal this _____ day of _____ 20____.

Notary Public

Commission Expires _____

THIS PAGE MUST BE SIGNED AND NOTARIZED TO BE CONSIDERED.

**SECTION 01 10 00
SUMMARY**

NOT FOR BIDDING PURPOSES

PART 1 GENERAL

1.01 PROJECT

- A. Project Name: 25P269 DSP CRIME LAB HVAC UNIT REPLACEMENT
- B. Owner's Name: State of Delaware OMB - Division of Facilities Management - State Department
- C. The Project scope of the project is to demolish and replace the existing make-up unit and exhaust fan at the Delaware State Police Crime Lab.

1.02 CONTRACT DESCRIPTION

- A. Contract Type: A single prime contract based on a Stipulated Price as described in Document 00 52 13 - Standard Form of Agreement Between Owner and Contractor.

1.03 DESCRIPTION OF WORK

- A. Plumbing: Alter existing and add new construction.
- B. HVAC: Replace existing system with new construction.
- C. Electrical Power and Lighting: Replace existing system with new construction, keeping existing in operation until ready for changeover.
- D. Fire Alarm: Replace existing system with new construction, keeping existing in operation until ready for changeover.
- E. Security System: Replace existing system with new construction, keeping existing in operation until ready for changeover.

1.04 OWNER OCCUPANCY

- A. State of Delaware OMB - Division of Facilities Management intends to continue to occupy adjacent portions of the existing building during the entire construction period.
- B. State of Delaware OMB - Division of Facilities Management intends to occupy the Project upon Substantial Completion.
- C. Cooperate with State of Delaware OMB - Division of Facilities Management to minimize conflict and to facilitate continuation of normal State of Delaware OMB - Division of Facilities Management's operations.
- D. Schedule the Work to accommodate State of Delaware OMB - Division of Facilities Management occupancy.

1.05 CONTRACTOR USE OF SITE AND PREMISES

- A. Provide access to and from site as required by law and by State of Delaware OMB - Division of Facilities Management:
 - 1. Emergency Building Exits During Construction: Keep all exits required by code clear and open during construction period; provide temporary exit signs if exit routes are temporarily altered.
 - 2. Do not obstruct roadways, sidewalks, or other public ways without permit.
- B. Utility Outages and Shutdown:
 - 1. Limit disruption of utility services to hours the building is unoccupied.
 - 2. Do not disrupt or shut down life safety systems, including but not limited to fire sprinklers and fire alarm system, without 7 days notice to State of Delaware OMB - Division of Facilities Management and authorities having jurisdiction.
 - 3. Prevent accidental disruption of utility services to other facilities.

1.06 PROJECT WORK HOURS

- A. Contractor work hours on this project shall be from 8:00 a.m. to 4:30 p.m. Monday through Friday unless otherwise noted. Contractors to coordinate work schedule with State Holidays. Contractor shall not work on site during State holidays unless otherwise noted by the Owner.

END OF SECTION

**SECTION 01 20 00
PRICE AND PAYMENT PROCEDURES**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Procedures for preparation and submittal of applications for progress payments.
- B. Change procedures.

1.02 SCHEDULE OF VALUES

- A. Forms to be used: AIA G703.
- B. Electronic media printout including equivalent information will be considered in lieu of standard form specified; submit draft to DEDC, LLC for approval.
- C. Forms shall be typed. Forms filled out by hand will not be accepted.
- D. Submit Schedule of Values in duplicate within 5 days after date of Pre-Construction Meeting.

1.03 APPLICATIONS FOR PROGRESS PAYMENTS

- A. Payment Period: Submit at intervals stipulated in the Agreement.
- B. Electronic media printout including equivalent information will be considered in lieu of standard form specified; submit sample to DEDC, LLC for approval.
- C. Forms shall be typed. Forms filled out by hand will not be accepted.
- D. Execute certification by signature of authorized officer.
- E. Submit one electronic and three hard-copies of each Application for Payment.
- F. Include the following with the application:
 - 1. OMB/DFM Project Number.
 - 2. Contractors Purchase Order Number from the State.
 - 3. Transmittal letter as specified for submittals in Section 01 30 00.

1.04 MODIFICATION PROCEDURES

- A. For minor changes not involving an adjustment to the Contract Sum or Contract Time, DEDC, LLC will issue instructions directly to Contractor.
- B. For other required changes, DEDC, LLC will issue a document signed by State of Delaware OMB - Division of Facilities Management instructing Contractor to proceed with the change, for subsequent inclusion in a Change Order.
 - 1. The document will describe the required changes and will designate method of determining any change in Contract Sum or Contract Time.
 - 2. Promptly execute the change.
- C. For changes for which advance pricing is desired, DEDC, LLC will issue a document that includes a detailed description of a proposed change with supplementary or revised drawings and specifications, a change in Contract Time for executing the change with a stipulation of any overtime work required and the period of time during which the requested price will be considered valid. Contractor shall prepare and submit a fixed price quotation within 10 days.
- D. Computation of Change in Contract Amount: As specified in the Agreement and Conditions of the Contract.
- E. Execution of Change Orders: DEDC, LLC will issue Change Orders for signatures of parties as provided in the Conditions of the Contract.
- F. After execution of Change Order, promptly revise Schedule of Values and Application for Payment forms to record each authorized Change Order as a separate line item and adjust the Contract Sum.
- G. Promptly revise progress schedules to reflect any change in Contract Time, and revise sub-schedules to adjust times for other items of work affected by the change.

H. Promptly enter changes in Project Record Documents.

1.05 APPLICATION FOR FINAL PAYMENT

- A. Prepare Application for Final Payment as specified for progress payments, identifying total adjusted Contract Sum, previous payments, and sum remaining due.
- B. Application for Final Payment will not be considered until the following have been accomplished:
 - 1. All closeout procedures specified in Section 01 70 00.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION - NOT USED

END OF SECTION

NOT FOR BIDDING PURPOSES

**SECTION 01 21 00
ALLOWANCES**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Contingency allowance.

1.02 RELATED REQUIREMENTS

- A. State of Delaware Front End Documents Division 00
- B. Section 01 20 00 - Price and Payment Procedures: Additional payment and modification procedures.

1.03 CONTINGENCY ALLOWANCE

- A. Contractor's costs for products, delivery, installation, labor, insurance, payroll, taxes, bonding, equipment rental, overhead and profit will be included in Change Orders authorizing expenditure of funds from this Contingency Allowance.
- B. Funds will be drawn from the Contingency Allowance only by Approved Allowance Authorization Form (Section 00 63 73) or Change Order.
- C. At closeout of Contract, funds remaining in Contingency Allowance will be credited to Owner by Change Order.

1.04 ALLOWANCES SCHEDULE

- A. Contingency Allowance: Include the stipulated sum/price of \$10,000 for use upon Owner's instructions for miscellaneous items found during construction. Contractor shall use Allowance Authorization Form to document any allowance change orders. At closeout of the Contract, funds remaining in the contingency allowance will be credited to the Owner by Change Order..

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION - NOT USED

END OF SECTION

NOT FOR BIDDING PURPOSES

THIS PAGE INTENTIONALLY LEFT BLANK

SECTION 01 26 00
CONTRACT MODIFICATION PROCEDURES

PART 1 GENERAL

1.01 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

1.02 SUMMARY

- A. This Section specifies administrative and procedural requirements for handling and processing Contract modifications.
- B. Related Sections include the following:
 - 1. Division 01 Section 01 60 00 "Product Requirements" for administrative procedures for handling requests for substitutions made after Contract award.

1.03 MINOR CHANGES IN THE WORK

- A. Architect will issue supplemental instructions authorizing Minor Changes in the Work, not involving adjustment to the Contract Sum or the Contract Time, on AIA Document G710, "Architect's Supplemental Instructions."

1.04 PROPOSAL REQUESTS

- A. Owner-Initiated Proposal Requests: Architect will issue a detailed description of proposed changes in the Work that may require adjustment to the Contract Sum or the Contract Time. If necessary, the description will include supplemental or revised Drawings and Specifications.
 - 1. Proposal Requests issued by Architect are for information only. Do not consider them instructions either to stop work in progress or to execute the proposed change.
 - 2. Within time specified in Proposal Request, but no more than 20 days after receipt of Proposal Request, submit a quotation estimating cost adjustments to the Contract Sum and the Contract Time necessary to execute the change.
 - a. Include a list of quantities of products required or eliminated and unit costs, with total amount of purchases and credits to be made. If requested, furnish survey data to substantiate quantities.
 - b. Indicate applicable taxes, delivery charges, equipment rental, and amounts of trade discounts.
 - c. Include costs of labor and supervision directly attributable to the change.
 - d. Include an updated Contractor's Construction Schedule that indicates the effect of the change, including, but not limited to, changes in activity duration, start and finish times, and activity relationship. Use available total float before requesting an extension of the Contract Time.
- B. Contractor-Initiated Proposals: If latent or unforeseen conditions require modifications to the Contract, Contractor may propose changes by submitting a request for a change to Architect.
 - 1. Include a statement outlining reasons for the change and the effect of the change on the Work. Provide a complete description of the proposed change. Indicate the effect of the proposed change on the Contract Sum and the Contract Time.
 - 2. Include a list of quantities of products required or eliminated and unit costs, with total amount of purchases and credits to be made. If requested, furnish survey data to substantiate quantities.
 - 3. Indicate applicable taxes, delivery charges, equipment rental, and amounts of trade discounts.
 - 4. Include costs of labor and supervision directly attributable to the change.
 - 5. Include an updated Contractor's Construction Schedule that indicates the effect of the change, including, but not limited to, changes in activity duration, start and finish times, and activity relationship. Use available total float before requesting an extension of the Contract Time.

6. Comply with requirements in Division 01 Section "Product Requirements" if the proposed change requires substitution of one product or system for product or system specified.

C. Proposal Request Form: Use AIA Document G709 for Proposal Requests.

1.05 CHANGE ORDER PROCEDURES

- A. On Owner's approval of a Proposal Request, Architect will issue a Change Order for signatures of Owner and Contractor on AIA Document G701.

1.06 CONSTRUCTION CHANGE DIRECTIVE

- A. Construction Change Directive: Architect may issue a Construction Change Directive on AIA Document G714. Construction Change Directive instructs Contractor to proceed with a change in the Work, for subsequent inclusion in a Change Order.
 1. Construction Change Directive contains a complete description of change in the Work. It also designates method to be followed to determine change in the Contract Sum or the Contract Time.
- B. Documentation: Maintain detailed records on a time and material basis of work required by the Construction Change Directive.
 1. After completion of change, submit an itemized account and supporting data necessary to substantiate cost and time adjustments to the Contract.

1.07 P2 PRODUCTS (NOT USED)

1.08 P3 EXECUTION (NOT USED)

END OF SECTION

**SECTION 01 30 00
ADMINISTRATIVE REQUIREMENTS**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. General administrative requirements.
- B. Preconstruction meeting.
- C. Progress meetings.
- D. Construction progress schedule.
- E. Progress photographs.
- F. Coordination drawings.
- G. Submittals for review, information, and project closeout.
- H. Number of copies of submittals.
- I. Requests for Interpretation (RFI) procedures.
- J. Submittal procedures.

1.02 RELATED REQUIREMENTS

- A. Section 01 60 00 - Product Requirements: General product requirements.
- B. Section 01 70 00 - Execution and Closeout Requirements: Additional coordination requirements.
- C. Section 01 78 00 - Closeout Submittals: Project record documents; operation and maintenance data; warranties and bonds.
- D. Section 01 91 13 - General Commissioning Requirements: Additional procedures for submittals relating to commissioning.
 - 1. Where submittals are indicated for review by both DEDC, LLC and the Commissioning Authority, submit one extra and route to DEDC, LLC first, for forwarding to the Commissioning Authority.
 - 2. Where submittals are not indicated to be reviewed by DEDC, LLC, submit directly to the Commissioning Authority; otherwise, the procedures specified in this section apply to commissioning submittals.

1.03 GENERAL ADMINISTRATIVE REQUIREMENTS

- A. Comply with requirements of Section 01 70 00 - Execution and Closeout Requirements for coordination of execution of administrative tasks with timing of construction activities.

1.04 PROJECT COORDINATOR

- A. Contractor.
- B. Cooperate with the Project Coordinator in allocation of mobilization areas of site; for field offices and sheds, for site access, traffic, and parking facilities.
- C. During construction, coordinate use of site and facilities through the Project Coordinator.
- D. Comply with Project Coordinator's procedures for intra-project communications; submittals, reports and records, schedules, coordination drawings, and recommendations; and resolution of ambiguities and conflicts.
- E. Comply with instructions of the Project Coordinator for use of temporary utilities and construction facilities. Responsibility for providing temporary utilities and construction facilities is identified in Section 01 10 00 - Summary.
- F. Coordinate field engineering and layout work under instructions of the Project Coordinator.
- G. Make the following types of submittals to DEDC, LLC through the Project Coordinator:
 - 1. Requests for Interpretation.

2. Requests for substitution.
3. Shop drawings, product data, and samples.
4. Test and inspection reports.
5. Manufacturer's instructions and field reports.
6. Applications for payment and change order requests.
7. Progress schedules.
8. Coordination drawings.
9. Closeout submittals.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION

3.01 PRECONSTRUCTION MEETING

- A. State of Delaware OMB - Division of Facilities Management will schedule a meeting after Notice of Award.
- B. Attendance Required:
 1. State of Delaware OMB - Division of Facilities Management.
 2. DEDC, LLC.
 3. Contractor.
 4. Major subcontractors.
- C. Agenda:
 1. Execution of State of Delaware OMB - Division of Facilities Management-Contractor Agreement.
 2. Designation of personnel representing the parties to Contract Owner and DEDC, LLC.
 3. Designation of personnel representing the parties to Contract, owner, and DEDC, LLC.
 4. Procedures and processing of field decisions, submittals, substitutions, applications for payments, proposal request, Change Orders, and Contract closeout procedures.
 5. Scheduling.

3.02 PROGRESS MEETINGS

- A. Schedule and administer meetings throughout progress of the work at maximum bi-monthly intervals.
- B. DEDC, LLC will make arrangements for meetings, prepare agenda with copies for participants, preside at meetings.
- C. Attendance Required:
 1. Contractor.
 2. State of Delaware OMB - Division of Facilities Management.
 3. DEDC, LLC.
 4. Contractor's superintendent.
 5. Major subcontractors.
- D. Contractor shall provide a 3-week look ahead schedule in writing at each meeting and be prepared to review with attendees.
- E. Agenda:
 1. Review minutes of previous meetings.
 2. Review of work progress.
 3. Field observations, problems, and decisions.
 4. Identification of problems that impede, or will impede, planned progress.
 5. Review of submittals schedule and status of submittals.
 6. Maintenance of progress schedule.
 7. Review contractor's 3 week look ahead schedule.
 8. Corrective measures to regain projected schedules.
 9. Planned progress during succeeding work period.

10. Maintenance of quality and work standards.
11. Effect of proposed changes on progress schedule and coordination.
12. Other business relating to work.

3.03 CONSTRUCTION PROGRESS SCHEDULE

- A. If preliminary construction progress schedule requires revision after review, submit revised schedule within 10 days.
- B. Within 20 days after review of preliminary construction progress schedule, submit draft of proposed final schedule for review.
 1. Include written certification that major Subcontractors have reviewed and accepted proposed schedule.
- C. Within 10 days after joint review, submit final schedule.
- D. Submit updated schedule with each Application for Payment.

3.04 PROGRESS PHOTOGRAPHS

- A. Submit photographs with each application for payment, taken no more than 3 days prior to submission of application for payment.
- B. Photography Type: Digital; electronic files.
- C. Provide photographs of site and construction throughout progress of work produced by an experienced photographer, acceptable to DEDC, LLC.
- D. In addition to periodic, recurring views, take photographs of each of the following events:
- E. Views:
 1. Provide non-aerial photographs from four cardinal views at each specified time, until date of Substantial Completion.
 2. Consult with DEDC, LLC for instructions on views required.
 3. Provide factual presentation.
 4. Provide correct exposure and focus, high resolution and sharpness, maximum depth of field, and minimum distortion.
- F. Digital Photographs: 24-bit color, minimum resolution of 1024 by 768, in JPG format; provide files unaltered by photo editing software.
 1. Delivery Medium: On photo CD.
 2. File Naming: Include project identification, date and time of view, and view identification.
 3. Point of View Sketch: Include digital copy of point of view sketch with each electronic submittal; include point of view identification in each photo file name.

3.05 COORDINATION DRAWINGS

- A. System coordination drawings are required as noted in the specifications. Each contractor shall review the existing conditions and other contractors shop drawings prior to submitting coordinated shop drawings. Any interferences that the contractor is unable to overcome shall be noted on the drawings.
- B. Plans are generally diagrammatic, and each contractor shall coordinate their work with the work of others, so that interference in the work do not occur. This includes interference with new work and existing conditions. Each contractor shall furnish and install offsets, bends, turns and the like in connection with their work to avoid interference with work of other contractors on this project and the existing conditions. In case of interference or lack of clearance and access, the prime contractor shall notify the project Architect immediately through the RFI process.
- C. Conflicts that result after the coordination drawings are approved by the Architect will be the responsibility of the contractor. All costs incurred or adjustments to the work made that are necessary to accommodate installations are the responsibility of the contractor.

3.06 REQUESTS FOR INTERPRETATION (RFI)

- A. Definition: A request seeking one of the following:

1. An interpretation, amplification, or clarification of some requirement of Contract Documents arising from inability to determine from them the exact material, process, or system to be installed; or when the elements of construction are required to occupy the same space (interference); or when an item of work is described differently at more than one place in Contract Documents.
 2. A resolution to an issue which has arisen due to field conditions and affects design intent.
- B. Preparation: Prepare an RFI immediately upon discovery of a need for interpretation of Contract Documents. Failure to submit a RFI in a timely manner is not a legitimate cause for claiming additional costs or delays in execution of the work.
1. Prepare a separate RFI for each specific item.
 - a. Review, coordinate, and comment on requests originating with subcontractors and/or materials suppliers.
 - b. Do not forward requests which solely require internal coordination between subcontractors.
 2. Prepare in a format and with content acceptable to State of Delaware OMB - Division of Facilities Management.
- C. Reason for the RFI: Prior to initiation of an RFI, carefully study all Contract Documents to confirm that information sufficient for their interpretation is definitely not included.
1. Include in each request Contractor's signature attesting to good faith effort to determine from Contract Documents information requiring interpretation.
 2. Unacceptable Uses for RFIs: Do not use RFIs to request the following::
 - a. Approval of submittals (use procedures specified elsewhere in this section).
 - b. Approval of substitutions (see Section 01 60 00 - Product Requirements)
 - c. Changes that entail change in Contract Time and Contract Sum (comply with provisions of the Conditions of the Contract).
 - d. Different methods of performing work than those indicated in the Contract Drawings and Specifications (comply with provisions of the Conditions of the Contract).

3.07 SUBMITTAL SCHEDULE

- A. Submit to DEDC, LLC for review a schedule for submittals in tabular format.
1. Submit at the same time as the preliminary schedule.
 2. Format schedule to allow tracking of status of submittals throughout duration of construction.
 3. Account for time required for preparation, review, manufacturing, fabrication and delivery when establishing submittal delivery and review deadline dates.
 - a. For assemblies, equipment, systems comprised of multiple components and/or requiring detailed coordination with other work, allow for additional time to make corrections or revisions to initial submittals, and time for their review.

3.08 SUBMITTALS FOR REVIEW

- A. When the following are specified in individual sections, submit them for review:
1. Product data.
 2. Shop drawings.
 3. Samples for selection.
 4. Samples for verification.
- B. Submit to DEDC, LLC for review for the limited purpose of checking for compliance with information given and the design concept expressed in Contract Documents.
- C. Samples will be reviewed for aesthetic, color, or finish selection.
- D. After review, provide copies and distribute in accordance with SUBMITTAL PROCEDURES article below and for record documents purposes described in Section 01 78 00 - Closeout Submittals.

3.09 SUBMITTALS FOR INFORMATION

- A. When the following are specified in individual sections, submit them for information:

1. Design data.
 2. Certificates.
 3. Test reports.
 4. Inspection reports.
 5. Manufacturer's instructions.
 6. Manufacturer's field reports.
 7. Other types indicated.
- B. Submit for DEDC, LLC's knowledge as contract administrator or for State of Delaware OMB - Division of Facilities Management.

3.10 SUBMITTALS FOR PROJECT CLOSEOUT

- A. Submit Correction Punch List for Substantial Completion.
- B. Submit Final Correction Punch List for Substantial Completion.
- C. When the following are specified in individual sections, submit them at project closeout in compliance with requirements of Section 01 78 00 - Closeout Submittals:
1. Project record documents.
 2. Operation and maintenance data.
 3. Warranties.
 4. Bonds.
 5. Other types as indicated.
- D. Submit for State of Delaware OMB - Division of Facilities Management's benefit during and after project completion.

3.11 NUMBER OF COPIES OF SUBMITTALS

- A. Documents for Review:
1. Small Size Sheets, Not Larger Than 8-1/2 by 11 inches: Submit the number of copies that Contractor requires, plus two copies that will be retained by DEDC, LLC.
- B. Documents for Information: Submit two copies.
- C. Documents for Project Closeout: Make one reproduction of submittal originally reviewed. Submit one extra of submittals for information.
- D. Samples: Submit the number specified in individual specification sections; one of which will be retained by DEDC, LLC.
1. After review, produce duplicates.
 2. Retained samples will not be returned to Contractor unless specifically so stated.

3.12 SUBMITTAL PROCEDURES

- A. General Requirements:
- B. Transmit each submittal with approved form.

END OF SECTION

NOT FOR BIDDING PURPOSES

THIS PAGE INTENTIONALLY LEFT BLANK

**SECTION 01 40 00
QUALITY REQUIREMENTS**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Submittals.
- B. Testing and inspection agencies and services.
- C. Control of installation.
- D. Manufacturers' field services.
- E. Defect Assessment.
- F. Warranty

1.02 RELATED REQUIREMENTS

- A. Section 01 30 00 - Administrative Requirements: Submittal procedures.
- B. Section 01 60 00 - Product Requirements: Requirements for material and product quality.

1.03 REFERENCE STANDARDS

- A. ASTM C1077 - Standard Practice for Agencies Testing Concrete and Concrete Aggregates for Use in Construction and Criteria for Testing Agency Evaluation; 2025.

1.04 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Design Data: Submit for DEDC, LLC's knowledge as contract administrator for the limited purpose of assessing compliance with information given and the design concept expressed in the Contract Documents, or for State of Delaware OMB - Division of Facilities Management's information.
- C. Test Reports: After each test/inspection, promptly submit two copies of report to DEDC, LLC and to Contractor.
 - 1. Include:
 - a. Date issued.
 - b. Project title and number.
 - c. Name of inspector.
 - d. Date and time of sampling or inspection.
 - e. Identification of product and specifications section.
 - f. Location in the Project.
 - g. Type of test/inspection.
 - h. Date of test/inspection.
 - i. Results of test/inspection.
 - j. Compliance with Contract Documents.
 - k. When requested by DEDC, LLC, provide interpretation of results.

1.05 TESTING AND INSPECTION AGENCIES AND SERVICES

- A. State of Delaware OMB - Division of Facilities Management will employ and pay for services of an independent testing agency to perform other specified testing.
- B. Employment of agency in no way relieves Contractor of obligation to perform Work in accordance with requirements of Contract Documents.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION

3.01 CONTROL OF INSTALLATION

- A. Monitor quality control over suppliers, manufacturers, products, services, site conditions, and workmanship, to produce work of specified quality.

- B. Comply with manufacturers' instructions, including each step in sequence.
- C. Should manufacturers' instructions conflict with Contract Documents, request clarification from DEDC, LLC before proceeding.
- D. Comply with specified standards as minimum quality for the work except where more stringent tolerances, codes, or specified requirements indicate higher standards or more precise workmanship.
- E. Have work performed by persons qualified to produce required and specified quality.
- F. Verify that field measurements are as indicated on shop drawings or as instructed by the manufacturer.
- G. Secure products in place with positive anchorage devices designed and sized to withstand stresses, vibration, physical distortion, and disfigurement.

3.02 TESTING AND INSPECTION

- A. Testing Agency Duties:
 - 1. Provide qualified personnel at site. Cooperate with DEDC, LLC and Contractor in performance of services.
 - 2. Perform specified sampling and testing of products in accordance with specified standards.
 - 3. Ascertain compliance of materials and mixes with requirements of Contract Documents.
 - 4. Promptly notify DEDC, LLC and Contractor of observed irregularities or non-compliance of Work or products.
 - 5. Perform additional tests and inspections required by DEDC, LLC.
 - 6. Submit reports of all tests/inspections specified.
- B. Limits on Testing/Inspection Agency Authority:
 - 1. Agency may not release, revoke, alter, or enlarge on requirements of Contract Documents.
 - 2. Agency may not approve or accept any portion of the Work.
 - 3. Agency may not assume any duties of Contractor.
 - 4. Agency has no authority to stop the Work.
- C. Contractor Responsibilities:
 - 1. Deliver to agency at designated location, adequate samples of materials proposed to be used that require testing, along with proposed mix designs.
 - 2. Cooperate with laboratory personnel, and provide access to the Work and to manufacturers' facilities.
 - 3. Provide incidental labor and facilities:
 - a. To provide access to Work to be tested/inspected.
 - b. To obtain and handle samples at the site or at source of Products to be tested/inspected.
 - c. To facilitate tests/inspections.
 - d. To provide storage and curing of test samples.
 - 4. Notify DEDC, LLC and laboratory 24 hours prior to expected time for operations requiring testing/inspection services.
 - 5. Employ services of an independent qualified testing laboratory and pay for additional samples, tests, and inspections required by Contractor beyond specified requirements.
 - 6. Arrange with State of Delaware OMB - Division of Facilities Management's agency and pay for additional samples, tests, and inspections required by Contractor beyond specified requirements.
- D. Re-testing required because of non-compliance with specified requirements shall be performed by the same agency on instructions by DEDC, LLC.
- E. Re-testing required because of non-compliance with specified requirements shall be paid for by Contractor.

3.03 MANUFACTURERS' FIELD SERVICES

- A. When specified in individual specification sections, require material or product suppliers or manufacturers to provide qualified staff personnel to observe site conditions, conditions of surfaces and installation, quality of workmanship, start-up of equipment, test, adjust and balance of equipment as applicable, and to initiate instructions when necessary.
- B. Report observations and site decisions or instructions given to applicators or installers that are supplemental or contrary to manufacturers' written instructions.

3.04 DEFECT ASSESSMENT

- A. Replace Work or portions of the Work not complying with specified requirements.
- B. If, in the opinion of DEDC, LLC, it is not practical to remove and replace the work, DEDC, LLC will direct an appropriate remedy or adjust payment.

3.05 WARRANTY

- A. The Contractor will guarantee all materials and workmanship against original defects, except injury from proper and usual wear when used for the purpose intended, for two years after Acceptance by the Owner, and will maintain all items in perfect condition during the period of guarantee.
- B. Defects appearing during the period of guarantee will be made good by the Contractor at his expense upon demand of the Owner, it being required that all work will be in perfect condition when the period of guarantee will have elapsed.
- C. In addition to the General Guarantee there are other guarantees required for certain items for different periods of time than the two years as above, and are particularly so stated in that part of the specifications referring to same. The said guarantees will commence at the same time as the General Guarantee.
- D. If the Contractor fails to remedy any failure, defect or damage within a reasonable time after receipt of notice, the Owner will have the right to replace, repair, or otherwise remedy the failure, defect or damage at the Contractor's expense.
- E. For a period of two (2) years from the date of substantial completion, as evidenced by the date of final acceptance of the work, the contractor warrants that work performed under this contract conforms to the contract requirements and is free of any defect of equipment, material or workmanship performed by the contractor or any of his subcontractors or suppliers. However, manufacturer's warranties and guarantees, if for a period longer than two (2) years, shall take precedence over the above warranties. The contractor shall remedy, at his own expense, any such failure to conform or any such defect. The protection of this warranty shall be included in the Contractor's Performance Bond.

END OF SECTION

NOT FOR BIDDING PURPOSES

THIS PAGE INTENTIONALLY LEFT BLANK

**SECTION 01 50 00
TEMPORARY FACILITIES AND CONTROLS**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Vehicular access and parking.
- B. Waste removal facilities and services.

1.02 VEHICULAR ACCESS AND PARKING - SEE SECTION 01 55 00

- A. Coordinate access and haul routes with governing authorities and State of Delaware OMB - Division of Facilities Management.
- B. Provide and maintain access to fire hydrants, free of obstructions.
- C. Provide temporary parking areas to accommodate construction personnel. When site space is not adequate, provide additional off-site parking.

1.03 WASTE REMOVAL

- A. Provide waste removal facilities and services as required to maintain the site in clean and orderly condition.
- B. Provide containers with lids. Remove trash from site periodically.
- C. If materials to be recycled or re-used on the project must be stored on-site, provide suitable non-combustible containers; locate containers holding flammable material outside the structure unless otherwise approved by the authorities having jurisdiction.
- D. Open free-fall chutes are not permitted. Terminate closed chutes into appropriate containers with lids.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION - NOT USED

END OF SECTION

NOT FOR BIDDING PURPOSES

THIS PAGE INTENTIONALLY LEFT BLANK

**SECTION 01 60 00
PRODUCT REQUIREMENTS**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. General product requirements.
- B. Re-use of existing products.
- C. Transportation, handling, storage and protection.
- D. Product option requirements.
- E. Substitution "or Equal" limitations and procedures.
- F. Procedures for State of Delaware OMB - Division of Facilities Management-supplied products.
- G. Maintenance materials, including extra materials, spare parts, tools, and software.

1.02 RELATED REQUIREMENTS

- A. Document Instructions to Bidders: Product options and substitution procedures prior to bid date.
- B. Section 01 10 00 - Summary:
- C. Section 01 25 00 - Substitution Procedures: Substitutions made during procurement and/or construction phases.
- D. Section 01 40 00 - Quality Requirements: Product quality monitoring.
- E. Section 01 74 19 - Construction Waste Management and Disposal: Waste disposal requirements potentially affecting product selection, packaging and substitutions.
- F. Section 22 05 13 - Common Motor Requirements for Plumbing Equipment: Motors for plumbing equipment.
- G. Section 23 05 13 - Common Motor Requirements for HVAC Equipment: Motors for HVAC equipment.

1.03 REFERENCE STANDARDS

- A. NEMA MG 00001 - Motors and Generators; 2024.
- B. NFPA 70 - National Electrical Code; Most Recent Edition Adopted by Authority Having Jurisdiction, including All Applicable Amendments and Supplements.

1.04 SUBMITTALS

- A. Product Data Submittals: Submit manufacturer's standard published data. Mark each copy to identify applicable products, models, options, and other data. Supplement manufacturers' standard data to provide information specific to this Project.
- B. Shop Drawing Submittals: Prepared specifically for this Project; indicate utility and electrical characteristics, utility connection requirements, and location of utility outlets for service for functional equipment and appliances.
- C. Sample Submittals: Illustrate functional and aesthetic characteristics of the product, with integral parts and attachment devices. Coordinate sample submittals for interfacing work.
 - 1. For selection from standard finishes, submit samples of the full range of the manufacturer's standard colors, textures, and patterns.

PART 2 PRODUCTS

2.01 EXISTING PRODUCTS

- A. Do not use materials and equipment removed from existing premises unless specifically required or permitted by Contract Documents.
- B. Unforeseen historic items encountered remain the property of the State of Delaware OMB - Division of Facilities Management; notify State of Delaware OMB - Division of Facilities

Management promptly upon discovery; protect, remove, handle, and store as directed by State of Delaware OMB - Division of Facilities Management.

- C. Existing materials and equipment indicated to be removed, but not to be re-used, relocated, reinstalled, delivered to the State of Delaware OMB - Division of Facilities Management, or otherwise indicated as to remain the property of the State of Delaware OMB - Division of Facilities Management, become the property of the Contractor; remove from site.
- D. Reused Products: Reused products include materials and equipment previously used in this or other construction, salvaged and refurbished as specified.
- E. Specific Products to be Reused: The reuse of certain materials and equipment already existing on the project site is not prohibited.
 - 1. See Section 01 10 00 for list of items required to be salvaged for reuse and relocation.

2.02 NEW PRODUCTS

- A. Provide new products unless specifically required or permitted by Contract Documents.
- B. Use of products having any of the following characteristics is not permitted:
 - 1. Made using or containing CFC's or HCFC's.
 - 2. Containing lead, cadmium, or asbestos.
- C. Where other criteria are met, Contractor shall give preference to products that:
 - 1. Are extracted, harvested, and/or manufactured closer to the location of the project.
 - 2. Have longer documented life span under normal use.
 - 3. Result in less construction waste. See Section 01 74 19
 - 4. Are made of vegetable materials that are rapidly renewable.
 - 5. Are made of recycled materials.
- D. Provide interchangeable components by the same manufacture for components being replaced.
- E. Motors: Refer to Section 23 05 13 - Common Motor Requirements for HVAC Equipment, NEMA MG 00001 Type. Specific motor type is specified in individual specification sections.
- F. Wiring Terminations: Provide terminal lugs to match branch circuit conductor quantities, sizes, and materials indicated. Size terminal lugs to NFPA 70, include lugs for terminal box.
- G. Cord and Plug: Provide minimum 6 foot cord and plug including grounding connector for connection to electric wiring system. Cord of longer length is specified in individual specification sections.

2.03 PRODUCT OPTIONS

- A. Products Specified by Reference Standards or by Description Only: Use any product meeting those standards or description.
- B. Products Specified by Naming One or More Manufacturers with a Provision for Substitutions: Submit a request for substitution for any manufacturer not named in accordance with this specification.

2.04 MAINTENANCE MATERIALS

- A. Furnish extra materials, spare parts, tools, and software of types and in quantities specified in individual specification sections.
- B. Deliver to Project site; obtain receipt prior to final payment.

PART 3 EXECUTION

3.01 SUBSTITUTION LIMITATIONS

- A. See Section 01 25 00 - Substitution Procedures.
- B. The intent of this process is to allow for manufacturers not listed to provide an "Equal" product to DEDC, LLC for review and approval. This process must take place prior to award of bid.
- C. A request for substitution constitutes a representation that the submitter:

1. Has investigated proper clearances and working spaces for substituted equipment and waives claims for additional costs or time extension that may subsequently become apparent. These physical differences must be pointed out at the time of the submittal.

3.02 OWNER-SUPPLIED PRODUCTS

- A. State of Delaware OMB - Division of Facilities Management's Responsibilities:
 1. Arrange for and deliver State of Delaware OMB - Division of Facilities Management reviewed shop drawings, product data, and samples, to Contractor.
 2. Arrange and pay for product delivery to site.
 3. On delivery, inspect products jointly with Contractor.
 4. Submit claims for transportation damage and replace damaged, defective or deficient items.
 5. Arrange for manufacturers' warranties, inspections, and service.
- B. Contractor's Responsibilities:
 1. Review State of Delaware OMB - Division of Facilities Management reviewed shop drawings, product data, and samples.
 2. Receive and unload products at site; inspect for completeness or damage jointly with State of Delaware OMB - Division of Facilities Management.
 3. Handle, store, install and finish products.
 4. Repair or replace items damaged after receipt.

3.03 TRANSPORTATION AND HANDLING

- A. Package products for shipment in manner to prevent damage; for equipment, package to avoid loss of factory calibration.
- B. If special precautions are required, attach instructions prominently and legibly on outside of packaging.
- C. Coordinate schedule of product delivery to designated prepared areas in order to minimize site storage time and potential damage to stored materials.
- D. Transport and handle products in accordance with manufacturer's instructions.
- E. Transport materials in covered trucks to prevent contamination of product and littering of surrounding areas.
- F. Promptly inspect shipments to ensure that products comply with requirements, quantities are correct, and products are undamaged.
- G. Provide equipment and personnel to handle products by methods to prevent soiling, disfigurement, or damage, and to minimize handling.
- H. Arrange for the return of packing materials, such as wood pallets, where economically feasible.

3.04 STORAGE AND PROTECTION

- A. Designate receiving/storage areas for incoming products so that they are delivered according to installation schedule and placed convenient to work area in order to minimize waste due to excessive materials handling and misapplication. See Section 01 74 19.
- B. Store and protect products in accordance with manufacturers' instructions.
- C. Store with seals and labels intact and legible.
- D. Store sensitive products in weathertight, climate-controlled enclosures in an environment favorable to product.
- E. For exterior storage of fabricated products, place on sloped supports above ground.
- F. Protect products from damage or deterioration due to construction operations, weather, precipitation, humidity, temperature, sunlight and ultraviolet light, dirt, dust, and other contaminants.
- G. Comply with manufacturer's warranty conditions, if any.

- H. Cover products subject to deterioration with impervious sheet covering. Provide ventilation to prevent condensation and degradation of products.
- I. Prevent contact with material that may cause corrosion, discoloration, or staining.
- J. Provide equipment and personnel to store products by methods to prevent soiling, disfigurement, or damage.
- K. Arrange storage of products to permit access for inspection. Periodically inspect to verify products are undamaged and are maintained in acceptable condition.

END OF SECTION

NOT FOR BIDDING PURPOSES

SECTION 01 70 00
EXECUTION AND CLOSEOUT REQUIREMENTS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Examination, preparation, and general installation procedures.
- B. Requirements for alterations work, including selective demolition, except removal, disposal, and/or remediation of hazardous materials and toxic substances.
- C. Pre-installation meetings.
- D. Cutting and patching.
- E. Cleaning and protection.
- F. Starting of systems and equipment.
- G. Demonstration and instruction of State of Delaware OMB - Division of Facilities Management personnel.
- H. Closeout procedures, including Contractor's Correction Punch List, except payment procedures.

1.02 RELATED REQUIREMENTS

- A. Section 01 10 00 - Summary: Limitations on working in existing building; continued occupancy; work sequence; identification of salvaged and relocated materials.
- B. Section 01 30 00 - Administrative Requirements: Submittals procedures, Electronic document submittal service.
- C. Section 01 74 19 - Construction Waste Management and Disposal: Additional procedures for trash/waste removal, recycling, salvage, and reuse.
- D. Section 01 78 00 - Closeout Submittals: Project record documents, operation and maintenance data, warranties, and bonds.
- E. Section 01 79 00 - Demonstration and Training: Demonstration of products and systems to be commissioned and where indicated in specific specification sections
- F. Section 01 91 13 - General Commissioning Requirements: Contractor's responsibilities in regard to commissioning.
- G. Section 07 84 00 - Firestopping.

1.03 REFERENCE STANDARDS

- A. NFPA 241 - Standard for Safeguarding Construction, Alteration, and Demolition Operations; 2022 with Errata (2021).

1.04 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Cutting and Patching: Submit written request in advance of cutting or alteration that affects:
 - 1. Structural integrity of any element of Project.
 - 2. Integrity of weather exposed or moisture resistant element.
 - 3. Efficiency, maintenance, or safety of any operational element.
 - 4. Visual qualities of sight exposed elements.
 - 5. Work of State of Delaware OMB - Division of Facilities Management or separate Contractor.
 - 6. Include in request:
 - a. Identification of Project.
 - b. Location and description of affected work.
 - c. Necessity for cutting or alteration.
 - d. Description of proposed work and products to be used.

- e. Effect on work of State of Delaware OMB - Division of Facilities Management or separate Contractor.
- f. Written permission of affected separate Contractor.
- g. Date and time work will be executed.

C. Project Record Documents: Accurately record actual locations of capped and active utilities.

1.05 PROJECT CONDITIONS

- A. Use of explosives is not permitted.
- B. Ventilate enclosed areas to assist cure of materials, to dissipate humidity, and to prevent accumulation of dust, fumes, vapors, or gases.
- C. Dust Control: Execute work by methods to minimize raising dust from construction operations. Provide positive means to prevent air-borne dust from dispersing into atmosphere and over adjacent property.
 - 1. Provide dust-proof barriers between construction areas and areas continuing to be occupied.
- D. Noise Control: Provide methods, means, and facilities to minimize noise produced by construction operations.
 - 1. Outdoors: Limit conduct of especially noisy exterior work to the hours of 8 am to 5 pm.
 - 2. Indoors: Limit conduct of especially noisy interior work to the hours of 6 pm to 7 am.
- E. Pest and Rodent Control: Provide methods, means, and facilities to prevent pests and insects from damaging the work.

1.06 COORDINATION

- A. See Section 01 10 00 for occupancy-related requirements.
- B. Coordinate scheduling, submittals, and work of the various sections of the Project Manual to ensure efficient and orderly sequence of installation of interdependent construction elements, with provisions for accommodating items installed later.
- C. Notify affected utility companies and comply with their requirements.
- D. Verify that utility requirements and characteristics of new operating equipment are compatible with building utilities. Coordinate work of various sections having interdependent responsibilities for installing, connecting to, and placing in service, such equipment.
- E. Coordinate space requirements, supports, and installation of mechanical and electrical work that are indicated diagrammatically on drawings. Follow routing indicated for pipes, ducts, and conduit, as closely as practicable; place runs parallel with lines of building. Utilize spaces efficiently to maximize accessibility for other installations, for maintenance, and for repairs.
- F. In finished areas except as otherwise indicated, conceal pipes, ducts, and wiring within the construction. Coordinate locations of fixtures and outlets with finish elements.
- G. Coordinate completion and clean-up of work of separate sections.
- H. After State of Delaware OMB - Division of Facilities Management occupancy of premises, coordinate access to site for correction of defective work and work not in accordance with Contract Documents, to minimize disruption of State of Delaware OMB - Division of Facilities Management's activities.

PART 2 PRODUCTS

2.01 PATCHING MATERIALS

- A. New Materials: As specified in product sections; match existing products and work for patching and extending work.
- B. Type and Quality of Existing Products: Determine by inspecting and testing products where necessary, referring to existing work as a standard.
- C. Product Substitution: For any proposed change in materials, submit request for substitution described in Section 01 60 00 - Product Requirements.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that existing site conditions and substrate surfaces are acceptable for subsequent work. Start of work means acceptance of existing conditions.
- B. Verify that existing substrate is capable of structural support or attachment of new work being applied or attached.
- C. Examine and verify specific conditions described in individual specification sections.
- D. Take field measurements before confirming product orders or beginning fabrication, to minimize waste due to over-ordering or misfabrication.
- E. Verify that utility services are available, of the correct characteristics, and in the correct locations.
- F. Prior to Cutting: Examine existing conditions prior to commencing work, including elements subject to damage or movement during cutting and patching. After uncovering existing work, assess conditions affecting performance of work. Beginning of cutting or patching means acceptance of existing conditions.

3.02 PREPARATION

- A. Clean substrate surfaces prior to applying next material or substance.
- B. Seal cracks or openings of substrate prior to applying next material or substance.
- C. Apply manufacturer required or recommended substrate primer, sealer, or conditioner prior to applying any new material or substance in contact or bond.

3.03 PREINSTALLATION MEETINGS

- A. When required in individual specification sections, convene a preinstallation meeting at the site prior to commencing work of the section.
- B. Require attendance of parties directly affecting, or affected by, work of the specific section.
- C. Notify DEDC, LLC four days in advance of meeting date.
- D. Prepare agenda and provide at meeting:
 - 1. Review conditions of examination, preparation and installation procedures.
 - 2. Review coordination with related work.
- E. Record minutes and distribute copies within two days after meeting to participants, with two copies to DEDC, LLC, State of Delaware OMB - Division of Facilities Management, participants, and those affected by decisions made.

3.04 GENERAL INSTALLATION REQUIREMENTS

- A. Install products as specified in individual sections, in accordance with manufacturer's instructions and recommendations, and so as to avoid waste due to necessity for replacement.
- B. Make vertical elements plumb and horizontal elements level, unless otherwise indicated.
- C. Install equipment and fittings plumb and level, neatly aligned with adjacent vertical and horizontal lines, unless otherwise indicated.
- D. Make consistent texture on surfaces, with seamless transitions, unless otherwise indicated.
- E. Make neat transitions between different surfaces, maintaining texture and appearance.

3.05 ALTERATIONS

- A. Drawings showing existing construction and utilities are based on casual field observation and existing record documents only.
 - 1. Verify that construction and utility arrangements are as indicated.
 - 2. Report discrepancies to DEDC, LLC before disturbing existing installation.
 - 3. Beginning of alterations work constitutes acceptance of existing conditions.

- B. Maintain weatherproof exterior building enclosure except for interruptions required for replacement or modifications; take care to prevent water and humidity damage.
1. Where openings in exterior enclosure exist, provide construction to make exterior enclosure weatherproof.
 2. Insulate existing ducts or pipes that are exposed to outdoor ambient temperatures by alterations work.
- C. Remove existing work as indicated and as required to accomplish new work.
1. Remove items indicated on drawings.
 2. Relocate items indicated on drawings.
 3. Where new surface finishes are to be applied to existing work, perform removals, patch, and prepare existing surfaces as required to receive new finish; remove existing finish if necessary for successful application of new finish.
 4. Where new surface finishes are not specified or indicated, patch holes and damaged surfaces to match adjacent finished surfaces as closely as possible.
- D. Services (Including but not limited to HVAC, Plumbing, Fire Protection, Electrical, and Telecommunications): Remove, relocate, and extend existing systems to accommodate new construction.
1. Maintain existing active systems that are to remain in operation; maintain access to equipment and operational components; if necessary, modify installation to allow access or provide access panel.
 2. Where existing systems or equipment are not active and Contract Documents require reactivation, put back into operational condition, repair supply, distribution, and equipment as required.
 3. Where existing active systems serve occupied facilities but are to be replaced with new services, maintain existing systems in service until new systems are complete and ready for service.
 - a. Disable existing systems only to make switchovers and connections; minimize duration of outages.
 - b. See Section 01 16 00 for other limitations on outages and required notifications.
 - c. Provide temporary connections as required to maintain existing systems in service.
 4. Verify that abandoned services serve only abandoned facilities.
 5. Remove abandoned pipe, ducts, conduits, and equipment, including those above accessible ceilings; remove back to source of supply where possible, otherwise cap stub and tag with identification; patch holes left by removal using materials specified for new construction.
- E. Protect existing work to remain.
1. Prevent movement of structure; provide shoring and bracing if necessary.
 2. Perform cutting to accomplish removals neatly and as specified for cutting new work.
 3. Repair adjacent construction and finishes damaged during removal work.
- F. Adapt existing work to fit new work: Make as neat and smooth transition as possible.
1. When existing finished surfaces are cut so that a smooth transition with new work is not possible, terminate existing surface along a straight line at a natural line of division and make recommendation to DEDC, LLC.
- G. Patching: Where the existing surface is not indicated to be refinished, patch to match the surface finish that existed prior to cutting. Where the surface is indicated to be refinished, patch so that the substrate is ready for the new finish.
- H. Refinish existing surfaces as indicated:
1. Where rooms or spaces are indicated to be refinished, refinish all visible existing surfaces to remain to the specified condition for each material, with a neat transition to adjacent finishes.
 2. If mechanical or electrical work is exposed accidentally during the work, re-cover and refinish to match.

- I. Clean existing systems and equipment.
- J. Remove demolition debris and abandoned items from alterations areas and dispose of off-site; do not burn or bury.
- K. Do not begin new construction in alterations areas before demolition is complete.
- L. Comply with all other applicable requirements of this section.

3.06 CUTTING AND PATCHING

- A. Whenever possible, execute the work by methods that avoid cutting or patching.
- B. See Alterations article above for additional requirements.
- C. Perform whatever cutting and patching is necessary to:
 - 1. Complete the work.
 - 2. Fit products together to integrate with other work.
 - 3. Provide openings for penetration of mechanical, electrical, and other services.
 - 4. Match work that has been cut to adjacent work.
 - 5. Repair areas adjacent to cuts to required condition.
 - 6. Repair new work damaged by subsequent work.
 - 7. Remove samples of installed work for testing when requested.
 - 8. Remove and replace defective and non-complying work.
- D. Execute work by methods that avoid damage to other work and that will provide appropriate surfaces to receive patching and finishing. In existing work, minimize damage and restore to original condition.
- E. Employ original installer to perform cutting for weather exposed and moisture resistant elements, and sight exposed surfaces.
- F. Cut rigid materials using masonry saw or core drill. Pneumatic tools not allowed without prior approval.
- G. Restore work with new products in accordance with requirements of Contract Documents.
- H. Fit work air tight to pipes, sleeves, ducts, conduit, and other penetrations through surfaces.
- I. At penetrations of fire rated walls, partitions, ceiling, or floor construction, completely seal voids with fire rated material in accordance with Section 07 84 00, to full thickness of the penetrated element.
- J. Patching:
 - 1. Finish patched surfaces to match finish that existed prior to patching. On continuous surfaces, refinish to nearest intersection or natural break. For an assembly, refinish entire unit.
 - 2. Match color, texture, and appearance.
 - 3. Repair patched surfaces that are damaged, lifted, discolored, or showing other imperfections due to patching work. If defects are due to condition of substrate, repair substrate prior to repairing finish.

3.07 PROGRESS CLEANING

- A. Maintain areas free of waste materials, debris, and rubbish. Maintain site in a clean and orderly condition.
- B. Remove debris and rubbish from pipe chases, plenums, attics, crawl spaces, and other closed or remote spaces, prior to enclosing the space.
- C. Broom and vacuum clean interior areas prior to start of surface finishing, and continue cleaning to eliminate dust.
- D. Collect and remove waste materials, debris, and trash/rubbish from site periodically and dispose off-site; do not burn or bury.

3.08 PROTECTION OF INSTALLED WORK

- A. Protect installed work from damage by construction operations.
- B. Provide special protection where specified in individual specification sections.
- C. Provide temporary and removable protection for installed products. Control activity in immediate work area to prevent damage.
- D. Provide protective coverings at walls, projections, jambs, sills, and soffits of openings.
- E. Protect finished floors, stairs, and other surfaces from traffic, dirt, wear, damage, or movement of heavy objects, by protecting with durable sheet materials.
- F. Prohibit traffic or storage upon waterproofed or roofed surfaces. If traffic or activity is necessary, obtain recommendations for protection from waterproofing or roofing material manufacturer.
- G. Remove protective coverings when no longer needed; reuse or recycle coverings if possible.

3.09 SYSTEM STARTUP

- A. Coordinate schedule for start-up of various equipment and systems.
- B. Verify that each piece of equipment or system has been checked for proper lubrication, drive rotation, belt tension, control sequence, and for conditions that may cause damage.
- C. Verify tests, meter readings, and specified electrical characteristics agree with those required by the equipment or system manufacturer.
- D. Verify that wiring and support components for equipment are complete and tested.
- E. Execute start-up under supervision of applicable Contractor personnel and manufacturer's representative in accordance with manufacturers' instructions.
- F. Submit a written report that equipment or system has been properly installed and is functioning correctly.

3.10 DEMONSTRATION AND INSTRUCTION

- A. See Section 01 79 00 - Demonstration and Training.

3.11 ADJUSTING

- A. Adjust operating products and equipment to ensure smooth and unhindered operation.

3.12 FINAL CLEANING

- A. Use cleaning materials that are nonhazardous.
- B. Clean interior and exterior glass, surfaces exposed to view; remove temporary labels, stains and foreign substances, polish transparent and glossy surfaces, vacuum carpeted and soft surfaces.
- C. Remove all labels that are not permanent. Do not paint or otherwise cover fire test labels or nameplates on mechanical and electrical equipment.
- D. Clean equipment and fixtures to a sanitary condition with cleaning materials appropriate to the surface and material being cleaned.
- E. Clean filters of operating equipment.
- F. Clean debris from roofs, gutters, downspouts, scuppers, overflow drains, area drains, drainage systems, and all new equipment..
- G. Clean site; sweep paved areas, rake clean landscaped surfaces.
- H. Remove waste, surplus materials, trash/rubbish, and construction facilities from the site; dispose of in legal manner; do not burn or bury.

3.13 CLOSEOUT PROCEDURES

- A. Make submittals that are required by governing or other authorities.
 - 1. Provide copies to DEDC, LLC.

- B. Accompany Project Coordinator on preliminary inspection to determine items to be listed for completion or correction in the Contractor's Correction Punch List for Contractor's Notice of Substantial Completion.
- C. Notify DEDC, LLC when work is considered ready for DEDC, LLC's Substantial Completion inspection.
- D. Submit written certification containing Contractor's Correction Punch List, that Contract Documents have been reviewed, work has been inspected, and that work is complete in accordance with Contract Documents and ready for DEDC, LLC's Substantial Completion inspection.
- E. Conduct Substantial Completion inspection and create Final Correction Punch List containing DEDC, LLC's and Contractor's comprehensive list of items identified to be completed or corrected and submit to DEDC, LLC.
- F. Correct items of work listed in Final Correction Punch List and comply with requirements for access to State of Delaware OMB - Division of Facilities Management-occupied areas.
- G. Notify DEDC, LLC when work is considered finally complete and ready for DEDC, LLC's Substantial Completion final inspection.
- H. Complete items of work determined by DEDC, LLC listed in executed Certificate of Substantial Completion.

END OF SECTION

NOT FOR BIDDING PURPOSES

THIS PAGE INTENTIONALLY LEFT BLANK

SECTION 01 74 19
CONSTRUCTION WASTE MANAGEMENT AND DISPOSAL

PART 1 – GENERAL

1.01 SUMMARY

- A. Section includes: Administrative and procedural requirements for construction waste management activities.

1.02 DEFINITIONS

- A. Construction, Demolition, and Land clearing (CDL) Waste: Includes all non-hazardous solid wastes resulting from construction, remodeling, alterations, repair, demolition and land clearing. Includes material that is recycled, reused, salvaged or disposed as garbage.
- B. Salvage: Recovery of materials for on-site reuse, sale or donation to a third party.
- C. Reuse: Making use of a material without altering its form. Materials can be reused on-site or reused on other projects off-site. Examples include, but are not limited to the following: Crushing or grinding of concrete for use as sub-base material. Chipping of land clearing debris for use as mulch.
- D. Recycling: The process of sorting, cleaning, treating, and reconstituting materials for the purpose of using the material in the manufacture of a new product.
- E. Source-Separated CDL Recycling: The process of separating recyclable materials in separate containers as they are generated on the job-site. The separated materials are hauled directly to a recycling facility or transfer station.
- F. Co-mingled CDL Recycling: The process of collecting mixed recyclable materials in one container on-site. The container is taken to a material recovery facility where materials are separated for recycling.
- G. Approved Recycling Facility: Any of the following:
 - 1. A facility that can legally accept CDL waste materials for the purpose of processing the materials into an altered form for the manufacture of a new product.
 - 2. Material Recovery Facility: A general term used to describe a waste-sorting facility.
 - a. Mechanical, hand-separation, or a combination of both procedures, are used to recover
 - b. recyclable materials.
- H. Universal waste components (UWC) are as follows: electric motors, PCB ballasts, non PCB ballasts, capacitors, contactors, circuit breakers, elemental and liquid mercury containing articles, transformers, lead acid batteries, fluorescent light bulbs, and all HID light bulbs.

1.03 SUBMITTALS

- A. Contractor shall develop a Waste Management Plan: Submit 3 copies of plan within 14 days of date established for the Notice to Proceed.
- B. Contractor shall provide Waste Management Report: Concurrent with each Application for Payment, submit 3 copies of report.

1.04 PERFORMANCE REQUIREMENTS

- A. General: Divert a minimum of 75% CDL waste, by weight, from the landfill by one, or a combination of the following activities:
 - 1. Salvage
 - 2. Reuse
 - 3. Source-Separated CDL Recycling
 - 4. Co-mingled CDL Recycling
- B. CDL waste materials that can be salvaged, reused or recycled include, but are not limited to, the following:
 - 1. Acoustical ceiling tiles

2. Asphalt
3. Asphalt shingles
4. Cardboard packaging
5. Carpet and carpet pad
6. Concrete
7. Drywall
8. Fluorescent lights and ballasts
9. Land clearing debris (vegetation, stumpage, dirt)
10. Metals
11. Paint (through hazardous waste outlets)
12. Wood
13. Plastic film (sheeting, shrink wrap, packaging)
14. Window glass
15. Wood
16. Field office waste, including office paper, aluminum cans, glass, plastic, and office cardboard.

1.05 QUALITY ASSURANCE

- A. Waste Management Coordinator Qualifications: Experienced firm, with a record of successful waste management coordination of projects with similar requirements, that employs a LEED Accredited Professional, certified by the USGBC as waste management coordinator.
- B. Refrigerant Recovery Technician Qualifications: Certified by EPA-approved certification program.
- C. Regulatory Requirements: Conduct construction waste management activities in accordance with hauling and disposal regulations of all authorities having jurisdiction and all other applicable laws and ordinances.
- D. Preconstruction Conference: Schedule and conduct meeting at Project site prior to construction activities.
 1. Attendees: Inform the following individuals, whose presence is required, of date and time of meeting.
 - a. Owner
 - b. Architect
 - c. Contractor's superintendent
 - d. Major subcontractors
 - e. Waste Management Coordinator
 - f. Other concerned parties.
 2. Agenda Items: Review methods and procedures related to waste management including, but not limited to, the following:
 - a. Review and discuss waste management plan including responsibilities of Waste Management Coordinator.
 - b. Review requirements for documenting quantities of each type of waste and its disposition.
 - c. Review and finalize procedures for materials separation and verify availability of containers and bins needed to avoid delays.
 - d. Review procedures for periodic waste collection and transportation to recycling and disposal facilities.
 - e. Review waste management requirements for each trade.
 3. Minutes: Record discussion. Distribute meeting minutes to all participants.
 - a. Note: If there is a Project Architect, they will perform this role.

1.06 WASTE MANAGEMENT PLAN – CONTACTOR SHALL DEVELOP AND DOCUMENT THE FOLLOWING:

- A. Develop a plan to meet the requirements listed in this section at a minimum. Plan shall consist of waste identification, waste reduction plan and cost/revenue analysis. Distinguish between demolition and construction waste. Indicate quantities by weight throughout the plan.
- B. Indicate anticipated types and quantities of demolition, site-cleaning and construction waste generated by the project. List all assumptions made for the quantities estimates.
- C. List each type of waste and whether it will be salvaged, recycled, or disposed of in an landfill. The plan should included the following information:
 1. Types and estimated quantities, by weight, of CDL waste expected to be generated during demolition and construction.
 2. Proposed methods for CDL waste salvage, reuse, recycling and disposal during demolition including, but not limited to, one or more of the following:
 - a. Contracting with a deconstruction specialist to salvage materials generated,
 - b. Selective salvage as part of demolition contractor's work,
 - c. Reuse of materials on-site or sale or donation to a third party.
 3. Proposed methods for salvage, reuse, recycling and disposal during construction including, but not limited to, one or more of the following:
 - a. Requiring subcontractors to take their CDL waste to a recycling facility;
 - b. Contracting with a recycling hauler to haul recyclable CDL waste to an approved recycling or material recovery facility;
 - c. Processing and reusing materials on-site;
 - d. Self-hauling to a recycling or material recovery facility.
 4. Name of recycling or material recovery facility receiving the CDL wastes.
 5. Handling and Transportation Procedures: Include method that will be used for separating recyclable waste including sizes of containers, container labeling, and designated location on project site where materials separation will be located.
- D. Cost/Revenue Analysis: Indicate total cost of waste disposal as if there was no waste management plan and net additional cost or net savings resulting from implementing waste management plan. Include the following:
 1. Total quantity of waste.
 2. Estimated cost of disposal (cost per unit). Include hauling and tipping fees and cost of collection containers for each type of waste.
 3. Total cost of disposal (with no waste management).
 4. Revenue from salvaged materials.
 5. Revenue from recycled materials.
 6. Savings in hauling and tipping fees by donating materials.
 7. Savings in hauling and tipping fees that are avoided.
 8. Handling and transportation costs. Including cost of collection containers for each type of waste.
 9. Net additional cost or net savings from waste management plan.

PART 2 - PRODUCTS (NOT USED)

PART 3 – EXECUTION

3.01 CONSTRUCTION WASTE MANAGEMENT, GENERAL

- A. Provide containers for CDL waste that is to be recycled clearly labeled as such with a list of acceptable and unacceptable materials. The list of acceptable materials must be the same as the materials recycled at the receiving material recovery facility or recycling processor.
- B. The collection containers for recyclable CDL waste must contain no more than 10% non-recyclable material, by volume.
- C. Provide containers for CDL waste that is disposed in a landfill clearly labeled as such.

- D. Use detailed material estimates to reduce risk of unplanned and potentially wasteful cuts.
- E. To the greatest extent possible, include in material purchasing agreements a waste reduction provision requesting that materials and equipment be delivered in packaging made of recyclable material, that they reduce the amount of packaging, that packaging be taken back for reuse or recycling, and to take back all unused product. Insure that subcontractors require the same provisions in their purchase agreements.
- F. Conduct regular visual inspections of dumpsters and recycling bins to remove contaminants.

3.02 SOURCE SEPARATION

- A. General: Contractor shall separate recyclable materials from CDL waste to the maximum extent possible.
- B. Separate recyclable materials by type.
 - 1. Provide containers, clearly labeled, by type of separated materials or provide other storage method for managing recyclable materials until they are removed from Project site.
 - 2. Stockpile processed materials on-site without intermixing with other materials. Place, grade, and shape stockpiles to drain surface water and to minimize pest attraction. Cover to prevent windblown dust.
 - 3. Stockpile materials away from demolition area. Do not store within drip line of remaining trees.
 - 4. Store components off the ground and protect from weather.

3.03 CO-MINGLED RECYCLING

- A. General: Do not put CDL waste that will be disposed in a landfill into a co-mingled CDL waste recycling container.

3.04 REMOVAL OF CONSTRUCTION WASTE MATERIALS

- A. Remove CDL waste materials from project site on a regular basis. Do not allow CDL waste to accumulate on-site.
- B. Transport CDL waste materials off Owner's property and legally dispose of them.
- C. Burning of CDL waste is not permitted.

3.05 UNIVERSAL WASTE DIVERSION

- A. Remove all universal waste from fixtures, panels, and related devices for proper diversion and reclamation.
- B. Store all universal waste in containers provided by contact person within facilities operations.
- C. Store all universal waste in a secured location and request periodic removal from assigned contact person.
- D. Exemption: electric motors, circuit breakers, transformers and lighting contactors are exempt from this provision provided the contractor chooses to salvage or reuse the components.
- E. No identified universal waste will be discarded into the waste stream.

PERCENTAGE OF WASTE DIVERTED	(TOTAL WASTE DIVIDED BY TOTAL DIVERTED)
---	--

END OF SECTION

**SECTION 01 78 00
CLOSEOUT SUBMITTALS**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Project record documents.
- B. Operation and maintenance data.
- C. Closeout Document Checklist
- D. Warranties and bonds.

1.02 RELATED REQUIREMENTS

- A. Division 00 Documents
- B. Section 01 30 00 - Administrative Requirements: Submittals procedures, shop drawings, product data, and samples.
- C. Section 01 70 00 - Execution and Closeout Requirements: Contract closeout procedures.
- D. Individual Product Sections: Specific requirements for operation and maintenance data.
- E. Individual Product Sections: Warranties required for specific products or Work.

1.03 SUBMITTALS

- A. Project Record Documents: Submit documents to DEDC, LLC prior to final payment application. The following documents must be submitted:
 - 1. Red line drawings (As-Built)
 - a. One original paper copy
 - b. Two copies of the original
- B. Electronic Documentation: Submit the electronic documentation on two long duration archival cd storage devices with gold lacquer finish. The following electronic data shall be included on each CD:
 - 1. Scanned copy of the As-Built in PDF format.
 - 2. Revised AutoCAD (release 2007 or later) drawing. Original copy of the AutoCAD file will be provided upon request.
 - 3. Approved project submittals (PDF Format).
 - 4. Operation and Maintenance Data (PDF Format)
- C. Operation and Maintenance Data:
 - 1. Submit two copies of preliminary draft or proposed formats and outlines of contents before start of Work. DEDC, LLC will review draft and return one copy with comments.
 - 2. For equipment, or component parts of equipment put into service during construction and operated by State of Delaware OMB - Division of Facilities Management, submit completed documents within ten days after acceptance.
 - 3. Submit one copy of completed documents 15 days prior to final inspection. This copy will be reviewed and returned after final inspection, with DEDC, LLC comments. Revise content of all document sets as required prior to final submission.
 - 4. Submit two sets of revised final documents in a 3-ring binder in final form within 10 days after final inspection.
- D. Warranties and Bonds:
 - 1. For equipment or component parts of equipment put into service during construction with State of Delaware OMB - Division of Facilities Management's permission, submit documents within 10 days after acceptance.
 - 2. Make other submittals within 10 days after Date of Substantial Completion, prior to final Application for Payment.

3. For items of Work for which acceptance is delayed beyond Date of Substantial Completion, submit within 10 days after acceptance, listing the date of acceptance as the beginning of the warranty period.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION

3.01 PROJECT RECORD DOCUMENTS

- A. Maintain on site one set of the following record documents; record actual revisions to the Work:
 1. Drawings.
 2. Addenda.
 3. Change Orders and other modifications to the Contract.
 4. Manufacturer's instruction for assembly, installation, and adjusting.
- B. Ensure entries are complete and accurate, enabling future reference by State of Delaware OMB - Division of Facilities Management.
- C. Store record documents separate from documents used for construction.
- D. Record information concurrent with construction progress.
- E. Record Drawings: Legibly mark each item to record actual construction including:
 1. Field changes of dimension and detail.
 2. Details not on original Contract drawings.

3.02 OPERATION AND MAINTENANCE DATA

- A. Source Data: For each product or system, list names, addresses and telephone numbers of Subcontractors and suppliers, including local source of supplies and replacement parts.
- B. Product Data: Mark each sheet to clearly identify specific products and component parts, and data applicable to installation. Delete inapplicable information.
- C. Drawings: Supplement product data to illustrate relations of component parts of equipment and systems, to show control and flow diagrams. Do not use Project Record Documents as maintenance drawings.
- D. Typed Text: As required to supplement product data. Provide logical sequence of instructions for each procedure, incorporating manufacturer's instructions.

3.03 OPERATION AND MAINTENANCE DATA FOR EQUIPMENT AND SYSTEMS

- A. For Each Item of Equipment and Each System:
 1. Description of unit or system, and component parts.
 2. Identify function, normal operating characteristics, and limiting conditions.
 3. Include performance curves, with engineering data and tests.
 4. Complete nomenclature and model number of replaceable parts.
- B. Where additional instructions are required, beyond the manufacturer's standard printed instructions, have instructions prepared by personnel experienced in the operation and maintenance of the specific products.
- C. Panelboard Circuit Directories: Provide electrical service characteristics, controls, and communications; typed.
- D. Operating Procedures: Include start-up, break-in, and routine normal operating instructions and sequences. Include regulation, control, stopping, shut-down, and emergency instructions. Include summer, winter, and any special operating instructions.
- E. Maintenance Requirements: Include routine procedures and guide for preventative maintenance and trouble shooting; disassembly, repair, and reassembly instructions; and alignment, adjusting, balancing, and checking instructions.
- F. Provide servicing and lubrication schedule, and list of lubricants required.
- G. Include manufacturer's printed operation and maintenance instructions.

- H. Include sequence of operation by controls manufacturer.
- I. Provide original manufacturer's parts list, illustrations, assembly drawings, and diagrams required for maintenance.
- J. Provide control diagrams by controls manufacturer as installed.
- K. Include test and balancing reports.
- L. Additional Requirements: As specified in individual product specification sections.

3.04 ASSEMBLY OF OPERATION AND MAINTENANCE MANUALS

- A. Assemble operation and maintenance data into durable manuals for State of Delaware OMB - Division of Facilities Management's personnel use, with data arranged in the same sequence as, and identified by, the specification sections.
- B. Where systems involve more than one specification section, provide separate tabbed divider for each system.
- C. Binders: Commercial quality, 8-1/2 by 11 inch three D side ring binders with durable plastic covers; 2 inch maximum ring size. When multiple binders are used, correlate data into related consistent groupings.
- D. Cover: Identify each binder with typed or printed title OPERATION AND MAINTENANCE INSTRUCTIONS; identify title of Project; identify subject matter of contents.
- E. Project Directory: Title and address of Project; names, addresses, and telephone numbers of DEDC, LLC, Consultants, Contractor and subcontractors, with names of responsible parties.
- F. Tables of Contents: List every item separated by a divider, using the same identification as on the divider tab; where multiple volumes are required, include all volumes Tables of Contents in each volume, with the current volume clearly identified.
- G. Dividers: Provide tabbed dividers for each separate product and system; identify the contents on the divider tab; immediately following the divider tab include a description of product and major component parts of equipment.
- H. Text: Manufacturer's printed data, or typewritten data on 24 pound paper.
- I. Drawings: Provide with reinforced punched binder tab. Bind in with text; fold larger drawings to size of text pages.

3.05 CLOSEOUT DOCUMENT CHECKLIST

- A. Form G704 Substantial Completion
- B. Form G706 Affidavit of Payment of Debts and Claims
- C. Form 706A Release of Liens Contractor / Subcontractor
- D. Individual Contractor and Subcontractor Release and Waiver of Liens
- E. Form 707 Consent of Surety Company
- F. Final Payment App (to be added after review/approval of closeout docs)
- G. Design Review Summaries (to be added by Architect)
- H. Meeting Minutes (to be added by Architect)
- I. Approved Product and Equipment Submittals, Tabbed by Specification No. (Include Architects approval stamp and comments)
- J. Certificate of Occupancy
- K. Environmental Certificates
- L. Warranties (Letter of Guarantee and Warranty Info) (note extended equipment warranty requirements)
- M. Warranty (Subcontractor) Contact List

- N. Operation, Maintenance, & Cleaning Requirements for all products and Equipment (Tabbed by specification)
- O. Hard Copies of As-Built Drawings
- P. 2 sets of Archive grade discs to include updated as-built drawings and updated AutoCAD files (Contractor and Architect to coordinate), copy of final specifications/Project Manual (by Architect), tabbed copy of all closeout documents.
- Q. Test & Balancing Reports
- R. Field Reports/Inspection Reports
- S. Pest Control Final Inspection Report & Warranty (Slabs over 400SF)
- T. Affidavit of Discharge of State Tax Liability
- U. Copy of completed final punch list signed off on by Owner's Representative (By Architect)
- V. Punch list Closeout Letter.
- W. General correspondence (to be added by the Owner)
- X. Contractor to organize package using tabs per the above numbering sequence and include a "Table of Contents" in binders of sufficient size and quality to contain the documentation and enough space for items to be added by the Architect, without being overloaded.
- Y. Submissions are to include all documents listed above, unless identified by others. Architect shall verify that all items are complete and correct, then certify, and add copies of the certified application for payment to the package and archive disc. Once approved by the Architect, the package will be forwarded to the Owner.
- Z. The above item "F" indicates a copy of the final application is to be added. This is intended as a copy. The original should be forwarded to the A/E for certification separately from the closeout package. The final application will not be certified until all other closeout documents are complete and approved.

3.06 WARRANTIES AND BONDS

- A. Obtain warranties and bonds, executed in duplicate by responsible Subcontractors, suppliers, and manufacturers, within 10 days after completion of the applicable item of work. Except for items put into use with State of Delaware OMB - Division of Facilities Management's permission, leave date of beginning of time of warranty until Date of Substantial completion is determined.
- B. Verify that documents are in proper form, contain full information, and are notarized.
- C. Co-execute submittals when required.
- D. Retain warranties and bonds until time specified for submittal.

END OF SECTION

**SECTION 01 79 00
DEMONSTRATION AND TRAINING**

PART 1 GENERAL

1.01 SUMMARY

- A. Demonstration of products and systems to be commissioned and where indicated in specific specification sections.
- B. Training of State of Delaware OMB - Division of Facilities Management personnel in operation and maintenance is required for:
 - 1. All software-operated systems.
 - 2. HVAC systems and equipment.
 - 3. Plumbing equipment.
 - 4. Electrical systems and equipment.
 - 5. Items specified in individual product Sections.
- C. Training of State of Delaware OMB - Division of Facilities Management personnel in care, cleaning, maintenance, and repair is required for:
 - 1. Finishes, including flooring, wall finishes, ceiling finishes.
 - 2. Fixtures and fittings.
 - 3. Items specified in individual product Sections.

1.02 RELATED REQUIREMENTS

- A. Section 01 78 00 - Closeout Submittals: Operation and maintenance manuals.
- B. Section 01 91 13 - General Commissioning Requirements: Additional requirements applicable to demonstration and training.

1.03 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures; except:
 - 1. Make all submittals specified in this section, and elsewhere where indicated for commissioning purposes, directly to the Commissioning Authority.
 - 2. Submit one copy to the Commissioning Authority, not to be returned.
 - 3. Make commissioning submittals on time schedule specified by Commissioning Authority.
 - 4. Submittals indicated as "Draft" are intended for the use of the Commissioning Authority in preparation of overall Training Plan; submit in editable electronic format, Microsoft Word 2003 preferred.
- B. Draft Training Plans: State of Delaware OMB - Division of Facilities Management will designate personnel to be trained; tailor training to needs and skill-level of attendees.
 - 1. Submit to DEDC, LLC for transmittal to State of Delaware OMB - Division of Facilities Management.
 - 2. Submit to Commissioning Authority for review and inclusion in overall training plan.
 - 3. Submit not less than four weeks prior to start of training.
 - 4. Revise and resubmit until acceptable.
 - 5. Provide an overall schedule showing all training sessions.
 - 6. Include at least the following for each training session:
 - a. Identification, date, time, and duration.
 - b. Description of products and/or systems to be covered.
 - c. Name of firm and person conducting training; include qualifications.
 - d. Intended audience, such as job description.
 - e. Objectives of training and suggested methods of ensuring adequate training.
 - f. Methods to be used, such as classroom lecture, live demonstrations, hands-on, etc.
 - g. Media to be used, such as slides, hand-outs, etc.
 - h. Training equipment required, such as projector, projection screen, etc., to be provided by Contractor.

- C. Training Manuals: Provide training manual for each attendee; allow for minimum of two attendees per training session.
 - 1. Include applicable portion of O&M manuals.
 - 2. Include copies of all hand-outs, slides, overheads, video presentations, etc., that are not included in O&M manuals.
 - 3. Provide one extra copy of each training manual to be included with operation and maintenance data.
- D. Training Reports:
 - 1. Identification of each training session, date, time, and duration.
 - 2. Sign-in sheet showing names and job titles of attendees.
 - 3. List of attendee questions and written answers given, including copies of and references to supporting documentation required for clarification; include answers to questions that could not be answered in original training session.
 - 4. Include Commissioning Authority's formal acceptance of training session.
- E. Video Recordings: Submit digital video recording of each demonstration and training session for State of Delaware OMB - Division of Facilities Management's subsequent use.
 - 1. Format: DVD Disc.
 - 2. Label each disc and container with session identification and date.

1.04 QUALITY ASSURANCE

- A. Instructor Qualifications: Familiar with design, operation, maintenance and troubleshooting of the relevant products and systems.
 - 1. Provide as instructors the most qualified trainer of those contractors and/or installers who actually supplied and installed the systems and equipment.
 - 2. Where a single person is not familiar with all aspects, provide specialists with necessary qualifications.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION

3.01 DEMONSTRATION - GENERAL

- A. Demonstrations conducted during system start-up do not qualify as demonstrations for the purposes of this section, unless approved in advance by State of Delaware OMB - Division of Facilities Management.
- B. Demonstrations conducted during Functional Testing need not be repeated unless State of Delaware OMB - Division of Facilities Management personnel training is specified.
- C. Demonstration may be combined with State of Delaware OMB - Division of Facilities Management personnel training if applicable.
- D. Operating Equipment and Systems: Demonstrate operation in all modes, including start-up, shut-down, seasonal changeover, emergency conditions, and troubleshooting, and maintenance procedures, including scheduled and preventive maintenance.
 - 1. Perform demonstrations not less than two weeks prior to Substantial Completion.
 - 2. For equipment or systems requiring seasonal operation, perform demonstration for other season within six months.
- E. Non-Operating Products: Demonstrate cleaning, scheduled and preventive maintenance, and repair procedures.
 - 1. Perform demonstrations not less than two weeks prior to Substantial Completion.

3.02 TRAINING - GENERAL

- A. Commissioning Authority will prepare the Training Plan based on draft plans submitted.
- B. Conduct training on-site unless otherwise indicated.
- C. State of Delaware OMB - Division of Facilities Management will provide classroom and seating at no cost to Contractor.

- D. Do not start training until Functional Testing is complete, unless otherwise specified or approved by the Commissioning Authority.
- E. Provide training in minimum two hour segments.
- F. The Commissioning Authority is responsible for determining that the training was satisfactorily completed and will provide approval forms.
- G. Training schedule will be subject to availability of State of Delaware OMB - Division of Facilities Management's personnel to be trained; re-schedule training sessions as required by State of Delaware OMB - Division of Facilities Management; once schedule has been approved by State of Delaware OMB - Division of Facilities Management failure to conduct sessions according to schedule will be cause for State of Delaware OMB - Division of Facilities Management to charge Contractor for personnel "show-up" time.
- H. Review of Facility Policy on Operation and Maintenance Data: During training discuss:
 - 1. The location of the O&M manuals and procedures for use and preservation; backup copies.
 - 2. Typical contents and organization of all manuals, including explanatory information, system narratives, and product specific information.
 - 3. Typical uses of the O&M manuals.
- I. Product- and System-Specific Training:
 - 1. Review the applicable O&M manuals.
 - 2. For systems, provide an overview of system operation, design parameters and constraints, and operational strategies.
 - 3. Review instructions for proper operation in all modes, including start-up, shut-down, seasonal changeover and emergency procedures, and for maintenance, including preventative maintenance.
 - 4. Provide hands-on training on all operational modes possible and preventive maintenance.
 - 5. Emphasize safe and proper operating requirements; discuss relevant health and safety issues and emergency procedures.
 - 6. Discuss common troubleshooting problems and solutions.
 - 7. Discuss any peculiarities of equipment installation or operation.
 - 8. Discuss warranties and guarantees, including procedures necessary to avoid voiding coverage.
 - 9. Review recommended tools and spare parts inventory suggestions of manufacturers.
 - 10. Review spare parts and tools required to be furnished by Contractor.
 - 11. Review spare parts suppliers and sources and procurement procedures.
- J. Be prepared to answer questions raised by training attendees; if unable to answer during training session, provide written response within three days.

END OF SECTION

NOT FOR BIDDING PURPOSES

THIS PAGE INTENTIONALLY LEFT BLANK

SECTION 01 91 13
GENERAL COMMISSIONING REQUIREMENTS

PART 1 GENERAL

1.01 SUMMARY

- A. Commissioning is intended to achieve the following specific objectives; this section specifies the Contractor's responsibilities for commissioning:
 - 1. Verify that the work is installed in accordance with the Contract Documents, the manufacturer's recommendations and instructions, and that it receives adequate operational checkout prior to startup: Startup reports are utilized to achieve this.
 - 2. Verify and document that functional performance is in accordance with the Contract Documents: Functional Tests such as manufacturers startup reports, balancing, and site demonstrations executed by the contractor and witnessed by the Commissioning Authority are utilized to achieve this.
 - 3. Verify that operation and maintenance manuals submitted to State of Delaware OMB - Division of Facilities Management are complete: Detailed operation and maintenance (O&M) data submittals by Contractor are utilized to achieve this.
 - 4. Verify that the State of Delaware OMB - Division of Facilities Management's operating personnel are adequately trained: Formal training conducted by Contractor is utilized to achieve this.
- B. The Commissioning Authority is the State of Delaware OMB - Division of Facilities Management

1.02 SCOPE OF COMMISSIONING

- A. The following are to be commissioned:
- B. HVAC System, including:
 - 1. Major and minor equipment items.
 - 2. Piping systems and equipment.
 - 3. Ductwork and accessories.
 - 4. Control system.
 - 5. Variable frequency drives.
- C. Other equipment and systems explicitly identified elsewhere in Contract Documents as requiring commissioning.

1.03 RELATED REQUIREMENTS

- A. Section 01 70 00 - Execution and Closeout Requirements: General startup requirements.
- B. Section 01 78 00 - Closeout Submittals: Scope and procedures for operation and maintenance manuals and project record documents.
- C. Section 01 79 00 - Demonstration and Training: Scope and procedures for State of Delaware OMB - Division of Facilities Management personnel training.
- D. Section 23 08 00 - Commissioning of HVAC: HVAC control system testing; other requirements.
- E. Section 23 09 59 - BAS System Commissioning

1.04 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures, General Requirements:
- B. Make all submittals specified in this section, and elsewhere where indicated for commissioning purposes, directly to the Commissioning Authority, unless they require review by DEDC, LLC; in that case, submit to DEDC, LLC first.
- C. Product Data: If submittals to DEDC, LLC do not include the following, submit copies as soon as possible:
- D. Product Data: Submit to DEDC, LLC:
 - 1. Manufacturer's product data, cut sheets, and shop drawings.

2. Manufacturer's installation instructions.
 3. Startup, operating, and troubleshooting procedures.
 4. Fan and pump curves.
 5. Factory test reports.
 6. Warranty information, including details of State of Delaware OMB - Division of Facilities Management's responsibilities in regard to keeping warranties in force.
- E. Manufacturers' Instructions: Submit copies of all manufacturer-provided instructions that are shipped with the equipment as soon as the equipment is delivered.
- F. Startup Plans and Reports.

PART 2 PRODUCTS

2.01 TEST EQUIPMENT

- A. Provide all standard testing equipment required to perform startup and initial checkout and required Functional Testing; unless otherwise noted such testing equipment will NOT become the property of State of Delaware OMB - Division of Facilities Management.
- B. Calibration Tolerances: Provide testing equipment of sufficient quality and accuracy to test and/or measure system performance with the tolerances specified. If not otherwise noted, the following minimum requirements apply:
1. Temperature Sensors and Digital Thermometers: Certified calibration within past year to accuracy of 0.5 degree F and resolution of plus/minus 0.1 degree F.
 2. Pressure Sensors: Accuracy of plus/minus 2.0 percent of the value range being measured (not full range of meter), calibrated within the last year.
 3. Calibration: According to the manufacturer's recommended intervals and when dropped or damaged; affix calibration tags or keep certificates readily available for inspection.
- C. Equipment-Specific Tools: Where special testing equipment, tools and instruments are specific to a piece of equipment, are only available from the vendor, and are required in order to accomplish startup or Functional Testing, provide such equipment, tools, and instruments as part of the work at no extra cost to State of Delaware OMB - Division of Facilities Management; such equipment, tools, and instruments are to become the property of State of Delaware OMB - Division of Facilities Management.

PART 3 EXECUTION

3.01 STARTUP PLANS AND REPORTS

- A. Startup Plans: For each item of equipment and system for which the manufacturer provides a startup plan, submit the plan not less than 2 weeks prior to startup.
- B. Startup Reports: For each item of equipment and system for which the manufacturer provides a startup checklist (or startup plan or field checkout sheet), document compliance by submitting the completed startup checklist prior to startup, signed and dated by responsible entity.
- C. Submit directly to the Commissioning Authority and DEDC, LLC.

3.02 FUNCTIONAL TESTS

- A. A Functional Test is required for each item of equipment, system, or other assembly specified to be commissioned, unless sampling of multiple identical or near-identical units is allowed by the final test procedures.
- B. Commissioning Authority is responsible for witnessing results of Functional Tests.
- C. Contractor is responsible for correction of deficiencies and re-testing at no extra cost to State of Delaware OMB - Division of Facilities Management; if a deficiency is not corrected and re-tested immediately, the Commissioning Authority will document the deficiency and the Contractor's stated intentions regarding correction.
1. Deficiencies are any condition in the installation or function of a component, piece of equipment or system that is not in compliance with Contract Documents or does not perform properly.

2. When the deficiency has been corrected, the Contractor completes the form certifying that the item is ready to be re-tested and returns the form to the Commissioning Authority; the Commissioning Authority will reschedule the test and the Contractor shall re-test.
 3. Identical or Near-Identical Items: If 10 percent, or three, whichever is greater, of identical or near-identical items fail to perform due to material or manufacturing defect, all items will be considered defective; provide a proposal for correction within 2 weeks after notification of defect, including provision for testing sample installations prior to replacement of all items.
 4. Contractor shall bear the cost of State of Delaware OMB - Division of Facilities Management and Commissioning Authority personnel time witnessing re-testing.
- D. Functional Test Procedures:
1. Some test procedures are included in Contract Documents; where Functional Test procedures are not included in Contract Documents, test procedures will be determined by the Commissioning Authority with input by and coordination with Contractor.
 2. Examples of Functional Testing:
 - a. Test the dynamic function and operation of equipment and systems (rather than just components) using manual (direct observation) or monitoring methods under full operation (e.g., the chiller pump is tested interactively with the chiller functions to see if the pump ramps up and down to maintain the differential pressure setpoint).
 - b. Systems are tested under various modes, such as during low cooling or heating loads, high loads, component failures, unoccupied, varying outside air temperatures, fire alarm, power failure, etc.
 - c. Systems are run through all the HVAC control system's sequences of operation and components are verified to be responding as the sequence's state.
 - d. Traditional air or water test and balancing (TAB) is not Functional Testing; spot checking of TAB by demonstration to the Commissioning Authority is Functional Testing.
- E. Deferred Functional Tests: Some tests may need to be performed later, after substantial completion, due to partial occupancy, equipment, seasonal requirements, design or other site conditions; performance of these tests remains the Contractor's responsibility regardless of timing.

3.03 TEST PROCEDURES - GENERAL

- A. Provide skilled technicians to execute starting of equipment and to execute the Functional Tests. Ensure that they are available and present during the agreed upon schedules and for sufficient duration to complete the necessary tests, adjustments and problem-solving.
- B. Provide all necessary materials and system modifications required to produce the flows, pressures, temperatures, and conditions necessary to execute the test according to the specified conditions. At completion of the test, return all affected equipment and systems to their pre-test condition.
- C. Simulating Signals: Disconnect the sensor and use a signal generator to send an amperage, resistance or pressure to the transducer and control system to simulate the sensor value.

3.04 OPERATION AND MAINTENANCE MANUALS

- A. See Section 01 78 00 - Closeout Submittals for additional requirements.
- B. Add design intent documentation furnished by DEDC, LLC to manuals prior to submission to State of Delaware OMB - Division of Facilities Management.

END OF SECTION

NOT FOR BIDDING PURPOSES

THIS PAGE INTENTIONALLY LEFT BLANK

**SECTION 02 41 00
DEMOLITION**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Selective demolition of built site elements.
- B. Selective demolition of building elements for alteration purposes.

1.02 RELATED REQUIREMENTS

- A. Section 00 31 00 - Available Project Information: Existing building survey conducted by Owner; information about known hazardous materials.
- B. Section 01 10 00 - Summary: Limitations on Contractor's use of site and premises.
- C. Section 01 50 00 - Temporary Facilities and Controls: Site fences, security, protective barriers, and waste removal.
- D. Section 01 57 13 - Temporary Erosion and Sediment Control.
- E. Section 01 70 00 - Execution and Closeout Requirements: Project conditions; protection of bench marks, survey control points, and existing construction to remain; reinstallation of removed products; temporary bracing and shoring.
- F. Section 01 74 19 - Construction Waste Management and Disposal: Limitations on disposal of removed materials; requirements for recycling.
- G. Section 32 91 19 - Landscape Grading: Topsoil placement and finish grading.

1.03 DEFINITIONS

- A. Demolish: Dismantle, raze, destroy, or wreck any building or structure or any part thereof.
- B. Remove: Detach or dismantle items from existing construction and dispose of them off site, unless items are indicated to be salvaged or reinstalled.
- C. Remove and Salvage: Detach or dismantle items from existing construction in a manner to prevent damage. Clean, package, label and deliver salvaged items to Owner in ready-for-reuse condition.
- D. Remove and Reinstall: Detach or dismantle items from existing construction in a manner to prevent damage. Clean and prepare for reuse and reinstall where indicated.
- E. Existing to Remain: Designation for existing items that are not to be removed and that are not otherwise indicated to be salvaged or reinstalled.

1.04 REFERENCE STANDARDS

- A. 29 CFR 1926 - Safety and Health Regulations for Construction; Current Edition.
- B. NFPA 241 - Standard for Safeguarding Construction, Alteration, and Demolition Operations; 2027.

1.05 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements for submittal procedures.
- B. Demolition Plan: Submit demolition plan as required by OSHA and local AHJs.
 - 1. Indicate extent of demolition, removal sequencing, bracing and shoring, and location and construction of barricades and fences.
 - 2. Summary of safety procedures.
 - 3. Demolition firm qualifications.

1.06 QUALITY ASSURANCE

- A. Demolition Firm Qualifications: Company specializing in the type of work required.

1. Minimum of 10 years of documented experience.

PART 2 PRODUCTS

2.01 MATERIALS

PART 3 EXECUTION

3.01 GENERAL PROCEDURES AND PROJECT CONDITIONS

- A. Comply with requirements in Section 01 70 00.
- B. Comply with applicable codes and regulations for demolition operations and safety of adjacent structures and the public.
 1. Obtain required permits.
 2. Comply with applicable requirements of NFPA 241.
 3. Use of explosives is not permitted.
 4. Take precautions to prevent catastrophic or uncontrolled collapse of structures to be removed; do not allow worker or public access within range of potential collapse of unstable structures.
 5. Provide, erect, and maintain temporary barriers and security devices.
 6. Conduct operations to minimize effects on and interference with adjacent structures and occupants.
 7. Do not close or obstruct roadways or sidewalks without permits from authority having jurisdiction.
 8. Conduct operations to minimize obstruction of public and private entrances and exits. Do not obstruct required exits at any time. Protect persons using entrances and exits from removal operations.
 9. Obtain written permission from owners of adjacent properties when demolition equipment will traverse, infringe upon, or limit access to their property.
- C. Do not begin removal until receipt of notification to proceed from Owner.
- D. Do not begin removal until building elements to be salvaged or relocated have been removed.
- E. Do not begin removal until vegetation to be relocated has been removed and vegetation to remain has been protected from damage.
- F. Protect existing structures and other elements to remain in place and not removed.
 1. Provide bracing and shoring.
 2. Prevent movement or settlement of adjacent structures.
 3. Stop work immediately if adjacent structures appear to be in danger.
- G. Minimize production of dust due to demolition operations. Do not use water if that will result in ice, flooding, sedimentation of public waterways or storm sewers, or other pollution.
- H. Hazardous Materials:
 1. If hazardous materials are discovered during removal operations, stop work and notify Architect and Owner; hazardous materials include regulated asbestos containing materials, lead, PCBs, and mercury.
- I. Perform demolition in a manner that maximizes salvage and recycling of materials.
 1. Comply with requirements of Section 01 74 19 - Construction Waste Management and Disposal.
 2. Dismantle existing construction and separate materials.
 3. Set aside reusable, recyclable, and salvageable materials; store and deliver to collection point or point of reuse.

3.02 SELECTIVE DEMOLITION FOR ALTERATIONS

- A. Existing construction and utilities indicated on drawings are based on casual field observation and existing record documents only.
 1. Verify construction and utility arrangements are as indicated.

2. Report discrepancies to Architect before disturbing existing installation.
3. Beginning of demolition work constitutes acceptance of existing conditions that would be apparent upon examination prior to starting demolition.
- B. Separate areas in which demolition is being conducted from areas that remain occupied.
 1. Provide, erect, and maintain temporary dustproof partitions of construction specified in Section 01 50 00 in locations indicated on drawings.
 2. Provide sound retardant partitions of construction and in locations indicated on drawings.
- C. Maintain weatherproof exterior building enclosure, except for interruptions required for replacement or modifications; prevent water and humidity damage.
- D. Remove existing work as indicated and required to accomplish new work.
 1. Remove rotted wood, corroded metals, and deteriorated masonry and concrete; replace with new construction indicated.
 2. Remove items indicated on drawings.
- E. Services including, but not limited to, HVAC, Plumbing, Fire Protection, Electrical, and Telecommunications: Remove existing systems and equipment as indicated.
 1. Maintain existing active systems to remain in operation, and maintain access to equipment and operational components.
 2. Where existing active systems serve occupied facilities but are to be replaced with new services, maintain existing systems in service until new systems are complete and ready for service.
 3. See Section 01 10 00 - Summary for limitations on outages and required notifications.
 4. Verify that abandoned services serve only abandoned facilities before removal.
 5. Remove abandoned pipe, ducts, conduits, and equipment, including those above accessible ceilings. Remove back to source of supply where possible, otherwise cap stub and tag with identification.
- F. Protect existing work to remain.
 1. Prevent movement of structure. Provide shoring and bracing as required.
 2. Perform cutting to accomplish removal work neatly and as specified for cutting new work.
 3. Repair adjacent construction and finishes damaged during removal work.
 4. Patch to match new work.

3.03 DEBRIS AND WASTE REMOVAL

- A. Remove debris, junk, and trash from site.
- B. Remove materials not to be reused on site; comply with requirements of Section 01 74 19 - Waste Management.
- C. Leave site in clean condition, ready for subsequent work.
- D. Clean up spillage and wind-blown debris from public and private lands.

END OF SECTION 02 41 00

NOT FOR BIDDING PURPOSES

This page intentionally left blank

**SECTION 03 30 00
CAST-IN-PLACE CONCRETE**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Concrete formwork.
- B. Concrete reinforcement.
- C. Miscellaneous concrete elements, including equipment pads.
- D. Concrete curing.

1.02 REFERENCE STANDARDS

- A. ACI 117 - Specification for Tolerances for Concrete Construction and Materials; 2010 (Reapproved 2015).
- B. ACI 211.1 - Selecting Proportions for Normal-Density and High Density-Concrete - Guide; 2022.
- C. ACI 301 - Specifications for Concrete Construction; 2020.
- D. ACI 304R - Guide for Measuring, Mixing, Transporting, and Placing Concrete; 2000 (Reapproved 2009).
- E. ACI 306R - Guide to Cold Weather Concreting; 2016.
- F. ACI 308R - Guide to External Curing of Concrete; 2016.
- G. ACI 318 - Building Code Requirements for Structural Concrete; 2019 (Reapproved 2022).
- H. ACI 347R - Guide to Formwork for Concrete; 2014 (Reapproved 2021).
- I. ACI CODE-318 - Building Code Requirements for Structural Concrete and Commentary; 2019 (Reapproved 2022).
- J. ACI PRC-211.1 - Selecting Proportions for Normal-Density and High Density-Concrete - Guide; 2022.
- K. ACI PRC-304 - Guide for Measuring, Mixing, Transporting, and Placing Concrete; 2000 (Reapproved 2009).
- L. ACI PRC-306 - Guide to Cold Weather Concreting; 2016.
- M. ACI PRC-308 - Guide to External Curing of Concrete; 2016.
- N. ACI PRC-347 - Guide to Formwork for Concrete; 2014 (Reapproved 2021).
- O. ACI SPEC-117 - Specification for Tolerances for Concrete Construction and Materials; 2010 (Reapproved 2015).
- P. ACI SPEC-301 - Specifications for Concrete Construction; 2020.
- Q. ASTM A615/A615M - Standard Specification for Deformed and Plain Carbon-Steel Bars for Concrete Reinforcement; 2024.
- R. ASTM C33/C33M - Standard Specification for Concrete Aggregates; 2024a.
- S. ASTM C39/C39M - Standard Test Method for Compressive Strength of Cylindrical Concrete Specimens; 2024.
- T. ASTM C143/C143M - Standard Test Method for Slump of Hydraulic-Cement Concrete; 2020.
- U. ASTM C150/C150M - Standard Specification for Portland Cement; 2024.
- V. ASTM C171 - Standard Specification for Sheet Materials for Curing Concrete; 2020.
- W. ASTM C618 - Standard Specification for Coal Ash and Raw or Calcined Natural Pozzolan for Use in Concrete; 2025a.
- X. ASTM C685/C685M - Standard Specification for Concrete Made by Volumetric Batching and Continuous Mixing; 2024.

- Y. ASTM C1240 - Standard Specification for Silica Fume Used in Cementitious Mixtures; 2020.

1.03 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements for submittal procedures.
- B. Product Data: Submit manufacturers' data on manufactured products showing compliance with specified requirements and installation instructions.
- C. Test Reports: Submit report for each test or series of tests specified.

1.04 QUALITY ASSURANCE

- A. Perform work of this section in accordance with ACI SPEC-301 and ACI CODE-318.
 - 1. Maintain one copy of each document on site.
- B. Follow recommendations of ACI PRC-306 when concreting during cold weather.

PART 2 PRODUCTS

2.01 FORMWORK

- A. Formwork Design and Construction: Comply with guidelines of ACI PRC-347 to provide formwork that will produce concrete complying with tolerances of ACI SPEC-117.
- B. Form Materials: Contractor's choice of standard products with sufficient strength to withstand hydrostatic head without distortion in excess of permitted tolerances.
 - 1. Form Ties: Cone snap type that will leave no metal within 1-1/2 inches of concrete surface.

2.02 REINFORCEMENT MATERIALS

- A. Reinforcing Steel: ASTM A615/A615M, Grade 60 (60,000 psi).
- B. Reinforcement Accessories:
 - 1. Tie Wire: Annealed, minimum 16 gauge, 0.0508 inch.

2.03 CONCRETE MATERIALS

- A. Cement: ASTM C150/C150M, Type I - Normal Portland type.
 - 1. Acquire cement for entire project from same source.
- B. Fine and Coarse Aggregates: ASTM C33/C33M.
 - 1. Acquire aggregates for entire project from same source.
- C. Fly Ash: ASTM C618, Class C or F.
- D. Calcined Pozzolan: ASTM C618, Class N.
- E. Silica Fume: ASTM C1240, proportioned in accordance with ACI PRC-211.1.

2.04 ACCESSORY MATERIALS

- A. Moisture-Retaining Cover: ASTM C 171; regular curing paper, white curing paper, clear polyethylene, or white polyethylene.

2.05 CONCRETE MIX DESIGN

- A. Proportioning Normal Weight Concrete: Comply with ACI PRC-211.1 recommendations.
- B. Concrete Strength: Establish required average strength for each type of concrete on the basis of field experience or trial mixtures, as specified in ACI SPEC-301.
 - 1. For trial mixtures method, employ independent testing agency acceptable to DEDC, LLC for preparing and reporting proposed mix designs.
- C. Normal Weight Concrete:
 - 1. Compressive Strength, when tested in accordance with ASTM C 39/C 39M at 28 days: As scheduled in part 3.09.
 - 2. Fly Ash Content: Maximum 15 percent of cementitious materials by weight.
 - 3. Calcined Pozzolan Content: Maximum 10 percent of cementitious materials by weight.
 - 4. Silica Fume Content: Maximum 5 percent of cementitious materials by weight.

5. Maximum Aggregate Size: 5/8 inch.

2.06 MIXING

- A. On Project Site: Mix in drum type batch mixer, complying with ASTM C685/C685M. Mix each batch not less than 1-1/2 minutes and not more than 5 minutes.
- B. Adding Water: If concrete arrives on-site with slump less than suitable for placement, do not add water that exceeds the maximum water-cement ratio or exceeds the maximum permissible slump.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify lines, levels, and dimensions before proceeding with work of this section.

3.02 PREPARATION

- A. Formwork: Comply with requirements of ACI SPEC-301. Design and fabricate forms to support all applied loads until concrete is cured and for easy removal without damage to concrete.

3.03 INSTALLING REINFORCEMENT AND OTHER EMBEDDED ITEMS

- A. Comply with requirements of ACI SPEC-301. Clean reinforcement of loose rust and mill scale, and accurately position, support, and secure in place to achieve not less than minimum concrete coverage required for protection.

3.04 PLACING CONCRETE

- A. Place concrete in accordance with ACI PRC-304.

3.05 CONCRETE FINISHING

- A. Repair surface defects, including tie holes, immediately after removing formwork.

3.06 CURING AND PROTECTION

- A. Comply with requirements of ACI PRC-308. Immediately after placement, protect concrete from premature drying, excessively hot or cold temperatures, and mechanical injury.
- B. Maintain concrete with minimal moisture loss at relatively constant temperature for period necessary for hydration of cement and hardening of concrete.
- C. Surfaces Not in Contact with Forms:
 - 1. Initial Curing: Start as soon as free water has disappeared and before surface is dry. Keep continuously moist for not less than three days by water ponding, water-saturated sand, water-fog spray, or saturated burlap.
 - 2. Final Curing: Begin after initial curing but before surface is dry.
 - a. Moisture-Retaining Cover: Seal in place with waterproof tape or adhesive.

3.07 FIELD QUALITY CONTROL

- A. An independent testing agency will perform field quality control tests.
- B. Provide free access to concrete operations at project site and cooperate with appointed firm.
- C. Submit proposed mix design of each class of concrete to inspection and testing firm for review prior to commencement of concrete operations.
- D. Tests of concrete and concrete materials may be performed at any time to ensure compliance with specified requirements.
- E. Compressive Strength Tests: ASTM C39/C39M, for each test, mold and cure three concrete test cylinders. Obtain test samples for every 100 cubic yards or less of each class of concrete placed.
- F. Take one additional test cylinder during cold weather concreting, cured on job site under same conditions as concrete it represents.
- G. Perform one slump test for each set of test cylinders taken, following procedures of ASTM C143/C143M.

3.08 DEFECTIVE CONCRETE

- A. Defective Concrete: Concrete not complying with required lines, details, dimensions, tolerances or specified requirements.
- B. Repair or replacement of defective concrete will be determined by the DEDC, LLC. The cost of additional testing shall be borne by Contractor when defective concrete is identified.

3.09 SCHEDULE - CONCRETE TYPES AND FINISHES

- A. Condensing Unit Pad: 4,500 PSI 28 day concrete, form finish with honeycomb exposed side surfaces, level broom finish top surface.
- B. Interior Housekeeping Pads: 4,000 PSI 28 day concrete, form finish with honeycomb filled side surfaces, hard trowel finish top surface.

END OF SECTION

NOT FOR BIDDING PURPOSES

**SECTION 04 20 00
UNIT MASONRY**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Concrete block.
- B. Concrete building brick.
- C. Mortar and grout.
- D. Reinforcement and anchorage.
- E. Flashings.
- F. Accessories.

1.02 RELATED REQUIREMENTS

- A. Section 03 10 00 - Concrete Forming and Accessories: Dovetail slots for masonry anchors.
- B. Section 03 30 00 - Cast-in-Place Concrete: Installation of dovetail slots for masonry anchors.
- C. Section 04 01 00 - Maintenance of Masonry.
- D. Section 05 50 00 - Metal Fabrications: Loose steel lintels.
- E. Section 06 10 00 - Rough Carpentry: Nailing strips built into masonry.
- F. Section 07 11 13 - Bituminous Dampproofing: Dampproofing parged masonry surfaces.
- G. Section 07 21 00 - Thermal Insulation: Insulation for cavity spaces.
- H. Section 07 25 00 - Weather Barriers: Water-resistive barriers applied to exterior face of backing sheathing or unit masonry substrate.

1.03 REFERENCE STANDARDS

- A. ASTM A153/A153M - Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware; 2023.
- B. ASTM A240/A240M - Standard Specification for Chromium and Chromium-Nickel Stainless Steel Plate, Sheet, and Strip for Pressure Vessels and for General Applications; 2025a.
- C. ASTM A645/A645M - Standard Specification for Deformed and Plain Carbon-Steel Bars for Concrete Reinforcement; 2024.
- D. ASTM A641/A641M - Standard Specification for Zinc-Coated (Galvanized) Carbon Steel Wire; 2019 (Reapproved 2025).
- E. ASTM A951/A951M - Standard Specification for Steel Wire for Masonry Joint Reinforcement; 2022.
- F. ASTM A1064/A1064M - Standard Specification for Carbon-Steel Wire and Welded Wire Reinforcement, Plain and Deformed, for Concrete; 2024.
- G. ASTM C55 - Standard Specification for Dry-Cast Concrete Building Brick; 2025.
- H. ASTM C67/C67M - Standard Test Methods for Sampling and Testing Brick and Structural Clay Tile; 2023.
- I. ASTM C90 - Standard Specification for Dry-Cast Loadbearing Concrete Masonry Units; 2024a.
- J. ASTM C91/C91M - Standard Specification for Masonry Cement; 2025.
- K. ASTM C140/C140M - Standard Test Methods for Sampling and Testing Concrete Masonry Units and Related Units; 2025.
- L. ASTM C144 - Standard Specification for Aggregate for Masonry Mortar; 2025.

- M. ASTM C150/C150M - Standard Specification for Portland Cement; 2024.
- N. ASTM C207 - Standard Specification for Hydrated Lime for Masonry Purposes; 2024.
- O. ASTM C270 - Standard Specification for Mortar for Unit Masonry; 2025a.
- P. ASTM C404 - Standard Specification for Aggregates for Masonry Grout; 2024.
- Q. ASTM C476 - Standard Specification for Grout for Masonry; 2023.
- R. ASTM C780 - Standard Test Methods for Preconstruction and Construction Evaluation of Mortars for Plain and Reinforced Unit Masonry; 2025a.
- S. BIA Technical Notes No. 28B - Brick Veneer/Cold-Formed Steel Framed Walls; 2025.
- T. BIA Technical Notes No. 7 - Water Penetration Resistance – Design and Detailing; 2017.
- U. BIA Technical Notes No. 13 - Ceramic Glazed Brick Exterior Walls; 2017.
- V. BIA Technical Notes No. 46 - Maintenance of Brick Masonry; 2017.
- W. TMS 402/602 - Building Code Requirements and Specification for Masonry Structures; 2022, with Errata (2024).

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Preinstallation Meeting: Convene a preinstallation meeting one week before starting work of this section; require attendance by all relevant installers.

1.05 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements for submittal procedures.
- B. Product Data: Provide data for masonry units, fabricated wire reinforcement, mortar, and masonry accessories.
- C. Shop Drawings: Indicate pertinent dimensions, materials, anchorage, size and type of fasteners, and accessories for brickwork support system.
 - 1. Include calculations or selections from the manufacturer's prescriptive design tables that indicate compliance with the applicable building code and project conditions.
 - 2. Include the design engineer's stamp or seal on each sheet of shop drawings.
- D. Samples: Submit four samples of decorative block units to illustrate color, texture, and extremes of color range.
- E. Manufacturer's Certificate: Certify that masonry units meet or exceed specified requirements.

1.06 QUALITY ASSURANCE

- A. Comply with provisions of TMS 402/602, except where exceeded by requirements of Contract Documents.
 - 1. Maintain one copy of each document on project site.
- B. Designer Qualifications: Perform design under direct supervision of a Professional Engineer experienced in design of this type of work and licensed in the State in which the Project is located.
- C. Manufacturer Qualifications: Company specializing in manufacturing the type of products specified in this section with minimum three years of documented experience.
- D. Installer Qualifications: Company specializing in performing work of the type specified and with at least three years of documented experience.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. Deliver, handle, and store masonry units by means that will prevent mechanical damage and contamination by other materials.
- B. Handle and store ceramic glazed masonry units in protective cartons or trays. Do not remove from protective packaging until ready for installation.

PART 2 PRODUCTS

2.01 CONCRETE MASONRY UNITS

- A. Concrete Block: Comply with referenced standards and as follows:
 - 1. Size: Standard units with nominal face dimensions of 16 by 8 inches (400 by 200 mm) and nominal depth of 8 inches (200 mm).
 - 2. Load-Bearing Units: ASTM C90, normal weight.
 - a. Hollow block, as indicated.
 - b. Exposed Faces: Manufacturer's standard color and texture where indicated.
 - c. Pattern: Running bond.
- B. Concrete Brick:
 - 1. Size: As indicated on drawings.
 - 2. Concrete Building Brick: ASTM C55; lightweight, solid, for interior or concealed use.

2.02 MORTAR AND GROUT MATERIALS

- A. Masonry Cement: ASTM C91/C91M, Type N.
- B. Portland Cement: ASTM C150/C150M, Type I; color as required to produce approved color sample.
 - 1. Not more than 0.60 percent alkali.
- C. Hydrated Lime: ASTM C207, Type S.
- D. Mortar Aggregate: ASTM C144.
- E. Grout Aggregate: ASTM C404.
- F. Water: Clean and potable.

2.03 REINFORCEMENT AND ANCHORAGE

- A. Manufacturers:
 - 1. FERRO Corporation: www.ferrocorp.com/#sle.
 - 2. Hohmann & Barnard, Inc; HB 213 Veneer Anchor : www.h-b.com/#sle.
 - 3. WIRE-BOND: www.wirebond.com/#sle.
 - 4. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Reinforcing Steel: ASTM A615/A615M, Grade 40 (40,000 psi) (280 MPa), deformed billet bars; galvanized.
- C. Joint Reinforcement: Use ladder type joint reinforcement where vertical reinforcement is involved and truss type elsewhere, unless otherwise indicated.
- D. Single Wythe Joint Reinforcement: ASTM A951/A951M.
 - Type: Ladder.
 - 2. Material: ASTM A1064/A1064M steel wire, mill galvanized to ASTM A641/A641M Class 3.
- E. Masonry Veneer Anchors: 2-piece anchors that permit differential movement between masonry veneer and structural backup, hot dip galvanized to ASTM A 153/A 153M, Class B.
 - 1. Anchor plates: Not less than 0.075 inch (1.91 mm) thick, designed for fastening to structural backup through sheathing by two fasteners; provide design with legs that penetrate sheathing and insulation to provide positive anchorage.
 - 2. Wire ties: Manufacturer's standard shape, 0.1875 inch (4.75 mm) thick.
 - 3. Vertical adjustment: Not less than 3-1/2 inches (89 mm).
- F. Metal-to-Metal Fasteners: Self-drilling, self-tapping screws; corrosion resistant finish or hot dip galvanized to ASTM A153/A153M.

2.04 FLASHINGS

- A. Metal Flashing Materials: Stainless Steel, as specified in Section 07 62 00.
- B. Combination Non-Asphaltic Flashing Materials - Stainless Steel:
 - 1. Stainless Steel/Polymer Fabric Flashing: ASTM A240/A240M; 2 mil (0.05 mm) type 304 stainless steel sheet bonded on one side to one sheet of polymer fabric.
 - a. Manufacturers:
 - 1) Hohmann & Barnard, Inc; Mighty-Flash Stainless Flashing: www.h-b.com/#sle.
 - 2) WIRE-BOND; BOND-N-FLASH: www.wirebond.com/#sle.
 - 3) York Flashings; Multi-Flash SS: www.yorkflashings.com/#sle.
 - 2. Stainless Steel/Polymer Fabric Drainage Plane Flashing: ASTM A240/A240M; 2 mil (0.05 mm) type 304 stainless steel sheet bonded between one sheet of polymer fabric and one sheet of non-woven drainage material.
 - a. Manufacturers:
 - 1) MortarNet Solutions; TotalFlash: www.mortarnet.com/#sle.
 - 2) STS Coatings, Inc: www.stscoatings.com/#sle.
 - 3) York Flashings; Flash-Vent SS: www.yorkflashings.com/#sle.
 - 4) Substitutions: See Section 01 60 00 - Product Requirements.
- C. Termination Bars: Stainless steel; compatible with membrane and adhesives.
 - 1. Manufacturer: Same as flashing, or other manufacturer approved in writing by flashing manufacturer.
- D. Drip Edge: Stainless steel; angled drip with hemmed edge; compatible with membrane and adhesives.

2.05 ACCESSORIES

- A. Joint Filler: Closed cell polyvinyl chloride; oversized 50 percent to joint width; self expanding; in maximum lengths available.
- B. Cavity Mortar Control: Semi-rigid polyethylene or polyester mesh panels, sized to thickness of wall cavity, and designed to prevent mortar droppings from clogging weeps and cavity vents and allow proper cavity drainage.
 - 1. Mortar Diverter: Semi-rigid mesh designed for installation at flashing locations.
 - a. Manufacturers:
 - 1) Mortar Net Solutions; MortarNet: www.mortarnet.com/#sle.
 - 2) WIRE-BOND: www.wirebond.com/#sle.
 - 3) York Flashings: www.yorkflashings.com/#sle.
- C. Weeps:
 - 1. Type: Extruded propylene with honeycomb design.
 - 2. Manufacturers:
 - a. CavClear, a Division of Archovations Inc: www.cavclear.com/#sle.
 - b. Hohmann & Barnard, Inc: www.h-b.com/#sle.
 - c. Mortar Net Solutions; WeepVent: www.mortarnet.com/#sle.
 - d. WIRE-BOND: www.wirebond.com/#sle.
- D. Cavity Vents:
 - 1. Type: Extruded propylene with honeycomb design.
 - 2. Color(s): As selected by Architect from manufacturer's full range.
 - 3. Manufacturers:
 - a. Advanced Building Products, Inc: www.advancedbuildingproducts.com/#sle.
 - b. CavClear, a Division of Archovations Inc: www.cavclear.com/#sle.
 - c. Hohmann & Barnard, Inc: www.h-b.com/#sle.
 - d. Mortar Net Solutions; CellVent: www.mortarnet.com/#sle.
 - e. Substitutions: See Section 01 60 00 - Product Requirements.

- E. Drainage Fabric: Polyester or polypropylene mesh bonded to a water and vapor-permeable fabric.
- F. Cleaning Solution: Non-acidic, not harmful to masonry work or adjacent materials.

2.06 MORTAR AND GROUT MIXING

- A. Mortar for Unit Masonry: ASTM C270, using the Proportion Specification.
 - 1. Masonry below grade and in contact with earth: Type S.
 - 2. Exterior, loadbearing masonry: Type N.
 - 3. Exterior, non-loadbearing masonry: Type N.
 - 4. Interior, loadbearing masonry: Type N.
 - 5. Interior, non-loadbearing masonry: Type O.
- B. New Mortar for Old Brick: Proportion by volume only; no more than 20 percent of the total volume of Portland cement and lime combined to be Portland cement.
- C. Grout: ASTM C476; consistency required to fill completely volumes indicated for grouting; fine grout for spaces with smallest horizontal dimension of 2 inches (50 mm) or less; coarse grout for spaces with smallest horizontal dimension greater than 2 inches (50 mm).
- D. Mixing: Use mechanical batch mixer and comply with referenced standards.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field conditions are acceptable and are ready to receive masonry.
- B. Verify that related items provided under other sections are properly sized and located.
- C. Verify that built-in items are in proper location, and ready for roughing into masonry work.

3.02 PREPARATION

- A. Direct and coordinate placement of metal anchors supplied for installation under other sections.
- B. Provide temporary bracing during installation of masonry work. Maintain in place until building structure provides permanent bracing.

3.03 COLD AND HOT WEATHER REQUIREMENTS

- A. Comply with requirements of TMS 402/602 or applicable building code, whichever is more stringent.

3.04 COURSING

- A. Establish lines, levels, and coursing indicated. Protect from displacement.
- B. Maintain masonry courses to uniform dimension. Form vertical and horizontal joints of uniform thickness.
- C. Concrete Masonry Units:
 - 1. Bond: Running.
 - 2. Coursing: One unit and one mortar joint to equal 8 inches (200 mm).
 - 3. Mortar Joints: Concave.

3.05 PLACING AND BONDING

- A. Lay hollow masonry units with face shell bedding on head and bed joints.
- B. Buttering corners of joints or excessive furrowing of mortar joints is not permitted.
- C. Remove excess mortar and mortar smears as work progresses.
- D. Remove excess mortar with water repellent admixture promptly. Do not use acids, sandblasting or high pressure cleaning methods.

- E. Interlock intersections and external corners, except for units laid in stack bond.
- F. Do not shift or tap masonry units after mortar has achieved initial set. Where adjustment must be made, remove mortar and replace.
- G. Perform job site cutting of masonry units with proper tools to provide straight, clean, unchipped edges. Prevent broken masonry unit corners or edges.
- H. Cut mortar joints flush where wall tile is scheduled or resilient base is scheduled.
- I. Isolate masonry partitions from vertical structural framing members with a control joint as indicated.

3.06 WEEPS/CAVITY VENTS

- A. Install weeps in veneer and cavity walls at 24 inches (600 mm) on center horizontally on top of through-wall flashing above shelf angles and lintels and at bottom of walls.
- B. Install cavity vents in veneer and cavity walls at 32 inches (800 mm) on center horizontally below shelf angles and lintels and near top of walls.

3.07 CAVITY MORTAR CONTROL

- A. Do not permit mortar to drop or accumulate into cavity air space or to plug weep/cavity vents.
- B. For cavity walls, build inner wythe ahead of outer wythe to accommodate accessories.
- C. Install cavity mortar diverter at base of cavity and at other flashing locations as recommended by manufacturer to prevent mortar droppings from blocking weep/cavity vents.

3.08 REINFORCEMENT AND ANCHORAGE - GENERAL, SINGLE WYTHER MASONRY, AND CAVITY WALL MASONRY

- A. Unless otherwise indicated on drawings or specified under specific wall type, install horizontal joint reinforcement 16 inches (400 mm) on center.
- B. Place masonry joint reinforcement in first and second horizontal joints above and below openings. Extend minimum 16 inches (400 mm) each side of opening.
- C. Place continuous joint reinforcement in first and second joint below top of walls.
- D. Embed longitudinal wires or joint reinforcement in mortar joint with at least 5/8 inch (16 mm) mortar cover on each side.
- E. Lap joint reinforcement ends minimum 6 inches (150 mm).
- F. Reinforce stack bonded unit joint corners and intersections with strap anchors 16 inches (400 mm) on center.
- G. Embed ties and anchors in mortar joint and extend into masonry unit a minimum of 1-1/2 inches (38 mm) with at least 5/8 inch (16 mm) mortar cover to the outside face of the anchor.

3.09 REINFORCEMENT AND ANCHORAGE - MASONRY VENEER

- A. Masonry Back-Up: Embed anchors to bond veneer at maximum 16 inches (400 mm) on center vertically and 36 inches (900 mm) on center horizontally. Place additional anchors at perimeter of openings and ends of panels, so maximum spacing of anchors is 8 inches (200 mm) on center.
- B. Stud Back-Up: Secure veneer anchors to stud framed back-up and embed into masonry veneer at maximum 16 inches (400 mm) on center vertically and 24 inches (600 mm) on center horizontally. Place additional anchors at perimeter of openings and ends of panels, so maximum spacing of anchors is 8 inches (200 mm) on center.
- C. Seismic Reinforcement: Connect veneer anchors with continuous horizontal wire reinforcement before embedding anchors in mortar.

3.10 REINFORCEMENT AND ANCHORAGES - MULTIPLE WYTHER UNIT MASONRY

- A. Use individual metal ties installed in horizontal joints to bond wythes together. Provide ties spaced as indicated on drawings.
- B. Support and secure reinforcing bars from displacement. Maintain position within 1/2 inch (13 mm) of dimensioned position.

3.11 MASONRY FLASHINGS

- A. Whether or not specifically indicated, install masonry flashing to divert water to exterior at all locations where downward flow of water will be interrupted.
 - 1. Extend flashings full width at such interruptions and at least 6 inches (152 mm), minimum, into adjacent masonry or turn up flashing ends at least 1 inch (25.4 mm), minimum, to form watertight pan at nonmasonry construction.
 - 2. Remove or cover protrusions or sharp edges that could puncture flashings.
 - 3. Seal lapped ends and penetrations of flashing before covering with mortar.
- B. Terminate flashing up 8 inches (203 mm) minimum on vertical surface of backing:
 - 1. Install vertical leg of flashing behind water-resistive barrier sheet over backing.
 - 2. Terminate vertical leg of flashing into bed joint in masonry or reglet in concrete.
 - 3. Anchor vertical leg of flashing into backing with a termination bar and sealant.
 - 4. Apply cap bead of sealant on top edge of self-adhered flashing.
- C. Install flashing in accordance with manufacturer's instructions and BIA Technical Notes No. 7.
- D. Extend metal flashings through exterior face of masonry and terminate in an angled drip with hemmed edge. Install joint sealer below drip edge to prevent moisture migration under flashing.
- E. Support flexible flashings across gaps and openings.
- F. Extend laminated flashings to within 1/2 inch (12 mm) of exterior face of masonry and adhere to top of stainless steel angled drip with hemmed edge.
- G. Lap end joints of flashings at least 6 inches (152 mm), minimum, and seal watertight with flashing sealant/adhesive.

3.12 GROUTED COMPONENTS

- A. Lap splices minimum 24 bar diameters.
- B. Support and secure reinforcing bars from displacement. Maintain position within 1/2 inch (13 mm) of dimensioned position.
- C. Place and consolidate grout fill without displacing reinforcing.

3.13 BUILT-IN WORK

- A. As work progresses, install built-in metal door frames and glazed frames and other items to be built into the work and furnished under other sections.
- B. Install built-in items plumb, level, and true to line.
- C. Bed anchors of metal door and glazed frames in adjacent mortar joints. Fill frame voids solid with grout.
 - 1. Fill adjacent masonry cores with grout minimum 12 inches (300 mm) from framed openings.
- D. Do not build into masonry construction organic materials that are subject to deterioration.

3.14 TOLERANCES

- A. Install masonry within the site tolerances found in TMS 402/602.
- B. Maximum Variation from Alignment of Columns: 1/4 inch (6 mm).
- C. Maximum Variation From Unit to Adjacent Unit: 1/16 inch (1.6 mm).

- D. Maximum Variation from Plane of Wall: 1/4 inch in 10 ft (6 mm/3 m) and 1/2 inch in 20 ft (13 mm/6 m) or more.
- E. Maximum Variation from Plumb: 1/4 inch (6 mm) per story non-cumulative; 1/2 inch (13 mm) in two stories or more.
- F. Maximum Variation from Level Coursing: 1/8 inch in 3 ft (3 mm/m) and 1/4 inch in 10 ft (6 mm/3 m); 1/2 inch in 30 ft (13 mm/9 m).
- G. Maximum Variation of Mortar Joint Thickness: Head joint, minus 1/4 inch, plus 3/8 inch (minus 6.4 mm, plus 9.5 mm).
- H. Maximum Variation from Cross Sectional Thickness of Walls: 1/4 inch (6 mm).

3.15 CUTTING AND FITTING

- A. Cut and fit for chases. Coordinate with other sections of work to provide correct size, shape, and location.
- B. Obtain approval prior to cutting or fitting masonry work not indicated or where appearance or strength of masonry work may be impaired.

3.16 FIELD QUALITY CONTROL

- A. An independent testing agency will perform field quality control tests, as specified in Section 01 40 00 - Quality Requirements.
- B. Clay Masonry Unit Tests: Test each variety of clay masonry in accordance with ASTM C67/C67M requirements, sampling 5 randomly chosen units for each 50,000 installed.
- C. Concrete Masonry Unit Tests: Test each variety of concrete unit masonry in accordance with ASTM C140/C140M for compliance with requirements of this specification.
- D. Mortar Tests: Test each type of mortar in accordance with ASTM C780, testing with same frequency as masonry samples.

3.17 CLEANING

- A. Remove excess mortar and mortar droppings.
- B. Replace defective mortar. Match adjacent work.
- C. Clean soiled surfaces with cleaning solution.
- D. Use non-metallic tools in cleaning operations.

3.18 PROTECTION

- A. Without damaging completed work, provide protective boards at exposed external corners that are subject to damage by construction activities.

END OF SECTION 04 20 00

**SECTION 06 10 00
ROUGH CARPENTRY**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Structural dimension lumber framing.
- B. Nonstructural dimension lumber framing.
- C. Rough opening framing for doors, windows, and roof openings.
- D. Sheathing.
- E. Preservative treated wood materials.
- F. Fire retardant treated wood materials.
- G. Miscellaneous framing and sheathing.
- H. Concealed wood blocking, nailers, and supports.
- I. Miscellaneous wood nailers, furring, and grounds.

1.02 RELATED REQUIREMENTS

- A. Section 01 61 16 - Volatile Organic Compound (VOC) Content Restrictions.
- B. Section 03 30 00 - Cast-in-Place Concrete: Setting anchors in concrete.
- C. Section 07 25 00 - Weather Barriers: Water-resistive barrier over sheathing.
- D. Section 07 62 00 - Sheet Metal Flashing and Trim: Sill flashings.
- E. Section 07 72 00 - Roof Accessories: Prefabricated roof curbs.
- F. Section 09 21 16 - Gypsum Board Assemblies: Gypsum-based sheathing.
- G. Section 31 31 16 - Termite Control: Field-applied termiticide and mildewcide for wood materials.

1.03 REFERENCE STANDARDS

- A. ASTM A153/A153M - Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware; 2023.
- B. ASTM A653/A653M - Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process; 2025a.
- C. ASTM C557 - Standard Specification for Adhesives for Fastening Gypsum Wallboard to Wood Framing; 2003 (Reapproved 2026).
- D. ASTM C1177/C1177M - Standard Specification for Glass Mat Gypsum Substrate for Use as Sheathing; 2024.
- E. ASTM D2898 - Standard Practice for Accelerated Weathering of Fire-Retardant-Treated Wood for Fire Testing; 2010 (Reapproved 2024).
- F. ASTM D3273 - Standard Test Method for Resistance to Growth of Mold on the Surface of Interior Coatings in an Environmental Chamber; 2021.
- G. AWC (WFCM) - Wood Frame Construction Manual for One- and Two-Family Dwellings; 2024, with Errata.
- H. AWP A M4 - Standard for the Handling, Storage, Field Fabrication and Field Treatment of Preservative-Treated Wood Products; 2023.
- I. AWP A U1 - Use Category System: User Specification for Treated Wood; 2025.

- J. ICC (IBC) - International Building Code; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- K. PS 1 - Structural Plywood; 2023.
- L. PS 2 - Performance Standard for Wood Structural Panels; 2019.
- M. PS 20 - American Softwood Lumber Standard; 2025.

1.04 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements for submittal procedures.
- B. Product Data: Provide technical data on insulated sheathing and application instructions.
- C. Product Data: Submit technical data on wood treatment.
- D. Manufacturer's Certificate: Certify that wood products supplied for rough carpentry meet or exceed specified requirements.
- E. Warranty Documentation: Submit manufacturer warranty and ensure that forms have been completed in Owner's name and registered with manufacturer.

1.05 DELIVERY, STORAGE, AND HANDLING

- A. General: Cover wood products to protect against moisture. Support stacked products to prevent deformation and to allow air circulation.
- B. Fire Retardant Treated Wood: Prevent exposure to precipitation during shipping, storage, and installation.

1.06 WARRANTY

- A. See Section 01 78 00 - Closeout Submittals for additional warranty requirements.
- B. Manufacturer Warranty: Provide 2-year manufacturer warranty for materials and workmanship commencing on Date of Substantial Completion.
- C. Extended Correction Period: Correct defective work within 2-year period commencing on Date of Substantial Completion.

PART 2 PRODUCTS

2.01 GENERAL REQUIREMENTS

- A. Dimension Lumber: Comply with PS 20 and requirements of specified grading agencies.
 - 1. Species: Douglas Fir-Larch, unless otherwise indicated.
 - 2. If no species is specified, provide species graded by the agency specified; if no grading agency is specified, provide lumber graded by grading agency meeting the specified requirements.
 - 3. Grading Agency: Grading agency whose rules are approved by the Board of Review, American Lumber Standard Committee at www.alsc.org, and who provides grading service for the species and grade specified; provide lumber stamped with grade mark unless otherwise indicated.
 - 4. Lumber of other species or grades is acceptable provided structural and appearance characteristics are equivalent to or better than products specified.

2.02 DIMENSION LUMBER FOR CONCEALED APPLICATIONS

- A. Sizes: Nominal sizes as indicated on drawings, S4S.
- B. Moisture Content: S-dry or MC19.
- C. Stud Framing (2 by 2 through 2 by 6 (50 by 50 mm through 50 by 150 mm)):
 - 1. Species: Douglas Fir-Larch.
 - 2. Grade: No. 2.
- D. Joist, Rafter, and Small Beam Framing (2 by 6 through 2 by 10 (50 by 150 mm through 100 by 250 mm)):

1. Species: Douglas Fir-Larch.
 2. Grade: No. 1 and Better.
- E. Miscellaneous Framing, Blocking, Nailers, Grounds, and Furring:
1. Lumber: S4S, No. 2 or Standard Grade.
 2. Boards: Standard or No. 3.

2.03 EXPOSED DIMENSION LUMBER

- A. Submit manufacturer's certificate that products meet or exceed specified requirements, in lieu of grade stamping.
- B. Sizes: Nominal sizes as indicated on drawings.
- C. Surfacing: S4S.
- D. Moisture Content: S-dry or MC19.

2.04 EXPOSED BOARDS

- A. Submit manufacturer's certificate that products meet or exceed specified requirements, in lieu of grade stamping.
- B. Moisture Content: Kiln-dry (15 percent maximum).
- C. Surfacing: S4S.
- D. Species: Douglas Fir.
- E. Grade: No. 2, 2 Common, or Construction.

2.05 CONSTRUCTION PANELS

- A. Roof Sheathing: PS 2 type, rated Structural I Sheathing.
 1. Bond Classification: Exterior.
 2. Span Rating: 60.
 3. Performance Category: 3/4 PERF CAT.
- B. Roof Sheathing: Wood construction panel laminated to insulation board.
 1. Construction Panel: 7/16 inch (11 mm) oriented strand board (OSB).
 2. Insulation Board: Polyisocyanurate foam plastic with cellulosic felt facer or glass fiber mat facer on major surface opposite construction panel.
 3. Products:
 - a. Hunter Panels: www.hunterpanels.com/#sle.
 - b. Substitutions: See Section 01 60 00 - Product Requirements.
- C. Wall Sheathing: PS 2 type.
 1. Bond Classification: Exterior.
 2. Grade: Structural I Sheathing.
 3. Span Rating: 24.
 4. Performance Category: 5/16 PERF CAT.
 5. Edge Profile: Square edge.
- D. Wall Sheathing: Glass mat faced gypsum, ASTM C1177/C1177M, 5/8 inch Type X fire resistant (16 mm Type X fire resistant).
 1. At Assemblies Indicated with Fire-Rating: Use type required by indicated tested assembly.
 2. Mold Resistance: Score of 10, when tested in accordance with ASTM D3273.
 3. Edges: Square.
 4. Products:
 - a. CertainTeed Corporation; GlasRoc Brand: www.certainteed.com/#sle.
 - b. Georgia-Pacific Gypsum; DensGlass Sheathing: www.gpgypsum.com/#sle.

- c. Gold Bond Building Products, LLC provided by National Gypsum Company; Gold Bond eXP Fire-Shield Sheathing: www.goldbondbuilding.com/#sle.
- d. USG Corporation; Securock Brand UltraLight Glass-Mat Sheathing Regular 5/8 in. (15.9 mm): www.usg.com/#sle.
- E. Other Applications:
 - 1. Plywood Concealed From View But Located Within Exterior Enclosure: PS 1, C-C Plugged or better, Exterior grade.
 - 2. Plywood Exposed to View But Not Exposed to Weather: PS 1, A-D, or better.
 - 3. Other Locations: PS 1, C-D Plugged or better.

2.06 PRESSURE-PRESERVATIVE TREATMENT (PPT)

- A. Factory-treat wood members in accordance with AWP A U1 and use category indicated.
- B. Preservative Limitations for Interior Use Categories UC1 and UC2:
- C. Applications - Treat the Following:
 - 1. Wood framing in contact with exterior foundation walls where member is less than 8 inches (200 mm) from exposed earth: Use Category UC1, above ground, interior, dry.
 - 2. Sleepers and sills on concrete or masonry in direct contact with earth: Use Category UC2, above ground, interior, damp.
- D. Kiln-dry wood after treatment with waterborne preservative to maximum moisture content of 19 percent for lumber and 15 percent for plywood.
- E. Fabricate to maximum extent possible before treatment.
- F. Label preservative-treated wood with marking as required by AWP A U1 and ICC (IBC). Unless otherwise permitted by standard U1 and building code, include the following markings: AWP A U1, accredited inspection agency mark, treating plant identification, type of preservative, preservative retention, and permitted end use.
- G. Field Treatment for Cuts and Holes in Preservative-Treated Wood: Comply with AWP A M4.

2.07 ACCESSORIES

- A. Metal and Finish of Fasteners:
 - 1. Preservative-Treated Wood:
 - a. Nails, timber rivets, wood screws, and lag screws - general use: Hot-dip galvanized steel complying with ASTM A153/A153M Class D.
 - 2. Untreated Wood: Unfinished steel.
- B. Joist Hangers: Hot dipped galvanized steel, sized to suit framing conditions.
 - 1. For contact with preservative treated wood in exposed locations, provide minimum G185 (Z550) galvanizing complying with ASTM A653/A653M.
- C. Sill Flashing: See Section 07 62 00.
- D. General Purpose Construction Adhesives: Comply with ASTM C557.
- E. Seam and Perimeter Tape: Polyethylene-faced material with acrylic adhesive.
 - 1. Thickness: 12 mils, 0.012 inch (0.304 mm).
- F. Water-Resistive Barrier: See Section 07 25 00.

PART 3 EXECUTION

3.01 PREPARATION

- A. Where wood framing bears on cementitious foundations, install full width sill flashing continuous over top of foundation, lap ends of flashing minimum of 4 inches (100 mm) and seal.
- B. Install sill gasket under sill plate of framed walls bearing on foundations; puncture gasket cleanly to fit tightly around protruding anchor bolts.
- C. Coordinate installation of rough carpentry members specified in other sections.

3.02 INSTALLATION - GENERAL

- A. Select material sizes to minimize waste.
- B. Reuse scrap to the greatest extent possible; clearly separate scrap for use on site as accessory components, including: shims, bracing, and blocking.
- C. Where treated wood is used on interior, provide temporary ventilation during and immediately after installation sufficient to remove indoor air contaminants.

3.03 FRAMING INSTALLATION

- A. Set structural members level, plumb, and true to line. Discard pieces with defects that would lower required strength or result in unacceptable appearance of exposed members.
- B. Make provisions for temporary construction loads, and provide temporary bracing sufficient to maintain structure in true alignment and safe condition until completion of erection and installation of permanent bracing.
- C. Install structural members full length without splices unless otherwise specifically detailed.
- D. Comply with member sizes, spacing, and configurations indicated, and fastener size and spacing indicated, but not less than required by applicable codes and AWC (WFCM) Wood Frame Construction Manual.
- E. Construct double joist headers at floor and ceiling openings and under wall stud partitions that are parallel to floor joists; use metal joist hangers unless otherwise detailed.
- F. Frame wall openings with two or more studs at each jamb; support headers on cripple studs.

3.04 BLOCKING, NAILERS, AND SUPPORTS

- A. Provide framing and blocking members as indicated or as required to support finishes, fixtures, specialty items, and trim.
- B. In framed assemblies that have concealed spaces, provide solid wood fireblocking as required by applicable local code, to close concealed draft openings between floors and between top story and roof/attic space; other material acceptable to authorities having jurisdiction may be used in lieu of solid wood blocking.
- C. In metal stud walls, provide continuous blocking around door and window openings for anchorage of frames, securely attached to stud framing.
- D. In walls, provide blocking attached to studs as backing and support for wall-mounted items, unless item can be securely fastened to two or more studs or other method of support is explicitly indicated.
- E. Where ceiling-mounting is indicated, provide blocking and supplementary supports above ceiling, unless other method of support is explicitly indicated.

3.05 ROOF-RELATED CARPENTRY

- A. Coordinate installation of roofing carpentry with deck construction, framing of roof openings, and roofing assembly installation.
- B. Provide wood curb at each roof opening except where prefabricated curbs are specified and where specifically indicated otherwise; form corners by alternating lapping side members.

3.06 INSTALLATION OF CONSTRUCTION PANELS

- A. Roof Sheathing: Secure panels with long dimension perpendicular to framing members, with ends staggered and over firm bearing.
 - 1. Nail panels to framing; staples are not permitted.
- B. Wall Sheathing: Secure with long dimension perpendicular to wall studs, with ends over firm bearing and staggered, using nails, screws, or staples.

1. Place water-resistive barrier horizontally over wall sheathing, weather lapping edges and ends.

3.07 TOLERANCES

- A. Framing Members: 1/4 inch (6 mm) from true position, maximum.
- B. Surface Flatness of Floor: 1/8 inch in 10 feet (1 mm/m) maximum, and 1/4 inch in 30 feet (7 mm in 10 m) maximum.
- C. Variation from Plane, Other than Floors: 1/4 inch in 10 feet (2 mm/m) maximum, and 1/4 inch in 30 feet (7 mm in 10 m) maximum.

3.08 FIELD QUALITY CONTROL

- A. See Section 01 40 00 - Quality Requirements for additional requirements.

3.09 CLEANING

- A. Waste Disposal: See Section 01 74 19 - Construction Waste Management and Disposal.
 1. Comply with applicable regulations.
 2. Do not burn scrap on project site.
 3. Do not burn scraps that have been pressure treated.
 4. Do not send materials treated with pentachlorophenol, CCA, or ACA to co-generation facilities or "waste-to-energy" facilities.
- B. Do not leave wood, shavings, sawdust, etc. on the ground or buried in fill.
- C. Prevent sawdust and wood shavings from entering the storm drainage system.

END OF SECTION 06 10 00

**SECTION 06 20 00
FINISH CARPENTRY**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Finish carpentry items.
- B. Wood casings and moldings.
- C. Hardware and attachment accessories.

1.02 RELATED REQUIREMENTS

- A. Section 06 10 00 - Rough Carpentry: Support framing, grounds, and concealed blocking.
- B. Section 09 91 13 - Exterior Painting: Painting of finish carpentry items.
- C. Section 09 91 23 - Interior Painting: Painting of finish carpentry items.

1.03 REFERENCE STANDARDS

- A. ASTM E84 - Standard Test Method for Surface Burning Characteristics of Building Materials; 2026a.
- B. AWPA U1 - Use Category System: User Specification for Treated Wood; 2025.
- C. BHMA A156.9 - Cabinet Hardware; 2020.
- D. WDMA I.S. 4 - Industry Specification for Preservative Treatment for Millwork; 2024.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordinate the work with plumbing rough-in, electrical rough-in, and installation of associated and adjacent components.
- B. Sequence installation to ensure utility connections are achieved in an orderly and expeditious manner.

1.05 SUBMITTALS

- A. See Section 01 35 00 - Administrative Requirements for submittal procedures.
- B. Product Data:
 - 1. Provide manufacturer's product data, storage and handling instructions for factory-fabricated units.
 - 2. Provide data on fire retardant treatment materials and application instructions.

1.06 QUALITY ASSURANCE

- A. Fabricator Qualifications: Company specializing in fabricating the products specified in this section with minimum five years of documented experience.
 - 1. Company with at least one project within the past 5 years with value of woodwork within 20 percent of cost of woodwork for this project.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. Deliver factory-fabricated units to project site in original packages, containers or bundles bearing brand name and identification.
- B. Store finish carpentry items under cover, elevated above grade, and in a dry, well-ventilated area not exposed to heat or sunlight.
- C. Protect from moisture damage.
- D. Handle materials and products to prevent damage to edges, ends, or surfaces.

PART 2 PRODUCTS

2.01 FINISH CARPENTRY ITEMS

- A. Surface Burning Characteristics: Provide materials having fire and smoke properties as required by applicable code.
- B. Interior Woodwork Items:
 - 1. Moldings, Bases, Casings, and Miscellaneous Trim: Clear white pine; prepare for paint finish.

2.02 LUMBER MATERIALS

- A. Softwood Lumber: Pine species, flat or plain sawn, maximum moisture content of 6 percent; with vertical grain, of quality suitable for transparent finish.
 - 1. Grading: In accordance with rules certified by ALSC; www.alsc.org.

2.03 FASTENINGS

- A. Adhesive for Purposes Other Than Laminate Installation: Suitable for the purpose; not containing formaldehyde or other volatile organic compounds.
- B. Adhesive for factory-fabricated units: Manufacturer's recommended adhesive for application.
- C. Fasteners: Of size and type to suit application; galvanized finish in concealed locations and stainless steel finish in exposed locations.

2.04 ACCESSORIES

- A. Adhesive: Type recommended by fabricator to suit application.
- B. Lumber for Shimming and Blocking: Softwood lumber of SPF species.
- C. Primer: Alkyd primer sealer.
- D. Wood Filler: Solvent base, tinted to match surface finish color.

2.05 HARDWARE

- A. Hardware: Comply with BHMA A156.1.

2.06 WOOD TREATMENT

- A. Factory-Treated Lumber: Comply with requirements of AWPA U1 - Use Category System for pressure impregnated wood treatments determined by use categories, expected service conditions, and specific applications.
- B. Fire Retardant Treatment (FR-S Type): Chemically treated and pressure impregnated; capable of providing flame spread index of 25, maximum, and smoke developed index of 450, maximum, when tested in accordance with ASTM E84.
- C. Wood Preservative by Pressure Treatment (PT Type): Provide AWPA U1 treatment using waterborne preservative with 0.25 percent retainage.
- D. Water Repellent Preservative Treatment by Dipping Method: WDMA I.S. 4, with 0.25 percent retainage.
- E. Shop pressure treat wood materials requiring fire rating to concealed wood blocking.
- F. Provide identification on fire retardant treated material.
- G. Deliver fire retardant treated materials cut to required sizes. Minimize field cutting.
- H. Redry wood after pressure treatment to maximum 10 percent moisture content.

2.07 FABRICATION

- A. Shop assemble work for delivery to site, permitting passage through building openings.
- B. Shop prepare and identify components for book match grain matching during site erection.
- C. When necessary to cut and fit on site, provide materials with ample allowance for cutting. Provide trim for scribing and site cutting.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify adequacy of backing and support framing.
- B. Verify mechanical, electrical, and building items affecting work of this section are placed and ready to receive this work.

3.02 INSTALLATION

- A. Set and secure materials and components in place, plumb and level.
- B. Carefully scribe work abutting other components, with maximum gaps of 1/32 inch (0.79 mm). Do not use additional overlay trim to conceal larger gaps.

3.03 PREPARATION FOR SITE FINISHING

- A. Set exposed fasteners. Apply wood filler in exposed fastener indentations. Sand work smooth.
- B. Site Finishing: See Section 09 91 13 and 09 91 23.
- C. Before installation, prime paint surfaces of items or assemblies to be in contact with cementitious materials.

3.04 TOLERANCES

- A. Maximum Variation from True Position: 1/16 inch (1.6 mm).
- B. Maximum Offset from True Alignment with Abutting Materials: 1/32 inch (0.79 mm).

END OF SECTION 06 20 00

NOT FOR BIDDING PURPOSES

This page intentionally left blank

SECTION 07 11 13
BITUMINOUS DAMPPROOFING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Bituminous dampproofing.
- B. Protection boards.
- C. Drainage panels.

1.02 RELATED REQUIREMENTS

- A. Section 07 21 00 - Thermal Insulation: Rigid insulation board used as protection board.
- B. Section 31 23 23 - Fill.
- C. Section 33 41 00 - Subdrainage.

1.03 REFERENCE STANDARDS

- A. ASTM D41/D41M - Standard Specification for Asphalt Primer Used in Roofing, Dampproofing, and Waterproofing; 2011 (Reapproved 2023).
- B. ASTM D1187/D1187M - Standard Specification for Asphalt-Base Emulsions for Use as Protective Coatings for Metal; 1997 (Reapproved 2024).
- C. ASTM D1227/D1227M - Standard Specification for Emulsified Asphalt Used as a Protective Coating for Roofing; 2013, with Editorial Revision (2019).
- D. NRCA (WM) - The NRCA Waterproofing Manual; 2021.

1.04 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements for submittal procedures.
- B. Product Data: Provide properties of primer, bitumen, and mastics.
- C. Manufacturer's Installation Instructions: Indicate special procedures and perimeter conditions requiring special attention.
- D. Installer's qualification statement.

1.05 QUALITY ASSURANCE

- A. Installer Qualifications: Company specializing in performing the work of this section with at least three years of documented experience.

1.06 FIELD CONDITIONS

- A. Maintain ambient temperatures above 40 degrees F (5 degrees C) for 24 hours before and during application until dampproofing has cured.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Source Limitations: Furnish products produced by single manufacturer and obtained from single supplier.

2.02 BITUMINOUS DAMPPROOFING

- A. Bituminous Dampproofing: Cold-applied water-based emulsion; asphalt with mineral colloid or chemical emulsifying agent; with or without fiber reinforcement; asbestos-free; suitable for application on vertical and horizontal surfaces.
 - 1. Asphalt-Base Emulsion for Metal Protective Coating: ASTM D1187/D1187M, Type I - Continuous water exposure within few days after drying or Type II - Continuous weather exposure after drying.

2. Emulsified Asphalt for Roofing Protective Coating: ASTM D1227/D1227M, Type II, Class 1 - Mineral colloid emulsifying agents with non-asbestos fibers.
3. VOC Content: Not more than permitted by local, State, and federal regulations.
4. Applied Thickness: 1/16 inch (1.5 mm), minimum, wet film.
5. Products:
 - a. Karnak Corporation; 220 Fibered Emulsion Dampproofing: www.karnakcorp.com/#sle.
 - b. W. R. Meadows, Inc; Sealastic Emulsion Type I (spray-grade): www.wrmeadows.com/#sle.
 - c. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Primers, Mastics, and Related Materials: Type as recommended by dampproofing manufacturer.

2.03 BITUMEN MATERIALS

- A. Cold Asphaltic Type:
 1. Emulsified Asphalt: ASTM D1227/D1227M, with fiber reinforcement other than asbestos, Type II, Class 1 or 2.
 2. Asphalt Primer: ASTM D41/D41M, compatible with substrate.

2.04 ACCESSORIES

- A. Drainage Panel: 1/4-inch (6 mm) thick formed plastic, hollowed sandwich.
- B. Protection Board: 1/8-inch (3 mm) thick biodegradable hardboard.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify existing conditions are acceptable prior to starting this work.
- B. Verify substrate surfaces are durable, free of matter detrimental to adhesion or application of dampproofing system.
- C. Verify that items penetrating surfaces to receive dampproofing are securely installed.

3.02 PREPARATION

- A. Protect adjacent surfaces not designated to receive dampproofing.
- B. Clean and prepare surfaces to receive dampproofing in accordance with manufacturer's instructions.
- C. Do not apply dampproofing to surfaces unacceptable to manufacturer.
- D. Apply mastic to seal penetrations, small cracks, or minor honeycombs in substrate.

3.03 APPLICATION

- A. Foundation Walls: Apply two coats of asphalt dampproofing.
- B. Perform this work in accordance with manufacturer's instructions and NRCA (WM) applicable requirements.
- C. Prime surfaces in accordance with manufacturer's instructions and NRCA (WM) applicable requirements.
- D. Apply bitumen with mop.
- E. Apply bitumen at a temperature limited by equiviscous temperature (EVT) plus or minus 25 degrees F (14 degrees C); do not exceed finish blowing temperature for four hours.
- F. Apply from 2 inches (50 mm) below finish grade elevation down to top of footings.
- G. Seal items watertight with mastic, that project through dampproofing surface.

- H. Place drainage panel directly over dampproofing, butt joints, and position to ensure downward drainage.
- I. Scribe and cut boards around projections, penetrations, and interruptions.

END OF SECTION 07 11 13

NOT FOR BIDDING PURPOSES

NOT FOR BIDDING PURPOSES

This page intentionally left blank

**SECTION 07 21 00
THERMAL INSULATION**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Board insulation at perimeter foundation wall, over roof sheathing, and exterior wall behind metal panel wall finish.

1.02 RELATED REQUIREMENTS

- A. Section 07 27 00 - Air Barriers: Separate air barrier materials.
- B. Section 07 54 00 - Thermoplastic Membrane Roofing: Installation requirements for board insulation over low slope roof deck.

1.03 DEFINITIONS

- A. Mineral Fiber Material Composition: Insulation referred to as mineral fiber block, board, and blanket insulation is composed of fibers from mineral based substances such as rock, slag, or glass and processed from the molten state into fibrous form.
 - 1. Based on type of insulation substance, the material will be referred to as a mineral fiber when having a rock or slag base, and glass fiber with a glass or silica sand base, also considered a mineral.
 - 2. Insulation blankets are flexible units consisting of felted, bonded, or unbonded fibers formed into rolls or flat cut pieces referred to as batts; rolls are simply longer versions of batts.
 - 3. For additional information about mineral fiber and the various classification types, refer to the following reference standards, ASTM C553, ASTM C612, ASTM C665, and ASTM C726.

1.04 REFERENCE STANDARDS

- A. ASTM C553 - Standard Specification for Mineral Fiber Blanket Thermal Insulation for Commercial and Industrial Applications; 2024.
- B. ASTM C578 - Standard Specification for Rigid, Cellular Polystyrene Thermal Insulation; 2023.
- C. ASTM C612 - Standard Specification for Mineral Fiber Block and Board Thermal Insulation; 2025.
- D. ASTM C665 - Standard Specification for Mineral-Fiber Blanket Thermal Insulation for Light Frame Construction and Manufactured Housing; 2024.
- E. ASTM C726 - Standard Specification for Mineral Wool Roof Insulation Board; 2024.
- F. ASTM C1289 - Standard Specification for Faced Rigid Cellular Polyisocyanurate Thermal Insulation Board; 2025.
- G. ASTM E84 - Standard Test Method for Surface Burning Characteristics of Building Materials; 2026a.
- H. ASTM E96/E96M - Standard Test Methods for Gravimetric Determination of Water Vapor Transmission Rate of Materials; 2024a.
- I. NFPA 285 - Standard Fire Test Method for Evaluation of Fire Propagation Characteristics of Exterior Wall Assemblies Containing Combustible Components; 2025.

1.05 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements for submittal procedures.
- B. Product Data: Provide data on product characteristics, performance criteria, and product limitations.
- C. Manufacturer's Certificate: Certify that products meet or exceed specified requirements.

1.06 FIELD CONDITIONS

- A. Do not install insulation adhesives when temperature or weather conditions are detrimental to successful installation.

PART 2 PRODUCTS

2.01 APPLICATIONS

- A. Insulation at Perimeter of Foundation: Extruded polystyrene (XPS) board.
- B. Insulation Inside Masonry Cavity Walls: Polyisocyanurate board.
- C. Insulation in Wood Framed Walls: Batt insulation with no vapor retarder.
- D. Insulation in Wood Framed Ceiling Structure: Batt insulation with no vapor retarder.
- E. Insulation Above Lay-In Acoustical Ceilings: Batt insulation with no vapor retarder.

2.02 FOAM BOARD INSULATION MATERIALS

- A. Extruded Polystyrene (XPS) Board Insulation: Comply with ASTM C578 with either natural skin or cut cell surfaces.
 - 1. Type and Compressive Resistance: Type IV, 25 psi (173 kPa), minimum.
 - 2. Flame Spread Index (FSI): Class A - 0 to 25, when tested in accordance with ASTM E84.
 - 3. Smoke Developed Index (SDI): 450 or less, when tested in accordance with ASTM E84.
 - 4. Type and Thermal Resistance, R-value (RSI-value): Type IV, 5.0 (0.88), minimum, per 1 inch (25.4 mm) thickness at 75 degrees F (24 degrees C) mean temperature.
 - 5. Complies with fire resistance requirements indicated on drawings as part of an exterior non-load-bearing exterior wall assembly when tested in accordance with NFPA 285.
 - 6. Board Edges: Square.
 - 7. Type and Water Absorption: Type XII, 0.3 percent by volume, maximum, by total immersion.
 - 8. Products:
 - a. DuPont de Nemours, Inc.: building.dupont.com/#sle.
 - b. Kingspan Insulation LLC; GreenGuard GG25-LG XPS Insulation Board: www.kingspan.com/#sle.
 - c. Owens Corning Corporation; FOAMULAR NGX Type ____ Next Generation Extruded: www.ocbuildingspec.com/#sle.
 - d. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Polyisocyanurate (ISO) Board Insulation: Rigid cellular foam, comply with ASTM C1289.
 - 1. Classifications:
 - a. Type I: Faced with aluminum foil on both major surfaces of the core foam.
 - 1) Class 1 - Non-reinforced core foam.
 - 2) Compressive Strength: 16 psi (110 kPa), minimum.
 - 3) Thermal Resistance, R-value (RSI-value): At 1-1/2 inch (38.1 mm) thick; 9.0 (1.59), minimum, at 75 degrees F (24 degrees C).
 - b. Type II: Faced with either cellulosic facers or glass fiber mat facers on both major surfaces of the core foam.
 - 1) Class 2 - Faced with coated glass fiber mat facers on both major surfaces of core foam.
 - 2) Compressive Strength: Classes 1-2-3, Grade 2 - 20 psi (138 kPa), minimum.
 - 3) Thermal Resistance, R-value (RSI-value): At 1-1/2 inch (38.1 mm) thick; Class 2 - 8.0 (1.41), minimum, at 75 degrees F (24 degrees C).
 - 2. Flame Spread Index (FSI): Class A - 0 to 25, when tested in accordance with ASTM E84.
 - 3. Smoke Developed Index (SDI): 450 or less, when tested in accordance with ASTM E84.
 - 4. Water Vapor Permeance: 1.2 perm (68 ng/(Pa s sqm)), maximum, at 1 inch (25 mm) thickness, and when tested in accordance with ASTM E96/E96M, desiccant method.

5. Comply with fire resistance requirements indicated on drawings as part of an exterior non-load-bearing exterior wall assembly when tested in accordance with NFPA 285.
6. Board Size: 48 inch by 96 inch (1220 mm by 2440 mm).
7. Board Thickness: 2.7 inch (69 mm).
8. Tapered Board: Slope as indicated; minimum thickness 0.5 inch (12 mm); fabricate of fewest layers possible.
9. Board Edges: Square.
10. Products:
 - a. Carlisle Coatings & Waterproofing, Inc: www.carlisleccw.com/#sle.
 - b. GAF: www.gaf.com/#sle.
 - c. Hunter Panels: www.hunterpanels.com/#sle.
 - d. Johns Manville: www.jm.com/#sle.
 - e. Rmax Inc: www.rmax.com/#sle.
 - f. Substitutions: See Section 01 60 00 - Product Requirements.

2.03 ACCESSORIES

- A. Tape: Reinforced polyethylene film with acrylic pressure sensitive adhesive.
 1. Application: Sealing of interior circular penetrations, such as pipes or cables.
 2. Width: Are required for application.
 3. Temperature Resistance: Range of minus 40 to 212 degrees F (minus 40 to 100 degrees C).
 4. Products:
 - a. SIGA Cover Inc; SIGA-Rissat: www.siga.swiss/global_en/#sle.
 - b. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Tape: Bright aluminum self-adhering type, mesh reinforced, 2 inch (50 mm) wide.
 1. Products:
- C. Air and Moisture Sealing Insulation Fasteners: Preassembled fastener units consisting of sealing washer, screw, and gasketing tube.
- D. Infill Strips:
 1. High-performance insulation, PIR or XPS.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that substrate, adjacent materials, and insulation materials are dry and that substrates are ready to receive insulation.
- B. Verify substrate surfaces are flat, free of honeycomb, fins, irregularities, or materials or substances that may impede adhesive bond.

3.02 BOARD INSTALLATION AT FOUNDATION PERIMETER

- A. Adhere a 6 inches (152 mm) wide strip of polyethylene sheet over construction, control, and expansion joints with double beads of adhesive each side of joint.
 1. Tape seal joints.
 2. Extend sheet full height of joint.
- B. Install boards horizontally on foundation perimeter.
 1. Place boards to maximize adhesive contact.
 2. Butt edges and ends tightly to adjacent boards and to protrusions.
- C. Extend boards over expansion joints, unbonded to foundation on one side of joint.
- D. Cut and fit insulation tightly to protrusions or interruptions to the insulation plane.

- E. Immediately following application of board insulation, place protective boards over exposed insulation surfaces.

3.03 BOARD INSTALLATION AT CAVITY WALLS

- A. Install boards to fit snugly between wall ties.
- B. Install boards horizontally on walls.
- C. Cut and fit insulation tightly to protrusions or interruptions to the insulation plane.

3.04 BATT INSTALLATION

- A. Install insulation and vapor retarder in accordance with manufacturer's instructions.
- B. Install in exterior wall and roof spaces without gaps or voids. Do not compress insulation.
- C. Trim insulation neatly to fit spaces. Insulate miscellaneous gaps and voids.
- D. Fit insulation tightly in cavities and tightly to exterior side of mechanical and electrical services within the plane of the insulation.

3.05 PROTECTION

- A. Do not permit installed insulation to be damaged prior to its concealment.

END OF SECTION 07 21 00

**SECTION 07 27 00
AIR BARRIERS**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Air barriers.

1.02 RELATED REQUIREMENTS

- A. Section 03 10 00 - Concrete Forming and Accessories: For concrete form release agents.
- B. Section 07 62 00 - Sheet Metal Flashing and Trim: Metal flashings installed in conjunction with air barriers.

1.03 DEFINITIONS

- A. Air Barrier: Airtight barrier made of material that is virtually air impermeable but water vapor permeable, both to amount as specified, with sealed seams and sealed joints to adjacent surfaces.

1.04 REFERENCE STANDARDS

- A. ASTM C1289 - Standard Specification for Faced Rigid Cellular Polyisocyanurate Thermal Insulation Board; 2025.
- B. ASTM D412 - Standard Test Methods for Vulcanized Rubber and Thermoplastic Elastomers--Tension; 2016 (Reapproved 2021).
- C. ASTM D751 - Standard Test Methods for Coated Fabrics; 2019.
- D. ASTM D903 - Standard Test Method for Peel or Stripping Strength of Adhesive Bonds; 1998 (Reapproved 2025).
- E. ASTM D1970/D1970M - Standard Specification for Self-Adhering Polymer Modified Bituminous Sheet Materials Used as Steep Roofing Underlayment for Ice Dam Protection; 2025.
- F. ASTM E84 - Standard Test Method for Surface Burning Characteristics of Building Materials; 2026a.
- G. ASTM E96/E96M - Standard Test Methods for Gravimetric Determination of Water Vapor Transmission Rate of Materials; 2024a.
- H. ASTM E2178 - Standard Test Method for Determining Air Leakage Rate and Calculation of Air Permeance of Building Materials; 2021a.
- I. ASTM E2357 - Standard Test Method for Determining Air Leakage Rate of Air Barrier Assemblies; 2025.
- J. ICC-ES AC148 - Acceptance Criteria for Flexible Flashing Materials; 2017, with Editorial Revision (2021).
- K. NFPA 285 - Standard Fire Test Method for Evaluation of Fire Propagation Characteristics of Exterior Wall Assemblies Containing Combustible Components; 2025.

1.05 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements for submittal procedures.
- B. Product Data: Provide data on material characteristics, performance criteria, and limitations.
- C. Shop Drawings: Provide drawings of special joint conditions.
- D. ABAA Field Quality Control Submittals: Submit third-party reports of testing and inspection required by ABAA QAP.
- E. Manufacturer's Installation Instructions: Indicate preparation, installation methods, and storage and handling criteria.

- F. ABAA Manufacturer Qualification: Submit documentation of current evaluation of proposed manufacturer and materials.
- G. ABAA Installer Qualification: Submit documentation of current contractor accreditation and current installer certification; keep copies of each contractor accreditation and installer certification on site during and after installation, and present on-site documentation upon request.
- H. Manufacturer's qualification statement.
- I. Installer's qualification statement.
- J. Testing agency qualification statement.

1.06 QUALITY ASSURANCE

- A. Air Barrier Association of America (ABAA) Quality Assurance Program (QAP), www.airbarrier.org/#sle:
 - 1. Installer Qualification: Use accredited contractor, certified installers, evaluated materials, and third-party field quality control audit.
- B. Air Barrier Association of America (ABAA) Evaluated Air Barrier Assemblies; www.airbarrier.org/#sle: Use evaluated materials from a single manufacturer regularly engaged in air barrier material manufacture, and use secondary materials approved in writing by primary material manufacturer.
- C. Installer Qualifications: Company specializing in performing the work of this section with minimum three years documented experience.
- D. Manufacturer Qualification: Use evaluated materials from a single manufacturer regularly engaged in air barrier material manufacture, and use secondary materials approved in writing by primary material manufacturer.
- E. Testing Agency Qualifications: Independent firm specializing in performing testing and inspections of the type specified in this section.

1.07 MOCK-UPS

- A. See Section 01 40 00 - Quality Requirements for additional requirements.
- B. Construct air barrier mock-up, 10 feet (3 m) long by 10 feet (3 m) wide, indicating quality detailing, flashing, and transitions to other materials..
- C. Locate where directed.
- D. Mock-up may remain as part of work.

1.08 FIELD CONDITIONS

- A. Maintain temperature and humidity recommended by materials manufacturers before, during, and after installation.

PART 2 PRODUCTS

2.01 AIR BARRIER MATERIALS (AIR IMPERMEABLE AND WATER VAPOR PERMEABLE)

- A. Air Barrier, Fluid Applied: Vapor semi-permeable, elastomeric waterproofing.
 - 1. Air Barrier Coating:
 - a. Material: 100 percent silicone.
 - b. Dry Film Thickness (DFT): 20 mil, 0.020 inch (0.508 mm), minimum.
 - c. Air Permeance: 0.004 cfm/sq ft (0.02 L/(s sq m)), maximum, when tested in accordance with ASTM E2178.
 - d. Water Vapor Permeance: 11 perms (629 ng/(Pa s sq m)), minimum, when tested in accordance with ASTM E96/E96M using Procedure B - Water Method, at 73.4 degrees F (23 degrees C).
 - e. Ultraviolet (UV) and Weathering Resistance: Approved by manufacturer for up to 90 days of weather exposure.

- f. Elongation: 300 percent, minimum, when tested in accordance with ASTM D412.
- g. Surface Burning Characteristics: Flame spread index of 25 or less, smoke developed index of 450 or less, Class A when tested in accordance with ASTM E84.
- h. Comply with NFPA 285 requirements for wall assembly.
- i. Nail Sealability: Pass, when tested in accordance with ASTM D1970/D1970M.
- j. VOC Content: Zero.
- k. Sealants, Tapes and Accessories: As recommended by coating manufacturer.
- l. Products:
 - 1) GCP Applied Technologies; Perm-A-Barrier VPL 50RS UV Stable. www.gcpat.com/#sle.
 - 2) Henry Company; Air-Bloc All Weather STPE: www.henry.com/#sle. (Basis of Design)
 - 3) PROSOCO, Inc; R-GUARD Spray Wrap MVP: www.prosoco.com/r-guard/#sle.

2.02 ACCESSORIES

- A. Sealants, Tapes, and Accessories for Sealing Air Barrier and Adjacent Substrates: As indicated or in compliance with air barrier manufacturer's installation instructions.
- B. Sealant for Cracks and Joints In Substrates: Resilient elastomeric joint sealant compatible with substrate and air barrier materials.
 - 1. Application: Apply at 30 to 40 mil, 0.030 to 0.040 inch (0.76 to 1.02 mm), nominal thickness.
 - 2. Color: Green.
 - 3. Elongation: 1,300 percent, measured in accordance with ASTM D412.
 - 4. Peel Adhesion: 28 lb/inch (5.0 kg/cm), minimum, when tested in accordance with ASTM D903.
 - 5. Hydrostatic Head Pressure: Resists head pressure of 57 feet (17.4 m), maximum, when tested in accordance with ASTM D751.
 - 6. Comply with NFPA 285 requirements for wall assembly.
 - 7. Products:
 - a. Karnak Corporation; 323 K-NRG Gap Seal FR: www.karnakcorp.com/#sle.
 - b. Rubber Polymer Company; Rub-R-Wall Mastic: www.rpcinfo.com/#sle.
 - c. TYFAR; TYPAR HD Heavy-Duty Sealant: www.typar.com/#sle.
 - d. Substitutions: See Section 01 60 00 - Product Requirements.
- C. Primer: Liquid applied polymer.
 - 1. Color: Green.
 - 2. Elongation: 1,300 percent, measured in accordance with ASTM D412.
- D. Stainless Steel Flashing: Self-adhering flexible flashing with 2 mil, 0.002 inch (0.051 mm) thick Type 304 stainless steel sheet, 8 mil, 0.008 inch (0.203 mm) of butyl adhesive and siliconized release liner.
 - 1. Roll Length: 50 feet (15.2 m) long.
 - 2. Width: 6 inches (152 mm) wide.
 - 3. Overlap joints at least 2 inches (51 mm).
 - 4. Products:
 - a. York; York 304 SA: www.yorkflashing.com/. (Basis of Design).
 - b. Substitutions: See Section 01 60 00 - Product Requirements.
- E. Seam and Perimeter Tape: Polyethylene face material with acrylic adhesive.
 - 1. Thickness: 3.6 mils, 0.0036 inch (0.091 mm).
- F. Thinners and Cleaners: As recommended by material manufacturer.

- G. Air and Moisture Sealing Insulation Fasteners: Preassembled fastener units consisting of sealing washer, screw, and gasketing tube.
 - 1. Length as required for thickness of insulation material and penetration of deck substrate.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that surfaces and conditions are ready for work of this section.
- B. Where existing conditions are responsibility of another installer, notify Architect of unsatisfactory conditions.
- C. Do not proceed with this work until unsatisfactory conditions have been corrected.

3.02 PREPARATION

- A. Remove projections, protruding fasteners, and loose or foreign matter that might interfere with proper installation.
- B. Clean and prime substrate surfaces to receive adhesives and sealants in accordance with manufacturer's installation instructions.

3.03 INSTALLATION

- A. Install materials in accordance with manufacturer's installation instructions.
- B. Air Barriers: Install continuous airtight barrier over surfaces indicated, with sealed seams and with sealed joints to adjacent surfaces.
- C. Apply sealants and adhesives within recommended temperature range in accordance with manufacturer's installation instructions.
- D. Fluid-Applied Coatings or Membranes:
 - 1. Prepare substrate in accordance with manufacturer's installation instructions; treat joints in substrate and between dissimilar materials as indicated.
 - 2. Use flashing to seal to adjacent construction and to bridge joints in coating substrate.
- E. Openings and Penetrations in Exterior Air Barriers:
 - 1. Install flashing over sills, covering entire sill frame member, extending at least 5 inches (125 mm) onto air barrier and at least 6 inches (150 mm) up jambs; mechanically fasten stretched edges.
 - 2. At openings with frames having nailing flanges, seal head and jamb flanges using a continuous bead of sealant compressed by flange and cover flanges with sealing tape at least 1/4 inches (100 mm) wide; do not seal sill flange.
 - 3. At openings with nonflanged frames, seal air barrier to each side of framing at opening using flashing at least 9 inches (230 mm) wide, and covering entire depth of framing.
 - 4. At head of openings, install flashing under air barrier extending at least 2 inches (50 mm) beyond face of jambs; seal air barrier to flashing.
 - 5. At interior face of openings, seal gap between window/door frame and rough framing, using joint sealant over backer rod.
 - 6. Service and Other Penetrations: Form flashing around penetrating item and seal to air barrier surface.

3.04 FIELD QUALITY CONTROL

- A. See Section 01 40 00 - Quality Requirements for additional requirements.
- B. Owner will provide testing services, and Contractor to provide temporary construction and materials for testing.
- C. Coordination of ABAA Tests and Inspections:
 - 1. Provide testing and inspection required by ABAA QAP.
 - 2. Notify ABAA in writing of schedule for air barrier work, and allow adequate time for testing and inspection.

3. Cooperate with ABAA testing agency.
 4. Allow access to air barrier work areas and staging.
 5. Do not cover air barrier work until tested, inspected, and accepted.
- D. Do not cover installed air barriers until required inspections have been completed.
- E. Obtain approval of installation procedures from air barrier manufacturer based on a mock-up installed in place, prior to proceeding with remainder of installation.
- F. Take digital photographs of each portion of installation prior to covering up air barriers.

3.05 PROTECTION

- A. Do not leave materials exposed to weather longer than recommended by manufacturer.

END OF SECTION 07 27 00

NOT FOR BIDDING PURPOSES

NOT FOR BIDDING PURPOSES

This page intentionally left blank

**SECTION 07 31 13
ASPHALT SHINGLES**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Asphalt shingle roofing.
- B. Flexible sheet membranes for eave protection and underlayment.
- C. Flashing.

1.02 RELATED REQUIREMENTS

- A. Section 06 10 00 - Rough Carpentry: Roof sheathing.
- B. Section 07 21 00 - Thermal Insulation: Nailable rigid insulation.
- C. Section 07 62 00 - Sheet Metal Flashing and Trim: Edge and cap flashings.
- D. Section 07 71 23 - Manufactured Gutters and Downspouts
- E. Section 07 72 00 - Roof Accessories: Snow guards.

1.03 REFERENCE STANDARDS

- A. ASTM D226/D226M - Standard Specification for Asphalt-Saturated Organic Felt Used in Roofing and Waterproofing; 2025.
- B. ASTM D1970/D1970M - Standard Specification for Self-Adhering Polymer Modified Bituminous Sheet Materials Used as Steep Roofing Underlayment for Ice Dam Protection; 2025.
- C. ASTM D3161/D3161M - Standard Test Method for Wind Resistance of Steep Slope Roofing Products (Fan-Induced Method); 2020 (Reapproved 2025).
- D. ASTM D3462/D3462M - Standard Specification for Asphalt Shingles Made from Glass Felt and Surfaced with Mineral Granules; 2023.
- E. ASTM D4586/D4586M - Standard Specification for Asphalt Roof Cement, Asbestos-Free; 2007 (Reapproved 2024).
- F. ASTM D4869/D4869M - Standard Specification for Asphalt-Saturated Organic Felt Underlayment Used in Steep Slope Roofing; 2016a (Reapproved 2021).
- G. ASTM D7158/D7158M - Standard Test Method for Wind Resistance of Asphalt Shingles (Uplift Force/Uplift Resistance Method); 2020.
- H. ASTM E108 - Standard Test Methods for Fire Tests of Roof Coverings; 2025.
- I. ASTM F1667/F1667M - Standard Specification for Driven Fasteners: Nails, Spikes, and Staples; 2021a.
- J. NRCA (RM) - The NRCA Roofing Manual; 2025.
- K. UL (DIR) - Online Certifications Directory; Current Edition.

1.04 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements for submittal procedures.
- B. Product Data: Provide data indicating material characteristics, performance criteria, and limitations.
- C. Shop Drawings: For metal flashings, indicate specially configured metal flashings, fastening methods and locations, and installation details.
- D. Samples: Submit two samples of each shingle color indicating color range and finish texture/pattern ; for color selection.
- E. Manufacturer's Installation Instructions: Indicate installation criteria and procedures.

- F. Installer's qualification statement.
- G. Warranty Documentation: Submit manufacturer warranty and ensure forms have been completed in Owner's name and registered with manufacturer.

1.05 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacture of roofing systems similar to those required for this project, with not less than 5 years of documented experience.
- B. Installer Qualifications: Company specializing in installing asphalt shingles, with at least 5 years of documented experience.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. See Section 01 74 19 - Construction Waste Management and Disposal for packaging waste requirements.
- B. Deliver and store materials with labels intact in manufacturer's unopened packaging until ready for installation.
- C. Store materials under dry and waterproof cover, well ventilated, and elevated above grade on a flat surface.
- D. Protect materials from harmful environmental elements, construction dust, direct sunlight, and other potentially detrimental conditions.
- E. When storing roofing materials on roofing system ensure no damage occurs to supporting members and other materials.

1.07 FIELD CONDITIONS

- A. Do not install shingles, eave protection membrane or underlayment when surface, ambient air, or wind chill temperatures are below 45 degrees F (7 degrees C).

1.08 WARRANTY

- A. See Section 01 78 00 - Closeout Submittals for additional warranty requirements.
- B. Provide lifetime manufacturer's warranty for coverage against black streaks caused by algae.
- C. Provide 5-year manufacturer's warranty for wind damage.
- D. Extended Correction Period: Correct defective work within 2-year period commencing on Date of Substantial Completion.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Asphalt Shingles:
 - 1. Atlas Roofing Corporation: www.atlasroofing.com/#sle.
 - 2. CertainTeed; Landmark PRO Solaris: www.certainteed.com/#sle.
 - 3. GAF; Timberline HDZ RS Shingles: www.gaf.com/#sle.
 - 4. Owens Corning Corporation: www.owenscorning.com/en-us/#sle.
 - 5. Substitutions: See Section 01 60 00 - Product Requirements.

2.02 ASPHALT SHINGLES

- A. Asphalt Shingles: Asphalt-coated glass felt, mineral granule surfaced, complying with ASTM D3462/D3462M.
 - 1. Fire Resistance: Class A, complying with ASTM E108.
 - 2. Wind Resistance: Class A, when tested in accordance with ASTM D3161/D3161M.
 - 3. Wind Resistance (Uplift): Class G, when tested in accordance with ASTM D7158/D7158M.
 - 4. Fire or Wind Resistance Criteria: Provide UL (DIR) listed and labeled products.
 - 5. Warranted Wind Speed: Not greater than 150 mph (241 km/h).

6. Algae resistant.
7. Solar reflective.
8. Weight: 95 lb/100 sq ft (43 kg/9.3 sq m).
9. Self-sealing type.
10. Style: Square.
11. Color: As selected by Architect.

2.03 SHEET MATERIALS

- A. Eave Protection Membrane:
1. Eave Protection Membrane: Self-adhering polymer-modified asphalt sheet complying with ASTM D1970/D1970M; 40 mil (1 mm) total thickness; with strippable treated release paper and polyethylene sheet top surface.
- B. Eave Edge Starter Shingles: Glass felt base, with ceramic coated mineral granules tightly embedded in refined, water-resistant asphalt, complying with ASTM D3462/D3462M.
1. Wind Resistance: Class F, when tested in accordance with ASTM D3161/D3161M.
 2. Fire Resistance: Class A, complying with ASTM E108.
 3. Shingle Size: 8-3/16 by 38-1/4 inches (208 by 972 mm), nominal.
 4. Application: Roof with slope greater than 2 inches per foot (51 mm per 305 mm) and shingle exposure less than 5-5/8 inches (143 mm).
- C. Underlayment: Synthetic non-asphaltic sheet, intended by manufacturer for mechanically fastened roofing underlayment without sealed seams.
1. Type: Woven polypropylene with anti-slip polyolefin coating on both sides.
 2. Self Sealability: Passing nail sealability test specified in ASTM D1970/D1970M.
 3. Flammability: Minimum of Class A, when tested in accordance with ASTM E108.
 4. Ultraviolet (UV) Resistance and Weatherability: Approved in writing by manufacturer for exposure to weather for minimum of six months.
 5. Low Temperature Flexibility: Passing test specified in ASTM D1970/D1970M.
 6. Performance: Meet or exceed requirements for ASTM D226/D226M, Type II asphalt-saturated organic felt.
 7. Liquid Water Transmission: Passes ASTM D4869/D4869M.
 8. Functional Temperature Range: From minus 70 degrees F (minus 56.7 degrees C) to 212 degrees F (100 degrees C).
 9. Fasteners: As recommended by manufacturer or building code qualification report or approval.
- D. Underlayment: Self-adhering, rubber-modified asphalt sheet complying with ASTM D1970/D1970M; 45 mils, 0.045 inch (1.14 mm) total thickness; with strippable release film and woven polypropylene sheet top surface.
- E. Underlayment: Self-adhering butyl-rubber sheet complying with ASTM D1970/D1970M; strippable release film.
1. Self Sealability: Passing nail sealability test specified in ASTM D1970/D1970M.
 2. Low Temperature Flexibility: Passing test specified in ASTM D1970/D1970M.

2.04 FLASHING

- A. Metal Flashings: Provide sheet metal eave edge, gable edge, ridge, and other flashing as indicated.
1. Form flashings to protect roofing materials from physical damage and shed water.
 2. Form sections square and accurate to profile, in maximum possible lengths, free from distortion or defects detrimental to appearance or performance.
 3. Hem exposed edges of flashings minimum 1/4 inch (6 mm) on underside.
 4. Coat concealed surfaces of flashings with bituminous paint.

- B. Aluminum Flashing: Prefinished aluminum, 26 gauge, 0.017 inch (0.43 mm) minimum thickness; stucco embossed, PVC coating, color as selected.
- C. Flexible Flashing: Self-adhering polymer-modified asphalt sheet complying with ASTM D1970/D1970M; 40-mil, 0.040-inch (1 mm) total thickness; with strippable treated release paper and polyethylene sheet top surface.

2.05 ACCESSORIES

- A. Roofing Nails: Standard round wire shingle type, galvanized steel, stainless steel, or aluminum roofing nails, minimum 3/8-inch (9.5 mm) head diameter, 12-gauge, 0.109-inch (2.77 mm) nail shank diameter, 1-1/2 inches (38 mm) long and complying with ASTM F1667/F1667M.
- B. Asphalt Roof Cement: ASTM D4586/D4586M, asbestos-free.
- C. Bituminous Paint: Acid and alkali resistant type; black color.
- D. Lap Cement: Fibrated cutback asphalt type, recommended for use in application of underlayment, free of toxic solvents.
- E. Plastic Ridge Vents: Extruded plastic with vent openings do not permit direct water or weather entry; flanged to receive shingles.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify existing conditions prior to starting this work.
- B. Verify roof deck is of sufficient thickness to accept fasteners.
- C. Verify roof penetrations and plumbing stacks are in place and flashed to deck surface.
- D. Verify roof openings are correctly framed.
- E. Verify deck surfaces are dry, free of ridges, warps, or voids.

3.02 PREPARATION

- A. Seal roof deck joints wider than 1/16 inch (1.5 mm) as recommended by shingle manufacturer.
- B. At areas where eave protection membrane is to be adhered to substrate, fill knot holes and surface cracks with latex filler.
- C. Broom clean deck surfaces before installing underlayment or eave protection.
- D. Protect surrounding areas and adjacent surfaces from damage during execution of this work.
- E. Install eave edge flashings tight with fascia boards, weather lap joints 2 inches (50 mm) and seal with roof cement, and secure flange with nails spaced 6 inches (150 mm) on center.

3.03 INSTALLATION

- A. Eave Protection Membrane:
 - 1. Install eave protection membrane from eave edge to minimum 48 inches (1,220 mm) up-slope beyond interior face of exterior wall.
 - 2. Install eave protection membrane in accordance with manufacturer's instructions and NRCA (RM) applicable requirements.
- B. Underlayment:
 - 1. Roof Slopes Up to 4:12: Install two layers of underlayment over area not protected by eave protection, with ends and edges weather lapped minimum 4 inches (100 mm); stagger end laps of each consecutive layer and nail in place.
 - 2. Roof Slopes Greater Than 4:12: Install underlayment perpendicular to slope of roof, with ends and edges weather lapped minimum 4 inches (100 mm); stagger end laps of each consecutive layer, nail in place, and weather lap minimum 4 inches (100 mm) over eave protection.

3. Weather lap and seal watertight with plastic cement any items projecting through or mounted on roof.
- C. Metal Flashing:
 1. Install flashings in accordance with manufacturer's instructions and NRCA (RM) applicable requirements.
 2. Weather lap joints minimum 2 inches (50 mm) and seal weather tight with plastic cement.
 3. Secure in place with nails at 8 inches (200 mm) on center, and conceal fastenings.
 4. Items Projecting Through or Mounted on Roofing: Flash and seal weather tight with plastic cement.
- D. Shingles:
 1. Install shingles in accordance with manufacturer's instructions and NRCA (RM) applicable requirements.
 - a. Fasten individual shingles using two nails per shingle, or as required by manufacturer and local building code, whichever is greater.
 - b. Fasten strip shingles using four nails per strip, or as required by manufacturer and local building code, whichever is greater.
 2. Place shingles in straight coursing pattern with 5-inch (125 mm) weather exposure to produce double thickness over full roof area, and provide double course of shingles at eaves.
 3. Project first course of shingles 3/4 inch (19 mm) beyond fascia boards.
 4. Extend shingles 1/2 inch (13 mm) beyond face of gable edge fascia boards.
 5. Extend shingles on one slope across valley and fasten; trim shingles from other slope 2 inches (50 mm) from valley center line to achieve closed cut valley, concealing valley protection.
 6. Extend shingles on both slopes across valley in a weave pattern and fasten; extend shingles a minimum of 12 inches (300 mm) beyond valley center line to achieve woven valley, concealing valley protection.
 7. Cap hips with individual shingles, maintaining 5-inch (127 mm) weather exposure, and place to avoid exposed nails.
 8. After installation, place one daub of plastic cement 1-inch (25.4 mm) diameter under each individual shingle tab exposed to weather to prevent lifting.
 9. Coordinate installation of roof mounted components or work projecting through roof with weathertight placement of counterflashings.
 10. Complete installation to provide weathertight service.

3.04 CLEANING

- A. See Section 01 70 00 - Execution and Closeout Requirements for additional requirements.
- B. Clean exposed work upon completion of installation; remove grease and oil films, excess joint sealer, handling marks, and debris from installation, leaving work clean and unmarked, free from dents, creases, waves, scratch marks, or other damage to finish.

3.05 PROTECTION

- A. Do not permit traffic over finished roof surface; protect roofing until completion of project.
- B. Touch-up, repair, or replace damaged asphalt shingles or accessories before Date of Substantial Completion.

END OF SECTION 07 31 13

NOT FOR BIDDING PURPOSES

This page intentionally left blank

**SECTION 07 42 13
METAL WALL PANELS**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Manufactured metal panels for exterior wall panels, with related flashings and accessory components.

1.02 RELATED REQUIREMENTS

- A. Section 05 40 00 - Cold-Formed Metal Framing: Wall panel substrate.
- B. Section 06 10 00 - Rough Carpentry: Wall panel substrate.
- C. Section 07 25 00 - Weather Barriers: Weather barrier under wall panels.
- D. Section 07 27 00 - Air Barriers: Air barrier under wall panels.
- E. Section 07 92 00 - Joint Sealants: Sealing joints between metal wall panel system and adjacent construction.

1.03 REFERENCE STANDARDS

- A. AAMA 2605 - Voluntary Specification, Performance Requirements and Test Procedures for Superior Performing Organic Coatings on Aluminum Extrusions and Panels (with Coil Coating Appendix); 2022.
- B. ASTM B209/B209M - Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate; 2021a.
- C. NFPA 285 - Standard Fire Test Method for Evaluation of Fire Propagation Characteristics of Exterior Wall Assemblies Containing Combustible Components; 2025.

1.04 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements for submittal procedures.
- B. Product Data - Wall System: Manufacturer's data sheets on each product to be used, including:
 - 1. Physical characteristics of components shown on shop drawings.
 - 2. Storage and handling requirements and recommendations.
 - 3. Installation instructions and recommendations.
- C. Shop Drawings: Indicate dimensions, layout, joints, construction details, support clips, and methods of anchorage.
- D. Samples: Submit two samples of wall panel and soffit panel, 12 inches by 12 inches (305 mm by 305 mm) in size illustrating finish color, sheen, and texture.
- E. Test Reports: Submit test report verifying compliance with NFPA 285 for previously-tested exterior wall assembly.
- F. Manufacturer's qualification statement.
- G. Installer's qualification statement.
- H. Testing agency's qualification statement.
- I. Warranty Documentation for Installation of Building Rainscreen Assembly: Submit installer warranty and ensure that forms have been completed in Owner's name and registered with installer.

1.05 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing products specified in this section with minimum three years of documented experience.

- B. Installer Qualifications: Company specializing in installing products specified in this section with minimum three years of documented experience.
- C. Testing Agency Qualifications: Independent firm specializing in performing testing and inspections of the type specified in this section.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. See Section 01 74 19 - Construction Waste Management and Disposal for packaging waste requirements.
- B. Protect panels from accelerated weathering by removing or venting sheet plastic shipping wrap.
- C. Store prefinished material off the ground and protected from weather; prevent twisting, bending, or abrasion; provide ventilation; slope metal sheets to ensure proper drainage.
- D. Prevent contact with materials that may cause discoloration or staining of products.

1.07 FIELD CONDITIONS

- A. Do not install wall panels when air temperature or relative humidity are outside manufacturer's limits.

1.08 WARRANTY

- A. See Section 01 78 00 - Closeout Submittals for additional warranty requirements.
- B. Finish Warranty: Provide 15-year manufacturer warranty against excessive degradation of exterior finish. Include provision for replacement of units with excessive fading, chalking, or flaking. Complete forms in Owner's name and register with warrantor.
- C. Special Warranty: Provide 2-year warranty covering water tightness and integrity of seals of metal wall panels. Complete forms in Owner's name and register with warrantor.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Metal Wall Panels - Exposed Fasteners:
 - 1. ATAS International, Inc: www.atas.com/#sle.
 - 2. IMETCO.
 - 3. MBCI, a Cornerstone Building Brands Company: www.mbc.com/#sle.
 - 4. Morin Corporation: www.morincorp.com/#sle.
 - 5. Petersen Aluminum Corporation; R-36 Panel: www.pac-clad.com/#sle. Basis-of-Design.

2.02 METAL WALL PANEL SYSTEM

- A. Wall Panel System: Factory fabricated prefinished metal panel system, site assembled.
 - 1. Provide exterior wall panels and subgirt framing assembly.
 - 2. Design and size components to support assembly dead loads, and to withstand live loads caused by positive and negative wind pressure acting normal to plane of wall.
 - 3. Design Pressure: In accordance with applicable codes.
 - 4. Fire Performance: Tested in accordance with, and complying with acceptance criteria of NFPA 285.
 - 5. Maximum Allowable Deflection of Panel: $L/180$ for length(L) of span.
 - 6. Movement: Accommodate movement within system without damage to components or deterioration of seals, movement between system and perimeter components when subject to seasonal temperature cycling; dynamic loading and release of loads; and deflection of structural support framing.
 - 7. Drainage: Provide positive drainage to exterior for moisture entering or condensation occurring within panel system.
 - 8. Fabrication: Formed true to shape, accurate in size, square, and free from distortion or defects; pieces of longest practical lengths.

9. Corners: Factory-fabricated in one continuous piece with minimum 2-inch (51 mm) returns.
 10. Provide continuity of weather barrier seal at building enclosure elements in accordance with requirements; see Section 07 25 00.
 11. Provide continuity of air barrier seal at building enclosure elements in accordance with requirements; see Section 07 27 00.
- B. Exterior Wall Panels:
1. Profile: Horizontal; style as indicated.
 2. Side Seams: Lap.
 3. Material: Precoated aluminum sheet, 18 gauge, 0.0403 inch (1.02 mm) minimum thickness.
 4. Panel Width: 36 inches (914 mm).
 5. Panel Depth: 1.25 inch (32 mm).
 6. Panel Finish: Smooth.
 7. Color: As selected by Architect from manufacturer's standard line.
- C. Subgirt Framing Assembly:
- D. Internal and External Corners: Same material, thickness, and finish as exterior sheets; profile to suit system; shop cut and factory mitered to required angles.
- E. Trim: Same material, thickness and finish as exterior sheets; brake formed to required profiles.
- F. Anchors: Aluminum or Stainless steel.

2.03 MATERIALS

- A. Precoated Aluminum Sheet: ASTM B209/B209M, 3105 alloy, O temper, with smooth surface texture; continuous-coil-coated on exposed surfaces with specified finish coating and on panel back with specified panel back coating.
- B. Select materials with surface flatness, smoothness, and lack of surface blemishes where exposed to view in finished system.

2.04 FINISHES

- A. Fluoropolymer Coil Coating System: Polyvinylidene fluoride (PVDF) multi-coat superior performing organic coatings system complying with AAMA 2605, including at least 70 percent PVDF resin, and at least 80 percent of coil coated metal surfaces having minimum total dry film thickness (DFT) of 0.9 mil, 0.0009 inch (0.023 mm); color and gloss as selected by Architect from manufacturer's standard line.
 1. Products:
 - a. Arkema, Inc; Kynar 500: www.arkema.com/#sle.
 - b. PPG; Duranar: www.ppgmetalcoatings.com/#sle.
 - c. Sherwin-Williams Company; Fluropon: www.coil.sherwin.com/#sle.
 - d. Substitutions: See Section 01 60 00 - Product Requirements.

2.05 ACCESSORIES

- A. Concealed Sealants: Non-curing butyl sealant or tape sealant, see Section 07 92 00
- B. Field Touch-up Paint: As recommended by panel manufacturer.
- C. Bituminous Paint: Asphalt base.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that building framing members are ready to receive panels.

- B. Verify weather barrier, see Section 07 25 00, has been installed over wall panel substrate; see Section 05 40 00.
- C. Verify air barrier, see Section 07 27 00, has been installed over wall panel substrate; see Section 05 40 00.

3.02 PREPARATION

- A. Install subgirts perpendicular to panel length, securely fastened to substrates and shimmed and leveled to uniform plane, and spaced at intervals indicated.
- B. Protect surrounding areas and adjacent surfaces from damage during execution of this work.

3.03 INSTALLATION

- A. Install panels on walls and soffits in accordance with manufacturer's instructions.
- B. Protect surfaces in contact with cementitious materials and dissimilar metals with bituminous paint; allow to dry prior to wall panel installation.
- C. Fasten panels to structural supports; aligned, level, and plumb.
- D. Locate joints over supports.
- E. Lap panel ends 2 inches (51 mm), minimum.
- F. Provide control joints where indicated.
- G. Use concealed fasteners unless otherwise indicated by Architect.
- H. Seal and place gaskets to prevent weather penetration. Maintain neat appearance.

3.04 TOLERANCES

- A. Offset From True Alignment Between Adjacent Members Abutting or In Line: 1/16 inch (1.6 mm), maximum.
- B. Variation from Plane or Location As Indicated on Drawings: 1/4 inch (6.4 mm), maximum.

3.05 CLEANING

- A. See Section 01 70 00 - Execution and Closeout Requirements for additional requirements.
- B. Remove site cuttings from finish surfaces.
- C. Remove protective material from wall panel surfaces.
- D. Clean and wash unfinished surfaces with mild soap and water; rinse with clean water.

3.06 PROTECTION

- A. Protect metal wall panels until completion of project.
- B. Touch-up, repair, or replace damaged wall panels or accessories before Date of Substantial Completion.

END OF SECTION 07 42 13

SECTION 07 71 23
MANUFACTURED GUTTERS AND DOWNSPOUTS

PART 1 GENERAL

1.01 RELATED REQUIREMENTS

- A. Section 07 62 00 - Sheet Metal Flashing and Trim.

1.02 REFERENCE STANDARDS

- A. AAMA 2604 - Voluntary Specification, Performance Requirements and Test Procedures for High Performance Organic Coatings on Aluminum Extrusions and Panels (with Coil Coating Appendix); 2022.
- B. ASTM B209/B209M - Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate; 2021a.
- C. SMACNA (ASMM) - Architectural Sheet Metal Manual; 2012.

1.03 ADMINISTRATIVE REQUIREMENTS

- A. Comply with SMACNA (ASMM) for sizing components for rainfall intensity determined by a storm occurrence of 1 in 5 years.
- B. Comply with applicable code for size and method of rain water discharge.
- C. Maintain one copy of each document on site.

1.04 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements for submittal procedures.
- B. Product Data: Provide data on prefabricated components.
- C. Shop Drawings: Indicate locations, configurations, jointing methods, fastening methods, locations, and installation details.
- D. Samples: Submit two samples, 12 inch (300 mm) long illustrating component design, finish, color, and configuration.

1.05 DELIVERY, STORAGE, AND HANDLING

- A. See Section 01 74 19 - Construction Waste Management and Disposal for packaging waste requirements.
- B. Stack material to prevent twisting, bending, or abrasion, and to provide ventilation. Slope to drain.
- C. Prevent contact with materials that could cause discoloration, staining, or damage.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Gutters and Downspouts:
 - 1. ATAS International, Inc: www.atas.com/#sle.
 - 2. Cheney Flashing Company: www.cheneyflashing.com/#sle.
 - 3. Drexel Metals Inc: www.drexmet.com/#sle.
 - 4. Hickman Edge Systems: www.hickmanedgesystems.com/#sle.
 - 5. Metal-Era Inc: www.metalera.com/#sle.
 - 6. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Scupper and Collectors:

2.02 MATERIALS

- A. Pre-Finished Aluminum Sheet: ASTM B209/B209M; 0.040 inch (1.0 mm) thick.

1. Finish: Plain, shop pre-coated with modified silicone coating.
 2. Color: To match existing.
- B. Primer: Zinc molybdate type.
- C. Protective Backing Paint: Zinc molybdate alkyd.

2.03 COMPONENTS

- A. Gutters: SMACNA semi-circular style profile Profile as indicated.
- B. Downspouts: CDA rectangular profile.
- C. Anchors and Supports: Profiled to suit gutters and downspouts.
1. Anchoring Devices: In accordance with SMACNA requirements.
 2. Gutter Supports: Match existing.
 3. Downspout Supports: Match existing.
- D. Fasteners: Aluminum, with soft neoprene washers.

2.04 FABRICATION

- A. Form gutters and downspouts of profiles and size indicated.
- B. Fabricate with required connection pieces.
- C. Form sections square, true, and accurate in size, in maximum possible lengths, free of distortion or defects detrimental to appearance or performance. Allow for expansion at joints.
- D. Hem exposed edges of metal.
- E. Tin edges of copper sheet to be soldered. Solder shop formed metal joints. After soldering, remove flux. Wipe and wash solder joints clean. Weather seal joints.
- F. Fabricate gutter and downspout accessories; seal watertight.

2.05 FINISHES

- A. Fluoropolymer Coating: High Performance Organic Finish, AAMA 2604, multiple coat, thermally cured fluoropolymer finish system; color as indicated.

2.06 ACCESSORIES

- A. Splash Pads: Precast concrete type, profiles size(s) as indicated; minimum 3,000 psi (21 MPa) compressive strength at 28 days, with minimum 5 percent air entrainment.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify existing conditions before starting work.
- B. Verify that surfaces are ready to receive work.

3.02 PREPARATION

- A. Paint concealed sheet metal surfaces and surfaces in contact with dissimilar metals with protective backing paint to a minimum dry film thickness of 15 mil, 0.015 inch (0.381 mm).

3.03 INSTALLATION

- A. Install gutters, downspouts, and accessories in accordance with manufacturer's instructions.
- B. Sheet Metal: Join lengths with formed seams sealed watertight. Flash and seal gutters to downspouts and accessories.
- C. Slope gutters 1/16 inch per foot (5.2 mm/m) , 1 percent minimum.
- D. Connect downspouts to downspout boots at grade. Seal connection watertight.
- E. Set splash pads under downspouts.

END OF SECTION 07 71 23

**SECTION 07 84 00
FIRESTOPPING**

PART 1 GENERAL

1.01 RELATED REQUIREMENTS

- A. Section 01 70 00 - Execution and Closeout Requirements: Cutting and patching.

1.02 REFERENCE STANDARDS

- A. ASTM E119 - Standard Test Methods for Fire Tests of Building Construction and Materials; 2015.
- B. ASTM E814 - Standard Test Method for Fire Tests of Through-Penetration Fire Stops; 2013a.
- C. FM (AG) - FM Approval Guide; Current Edition.
- D. FM 4991 - Approval Standard for Firestop Contractors; 2013.
- E. ITS (DIR) - Directory of Listed Products; Current Edition.
- F. SCAQMD 1168 - South Coast Air Quality Management District Rule No.1168; current edition.
- G. UL (FRD) - Fire Resistance Directory; current edition.
- H. UL 1479 - Standard for Fire Tests of Penetration Firestops; Current Edition, Including All Revisions.

1.03 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements for submittal procedures.
- B. Schedule of Firestopping: List each type of penetration, fire rating of the penetrated assembly, and firestopping test or design number.
- C. Product Data: Provide data on product characteristics, performance ratings, and limitations.
- D. Manufacturer's qualification statement.
- E. Installer's qualification statement.

1.04 QUALITY ASSURANCE

- A. Fire Testing: Provide firestopping assemblies of designs that provide the scheduled fire ratings when tested in accordance with methods indicated.
 - 1. Listing in UL (FRD), FM (AG), or ITS (DIR) will be considered as constituting an acceptable test report.
 - 2. Valid evaluation report published by ICC Evaluation Service, Inc. (ICC-ES) at www.icc-es.org will be considered as constituting an acceptable test report.
- B. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum three years documented experience.
- C. Installer Qualifications: Company specializing in performing the work of this section and:
 - 1. Approved by Factory Mutual Research Corporation under FM 4991, or meeting any two of the following requirements:
 - 2. Verification of minimum three years documented experience installing work of this type.
 - 3. Verification of at least five satisfactorily completed projects of comparable size and type.
 - 4. Licensed by local authorities having jurisdiction (AHJ).

PART 2 PRODUCTS

2.01 MATERIALS

- A. Primers, Sleeves, Forms, Insulation, Packing, Stuffing, and Accessories: Provide type of materials as required for tested firestopping assembly.

2.02 FIRESTOPPING SYSTEMS

- A. Firestopping: Any material meeting requirements.

1. Fire Ratings: Use system that is listed by FM (AG), ITS (DIR), or UL (FRD) and tested in accordance with ASTM E814, ASTM E119, or UL 1479 with F Rating equal to fire rating of penetrated assembly and minimum T Rating Equal to F Rating and in compliance with other specified requirements.

2.03 MATERIALS

- A. Firestopping Sealants: Provide only products having lower volatile organic compound (VOC) content than required by South Coast Air Quality Management District Rule No.1168.
- B. Elastomeric Silicone Firestopping: Single component silicone elastomeric compound and compatible silicone sealant; conforming to the following:
 1. Color: Black, dark gray, or red.
 2. Manufacturers:
 - a. A/D Fire Protection Systems Inc: www.adfire.com.
 - b. 3M Fire Protection Products: www.3m.com/firestop.
 - c. Hilti, Inc: www.us.hilti.com.
 - d. Specified Technologies, Inc: www.stifirestop.com.
 - e. Substitutions: See Section 01 60 00 - Product Requirements.
- C. Foam Firestopping: Single component silicone foam compound; conforming to the following:
 1. Durability and Longevity: Permanent.
 2. Color: Dark grey.
 3. Manufacturers:
 - a. 3M Fire Protection Products: www.3m.com/firestop.
 - b. Hilti, Inc: www.us.hilti.com.
 - c. Specified Technologies, Inc: www.stifirestop.com.
 - d. Substitutions: See Section 01 60 00 - Product Requirements.
- D. Fibered Compound Firestopping: Formulated compound mixed with incombustible non-asbestos fibers; conforming to the following:
 1. Durability and Longevity: Permanent.
 2. Color: Dark grey.
 3. Manufacturers:
 - a. A/D Fire Protection Systems Inc: www.adfire.com.
 - b. USG: www.usg.com.
 - c. Substitutions: See Section 01 60 00 - Product Requirements.
- E. Fiber Firestopping: Mineral fiber insulation used in conjunction with elastomeric surface sealer forming airtight bond to opening; conforming to the following:
 1. Durability and Longevity: Permanent.
 2. Manufacturers:
 - a. A/D Fire Protection Systems Inc: www.adfire.com.
 - b. Pecora Corporation: www.pecora.com.
 - c. Thermafiber, Inc: www.thermafiber.com.
 - d. Substitutions: See Section 01 60 00 - Product Requirements.
- F. Firestop Devices - Wrap Type: Mechanical device with incombustible filler and sheet stainless steel jacket, intended to be installed after penetrating item has been installed; conforming to the following:
 1. Manufacturers:
 - a. Grace Construction Products: www.na.graceconstruction.com.
 - b. 3M Fire Protection Products: www.3m.com/firestop.
 - c. Hilti, Inc: www.us.hilti.com.
 - d. Specified Technologies, Inc: www.stifirestop.com.
 - e. Substitutions: See Section 01 60 00 - Product Requirements.
- G. Intumescent Putty: Compound that expands on exposure to surface heat gain; conforming to the following:

1. Potential Expansion: Minimum 1000 percent.
2. Durability and Longevity: Permanent.
3. Color: Black, dark gray, or red.
4. Manufacturers:
 - a. Grace Construction Products: www.na.graceconstruction.com.
 - b. 3M Fire Protection Products: www.3m.com/firestop.
 - c. Hilti, Inc: www.us.hilti.com.
 - d. Specified Technologies, Inc: www.stifirestop.com.
 - e. Substitutions: See Section 01 60 00 - Product Requirements.
- H. Primers, Sleeves, Forms, Insulation, Packing, Stuffing, and Accessories: Type required for tested assembly design.

PART 3 EXECUTION

3.01 PREPARATION

- A. Clean substrate surfaces of dirt, dust, grease, oil, loose material, or other materials that could adversely affect bond of firestopping material.
- B. Remove incompatible materials that could adversely affect bond.
- C. Install backing materials to prevent liquid material from leakage.

3.02 INSTALLATION

- A. Install materials in manner described in fire test report and in accordance with manufacturer's instructions, completely closing openings.
- B. Do not cover installed firestopping until inspected by authorities having jurisdiction.

3.03 CLEANING

- A. Clean adjacent surfaces of firestopping materials.

3.04 PROTECTION

- A. Protect adjacent surfaces from damage by material installation.

END OF SECTION

NOT FOR BIDDING PURPOSES

THIS PAGE INTENTIONALLY LEFT BLANK

**SECTION 07 92 00
JOINT SEALANTS**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Nonsag gunnable joint sealants.
- B. Self-leveling pourable joint sealants.
- C. Joint backings and accessories.

1.02 RELATED REQUIREMENTS

- A. Section 01 61 16 - Volatile Organic Compound (VOC) Content Restrictions: Additional requirements for sealants and primers.
- B. Section 07 91 00 - Preformed Joint Seals: Precompressed foam, gaskets, and strip seals.
- C. Section 09 21 16 - Gypsum Board Assemblies: Sealing acoustical and sound-rated walls and ceilings.

1.03 REFERENCE STANDARDS

- A. ASTM C661 - Standard Test Method for Indentation Hardness of Elastomeric-Type Sealants by Means of a Durometer; 2015 (Reapproved 2022).
- B. ASTM C794 - Standard Test Method for Adhesion-in-Peel of Elastomeric Joint Sealants; 2018 (Reapproved 2022).
- C. ASTM C834 - Standard Specification for Latex Sealants; 2017 (Reapproved 2023).
- D. ASTM C920 - Standard Specification for Elastomeric Joint Sealants; 2018 (Reapproved 2024).
- E. ASTM C1087 - Standard Test Method for Determining Compatibility of Liquid-Applied Sealants with Accessories Used in Structural Glazing Systems; 2023.
- F. ASTM C1193 - Standard Guide for Use of Joint Sealants; 2025.
- G. ASTM C1521 - Standard Practice for Evaluating Adhesion of Installed Weatherproofing Sealant Joints; 2019 (Reapproved 2020).
- H. SWRI (VAL) - SWRI Institute Validated Products Directory; Current Edition.

1.04 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements for submittal procedures.
- B. Product Data: Submit manufacturer's technical datasheets for each product to be used; include the following:
 - 1. Physical characteristics, including movement capability, VOC content, hardness, cure time, and color availability.
 - 2. List of backing materials approved for use with the specific product.
 - 3. Backing material recommended by sealant manufacturer.
 - 4. Substrates that product is known to satisfactorily adhere to and with which it is compatible.
 - 5. Substrates the product should not be used on.
 - 6. Substrates for which laboratory adhesion and/or compatibility testing is required.
 - 7. Installation instructions, including precautions, limitations, and recommended backing materials and tools.
 - 8. Sample product warranty.
 - 9. Certification by manufacturer indicating that product complies with specification requirements.
 - 10. SWRI Validation: Provide currently available sealant product validations as listed by SWRI (VAL) for specified sealants.

- C. Product Data for Accessory Products: Submit manufacturer's technical data sheet for each product to be used, including physical characteristics, installation instructions, and recommended tools.
- D. Color Cards for Selection: Where sealant color is not specified, submit manufacturer's color cards showing standard colors available for selection.
- E. Samples for Verification: Where custom sealant color is specified, obtain directions from Architect and submit at least two physical samples for verification of color of each required sealant.
- F. Preconstruction Laboratory Test Reports: Submit at least four weeks prior to start of installation.
- G. Installation Plan: Submit at least four weeks prior to start of installation.
- H. Preinstallation Field Adhesion Test Plan: Submit at least two weeks prior to start of installation.
- I. Field Quality Control Plan: Submit at least two weeks prior to start of installation.
- J. Preinstallation Field Adhesion Test Reports: Submit filled out Preinstallation Field Adhesion Test Reports log within 10 days after completion of tests; include bagged test samples and photographic records.
- K. Installation Log: Submit filled-out log for each length or instance of sealant installed.
- L. Field Quality Control Log: Submit filled-out log for each length or instance of sealant installed, within 10 days after completion of inspections/tests; include bagged test samples and photographic records, if any.
- M. Manufacturer's qualification statement.
- N. Installer's qualification statement.
- O. Executed warranty.

1.05 QUALITY ASSURANCE

- A. Maintain one copy of each referenced document covering installation requirements on site.
- B. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum three years documented experience.
- C. Installer Qualifications: Company specializing in performing the work of this section and with at least three years of documented experience.
- D. Testing Agency Qualifications: Independent firm specializing in performing testing and inspections of the type specified in this section.
- E. Preconstruction Laboratory Testing: Arrange for sealant manufacturer(s) to test each combination of sealant, substrate, backing, and accessories.
 - 1. Adhesion Testing: In accordance with ASTM C794.
 - 2. Compatibility Testing: In accordance with ASTM C1087.
 - 3. Allow sufficient time for testing to avoid delaying the work.
 - 4. Deliver sufficient samples to manufacturer for testing.
 - 5. Report manufacturer's recommended corrective measures, if any, including primers or techniques not indicated in product data submittals.
 - 6. Testing is not required if sealant manufacturer provides data showing previous testing, not older than 24 months, that shows satisfactory adhesion, lack of staining, and compatibility.
- F. Installation Plan: Include schedule of sealed joints, including the following:
 - 1. Joint width indicated in Contract Documents.
 - 2. Joint depth indicated in Contract Documents; to face of backing material at centerline of joint.

3. Method to be used to protect adjacent surfaces from sealant droppings and smears, with acknowledgment that some surfaces cannot be cleaned to like-new condition and therefore prevention is imperative.
4. Installation Log Form: Include the following data fields, with known information filled out.
 - a. Unique identification of each length or instance of sealant installed.
 - b. Location on project.
 - c. Substrates.
 - d. Sealant used.
 - e. Stated movement capability of sealant.
 - f. Primer to be used, or indicate no primer is used.
 - g. Size and actual backing material used.
 - h. Date of installation.
 - i. Name of installer.
 - j. Actual joint width; provide space to indicate maximum and minimum width.
 - k. Actual joint depth to face of backing material at centerline of joint.
 - l. Air temperature.
- G. Preinstallation Field Adhesion Test Plan: Include destructive field adhesion testing of one sample of each combination of sealant type and substrate, except interior acrylic latex sealants, and include the following for each tested sample.
 1. Identification of testing agency.
 2. Name(s) of sealant manufacturer's field representatives who will be observing.
 3. Preinstallation Field Adhesion Test Log Form: Include the following data fields, with known information filled out.
 - a. Substrate; if more than one type of substrate is involved in a single joint, provide two entries on form, for testing each sealant substrate side separately.
 - b. Test date.
 - c. Location on project.
 - d. Sealant used.
 - e. Stated movement capability of sealant.
 - f. Test method used.
 - g. Date of installation of field sample to be tested.
 - h. Date of test.
 - i. Copy of test method documents.
 - j. Age of sealant upon date of testing.
 - k. Test results, modeled after the sample form in the test method document.
Indicate use of photographic record of test.
- H. Field Quality Control Plan:
 1. Visual inspection of entire length of sealant joints.
 2. Nondestructive field adhesion testing of sealant joints, except interior acrylic latex sealants.
 - a. For each different sealant and substrate combination, allow for one test every 12 inches (305 mm) in the first 10 linear feet (3 linear m) of joint and one test every 24 inches (610 mm) thereafter.
 - b. If any failures occur in the first 10 linear feet (3 linear m), continue testing at 12 inches (305 mm) intervals at no extra cost to Owner.
 3. Field testing agency's qualifications.
 4. Field Quality Control Log Form: Show same data fields as on Preinstallation Field Adhesion Test Log, with known information filled out and lines for multiple tests per sealant/substrate combinations; include visual inspection and specified field testing; allow for possibility that more tests than minimum specified may be necessary.

- I. Field Adhesion Test Procedures:
 - 1. Allow sealants to fully cure as recommended by manufacturer before testing.
 - 2. Have a copy of the test method document available during tests.
 - 3. Record the type of failure that occurred, other information required by test method, and the information required on the Field Quality Control Log.
 - 4. When performing destructive tests, also inspect the opened joint for proper installation characteristics recommended by manufacturer, and report any deficiencies.
 - 5. Deliver the samples removed during destructive tests in separate sealed plastic bags, identified with project, location, test date, and test results, to Owner.
 - 6. If any combination of sealant type and substrate does not show evidence of minimum adhesion or shows cohesion failure before minimum adhesion, report results to Architect.
- J. Nondestructive Field Adhesion Test: Test for adhesion in accordance with ASTM C1521, using Nondestructive Spot Method.
- K. Destructive Field Adhesion Test: Test for adhesion in accordance with ASTM C1521, using Destructive Tail Procedure.
 - 1. Sample: At least 18 inches (457 mm) long.
 - 2. Minimum Elongation Without Adhesive Failure: Consider the tail at rest, not under any elongation stress; multiply the stated movement capability of the sealant in percent by two; then multiply 1 inch (25.4 mm) by that percentage; if adhesion failure occurs before the 1-inch mark is that distance from the substrate, the test has failed.
 - 3. If either adhesive or cohesive failure occurs before minimum elongation, take necessary measures to correct conditions and retest; record each modification to products or installation procedures.
- L. Field Adhesion Tests of Joints: Test for adhesion using most appropriate method in accordance with ASTM C1521, or another applicable method as recommended by manufacturer.

1.06 WARRANTY

- A. See Section 01 78 00 - Closeout Submittals for additional warranty requirements.
- B. Manufacturer Warranty: Provide 2-year manufacturer warranty for installed sealants and accessories that fail to achieve a watertight seal, exhibit loss of adhesion or cohesion, or do not cure. Complete forms in Owner's name and register with manufacturer.
- C. Extended Correction Period: Correct defective work within 2-year period commencing on Date of Substantial Completion.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Nonsag Sealants:
 - 1. Dow: www.dow.com/#sle.
 - 2. Henry Company: www.henry.com/#sle.
 - 3. Momentive Performance Materials, Inc (formerly GE Silicones): www.momentive.com/#sle.
 - 4. Pecora Corporation: www.pecora.com/#sle.
 - 5. Sherwin-Williams Company: www.sherwin-williams.com/#sle.
 - 6. Sika Corporation: usa.sika.com/#sle.
 - 7. Specified Technologies Inc: www.stifirestop.com/#sle.
 - 8. Tremco Commercial Sealants & Waterproofing: www.tremcosealants.com/#sle.
 - 9. W. R. Meadows, Inc: www.wrmeadows.com/#sle.
 - 10. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Self-Leveling Sealants:
 - 1. Dow: www.dow.com/#sle.

2. Pecora Corporation: www.pecora.com/#sle.
3. Sherwin-Williams Company: www.sherwin-williams.com/#sle.
4. Sika Corporation: usa.sika.com/#sle.
5. Tremco Commercial Sealants & Waterproofing: www.tremcosealants.com/#sle.
6. W. R. Meadows, Inc: www.wrmeadows.com/#sle.
7. Substitutions: See Section 01 60 00 - Product Requirements.

2.02 JOINT SEALANT APPLICATIONS

A. Scope:

1. Exterior Joints:
 - a. Seal the following joints:
 - 1) Wall expansion and control joints.
 - 2) Joints between doors, windows, and other frames or adjacent construction.
 - 3) Joints between different exposed materials.
2. Interior Joints:
 - a. Seal the following joints:
 - 1) Joints between door frames and window frames and adjacent construction.
 - 2) In sound-rated wall and ceiling assemblies gaps at electrical outlets, wiring devices, and piping penetrations.
 - 3) In sound-rated wall and ceiling assemblies, seal joints between wall assemblies and ceiling assemblies; between wall assemblies and other construction; between ceiling assemblies and other construction.
 - 4) Joints between different exposed materials.
3. Do Not Seal:
 - a. Intentional weep holes in masonry.
 - b. Joints indicated to be covered with expansion joint cover assemblies.
 - c. Joints where sealant is specified to be furnished and installed by manufacturer of product to be sealed.
 - d. Joints where sealant installation is specified in other sections.

B. Exterior Joints: Use nonsag silyl-terminated polyether/polyurethane sealant, unless otherwise indicated.

1. Lap Joints in Sheet Metal Fabrications: Butyl rubber, noncuring.

C. Interior Joints: Use nonsag polyurethane sealant, unless otherwise indicated.

1. Wall and Ceiling Joints in Nonwet Areas: Acrylic emulsion latex sealant.
2. Wall and Ceiling Joints in Wet Areas: Nonsag polyurethane sealant for continuous liquid immersion.
3. Floor Joints in Wet Areas: Nonsag polyurethane non-traffic-grade sealant suitable for continuous liquid immersion.
4. In Sound-Rated Assemblies: Acrylic emulsion latex sealant.

D. Interior Wet Areas: Bathrooms, restrooms, kitchens, and food service areas; fixtures in wet areas include plumbing fixtures, food service equipment, countertops, cabinets, and other similar items.

E. Sound-Rated Assemblies: Walls and ceilings identified as STC-rated, sound-rated, or acoustical.

F. Preformed Joint Seals: See Section 07 91 00 for information.

2.03 JOINT SEALANTS - GENERAL

- A. Sealants and Primers: Provide products with acceptable levels of volatile organic compound (VOC) content; see Section 01 61 16.
- B. Colors: As indicated on drawings.

2.04 NONSAG JOINT SEALANTS

- A. Hybrid Elastomeric Sealant: ASTM C920, Grade NS, Uses M and A; single component; not expected to withstand continuous water immersion or traffic.
 - 1. Movement Capability: Plus and minus 50 percent, minimum.
- B. Polyurethane Sealant: ASTM C920, Grade NS, Uses M and A; single or multi-component; not expected to withstand continuous water immersion or traffic.
 - 1. Movement Capability: Plus and minus 50 percent, minimum.
- C. Polyurethane Sealant for Continuous Water Immersion: ASTM C920, Grade NS, Uses M and A; single or multicomponent; explicitly approved by manufacturer for continuous water immersion; suitable for traffic exposure when recessed below traffic surface.
 - 1. Movement Capability: Plus and minus 35 percent, minimum.
- D. Acrylic Emulsion Latex: Water-based; ASTM C834, single component, nonstaining, nonbleeding, nonsagging; not intended for exterior use.
- E. Noncuring Butyl Sealant: Solvent-based, single component, nonsag, nonskinning, nonhardening, nonbleeding; nonvapor permeable; intended for fully concealed applications.

2.05 SELF-LEVELING JOINT SEALANTS

- A. Self-Leveling Polyurethane Sealant: ASTM C920, Grade P, Uses M and A; single or multicomponent; explicitly approved by manufacturer for traffic exposure; not expected to withstand continuous water immersion.
 - 1. Movement Capability: Plus and minus 25 percent, minimum.
 - 2. Hardness Range: 35 to 55, Shore A, when tested in accordance with ASTM C661.
 - 3. Color: To be selected by Architect from manufacturer's standard range.
 - 4. Service Temperature Range: Minus 40 to 180 degrees F (Minus 40 to 82 degrees C).

2.06 ACCESSORIES

- A. Sealant Backing Materials, General: Materials placed in joint before applying sealants; assists sealant performance and service life by developing optimum sealant profile and preventing three-sided adhesion; type and size recommended by sealant manufacturer for compatibility with sealant, substrate, and application.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that joints are ready to receive work.
- B. Verify that backing materials are compatible with sealants.
- C. Preinstallation Adhesion Testing: Install a sample for each test location indicated in the test plan.
 - 1. Test each sample as specified in PART 1 under QUALITY ASSURANCE article.
 - 2. Notify Architect of date and time that tests will be performed, at least seven days in advance.
 - 3. Arrange for sealant manufacturer's technical representative to be present during tests.
 - 4. Record each test on Preinstallation Adhesion Test Log as indicated.
 - 5. If any sample fails, review products and installation procedures, consult manufacturer, or take other measures that are necessary to ensure adhesion; retest in a different location; if unable to obtain satisfactory adhesion, report to Architect.
 - 6. After completion of tests, remove remaining sample material and prepare joints for new sealant installation.

3.02 PREPARATION

- A. Remove loose materials and foreign matter that could impair adhesion of sealant.
- B. Clean joints, and prime as necessary, in accordance with manufacturer's instructions.

- C. Perform preparation in accordance with manufacturer's instructions and ASTM C1193.
- D. Mask elements and surfaces adjacent to joints from damage and disfigurement due to sealant work; be aware that sealant drips and smears may not be completely removable.

3.03 INSTALLATION

- A. Install this work in accordance with sealant manufacturer's requirements for preparation of surfaces and material installation instructions.
- B. Provide joint sealant installations complying with ASTM C1193.
- C. Install bond breaker backing tape where backer rod cannot be used.
- D. Install sealant free of air pockets, foreign embedded matter, ridges, and sags, and without getting sealant on adjacent surfaces.
- E. Do not install sealant when ambient temperature is outside manufacturer's recommended temperature range, or will be outside that range during the entire curing period, unless manufacturer's approval is obtained and instructions are followed.
- F. Nonsag Sealants: Tool surface concave, unless otherwise indicated; remove masking tape immediately after tooling sealant surface.

3.04 FIELD QUALITY CONTROL

- A. See Section 01 40 00 - Quality Requirements for additional requirements.
- B. Perform field quality control inspection/testing as specified in PART 1 under QUALITY ASSURANCE article.
- C. Non-Destructive Adhesion Testing: If there are any failures in first 100 linear feet (30 linear m), notify Architect immediately.
- D. Remove and replace failed portions of sealants using same materials and procedures as indicated for original installation.

END OF SECTION 07 92 00

NOT FOR BIDDING PURPOSES

This page intentionally left blank

SECTION 08 06 71
DOOR HARDWARE SCHEDULE

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Preliminary schedule of door hardware sets for swinging, sliding, folding, _____, and other door types as indicated on drawings.

1.02 RELATED REQUIREMENTS

- A. Section 08 71 00 - Door Hardware: Requirements to comply with in coordination with this section.

1.03 REFERENCE STANDARDS

- A. BHMA (CPD) - Certified Products Directory; Current Edition.
- B. BHMA A156.3 - Exit Devices; 2025.
- C. BHMA A156.5 - Cylinders and Input Devices for Locks; 2020.
- D. BHMA A156.13 - Mortise Locks & Latches Series 1000; 2022.
- E. BHMA A156.18 - Standard for Materials and Finishes; 2020.
- F. DHI (H&S) - Sequence and Format for the Hardware Schedule; 2019.

1.04 PROJECT INFORMATION

- A. Project Name: HVAC Unit Replacement
 - 1. Location: 1411 North Dupont Highway, Dover, Delaware
- B. Architect: Becker Morgan Group, Inc.
 - 1. Location: 309 S. Governors Avenue, Dover, DE.

1.05 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Comply with submittal requirements as indicated in Section 08 71 00.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Only manufacturers listed in Door Hardware Schedule or Section 08 71 00 are considered acceptable, unless noted otherwise.
- B. Obtain each type of door hardware as indicated from a single manufacturer and single supplier.
- C. Products are listed and certified compliant with specified standards by BHMA (CPD).
- D. Manufacturer's Abbreviations: Coordinate with manufacturers listed in Section 08 71 00.

2.02 DESCRIPTION

- A. Door hardware sets provided represent the design intent, they are only a guideline and should not be considered a detailed or complete hardware schedule.
 - 1. Provide door hardware item(s) as required for similar purposes, even when item is not listed for a door in Door Hardware Schedule.
 - 2. Necessary items that are not included in a Hardware Set should be added and have the appropriate additional hardware as required for proper application and functionality.
 - 3. Door hardware supplier is responsible for providing proper size and hand of door for products required in accordance with Door Hardware Schedule and as indicated on drawings.
 - 4. Quantities listed are for each Pair (PR) of doors, or for each Single (SGL) door, as indicated in hardware sets.

2.03 LOCK FUNCTION CODES

- A. Function Codes for Cylindrical Locks: Complying with BHMA A156.5.
- B. Function Codes for Mortise Locks: Complying with BHMA A156.13.
- C. Function Codes for Exit Devices: Complying with BHMA A156.3.

2.04 FINISHES

- A. Finishes: Complying with BHMA A156.18.
 - 1. Code 604: Zinc plated and dichromate sealed, with steel base material.
 - 2. Code 626: Satin chromium plated over nickel, with brass or bronze base material (former US equivalent US26D).
 - 3. Code 630: Satin stainless steel, with stainless steel 300 series base material (former US equivalent US32D).
 - 4. Code 652: Satin chromium plated over nickel, with steel base material (former US equivalent US26D).
 - 5. Code 689: Aluminum painted, with any base material (former US equivalent US28).

PART 3 EXECUTION

3.01 DOOR HARDWARE SCHEDULE

- A. Organize listing of door hardware components within each hardware set in compliance with 10-Part scheduling sequence indicated in DHI (H&S), unless otherwise indicated.

3.02 HARDWARE SET # __: "____"

- A. For use on Door Number(s): ____.
- B. Provide for each Single (SGL) door(s)

UNITS	LOCK	ITEM	DESCRIPTION	FINISH	MFR

END OF SECTION 08 06 71

SECTION 08 11 13
HOLLOW METAL DOORS AND FRAMES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Thermally insulated hollow metal doors with frames.

1.02 RELATED REQUIREMENTS

- A. Section 08 71 00 - Door Hardware.
- B. Section 09 91 13 - Exterior Painting: Field painting.
- C. Section 09 91 23 - Interior Painting: Field painting.

1.03 ABBREVIATIONS AND ACRONYMS

- A. ANSI: American National Standards Institute.
- B. ASCE: American Society of Civil Engineers.
- C. HMMA: Hollow Metal Manufacturers Association.
- D. NAAMM: National Association of Architectural Metal Manufacturers.
- E. NFPA: National Fire Protection Association.
- F. SCIF: Sensitive Compartmented Information Facility.
- G. SDI: Steel Door Institute.
- H. UL: Underwriters Laboratories.

1.04 REFERENCE STANDARDS

- A. ADA Standards - 2010 ADA Standards for Accessible Design; 2010.
- B. ANSI/SDI A250.4 - Test Procedure and Acceptance Criteria for Physical Endurance for Steel Doors, Frames and Frame Anchors; 2024.
- C. ANSI/SDI A250.6 - Recommended Practice for Hardware Reinforcing on Standard Steel Doors and Frames; 2024.
- D. ANSI/SDI A250.8 - Specifications for Standard Steel Doors and Frames (SDI-100); 2023.
- E. ANSI/SDI A250.10 - Test Procedure and Acceptance Criteria for Prime Painted Steel Surfaces for Steel Doors and Frames; 2025.
- F. ASTM A653/A653M - Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process; 2025a.
- G. ASTM A1008/A1008M - Standard Specification for Steel, Sheet, Cold-Rolled, Carbon, Structural, High-Strength Low-Alloy, High-Strength Low-Alloy with Improved Formability, Required Hardness, Solution Hardened, and Bake Hardenable; 2024.
- H. ASTM A1011/A1011M - Standard Specification for Steel, Sheet and Strip, Hot-Rolled, Carbon, Structural, High-Strength Low-Alloy, High-Strength Low-Alloy with Improved Formability, and Ultra-High Strength; 2023.
- I. ASTM C143/C143M - Standard Test Method for Slump of Hydraulic-Cement Concrete; 2020.
- J. ASTM C476 - Standard Specification for Grout for Masonry; 2023.
- K. ASTM E84 - Standard Test Method for Surface Burning Characteristics of Building Materials; 2026a.
- L. BHMA A156.115 - Hardware Preparation in Steel Doors and Frames; 2016.
- M. ICC A117.1 - Accessible and Usable Buildings and Facilities; 2017.

- N. NAAMM HMMA 830 - Hardware Selection for Hollow Metal Doors and Frames; 2002.
- O. NAAMM HMMA 831 - Hardware Locations for Hollow Metal Doors and Frames; 2024.
- P. NAAMM HMMA 840 - Guide Specifications for Receipt, Storage and Installation of Hollow Metal Doors and Frames; 2024.
- Q. NAAMM HMMA 861 - Guide Specifications for Commercial Hollow Metal Doors and Frames; 2014.
- R. SDI 117 - Manufacturing Tolerances for Standard Steel Doors and Frames; 2023.

1.05 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements for submittal procedures.
- B. Product Data: Materials and details of design and construction, hardware locations, reinforcement type and locations, anchorage and fastening methods, and finishes; and one copy of referenced standards/guidelines.
- C. Design Submittals: Manufacturer to submit anchor design analysis calculations for blast-resistant doors signed and sealed by specialty design engineer experienced in this type of work and licensed in the State in which the Project is located.
- D. Installation Instructions: Manufacturer's published instructions, including any special installation instructions relating to this project.
- E. Manufacturer's Certificate: Certification that products meet or exceed specified requirements.
- F. Manufacturer's Qualification Statement.
- G. Installer's Qualification Statement.

1.06 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Provide hollow metal doors and frames from SDI Certified manufacturer: <https://steeldoors.org/sdi-certified/#sle>.
- B. Installer Qualifications: Company specializing in performing work of the type specified and with at least three years of documented experience.
- C. Maintain at project site copies of reference standards relating to installation of products specified.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. Comply with NAAMM HMMA 840 or ANSI/SDI A250.8 (SDI-100) in accordance with specified requirements.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Hollow Metal Doors and Frames:
 - 1. Ceco Door, an Assa Abloy Group company: www.assaabloydss.com/#sle.
 - 2. Curries, an Assa Abloy Group company: www.assaabloydss.com/#sle.
 - 3. Mesker, dormakaba Group: www.meskeropeningsgroup.com/#sle.
 - 4. Republic Doors, an Allegion brand: www.republicdoor.com/#sle.
 - 5. Steelcraft, an Allegion brand: www.allegion.com/#sle.
 - 6. Titan Metal Products, Inc; Builders Series 20 - 90 Minute Doors: www.titanmetalproducts.com/#sle.
 - 7. Substitutions: See Section 01 60 00 - Product Requirements.

2.02 PERFORMANCE REQUIREMENTS

- A. Requirements for Hollow Metal Doors and Frames:
 - 1. Steel Sheet: Comply with one or more of the following requirements; galvanized steel complying with ASTM A653/A653M, cold-rolled steel complying with ASTM

- A1008/A1008M, or hot-rolled pickled and oiled (HRPO) steel complying with ASTM A1011/A1011M, commercial steel (CS) Type B, for each.
2. Accessibility: Comply with ICC A117.1 and ADA Standards.
 3. Exterior Door Top Closures: Flush end closure channel, with top and door faces aligned.
 4. Door Edge Profile: Manufacturers standard for application indicated.
 5. Typical Door Face Sheets: Flush.
 6. Glazed Lights: Non-removable stops on non-secure side; sizes and configurations as indicated on drawings. Style: Manufacturer's standard.
 7. Hardware Preparations, Selections and Locations: Comply with NAAMM HMMA 830 and NAAMM HMMA 831 or BHMA A156.115 and ANSI/SDI A250.8 (SDI-100) in accordance with specified requirements.
 8. Zinc Coating for Typical Interior and/or Exterior Locations: Provide metal components zinc-coated (galvanized) and/or zinc-iron alloy-coated (galvannealed) by the hot-dip process in accordance with ASTM A653/A653M, with manufacturer's standard coating thickness, unless noted otherwise for specific hollow metal doors and frames.
 - a. Based on SDI Standards: Provide at least A40/ZF120 (galvannealed) when necessary, coating not required for typical interior door applications, and at least A60/ZF180 (galvannealed) for corrosive locations.
- B. Combined Requirements: If a particular door and frame unit is indicated to comply with more than one type of requirement, comply with the specified requirements for each type; for instance, an exterior door that is also indicated as being sound-rated must comply with the requirements specified for exterior doors and for sound-rated doors; where two requirements conflict, comply with the most stringent.

2.03 HOLLOW METAL DOORS

- A. Exterior Doors: Thermally insulated.
1. Based on SDI Standards: ANSI/SDI A250.8 (SDI-100).
 - a. Level 3 - Extra Heavy duty.
 - b. Physical Performance Level A, 1,000,000 cycles; in accordance with ANSI/SDI A250.4.
 - c. Model 1 - Full Flush.
 - d. Door Face Metal Thickness: 16 gauge, 0.053 inch (1.3 mm), minimum.
 - e. Zinc Coating: A60/ZF180 galvannealed coating; ASTM A653/A653M.
 2. Door Core Material: Polyisocyanurate, 2 lbs/cu ft minimum density.
 3. Foam Plastic Insulation: Manufacturer's standard board insulation with maximum flame spread index (FSI) of 75, and maximum smoke developed index (SDI) of 450 in accordance with ASTM E84, and completely enclosed within interior of door.
 4. Door Thermal Resistance: R-Value of 9.9, minimum, for installed thickness of polyisocyanurate.
 5. Door Thickness: 1-3/4 inches (44.5 mm), nominal.
 6. Weatherstripping: Refer to Section 08 71 00.
 7. Door Finish: Factory primed and field finished.

2.04 HOLLOW METAL FRAMES

- A. Comply with standards and/or custom guidelines as indicated for corresponding door in accordance with applicable door frame requirements.
- B. Exterior Door Frames: Full profile/continuously welded type.
1. Galvanizing: Components hot-dipped zinc-iron alloy-coated (galvannealed) in accordance with ASTM A653/A653M, with A40/ZF120 coating.
 2. Frame Metal Thickness: 16 gauge, 0.053 inch (1.3 mm), minimum.
 3. Frame Finish: Factory primed and field finished.
 4. Weatherstripping: Separate, see Section 08 71 00.

- C. Provide mortar guard boxes for hardware cut-outs in frames to be installed in masonry or to be grouted.
- D. Frames in Masonry Walls: Size to suit masonry coursing with head member 4 inches (102 mm) high to fill opening without cutting masonry units.

2.05 FINISHES

- A. Primer: Rust-inhibiting, complying with ANSI/SDI A250.10, door manufacturer's standard.
- B. Bituminous Coating: Cold-applied asphalt mastic, compounded for 15 mil, 0.015 inch (0.4 mm) dry film thickness (DFT) per coat; provide inert-type noncorrosive compound free of asbestos fibers, sulfur components, and other deleterious impurities.

2.06 ACCESSORIES

- A. Mechanical Fasteners for Concealed Metal-to-Metal Connections: Self-drilling, self-tapping, steel with electroplated zinc finish.
- B. Grout for Frames: Mortar grout complying with ASTM C476 with maximum slump of 4 inches (102 mm) as measured in accordance with ASTM C143/C143M for hand troweling in place; plaster grout and thinner pumpable grout are prohibited.
- C. Silencers: Resilient rubber, fitted into drilled hole; provide three on strike side of single door, three on center mullion of pairs, and two on head of pairs without center mullions.
- D. Temporary Frame Spreaders: Provide for factory or shop-assembled frames.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify existing conditions before starting work.
- B. Verify that opening sizes and tolerances are acceptable.
- C. Verify that finished walls are in plane to ensure proper door alignment.

3.02 PREPARATION

- A. Coat inside of frames to be installed in masonry or to be grouted, with bituminous coating, prior to installation.

3.03 INSTALLATION

- A. Install doors and frames in accordance with manufacturer's instructions and related requirements of specified door and frame standards or custom guidelines indicated.
- B. Install prefinished frames after painting and wall finishes are complete.
- C. Coordinate frame anchor placement with wall construction.
- D. Grout frames in masonry construction, using hand trowel methods; brace frames so that pressure of grout before setting will not deform frames.
- E. Install door hardware as specified in Section 08 71 00.
 - 1. Comply with recommended practice for hardware placement of doors and frames in accordance with ANSI/SDI A250.6 or NAAMM HMMA 861.
- F. Comply with glazing installation requirements of Section 08 80 00.
- G. Coordinate installation of electrical connections to electrical hardware items.

3.04 TOLERANCES

- A. Clearances Between Door and Frame: Comply with related requirements of specified frame standards or custom guidelines indicated in accordance with SDI 117 or NAAMM HMMA 861.
- B. Maximum Diagonal Distortion: 1/16 inch (1.6 mm) measured with straight edge, corner to corner.

3.05 ADJUSTING

- A. Adjust for smooth and balanced door movement.
- B. Test sound control doors for force to close, latch, and unlatch; adjust as necessary in compliance with requirements.

3.06 SCHEDULE

- A. Refer to Door and Frame Schedule on the drawings.

END OF SECTION 08 11 13

NOT FOR BIDDING PURPOSES

NOT FOR BIDDING PURPOSES

This page intentionally left blank

**SECTION 08 71 00
DOOR HARDWARE**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Hardware for hollow metal doors.
- B. Electrically operated and controlled hardware.
- C. Thresholds.
- D. Weatherstripping and gasketing.

1.02 RELATED REQUIREMENTS

- A. Section 06 20 00 - Finish Carpentry: Wood door frames.
- B. Section 07 92 00 - Joint Sealants: Sealants for setting exterior door thresholds.
- C. Section 08 06 71 - Door Hardware Schedule: Schedule of door hardware sets.
- D. Section 08 11 13 - Hollow Metal Doors and Frames.
- E. Section 08 11 16 - Aluminum Doors and Frames.
- F. Section 08 14 16 - Flush Wood Doors.
- G. Section 08 32 00 - Sliding Glass Doors: Door hardware, except cylinders.
- H. Section 08 33 23 - Overhead Coiling Doors: Door hardware, except cylinders.
- I. Section 08 43 13 - Aluminum-Framed Storefronts: Door hardware, except as noted in section.
- J. Section 08 44 13 - Glazed Aluminum Curtain Walls: Door hardware, except cylinders.
- K. Section 10 26 00 - Wall and Door Protection: Door and frame protection.
- L. Section 28 10 00 - Access Control: Electronic access control devices.
- M. Section 28 46 00 - Fire Detection and Alarm: Electrical connection to activate door closers.

1.03 REFERENCE STANDARDS

- A. ADA Standards - 2010 ADA Standards for Accessible Design; 2010.
- B. BHMA (CFD).- Certified Products Directory; Current Edition.
- C. BHMA A156.1 - Standard for Butts and Hinges; 2021.
- D. BHMA A156.3 - Exit Devices; 2025.
- E. BHMA A156.4 - Door Closers and Pivots; 2024.
- F. BHMA A156.7 - Template Hinge Dimensions; 2022.
- G. BHMA A156.8 - Door Controls - Overhead Stops and Holders; 2021.
- H. BHMA A156.13 - Mortise Locks & Latches Series 1000; 2022.
- I. BHMA A156.16 - Standard for Auxiliary Hardware; 2023.
- J. BHMA A156.20 - Standard for Strap and Tee Hinges, and Hasps; 2021.
- K. BHMA A156.21 - Thresholds; 2025.
- L. BHMA A156.22 - Standard for Gasketing; 2021.
- M. BHMA A156.26 - Standard for Continuous Hinges; 2021.
- N. BHMA A156.36 - Auxiliary Locks; 2020.
- O. BHMA A156.115 - Hardware Preparation in Steel Doors and Frames; 2016.

- P. DHI (H&S) - Sequence and Format for the Hardware Schedule; 2019.
- Q. ICC A117.1 - Accessible and Usable Buildings and Facilities; 2017.
- R. NFPA 70 - National Electrical Code; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- S. NFPA 80 - Standard for Fire Doors and Other Opening Protectives; 2025.
- T. NFPA 101 - Life Safety Code; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- U. NFPA 105 - Standard for Smoke Door Assemblies and Other Opening Protectives; 2025.
- V. UL (DIR) - Online Certifications Directory; Current Edition.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordinate the manufacture, fabrication, and installation of products that door hardware is installed on.
- B. Sequence installation to ensure utility connections are achieved in an orderly and expeditious manner.
- C. Preinstallation Meeting: Convene a preinstallation meeting one week prior to commencing work of this section; attendance is required by affected installers and the following:
 - 1. Architect.
 - 2. Installer's Architectural Hardware Consultant (AHC).
 - 3. Hardware Installer.
 - 4. Owner's Security Consultant.
- D. Furnish templates for door and frame preparation to manufacturers and fabricators of products requiring internal reinforcement for door hardware.
- E. Keying Requirements Meeting:
 - 1. Schedule meeting at project site prior to Contractor occupancy.
 - 2. Attendance Required:
 - a. Contractor.
 - b. Owner.
 - c. Installer's Architectural Hardware Consultant (AHC).
 - d. Hardware Installer.
 - e. Owner's Security Consultant.
 - 3. Agenda:
 - a. Establish keying requirements.
 - b. Verify locksets and locking hardware are functionally correct for project requirements.
 - c. Verify that keying and programming complies with project requirements.
 - d. Establish keying submittal schedule and update requirements.
 - 4. Incorporate "Keying Requirements Meeting" decisions into keying submittal upon review of door hardware keying system including, but not limited to, the following:
 - a. Access control requirements.
 - b. Key control system requirements.
 - c. Schematic diagram of preliminary key system.
 - d. Flow of traffic and extent of security required.
 - 5. Record minutes and distribute copies within two days after meeting to participants, with two copies to Architect, Owner, participants, and those affected by decisions made.
 - 6. Deliver established keying requirements to manufacturers.

1.05 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements for submittal procedures.

- B. Product Data: Manufacturer's catalog literature for each type of hardware, marked to clearly show products to be furnished for this project, and includes construction details, material descriptions, finishes, and dimensions and profiles of individual components.
- C. Shop Drawings - Door Hardware Schedule: Submit detailed listing that includes each item of hardware to be installed on each door. Use door numbering scheme as included in Contract Documents.
1. Prepared by or under supervision of Architectural Hardware Consultant (AHC).
 2. Comply with DHI (H&S) using door numbers and hardware set numbers as indicated in construction documents.
 - a. Submit in vertical format; see Section 08 0671.
 3. List groups and suffixes in proper sequence.
 4. Provide complete description for each door listed.
 5. Provide manufacturer name, product names, and catalog numbers; include functions, types, styles, sizes and finishes of each item.
 6. Include account of abbreviations and symbols used in schedule.
- D. Shop Drawings - Electrified Door Hardware: Submit diagrams for power, signal, and control wiring for electrified door hardware that include details of interface with building safety and security systems. Provide elevations and diagrams for each electrified door opening as follows:
1. Prepared by or under supervision of Architectural Hardware Consultant (AHC) and Electrified Hardware Consultant (EHC)
 2. Elevations: Submit front and back elevations of each door opening showing electrified devices with connections installed and an operations narrative describing how opening operates from either side at any given time.
 3. Diagrams: Submit point-to-point wiring diagram that shows each device in door opening system with related colored wire connections to each device.
- E. Samples for Verification:
1. Submit minimum size of 2 by 4 inch (51 by 102 mm) for sheet samples, and minimum length of 4 inch (102 mm) for other products.
 2. Submit one (1) sample of hinge, latchset, lockset, closer, and _____ illustrating style, color, and finish.
 3. Return full-size samples to Contractor.
 4. Submit product description with samples.
- F. Manufacturer's Installation Instructions: Indicate special procedures and perimeter conditions requiring special attention.
- G. Maintenance Data: Include data on operating hardware, lubrication requirements, and inspection procedures related to preventative maintenance.
1. Submit manufacturer's parts lists and templates.
 2. Bitting List: List of combinations as furnished.
- H. Keying Schedule:
1. Submit three (3) copies of Keying Schedule in compliance with requirements established during Keying Requirements Meeting unless otherwise indicated.
- I. Manufacturer's qualification statement.
- J. Installer's qualification statement.
- K. Supplier's qualification statement.
- L. Specimen warranty.
- M. Project Record Documents: Record actual locations of concealed equipment, services, and conduit.

- N. Maintenance Materials and Tools: Furnish the following for Owner's use in maintenance of project.
1. See Section 01 60 00 - Product Requirements, for additional provisions.
 2. Lock Cylinders: Ten for each master keyed group.
 3. Tools: One set of each special wrench or tool applicable for each different or special hardware component, whether supplied by hardware component manufacturer or not.

1.06 QUALITY ASSURANCE

- A. Standards for Fire-Rated Doors: Maintain one copy of each referenced standard on site, for use by Architect and Contractor.
- B. Manufacturer Qualifications: Company specializing in manufacturing products specified in this section with minimum three years of documented experience.
- C. Installer Qualifications: Company specializing in performing work of the type specified for commercial door hardware with at least three years of documented experience.
- D. Supplier Qualifications: Company with certified Architectural Hardware Consultant (AHC) and Electrified Hardware Consultant (EHC) to assist in work of this section.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. Package hardware items individually; label and identify each package with door opening code to match door hardware schedule.

1.08 WARRANTY

- A. See Section 01 78 00 - Closeout Submittals for additional warranty requirements.
- B. Manufacturer's Warranty: Provide warranty against defects in material and workmanship for period indicated. Complete forms in Owner's name and register with manufacturer.
1. Closers: Five years, minimum.
 2. Exit Devices: Three years, minimum.
 3. Locksets and Cylinders: Three years, minimum.
 4. Other Hardware: Two years, minimum.

PART 2 PRODUCTS

2.01 DESIGN AND PERFORMANCE CRITERIA

- A. Provide specified door hardware as required to make doors fully functional, compliant with applicable codes, and secure to extent indicated.
- B. Provide individual items of single type, of same model, and by same manufacturer.
- C. Provide door hardware products that comply with the following requirements:
1. Applicable provisions of federal, state, and local codes.
 2. Accessibility: ADA Standards and ICC A117.1.
 3. Applicable provisions of NFPA 101.
 4. Listed and certified compliant with specified standards by BHMA (CPD).
 5. Auxiliary Hardware: BHMA A156.16.
 6. Straps and Tee Hinges: BHMA A156.20.
 7. Hardware Preparation for Steel Doors and Steel Frames: BHMA A156.115.
 8. Products Requiring Electrical Connection: Listed and classified by UL (DIR) as suitable for the purpose specified.
- D. Electrically Operated and/or Controlled Hardware: Provide necessary power supplies, power transfer hinges, relays, and interfaces as required for proper operation; provide wiring between hardware and control components and to building power connection in compliance with NFPA 70.
1. See Section 28 10 00 for additional access control system requirements.

- E. Lock Function: Provide lock and latch function numbers and descriptions of manufacturer's series. See Door Hardware Schedule.
- F. Fasteners:
 - 1. Provide fasteners of proper type, size, quantity, and finish that comply with commercially recognized standards for proposed applications.
 - a. Aluminum fasteners are not permitted.
 - b. Provide phillips flat-head screws with heads finished to match door surface hardware unless otherwise indicated.
 - 2. Provide machine screws for attachment to reinforced hollow metal and aluminum frames.
 - a. Self-drilling (Tek) type screws are not permitted.
 - 3. Provide stainless steel machine screws and lead expansion shields for concrete and masonry substrates.
 - 4. Provide wall grip inserts for hollow wall construction.
 - 5. Provide spacers or sex bolts with sleeves for through bolting of hollow metal doors and frames.
 - 6. Fire-Rated Applications: Comply with NFPA 80.
 - a. Provide wood or machine screws for hinges mortised to doors or frames, strike plates to frames, and closers to doors and frames.
 - b. Provide steel through bolts for attachment of surface mounted closers, hinges, or exit devices to door panels unless proper door blocking is provided.

2.02 HINGES

- A. Manufacturers:
 - 1. McKinney; an Assa Abloy Group company; ____: www.assaabloydss.com/#sle.
 - 2. D&D Technologies USA, Inc; SuleClose ConcealFit: www.ddtech.com/#sle.
 - 3. Hager Companies; ____: www.hagerco.com/#sle.
 - 4. Pamex, Inc; Hinges: www.pamexinc.com/#sle.
 - 5. BEST, dormakaba Group; ____: www.bestaccess.com/#sle.
 - 6. Studco Building Systems; EZConcept RocYork Concealed Hinges : www.studcosystems.com/#sle.
 - 7. Waterson Corp; Self-Closing Hinge, Model ____: www.watsonsonusa.com/#sle.
 - 8. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Hinges: Comply with BHMA A156.1, Grade 1.
 - 1. Butt Hinges: Comply with BHMA A156.1 and BHMA A156.7 for templated hinges.
 - a. Provide hinge width required to clear surrounding trim.
 - 2. Continuous Hinges: Comply with BHMA A156.26.
 - 3. Provide hinges on every swinging door.
 - 4. Provide five-knuckle full mortise butt hinges unless otherwise indicated.
 - 5. Provide ball-bearing hinges at each door with closer.
 - 6. Provide non-removable pins on exterior outswinging doors.
 - 7. Provide non-removable pins on interior outswinging doors at locations as indicated.
 - 8. Provide power transfer hinges where electrified hardware is mounted in door leaf.
 - 9. Provide following quantity of butt hinges for each door:
 - a. Doors up to 60 inches (1.5 m) High: Two hinges.
 - b. Doors From 60 inches (1.5 m) High up to 90 inches (2.3 m) High: Three hinges.
 - c. Doors 90 inches (2.3 m) High up to 120 inches (3 m) High: Four hinges.
 - d. Doors over 120 inches (3 m) High: One additional hinge per each additional 30 inches (762 mm) in height.

2.03 EXIT DEVICES

- A. Manufacturers:

1. Corbin Russwin, Sargent, or Yale; an Assa Abloy Group company; ____: www.assaabloydss.com/#sle.
 2. Detex Corporation; Advantex Series ____: www.detex.com/#sle.
 3. dormakaba; Architectural Hardware Series 8000: www.dormakaba.com/#sle.
 4. Hager Companies; ____: www.hagerco.com/#sle.
 5. Marks USA, a subsidiary of NAPCO Security Technologies, Inc: www.marksusa.com/#sle.
 6. Pamex, Inc; Exit Devices: www.pamexinc.com/#sle.
 7. BEST, dormakaba Group; Precision 100/200/300 Series: www.bestaccess.com/#sle.
 8. Von Duprin, an Allegion brand; ____: www.allegion.com/us/#sle.
 9. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Exit Devices: Comply with BHMA A156.3, Grade 1.
1. Lever design to match lockset trim.
 2. Provide cylinder with cylinder dogging or locking trim.
 3. Provide exit devices properly sized for door width and height.
 4. Provide strike as recommended by manufacturer for application indicated.
 5. Provide UL (DIR) listed exit device assemblies for fire-rated doors and panic device assemblies for non-fire-rated doors.
 6. For electrical options, provide quick connect plug-in pre-wired connectors.

2.04 LOCK CYLINDERS

- A. Manufacturers:
1. BEST, dormakaba Group; ____: www.bestaccess.com/#sle.
 2. Substitutions: Not permitted.
- B. Lock Cylinders: Provide key access on outside of each lock, unless otherwise indicated.
1. Provide cylinders from same manufacturer as locking device.
 2. Provide cams and/or tailpieces as required for locking devices.

2.05 MORTISE LOCKS

- A. Manufacturers:
1. Corbin Russwin, Sargent, or Yale; an Assa Abloy Group company; ____: www.assaabloydss.com/#sle.
 2. BEST, dormakaba Group; 45H Series: www.bestaccess.com/#sle.
 3. dormakaba; Architectural Hardware M1000 Series: www.dormakaba.com/#sle.
 4. Hager Companies; ____: www.hagerco.com/#sle.
 5. Marks USA, a subsidiary of NAPCO Security Technologies, Inc; Electrified: www.marksusa.com/#sle.
 6. Schlage, an Allegion brand; ____: www.allegion.com/us/#sle.
 7. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Mortise Locks: Comply with BHMA A156.13, Grade 1, Security, 1000 Series.
1. Latchbolt Throw: 3/4 inch (19 mm), minimum.
 2. Deadbolt Throw: 1 inch (25.4 mm), minimum.
 3. Backset: 2-3/4 inch (70 mm) unless otherwise indicated.
 4. Strikes: Provide manufacturer's standard strike for each latchset or lockset with strike box and curved lip extending to protect frame in compliance with indicated requirements.
 - a. Extra-Long-Lip Strikes: Provide for locks used on frames with applied wood casing trim.
 - b. Aluminum-Frame Strike Box: Provide strike box fabricated for use with aluminum framing by framing manufacturer.
 - c. Rabbet Front and Strike: Provide on locksets for use with rabbeted meeting rails.
 - d. Finish: To match lock or latch.

2.06 AUXILIARY LOCKS (DEADLOCKS)

- A. Manufacturers:
1. Yale; an Assa Abloy Group company; ____: www.assaabloydss.com/#sle.
 2. BEST, dormakaba Group; 48H Series: www.bestaccess.com/#sle.
 3. dormakaba; Architectural Hardware DB100 Series: www.dormakaba.com/#sle.
 4. Hager Companies; ____: www.hagerco.com/#sle.
 5. Marks USA, a subsidiary of NAPCO Security Technologies, Inc: www.marksusa.com/#sle.
 6. Pamex, Inc; Auxiliary Locks: www.pamexinc.com/#sle.
 7. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Auxiliary Locks (Deadlocks): Comply with BHMA A156.36, Grade 1.
1. Type: Bored (cylindrical).
 2. Application: Bored.
 3. Backset: 2-3/4 inch (70 mm), unless otherwise indicated.
 4. Bolt Throw: 1/2 inch (12.7 mm), with latch made of hardened steel.

2.07 CLOSERS

- A. Manufacturers; Surface Mounted:
1. BEST, dormakaba Group; EHD9000: www.bestaccess.com/#sle.
 2. Corbin Russwin, Norton, Rixson, Sargent, or Yale; an Assa Abloy Group company; ____: www.assaabloydss.com/#sle.
 3. dormakaba; Architectural Hardware 7100 Series, Architectural Hardware 7400 Series, Architectural Hardware 8600 Series, Architectural Hardware 8900 Series, Architectural Hardware STA Series, Architectural Hardware TS93 Series, Commercial Hardware QDC100 Series, Commercial Hardware QDC200 Series, and Commercial Hardware QDC300 Series: www.dormakaba.com/#sle.
 4. Hager Companies; ____: www.hagerco.com/#sle.
 5. LCN, an Allegion brand; ____: www.allegion.com/us/#sle.
 6. Pamex, Inc; Closers: www.pamexinc.com/#sle.
 7. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Closers: Comply with BHMA A156.4, Grade 1.
1. Type: Surface mounted to door.
 2. Provide door closer on each exterior door.
 3. Provide door closer on each fire-rated and smoke-rated door.
 4. Where an overlapping astragal is included on pairs of swinging doors, provide coordinator to ensure door leaves close in proper order.
 5. At corridor entry doors, mount closer on room side of door.
 6. At outswinging exterior doors, mount closer on interior side of door.

2.08 OVERHEAD STOPS AND HOLDERS

- A. Manufacturers:
1. Rixson or Sargent; an Assa Abloy Group company; ____: www.assaabloydss.com/#sle.
 2. dormakaba; Architectural Hardware 900 Series: www.dormakaba.com/#sle.
 3. Glynn-Johnson, an Allegion brand; ____: www.allegion.com/us/#sle.
 4. Pamex, Inc; Overhead Stops and Holders: www.pamexinc.com/#sle.
 5. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Overhead Stops and Holders (Door Checks): Comply with BHMA A156.8, Grade 1.
1. Provide stop for every swinging door, unless otherwise indicated.
 2. Stop is not required if positive stop feature is specified for door closer; positive stop feature of door closer is not an acceptable substitute for a stop, unless otherwise indicated.

2.09 KICK PLATES

- A. Manufacturers:
1. Hiawatha, Inc, an Activar Construction Products Group company; ____: www.activarcpg.com/hiawatha/#sle.
 2. Ives, an Allegion brand; ____: www.allegion.com/us/#sle.
 3. Standard Metal Hardware Manufacturing Ltd; Door Plates: www.smhardware.com/#sle.
 4. Trimco; ____: www.trimcohardware.com/#sle.
 5. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Kick Plates: Provide along bottom edge of push side of every door with closer, except aluminum storefront and glass entry doors, unless otherwise indicated.
1. Size: 8 inch (203 mm) high by 2 inch (51 mm) less door width (LDW) on push side of door.

2.10 MOP PLATES

- A. Manufacturers:
1. Hiawatha, Inc, an Activar Construction Products Group company; ____: www.activarcpg.com/hiawatha/#sle.
 2. Ives, an Allegion brand; ____: www.allegion.com/us/#sle.
 3. Trimco; ____: www.trimcohardware.com/#sle.
 4. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Mop Plates: Provide along bottom edge of push side of doors to provide protection from cleaning liquids and equipment damage to floor surface.
1. Size: 6 inch (152 mm) high by 1-1/2 inch (38 mm) less door width (LDW) on pull side and 2 inch (51 mm) LDW on push side of door.

2.11 FLOOR STOPS

- A. Manufacturers:
1. Rockwood; an Assa Abloy Group company; ____: www.assaabloydss.com/#sle.
 2. Hager Companies; ____: www.hagerco.com/#sle.
 3. Hiawatha, Inc, division of Activar Construction Products Group, Inc; ____: www.activarcpg.com/hiawatha/#sle.
 4. Standard Metal Hardware Manufacturing Ltd; Floor Stops: www.smhardware.com/#sle.
 5. Sugatsune America, Inc; Door Stoppers: www.sugatsune.com/#sle.
 6. Trimco; ____: www.trimcohardware.com/#sle.
 7. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Floor Stops: Comply with BHMA A156.16, Grade 1 and Resilient Material Retention Test as described in this standard.
1. Type: Manual hold-open, with pencil floor stop.
 2. Material: Aluminum housing with rubber insert.

2.12 WALL STOPS

- A. Manufacturers:
1. Rockwood; an Assa Abloy Group company; ____: www.assaabloydss.com/#sle.
 2. Hager Companies; ____: www.hagerco.com/#sle.
 3. Hiawatha, Inc, division of Activar Construction Products Group, Inc; ____: www.activarcpg.com/hiawatha/#sle.
 4. Pamex, Inc; Wall Stops: www.pamexinc.com/#sle.
 5. Standard Metal Hardware Manufacturing Ltd; Wall Stops: www.smhardware.com/#sle.
 6. Trimco; ____: www.trimcohardware.com/#sle.
 7. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Wall Stops: Comply with BHMA A156.16, Grade 1 and Resilient Material Retention Test as described in this standard.

1. Provide wall stops to prevent damage to wall surface upon opening door.
2. Type: Bumper, concave, wall stop.
3. Material: Aluminum housing with rubber insert.

2.13 THRESHOLDS

A. Manufacturers:

1. Dunbarton Corporation; ____: www.dunbarton.com/#sle.
2. Pemko; an Assa Abloy Group company; ____: www.assaabloydss.com/#sle.
3. Hager Companies; ____: www.hagerco.com/#sle.
4. National Guard Products, Inc; ____: www.ngpinc.com/#sle.
5. Reese Enterprises, Inc; ____: www.reeseusa.com/#sle.
6. Zero International, Inc; ____: www.zerointernational.com/#sle.
7. Substitutions: See Section 01 60 00 - Product Requirements.

B. Thresholds: Comply with BHMA A156.21.

1. Provide threshold at interior doors for transition between two different floor types, and over building expansion joints, unless otherwise indicated.
2. Provide threshold at each exterior door, unless otherwise indicated.
3. Type: Flat surface.
4. Material: Aluminum.
5. Threshold Surface: Fluted horizontal grooves across full width.
6. Field cut threshold to profile of frame and width of door sill for tight fit.
7. Provide non-corroding fasteners at exterior locations.

2.14 WEATHERSTRIPPING AND GASKETING

A. Manufacturers:

1. Dunbarton Corporation; ____: www.dunbarton.com/#sle.
2. Pemko; an Assa Abloy Group company; ____: www.assaabloydss.com/#sle.
3. Hager Companies; ____: www.hagerco.com/#sle.
4. National Guard Products, Inc; ____: www.ngpinc.com/#sle.
5. Reese Enterprises, Inc; ____: www.reeseusa.com/#sle.
6. Zero International, Inc; ____: www.zerointernational.com/#sle.
7. Substitutions: See Section 01 60 00 - Product Requirements.

B. Weatherstripping and Gasketing: Comply with BHMA A156.22.

1. Head and Jamb Type: Adjustable.
2. Door Sweep Type: Encased in retainer.
3. Material: Aluminum, with brush weatherstripping.
4. Provide gasketing for smoke and draft control doors (Indicated as "S" on Drawings) that complies with local codes, requirements of assemblies tested in accordance with UL 1784.
5. Provide weatherstripping on each exterior door at head, jambs, and meeting stiles of door pairs, unless otherwise indicated.
6. Provide door bottom sweep on each exterior door, unless otherwise indicated.

2.15 SILENCERS

A. Manufacturers:

1. Ives, an Allegion brand; ____: www.allegion.com/us/#sle.
2. Rockwood; an Assa Abloy Group company; ____: www.assaabloydss.com/#sle.
3. Substitutions: See Section 01 60 00 - Product Requirements.

B. Silencers: Provide at equal locations on door frame to mute sound of door's impact upon closing.

1. Single Door: Provide three on strike jamb of frame.
2. Pair of Doors: Provide two on head of frame, one for each door at latch side.

3. Material: Rubber, gray color.

2.16 FINISHES

- A. Finishes: Identified in Section 08 0671 - Door Hardware Schedule.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that doors and frames are ready to receive this work; labeled, fire-rated doors and frames are properly installed, and dimensions are as indicated on shop drawings.
- B. Verify that electric power is available to power operated devices and of correct characteristics.

3.02 INSTALLATION

- A. Install hardware in accordance with manufacturer's instructions and applicable codes.
- B. Install hardware on fire-rated doors and frames in accordance with applicable codes and NFPA 80.
- C. Install hardware for smoke and draft control doors in accordance with NFPA 105.
- D. Use templates provided by hardware item manufacturer.
- E. Do not install surface mounted items until application of finishes to substrate are fully completed.
- F. Door Hardware Mounting Heights: Distance from finished floor to center line of hardware item. As indicated in following list; unless noted otherwise in Door Hardware Schedule or on drawings.
 1. For Steel Doors and Frames: See Section 08 11 13.
 2. For Aluminum-Framed Storefront Doors and Frames: See Section 08 43 13.
 3. Flush Wood Doors: See Section 08 14 16.
 4. Mounting heights in compliance with ADA Standards:
 - a. Locksets: 40-5/16 inch (1024 mm).
 - b. Push Plates/Pull Bars: 42 inch (1067 mm).
 - c. Deadlocks (Deadbolts): 48 inch (1219 mm).
 - d. Exit Devices: 40-5/16 inch (1024 mm).
 - e. Door Viewer: 43 inch (1092 mm); standard height 60 inch (1524 mm).
- G. Set exterior door thresholds with full-width bead of elastomeric sealant at each point of contact with floor providing a continuous weather seal; anchor thresholds with stainless steel countersunk screws.
 1. See Section 07 92 00 for additional requirements.

3.03 FIELD QUALITY CONTROL

- A. Perform field inspection and testing under provisions of Section 01 40 00 - Quality Requirements.
- B. Provide an Architectural Hardware Consultant (AHC) to inspect installation and certify that hardware and installation has been furnished and installed in accordance with manufacturer's instructions and as specified.

3.04 ADJUSTING

- A. Adjust work under provisions of Section 01 70 00 - Execution and Closeout Requirements.
- B. Adjust hardware for smooth operation.
- C. Adjust gasketing for complete, continuous seal; replace if unable to make complete seal.

3.05 CLEANING

- A. Clean finished hardware in accordance with manufacturer's written instructions after final adjustments have been made.

- B. Clean adjacent surfaces soiled by hardware installation.
- C. Replace items that cannot be cleaned to manufacturer's level of finish quality at no additional cost.
- D. See Section 01 74 19 - Construction Waste Management and Disposal for additional requirements.

3.06 PROTECTION

- A. Protect finished Work under provisions of Section 01 70 00 - Execution and Closeout Requirements.
- B. Do not permit adjacent work to damage hardware or finish.

END OF SECTION 08 71 00

NOT FOR BIDDING PURPOSES

NOT FOR BIDDING PURPOSES

This page intentionally left blank

SECTION 09 21 16
GYPSUM BOARD ASSEMBLIES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Gypsum wallboard.
- B. Joint treatment and accessories.

1.02 RELATED REQUIREMENTS

- A. Section 06 10 00 - Rough Carpentry: Building framing and sheathing.
- B. Section 07 92 00 - Joint Sealants: Sealing acoustical gaps in construction other than gypsum board or plaster work.

1.03 REFERENCE STANDARDS

- A. ASTM C475/C475M - Standard Specification for Joint Compound and Joint Tape for Finishing Gypsum Board; 2017 (Reapproved 2022).
- B. ASTM C514 - Standard Specification for Nails for the Application of Gypsum Board; 2004 (Reapproved 2020).
- C. ASTM C840 - Standard Specification for Application and Finishing of Gypsum Board; 2024.
- D. ASTM C1047 - Standard Specification for Accessories for Gypsum Wallboard and Gypsum Veneer Base; 2019.
- E. ASTM C1396/C1396M - Standard Specification for Gypsum Board; 2024.
- F. GA-216 - Application and Finishing of Gypsum Panel Products; 2024.
- G. GA-226 - Application of Gypsum Board to Form Curved Surfaces; 2025.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination: Coordinate the installation of gypsum board assemblies with size, location, and installation of service utilities.
- B. Preinstallation Meeting: Conduct a preinstallation meeting one week prior to the start of the work of this section; require attendance by all affected installers.

1.05 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements for submittal procedures.
- B. Product Data:
 - 1. Provide data on gypsum board and accessories.
 - 2. Provide manufacturer's data on partition head to structure connectors, showing compliance with requirements.

1.06 QUALITY ASSURANCE

- A. Installer Qualifications: Company specializing in performing work of the type specified and with at least 5 years of documented experience.
- B. Documents at Project Site: Maintain at the project site a copy of manufacturer's instructions, erection drawings, and shop drawings.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. See Section 01 74 19 - Construction Waste Management and Disposal for packaging waste requirements.
- B. Store gypsum products and accessories indoors and keep above freezing. Elevate boards above floor, on nonwicking supports, in accordance with manufacturer's recommendations.

- C. Store metal products to prevent corrosion.

PART 2 PRODUCTS

2.01 GYPSUM BOARD ASSEMBLIES

- A. Provide completed assemblies complying with ASTM C840 and GA-216.
1. See PART 3 for finishing requirements.

2.02 BOARD MATERIALS

- A. Gypsum Wallboard: Paper-faced gypsum panels as defined in ASTM C1396/C1396M; sizes to minimize joints in place; ends square cut.
1. Application: Use for vertical surfaces and ceilings, unless otherwise indicated.
 2. At Assemblies Indicated with Fire-Resistance Rating: Use type required by indicated tested assembly; if no tested assembly is indicated, use Type X board, UL or WH listed.
 3. Thickness:
 - a. Vertical Surfaces: 5/8 inch (16 mm).
 - b. Ceilings: 5/8 inch (16 mm).
 - c. Multi-Layer Assemblies: Thicknesses as indicated on drawings.
 4. Paper-Faced Products:
 - a. American Gypsum Company; FireBloc Type X Gypsum Wallboard: www.americangypsum.com/#sle.
 - b. CertainTeed Corporation; Type C Drywall: www.certainteed.com/#sle.
 - c. CertainTeed Corporation; Type X Drywall: www.certainteed.com/#sle.
 - d. Georgia-Pacific Gypsum; ToughRock Fireguard X: www.gpgypsum.com/#sle.
 - e. Gold Bond Building Products, LLC provided by National Gypsum Company; Gold Bond Fire-Shield Gypsum Board: www.goldbondbuilding.com/#sle.
 - f. USG Corporation; Sheetrock Brand EcoSmart Panels Firecode X 5/8 in. (15.9 mm): www.usg.com/#sle.
 - g. USG Corporation; Sheetrock Brand UltraLight Panels Firecode ULIX 5/8 in. (15.9 mm): www.usg.com/#sle.
 - h. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Exterior Sheathing Board: See Section 06 10 00.

2.03 GYPSUM BOARD ACCESSORIES

- A. Finishing Accessories: ASTM C1047, extruded aluminum alloy (6063 T5) or galvanized steel sheet ASTM A924/A924M G90, unless noted otherwise.
1. Types: As detailed or required for finished appearance.
 2. Special Shapes: In addition to conventional corner bead and control joints, provide U-bead at exposed panel edges.
- B. Beads, Joint Accessories, and Other Trim: ASTM C1047, rigid plastic, galvanized steel, or rolled zinc, unless noted otherwise.
1. Corner Beads: Low profile, for 90 degree outside corners.
 2. L-Trim with Tear-Away Strip: Sized to fit 1/2-inch (13 mm) thick gypsum wallboard.
- C. Joint Materials: ASTM C475/C475M and as recommended by gypsum board manufacturer for project conditions.
1. Fiberglass Tape: 2 inch (50 mm) wide, coated glass fiber tape for joints and corners, except as otherwise indicated.
 2. Paper Tape: 2 inch (50 mm) wide, creased paper tape for joints and corners, except as otherwise indicated.
 3. Joint Compound: Drying type, vinyl-based, ready-mixed.
 4. Joint Compound: Setting type, field-mixed.
- D. Nails for Attachment to Wood Members: ASTM C514.

- E. Anchorage to Substrate: Tie wire, nails, screws, and other metal supports, of type and size to suit application; to rigidly secure materials in place.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that project conditions are appropriate for work of this section to commence.

3.02 BOARD INSTALLATION

- A. Comply with ASTM C840, GA-216, and manufacturer's instructions. Install to minimize butt end joints, especially in highly visible locations.
- B. Single-Layer Nonrated: Install gypsum board in most economical direction, with ends and edges occurring over firm bearing.
 - 1. Exception: Tapered edges to receive joint treatment at right angles to framing.
- C. Installation on Wood Framing: For rated assemblies, comply with requirements of listing authority. For nonrated assemblies, install as follows:
 - 1. Single-Layer Applications: Adhesive application.
 - 2. Double-Layer Application: Install base layer using screws or nails. Install face layer using adhesive.
- D. Curved Surfaces: Apply gypsum board to curved substrates in accordance with GA-226.

3.03 INSTALLATION OF TRIM AND ACCESSORIES

- A. Control Joints: Place control joints consistent with lines of building spaces and as indicated.
 - 1. Not more than 30 feet (10 meters) apart on walls and ceilings over 50 feet (16 meters) long.
 - 2. At exterior soffits, not more than 30 feet (10 meters) apart in both directions.
- B. Corner Beads: Install at external corners, using longest practical lengths.
- C. Edge Trim: Install at locations where gypsum board abuts dissimilar materials.

3.04 JOINT TREATMENT

- A. Glass Mat Faced Gypsum Board and Exterior Glass Mat Faced Sheathing: Use fiberglass joint tape, embed and finish with setting type joint compound.
- B. Paper Faced Gypsum Board: Use paper joint tape, embed with drying type joint compound and finish with drying type joint compound.
- C. Finish gypsum board in accordance with levels defined in ASTM C840, as follows:
 - 1. Level 4: Walls and ceilings to receive paint finish or wall coverings, unless otherwise indicated.
 - 2. Level 3: Walls to receive textured wall finish.
 - 3. Level 2: In utility areas, behind cabinetry, and on backing board to receive tile finish.
 - 4. Level 1: Fire-resistance-rated wall areas above finished ceilings, whether or not accessible in the completed construction.
 - 5. Level 0: Temporary partitions.
 - 6. Level 0: Surfaces indicated to be finished in later stage of project.
- D. Tape, fill, and sand exposed joints, edges, and corners to produce smooth surface ready to receive finishes.
 - 1. Feather coats of joint compound so that camber is maximum 1/32 inch (0.8 mm).
 - 2. Taping, filling, and sanding are not required at surfaces behind adhesive applied ceramic tile and fixed cabinetry.
 - 3. Taping, filling, and sanding are not required at base layer of double-layer applications.

- E. Fill and finish joints and corners of cementitious backing board as recommended by manufacturer.

3.05 TOLERANCES

- A. Maximum Variation of Finished Gypsum Board Surface from True Flatness: 1/8 inch in 10 feet (3 mm in 3 m) in any direction.

3.06 CLEANING

- A. See Section 01 70 00 - Execution and Closeout Requirements for additional requirements.

3.07 PROTECTION

- A. Protect installed gypsum board assemblies from subsequent construction operations.

END OF SECTION 09 21 16

NOT FOR BIDDING PURPOSES

**SECTION 09 51 00
ACOUSTICAL CEILINGS**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Suspended metal grid ceiling system.
- B. Acoustical units.
- C. Supplementary insulation above ceiling.

1.02 RELATED REQUIREMENTS

- A. Section 01 61 16 - Volatile Organic Compound (VOC) Content Restrictions.
- B. Section 07 21 00 - Thermal Insulation: Acoustical insulation.

1.03 REFERENCE STANDARDS

- A. ASCE 7 - Minimum Design Loads and Associated Criteria for Buildings and Other Structures; Most Recent Edition Cited by Referring Code or Reference Standard.
- B. ASTM A653/A653M - Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process; 2025a.
- C. ASTM C635/C635M - Standard Specification for Manufacture, Performance, and Testing of Metal Suspension Systems for Acoustical Tile and Lay-in Panel Ceilings; 2022.
- D. ASTM C636/C636M - Standard Practice for Installation of Metal Ceiling Suspension Systems for Acoustical Tile and Lay-In Panels; 2019 (Reapproved 2025).
- E. ASTM E580/E580M - Standard Practice for Installation of Ceiling Suspension Systems for Acoustical Tile and Lay-in Panels in Areas Subject to Earthquake Ground Motions; 2024a.
- F. ASTM E1264 - Standard Classification for Acoustical Ceiling Products; 2023.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Sequence work to ensure acoustical ceilings are not installed until building is enclosed, sufficient heat is provided, dust generating activities have terminated, and overhead work is completed, tested, and approved.
- B. Do not install acoustical units until after interior wet work is dry.

1.05 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements for submittal procedures.
- B. Product Data: Provide data on suspension system components and acoustical units.
- C. Samples: Submit two samples 6 by 6 inch (150 by 150 mm) in size illustrating material and finish of acoustical units.
- D. Samples: Submit two samples each, 8 inches (200 mm) long, of suspension system main runner, cross runner, and perimeter molding.
- E. Maintenance Materials: Furnish the following for Owner's use in maintenance of project.
 - 1. See Section 01 60 00 - Product Requirements, for additional provisions.
 - 2. Extra Acoustical Units: Quantity equal to 5 percent of total installed.

1.06 QUALITY ASSURANCE

- A. Suspension System Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum 10 years documented experience.
- B. Acoustical Unit Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum 10 years documented experience.

1.07 FIELD CONDITIONS

- A. Maintain uniform temperature of minimum 60 degrees F (16 degrees C), and maximum humidity of 40 percent prior to, during, and after acoustical unit installation.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Acoustic Tiles/Panels:
 - 1. Armstrong World Industries, Inc: www.armstrongceilings.com/#sle.
 - 2. Certainteed Architectural: www.certainteed.com/ceilings-and-walls/#sle.
 - 3. USG Corporation: www.usg.com/ceilings/#sle.
 - 4. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Suspension Systems:
 - 1. Same as for acoustical units.
 - 2. Substitutions: See Section 01 60 00 - Product Requirements.

2.02 PERFORMANCE REQUIREMENTS

- A. Seismic Performance: Ceiling systems designed to withstand the effects of earthquake motions determined according to ASCE 7 for Seismic Design Category C and complying with the following:
 - 1. Local authorities having jurisdiction.

2.03 ACOUSTICAL UNITS

- A. Acoustical Units - General: ASTM E1264, Class A.
 - 1. VOC Content: As specified in Section 01 61 16.
- B. Acoustical Panels, Type ACT-1: Fiberglass board with acoustically transparent membrane overlay, with the following characteristics:
 - 1. Classification: ASTM E1264 Type A.
 - a. Form: A2.2, wet formed.
 - b. Pattern: G - smooth.
 - 2. Size: 24 by 24 inches (610 by 610 mm).
 - 3. Thickness: 1 inch (25 mm).
 - 4. Light Reflectance: 85 percent, in accordance with ASTM E1264.
 - 5. Noise Reduction Coefficient (NRC) Range: 75 to 85, in accordance with ASTM E1264.
 - 6. Articulation Class (AC): 170, in accordance with ASTM E1264.
 - 7. Ceiling Attenuation Class (CAC): 40, in accordance with ASTM E1264.
 - 8. Panel Edge: Square.
 - 9. Tile Edge: Square.
 - a. Joint: Kerfed and rabbeted.
 - 10. Color: White.
 - 11. Suspension System Type ESS-1: Exposed grid.
 - 12. Products:
 - a. Armstrong World Industries, Inc; Calla Health Zone AirAssure #1354: www.armstrongceilings.com/#sle.
 - b. Certainteed Architectural: www.certainteed.com/ceilings-and-walls/#sle.
 - c. USG Corporation: www.usg.com/#sle.
 - d. Substitutions: See Section 01 60 00 - Product Requirements.

2.04 SUSPENSION SYSTEMS

- A. Metal Suspension Systems - General: Complying with ASTM C635/C635M; die cut and interlocking components, with perimeter moldings, hold-down clips, stabilizer bars, clips, and splices as required.
 - 1. Materials:

- a. Steel Grid: ASTM A653/A653M, G30 coating, unless otherwise indicated.
- B. Exposed Suspension System, Type ESS-1: Hot-dip galvanized steel grid with steel cap.
 - 1. Structural Classification: Intermediate-duty, when tested in accordance with ASTM C635/C635M.
 - 2. Profile: Tee; 15/16 inch (24 mm) face width.
 - 3. Finish: Baked enamel.
 - 4. Color: White.
 - 5. Products:
 - a. Armstrong World Industries, Inc; Prelude XL: www.armstrongceilings.com/#sle. Basis of Design)
 - b. Certainteed Architectural; 15/16" EZ Stab Classic System: www.certainteed.com/ceilings-and-walls/#sle.
 - c. USG Corporation; Donn Brand ZXLA 15/16 inch Acoustical Suspension System: www.usg.com/#sle.

2.05 ACCESSORIES

- A. Support Channels and Hangers: Galvanized steel; size and type to suit application, seismic requirements, and ceiling system flatness requirement specified.
- B. Hanger Wire: 12 gauge, 0.08 inch (2 mm) galvanized steel wire.
- C. Hold-Down Clips: Manufacturer's standard clips to suit application.
- D. Seismic Clips: Manufacturer's standard clips for seismic conditions and to suit application.
- E. Face sleeve.
- F. Intersection sleeve.
- G. Perimeter Moldings: Same metal and finish as grid.
- H. Metal Edge Trim for Suspension Systems: Steel or extruded aluminum; provide attachment clips, splice plates, and preformed corner pieces for complete trim system.
- I. Touch-up Paint: Type and color to match acoustical and grid units.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify existing conditions before starting work.
- B. Verify that layout of hangers will not interfere with other work.

3.02 PREPARATION

- A. Install after major above-ceiling work is complete.
- B. Coordinate the location of hangers with other work.
- C. Provide hanger clips during steel deck erection. Provide additional hangers and inserts as required.

3.03 INSTALLATION - SUSPENSION SYSTEM

- A. Install suspension system in accordance with ASTM C636/C636M, ASTM E580/E580M, and manufacturer's instructions, as supplemented in this section.
- B. Rigidly secure system, including integral mechanical and electrical components, for maximum deflection of 1:360.
- C. Lay out system to a balanced grid design with edge units no less than 50 percent of acoustical unit size.

- D. Perimeter Molding: Install at intersection of ceiling and vertical surfaces and at junctions with other interruptions.
 - 1. Use longest practical lengths.
 - 2. Overlap and rivet corners.
- E. Suspension System, Non-Seismic: Hang suspension system independent of walls, columns, ducts, pipes and conduit. Where carrying members are spliced, avoid visible displacement of face plane of adjacent members.
- F. Seismic Suspension System, Seismic Design Category C: Hang suspension system independent of walls, columns, ducts, pipes and conduit. Maintain a 3/8 inch (9 mm) clearance between grid ends and wall.
- G. Where ducts or other equipment prevent the regular spacing of hangers, reinforce the nearest affected hangers and related carrying channels to span the extra distance.
- H. Do not support components on main runners or cross runners if weight causes total dead load to exceed deflection capability.
- I. Support fixture loads using supplementary hangers located within 6 inches (152 mm) of each corner, or support components independently.
- J. Do not eccentrically load system or induce rotation of runners.

3.04 INSTALLATION - ACOUSTICAL UNITS

- A. Install acoustical units in accordance with manufacturer's instructions.
- B. Fit acoustical units in place, free from damaged edges or other defects detrimental to appearance and function.
- C. Fit border trim neatly against abutting surfaces.
- D. Install acoustical units level, in uniform plane, and free from twist, warp, and dents.
- E. Cutting Acoustical Units:
 - 1. Cut to fit irregular grid and perimeter edge trim.
 - 2. Make field cut edges of same profile as factory edges.
 - 3. Double cut and field paint exposed reveal edges.
- F. Where round obstructions occur, provide preformed closures to match perimeter molding.
- G. Install hold-down clips on each panel to retain panels tight to grid system; comply with fire rating requirements.
- H. Install hold-down clips on panels within 10 ft (3 m) of an exterior door.

3.05 TOLERANCES

- A. Maximum Variation from Flat and Level Surface: 1/8 inch in 10 feet (3 mm in 3 m).
- B. Maximum Variation from Plumb of Grid Members Caused by Eccentric Loads: 2 degrees.

3.06 CLEANING

- A. See Section 01 70 00 - Execution and Closeout Requirements for additional requirements.
- B. Clean surfaces.
- C. Replace damaged or abraded components.

END OF SECTION 09 51 00

**SECTION 09 65 00
RESILIENT FLOORING**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Resilient base.
- B. Installation accessories.

1.02 RELATED REQUIREMENTS

- A. Section 01 61 16 - Volatile Organic Compound (VOC) Content Restrictions.

1.03 REFERENCE STANDARDS

- A. ASTM E648 - Standard Test Method for Critical Radiant Flux of Floor Covering Systems Using a Radiant Heat Energy Source; 2025.
- B. ASTM F1861 - Standard Specification for Resilient Wall Base, 2021 (Reapproved 2025).
- C. NFPA 253 - Standard Method of Test for Critical Radiant Flux of Floor Covering Systems Using a Radiant Heat Energy Source; 2023.
- D. RFCI (RWP) - Recommended Work Practices for Removal of Resilient Floor Coverings; 2018.

1.04 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements for submittal procedures.
- B. Product Data: Provide data on specified products, describing physical and performance characteristics; including sizes, patterns and colors available; and installation instructions.
- C. Shop Drawings: Indicate seaming plans and floor patterns.
- D. Selection Samples: Submit manufacturer's complete set of color samples for Architect's initial selection.
- E. Maintenance Data: Include maintenance procedures, recommended maintenance materials, and suggested schedule for cleaning, stripping, and re-waxing.

1.05 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing specified flooring with minimum 10 years documented experience.
- B. Installer Qualifications: Company specializing in installing specified flooring with minimum three years documented experience.
- C. Testing Agency Qualifications: Independent firm specializing in performing concrete slab moisture testing and inspections of the type specified in this section.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. Upon receipt, immediately remove any shrink-wrap and check materials for damage and the correct style, color, quantity and run numbers.
- B. Store all materials off of the floor in an acclimatized, weather-tight space.
- C. Maintain temperature in storage area between 55 degrees F (13 degrees C) and 90 degrees F (72 degrees C).
- D. Protect roll materials from damage by storing on end.
- E. Do not double stack pallets.

1.07 FIELD CONDITIONS

- A. Store materials for not less than 48 hours prior to installation in area of installation at a temperature of 70 degrees F (21 degrees C) to achieve temperature stability. Thereafter, maintain conditions above 55 degrees F (13 degrees C).

PART 2 PRODUCTS

2.01 RESILIENT BASE

- A. Resilient Base - Type RB-1: ASTM F1861, Type TP, rubber, thermoplastic; style as scheduled.
1. Manufacturers:
 - a. Flexco Corporation: www.flexcofloors.com/#sle.
 - b. Mannington Commercial: www.manningtoncommercial.com/#sle.
 - c. Roppe Corporation: www.roppe.com/#sle.
 - d. Tarkett Flooring, Johnsonite; ; Cove Base: www.tarkett.com/#sle.
 - e. Substitutions: See Section 01 60 00 - Product Requirements.
 2. Critical Radiant Flux (CRF): Minimum 0.45 watt per square centimeter, when tested in accordance with ASTM E648 or NFPA 253.
 3. Height: 4 inches (100 mm).
 4. Thickness: 0.125 inch (3.2 mm).
 5. Finish: Satin.
 6. Length: Roll.
 7. Color(s): As indicated.

2.02 ACCESSORIES

- A. Primers, Adhesives, and Seam Sealer: Waterproof; types recommended by flooring manufacturer.
1. VOC Content Limits: As specified in Section 01 61 16.
- B. Moldings, Transition and Edge Strips: Same material as wall base.
1. Manufacturers:
 - a. Mannington Commercial: www.manningtoncommercial.com/#sle.
 - b. Substitutions: See Section 01 60 00 - Product Requirements.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that surfaces are flat to tolerances acceptable to flooring manufacturer, free of cracks that might telegraph through flooring, clean, dry, and free of curing compounds, surface hardeners, and other chemicals that might interfere with bonding of flooring to substrate.
- B. Verify that wall surfaces are smooth and flat within the tolerances specified for that type of work, are dust-free, and are ready to receive resilient base.

3.02 PREPARATION

- A. Remove existing resilient flooring and flooring adhesives; follow the recommendations of RFCI (RWP).
- B. Clean substrate.
- C. Apply primer as required to prevent "bleed-through" or interference with adhesion by substances that cannot be removed.

3.03 INSTALLATION - RESILIENT BASE

- A. Fit joints tightly and make vertical. Maintain minimum dimension of 18 inches (45 mm) between joints.
- B. Miter internal corners. At external corners, use premolded units. At exposed ends, use premolded units.
- C. Install base on solid backing. Bond tightly to wall and floor surfaces.

- D. Scribe and fit to door frames and other interruptions.

3.04 CLEANING

- A. Remove excess adhesive from floor, base, and wall surfaces without damage.
- B. Clean in accordance with manufacturer's written instructions.

3.05 PROTECTION

- A. Prohibit traffic on resilient flooring for 48 hours after installation.

END OF SECTION 09 65 00

NOT FOR BIDDING PURPOSES

NOT FOR BIDDING PURPOSES

This page intentionally left blank

SECTION 09 91 13
EXTERIOR PAINTING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Surface preparation.
- B. Field application of paints.
- C. Materials for backpriming woodwork.
- D. Scope: Finish exterior surfaces exposed to view, unless fully factory-finished and unless otherwise indicated, including the following:
 - 1. Both sides and edges of plywood backboards for electrical and telecom equipment before installing equipment.
 - 2. Exposed surfaces of steel lintels and ledge angles.
 - 3. Exposed walls and bottom of swimming pools and fountains.
 - 4. Mechanical and Electrical:
- E. Do Not Paint or Finish the Following Items:
 - 1. Items factory-finished unless otherwise indicated, materials and products having factory-applied primers are not considered factory finished.
 - 2. Items indicated to receive other finishes.
 - 3. Items indicated to remain unfinished.
 - 4. Fire rating labels, equipment serial number and capacity labels, and operating parts of equipment.
 - 5. Non-metallic roofing and flashing.
 - 6. Stainless steel, anodized aluminum, bronze, terne-coated stainless steel, zinc, and lead.
 - 7. Marble, granite, slate, and other natural stones.
 - 8. Floors, unless specifically indicated.
 - 9. Ceramic and other types of tiles.
 - 10. Brick, glass unit masonry, architectural concrete, cast stone, integrally colored plaster and stucco.
 - 11. Exterior insulation and finish system (EIFS).
 - 12. Glass.
 - 13. Concrete masonry units in utility, mechanical, and electrical spaces.
 - 14. Concealed pipes, ducts, and conduits.

1.02 RELATED REQUIREMENTS

- A. Section 01 61 16 - Volatile Organic Compound (VOC) Content Restrictions.
- B. Section 05 50 00 - Metal Fabrications: Shop-primed items.
- C. Section 05 51 00 - Metal Stairs: Shop-primed items.
- D. Section 09 91 23 - Interior Painting.
- E. Section 09 96 00 - High-Performance Coatings.
- F. Section 21 05 53 - Identification for Fire Suppression Piping and Equipment: Painted identification.
- G. Section 21 05 53 - Identification for Fire Suppression Piping and Equipment: Color coding scheme for items to be painted under this section.
- H. Section 22 05 53 - Identification for Plumbing Piping and Equipment: Painted identification.
- I. Section 22 05 53 - Identification for Plumbing Piping and Equipment: Color coding scheme for items to be painted under this section.

- J. Section 23 05 53 - Identification for HVAC Piping and Equipment: Painted identification.
- K. Section 23 05 53 - Identification for HVAC Piping and Equipment: Color coding scheme for items to be painted under this section.
- L. Section 26 05 53 - Identification for Electrical Systems: Painted identification.
- M. Section 26 05 53 - Identification for Electrical Systems: Color coding scheme for items to be painted under this section.
- N. Section 32 17 23 - Pavement Markings: Painted pavement markings.

1.03 DEFINITIONS

- A. Comply with ASTM D16 for interpretation of terms used in this section.

1.04 REFERENCE STANDARDS

- A. ASTM D16 - Standard Terminology for Paint, Related Coatings, Materials, and Applications; 2024.
- B. MPI (APSM) - Master Painters Institute Architectural Painting Specification Manual; Current Edition.
- C. SSPC-SP 1 - Solvent Cleaning; 2015, with Editorial Revision (2016).
- D. SSPC-SP 2 - Hand Tool Cleaning; 2024.
- E. SSPC-SP 6/NACE No.3 - Commercial Blast Cleaning; 2006.

1.05 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide complete list of products to be used, with the following information for each:
 - 1. Manufacturer's name, product name and/or catalog number, and general product category (e.g. "alkyd enamel").
 - 2. MPI product number (e.g. MPI #47).
 - 3. Cross-reference to specified paint system(s) product is to be used in; include description of each system.
 - 4. Manufacturer's installation instructions.
 - 5. If proposal of substitutions is allowed under submittal procedures, explanation of substitutions proposed.
- C. Samples: Submit three paper "draw down" samples, 8-1/2 by 11 inches (216 by 279 mm) in size, illustrating range of colors available for each finishing product specified.
 - 1. Where sheen is specified, submit samples in only that sheen.
 - 2. Allow 30 days for approval process, after receipt of complete samples by Architect.
 - 3. Paint color submittals will not be considered until color submittals for major materials not to be painted, such as masonry, have been approved.
- D. Certification: By manufacturer that paints and finishes comply with VOC limits specified.
- E. Manufacturer's Instructions: Indicate special surface preparation procedures.
- F. Maintenance Data: Submit data including finish schedule showing where each product/color/finish was used, product technical data sheets, material safety data sheets (MSDS), care and cleaning instructions, touch-up procedures, repair of painted and finished surfaces, and color samples of each color and finish used.
- G. Maintenance Materials: Furnish the following for Owner's use in maintenance of project.
 - 1. See Section 01 60 00 - Product Requirements, for additional provisions.
 - 2. Extra Paint and Finish Materials: 1 gallon (4 L) of each color; from the same product run, store where directed.
 - 3. Label each container with color in addition to the manufacturer's label.

1.06 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing the products specified, with minimum 10 years documented experience.
- B. Applicator Qualifications: Company specializing in performing the type of work specified with minimum 5 years experience and approved by manufacturer.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. Deliver products to site in sealed and labeled containers; inspect to verify acceptability.
- B. Container Label: Include manufacturer's name, type of paint, brand name, lot number, brand code, coverage, surface preparation, drying time, cleanup requirements, color designation, and instructions for mixing and reducing.
- C. Paint Materials: Store at minimum ambient temperature of 45 degrees F (7 degrees C) and a maximum of 90 degrees F (32 degrees C), in ventilated area, and as required by manufacturer's instructions.

1.08 FIELD CONDITIONS

- A. Do not apply materials when surface and ambient temperatures are outside the paint product manufacturer's temperature ranges.
- B. Follow manufacturer's recommended procedures for producing best results, including testing of substrates, moisture in substrates, and humidity and temperature limitations.
- C. Do not apply exterior paint and finishes during rain or snow, or when relative humidity is outside the humidity ranges required by the paint product manufacturer.
- D. Minimum Application Temperatures for Latex Paints: 50 degrees F (10 degrees C) for exterior; unless required otherwise by manufacturer's instructions.
- E. Provide lighting level of 80 ft candles (860 lx) measured mid-height at substrate surface.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Provide paints and finishes from the same manufacturer to the greatest extent possible.
 - 1. If a single manufacturer cannot provide specified products, minor exceptions will be permitted provided approval by Architect is obtained using the specified procedures for substitutions.
- B. Paints:
 - 1. Pittsburgh Paints: www.pittsburghpaintsco.com/#sle.
 - 2. Sherwin-Williams Company: www.sherwin-williams.com/#sle. (Basis of Design)
- C. Primer Sealers: Same manufacturer as top coats.
- D. Substitutions: See Section 01 60 00 - Product Requirements.

2.02 PAINTS AND FINISHES - GENERAL

- A. Paints and Finishes: Ready-mixed, unless required to be a field-catalyzed paint.
 - 1. Provide paints and finishes of a soft paste consistency, capable of being readily and uniformly dispersed to a homogeneous coating, with good flow and brushing properties, and capable of drying or curing free of streaks or sags.
 - 2. Provide materials that are compatible with one another and the substrates indicated under conditions of service and application, as demonstrated by manufacturer based on testing and field experience.
 - 3. For opaque finishes, tint each coat including primer coat and intermediate coats, one-half shade lighter than succeeding coat, with final finish coat as base color.

4. Supply each paint material in quantity required to complete entire project's work from a single production run.
 5. Do not reduce, thin, or dilute paint or finishes or add materials unless such procedure is described explicitly in manufacturer's product instructions.
- B. Volatile Organic Compound (VOC) Content: Comply with Section 01 61 16.
- C. Flammability: Comply with applicable code for surface burning characteristics.
- D. Sheens: Provide the sheens specified; where sheen is not specified, sheen will be selected later by Architect from the manufacturer's full line.
- E. Colors: To be selected from manufacturer's full range of available colors.
1. Selection to be made by Architect after award of contract.

2.03 PAINT SYSTEMS - EXTERIOR

- A. Paint E-OP - Exterior Surfaces to be Painted, Unless Otherwise Indicated: Including concrete, concrete masonry units, brick, fiber cement siding, primed wood, and primed metal.
1. Two top coats and one coat primer.

2.04 ACCESSORY MATERIALS

- A. Accessory Materials: Provide primers, sealers, cleaning agents, cleaning cloths, sanding materials, and clean-up materials as required for final completion of painted surfaces.
- B. Sacrificial Anti-Graffiti Coating: Clear, wax emulsion for coating porous or painted surfaces; capable of being removed from substrate with only hot water.
- C. Patching Material: Latex filler.
- D. Fastener Head Cover Material: Latex filler.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Do not begin application of paints and finishes until substrates have been properly prepared.
- B. Verify that surfaces are ready to receive work as instructed by the product manufacturer.
- C. Examine surfaces scheduled to be finished prior to commencement of work. Report any condition that may potentially affect proper application.
- D. If substrate preparation is the responsibility of another installer, notify Architect of unsatisfactory preparation before proceeding.
- E. Test shop-applied primer for compatibility with subsequent cover materials.

3.02 PREPARATION

- A. Clear surfaces thoroughly and correct defects prior to application.
- B. Prepare surfaces using the methods recommended by the manufacturer for achieving the best result for the substrate under the project conditions.
- C. Remove or repair existing paints or finishes that exhibit surface defects.
- D. Remove or mask surface appurtenances, including electrical plates, hardware, light fixture trim, escutcheons, and fittings, prior to preparing surfaces for finishing.
- E. Seal surfaces that might cause bleed through or staining of topcoat.
- F. Remove mildew from impervious surfaces by scrubbing with solution of tetra-sodium phosphate and bleach. Rinse with clean water and allow surface to dry.
- G. Galvanized Surfaces:
1. Remove surface contamination and oils and wash with solvent according to SSPC-SP 1.
 2. Prepare surface according to SSPC-SP 2.
- H. Ferrous Metal:

1. Solvent clean according to SSPC-SP 1.
 2. Shop-Primed Surfaces: Sand and scrape to remove loose primer and rust. Feather edges to make touch-up patches inconspicuous. Clean surfaces with solvent. Prime bare steel surfaces. Re-prime entire shop-primed item.
 3. Remove rust, loose mill scale, and other foreign substances using methods recommended in writing by paint manufacturer and blast cleaning in accordance with SSPC-SP 6/NACE No.3. Protect from corrosion until coated.
- I. Exterior Wood Surfaces to Receive Opaque Finish: Remove dust, grit, and foreign matter. Seal knots, pitch streaks, and sappy sections. Fill nail holes with tinted exterior caulking compound after prime coat has been applied. Back prime concealed surfaces before installation.
- J. Metal Doors to be Painted: Prime metal door top and bottom edge surfaces.

3.03 APPLICATION

- A. Remove unfinished louvers, grilles, covers, and access panels on mechanical and electrical components and paint separately.
- B. Exterior Wood to Receive Opaque Finish: If final painting must be delayed more than 2 weeks after installation of woodwork, apply primer within 2 weeks and final coating within 4 weeks.
- C. Apply products in accordance with manufacturer's written instructions and recommendations in "MPI Architectural Painting Specification Manual".
- D. Where adjacent sealant is to be painted, do not apply finish coats until sealant is applied.
- E. Do not apply finishes to surfaces that are not dry. Allow applied coats to dry before next coat is applied.
- F. Apply each coat to uniform appearance.
- G. Dark Colors and Deep Clear Colors: Regardless of number of coats specified, apply additional coats until complete hide is achieved.
- H. Sand wood and metal surfaces lightly between coats to achieve required finish.
- I. Vacuum clean surfaces of loose particles. Use tack cloth to remove dust and particles just prior to applying next coat.
- J. Reinstall electrical cover plates, hardware, light fixture trim, escutcheons, and fittings removed prior to finishing.

3.04 CLEANING

- A. Collect waste material that could constitute a fire hazard, place in closed metal containers, and remove daily from site.

3.05 PROTECTION

- A. Protect finishes until completion of project.
- B. Touch-up damaged finishes after Substantial Completion.

3.06 SCHEDULE - PAINT SYSTEMS

- A. Shop-Primed Metal Items: Finish surfaces exposed to view.

END OF SECTION 09 91 13

NOT FOR BIDDING PURPOSES

This page intentionally left blank

**SECTION 09 91 23
INTERIOR PAINTING**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Surface preparation.
- B. Field application of paints.
- C. Materials for backpriming woodwork.
- D. Scope: Finish interior surfaces exposed to view, unless fully factory-finished and unless otherwise indicated.
 - 1. Prime surfaces to receive wall coverings.
 - 2. Mechanical and Electrical:
 - a. In finished areas, paint insulated and exposed pipes, conduit, boxes, insulated and exposed ducts, hangers, brackets, collars and supports, mechanical equipment, and electrical equipment, unless otherwise indicated.
 - b. In finished areas, paint shop-primed items.
 - c. Paint interior surfaces of air ducts and convectors and baseboard heating cabinets that are visible through grilles and louvers with one coat of flat black paint to visible surfaces.
 - d. Paint dampers exposed behind louvers, grilles, and convectors and baseboard cabinets to match face panels.
- E. Do Not Paint or Finish the Following Items.
 - 1. Items factory-finished unless otherwise indicated; materials and products having factory-applied primers are not considered factory finished.
 - 2. Items indicated to receive other finishes.
 - 3. Items indicated to remain unfinished.
 - 4. Fire rating labels, equipment serial number and capacity labels, bar code labels, and operating parts of equipment.
 - 5. Stainless steel, anodized aluminum, bronze, terne-coated stainless steel, and lead items.
 - 6. Floors, unless specifically indicated.
 - 7. Glass.
 - 8. Concealed pipes, ducts, and conduits.

1.02 RELATED REQUIREMENTS

- A. Section 01 61 16 - Volatile Organic Compound (VOC) Content Restrictions.
- B. Section 05 50 00 - Metal Fabrications: Shop-primed items.
- C. Section 05 51 00 - Metal Stairs: Shop-primed items.
- D. Section 09 91 13 - Exterior Painting.
- E. Section 09 96 00 - High-Performance Coatings.
- F. Section 21 05 53 - Identification for Fire Suppression Piping and Equipment: Painted identification.
- G. Section 21 05 53 - Identification for Fire Suppression Piping and Equipment: Color coding scheme for items to be painted under this section.
- H. Section 22 05 53 - Identification for Plumbing Piping and Equipment: Painted identification.
- I. Section 22 05 53 - Identification for Plumbing Piping and Equipment: Color coding scheme for items to be painted under this section.
- J. Section 23 05 53 - Identification for HVAC Piping and Equipment: Painted identification.

- K. Section 23 05 53 - Identification for HVAC Piping and Equipment: Color coding scheme for items to be painted under this section.
- L. Section 26 05 53 - Identification for Electrical Systems: Painted identification.
- M. Section 26 05 53 - Identification for Electrical Systems: Color coding scheme for items to be painted under this section.
- N. Section 32 17 23 - Pavement Markings: Painted pavement markings.

1.03 DEFINITIONS

- A. Comply with ASTM D16 for interpretation of terms used in this section.

1.04 REFERENCE STANDARDS

- A. ASTM D16 - Standard Terminology for Paint, Related Coatings, Materials, and Applications; 2024.
- B. ASTM D4442 - Standard Test Methods for Direct Moisture Content Measurement of Wood and Wood-Based Materials; 2020 (Reapproved 2025).
- C. MPI (APSM) - Master Painters Institute Architectural Painting Specification Manual; Current Edition.
- D. SSPC-SP 1 - Solvent Cleaning; 2015, with Editorial Revision (2016).
- E. SSPC-SP 2 - Hand Tool Cleaning; 2024.
- F. SSPC-SP 6/NACE No.3 - Commercial Blast Cleaning; 2006.

1.05 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide complete list of products to be used, with the following information for each:
 - 1. Manufacturer's name, product name and/or catalog number, and general product category (e.g., "alkyd enamel").
 - 2. MPI product number (e.g., MPI #47).
 - 3. Cross-reference to specified paint system products to be used in project; include description of each system.
 - 4. Manufacturer's installation instructions.
 - 5. If proposal of substitutions is allowed under submittal procedures, explanation of substitutions proposed.
- C. Samples: Submit three paper "draw down" samples, 8-1/2 by 11 inches (216 by 279 mm) in size, illustrating range of colors available for each finishing product specified.
 - 1. Where sheen is specified, submit samples in only that sheen.
- D. Certification: By manufacturer that paints and finishes comply with VOC limits specified.
- E. Manufacturer's Instructions: Indicate special surface preparation procedures.
- F. Maintenance Data: Submit data including finish schedule showing where each product/color/finish was used, product technical data sheets, material safety data sheets (MSDS), care and cleaning instructions, touch-up procedures, repair of painted and finished surfaces, and color samples of each color and finish used.
- G. Maintenance Materials: Furnish the following for Owner's use in maintenance of project.
 - 1. See Section 01 60 00 - Product Requirements, for additional provisions.
 - 2. Extra Paint and Finish Materials: 1 gal (4 L) of each color; from the same product run, store where directed.
 - 3. Label each container with color in addition to the manufacturer's label.

1.06 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing the products specified, with minimum 10 years documented experience.
- B. Applicator Qualifications: Company specializing in performing the type of work specified with minimum 5 years experience and approved by manufacturer.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. Deliver products to site in sealed and labeled containers; inspect to verify acceptability.
- B. Container Label: Include manufacturer's name, type of paint, brand name, lot number, brand code, coverage, surface preparation, drying time, cleanup requirements, color designation, and instructions for mixing and reducing.
- C. Paint Materials: Store at minimum ambient temperature of 45 degrees F (7 degrees C) and a maximum of 90 degrees F (32 degrees C), in ventilated area, and as required by manufacturer's instructions.

1.08 FIELD CONDITIONS

- A. Do not apply materials when surface and ambient temperatures are outside the temperature ranges required by the paint product manufacturer.
- B. Follow manufacturer's recommended procedures for producing best results, including testing of substrates, moisture in substrates, and humidity and temperature limitations.
- C. Do not apply materials when relative humidity exceeds 85 percent, at temperatures less than 5 degrees F (3 degrees C) above the dew point, or to damp or wet surfaces.
- D. Minimum Application Temperatures for Paints: 50 degrees F (10 degrees C) for interiors unless required otherwise by manufacturer's instructions.
- E. Provide lighting level of 80 fc (860 lux) measured mid-height at substrate surface.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Provide paints and finishes used in any individual system from the same manufacturer; no exceptions.
- B. Paints:
 - 1. Pittsburgh Paints: www.pittsburghpaintsco.com/#sle.
 - 2. Sherwin-Williams Company: www.sherwin-williams.com/#sle. (Basis of Design)
- C. Primer Sealers: Same manufacturer as top coats.
- D. Substitutions: See Section 01 60 00 - Product Requirements.

2.02 PAINTS AND FINISHES - GENERAL

- A. Paints and Finishes: Ready-mixed, unless intended to be a field-catalyzed paint.
 - 1. Provide paints and finishes of a soft paste consistency, capable of being readily and uniformly dispersed to a homogeneous coating, with good flow and brushing properties, and capable of drying or curing free of streaks or sags.
 - 2. Supply each paint material in quantity required to complete entire project's work from a single production run.
 - 3. Do not reduce, thin, or dilute paint or finishes or add materials unless such procedure is specifically described in manufacturer's product instructions.
- B. Volatile Organic Compound (VOC) Content: See Section 01 61 16.
- C. Flammability: Comply with applicable code for surface burning characteristics.
- D. Sheens: Provide the sheens specified; where sheen is not specified, sheen will be selected later by Architect from the manufacturer's full line.

- E. Colors: To be selected from manufacturer's full range of available colors.
 - 1. Selection to be made by Architect after award of contract.
 - 2. In finished areas, finish pipes, ducts, conduit, and equipment the same color as the wall/ceiling under which they are mounted.
 - 3. In utility areas, finish equipment, piping, conduit, and exposed duct work in colors according to the color coding scheme indicated.

2.03 PAINT SYSTEMS - INTERIOR

- A. Paint I-OP - Interior Surfaces to be Painted, Unless Otherwise Indicated: Including gypsum board, concrete, concrete masonry units, brick, wood, plaster, uncoated steel, shop primed steel, galvanized steel, aluminum, and acoustical ceilings.
 - 1. Two top coats and one coat primer.

2.04 PRIMERS

- A. Primers: Provide the following unless other primer is required or recommended by manufacturer of top coats.
 - 1. Alkali Resistant Water Based Primer; MPI #3.
 - a. Products:
 - 1) Sherwin-Williams Loxon Concrete and Masonry Primer Sealer, LX02W50. (MPI #3)
 - 2. Interior/Exterior Latex Block Filler; MPI #4.
 - a. Products:
 - 1) Sherwin-Williams Loxon Block Surfacer. (MPI #4)
 - 3. Interior Rust-Inhibitive Water Based Primer, MPI #107.
 - 4. Alkyd Primer for Galvanized Metal

2.05 ACCESSORY MATERIALS

- A. Accessory Materials: Provide primers, sealers, cleaning agents, cleaning cloths, sanding materials, and clean-up materials as required for final completion of painted surfaces.
- B. Patching Material: Latex filler.
- C. Fastener Head Cover Material: Latex filler.

PART 3 EXECUTION

3.01 INSTALLERS

- A. Acceptable Applicators:

3.02 EXAMINATION

- A. Do not begin application of paints and finishes until substrates have been adequately prepared.
- B. Verify that surfaces are ready to receive work as instructed by the product manufacturer.
- C. Examine surfaces scheduled to be finished prior to commencement of work. Report any condition that may potentially affect proper application.
- D. If substrate preparation is the responsibility of another installer, notify Architect of unsatisfactory preparation before proceeding.
- E. Test shop-applied primer for compatibility with subsequent cover materials.
- F. Measure moisture content of surfaces using an electronic moisture meter. Do not apply finishes unless moisture content of surfaces is below the following maximums:
 - 1. Gypsum Wallboard: 12 percent.
 - 2. Interior Wood: 15 percent, measured in accordance with ASTM D4442.

3.03 PREPARATION

- A. Clean surfaces thoroughly and correct defects prior to application.

- B. Prepare surfaces using the methods recommended by the manufacturer for achieving the best result for the substrate under the project conditions.
- C. Remove or repair existing paints or finishes that exhibit surface defects.
- D. Remove or mask surface appurtenances, including electrical plates, hardware, light fixture trim, escutcheons, and fittings, prior to preparing surfaces or finishing.
- E. Seal surfaces that might cause bleed through or staining of topcoat.
- F. Remove mildew from impervious surfaces by scrubbing with solution of tetra-sodium phosphate and bleach. Rinse with clean water and allow surface to dry.
- G. Gypsum Board: Fill minor defects with filler compound. Spot prime defects after repair.
- H. Galvanized Surfaces:
 - 1. Remove surface contamination and oils and wash with solvent according to SSPC-SP 1.
 - 2. Prepare surface according to SSPC-SP 2.
- I. Ferrous Metal:
 - 1. Solvent clean according to SSPC-SP 1.
 - 2. Shop-Primed Surfaces: Sand and scrape to remove loose primer and rust. Feather edges to make touch-up patches inconspicuous. Clean surfaces with solvent. Prime bare steel surfaces. Re-prime entire shop-primed item.
 - 3. Remove rust, loose mill scale, and other foreign substances using methods recommended in writing by paint manufacturer and blast cleaning in accordance with SSPC-SP 6/NACE No.3. Protect from corrosion until coated.
- J. Wood Surfaces to Receive Opaque Finish: Wipe off dust and grit prior to priming. Seal knots, pitch streaks, and sappy sections with sealer. Fill nail holes and cracks after primer has dried; sand between coats. Back prime concealed surfaces before installation.
- K. Metal Doors to be Painted: Prime metal door top and bottom edge surfaces.

3.04 APPLICATION

- A. Remove unfinished louvers, grilles, covers, and access panels on mechanical and electrical components and paint separately.
- B. Apply products in accordance with manufacturer's written instructions and recommendations in "MPI Architectural Painting Specification Manual".
- C. Where adjacent sealant is to be painted, do not apply finish coats until sealant is applied.
- D. Do not apply finishes to surfaces that are not dry. Allow applied coats to dry before next coat is applied.
- E. Apply each coat to uniform appearance in thicknesses specified by manufacturer.
- F. Dark Colors and Deep Clear Colors: Regardless of number of coats specified, apply as many coats as necessary for complete hide.
- G. Sand wood and metal surfaces lightly between coats to achieve required finish.
- H. Vacuum clean surfaces of loose particles. Use tack cloth to remove dust and particles just prior to applying next coat.
- I. Reinstall electrical cover plates, hardware, light fixture trim, escutcheons, and fittings removed prior to finishing.

3.05 CLEANING

- A. Collect waste material that could constitute a fire hazard, place in closed metal containers, and remove daily from site.

3.06 PROTECTION

- A. Protect finishes until completion of project.
- B. Touch-up damaged finishes after Substantial Completion.

3.07 SCHEDULE - PAINT SYSTEMS

- A. Gypsum Board: Finish surfaces exposed to view.
- B. Wood: Finish surfaces exposed to view.
- C. Steel Doors and Frames: Finish surfaces exposed to view; MI-OP-3A, gloss.
- D. Steel Fabrications: Finish surfaces exposed to view and to concealed surfaces where required to conform to performance requirements and resist corrosion.
- E. Galvanized Steel: Finish surfaces exposed to view.
- F. Shop-Primed Metal Items: Finish surfaces exposed to view.
- G. Wall Surfaces Under Vinyl Wall Covering: GI-P-1A.
- H. Pipe and Duct Insulation Jackets: Finish surfaces exposed to view; EI-OP-2L, flat.

END OF SECTION 09 91 23

NOT FOR BIDDING PURPOSES

**SECTION 23 05 13
COMMON MOTOR REQUIREMENTS FOR HVAC EQUIPMENT**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. General construction and requirements.
- B. Three phase electric motors.
- C. Electronically Commutated Motors (ECM).

1.02 RELATED REQUIREMENTS

- A. Section 26 05 83 - Wiring Connections: Electrical characteristics and wiring connections.

1.03 REFERENCE STANDARDS

- A. ABMA STD 9 - Load Ratings and Fatigue Life for Ball Bearings; 2015 (Reaffirmed 2020).
- B. IEEE 112 - IEEE Standard Test Procedure for Polyphase Induction Motors and Generators; 2004.
- C. NEMA MG 00001 - Motors and Generators; 2024.
- D. NFPA 70 - National Electrical Code; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.

1.04 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements for submittal procedures.
- B. Product Data: Provide wiring diagrams with electrical characteristics and connection requirements.
- C. Test Reports: Indicate test results verifying nominal efficiency and power factor for three phase motors larger than 1/2 horsepower.
- D. Manufacturer's Installation Instructions: Indicate setting, mechanical connections, lubrication, and wiring instructions.
- E. Operation Data: Include instructions for safe operating procedures.
- F. Maintenance Data: Include assembly drawings, bearing data including replacement sizes, and lubrication instructions.

1.05 QUALITY ASSURANCE

- A. Comply with NFPA 70.
- B. Products Requiring Electrical Connection: Listed and classified by Underwriters Laboratories Inc. as suitable for the purpose specified and indicated.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. Protect motors stored on site from weather and moisture by maintaining factory covers and suitable weather-proof covering. For extended outdoor storage, remove motors from equipment and store separately.

PART 2 PRODUCTS

2.01 GENERAL CONSTRUCTION AND REQUIREMENTS

- A. Electrical Service:
 - 1. Motors 1/2 HP and Smaller: 115 volts, single phase, 60 Hz.
 - 2. Motors Larger than 1/2 Horsepower: 208 or 460 volts, three phase, 60 Hz.
 - 3. Verify facility voltage availability prior to final motor selection.
- B. Construction:
 - 1. Open drip-proof type except where specifically noted otherwise.
 - 2. Design for continuous operation in 104 degrees F environment.

3. Design for temperature rise in accordance with NEMA MG 00001 limits for insulation class, service factor, and motor enclosure type.
- C. Visible Nameplate: Indicating motor horsepower, voltage, phase, cycles, RPM, full load amps, locked rotor amps, frame size, manufacturer's name and model number, service factor, power factor, efficiency.
- D. Wiring Terminations:
 1. Provide terminal lugs to match branch circuit conductor quantities, sizes, and materials indicated. Enclose terminal lugs in terminal box sized to NFPA 70, threaded for conduit.
 2. For fractional horsepower motors where connection is made directly, provide threaded conduit connection in end frame.

2.02 THREE PHASE POWER - SQUIRREL CAGE MOTORS

- A. Starting Torque: Between 1 and 1-1/2 times full load torque.
- B. Starting Current: Six times full load current.
- C. Power Output, Locked Rotor Torque, Breakdown or Pull Out Torque: NEMA Design B characteristics.
- D. Design, Construction, Testing, and Performance: Comply with NEMA MG 00001 for Design B motors.
- E. Insulation System: NEMA Class B or better.
- F. Testing Procedure: In accordance with IEEE 112. Load test motors to determine free from electrical or mechanical defects in compliance with performance data.
- G. Bearings: Grease lubricated anti-friction ball bearings with housings equipped with plugged provision for relubrication, rated for minimum ABMA STD 9, L-10 life of 20,000 hours. Calculate bearing load with NEMA minimum V-belt pulley with belt center line at end of NEMA standard shaft extension. Stamp bearing sizes on nameplate.
- H. Sound Power Levels: To NEMA MG 00001.
- I. Motors to be used with AC drives shall be inverter duty rated and shall conform to the following:
 1. All motors used with AC drives shall be equipped with thermostats in the stator windings.
 2. The motor shall meet NEMA MG-1, Part 31 standards.
 - a. 1600 Volt rated magnet wire.

2.03 ELECTRONICALLY COMMUTATED MOTORS (ECM)

- A. Applications:

PART 3 EXECUTION

3.01 INSTALLATION

- A. Install in accordance with manufacturer's instructions.
- B. Install securely on firm foundation. Mount ball bearing motors with shaft in any position.
- C. Check line voltage and phase and ensure agreement with nameplate.

END OF SECTION

SECTION 23 05 17
SLEEVES AND SLEEVE SEALS FOR HVAC PIPING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Pipe sleeves.
- B. Pipe-sleeve seals.

1.02 RELATED REQUIREMENTS

- A. Section 23 05 23 - General-Duty Valves for HVAC Piping.
- B. Section 23 05 53 - Identification for HVAC Piping and Equipment: Piping identification.
- C. Section 23 07 16 - HVAC Equipment Insulation.
- D. Section 23 07 19 - HVAC Piping Insulation.

1.03 REFERENCE STANDARDS

- A. ASTM C592 - Standard Specification for Mineral Fiber Blanket Insulation and Blanket-Type Pipe Insulation (Metal-Mesh Covered) (Industrial Type); 2024.
- B. ASTM E814 - Standard Test Method for Fire Tests of Through-Penetration Fire Stops; 2013a.
- C. FM (AG) - FM Approval Guide; Current Edition.
- D. UL (DIR) - Online Certifications Directory; Current Edition.

1.04 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements for submittal procedures.

1.05 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing the Products specified in this section with minimum three years documented experience.

1.06 WARRANTY

- A. See Section 01 78 00 - Closeout Submittals, for additional warranty requirements.

PART 2 PRODUCTS

2.01 PIPE SLEEVES

- A. Manufacturers:
 - 1. Flexicraft Industries; Pipe Wall Sleeve: www.flexicraft.com/#sle.
 - 2. Ferguson; www.ferguson.com
 - 3. Fernco; www.fernco.com
- B. Substitutions: See Section 01 60 00 - Product Requirements.
- C. Vertical Piping:
 - 1. Sleeve Length: 1 inch above finished floor.
 - 2. Provide sealant for watertight joint.
 - 3. Blocked Out Floor Openings: Provide 1-1/2 inch angle set in silicon adhesive around opening.
 - 4. Drilled Penetrations: Provide 1-1/2 inch angle ring or square set in silicone adhesive around penetration.
- D. Plastic or Sheet Metal: Pipe passing through interior walls, partitions, and floors, unless steel or brass sleeves are specified below.
- E. Pipe Passing Through Below Grade Exterior Walls:
 - 1. Zinc coated or cast iron pipe.
 - 2. Provide watertight space with link rubber or modular seal between sleeve and pipe on both pipe ends.

- F. Clearances:
 - 1. Provide allowance for insulated piping.
 - 2. Wall, Floor, Partitions, and Beam Flanges: 1 inch greater than external pipe diameter.
 - 3. All Rated Openings: Caulked tight with fire stopping material in compliance with ASTM E814 in accordance with Section 07 84 00 to prevent the spread of fire, smoke, and gases.

2.02 PIPE-SLEEVE SEALS

- A. Manufacturers:
 - 1. Advance Products & Systems, LLC; Innerlynx: www.apsonline.com/#sle.
 - 2. American Polywater Corporation; PGKD Modular Seals: www.polywater-haufftechnik.com/#sle.
 - 3. Flexicraft Industries; PipeSeal: www.flexicraft.com/#sle.
 - 4. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Modular Mechanical Sleeve-Seal:
 - 1. Elastomer-based interlocking links continuously fill annular space between pipe and wall-sleeve, wall or casing opening.
 - 2. Watertight seal between pipe and wall-sleeve, wall or casing opening.
 - 3. Size and select seal component materials in accordance with service requirements.
 - 4. Glass-reinforced plastic pressure end plates.
- C. Sealing Compounds:
 - 1. Provide packing and sealing compound to fill pipe to sleeve thickness.
 - 2. Combined packing and seal compound is to match partition fire-resistance hourly rating.
- D. Pipe Sleeve Material:
 - 1. Bearing Walls: Steel, cast iron, or terra-cotta pipe.
 - 2. Masonry Structures: Sheet metal or fiber.
- E. Wall Sleeve: PVC material with waterstop collar, and nailer end-caps.

PART 3 EXECUTION

3.01 INSTALLATION

- A. Route piping in orderly manner, plumb and parallel to building structure. Maintain gradient.
- B. Install piping to conserve building space, to not interfere with use of space and other work.
- C. Install piping and pipe sleeves to allow for expansion and contraction without stressing pipe, joints, or connected equipment.
- D. Inserts:
 - 1. Provide inserts for placement in concrete formwork.
- E. Structural Considerations:
 - 1. Do not penetrate building structural members unless indicated.
- F. Provide sleeves when penetrating footings, floors, walls, and partitions. Seal pipe including sleeve penetrations to achieve fire resistance equivalent to fire separation required.
 - 1. Underground Piping: Caulk pipe sleeve watertight with lead and oakum or mechanically expandable chloroprene inserts with bitumen sealed metal components.
 - 2. Aboveground Piping:
 - a. Pack solid using mineral fiber in compliance with ASTM C592.
 - b. Fill space with an elastomer caulk to a depth of 0.50 inch where penetrations occur between conditioned and unconditioned spaces.
 - 3. All Rated Openings: Caulk tight with fire stopping material in compliance with ASTM E814 in accordance with Section 07 84 00 to prevent the spread of fire, smoke, and gases.
 - 4. Caulk exterior wall sleeves watertight with lead and oakum or mechanically expandable chloroprene inserts with mastic-sealed components.
- G. Manufactured Sleeve-Seal Systems:

1. Install manufactured sleeve-seal systems in sleeves located in grade slabs and exterior concrete walls at piping entrances into building.
 2. Provide sealing elements of the size, quantity, and type required for the piping and sleeve inner diameter or penetration diameter.
 3. Locate piping in center of sleeve or penetration.
 4. Install field assembled sleeve-seal system components in annular space between sleeve and piping.
 5. Tighten bolting for a water-tight seal.
 6. Install in accordance with manufacturer's recommendations.
- H. When installing more than one piping system material, ensure system components are compatible and joined to ensure the integrity of the system. Provide necessary joining fittings. Ensure flanges, union, and couplings for servicing are consistently provided.

3.02 CLEANING

- A. Upon completion of work, clean all parts of the installation.
- B. Clean equipment, pipes, valves, and fittings of grease, metal cuttings, and sludge that may have accumulated from the installation and testing of the system.
- C. See Section 01 74 19 - Construction Waste Management and Disposal, for additional requirements.

END OF SECTION

THIS PAGE INTENTIONALLY LEFT BLANK

**SECTION 23 05 19
METERS AND GAUGES FOR HVAC PIPING**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Pressure gauges and pressure gauge taps.
- B. Thermometers and thermometer wells.
- C. Static pressure gauges.

1.02 RELATED REQUIREMENTS

- A. Section 23 21 13 - Hydronic Piping.

1.03 REFERENCE STANDARDS

- A. ASME B40.100 - Pressure Gauges and Gauge Attachments; 2022.
- B. ASTM E1 - Standard Specification for ASTM Liquid-in-Glass Thermometers; 2014 (Reapproved 2025).
- C. ASTM E77 - Standard Test Method for Inspection and Verification of Thermometers; 2014 (Reapproved 2021).
- D. UL 393 - Indicating Pressure Gauges for Fire-Protection Service; Current Edition, Including All Revisions.

1.04 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide list that indicates use, operating range, total range and location for manufactured components.
- C. Project Record Documents: Record actual locations of components and instrumentation.

PART 2 PRODUCTS

2.01 PRESSURE GAUGES

- A. Manufacturers:
 - 1. Dwyer Instruments, Inc: www.dwyer-inst.com.
 - 2. Moeller Instrument Company, Inc: www.moellerinstrument.com.
 - 3. Omega Engineering, Inc: www.omega.com.
 - 4. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Pressure Gauges: ASME B40.100, UL 393 drawn steel case, phosphor bronze bourdon tube, rotary brass movement, brass socket, with front recalibration adjustment, black scale on white background.
 - 1. Case: Steel with brass bourdon tube.
 - 2. Size: 4-1/2 inch diameter.
 - 3. Mid-Scale Accuracy: One percent.
 - 4. Scale: Psi.

2.02 PRESSURE GAUGE TAPPINGS

- A. Gauge Cock: Tee or lever handle, brass for maximum 150 psi.

2.03 STEM TYPE THERMOMETERS

- A. Manufacturers:
 - 1. Dwyer Instruments, Inc: www.dwyer-inst.com.
 - 2. Omega Engineering, Inc: www.omega.com.
 - 3. Weksler Glass Thermometer Corp: www.wekslerglass.com.
 - 4. Substitutions: See Section 01 60 00 - Product Requirements.

- B. Thermometers - Adjustable Angle: Red- or blue-appearing non-toxic liquid in glass; ASTM E1; lens front tube, cast aluminum case with enamel finish, cast aluminum adjustable joint with positive locking device; adjustable 360 degrees in horizontal plane, 180 degrees in vertical plane.
 - 1. Size: 9 inch scale.
 - 2. Window: Clear Lexan.
 - 3. Stem: 3/4 inch NPT brass.
 - 4. Accuracy: 2 percentper ASTM E77.
 - 5. Calibration: Degrees F.

2.04 THERMOMETER SUPPORTS

- A. Socket: Brass separable sockets for thermometer stems with or without extensions as required, and with cap and chain.
- B. Flange: 3 inch outside diameter reversible flange, designed to fasten to sheet metal air ducts, with brass perforated stem.

2.05 TEST PLUGS

- A. Test Plug: 1/4 inch or 1/2 inch brass fitting and cap for receiving 1/8 inch outside diameter pressure or temperature probe with neoprene core for temperatures up to 200 degrees F.

2.06 STATIC PRESSURE GAUGES

- A. Manufacturers:
 - 1. Dwyer Instruments, Inc: www.dwyer-inst.com.
 - 2. Omega Engineering, Inc: www.omega.com.
 - 3. Weksler Glass Thermometer Corp: www.wekslerglass.com.
 - 4. Substitutions: See Section 01 60 00 - Product Requirements.
- B. 3-1/2 inch diameter dial in metal case, diaphragm actuated, black figures on white background, front recalibration adjustment, 2 percent of full scale accuracy.

PART 3 EXECUTION

3.01 INSTALLATION

- A. Install in accordance with manufacturer's instructions.
- B. Provide one pressure gauge per pump, installing taps before strainers and on suction and discharge of pump. Pipe to gauge.
- C. Install pressure gauges with pulsation dampers. Provide gauge cock to isolate each gauge. Provide siphon on gauges in steam systems. Extend nipples and siphons to allow clearance from insulation.
- D. Install thermometers in piping systems in sockets in short couplings. Enlarge pipes smaller than 2-1/2 inch for installation of thermometer sockets. Ensure sockets allow clearance from insulation.
- E. Locate duct mounted thermometers minimum 10 feet downstream of mixing dampers, coils, or other devices causing air turbulence.
- F. Provide instruments with scale ranges selected according to service with largest appropriate scale.
- G. Install gauges and thermometers in locations where they are easily read from normal operating level. Install vertical to 45 degrees off vertical.
- H. Adjust gauges and thermometers to final angle, clean windows and lenses, and calibrate to zero.

END OF SECTION

SECTION 23 05 23
GENERAL-DUTY VALVES FOR HVAC PIPING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Ball valves.
- B. Check valves.

1.02 RELATED REQUIREMENTS

- A. Section 23 05 53 - Identification for HVAC Piping and Equipment.
- B. Section 23 07 19 - HVAC Piping Insulation.
- C. Section 23 21 13 - Hydronic Piping.

1.03 REFERENCE STANDARDS

- A. ASME B31.9 - Building Services Piping; 2020.
- B. ASTM A216/A216M - Standard Specification for Steel Castings, Carbon, Suitable for Fusion Welding, for High-Temperature Service; 2021.
- C. MSS SP-110 - Ball Valves Threaded, Socket-Welding, Solder Joint, Grooved and Flared Ends; 2010, with Errata .

1.04 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements for submittal procedures.
- B. Product Data: Provide data on valves including manufacturers catalog information. Submit performance ratings, rough-in details, weights, support requirements, and piping connections.

PART 2 PRODUCTS

2.01 APPLICATIONS

- A. Listed pipe sizes shown using nominal pipe sizes (NPS) and nominal diameter (DN).
- B. Provide the following valves for the applications if not indicated on drawings:
 - 1. Isolation (Shutoff): Butterfly, Gate, Ball, and Plug.
- C. Heating Hot Water Valves:
 - 1. Size 2 inch and Smaller, Brass and Bronze Valves:
 - a. Threaded ends.
 - 2. Size 2-1/2 inch and Larger, Iron Valves:
 - a. 2-1/2 inch to 4 inch: Threaded ends.

2.02 GENERAL REQUIREMENTS

- A. Valve Pressure and Temperature Ratings: No less than rating indicated; as required for system pressures and temperatures.
- B. Valve Sizes: Match upstream piping unless otherwise indicated.
- C. Valve Actuator Types:
 - 1. Hand Lever: Quarter-turn valves 6 inch and smaller.
- D. Valves in Insulated Piping: Provide 2 inch stem extensions and the following features:
 - 1. Ball Valves: Extended operating handle of non-thermal-conductive material, and protective sleeve that allows operation of valve without breaking the vapor seal or disturbing insulation.
- E. General ASME Compliance:
 - 1. Building Services Piping Valves: ASME B31.9.

2.03 BRASS, BALL VALVES

- A. Two Piece, Full Port with Stainless Steel Trim and Female Thread, Male thread, or Solder Connections:
 - 1. Comply with MSS SP-110.
 - 2. SWP Rating: 150 psi.
 - 3. WOG Rating: 600 psi.
 - 4. Vacuum Rating: 28.9 in-Hg.
 - 5. Body: Forged brass.
 - 6. Seats: PTFE.
 - 7. Stem: Stainless Steel.
 - 8. Ball: Chrome-plated brass.

2.04 BRONZE, BALL VALVES

- A. General:
 - 1. Fabricate from dezincification resistant material.
 - 2. Copper alloys containing more than 15 percent zinc are not permitted.
- B. Two Piece, Full Port with Bronze or Brass Trim:
 - 1. Comply with MSS SP-110.
 - 2. WSP Rating: 150 psi.
 - 3. WOG Rating: 400 psi.
 - 4. Body: Forged bronze or dezincified-brass alloy.
 - 5. End Connections: Pipe thread or solder.
 - 6. Seats: PTFE.

2.05 CARBON STEEL, BALL VALVES

- A. Class 150, Full Port, Stainless Steel Trim, Threaded with Lockable Handle:
 - 1. WOG Rating: 125 psi.
 - 2. WSP Rating: 150 psi.
 - 3. Vacuum Rating: 14.2 psi.
 - 4. Body: Carbon steel, ASTM A216/A216M.
 - 5. Seats: PTFE.
 - 6. Stem: Stainless steel.
 - 7. Ball: Stainless steel.
 - 8. Size: 1/4 to 2 inches.

PART 3 EXECUTION

3.01 INSTALLATION

- A. Provide unions or flanges with valves to facilitate equipment removal and maintenance while maintaining system operation and full accessibility for servicing.
- B. Provide separate valve support as required and locate valve with stem at or above center of piping, maintaining unimpeded stem movement.

END OF SECTION

**SECTION 23 05 48
VIBRATION AND SEISMIC CONTROLS FOR HVAC**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Vibration isolation requirements.
- B. Vibration-isolated equipment support bases.
- C. Inertia bases.
- D. Vibration isolators.

1.02 RELATED REQUIREMENTS

- A. Section 03 30 00 - Cast-in-Place Concrete.

1.03 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements for submittal procedures.
- B. Product Data: Provide schedule of vibration isolator type with location and load on each.
- C. Shop Drawings: Indicate inertia bases and locate vibration isolators, with static and dynamic load on each. Indicate seismic control measures.

1.04 QUALITY ASSURANCE

- A. Comply with applicable building code.
- B. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum three years documented experience.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Isolation Technology, Inc: www.isolationtech.com.
- B. Kinetics Noise Control, Inc: www.kineticsnoise.com.
- C. Mason Industries: www.mason-ind.com.
- D.

2.02 VIBRATION ISOLATORS

- A. Restrained Open Spring Isolators:
 - 1. Springs: Minimum horizontal stiffness equal to 75 percent vertical stiffness, with working deflection between 0.3 and 0.6 of maximum deflection. Color code springs for load carrying capacity.
 - 2. Spring Mounts: Provide with leveling devices, minimum 0.25 inch thick neoprene sound pads, and zinc chromate plated hardware.
 - 3. Sound Pads: Size for minimum deflection of 0.05 inch; meet requirements for neoprene pad isolators.
 - 4. Restraint: Provide heavy mounting frame and limit stops.
 - 5. For Exterior and Humid Areas: Hot dipped galvanized housings and neoprene coated springs.
- B. Spring Hangers:
 - 1. Springs: Minimum horizontal stiffness equal to 75 percent vertical stiffness, with working deflection between 0.3 and 0.6 of maximum deflection. Color code springs for load carrying capacity.
 - 2. Housings: Incorporate neoprene isolation pad meeting requirements for neoprene pad isolators.
 - 3. Misalignment: Capable of 20 degree hanger rod misalignment.
 - 4. For Exterior and Humid Areas: Hot dipped galvanized housings and neoprene coated springs.

- C. Neoprene Pad Isolators:
 - 1. Rubber or neoprene waffle pads.
 - a. Hardness: 30 durometer.
 - b. Thickness: Minimum 1/2 inch.
 - c. Maximum Loading: 50 psi.
 - d. Rib Height: Maximum 0.7 times width.
 - 2. Configuration: Single layer.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field measurements are as shown on the drawings.
- B. Verify that mounting surfaces are ready to receive vibration isolation and/or seismic control components and associated attachments.
- C. Verify that conditions are satisfactory for installation prior to starting work.

3.02 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.
- B. Install anchors and fasteners in accordance with ICC Evaluation Services, LLC (ICC-ES) evaluation report conditions of use where applicable.
- C. Secure fasteners according to manufacturer's recommended torque settings.
- D. Install flexible piping connections to provide sufficient slack for vibration isolation and/or seismic relative displacements as indicated or as required.

3.03 INSTALLATION - GENERAL

- A. Provide seismic snubbers for all equipment, piping, and ductwork mounted on isolators. Each inertia base shall have minimum of four seismic snubbers located close to isolators. Snub equipment designated for post-disaster use to 0.05 inch maximum clearance. Other snubbers shall have clearance between 0.15 inch and 0.25 inch.

3.04 FIELD QUALITY CONTROL

- A. See Section 01 40 00 - Quality Requirements, for additional requirements.
- B. Inspect vibration isolation and/or seismic control components for damage and defects.
- C. Correct deficiencies and replace damaged or defective vibration isolation and/or seismic control components.

3.05 SCHEDULE

- A. Equipment Isolation Schedule.

END OF SECTION

SECTION 23 05 53
IDENTIFICATION FOR HVAC PIPING AND EQUIPMENT

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Nameplates.
- B. Tags.
- C. Pipe markers.
- D. Ceiling tacks.
- E. Ceiling Tacks

1.02 REFERENCE STANDARDS

- A. ASME A13.1 - Scheme for the Identification of Piping Systems; 2023.

1.03 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements for submittal procedures.
- B. List: Submit list of wording, symbols, letter size, and color coding for mechanical identification.
- C. Chart and Schedule: Submit valve chart and schedule, including valve tag number, location, function, and valve manufacturer's name and model number.
- D. Product Data: Provide manufacturers catalog literature for each product required.
- E. Manufacturer's Installation Instructions: Indicate special procedures, and installation.
- F. Project Record Documents: Record actual locations of tagged valves.

PART 2 PRODUCTS

2.01 IDENTIFICATION APPLICATIONS

- A. Air Handling Units: Nameplates.
- B. Air Terminal Units: Tags.
- C. Control Panels: Nameplates.
- D. Heat Transfer Equipment: Nameplates.
- E. Major Control Components: Nameplates.
- F. Piping: Tags.
- G. Pumps: Nameplates.
- H. Valves: Tags and ceiling tacks where located above lay-in ceiling.
- I. Water Treatment Devices: Nameplates.

2.02 MANUFACTURERS

- A. Brady Corporation: www.bradycorp.com.
- B. Champion America, Inc: www.Champion-America.com.
- C. Seton Identification Products: www.seton.com/aec.
- D. Substitutions: See Section 01 60 00 - Product Requirements.

2.03 NAMEPLATES

- A. Description: Laminated three-layer plastic with engraved letters.
 - 1. Letter Color: White.
 - 2. Letter Height: 1/4 inch.
 - 3. Background Color: Black.

2.04 TAGS

- A. Plastic Tags: Laminated three-layer plastic with engraved black letters on light contrasting background color. Tag size minimum 1-1/2 inch diameter.
- B. Metal Tags: Brass with stamped letters; tag size minimum 1-1/2 inch diameter with smooth edges.
- C. Valve Tag Chart: Typewritten letter size list in anodized aluminum frame.

2.05 PIPE MARKERS

- A. Color: Comply with ASME A13.1.
- B. Plastic Pipe Markers: Factory fabricated, flexible, semi-rigid plastic, preformed to fit around pipe or pipe covering; minimum information indicating flow direction arrow and identification of fluid being conveyed.

2.06 CEILING TACKS

- A. Description: Steel with 3/4 inch diameter color coded head.
- B. Color code as follows:
 - 1. HVAC Equipment: Yellow.
 - 2. Fire Dampers and Smoke Dampers: Red.
 - 3. Heating/Cooling Valves: Blue.

PART 3 EXECUTION

3.01 PREPARATION

- A. Degrease and clean surfaces to receive adhesive for identification materials.

3.02 INSTALLATION

- A. Install nameplates with corrosive-resistant mechanical fasteners, or adhesive. Apply with sufficient adhesive to ensure permanent adhesion and seal with clear lacquer.
- B. Install tags with corrosion resistant chain.
- C. Install plastic pipe markers in accordance with manufacturer's instructions.
- D. Install underground plastic pipe markers 6 to 8 inches below finished grade, directly above buried pipe.
- E. Identify air handling units, pumps, heat transfer equipment, tanks, and water treatment devices with plastic nameplates. Small devices, such as in-line pumps, may be identified with tags.
- F. Identify control panels and major control components outside panels with plastic nameplates.
- G. Identify thermostats relating to terminal boxes or valves with nameplates.
- H. Identify valves in main and branch piping with tags.
- I. Locate ceiling tacks to locate valves or dampers above lay-in panel ceilings. Locate in corner of panel closest to equipment.

END OF SECTION

SECTION 23 05 93
TESTING, ADJUSTING, AND BALANCING FOR HVAC

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Testing, adjustment, and balancing of air systems.
- B. Testing, adjustment, and balancing of hydronic systems.
- C. Measurement of final operating condition of HVAC systems.
- D. Commissioning activities.

1.02 RELATED REQUIREMENTS

- A. Section 01 40 00 - Quality Requirements: Employment of testing agency and payment for services.
- B. Section 01 91 13 - General Commissioning Requirements: Commissioning requirements that apply to all types of work.
- C. Section 23 08 00 - Commissioning of HVAC.

1.03 REFERENCE STANDARDS

- A. ASHRAE Std 111 - Measurement, Testing, Adjusting, and Balancing of Building HVAC Systems; 2008.
- B. NEBB (TAB) - Procedural Standards for Testing Adjusting and Balancing of Environmental Systems; 2015, Eighth Edition.
- C. SMACNA (TAB) - HVAC Systems Testing, Adjusting and Balancing; 2002.

1.04 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. TAB Plan: Submit a written plan indicating the testing, adjusting, and balancing standard to be followed and the specific approach for each system and component.
 - 1. Submit to DEDC, LLC.
 - 2. Include at least the following in the plan:
 - a. List of all air flow, water flow, sound level, system capacity and efficiency measurements to be performed and a description of specific test procedures, parameters, formulas to be used.
 - b. Copy of field checkout sheets and logs to be used, listing each piece of equipment to be tested, adjusted and balanced with the data cells to be gathered for each.
 - c. Discussion of what notations and markings will be made on the duct and piping drawings during the process.
 - d. Final test report forms to be used.
 - e. Detailed step-by-step procedures for TAB work for each system and issue, including:
 - 1) Terminal flow calibration (for each terminal type).
 - 2) Diffuser proportioning.
 - 3) Branch/submain proportioning.
 - 4) Total flow calculations.
 - 5) Rechecking.
 - 6) Diversity issues.
 - f. Expected problems and solutions, etc.
 - g. Details of how TOTAL flow will be determined; for example:
 - 1) Air: Sum of terminal flows via control system calibrated readings or via hood readings of all terminals, supply (SA) and return air (RA) pitot traverse, SA or RA flow stations.
 - 2) Water: Pump curves, circuit setter, flow station, ultrasonic, etc.

- h. Confirmation of understanding of the outside air ventilation criteria under all conditions.
 - i. Method of verifying and setting minimum outside air flow rate will be verified and set and for what level (total building, zone, etc.).
 - j. Procedures for formal deficiency reports, including scope, frequency and distribution.
- C. Final Report: Indicate deficiencies in systems that would prevent proper testing, adjusting, and balancing of systems and equipment to achieve specified performance.
 - 1. Revise TAB plan to reflect actual procedures and submit as part of final report.
 - 2. Submit draft copies of report for review prior to final acceptance of Project. Provide final copies for DEDC, LLC and for inclusion in operating and maintenance manuals.
 - 3. Include actual instrument list, with manufacturer name, serial number, and date of calibration.
 - 4. Form of Test Reports: Where the TAB standard being followed recommends a report format use that; otherwise, follow ASHRAE Std 111.
 - 5. Units of Measure: Report data in both I-P (inch-pound) and SI (metric) units.
 - 6. Include the following on the title page of each report:
 - a. Name of Testing, Adjusting, and Balancing Agency.
 - b. Address of Testing, Adjusting, and Balancing Agency.
 - c. Telephone number of Testing, Adjusting, and Balancing Agency.
 - d. Project name.
 - e. Project location.
 - f. Project Engineer.
 - g. Project Contractor.
 - h. Report date.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION

3.01 GENERAL REQUIREMENTS

- A. TAB contractor shall review all of the drawings with special attention to the controls drawings as there is additional instruction on the drawings and sequence of operation as to how balancing shall be performed and what information the controls contractor is required to obtain.
- B. TAB contractor shall perform ductwork leak tests prior to installation of ceiling. TAB contractor shall schedule this work thru the mechanical contractor.
- C. Perform total system balance in accordance with one of the following:
 - 1. SMACNA (TAB).
- D. Begin work after completion of systems to be tested, adjusted, or balanced and complete work prior to Substantial Completion of the project.
- E. Where HVAC systems and/or components interface with life safety systems, including fire and smoke detection, alarm, and control, coordinate scheduling and testing and inspection procedures with the authorities having jurisdiction.
- F. TAB Agency Qualifications:
 - 1. Company specializing in the testing, adjusting, and balancing of systems specified in this section.
 - 2. Certified by one of the following:
 - a. TABB, The Testing, Adjusting, and Balancing Bureau of National Energy Management Institute: www.tabbcertified.org/#sle.
- G. TAB Supervisor and Technician Qualifications: Certified by same organization as TAB agency.

3.02 EXAMINATION

- A. Verify that systems are complete and operable before commencing work. Ensure the following conditions:
 - 1. Systems are started and operating in a safe and normal condition.

2. Temperature control systems are installed complete and operable.
 3. Proper thermal overload protection is in place for electrical equipment.
 4. Final filters are clean and in place. If required, install temporary media in addition to final filters.
 5. Duct systems are clean of debris.
 6. Fans are rotating correctly.
 7. Fire and volume dampers are in place and open.
 8. Air coil fins are cleaned and combed.
 9. Access doors are closed and duct end caps are in place.
 10. Air outlets are installed and connected.
 11. Duct system leakage is minimized.
 12. Hydronic systems are flushed, filled, and vented.
 13. Pumps are rotating correctly.
 14. Proper strainer baskets are clean and in place.
 15. Service and balance valves are open.
- B. Submit field reports. Report defects and deficiencies that will or could prevent proper system balance.
- C. Beginning of work means acceptance of existing conditions.

3.03 PREPARATION

- A. Hold a pre-balancing meeting at least one week prior to starting TAB work.
1. Require attendance by all installers whose work will be tested, adjusted, or balanced.
- B. Provide instruments required for testing, adjusting, and balancing operations. Make instruments available to DEDC, LLC to facilitate spot checks during testing.

3.04 ADJUSTMENT TOLERANCES

- A. Air Handling Systems: Adjust to within plus or minus 5 percent of design for supply systems and plus or minus 10 percent of design for return and exhaust systems.
- B. Hydronic Systems: Adjust to within plus or minus 10 percent of design.

3.05 RECORDING AND ADJUSTING

- A. Ensure recorded data represents actual measured or observed conditions.
- B. Permanently mark settings of valves, dampers, and other adjustment devices allowing settings to be restored. Set and lock memory stops.
- C. After adjustment, take measurements to verify balance has not been disrupted or that such disruption has been rectified.
- D. Leave systems in proper working order, replacing belt guards, closing access doors, closing doors to electrical switch boxes, and restoring thermostats to specified settings.

3.06 AIR SYSTEM PROCEDURE

- A. Adjust air handling and distribution systems to provide required or design supply, return, and exhaust air quantities at site altitude.
- B. Make air quantity measurements in ducts by Pitot tube traverse of entire cross sectional area of duct.
- C. Measure air quantities at air inlets and outlets.
- D. Adjust distribution system to obtain uniform space temperatures free from objectionable drafts and noise.
- E. Use volume control devices to regulate air quantities only to extend that adjustments do not create objectionable air motion or sound levels. Effect volume control by duct internal devices such as dampers and splitters.

- F. Vary total system air quantities by adjustment of fan speeds. Provide drive changes required. Vary branch air quantities by damper regulation.
- G. For all belt driven fans provide adjustable sheave during balancing process, and then permanent sheave once balancing is complete.

3.07 WATER SYSTEM PROCEDURE

- A. Adjust water systems to provide required or design quantities.
- B. Use calibrated Venturi tubes, orifices, or other metered fittings and pressure gauges to determine flow rates for system balance. Where flow metering devices are not installed, base flow balance on temperature difference across various heat transfer elements in the system.
- C. Adjust systems to provide specified pressure drops and flows through heat transfer elements prior to thermal testing. Perform balancing by measurement of temperature differential in conjunction with air balancing.
- D. Effect system balance with automatic control valves fully open to heat transfer elements.
- E. Effect adjustment of water distribution systems by means of balancing cocks, valves, and fittings. Do not use service or shut-off valves for balancing unless indexed for balance point.

3.08 COMMISSIONING

- A. See Sections 01 91 13 - General Commissioning Requirements and 23 08 00 for additional requirements.
- B. Perform prerequisites prior to starting commissioning activities.
- C. Fill out Prefunctional Checklists for:
 - 1. Air side systems.
 - 2. Water side systems.
- D. Furnish to the Commissioning Authority, upon request, any data gathered but not shown in the final TAB report.
- E. Re-check a random sample equivalent to 10 percent of the final TAB report data as directed by Commissioning Authority.
 - 1. Original TAB agency shall execute the re-checks, witnessed by the Commissioning Authority.
 - 2. Use the same test instruments as used in the original TAB work.
 - 3. Failure of more than 10 percent of the re-checked items of a given system shall result in the rejection of the system TAB report; rebalance the system, provide a new system TAB report, and repeat random re-checks.
 - 4. For purposes of re-check, failure is defined as follows:
 - a. Air Flow of Supply and Return: Deviation of more than 10 percent of instrument reading.
 - b. Minimum Outside Air Flow: Deviation of more than 20 percent of instrument reading; for inlet vane or VFD OSA compensation system using linear proportional control, deviation of more than 30 percent at intermediate supply flow.
 - c. Temperatures: Deviation of more than one degree F.
 - d. Air and Water Pressures: Deviation of more than 10 percent of full scale of test instrument reading.
 - e. Sound Pressures: Deviation of more than 3 decibels, with consideration for variations in background noise.
 - 5. For purposes of re-check, a whole system is defined as one in which inaccuracies will have little or no impact on connected systems; for example, the air distribution system served by one air handler or the hydronic chilled water supply system served by a chiller or the condenser water system.
- F. In the presence of the Commissioning Authority, verify that:
 - 1. Final settings of all valves, splitters, dampers and other adjustment devices have been permanently marked.

2. The air system is being controlled to the lowest possible static pressure while still meeting design loads, less diversity; this shall include a review of TAB methods, established control setpoints, and physical verification of at least one leg from fan to diffuser having all balancing dampers wide open and that during full cooling of all terminal units taking off downstream of the static pressure sensor, the terminal unit on the critical leg has its damper 90 percent or more open.
3. The water system is being controlled to the lowest possible pressure while still meeting design loads, less diversity; this shall include a review of TAB methods, established control setpoints, and physical verification of at least one leg from the pump to the coil having all balancing valves wide open and that during full cooling the cooling coil valve of that leg is 90 percent or more open.

3.09 SCOPE

- A. Test, adjust, and balance the following:
 1. HVAC Pumps.
 2. Air Cooled Refrigerant Condensers.
 3. Air Coils.
 4. Sprayed Coil Dehumidifier.
 5. Air Handling Units.
 6. Fans.
 7. Air Filters.
 8. Air Terminal Units.
 9. Air Inlets and Outlets.

3.10 MINIMUM DATA TO BE REPORTED

- A. Electric Motors:
 1. Manufacturer.
 2. Model/Frame.
 3. HP/BHP.
 4. Phase, voltage, amperage; nameplate, actual, no load.
 5. RPM.
 6. Service factor.
 7. Sheave Make/Size/Bore.
- B. V-Belt Drives:
 1. Identification/location.
 2. Required driven RPM.
 3. Driven sheave, diameter and RPM.
 4. Belt, size and quantity.
 5. Motor sheave diameter and RPM.
 6. Center to center distance, maximum, minimum, and actual.
- C. Pumps:
 1. Identification/number.
 2. Manufacturer.
 3. Size/model.
 4. Impeller.
 5. Service.
 6. Design flow rate, pressure drop, BHP.
 7. Actual flow rate, pressure drop, BHP.
 8. Discharge pressure.
 9. Suction pressure.
 10. Total operating head pressure.
- D. Air Cooled Condensers:
 1. Identification/number.

2. Location.
 3. Manufacturer.
 4. Model number.
 5. Serial number.
 6. Entering DB air temperature, design and actual.
 7. Leaving DB air temperature, design and actual.
 8. Number of compressors.
- E. Cooling Coils:
1. Identification/number.
 2. Location.
 3. Service.
 4. Manufacturer.
 5. Air flow, design and actual.
 6. Entering air DB temperature, design and actual.
 7. Entering air WB temperature, design and actual.
 8. Leaving air DB temperature, design and actual.
 9. Leaving air WB temperature, design and actual.
 10. Water flow, design and actual.
 11. Water pressure drop, design and actual.
 12. Entering water temperature, design and actual.
 13. Leaving water temperature, design and actual.
 14. Saturated suction temperature, design and actual.
 15. Air pressure drop, design and actual.
- F. Heating Coils:
1. Identification/number.
 2. Location.
 3. Service.
 4. Manufacturer.
 5. Air flow, design and actual.
 6. Water flow, design and actual.
 7. Water pressure drop, design and actual.
 8. Entering water temperature, design and actual.
 9. Leaving water temperature, design and actual.
 10. Entering air temperature, design and actual.
 11. Leaving air temperature, design and actual.
 12. Air pressure drop, design and actual.
- G. Air Moving Equipment:
1. Location.
 2. Manufacturer.
 3. Model number.
 4. Serial number.
 5. Arrangement/Class/Discharge.
 6. Air flow, specified and actual.
 7. Return air flow, specified and actual.
 8. Outside air flow, specified and actual.
 9. Total static pressure (total external), specified and actual.
 10. Inlet pressure.
 11. Discharge pressure.
 12. Sheave Make/Size/Bore.
 13. Number of Belts/Make/Size.
 14. Fan RPM.

- H. Return Air/Outside Air:
 - 1. Identification/location.
 - 2. Design air flow.
 - 3. Actual air flow.
 - 4. Design return air flow.
 - 5. Actual return air flow.
 - 6. Design outside air flow.
 - 7. Actual outside air flow.
 - 8. Return air temperature.
 - 9. Outside air temperature.
 - 10. Required mixed air temperature.
 - 11. Actual mixed air temperature.
 - 12. Design outside/return air ratio.
 - 13. Actual outside/return air ratio.
- I. Exhaust Fans:
 - 1. Location.
 - 2. Manufacturer.
 - 3. Model number.
 - 4. Serial number.
 - 5. Air flow, specified and actual.
 - 6. Total static pressure (total external), specified and actual.
 - 7. Inlet pressure.
 - 8. Discharge pressure.
 - 9. Sheave Make/Size/Bore.
 - 10. Number of Belts/Make/Size.
 - 11. Fan RPM.
- J. Duct Traverses:
 - 1. System zone/branch.
 - 2. Duct size.
 - 3. Area.
 - 4. Design velocity.
 - 5. Design air flow.
 - 6. Test velocity.
 - 7. Test air flow.
 - 8. Duct static pressure.
 - 9. Air temperature.
 - 10. Air correction factor.
- K. Duct Leak Tests:
 - 1. Description of ductwork under test.
 - 2. Duct design operating pressure.
 - 3. Duct design test static pressure.
 - 4. Duct capacity, air flow.
 - 5. Maximum allowable leakage duct capacity times leak factor.
 - 6. Test apparatus:
 - a. Blower.
 - b. Orifice, tube size.
 - c. Orifice size.
 - d. Calibrated.
 - 7. Test static pressure.
 - 8. Test orifice differential pressure.
 - 9. Leakage.

- L. Air Monitoring Stations:
 - 1. Identification/location.
 - 2. System.
 - 3. Size.
 - 4. Area.
 - 5. Design velocity.
 - 6. Design air flow.
 - 7. Test velocity.
 - 8. Test air flow.
- M. Terminal Unit Data:
 - 1. Manufacturer.
 - 2. Type, constant, variable, single, dual duct.
 - 3. Identification/number.
 - 4. Location.
 - 5. Model number.
 - 6. Size.
 - 7. Minimum static pressure.
 - 8. Minimum design air flow.
 - 9. Maximum design air flow.
 - 10. Maximum actual air flow.
 - 11. Inlet static pressure.

END OF SECTION

**SECTION 23 07 13
DUCT INSULATION**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Glass Fiber, Flexible.
- B. Glass Fiber, Rigid
- C. Polyisocyanurate, Rigid
- D. Jackets.
- E. Duct insulation.
- F. Jacketing and accessories.

1.02 RELATED REQUIREMENTS

- A. Section 23 05 53 - Identification for HVAC Piping and Equipment.
- B. Section 23 3100 - HVAC Ducts and Casings

1.03 REFERENCE STANDARDS

- A. ASTM B209/B209M - Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate; 2021a.
- B. ASTM C518 - Standard Test Method for Steady-State Thermal Transmission Properties by Means of the Heat Flow Meter Apparatus; 2021.
- C. ASTM C553 - Standard Specification for Mineral Fiber Blanket Thermal Insulation for Commercial and Industrial Applications; 2024.
- D. ASTM C612 - Standard Specification for Mineral Fiber Block and Board Thermal Insulation; 2014.
- E. ASTM C1071 - Standard Specification for Fibrous Glass Duct Lining Insulation (Thermal and Sound Absorbing Material); 2012.
- F. ASTM E84 - Standard Test Method for Surface Burning Characteristics of Building Materials; 2024.
- G. ASTM E96/E96M - Standard Test Methods for Gravimetric Determination of Water Vapor Transmission Rate of Materials; 2024a.
- H. SMACNA (DCS) - HVAC Duct Construction Standards Metal and Flexible; 2005.
- I. UL 723 - Standard for Test for Surface Burning Characteristics of Building Materials; Current Edition, Including All Revisions.

1.04 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements for submittal procedures.
- B. Product Data: Provide product description, thermal characteristics, list of materials and thickness for each service, and locations.

1.05 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing products of the type specified in this section with not less than three years of documented experience.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. Accept materials on site in original factory packaging, labelled with manufacturer's identification, including product density and thickness.
- B. Protect insulation from weather and construction traffic, dirt, water, chemical, and mechanical damage, by storing in original wrapping.

1.07 FIELD CONDITIONS

- A. Maintain ambient temperatures and conditions required by manufacturers of adhesives, mastics, and insulation cements.
- B. Maintain temperature during and after installation for minimum period of 24 hours.

PART 2 PRODUCTS

2.01 REGULATORY REQUIREMENTS

- A. Surface Burning Characteristics: Flame spread index/Smoke developed index of 25/50, maximum, when tested in accordance with ASTM E84, UL 723, ASTM E84, or UL 723.

2.02 GLASS FIBER, FLEXIBLE

- A. Manufacturer:
 - 1. Knauf Insulation: www.knaufusa.com.
 - 2. Johns Manville: www.jm.com.
 - 3. Owens Corning Corporation: www.ocbuildingspec.com/#sle.
- B. Insulation: ASTM C553; flexible, noncombustible blanket.
 - 1. K value: 0.36 at 75 degrees F, when tested in accordance with ASTM C518.
 - 2. Minimum Density of 1.0 PCF.
- C. Vapor Barrier Jacket:
 - 1. 0.0032 inch vinyl.
 - 2. Moisture Vapor Permeability: 0.02 perm inch, when tested in accordance with ASTM E96/E96M.
 - 3. Secure with pressure-sensitive tape.

2.03 POLYISOCYANURATE, RIGID

- A. Insulation consists of a pre-manufactured panel system consisting of four (4) piece interlocking panels.
- B. The interlocking panels shall be constructed of Dow Thermax polyisocyanurate insulation, ASTM D-1622, normal 2 pcf.
 - 1. Water vapor transmission as permeance less than 0.03, per ASTM E-96;
 - 2. Water absorption less than 0.3% (24 Hours), per ASTM C-209.
 - 3. Flexural strength more than 40 psi, per ASTM C-203.
- C. Operating temperature range of -100 deg. F to +250 deg. F.
- D. Insulation shall be clad with 0.032" thick embossed aluminum and sealed with vapor barrier compound. All joints shall interlock to ensure a thermal seal with no pass through seams.
- E. Panels shall be secured with #10 self-tapping stainless screws with weather seal washers.
- F. Manufacturers:
 - 1. P.T.M. Manufacturing, LLC Model Techna-Duc.
 - 2. Fab-Rite Exterior Duct Cladding System
 - 3. Polyguard Products, Inc. Model Alumaguard 60.
 - 4. Substitutions: See Section 01 6000 - Product Requirements.
- G. Insulation shall be provided with a 20-year warranty.

2.04 GLASS FIBER, RIGID

- A. Manufacturer:
 - 1. Knauf Insulation: www.knaufusa.com.
 - 2. Johns Manville: www.jm.com.
 - 3. Owens Corning Corp: www.owenscorning.com.
 - 4. CertainTeed Corporation: www.certainteed.com.
- B. Insulation: ASTM C612; rigid, noncombustible blanket.
 - 1. K Value: 0.24 at 75 degrees F, when tested in accordance with ASTM C518.

2. Maximum Service Temperature: 450 degrees F.
 3. Maximum Water Vapor Absorption: 5.0 percent.
 4. Maximum Density: 8.0 pcf.
- C. Vapor Barrier Jacket:
1. 0.0032 inch vinyl.
 2. Moisture Vapor Permeability: 0.02 perm inch, when tested in accordance with ASTM E96/E96M.

2.05 JACKETING AND ACCESSORIES

- A. Aluminum Jacket:
1. Comply with ASTM B209/B209M, Temper H14, minimum thickness of 0.016 inch with factory-applied polyethylene and kraft paper moisture barrier on the inside surface.
 2. Thickness: 0.016 inch sheet.
 3. Finish: Smooth.
 4. Joining: Longitudinal slip joints and 2 inch laps.
 5. Fittings: 0.016 inch thick die-shaped fitting covers with factory-attached protective liner.
 6. Metal Jacket Bands: 3/8 inch wide; 0.010 inch thick stainless steel.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Test ductwork for design pressure prior to applying insulation materials.
- B. Verify that surfaces are clean, foreign material removed, and dry.

3.02 INSTALLATION

- A. Install in accordance with manufacturer's instructions.
1. For rigid polyisocyanurate, installation shall only be completed by manufacturer licensed contractors.
- B. Insulated Ducts Conveying Air Below Ambient Temperature:
1. Provide insulation with vapor barrier jackets.
 2. Finish with tape and vapor barrier jacket.
 3. Continue insulation through walls, sleeves, hangers, and other duct penetrations.
 4. Insulate entire system, including fittings, joints, flanges, fire dampers, flexible connections, and expansion joints.
- C. Insulated Ducts Conveying Air Above Ambient Temperature:
1. Provide with or without standard vapor barrier jacket.
 2. Insulate fittings and joints. Where service access is required, bevel and seal ends of insulation.
- D. Ducts Exposed in Mechanical Equipment Rooms or Finished Spaces (below 10 feet above finished floor): Finish with canvas jacket sized for finish painting.
- E. Exterior Applications: Provide insulation with vapor barrier jacket. Cover with with calked aluminum jacket with seams located on bottom side of horizontal duct section.
- F. External Duct Insulation Application:
1. Secure insulation with vapor barrier with wires and seal jacket joints with vapor barrier adhesive or tape to match jacket.
 2. Secure insulation without vapor barrier with staples, tape, or wires.
 3. Install without sag on underside of duct. Use adhesive or mechanical fasteners where necessary to prevent sagging. Lift duct off trapeze hangers and insert spacers.
 4. Seal vapor barrier penetrations by mechanical fasteners with vapor barrier adhesive.
 5. Stop and point insulation around access doors and damper operators to allow operation without disturbing wrapping.

3.03 SCHEDULES

- A. Outside Air Intake Ducts: 2 inches thick, flexible glass fiber or rigid board.
- B. Supply Ducts within insulated building envelope (R-6 min.): 2 inches thick, flexible glass fiber
- C. Supply Ducts within building but outside insulated building envelope (R-8 min.): 3 inches thick, flexible glass fiber, or 2" thick rigid board.
- D. Return Ducts: 1 inch thick, flexible glass fiber or rigid board.
- E. Ducts exposed in mechanical room or non public spaces: shall be provided with rigid board and jacket.
- F. Ducts Exposed to Outdoors (R-8 min): 2 inches thick, rigid polyisocyanurate encased in metal.

END OF SECTION

SECTION 23 07 16
HVAC EQUIPMENT INSULATION

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Equipment insulation.
- B. Jacketing and accessories.

1.02 REFERENCE STANDARDS

- A. ASTM A666/A666M - Standard Specification for Annealed or Cold-Worked Austenitic Stainless Steel Sheet, Strip, Plate, and Flat Bar; 2024.
- B. ASTM C177 - Standard Test Method for Steady-State Heat Flux Measurements and Thermal Transmission Properties by Means of the Guarded-Hot-Plate Apparatus; 2019, with Editorial Revision (2023).
- C. ASTM C449 - Standard Specification for Mineral Fiber Hydraulic-Setting Thermal Insulating and Finishing Cement; 2007 (Reapproved 2024).
- D. ASTM C518 - Standard Test Method for Steady-State Thermal Transmission Properties by Means of the Heat Flow Meter Apparatus; 2021.
- E. ASTM C533 - Standard Specification for Calcium Silicate Block and Pipe Thermal Insulation; 2017 (Reapproved 2023).
- F. ASTM E84 - Standard Test Method for Surface Burning Characteristics of Building Materials; 2024.
- G. UL 723 - Standard for Test for Surface Burning Characteristics of Building Materials; Current Edition, Including All Revisions.

1.03 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide product description, thermal characteristics, list of materials and thickness for equipment scheduled.

1.04 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with not less than three years of documented experience.

1.05 DELIVERY, STORAGE, AND HANDLING

- A. Accept materials on site in original factory packaging, labeled with manufacturer's identification, including product density and thickness.
- B. Protect insulation from weather and construction traffic, dirt, water, chemical, and mechanical damage, by storing in original wrapping.

PART 2 PRODUCTS

2.01 REGULATORY REQUIREMENTS

- A. Surface Burning Characteristics: Flame spread index/Smoke developed index of 25/50, maximum, when tested in accordance with ASTM E84, UL 723, ASTM E84, or UL 723.

2.02 HYDROUS CALCIUM SILICATE

- A. Manufacturer:
 - 1. Johns Manville Corporation: www.jm.com.
 - 2. General Isulation; www.generalinsulation.com
 - 3. Ritemore; www.ritemore.com
- B. Substitutions: See Section 01 60 00 - Product Requirements.
- C. Insulation: ASTM C533; rigid molded, asbestos free, gold color.

1. K Value: 0.40 at 300 degrees F, when tested in accordance with ASTM C177 or ASTM C518.
 2. Maximum Service Temperature: 1,200 degrees F.
 3. Density: 15 pcf.
- D. Tie Wire: 0.048 inches stainless steel with twisted ends on maximum 12 inch centers.
- E. Insulating Cement: ASTM C449.

2.03 JACKETING AND ACCESSORIES

- A. Stainless Steel Jacket: ASTM A666/A666M, Type 304 stainless steel.
1. Thickness: 0.010 inch.
 2. Finish: Smooth.
 3. Metal Jacket Bands: 3/8 inch wide; 0.010 inch thick stainless steel.

PART 3 EXECUTION

3.01 INSTALLATION

- A. Install in accordance with manufacturer's instructions.
- B. Exposed Equipment: Locate insulation and cover seams in least visible locations.
- C. Exterior Applications:
1. Provide vapor barrier jacket or finish with glass mesh reinforced vapor barrier cement.
 2. Cover with aluminum or stainless steel.
- D. Cover glass fiber insulation with metal mesh and finish with heavy coat of insulating cement.
- E. Nameplates and ASME Stamps: Bevel and seal insulation around; do not insulate over.
- F. Equipment Requiring Access for Maintenance, Repair, or Cleaning: Install insulation so it can be easily removed and replaced without damage.

END OF SECTION

**SECTION 23 08 00
COMMISSIONING OF HVAC**

PART 1 GENERAL

1.01 SUMMARY

- A. See Section 01 91 13 - General Commissioning Requirements for overall objectives; comply with the requirements of Section 01 91 13.
- B. This section covers the Contractor's responsibilities for commissioning; each subcontractor or installer responsible for the installation of a particular system or equipment item to be commissioned is responsible for the commissioning activities relating to that system or equipment item.
- C. The following HVAC equipment is to be commissioned, including commissioning activities for the following specific items:
 - 1. Control system.
 - 2. Piping systems and equipment.
 - 3. Boilers.
 - 4. Terminal units.
 - 5. Exhaust Fans
 - 6. Variable frequency drives.
 - 7. Other equipment and systems explicitly identified elsewhere in Contract Documents as requiring commissioning.

1.02 RELATED REQUIREMENTS

- A. Section 01 78 00 - Closeout Submittals: Scope and procedures for operation and maintenance manuals and project record documents.
- B. Section 01 79 00 - Demonstration and Training: Scope and procedures for State of Delaware OMB - Division of Facilities Management personnel training.
- C. Section 01 91 13 - General Commissioning Requirements: Commissioning requirements that apply to all types of work.
- D. Section 23 09 50 - Building Automation System (BAS) General
- E. Section 23 09 59 - BAS System Commissioning

1.03 REFERENCE STANDARDS

- A. ASHRAE Guideline 1.1 - The HVAC Commissioning Process; 2007

1.04 SUBMITTALS

- A. Contractor shall draft Prefunctional Checklists and Functional Test Procedures for systems being commissioned: Detailed written plan indicating the procedures to be followed to test, checkout and adjust the control system prior to full system Functional Testing; include at least the following for each type of equipment controlled:
 - 1. System name.
 - 2. List of devices.
 - 3. Step-by-step procedures for testing each controller after installation, including:
 - a. Process of verifying proper hardware and wiring installation.
 - b. Process of downloading programs to local controllers and verifying that they are addressed correctly.
 - c. Process of performing operational checks of each controlled component.
 - d. Plan and process for calibrating valve and damper actuators and all sensors.
 - e. Description of the expected field adjustments for transmitters, controllers and control actuators should control responses fall outside of expected values.
 - 4. Copy of proposed log and field checkout sheets to be used to document the process; include space for initial and final read values during calibration of each point and space to

- specifically indicate when a sensor or controller has “passed” and is operating within the contract parameters.
5. Description of the instrumentation required for testing.
 6. Indicate what tests on what systems should be completed prior to TAB using the control system for TAB work. Coordinate with the Commissioning Authority and TAB contractor for this determination.
- B. Startup Reports, Prefunctional Checklists, and Trend Logs: Submit for approval of Commissioning Authority.
 - C. HVAC Control System O&M Manual Requirements. Submit as required in section 23 09 59.
 - D. Project Record Documents: See Section 01 78 00 for additional requirements.
 1. Submit updated version of control system documentation, for inclusion with operation and maintenance data.
 2. Show actual locations of all static and differential pressure sensors (air, water and building pressure) and air-flow stations on project record drawings.
 - E. Draft Training Plan: In addition to requirements specified in Section 01 79 00, include:
 1. Follow the recommendations of ASHRAE Guideline 1.1.
 2. Control system manufacturer's recommended training.
 3. Demonstration and instruction on function and overrides of any local packaged controls not controlled by the HVAC control system.
 - F. Training Manuals: See Section 01 79 00 for additional requirements.
 1. Provide three extra copies of the controls training manuals in a separate manual from the O&M manuals.

PART 2 PRODUCTS

2.01 TEST EQUIPMENT

- A. Provide all standard testing equipment required to perform startup and initial checkout and required functional performance testing; unless otherwise noted such testing equipment will NOT become the property of State of Delaware OMB - Division of Facilities Management.
- B. Equipment-Specific Tools: Where special testing equipment, tools and instruments are specific to a piece of equipment, are only available from the vendor, and are required in order to accomplish startup or Functional Testing, provide such equipment, tools, and instruments as part of the work at no extra cost to State of Delaware OMB - Division of Facilities Management; such equipment, tools, and instruments are to become the property of State of Delaware OMB - Division of Facilities Management.

PART 3 EXECUTION

3.01 PREPARATION

- A. Prepare a preliminary schedule for HVAC pipe and duct system testing, flushing and cleaning, equipment start-up and testing, adjusting, and balancing start and completion for use by the Commissioning Authority; update the schedule as appropriate.
- B. Notify the Commissioning Authority when pipe and duct system testing, flushing, cleaning, startup of each piece of equipment and testing, adjusting, and balancing will occur; when commissioning activities not yet performed or not yet scheduled will delay construction notify ahead of time and be proactive in seeing that the Commissioning Authority has the scheduling information needed to efficiently execute the commissioning process.
- C. Put all HVAC equipment and systems into operation and continue operation during each working day of testing, adjusting, and balancing and commissioning, as required.
- D. Provide test holes in ducts and plenums where directed to allow air measurements and air balancing; close with an approved plug.
- E. Provide temperature and pressure taps in accordance with Contract Documents.

1. Provide a pressure/temperature plug at each water sensor that is an input point to the control system.

3.02 INSPECTING AND TESTING - GENERAL

- A. Submit startup plans, startup reports, and Prefunctional Checklists for each item of equipment or other assembly to be commissioned.
- B. Perform the Functional Tests directed by the Commissioning Authority for each item of equipment or other assembly to be commissioned.
- C. Provide two-way radios for use during the testing.
- D. Valve/Damper Stroke Setup and Check:
 1. For all valve/damper actuator positions checked, verify the actual position against the control system readout.
 2. Set pump/fan to normal operating mode.
 3. Command valve/damper closed; visually verify that valve/damper is closed and adjust output zero signal as required.
 4. Command valve/damper open; verify position is full open and adjust output signal as required.
 5. Command valve/damper to a few intermediate positions.
 6. If actual valve/damper position does not reasonably correspond, replace actuator or add pilot positioner (for pneumatics).
- E. Closure for Heating Coil Valves - Normally Open:
 1. Set heating setpoint 20 degrees F above room temperature.
 2. Observe valve open.
 3. Remove control air or power from the valve and verify that the valve stem and actuator position do not change.
 4. Restore to normal.
 5. Set heating setpoint to 20 degrees F below room temperature.
 6. Observe the valve close.
- F. Coil Valve Leak Check:
 1. Method 1 - Water Temperature With 2-Way Valve:
 - a. Calibrate water temperature sensors on each side of coil to be within 0.2 degree F of each other.
 - b. Turn off air handler fans, close outside air dampers. Keep pump running. Make sure appropriate coil dampers are open.
 - c. Normally closed valves will close.
 - d. Override normally open valves to the closed position.
 - e. After 10 minutes observe water delta T across coil. If it is greater than 2 degrees F (, leakage is probably occurring.
 - f. Reset valve stroke to close tighter.
 - g. Repeat test until compliance is achieved.
- G. Isolation Valve or System Valve Leak Check: For valves not by coils.
 1. With full pressure in the system, command valve closed.
 2. Use an ultra-sonic flow meter to detect flow or leakage.
- H. Deficiencies: Correct deficiencies and re-inspect or re-test, as applicable, at no extra cost to State of Delaware OMB - Division of Facilities Management.

3.03 TAB COORDINATION

- A. TAB: Testing, adjusting, and balancing of HVAC.
- B. Coordinate commissioning schedule with TAB schedule.
- C. Review the TAB plan to determine the capabilities of the control system toward completing TAB.

- D. Provide all necessary unique instruments and instruct the TAB technicians in their use; such as handheld control system interface for setting terminal unit boxes, etc.
- E. Have all required Prefunctional Checklists, calibrations, startup and component Functional Tests of the system completed and approved by the Commissioning Authority prior to starting TAB.
- F. Provide a qualified control system technician to operate the controls to assist the TAB technicians or provide sufficient training for the TAB technicians to operate the system without assistance.

3.04 CONTROL SYSTEM FUNCTIONAL TESTING

- A. Coordinate with Section 23 09 59 for requirements.

3.05 OPERATION AND MAINTENANCE MANUALS

- A. See Section 01 78 00 for additional requirements.
- B. Add design intent documentation furnished by DEDC, LLC to manuals prior to submission to State of Delaware OMB - Division of Facilities Management.
- C. Submit manuals related to items that were commissioned to Commissioning Authority for review; make changes recommended by Commissioning Authority.
- D. Commissioning Authority will add commissioning records to manuals after submission to State of Delaware OMB - Division of Facilities Management.

3.06 DEMONSTRATION AND TRAINING

- A. See Section 01 79 00 for additional requirements.
- B. Coordinate with Section 23 09 59 for requirements.
- C. These demonstrations are in addition to, and not a substitute for, Prefunctional Checklists and demonstrations to the Commissioning Authority during Functional Testing.
- D. Provide classroom and hands-on training of State of Delaware OMB - Division of Facilities Management's designated personnel on operation and maintenance of the HVAC system, control system, and all equipment items indicated to be commissioned. Provide the following minimum durations of training:
 - 1. Boilers and System: 8 hours.
 - 2. Piping Systems: 2 hours.
 - 3. Air Handling Units: 1 hours.
 - 4. Variable Speed Drives: 2 hours.
- E. TAB Review: Instruct State of Delaware OMB - Division of Facilities Management's personnel for minimum 2 hours, after completion of TAB, on the following:
 - 1. Review final TAB report, explaining the layout and meanings of each data type.
 - 2. Discuss any outstanding deficient items in control, ducting or design that may affect the proper delivery of air or water.
 - 3. Identify and discuss any terminal units, duct runs, diffusers, coils, fans and pumps that are close to or are not meeting their design capacity.
 - 4. Discuss any temporary settings and steps to finalize them for any areas that are not finished.
 - 5. Other salient information that may be useful for facility operations, relative to TAB.
- F. Provide the services of manufacturer representatives to assist instructors where necessary.
- G. Provide the services of the HVAC controls instructor at other training sessions, when requested, to discuss the interaction of the controls system as it relates to the equipment being discussed.

END OF SECTION

**SECTION 23 09 50
BUILDING AUTOMATION SYSTEM (BAS) GENERAL**

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. General Requirements
- B. Description of Work
- C. Quality Assurance
- D. System Architecture
- E. Distributed Processing Units/Quantity and Location
- F. Demolition and Reuse of Existing Materials and Equipment
- G. Sequence of Work

1.02 RELATED DOCUMENTS

- A. Section 23 09 69 - Variable Frequency Controllers
- B. Section 23 09 51 - Building Automation System (BAS) Basic Materials, Interface Devices, and Sensors
- C. Section 23 09 53 - BAS Field Panels
- D. Section 23 09 54 - BAS Communication Devices
- E. Section 23 09 55 - BAS Software and Programming
- F. Section 23 09 58 - Sequences of Operation
- G. Section 23 09 59 - BAS Commissioning

1.03 DESCRIPTION OF WORK

- A. The building automation system (BAS) defined in this specification shall interface with State of Delaware OMB - Division of Facilities Management Network, and shall utilize the BACnet communication requirements as defined by ASHRAE/ANSI 135 (current version and addendum) for all communication.
- B. This system shall be an extension of the existing Automated Logic System currently installed in the of the building.
- C. The systems to be controlled under work of this section basically comprise existing HVAC systems within an existing building. The HVAC systems being controlled are Air Handling Units, VAV Systems, Exhaust Fans, and other devices. This Section defines the manner and method by which these controls function.
- D. The BAS contractor shall provide Variable Frequency Controllers for all equipment identified as having a Variable Frequency Controller (or Variable Frequency Drives "VFD"). The Variable Frequency Controller shall be in accordance with specification section 23 09 69.

1.04 APPLICATION OF OPEN PROTOCOLS

- A. Subject to the detailed requirements provided throughout the specifications, the BAS and digital control and communications components installed, as work of this contract shall be an integrated distributed processing system utilizing BACnet. System components shall communicate using true BacNET in accordance with ASHRAE Standard 135 and current addenda and annexes, including all workstations, all building controllers, and all application specific controllers. Gateways to other communication protocols are not acceptable

1.05 QUALITY ASSURANCE

- A. Product Line Demonstrated History: The product line being proposed for the project must have an installed history of demonstrated satisfactory operation for a length of 2 years since date of

final completion in at least 10 installations of comparative size and complexity. Submittals shall document this requirement with references.

- B. The following requirement relates to the actual installing contractor.
- C. Installer's Qualifications: Firms specializing and experienced in control system installations for not less than 5 years. Firms with experience in BAS installation projects with point counts equal to this project and systems of the same character as this project. If installer is a Value Added Reseller (VAR) of a manufacturer's product, installer must demonstrate at least three years prior experience with that manufacturer's products. Experience starts with awarded Final Completion of previous projects. Submittals must document this experience with references.
- D. Installer's Experience with Proposed Product Line: Firms shall have specialized in and be experienced with the installation of the proposed product line for not less than one year from date of final completion on at least 3 projects of similar size and complexity. Submittals shall document this experience with references.
- E. Installer's Field Coordinator and Sequence Programmer Qualifications: Individual(s) shall specialize in and be experienced with control system installation for not less than 5 years. Proposed field coordinator shall have experience with the installation of the proposed product line for not less than 2 projects of similar size and complexity. Installer shall submit the names of the proposed individual and at least one alternate for each duty. Submittals shall document this experience with references. The proposed individuals must show proof of the following training:
 - 1. Product Line Training: Individuals overseeing the installation and configuration of the proposed product line must provide evidence of the most advanced training offered by the Manufacturer on that product line for installation and configuration
 - 2. Programming Training: Individuals involved with programming the site-specific sequences shall provide evidence of the most advanced programming training offered by the vendor of the programming application offered by the Manufacturer.
- F. Installer's Service Qualifications: The installer must be experienced in control system operation, maintenance and service. Installer must document a minimum 5 year history of servicing installations of similar size and complexity. Installer must also document at least a one year history of servicing the proposed product line.
- G. Installer's Response Time and Proximity
 - 1. Installer must maintain a fully capable service facility within a 45 mile radius of the project site. Service facility shall manage the emergency service dispatches and maintain the inventory of spare parts.
 - 2. Emergency response times are listed below in this section. Installer must demonstrate the ability to meet the response times.

1.06 CODES AND STANDARDS

- A. American Society of Heating, Refrigeration and Air Conditioning Engineers (ASHRAE)
 - 1. ASHRAE 135: BACnet - A Data Communication Protocol for Building Automation and Control Networks. American Society of Heating, Refrigerating and Air-Conditioning Engineers, Inc. current edition including all related addenda shall apply.
- B. Electronics Industries Alliance
 - 1. EIA-709.1-A-99: Control Network Protocol Specification
 - 2. EIA-709.3-99: Free-Topology Twisted-Pair Channel Specification
 - 3. EIA-232: Interface between Data Terminal Equipment and Data Circuit-Terminating Equipment Employing Serial Binary Data Interchange.
 - 4. EIA-458: Standard Optical Fiber Material Classes and Preferred Sizes
 - 5. EIA-485: Standard for Electrical Characteristics of Generator and Receivers for use in Balanced Digital Multipoint Systems.
 - 6. EIA-472: General and Sectional Specifications for Fiber Optic Cable

7. EIA-475: Generic and Sectional Specifications for Fiber Optic Connectors and all Sectional Specifications
8. EIA-573: Generic and Sectional Specifications for Field Portable Polishing Device for Preparation Optical Fiber and all Sectional Specifications
9. EIA-590: Standard for Physical Location and Protection of Below-Ground Fiber Optic Cable Plant and all Sectional Specifications
- C. Underwriters Laboratories
 1. UL 916: Energy Management Systems.
 2. The following rating is required only for devices used for smoke control purposes. If these are not intended, delete.
 3. UUKL 864: UL Supervised Smoke Control
- D. NEMA Compliance
 1. NEMA 250: Enclosure for Electrical Equipment
 2. NEMA ICS 1: General Standards for Industrial Controls.
- E. NFPA Compliance
 1. NFPA 90A "Standard for the Installation of Air Conditioning and Ventilating Systems" where applicable to controls and control sequences.
 2. NFPA 70 National Electrical Code (NEC)
- F. Institute of Electrical and Electronics Engineers (IEEE)
 1. IEEE 142: Recommended Practice for Grounding of Industrial and Commercial Power Systems
 2. IEEE 802.3: CSMA/CD (Ethernet - Based) LAN
 3. IEEE 802.4: Token Bus Working Group (ARCNET - Based) LAN

1.07 DEFINITIONS

- A. Advanced Application Controller (AAC): A device with limited resources relative to the Building Controller (BC). It may support a level of programming and may also be intended for application specific applications.
- B. Application Protocol Data Unit (APDU): A unit of data specified in an application protocol and consisting of application protocol control information and possible application user data (ISO 9545).
- C. Application Specific Controller (ASC): A device with limited resources relative to the Advanced Application Controller (AAC). It may support a level of programming and may also be intended for application-specific applications.
- D. BACnet/BACnet Standard: BACnet communication requirements as defined by ASHRAE/ANSI 135 (Current edition and addendum).
- E. BACnet Interoperability Building Blocks (BIBB): A BIBB defines a small portion of BACnet functionality that is needed to perform a particular task. BIBBS are combined to build the BACnet functional requirements for a device in a specification.
- F. Binding: In the general sense, binding refers to the associations or mappings of the sources network variable and their intended opr required destinations.
- G. Building Automation System (BAS): The entire integrated management and control system
- H. Building Controller (BC): A fully programmable device capable of carrying out a number of tasks including control and monitoring via direct digital control (DDC) of specific systems, acting as a communications router between the controlled devices / equipment and the CSS, and temporary data storage for trend information, time schedules, and alarm data.
- I. Change of Value (COV): An event that occurs when a measured or calculated analog value changes by a predefined amount (ASHRAE/ANSI 135 (current version and addendum)).
- J. Client: A device that is the requestor of services from a server. A client device makes requests of and receives responses from a server device.

- K. Continuous Monitoring: A sampling and recording of a variable based on time or change of state (e.g. trending an analog value, monitoring a binary change of state).
- L. Controller or Control Unit (CU): Intelligent stand-alone control device. Controller is a generic reference and shall include BCs, AACs, and ASCs as appropriate.
- M. Control Systems Server (CSS): A server class computer(s) that maintains the systems configuration and programming database. This server is located at the State of Delaware's data center in a virtual environment and serves as an access point to BAS.
- N. Controlling LAN: High speed, peer-to-peer controller LAN connecting BCs, AACs and ASCs. Refer to System Architecture below.
- O. Direct Digital Control (DDC): Microprocessor-based control including Analog/Digital conversion and program logic
- P. Functional Profile: A collection of variables required to define a the key parameters for a standard application. As this applies to the HVAC industry, this would include applications like VAV terminal, fan coil units, and the like.
- Q. Gateway (GTWY): A device, which contains two or more dissimilar networks/protocols, permitting information exchange between them.
- R. Hand Held Device (HHD): Manufacturer's microprocessor based device for direct connection to a Controller.
- S. LAN Interface Device (LANID): Device or function used to facilitate communication and sharing of data throughout the BAS
- T. Local Area Network (LAN): General term for a network segment within the architecture. Various types and functions of LANs are defined herein.
- U. Local Supervisory LAN: Also known as the State's Network: Ethernet-based network connecting Primary Controlling LANs with each other and OWSs and CSSs. See System Architecture below.
- V. Master-Slave/Token Passing (MS/TP): Data link protocol as defined by the BACnet standard.
- W. Open Database Connectivity (ODBC): An open standard application-programming interface (API) for accessing a database developed. ODBC compliant systems make it possible to access any data from any application, regardless of which database management system (DBMS) is handling the data.
- X. Operator Interface (OI): A device used by the operator to manage the BAS including OWSs, POTs, and HHDs.
- Y. Operator Workstation (OWS): The user's interface with the BAS system. As the BAS network devices are stand-alone, dedicated OWS is not required for communications to occur. The OWS can be any computer on the State's Network that has a compatible Web browser.
- Z. Point-to-Point (PTP): Serial communication as defined in the BACnet standard.
- AA. Portable Operators Terminal (POT): Mobile computer used both for direct connection to a controller as well as network connection.
- BB. Protocol Implementation Conformance Statement (PICS): A written document, created by the manufacturer of a device, which identifies the particular options specified by BACnet that are implemented in the device (ASHRAE/ANSI 135 (current version and addendum)).
- CC. Router: A device that connects two or more networks at the network layer.
- DD. Secondary Controlling LAN: LAN connecting AACs and ASCs, generally lower speed and less reliable than the Controlling LAN. Refer to System Architecture below.
- EE. Server : A device that is a provider of services to a client. A client device makes requests of and receives responses from a server device.

- FF. Standardized Query Language (SQL): A database computer language designed for managing data in relational database management system (RDBMS). Its scope includes data insert, query, update and delete, schema creation and modification, and data access control.
- GG. Smart Device: A control I/O device such as a sensor or actuator that can directly communicate with a controller through the network. This differs from an ASC in that it typically deals only with one variable.
- HH. Extensible Markup Language (XML): A specification developed by the World Wide Web Consortium. XML is a pared-down version of SGML, designed especially for Web documents. It is a set of rules for encoding documents in machine-readable form that allows designers to create their own customized tags, enabling the definition, transmission, validation, and interpretation of data between applications and between organizations.

1.08 FUNCTIONAL INTENT

- A. Throughout Sections 23 09 50 through 23 09 55, the Sequences of Operation, and Section 23 09 59 detailed requirements are specified, some of which indicate a means, method or configuration acceptable to meet that requirement. Contractor may submit products that utilize alternate means, methods, and configurations that meet the functional intent. However these will only be allowed with prior approval.

1.09 SUBMITTALS

- A. Submit under provisions of Section 01 30 00 .
- B. Electronic Submittals: While all requirements for hard copy submittal apply, control submittals and O&M information shall also be provided in electronic format as follows.
 - 1. Drawings and Diagrams: Shop drawings shall be provided on electronic media as an AutoCAD (current version) and/or Adobe Portable Document Format file. All 'X reference' and font files must be provided with AutoCAD files.
 - 2. Other Submittals: All other submittals shall be provided in Adobe Portable Document Format (PDF).
- C. Qualifications: Manufacturer, Installer, and Key personnel qualifications as indicated for the appropriate item above.
- D. Product Data: Submit manufacturer's technical product data for each control device, panel, and accessory furnished, indicating dimensions, capacities, performance and electrical characteristics, and material finishes. Also include installation and start-up instructions.
- E. Shop Drawings: Submit shop drawings for each control system, including a complete drawing for each air handling unit, system, pump, device, etc. with all point descriptors, addresses and point names indicated. Each shop drawing shall contain the following information:
 - 1. System Architecture and System Layout:
 - a. One-line diagram indicating schematic locations of all control units, workstations, LAN interface devices, gateways, etc. Indicate network number, device ID, , instance number, MAC address, drawing reference number, and controller type for each control unit. Indicate media, protocol, baud rate, and type of each LAN. Indicate media, protocol, baud rate, and type of each LAN. All optical isolators, repeaters, end-of-line resistors, junctions, ground locations etc. shall be located on the diagram.
 - b. Provide electronic floor plans locating all control units, workstations, LAN interface devices, gateways, etc. Include all network communication wiring routing, power wiring, power originating sources, and low voltage power wiring. Indicate network number, device ID, instance number, MAC address, drawing reference number, and controller type for each control unit. Indicate media, protocol, baud rate, and type of each LAN. All optical isolators, repeaters, end-of-line resistors, junctions, ground locations etc. shall be located on the floor plans. Wiring routing as-built conditions shall be maintained accurately throughout the construction period and the drawing shall be updated to accurately reflect accurate, actual installed conditions.

2. Schematic flow diagram of each air and water system showing fans, coils, dampers, valves, pumps, heat exchange equipment and control devices. Include verbal description of sequence of operation.
 3. All physical points on the schematic flow diagram shall be indicated with names, descriptors, and point addresses identified as listed in the point summary table.
 4. With each schematic, provide a point summary table listing building number and abbreviation, system type, equipment type, full point name, point description, Ethernet backbone network number, network number, device ID, object ID (object type, instance number). See Section 23 09 55 - Part III for additional requirements.
 5. Label each control device with setting or adjustable range of control.
 6. Label each input and output with the appropriate range.
 7. Provide a Bill of Materials with each schematic. Indicate device identification to match schematic and actual field labeling, quantity, actual product ordering number, manufacturer, description, size, voltage range, pressure range, temperature range, etc. as applicable.
 8. With each schematic, provide valve and actuator information including size, Cv, design flow, design pressure drop, manufacturer, model number, close off rating, etc. Indicate normal positions of spring return valves and dampers.
 9. Indicate all required electrical wiring. Electrical wiring diagrams shall include both ladder logic type diagram for motor starter, control, and safety circuits and detailed digital interface panel point termination diagrams with all wire numbers and terminal block numbers identified. Provide panel termination drawings on separate drawings. Ladder diagrams shall appear on system schematic. Clearly differentiate between portions of wiring, which are existing, factory-installed and portions to be field-installed.
 10. Details of control panels, including controls, instruments, and labeling shown in plan or elevation indicating the installed locations.
 11. Sheets shall be consecutively numbered.
 12. Each sheet shall have a title indicating the type of information included and the HVAC system controlled.
 13. Table of Contents listing sheet titles and sheet numbers.
 14. Legend and list of abbreviations.
 15. Memory allocation projections.
 16. Submit along with shop drawings but under separate cover calculated and guaranteed system response times of the most heavily loaded LAN in the system.
- F. Open Protocol Information
1. BACnet Systems:
 - a. BACnet object description, object ID, and device ID, for each I/O point.
 - b. Documentation for any non-standard BACnet objects, properties, or enumerations used detailing their structure, data types, and any associated lists of enumerated values.
 - c. Submit PICS indicating the BACnet functionality and configuration of each controller.
- G. Framed Control Drawings: Laminated control drawings including system control schematics, sequences of operation and panel termination drawings, shall be provided in panels for major pieces of equipment. Terminal unit drawings shall be located in the central plant equipment panel or mechanical room panel.
- H. Control Logic Documentation
1. Submit control logic program listings (for graphical programming) and logic flow charts (for line type programs) to document the control software of all control units.
 2. Control logic shall be annotated to describe how it accomplishes the sequence of operation. Annotations shall be sufficient to allow an operator to relate each program component (block or line) to corresponding portions of the specified Sequence of Operation.
 3. Include written description of each control sequence.

4. Include control response, settings, setpoints, throttling ranges, gains, reset schedules, adjustable parameters and limits.
 5. Sheets shall be consecutively numbered.
 6. Each sheet shall have a title indicating the controller designations and the HVAC system controlled.
 7. Include Table of Contents listing sheet titles and sheet numbers
 8. Submit one complete set of programming and operating manuals for all digital controllers concurrently with control logic documentation. This set will count toward the required number of Operation and Maintenance materials specified below and in Section 01 30 00.
- I. Operation and Maintenance Materials:
1. Submit documents under provisions of Section 01 03 00. One copy of the materials shall be delivered directly to the State facilities operation staff, in addition to the copies required by other Sections.
 2. Submit maintenance instructions and spare parts lists for each type of control device, control unit, and accessory.
 3. Submit BAS User's Guides (Operating Manuals) for each controller type .
 4. Submit BAS advanced Programming Manuals for each controller type.
 5. Include all submittals (product data, shop drawings, control logic documentation, hardware manuals, software manuals, installation guides or manuals, maintenance instructions and spare parts lists) in maintenance manual; in accordance with requirements of Division 1.
- J. Controls contractor shall provide the State with all product line technical manuals and technical bulletins, to include new and upgraded products, by the same distribution channel as to dealers or branches. This service will be provided for 5 years as part of the contract price, and will be offered to the State thereafter for the same price as to a dealer or branch.
- K. Manufacturers Certificates: For all listed and/or labeled products, provide certificate of conformance.
- L. Product Warranty Certificates: submit manufacturers product warranty certificates covering the hardware provided.

1.10 PROJECT RECORD DOCUMENTS

- A. Submit documents under provisions of Section 01 30 00.
- B. Record copies of product data and control shop drawings updated to reflect the final installed condition.
- C. Record copies of approved control logic programming and database on paper and on CD's. Accurately record actual setpoints and settings of controls, final sequence of operation, including changes to programs made after submission and approval of shop drawings and including changes to programs made during specified testing.
- D. Record copies of approved project specific graphic software on CDs.
- E. Record copies shall include individual floor plans with controller locations with all interconnecting wiring routing including space sensors, LAN wiring, power wiring, low voltage power wiring. Indicate device instance, MAC address and drawing reference number.
- F. Provide record riser diagram showing the location of all controllers.
- G. Maintain project record documents throughout the warranty period and submit final documents at the end of the warranty period

1.11 SYSTEM ARCHITECTURE

- A. The system provided shall incorporate hardware resources sufficient to meet the functional requirements of these Specifications. The Contractor shall include all items not specifically itemized in these Specifications that are necessary to implement, maintain, and operate the system in compliance with the functional intent of these Specifications.

- B. The system shall be configured as a distributed processing network(s) capable of expansion as specified below.
- C. The system architecture shall consist of the Ethernet-based State Network, and Controlling LANs that support BCs, AACs, ASCs, Operator Workstations (OWS), Smart Devices (SD), and Remote Communication Devices (RCDs) as applicable. The following indicates a functional description of the BAS structure.
 - 1. State Network: Internet-based network connecting multiple facilities with a central data and application server, accessible via standard web-browser. This is an existing infrastructure and contractor is not required to configure any components of this network. Refer to Section 23 09 54 for requirements. This contractor shall integrate the controlling devices and the CCS together.
 - 2. Local Supervisory LAN: The Local Supervisory LAN shall be an Ethernet-based, 100 Mbps LAN connecting Primary Control LANs and OWSs. The LAN serves as the inter-BC gateway and OWS-to-BC gateway and communications path. Contractor shall provide this as a dedicated LAN for the control system. LAN shall be IEEE 802.3 Ethernet over Fiber or Category 5 cable with switches and routers that support 100 Mbps throughput. Power-line carrier communication shall not be acceptable for communications. The physical media will be that installed for the IT infrastructure of the facility and as such network drops will be provided under that scope of work to facilitate work of this scope. This network will be 100 Mbps and therefore all network interface cards shall support that speed. The higher level layers of this network shall be BACnet as described below:
 - a. BACnet Supervisory LAN: Shall be BACnet/IP as defined in the BACnet standard, and shall share a common network number for the Ethernet backbone, as defined in the BACnet standard. Point/Object naming conventions are specified in 23 09 55 - Part III.
 - 3. Controlling LAN: High-speed, peer-to-peer communicating LAN used to connect AACs, ASCs and Building Controllers (BCs) and communicate exclusively control information. Acceptable technologies include:
 - a. Ethernet (IEEE802.3)
 - b. ARCNET (IEEE802.4)
 - c. Communication to/from building controller (BC) and the control system server (CSS) shall utilize standard TCP/IP, BACnet/IP ports (80and/or 47808)
 - 4. Secondary Controlling LAN : Network used to connect AACs, ASCs or SDs. These can be Master Slave/ Token Passing or polling, in addition to those allowed for Primary Controller LANs. Network speed vs. the number of controllers on the LAN shall be dictated by the response time and trending requirements.
- D. Dynamic Data Access: Any data throughout any level of the network shall be available to and accessible by all other devices, Controllers and OWS, whether directly connected or connected remotely.
- E. Remote Data Access: The system shall support the following methods of remote access to the building data.
 - 1. Browser-based access: A remote user using a standard browser shall be able to access all control system facilities and graphics with proper authentication. The State shall maintain continuous network connection. The following paradigms are acceptable for browser-based access:
 - a. Native Internet-based user interface (HTML, Java, XML, etc.) via a standard freely distributed web browser that does not require a Windows client software installation.
- F. The communication speed between the controllers, LAN interface devices, and operator interface devices shall be sufficient to ensure fast system response time under any loading condition. Contractor shall submit guaranteed response times with shop drawings including calculations to support the guarantee. In no case shall delay times between an event, request, or command initiation and its completion be greater than those listed herein. Contractor shall

recommend reconfiguring the LAN as necessary to accomplish these performance requirements.:

1. 5 seconds between a Level 1 (critical) alarm occurrence and enunciation at operator workstation.
 2. 10 seconds between a Level 2 alarm occurrence and enunciation at operator workstation.
 3. 20 seconds between and a Level 3-5 alarm occurrence and enunciation at operator workstation.
 4. 10 seconds between an operator command via the operator interface to change a setpoint and the subsequent change in the controller.
 5. 5 seconds between an operator command via the operator interface to start/stop a device and the subsequent command to be received at the controller.
 6. 10 seconds between a change of value or state of an input and it being updated on the operator interface.
 7. 10 seconds between an operator selection of a graphic and it completely painting the screen and updating at least 10 points.
- G. Control Systems Server (CSS): A server class computer(s) that maintains the systems configuration and programming database. This server is located at the State of Delaware's data center in a virtual environment and serves as an access point to BAS. It shall hold the backup files of the information downloaded into the individual controllers and as such support uploading and downloading that information directly to/from the controllers. It shall also act as a control information server to non-control system based programs. It shall allow secure multiple-access to the control information. Refer to Section 23 09 52 - BAS Operator Interfaces for its requirements.
- H. The Operator Interface shall provide for overall system supervision, graphical user interface, management report generation, alarm annunciation, and remote monitoring. Refer to Section 23 09 52 - BAS Operator Interfaces.
- I. The BCs, AACs, ASCs, [and SDs] shall monitor, control, and provide the field interface for all points specified. Each BC, AAC, or ASC shall be capable of performing all specified energy management functions, and all DDC functions, independent of other BCs, AACs, or ASCs and operator interface devices as more fully specified in Section 23 09 53 - BAS Field Panels.
- J. Systems Configuration Database: The system architecture shall support maintaining the systems configuration database on the CSS. User tools provided to the State shall allow configuring, updating, maintaining, etc. current configurations and settings whether they are initiated at the server or the end device.
1. Database Schematics shall be published and provided to the State to facilitate easy access to the data.
 2. Database shall be ODBC compliant.
- K. Interruptions or fault at any point on any Primary Controller LAN shall not interrupt communications between other nodes on the network. If a LAN is severed, two separate networks shall be formed and communications within each network shall continue uninterrupted.
- L. All line drivers, signal boosters, and signal conditioners etc. shall be provided as necessary for proper data communication.
- M. Anytime any controller's database or program is changed in the field, the controller shall be capable of automatically uploading the new data to the CSS.

1.12 WARRANTY MAINTENANCE

- A. Contractor shall warrant all products and labor for a period of (2) two years after Substantial Completion.
- B. The State reserves the right to make changes to the BAS during the warranty period. Such changes do not constitute a waiver of warranty. The Contractor shall warrant parts and installation work regardless of any such changes made by the State, unless the Contractor

provides clear and convincing evidence that a specific problem is the result of such changes to the BAS.

- C. At no cost to the State, during the warranty period, the Contractor shall provide maintenance services for software and hardware components as specified below:
1. Maintenance services shall be provided for all devices and hardware specified in sections 23 09 51 through 23 09 59 . Service all equipment per the manufacturer's recommendations. All devices shall be calibrated within the last month of the warranty period.
 2. Emergency Service: Any malfunction, failure, or defect in any hardware component or failure of any control programming that would result in property damage or loss of comfort control shall be corrected and repaired following notification by the State to the Contractor.
 - a. Response by telephone to any request for service shall be provided within two (2) hours of the State's initial telephone request for service.
 - b. In the event that the malfunction, failure, or defect is not corrected through the telephonic communication, at least one (1) hardware and software technician, trained in the system to be serviced, shall be dispatched to the State's site within eight (8) hours of the State's initial telephone request for such services, as specified.
 3. Normal Service: Any malfunction, failure, or defect in any hardware component or failure of any control programming that would not result in property damage or loss of comfort control shall be corrected and repaired following telephonic notification by the State to the Contractor.
 - a. Response by telephone to any request for service shall be provided within eight (8) working hours (contractor specified 40 hr per week normal working period) of the State's initial telephone request for service.
 - b. In the event that the malfunction, failure, or defect is not corrected through the telephonic communication, at least one (1) hardware and software technician, trained in the system to be serviced, shall be dispatched to the State's site within three (3) working days of the State's initial telephone request for such services, as specified.
 4. Telephonic Request for Service: Contractor shall specify a maximum of three telephone numbers for The State to call in the event of a need for service. At least one of the lines shall be attended at any given time at all times. Alternatively, pagers can be used for technicians trained in system to be serviced. One of the three paged technicians shall respond to every call within 15 minutes.
 5. Technical Support: Contractor shall provide technical support by telephone throughout the warranty period.
 6. Preventive maintenance shall be provided throughout the warranty period in accordance with the hardware component manufacturer's requirements.

1.13 DELIVERY, STORAGE, AND HANDLING

- A. Provide factory-shipping cartons for each piece of equipment and control device. Maintain cartons during shipping, storage and handling as required to prevent equipment damage, and to eliminate dirt and moisture from equipment. Store equipment and materials inside and protect from weather.

1.14 LISTING AND LABELING

- A. The BAS and components shall be listed by Underwriters Laboratories (UL 916) as an Energy Management System.

PART 2 - PRODUCTS

2.01 MANUFACTURERS (PRE-APPROVED BY THE STATE)

- A. Automated Logic by Radius Systems
B. Substitutions: See Section 01 60 00 - Product Requirements

2.02 MATERIALS AND EQUIPMENT

- A. Materials shall be new, the best of their respective kinds without imperfections or blemishes and shall not be damaged in any way. Used equipment shall not be used in any way for the permanent installation except where drawings or specs specifically allow existing materials to remain in place.

2.03 UNIFORMITY

- A. To the extent practical, all equipment of the same type serving the same function shall be identical and from the same manufacturer.
- B. All new controllers installed on the control system network shall be furnished and installed by the BAS contractor.

PART 3 - EXECUTION

3.01 INSPECTION

- A. Examine areas and conditions under which control systems are to be installed. Do not proceed with work until unsatisfactory conditions have been corrected in manner acceptable to Installer.

3.02 INSTALLATION OF CONTROL SYSTEMS

- A. General: Install systems and materials in accordance with manufacturer's instructions, roughing-in drawings and details shown on drawings.
- B. Network Connectivity: The BAS contractor shall provide two network connections with Cat-6 cables from the Building Controller to the State's IT network.
 - 1. The BAS contractor shall terminate one end of the two Cat-6 cables at or around the State's patch panel and make connections to the State's switch with green patch cables, following the instruction of the DFM's IT personnel.
 - 2. The BAS contractor shall terminate the other end of the two Cat-6 cables near or within the building controller cabinet with dual RJ-45 terminal box and make connection of one cable to the building controller. Note: the second connection is for on-site operator interface through a mobile computer. Exposed cable shall be protected by conduit or wire mold.
 - 3. The BAS contractor shall label the two network connections BAC-1 and BAC-2 on both ends.
- C. Refer to additional requirements in other sections of this specification.

3.03 SURGE PROTECTION

- A. The Contractor shall furnish and install any power supply surge protection, filters, etc. as necessary for proper operation and protection of all BCs, AAC/ASCS operator interfaces, printers, routers, gateways and other hardware and interface devices. All equipment shall be capable of handling voltage variations 10% above or below measured nominal value, with no effect on hardware, software, communications, and data storage.

3.04 DEMOLITION AND REUSE OF EXISTING MATERIALS AND EQUIPMENT

- A. Contractor shall assume that existing equipment that specifically is indicated to be reused is in good condition and is operable. Contractor, during the course of work, shall inspect these devices and determine if any devices are in need of replacement or repair. Contractor shall prepare an itemized list of suggested repairs/replacement. This repair/replacement will be at the discretion of the State and will be accomplished by expanding this contract.
- B. Existing wire, conduit, and control panel cabinets may be reused at the State Project Engineer's discretion, but only if such materials or equipment comply with the applicable specification for new materials and equipment. Such materials shall not be reused if visibly damaged or otherwise unsuitable for the intended service.
- C. Where such materials are reused, the contractor's shop drawings shall reflect the existing wiring designation. If existing labeling is illegible or otherwise does not comply with the

applicable specification for labeling, wiring runs shall be relabeled in accordance with the requirements specified elsewhere.

- D. Existing valves and dampers and their operators may be reused only when preapproved by the State. Contractor shall lubricate all damper linkages of dampers being controlled under this project.
- E. Other materials and equipment not specifically mentioned herein may be reused only if specifically allowed by indications on the drawings.
- F. For HVAC systems which are indicated to receive a new BAS, all existing materials and equipment associated with the EMCS shall be removed unless otherwise specified or indicated to remain, or unless reused in accordance with the above requirements, except for the following: 1) conduit and electrical boxes (but not wiring within conduit) may remain in place if not reused (leave a pull line); 2) inaccessible tubing may remain in place if not reused. Existing materials and equipment to be removed shall be removed subject to the requirements in paragraph "Sequence of Work". For HVAC systems, which are not to receive a new DDC BAS, the existing control system shall remain fully functional.

3.05 SEQUENCE OF WORK FOR EXISTING SYSTEMS CONVERSION

- A. General: All work involving changeover of control functions from existing control system to the new DDC BAS shall be performed in accordance with the following sequence in order to minimize the duration of equipment outages. The following descriptions are intended to indicate the sequence in which the work shall be performed, not to define fully the scope of the work.
- B. Install operator's terminal, peripherals, graphic software, and LAN prior to placing any equipment under the control of the new BAS.
- C. Work which requires shutting down a pump motor, fan motor, or chiller shall be considered a utility shutdown and shall be subject to the restrictions specified in Division 0.1
- D. The following sequence applies to an individually controlled HVAC subsystem, such as an air handling unit. Only one such system shall be placed under manual control (as described below) at any given time.
 - 1. Install controllers adjacent to (or within) existing control panel. Programming shall be complete (except for loading and debugging) prior to installation. Install all field devices, which do not require interruption of the existing control system.
 - 2. Install all conduit, wiring, and tubing which does not require interruption of the existing control system.
 - 3. Remove existing controls including wiring, conduit, and tubing (except materials to be reused in accordance with provisions specified elsewhere) which must be removed to facilitate installation of new BAS materials and equipment.
 - 4. Remove existing digital control system points (if applicable). Install and calibrate remainder of new BAS materials and equipment for this subsystem. Load controller software. Connect controller(s) to LAN.
 - 5. Perform all field testing and calibration that does not require connection of permanent outputs.
 - 6. Schedule work in The State's occupied spaces 3 days in advance with the State's representative.

3.06 CONTROL POWER SOURCE AND SUPPLY

- A. Section 23 09 50 Contractor shall extend all power source wiring required for operation of all equipment and devices provided under Sections 23 09 50 through 23 09 55 and Sequences of Operation.
- B. General requirements for obtaining power include the following:
 - 1. Obtain power from a source that feeds the equipment being controlled such that both the control component and the equipment are powered from the same panel. Where

equipment is powered from a 460V source, obtain power from the electrically most proximate 120v source fed from a common origin.

2. Where control equipment is located inside a new equipment enclosure, coordinate with the equipment manufacturer and feed the control with the same source as the equipment. If the equipment's control transformer is large enough and of the correct voltage to supply the controls it may be used. If the equipment's control transformer is not large enough or of the correct voltage to supply the controls provide separate transformer
3. Where a controller controls multiple systems on varying levels of power reliability (normal, emergency, and/or interruptible), the controller shall be powered by the highest level of reliability served. Furthermore, the controller in that condition shall monitor each power type served to determine so logic can assess whether a failure is due to a power loss and respond appropriately. A three-phase monitor into a digital input shall suffice as power monitoring.
4. Standalone Functionality: Refer to Section 23 09 53.

3.07 BAS STARTUP, COMMISSIONING AND TRAINING

- A. Refer to Section 23 09 59

3.08 SEQUENCE OF OPERATION

- A. Refer to Section 23 09 58 - Sequences of Operation

END OF SECTION 23 09 50

THIS PAGE INTENTIONALLY LEFT BLANK

SECTION 23 09 51
BAS BASIC MATERIALS, INTERFACE DEVICES, AND SENSORS

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. Wiring
- B. Control Dampers and Actuators
- C. Control Panels
- D. Sensors
- E. Electric Control Components (Switches, EP Valves, Thermostats, Relays, Smoke Detectors, etc.)
- F. Transducers
- G. Air Flow Measuring Stations
- H. Current Switches
- I. Nameplates
- J. Testing Equipment

1.02 RELATED DOCUMENTS

- A. Section 23 09 50 - Building Automation System (BAS) General
- B. Section 23 09 53 - BAS Field Panels
- C. Section 23 09 54 - BAS Communications Devices
- D. Section 23 09 55 - BAS Software
- E. Section 23 09 58 - Sequences of Operation
- F. Section 23 09 59 - BAS Commissioning

1.03 DESCRIPTION OF WORK

- A. Refer to Section 23 09 50 for general requirements.
- B. Refer to other Division 23 sections for installation of instrument wells, valve bodies, and dampers in mechanical systems; not work of this section.
- C. Provide the following electrical work of this section, complying with requirements of Division 26 sections:
 - 1. Control wiring between field-installed controls, indicating devices, and unit control panels.
 - 2. Interlock wiring between electrically interlocked devices, sensors, and between a hand or auto position of motor starters as indicated for all mechanical and controls.
 - 3. Wiring associated with indicating and alarm panels (remote alarm panels) and connections to their associated field devices.
 - 4. All other necessary wiring for fully complete and functional control system as specified.

1.04 WORK BY OTHERS

- A. Control Dampers furnished under this section shall be installed under the applicable air distribution or air handling equipment section under the direction of Section 23 09 51 Contractor who will be fully responsible for the proper operation of the damper
- B. Controlled Equipment Power Wiring shall be furnished and installed under Division 26. Where control involves 120V control devices controlling 120V equipment, Division 26 Contractor shall extend power wiring to the equipment. Section 23 09 51 Contractor shall extend it from the equipment to the control device.

PART 2 - PRODUCTS

2.01 MATERIALS AND EQUIPMENT

- A. General: Provide electronic control products in sizes and capacities indicated, consisting of valves, dampers, thermostats, clocks, controllers, sensors, and other components as required for complete installation and reviewed and approved by the State. Except as otherwise indicated, provide manufacturer's standard materials and components as published in their product information; designed and constructed as recommended by manufacturer, and as required for application indicated.
- B. Communication Wiring: All wiring shall be in accordance with National Electrical Codes and Division 26 of this specification.
 - 1. Contractor shall supply all communication wiring between Building Controllers, Routers, Gateways, AAC's, ASC's and local and remote peripherals (e.g., operator workstations, printers, and modems).
 - 2. Local Supervisory LAN: For any portions of this network required under this section of the specification, contractor shall use Fiber or Category 6 of standard TIA/EIA (100/1000BaseT). Network shall be run with no splices and separate from any wiring over thirty (30) volts.
 - 3. Primary and Secondary roller LANs: Communication wiring shall be individually 100% shielded pairs per manufacturers recommendations for distances installed, with overall PVC cover, Class 2, plenum-rated run with no splices and separate from any wiring over thirty (30) volts. Shield shall be terminated and wiring shall be grounded as recommended by BC manufacturer.
- C. Signal Wiring: Contractor shall run all signal wiring in accordance with National Electric Codes and Division 26 of this Specification.
 - 1. Signal wiring to all field devices, including, but not limited to, all sensors, transducers, transmitters, switches, etc. shall be twisted, 100% shielded pair, minimum 18-gauge wire, with PVC cover. Signal wiring shall be run with no splices and separate from any wiring above thirty (30) volts.
 - 2. Signal wiring shield shall be grounded at controller end only unless otherwise recommended by the controller manufacturer.
- D. Low Voltage Analog Output Wiring: Contractor shall run all low voltage control wiring in accordance with National Electric Codes and Division 26 of this Specification.
 - 1. Low voltage control wiring shall be minimum 16-gauge, twisted pair, 100% shielded, with PVC cover, Class 2 plenum-rated. Low voltage control wiring shall be run with no splices separate from any wiring above thirty (30) volts.
- E. Control Panels: Provide control panels with suitable brackets for wall mounting for each control system. Locate panel adjacent to systems served.
 - 1. Fabricate panels of 16-gage furniture-grade steel, or 6063-T5 extruded aluminum alloy, totally enclosed on four sides, with hinged door and keyed lock, with manufacturer's standard shop- painted finish and color.
 - 2. Provide UL-listed cabinets for use with line voltage devices.
 - 3. Control panel shall be completely factory wired and piped, and all electrical connections made to a terminal strip. Control panel shall have standard manufacturer's color.
 - 4. All gauges and control components shall be identified by means of nameplates.
 - 5. All control tubing and wiring shall be run neatly and orderly in open slot wiring duct with cover.
 - 6. Complete wiring and tubing termination drawings shall be mounted in or adjacent to panel.
- F. Cooling Tower and Closed Circuit Coolers: Contractor to field wire and install in galvanized conduit all sensors/control devices provided with the equipment.

2.02 CONTROL DAMPERS

- A. General: Provide factory fabricated automatic control dampers of sizes, velocity and pressure classes as required for smooth, stable, and controllable air flow. Provide parallel or opposed blade dampers as recommended by manufacturers sizing techniques. For dampers located near fan outlets, provide dampers rated for fan outlet velocity and close-off pressure, and recommended by damper manufacturer for fan discharge damper service. Control dampers used for smoke dampers shall comply with UL 555S. Control Dampers used for fire dampers shall comply with UL 555.
- B. For general isolation and modulating control service in rectangular ducts at velocities not greater than 1500 fpm (7.62 m/s), differential pressure not greater than 2.5" w.c. (622 Pa):
 - 1. Performance: Test in accordance with AMCA 500.
 - 2. Frames: Galvanized steel, 16-gauge minimum thickness, welded or riveted with corner reinforcement.
 - 3. Blades: Stainless steel in lab exhausts and galvanized steel elsewhere, maximum blade size 8 inches (200 mm) wide by 48 inches (1219 mm) long, attached to minimum 1/2 inch (12.7 mm) shafts with set screws, 16 gauge minimum thickness.
 - 4. Blade Seals: Synthetic elastomer, mechanically attached, field replaceable.
 - 5. Jamb Seals: Stainless steel.
 - 6. Shaft Bearings: Oil impregnated sintered bronze, graphite impregnated nylon sleeve or other molded synthetic sleeve, with thrust washers at bearings.
 - 7. Linkage: Concealed in frame.
 - 8. Linkage Bearings: Oil impregnated sintered bronze or graphite impregnated nylon.
 - 9. Leakage: Less than one percent based on approach velocity of 1500 ft./min. (7.62 m/s) and 1 inches wg. (249Pa).
 - 10. Maximum Pressure Differential: 2.5 inches wg. (622 Pa)
 - 11. Temperature Limits: -40 to 200 °F (-40 to 93 °C).
 - 12. Where opening size is larger than 48 inches (1219 mm) wide, or 72 inches (1829 mm) high, provide dampers in multiple sections, with intermediate frames and jackshafts appropriate for installation.
- C. For general isolation and modulating control service in rectangular ducts at velocities not greater than 4000 fpm (20.3 m/s), differential pressure not greater than 6" w.c. (1493 Pa):
 - 1. Performance: Test in accordance with AMCA 500.
 - 2. Frames: Galvanized steel, 16-gauge minimum thickness, welded or riveted with corner reinforcement.
 - 3. Blades: extruded aluminum hollow airfoil shape, maximum blade size 8 inches (200 mm) wide by 48 inches (1219 mm) long, attached to minimum 1/2 inch (12.7 mm) shafts, 14 gauge minimum extrusion thickness.
 - 4. Blade Seals: Synthetic elastomeric, mechanically attached, field replaceable.
 - 5. Jamb Seals: Stainless steel.
 - 6. Shaft Bearings: Oil impregnated sintered bronze sleeve, graphite impregnated nylon sleeve, molded synthetic sleeve, or stainless steel sleeve, with thrust washers at bearings.
 - 7. Linkage: Concealed in frame.
 - 8. Linkage Bearings: Oil impregnated sintered bronze or graphite impregnated nylon.
 - 9. Leakage: Less than 0.1 percent based on approach velocity of 4000 ft./min. (20.3 m/s) and 1 inches wg. (249Pa).
 - 10. Maximum Pressure Differential: 6 inches wg. (622 Pa)
 - 11. Temperature Limits: -40 to 200 °F (-40 to 93 °C).
 - 12. Where opening size is larger than 48 inches (1219 mm) wide, or 72 inches (1829 mm) high, provide dampers in multiple sections, with appropriately intermediate frames, and jackshafts.
- D. For general isolation and modulating control service in rectangular ducts at velocities not greater than 4000 fpm, differential pressure not greater than 12" w.c.:

1. Performance: Test in accordance with AMCA 500.
 2. Frames: Galvanized steel, 12-gauge minimum thickness, welded or riveted with corner reinforcement.
 3. Blades: Extruded aluminum hollow airfoil shape, maximum blade size 8 inches (200 mm) wide by 48 inches (1219 mm) long, attached to minimum 3/4 inch (19 mm) shafts with set screws
 4. Shaft Bearings: Oil impregnated sintered bronze or stainless steel, pressed into frame, with thrust washers at bearings.
 5. Linkage: 10-gauge minimum thickness galvanized steel clevis type crank arms, 3/16" x 3/4" (4.76 mm x 19 mm) minimum thickness tie rods.
 6. Linkage Bearings: Oil impregnated sintered bronze or graphite impregnated nylon.
 7. Leakage: Less than 0.2 percent based on approach velocity of 4000 ft./min. (20.3 m/s) and 1 inches wg. (249Pa) differential pressure.
 8. Maximum Pressure Differential: 12 inches wg. (2984 Pa)
 9. Temperature Limits: -40 to 300 °F (-40 to 149 °C).
 10. Where opening size is larger than 48 inches (1219 mm) wide, or 72 inches (1829 mm) high, provide dampers in multiple sections, with appropriately intermediate frames, and jackshafts.
- E. For general isolation and modulating control service in round ducts up to 40 inches in size at velocities not greater than 2500 fpm (12.7 m/s), differential pressure not greater than 4" w.c. (994 Pa):
1. Performance: Test in accordance with AMCA 500.
 2. Frames: rolled 12 gauge steel strip for sizes 6 inch and smaller, rolled 14 gauge steel channel for larger sizes, galvanized or aluminum finish.
 3. Blades: Steel construction, 12 gauge minimum thickness for dampers less than 18 inches (457 mm) in size, 10 gauge minimum thickness for larger dampers.
 4. Blade Seals: Full circumference neoprene.
 5. Shaft: 1/2 inch (12.7 mm) diameter zinc or cadmium plated steel.
 6. Shaft Bearings: Oil impregnated sintered bronze or stainless steel, pressed into frame, with thrust washers at bearings.
 7. Leakage: Less than 0.2 percent based on approach velocity of 4000 ft./min. (20.3 m/s) and 1 inches wg. (249Pa) differential pressure.
 8. Maximum Pressure Differential: 4 inches wg. (994 Pa)
 9. Temperature Limits: -40 to 300 °F (-40 to 149 °C).
- F. For general isolation and modulating control service in round ducts up to 60 inches in size at velocities not greater than 4000 fpm (20.3 m/s), differential pressure not greater than 6" w.c. (1492 Pa):
1. Performance: Test in accordance with AMCA 500.
 2. Frames: rolled 10-gauge steel channel for sizes 48 inch and smaller, rolled 3/16 inch (4.76 mm) thick steel channel for larger sizes, galvanized or aluminum finish.
 3. Blades: Steel construction, 10-gauge minimum thickness for dampers not greater than 48 inches in size, 1/4 inch (6.35 mm) minimum thickness for larger dampers.
 4. Blade stops: 1/2 inch x 1/4 inch (12.7 mm x 6.35 mm) full circumference steel bar.
 5. Blade Seals: Full circumference neoprene.
 6. Shaft: zinc or cadmium plated steel, angle reinforcing as necessary.
 7. Shaft Bearings: Oil impregnated sintered bronze or stainless steel, pressed into frame, with thrust washers at bearings.
 8. Leakage: Less than 0.4 percent based on approach velocity of 4000 ft./min. (20.3 m/s) and 1 inches wg. (249Pa) differential pressure.
 9. Maximum Pressure Differential: 6 inches wg. (1492 Pa)
 10. Temperature Limits: -40 to 250 °F (-40 to 121 °C).

2.03 ACTUATORS

- A. General: Size actuators and linkages to operate their appropriate dampers or valves with sufficient reserve torque or force to provide smooth modulating action or 2-position action as specified. Select spring-return actuators with manual override to provide positive shut-off of devices as they are applied.
- B. Damper Actuators
 - 1. Ambient Operating Temperature Limits: -10 to 150°F (-12.2 to 66 °C)
 - 2. Two Position Electric Actuators: Line voltage with spring return
 - 3. Electronic Actuators: Provide actuators with spring return for two-position (24v), 0-5 Vdc, 0-10 Vdc, 2-10Vdc, 4-20 mA, or PWM input (subject to restrictions) as required. Actuators shall travel full stroke in less than [90] seconds. Actuators shall be designed for a minimum of 60,000 full cycles at full torque and be UL 873 listed. Provide stroke indicator. Actuators shall have positive positioning circuit. Where two actuators are required in parallel or in sequence provide an auxiliary actuator driver. Actuators shall have current limiting motor protection. Actuators shall have manual override where indicated. Modulating actuators for valves shall have minimum rangeability of 40 to 1.
 - a. Close-Off Pressure: Provide the minimum torque required, and spring return for fail positioning (unless otherwise specifically indicated) sized for required close-off pressure. Required close-off pressure for two-way water valve applications shall be the shutoff head of associated pump. Required close-off rating of steam valve applications shall be design inlet steam pressure plus 50 percent for low pressure steam, and 10 percent for high pressure steam. Required close-off rating of air damper applications shall be shutoff pressure of associated fan, plus 10 percent.
 - b. Acceptable Manufacturers: Subject to compliance with requirements approved manufacturers are as follows:
 - 1) Belimo
 - 2) Johnson Controls
 - 3) Delta
 - 4) Invensys
 - 5) Substitutions: See Section 01 60 00 - Product Requirements

2.04 GENERAL FIELD DEVICES

- A. Provide field devices for input and output of digital (binary) and analog signals into controllers (BCs, AACs, ASCs). Provide signal conditioning for all field devices as recommended by field device manufacturers, and as required for proper operation in the system.
- B. It shall be the Contractor's responsibility to assure that all field devices are compatible with controller hardware and software.
- C. Field devices specified herein are generally 'two-wire' type transmitters, with power for the device to be supplied from the respective controller. If the controller provided is not equipped to provide this power, or is not designed to work with 'two-wire' type transmitters, or if field device is to serve as input to more than one controller, or where the length of wire to the controller will unacceptably affect the accuracy, the Contractor shall provide 'four-wire' type equal transmitter and necessary regulated DC power supply or 120 VAC power supply, as required.
- D. For field devices specified hereinafter that require signal conditioners, signal boosters, signal repeaters, or other devices for proper interface to controllers, Contractor shall furnish and install proper device, including 120V power as required. Such devices shall have accuracy equal to, or better than, the accuracy listed for respective field devices.
- E. Accuracy: As stated in this Section, accuracy shall include combined effects of nonlinearity, nonrepeatability and hysteresis.

2.05 TEMPERATURE SENSORS (TS)

- A. Sensor range: When matched with A/D converter of BC, AAC/ASC, or SD, sensor range shall provide a resolution of no worse than 0.3°F (0.16 °C) (unless noted otherwise). Where thermistors are used, the stability shall be better than 0.25°F over 5 years.
- B. Matched Sensors: The following applications shall require matched sensors:
 - 1. Air Handling Unit Sequencing: Provide matched pair for the cooling and heating coil leaving sensors where the sequence includes calculating an offset from the supply air setpoint to maintain a leaving heating coil temperature.
- C. Room Temperature Sensor: Shall be an element contained within a ventilated cover, suitable for wall mounting. Provide insulated base. Following sensing elements are acceptable:
 - 1. Sensing element shall be platinum RTD, thermistor, or integrated circuit, +/- 0.4°F accuracy at calibration point.
 - 2. Provide setpoint adjustment where indicated. The setpoint adjustment shall be a warmer/cooler indication that shall be scalable via the BAS.
 - 3. Provide an occupancy override button on the room sensor enclosure where indicated. This shall be a momentary contact closure
 - 4. Provide current temperature indication via an LCD or LED readout where indicated.
- D. Single-Point Duct Temperature Sensor: Shall consist of sensing element, junction box for wiring connections and gasket to prevent air leakage or vibration noise. Temperature range as required for resolution indicated in paragraph A. Sensor probe shall be 304 stainless steel.
 - 1. Sensing element shall be platinum RTD, thermistor, or integrated circuit, +/- 0.2°F accuracy at calibration point
- E. Averaging Duct Temperature Sensor: Shall consist of an averaging element, junction box for wiring connections and gasket to prevent air leakage. Provide sensor lengths and quantities to result in one lineal foot of sensing element for each three square feet of cooling coil/duct face area. Temperature range as required for resolution indicated in paragraph A.
 - 1. Sensing element shall be platinum RTD, or thermistor, +/- 0.2°F accuracy at calibration point.
- F. Outside air sensors shall consist of a sensor, sun shield, utility box, and watertight gasket to prevent water seepage. Temperature range shall be as require for resolution indicated in Paragraph A
 - 1. Sensing element shall be platinum RTD, thermistor, or integrated circuit, +/- 0.4°F accuracy at calibration point.

2.06 TEMPERATURE TRANSMITTERS

- A. Where required by Controller, or where wiring runs are over 50 feet, sensors as specified above may be matched with transmitters outputting 4-20 mA linearly across the specified temperature range. Transmitters shall have zero and span adjustments, an accuracy of 0.1°F when applied to the sensor range.

2.07 HUMIDITY TRANSMITTERS

- A. Units shall be suitable for duct, wall (room) or outdoor mounting. Unit shall be two-wire transmitter utilizing bulk polymer resistance change or thin film capacitance change humidity sensor. Unit shall produce linear continuous output of 4-20 mA for percent relative humidity (% RH). A combination temperature and humidity sensor may be used for zone level monitoring. Sensors shall have the following minimum performance and application criteria:
 - 1. Input Range: 0 to 100% RH.
 - 2. Accuracy(% RH): +/- 2% (when used for enthalpy calculation, dewpoint calculation or humidifier control) or +/- 3% (monitoring only) between 20-90% RH at 77°F, including hysteresis, linearity, and repeatability.
 - 3. Sensor Operating Range: As required by application
 - 4. Long Term Stability: Less than 1% drift per year.

- B. Acceptable Manufacturers: Units shall be Vaisala HM Series, General Eastern, Microline, or Hy-Cal HT Series. Substitutions shall be allowed per Division 1.

2.08 DIFFERENTIAL PRESSURE TRANSMITTERS (DP)

- A. General Purpose - Water: Two-wire transmitter, 4-20 mA output with zero and span adjustments. Plus or minus 0.5% overall accuracy, 450 psig (3103 KPa) maximum static pressure rating, 200 psid maximum overpressure rating for 6 through 60 psid range, 450 psid for 100 through 300 psid range. Acceptable units shall be Kele & Associates Model 360 C. Substitutions shall be allowed per Division 1.
- B. General Purpose Low Pressure Air: Generally for use in static measurement of duct pressure or constant volume air velocity pressure measurement where the range is applicable.
1. General: Loop powered two-wire differential capacitance cell-type transmitter.
 2. Output: two wire 4-20 mA output with zero adjustment.
 3. Overall Accuracy: Plus or minus 1%.
 4. Minimum Range: 0.1 in. w.c.
 5. Maximum Range: 10 inches w.c.
 6. Housing: Polymer housing suitable for surface mounting.
 7. Acceptable Manufacturers: Modus T30. Substitutions shall be allowed per Division 1.
 8. Static Sensing Element: Pitot-type static pressure sensing tips similar to Dwyer model A-301 and connecting tubing.
 9. Range: Select for specified setpoint to be between 25% and 75% full-scale.
- C. General Purpose Low Pressure/Low Differential Air: Generally for use in static measurement of space pressure or constant volume air velocity pressure measurement where the range is applicable.
1. General: Loop powered, two-wire differential capacitance cell type transmitter.
 2. Output: Two-wire 4-20 mA output with zero adjustment.
 3. Overall Accuracy: Plus or minus 1%.
 4. Minimum Range: 0 in. w.c.
 5. Maximum Range: 0.1, 0.25, or 0.5 inches w.c.
 6. Housing: Polymer housing suitable for surface mounting.
 7. Acceptable Manufacturers: Modus T30. Substitutions shall be allowed per Division 1.
 8. Static Sensing Element: Pitot-type static pressure sensing tips similar to Dwyer model A-301 and connecting tubing.
 9. Range: Select for specified setpoint to be between 25% and 75% full-scale.
- D. VAV Velocity Pressure: Generally for use in variable volume air velocity pressure measurement where the range is applicable.
1. General: Loop powered two-wire differential capacitance cell type transmitter.
 2. Output: Two-wire, 4-20 mA output with zero adjustment.
 3. Overall Accuracy: Plus or minus 0.25%
 4. Minimum Range: 0 in. w.c.
 5. Maximum Range: 1 inch w.c.
 6. Housing: Polymer housing suitable for surface mounting.
 7. Acceptable Manufacturers: Setra. Substitutions shall be allowed per Division 1.
 8. Range: Select for minimum range that will accept the maximum velocity pressure expected.

2.09 DIFFERENTIAL PRESSURE SWITCHES (DPS)

- A. General Service - Air: Diaphragm with adjustable setpoint and differential and snap acting form C contacts rated for the application. Provide manufacturer's recommended static pressure sensing tips and connecting tubing
- B. General Service - Water: Diaphragm with adjustable setpoint, 2 psig or adjustable differential, and snap-acting Form C contacts rated for the application. 60 psid minimum pressure differential range. 0°F to 160°F operating temperature range.

2.10 PRESSURE SWITCHES (PS)

- A. Diaphragm or bourdon tube with adjustable setpoint and differential and snap-acting Form C contacts rated for the application. Pressure switches shall be capable of withstanding 150% of rated pressure.
- B. Acceptable Manufacturers: Square D, ITT Neo-Dyn, ASCO, Penn, Honeywell, and Johnson Controls. Substitutions shall be allowed per Division 1.

2.11 TRANSDUCERS

- A. Binary to Analog Transducers ([Pulse Width Modulating] or Tri-State-to-Voltage or -Current):
 - 1. Adjustable zero and span.
 - 2. Failure Mode on Power Loss: Shall be provided with memory feature to allow the transducer to return to last value on power failure.
 - 3. Accuracy: $\pm 1\%$ of span
 - 4. Output Span: 4-20 mA, 0-5 Vdc, 1-5 Vdc, 0-10Vdc, 2-10Vdc, 0-15Vdc, 3-15Vdc
 - 5. Input: 4-20 mA, pulse width modulated or tri-state input.
 - 6. Pulse Width Modulated] and Tri-state Input Time Base: Dip switch selectable.
 - 7. Enclosure: Polymer designed for surface or panel mount.
 - 8. Failure Mode on Power Loss: Non-failsafe transducers shall have no output air loss. Failsafe transducers shall exhaust output upon power loss.
 - 9. Acceptable Manufacturers: RE Technologies Model PWA Series. Substitutions shall be allowed per Division 1.
- B. Electronic-to-Electronic (Voltage or Current to Current or Voltage):
 - 1. Adjustable zero and span.
 - 2. Failure Mode on Power Loss: Memory feature to allow the transducer to return to last value on power failure.
 - 3. Accuracy: $\pm 1\%$ of span.
 - 4. Output Span: 4-20 mA, 0-5 Vdc, 1-5 Vdc, 0-10 Vdc, 2-10 Vdc, 0-15 Vdc, 3-15 Vdc.
 - 5. Input: 0-20 Vdc, 0-20 ma, 0-10 kOhm.
 - 6. Pulse Width Modulated] and Tri-state Input Time Base: Dip switch selectable
 - 7. Enclosure: Polymer enclosure designed for surface or panel mount.
 - 8. Acceptable Manufacturers: RE Technologies Model PWA Series. Substitutions shall be allowed per Division 1.

2.12 CURRENT SWITCHES (CS)

- A. Clamp-On or Solid-Core Design Current Operated Switch (for Constant Speed Motor Status Indication)
 - 1. Range: 1.5 to 150 amps.
 - 2. Trip Point: Adjustable.
 - 3. Switch: Solid state, normally open, 1 to 135 Vac or Vdc, 0.3 Amps. Zero off state leakage.
 - 4. Lower Frequency Limit: 6 Hz.
 - 5. Trip Indication: LED
 - 6. Approvals: UL, CSA
 - 7. Max. Cable Size: 350 MCM
 - 8. Acceptable Manufacturers: Veris Industries H-708/908; Inc., RE Technologies SCS1150A-LED. Substitutions shall be allowed per Division 1.
- B. Clamp-on or Solid-Core Wire Through Current Switch (CS/CR) (for Constant Speed Motors): Same as CS with 24v command relay rated at 5A @ 240 Vac resistive, 3A @ 240 Vac inductive, load control contact power shall be induced from monitored conductor (minimum conductor current required to energize relay 5A, max. rating of 135A). Acceptable Manufacturers shall be Veris Industries, Inc., Model # H938/735; or RE Technologies RCS 1150. Substitutions shall be allowed per Division 1.

1. Where used for single-phase devices, provide the CS/CR in a self-contained unit in a housing similar with override switch to Kele RIBX. Substitutions shall be allowed per Division 1.
- C. Clamp-On Design Current Operated Switch for Variable Speed Motor Status Indication
 1. Range: 1.5 to 135 Amps.
 2. Trip Point: Self-calibrating based on VA memory associated with frequency to detect loss of belt with subsequent increase of control output to 60 Hz.
 3. Switch: Solid state, normally open, 1 to 135 Vac or Vdc, 0.3 Amps. Zero off state leakage.
 4. Frequency Range: 5-75 Hz
 5. Trip Indication: LED
 6. Approvals: UL, CSA
 7. Max. Cable Size: 350 MCM
 8. Acceptable Manufacturers: Veris Industries, Inc. H-904. Substitutions shall be allowed per Division 1.
- D. Clamp-On Wire Through Current Switch (CS/CR) (for Variable Speed Motors): Same as CS with 24v command relay rated at 5A @ 240 Vac resistive, 3A @ 240 Vac inductive, load control contact power shall be induced from monitored conductor (minimum conductor current required to energize relay 5A, max. rating of 135A). Acceptable manufacturer shall be Veris Industries, Inc., Model # H934. Substitutions shall be allowed per Division 1.
- E. Variable Speed Status: Where current switches are used to sense the status for variable speed devices, the CT shall include on-board VA/Hz memory to allow distinction between a belt break and subsequent ramp up to 60 Hz, versus operation at low speed. The belt break scenario shall be indicated as a loss of status and the operation at low speed shall indicate normal status.

2.13 CURRENT TRANSFORMERS (CT)

- A. Clamp-On Design Current Transformer (for Motor Current Sensing)
 1. Range: 1-10 amps minimum, 20-200 amps maximum
 2. Trip Point: Adjustable
 3. Output: 0-5 VDC.
 4. Accuracy: $\pm 0.2\%$ from 20 to 100 Hz.
 5. Acceptable Manufacturers: KELE SA100. Substitutions shall be allowed per Division 1.

2.14 OUTDOOR AIR STATIC PRESSURE SENSING TIP

- A. Pressure sensor: Pressure sensing tip shall be designed to minimize the effects of wind and resulting velocity pressure up to 80 mph. Acceptable manufacturers shall be Dwyer A-306. Substitutions shall be allowed per Division 1.
- B. Low Air Pressure Surge Dampener: 30-second time constant. Acceptable manufacturer shall be Modus SD030. Substitutions shall be allowed per Division 1.

2.15 CONTINUOUS LEVEL TRANSMITTERS

- A. Capacitance Type
 1. Provide a loop powered, continuous capacitance type level transmitter with adjustable span and zero.
 2. Output: 4-20 mA.
 3. Probe: Fluoropolymer coated stainless steel rod or cable. Provide cable probe with end attachment hardware or weight.
 4. Electrical Enclosure: NEMA-4, -7.
 5. Approvals: UL or CSA.
 6. Accuracy: $\pm 1\%$ of calibrated span.
 7. Process Connection: MPT or ANSI Flange as required.

8. Acceptable Manufacturers: Drexelbrook, Endress & Hauser. Substitutions shall be allowed per Division 1.

2.16 AIRFLOW MEASURING STATIONS (AFMS)

- A. Pitot Tube Grids: Provide an array of velocity pressure sensing elements with averaging manifolds and air straightening vanes packaged in a sheet metal casing. Distribute sensing elements in accordance with ASHRAE for traversing ducts. Provide taps to connect tubing from instrumentation. Label AFM with drawing number designation, design flow, velocity pressure, and pressure drop. Application of pitot grids shall be allowed only where minimum expected flow is greater than 30% or maximum flow
- B. Hot Wire Grid: Provide an array of hot wire anemometer with air straightening package in a sheet metal casing. Provide averaging circuitry and transmitter to transmit a linear signal proportional to airflow.
- C. Vortex Shedding Grid: Provide an array of vortex shedding elements designed to produce stable 'Karmen Vortices' that are linear with air velocity. Provide the electronics to totalize the pulses and output average velocity proportional to an output signal of 4-20ma.
 - 1. Sensor Accuracy: $\pm 1.5\%$
 - 2. Electronics Accuracy: $\pm 0.5\%$
 - 3. Range: Select minimum range to accommodate the expected flow range of the project
 - 4. Temperature Limits: 20-140°F
 - 5. Acceptable Manufacturer: Tek-Air Systems Inc. 'Vortek' Model. Ebtron 'Gold Series' Model. Substitutions shall be allowed per Division 1.

2.17 AIR VELOCITY PRESSURE SENSORS (INSERTION TYPE)

- A. Single or Multi-Point Averaging (as indicated): Sensing tip shall be for insertion into duct with mounting flange and push on tube connections. Material shall be suitable to the application.

2.18 CO2 SENSORS/TRANSMITTERS (CO2)

- A. CO2 sensors shall use silicon based, diffusion aspirated, infrared single beam, dual-wavelength sensor.
- B. Accuracy: ± 36 ppm at 800 ppm and 68°F.
- C. Stability: 5% over 5 years.
- D. Output: 4-20 mA, 0-10 Vdc or relay.
- E. Mounting: Duct or Wall as indicated.
- F. Acceptable Manufacturer: Vaisala, Inc. GMD20 (duct) or GMW20 (wall).

2.19 ELECTRIC CONTROL COMPONENTS

- A. Limit Switches (LS): Limit switches shall be UL listed, SPDT or DPDT type, with adjustable trim arm. Limit switches shall be as manufactured by Square D, Allen Bradley. Substitutions shall be allowed per Division 1.
- B. Low Temperature Detector ('Freezestat') (FZ): Low temperature detector shall consist of a 'cold spot' element which responds only to the lowest temperature along any one foot of entire element, minimum bulb size of 1/8" x 20' (3.2mm x 6.1m), junction box for wiring connections and gasket to prevent air leakage or vibration noise, DPST (4 wire, 2 circuit) with manual reset. Temperature range 15 to 55°F (-9.4 to 12.8°C), factory set at 38°F.
- C. High Temperature Detectors ('Firestat') (FS): High temperature detector shall consist of 3-pole contacts, a single point sensor, junction box for wiring connections and gasket to prevent air leakage of vibration noise, triple-pole, with manual reset. Temperature range 25 to 215°F (-4 to 102°C).
- D. Surface-Mounted Thermostat: Surface-mounted thermostat shall consist of SPDT contacts, operating temperature range of 50 to 150° F (10 to 65°C) , and a minimum 10°F fixed setpoint differential.

- E. Low Voltage Wall Thermostat: Wall-mounted thermostat shall consist of SPDT sealed mercury contacts, operating temperature range of 50 to 90°F (10 to 32°C), switch rating of 24 Vac (30 Vac max.), and both manual and automatic fan operation in both the heat and cool modes.
- F. Control Relays: All control relays shall be UL listed, with contacts rated for the application, and mounted in minimum NEMA-1 enclosure for indoor locations, NEMA-4 for outdoor locations.
 - 1. Control relays for use on electrical systems of 120 volts or less shall have, as a minimum, the following:
 - a. AC coil pull-in voltage range of +10%, -15% or nominal voltage.
 - b. Coil sealed volt-amperes (VA) not greater than four (4) VA.
 - c. Silver cadmium Form C (SPDT) contacts in a dustproof enclosure, with 8 or 11 pin type plug.
 - d. Pilot light indication of power-to-coil and coil retainer clips.
 - e. Coil rated for 50 and 60 Hz service.
 - f. Acceptable Manufacturers: Relays shall be Potter Brumfield, Model KRPA. Substitutions shall be allowed per Division 1.
 - g. Relays used for across-the-line control (start/stop) of 120V motors, 1/4 HP, and 1/3 HP, shall be rated to break minimum 10 Amps inductive load. Relays shall be IDEC. Substitutions shall be allowed per Division 1.
 - h. Relays used for stop/start control shall have low voltage coils (30 VAC or less), and shall be provided with transient and surge suppression devices at the controller interface.
- G. General Purpose Power Contactors: NEMA ICS 2, AC general-purpose magnetic contactor. ANSI/NEMA ICS 6, NEMA type 1 enclosure. Manufacturer shall be Square 'D', Cutler-Hammer or Westinghouse.
- H. Control Transformers: Furnish and install control transformers as required. Control transformers shall be machine tool type, and shall be US and CSA listed. Primary and secondary sides shall be fused in accordance with the NEC. Transformer shall be proper size for application, and mounted in minimum NEMA-1 enclosure.
 - 1. Transformers shall be manufactured by Westinghouse, Square 'D', or Jefferson. Substitutions shall be allowed per Division 1.
- I. Time Delay Relays (TDR): TDRs shall be capable of on or off delayed functions, with adjustable timing periods, and cycle timing light. Contacts shall be rated for the application with a minimum of two (2) sets of Form C contacts, enclosed in a dustproof enclosure.
 - 1. TDRs shall have silver cadmium contacts with a minimum life span rating of one million operations. TDRs shall have solid state, plug-in type coils with transient suppression devices.
 - 2. TDRs shall be UL and CSA listed, Crouzet type. Substitutions shall be allowed per Division 1.
- J. Electric Push Button Switch: Switch shall be momentary contact, oil tight, push button, with number of N.O. and/or N.C. contacts as required. Contacts shall be snap-action type, and rated for minimum 120 Vac operation. Switch shall be 800T type, as manufactured by Allen Bradley. Substitutions shall be allowed per Division 1.
- K. Electric Selector Switch (SS): Switch shall be maintained contact, NEMA ICS 2, oil-tight selector switch with contact arrangement, as required. Contacts shall be rated for minimum 120 Vac operation. Switch shall be 800T type, as manufactured by Allen-Bradley. Substitutions shall be allowed per Division 1.

2.20 NAMEPLATES

- A. Provide engraved phenolic or micarta nameplates for all equipment, components, and field devices furnished. Nameplates shall be 1/8 thick, black, with white center core, and shall be minimum 1" x 3", with minimum 1/4" high block lettering. Nameplates for devices smaller than 1" x 3" shall be attached to adjacent surface.

- B. Each nameplate shall identify the function for each device.

2.21 TESTING EQUIPMENT

- A. Contractor shall test and calibrate all signaling circuits of all field devices to ascertain that required digital and accurate analog signals are transmitted, received, and displayed at system operator terminals, and make all repairs and recalibrations required to complete test. Contractor shall be responsible for test equipment required to perform these tests and calibrations. Test equipment used for testing and calibration of field devices shall be at least twice as accurate as respective field device (e.g., if field device is $\pm 0.5\%$ accurate, test equipment shall be $\pm 0.25\%$ accurate over same range).

PART 3 - EXECUTION

3.01 INSPECTION

- A. Examine areas and conditions under which control systems are to be installed. Do not proceed with work until unsatisfactory conditions have been corrected in manner acceptable to Installer.

3.02 INSTALLATION OF CONTROL SYSTEMS

- A. General: Install systems and materials in accordance with manufacturer's instructions, roughing-in drawings and details shown on drawings. Install electrical components and use electrical products complying with requirements of National Electric Code and all local codes.
- B. Control Wiring: The term "control wiring" is defined to include providing of wire, conduit and miscellaneous materials as required for mounting and connection of electric control devices.
1. Wiring System: Install complete wiring system for electric control systems. Conceal wiring except in mechanical rooms and areas where other conduit and piping are exposed. Installation of wiring shall generally follow building lines. Install in accordance with National Electrical Code and Division 16 of this Specification. Fasten flexible conductors bridging cabinets and doors, neatly along hinge side, and protect against abrasion. Tie and support conductors neatly.
 2. Control Wiring Conductors: Install control wiring conductors, without splices between terminal points, color-coded. Install in neat workmanlike manner, securely fastened. Install in accordance with National Electrical Code and Division 16 of this Specification.
 3. Communication wiring, signal wiring and low voltage control wiring shall be installed separate from any wiring over thirty (30) volts. Signal wiring shield shall be grounded at controller end only, unless otherwise recommended by the controller manufacturer.
 4. All WAN and LAN Communication wiring shield shall be terminated as recommended by controller manufacturer. All WAN and LAN Communication wiring shall be labeled with a network number, device ID at each termination and shall correspond with the WAN and LAN system architecture and floor plan submittals.
 5. Install all control wiring external to panels in electric metallic tubing or raceway. However, communication wiring, signal wiring and low voltage control wiring may be run without conduit in concealed, accessible locations if noise immunity is ensured. Contractor will be fully responsible for noise immunity and rewire in conduit if electrical or RF noise affects performance. Accessible locations are defined as areas inside mechanical equipment enclosures, such as heating and cooling units, instrument panels etc.; in accessible pipe chases with easy access, or suspended ceilings with easy access. Installation of wiring shall generally follow building lines. Run in a neat and orderly fashion, bundled where applicable, and completely suspended (strapped to rigid elements or routed through wiring rings) away from areas of normal access. Tie and support conductors neatly with suitable nylon ties. Conductors shall not be supported by the ceiling system or ceiling support system. Conductors shall be pulled tight and be installed as high as practically possible in ceiling cavities. Wiring shall not be laid on the ceiling or duct. Conductors shall not be installed between the top cord of a joist or beam and the bottom of roof decking. Contractor shall be fully responsible for noise immunity and rewire in conduit if electrical or RF noise affects performance.

6. Number-code or color-code conductors appropriately for future identification and servicing of control system. Code shall be as indicated on approved installation drawings.
- C. Freezestats: Install freezestats in a serpentine fashion where shown on drawing. Provide one foot of element for each square foot of coil face area. Where coil face area exceeds required length of element, provide multiple devices, wired in parallel for normally open close on trip application, wired in series for normally closed, open on trip application. Adequately support with coil clips.
- D. Averaging Temperature Sensors: Cover no more than two square feet per linear foot of sensor length except where indicated. Generally where flow is sufficiently homogeneous/adequately mixed at sensing location, consult AE for requirements.
- E. Airflow Measuring Stations: Install per manufacturer's recommendations in an unobstructed straight length of duct (except those installations specifically designed for installation in fan inlet). For installations in fan inlets, provide on both inlets of double inlet fans and provide inlet cone adapter as recommended by AFM station manufacturer.
- F. Relative Humidity Sensors: Provide element guard as recommended by manufacturer for high velocity installations. For high limit sensors, position remote enough to allow full moisture absorption into the air stream before reaching the sensor.
- G. Differential Pressure Transmitters: Provide valve bypass arrangement to protect against over pressure damaging the transmitter.
- H. Current Switches for Motor Status Monitoring: Adjust so that setpoint is below minimum operating current and above motor no load current.
- I. Supply Duct Pressure Transmitters:
 1. General: Install pressure tips with at least 4 'round equivalent' duct diameters of straight duct with no takeoffs upstream. Install pressure tips securely fastened with tip facing upstream in accordance with manufacturer's installation instructions. Locate the transmitter at an accessible location to facilitate calibration.
 2. VAV System 'Down-Duct' Transmitters: Locate pressure tips approximately 2/3 of the hydraulic distance to the most remote terminal in the air system.
- J. Cutting and Patching Insulation: Repair insulation to maintain integrity of insulation and vapor barrier jacket. Use hydraulic insulating cement to fill voids and finish with material matching or compatible with adjacent jacket material.

END OF SECTION 23 09 51

THIS PAGE INTENTIONALLY LEFT BLANK

**SECTION 23 09 53
BAS FIELD PANELS**

PART 1 - GENERAL

1.01 SECTION INCLUDES:

- A. Building Controller (BC)
- B. Advance Application Specific Controller (AAC)
- C. Application Specific Controller (ASC)

1.02 RELATED DOCUMENTS:

- A. Section 23 09 50 - Building Automation System (BAS) General - Refer to this section for definitions of terminology
- B. Section 23 09 51 - BAS Basic Materials, Interface Devices, and Sensors
- C. Section 23 09 54 - BAS Communications Devices
- D. Section 23 09 55 - BAS Software
- E. Section 23 09 58 - Sequence of Operation
- F. Section 23 09 59 - BAS Commissioning

1.03 DESCRIPTION OF WORK:

- A. Furnish and install DDC Control units and/or Smart Devices required to support specified building automation system functions.
- B. Refer to Section 23 09 50 for general requirements.

PART 2 - PRODUCTS

2.01 STAND-ALONE FUNCTIONALITY

- A. General: These requirements clarify the requirement for stand-alone functionality relative to packaging I/O devices with a controller. Stand-alone functionality is specified with the controller and for each Application Category specified in Part 3. This item refers to acceptable paradigms for associating the points with the processor.
- B. Functional Boundary: Provide controllers so that all points associated with and common to one unit or other complete system/equipment shall reside within a single control unit. The boundaries of a standalone system shall be as dictated in the contract documents. Generally systems specified for the Application Category will dictate the boundary of the standalone control functionality. See related restrictions below. When referring to the controller as pertains to the standalone functionality, reference is specifically made to the processor. One processor shall execute all the related I/O control logic via one operating system that uses a common programming and configuration tool.
- C. The following configurations are considered acceptable with reference to a controller's standalone functionality:
 - 1. Points packaged as integral to the controller such that the point configuration is listed as an essential piece of information for ordering the controller (having a unique ordering number).
 - 2. Controllers with processors and modular back planes that allow plug in point modules as an integral part of the controller.
 - 3. I/O point expander boards, plugged directly into the main controller board to expand the point capacity of the controller.
 - 4. I/O point expansion devices connected to the main controller board via wiring and as such may be remote from the controller and that communicate via a sub LAN protocol. These arrangements to be considered standalone shall have a sub LAN that is dedicated to that controller and include no other controller devices (AACs or ASCs). All wiring to interconnect the I/O expander board shall be:
 - a. Contained in the control panel enclosure;

- b. Or run in conduit. Wiring shall only be accessible at the terminations.
- D. The following configurations are considered unacceptable with reference to a controller's standalone functionality:
 - 1. Multiple controllers enclosed in the same control panel to accomplish the point requirement.

2.02 BUILDING CONTROLLER (BC)

- A. General Requirements:
 - 1. The BC(s) shall provide fully distributed control independent of the operational status of the OWSs and CSS. All necessary calculations required to achieve control shall be executed within the BC independent of any other device. All control strategies performed by the BC(s) shall be both operator definable and modifiable through the Operator Interfaces.
 - 2. BCs shall perform overall system coordination, accept control programs, perform automated HVAC functions, control peripheral devices and perform all necessary mathematical and logical functions. BCs shall share information with the entire network of BCs and AACs/ASCs for full global control. Each controller shall be accessed through the CSS in normal operations. In the event that the CSS is not available, the controller shall permit multi-user operation from multiple OWS and mobile computers connected either locally or over the network. Each unit shall have its own internal RAM, non-volatile memory, microprocessor, battery backup, regulated power supply, power conditioning equipment, ports for connection of operating interface devices, and control enclosure. BCs shall be programmable from the CSS, OWS, mobile computer, or hand held device. BC shall contain sufficient memory for all specified global control strategies, user defined reports and trending, communication programs, and central alarming.
 - 3. BCs shall be connected to a controller network that qualifies as a controlling LAN.
 - 4. All BCs shall be provided with a UPS to protect against memory loss and allow for continuous communication with the CSS in the event of a loss of power.
 - a. The UPS shall be a 500 VA UPS equal to APC Back-UPS CS, 300 Watts / 500 VA, Input 120V / Output 120V, Interface Port DB-9 RS-232, USB
 - 5. In addition BCs may provide intelligent, standalone control of BAS functions. Each BC may be capable of standalone direct digital operation utilizing its own processor, non-volatile memory, input/output, wiring terminal strips, A/D converters, real-time clock/calendar and voltage transient and lightning protection devices. Refer to standalone functionality specified above.
 - 6. The BC may provide for point mix flexibility and expandability. This requirement may be met via either a family of expander boards, modular input/output configuration, or a combination thereof. Refer to stand alone functionality specified above.
 - 7. All BC point data, algorithms and application software shall be modifiable from the CSS and OWS.
 - 8. Each BC shall execute application programs, calculations, and commands via a microprocessor resident in the BC. The database and all application programs for each BC shall be stored in non-volatile or battery backed volatile memory within the BC and will be able to upload/download to/from the CSS.
 - 9. BC shall provide buffer for holding alarms, messages, trends etc.
 - 10. Each BC shall include self-test diagnostics, which allow the BC to automatically alarm any malfunctions, or alarm conditions that exceed desired parameters as determined by programming input.
 - 11. Each BC shall contain software to perform full DDC/PID control loops.
 - 12. For systems requiring end-of-line resistors those resistors shall be located in the BC.
 - 13. Input-Output Processing
 - a. Digital Outputs (DO): Outputs shall be rated for a minimum 24 Vac or Vdc, 1 amp maximum current. Each shall be configurable as normally open or normally closed. Each output shall have an LED to indicate the operating mode of the output and a manual hand off or auto switch to allow for override. Each DO shall be discrete

- outputs from the BC's board (multiplexing to a separate manufacturer's board is unacceptable). Provide suppression to limit transients to acceptable levels.
- b. Analog Inputs (AI): AI shall be 0-5 Vdc, 0-10 Vdc, 0-20 Vdc, and 0-20 mA. Provide signal conditioning, and zero and span calibration for each input. Each input shall be a discrete input to the BC's board (multiplexing to a separate manufacturers board is unacceptable unless specifically indicated otherwise). A/D converters shall have a minimum resolution of 12 bits.
 - c. Digital Inputs (DI): Monitor dry contact closures. Accept pulsed inputs of at least one per second. Source voltage for sensing shall be supplied by the BC and shall be isolated from the main board. Software multiplexing of an AI and resistors may only be done in non-critical applications and only with prior approval of Architect/Engineer.
 - d. Universal Inputs (UI-AI or DI): To serve as either AI or DI as specified above.
 - e. Electronic Analog Outputs (AO): Voltage mode: 0-5 Vdc and 0-10 Vdc; Current mode: 4-20 mA. Provide zero and span calibration and circuit protection. Pulse Width Modulated (PWM) analog via a DO [and transducer] is acceptable only with State approval (Generally these will not be allowed on loops with a short time constant such as discharge temperature loops, economizer loops, pressure control loops and the like. They are generally acceptable for standard room temperature control loops.). Where these are allowed, transducer/actuator shall be programmable for normally open, normally closed, or hold last position and shall allow adjustable timing. Each DO shall be discrete outputs from the BC's board (multiplexing to a separate manufacturers board is unacceptable). D/A converters shall have a minimum resolution of 10 bits.
 - f. Pulsed Inputs: Capable of counting up to 8 pulses per second with buffer to accumulate pulse count. Pulses shall be counted at all times.
14. A communication port for operator interface through a mobile computer shall be provided in each BC. It shall be possible to perform all program and database back-up, system monitoring, control functions, and BC diagnostics through this port. Standalone BC panels shall allow temporary use of portable devices without interrupting its normal operation.
 15. Each BC shall be equipped with loop tuning algorithm for precise proportional, integral, derivative (PID) control. Loop tuning tools provided with the CSS software is acceptable. In any case, tools to support loop tuning must be provided such that P, I, and D gains are automatically calculated.
 16. All analog output points shall have a selectable failure setpoint. The BC shall be capable of maintaining this failure setpoint in the event of a system malfunction, which causes loss of BC control, or loss of output signal, as long as power is available at the BC. The failure setpoint shall be selectable on a per point basis.
 17. Slope intercepts and gain adjustments shall be available on a per-point basis.
 18. BC Power Loss:
 - a. Upon a loss of power to any BC, the other units on the controlling LAN shall not in any way be affected.
 - b. Upon a loss of power to any BC, the battery backup shall ensure that the energy management control software, the Direct Digital Control software, the database parameters, and all other programs and data stored in the RAM are retained for a minimum of fifty (50) hours. An alarm diagnostic message shall indicate that the BC is under battery power.
 - c. Upon restoration of power within the specified battery backup period, the BC shall resume full operation without operator intervention. The BC shall automatically reset its clock such that proper operation of any time dependent function is possible without manual reset of the clock. All monitored functions shall be updated.
 - d. Should the duration of a loss of power exceed the specified battery back-up period or BC panel memory be lost for any reason, the panel shall automatically report the condition (upon resumption of power) and be capable of receiving a download via the network from the CSS or a mobile computer. In addition, the State shall be able to upload the most current versions of all energy management control programs, Direct

Digital Control programs, database parameters, and all other data and programs in the memory of each BC to the CSS or a mobile computer via the network or the local USB or RS-232C port.

19. BC Failure:
 - a. Building Controller LAN Data Transmission Failure: BC shall continue to operate in stand-alone mode. BC shall store loss of communication alarm along with the time of the event. All control functions shall continue with the global values programmable to either the last value or a specified value. Peer BCs shall recognize the loss and report alarm.
 - b. BC Hardware Failure: BC shall cease operation and terminate communication with other devices. All outputs shall go to their specified fail position.
 20. Each BC shall be equipped with firmware resident self-diagnostics for sensors and be capable of assessing an open or shorted sensor circuit and taking an appropriate control action (close valve, damper, etc.).
 21. BCs may include network communications interface functions for controlling secondary controlling LANs Refer to Section 23 09 54 - BAS System Communications Devices for requirements if this function is packaged with the BC.
 22. A minimum of four levels of privileges shall be provided at each BC.
 23. All local user accounts shall be password protected. Strong password shall be used and complies with the State security standard.
 24. BCs shall be mounted on equipment, in packaged equipment enclosures, or locking wall mounted in a NEMA 1 enclosure, as specified elsewhere.
- B. BACnet Building Controller Requirements:
1. The BC(s) shall support all BIBBs defined in the BACnet-IP (B-BC) device profile as defined in the BACnet standard.
 2. BCs shall communicate over the BACnet-IP LAN.
 3. Each BC shall be connected to the BACnet-IP LAN communicating to/from other BCs.

2.03 ADVANCED APPLICATION SPECIFIC CONTROLLER (AAC) AND APPLICATION SPECIFIC CONTROLLER (ASC)

- A. General Requirements:
1. AACs and ASCs shall provide intelligent, standalone control of HVAC equipment. Each unit shall have its own internal RAM, non-volatile memory and will continue to operate all local control functions in the event of a loss of communications on the ASC LAN or sub-LAN. Refer to standalone requirements by application specified in Part 3 of this section. In addition, it shall be able to share information with every other BC and AAC /ASC on the entire network.
 2. Each AAC and ASC shall include self-test diagnostics that allow the AAC /ASC to automatically relay to the BC, or LAN Interface Device, any malfunctions or abnormal conditions within the AAC /ASC or alarm conditions of inputs that exceed desired parameters as determined by programming input.
 3. AACs and ASCs shall include sufficient memory to perform the specific control functions required for its application and to communicate with other devices.
 4. Each AAC and ASC must be capable of stand-alone direct digital operation utilizing its own processor, non-volatile memory, input/output, minimum 8 bit A to D conversion, voltage transient and lightning protection devices. All volatile memory shall have a battery backup of at least fifty- (50) hrs with a battery life of (5) five years.
 5. All point data; algorithms and application software within an AAC /ASC shall be modifiable from the OWS.
 6. AAC and ASC Input-Output Processing
 - a. Digital Outputs (DO): Outputs shall be rated for a minimum 24 VAC or VDC, 1 amp maximum current. Each shall be configurable as normally open or normally closed. Each output shall have an LED to indicate the operating mode of the output and a manual hand off or auto switch to allow for override (Only AAC requires HOA). Each DO shall be discrete outputs from the AAC/ASC's board (multiplexing to a separate

- manufacturer's board is unacceptable). Provide suppression to limit transients to acceptable levels.
- b. Analog Inputs (AI): AI shall be 0-5 Vdc, 0-10Vdc, 0-20Vdc, and 0-20 mA. Provide signal conditioning, and zero and span calibration for each input. Each input shall be a discrete input to the BC's board (multiplexing to a separate manufacturers board is unacceptable unless specifically indicated otherwise). A/D converters shall have a minimum resolution of 8-10 bits depending on application.
 - c. Digital Inputs (DI): Monitor dry contact closures. Accept pulsed inputs of at least one per second. Source voltage for sensing shall be supplied by the BC and shall be isolated from the main board. Software multiplexing of an AI and resistors may only be done in non-critical applications and only with prior approval of Architect/Engineer
 - d. Universal Inputs (UI-AI or DI): To serve as either AI or DI as specified above.
 - e. Electronic Analog Outputs (AO) as required by application: voltage mode, 0-5VDC and 0-10VDC; current mode (4-20 mA). Provide zero and span calibration and circuit protection. Pulse Width Modulated (PWM) analog via a DO [and transducer] is acceptable only with State approval (Generally, PWM will not be allowed on loops with a short time constant such as discharge temperature loops, economizer loops, pressure control loops and the like. They are generally acceptable for standard room temperature control loops.). Where PWM is allowed, transducer/actuator shall be programmable for normally open, normally closed, or hold last position and shall allow adjustable timing. Each DO shall be discrete outputs from the BC's board (multiplexing to a separate manufacturers board is unacceptable). D/A converters shall have a minimum resolution of 8 bits.
- B. BACnet AAC(s) and ASC(s) Requirements:
1. The AAC(s) and ASC(s) shall support all BIBBs defined in the BACnet Building Controller (B-AAC and B-ASC) device profile as defined in the BACnet standard.
 2. AAC(s) and ASC(s) shall communicate over the BACnet Building Controller LAN or the ASC LAN or sub-LAN.
 3. Each BC shall be connected to the BACnet Building Controller LAN communicating to/from other BCs.
- C. Terminal Box Controllers:
1. Terminal box controllers controlling damper positions to maintain a quantity of supply or exhaust air serving a space shall have an automatically initiated function that resets the volume regulator damper to the fully closed position on a scheduled basis. The controllers shall initially be set up to perform this function once every 24 hours. The purpose of this required function is to reset and synchronize the actual damper position with the calculated damper position and to assure the damper will completely close when commanded. The software shall select scheduled boxes randomly and shall not allow more than 5% of the total quantity of controllers in a building to perform this function at the same time. This reset shall be performed while the AHU is operating. The BAS shall send an alarm for any terminal box that has been reset and does not indicate 0 cfm flow with the damper commanded closed.

PART 3 - EXECUTION

3.01 INSPECTION:

- A. Examine areas and conditions under which control systems are to be installed. Do not proceed with work until unsatisfactory conditions have been corrected in manner acceptable to Installer.

3.02 INSTALLATION OF CONTROL SYSTEMS:

- A. General: Install systems and materials in accordance with manufacturer's instructions, specifications roughing-in drawings and details shown on drawings. Contractor shall install all controllers in accordance with manufacturer's installation procedures and practices.

3.03 HARDWARE APPLICATION REQUIREMENTS

- A. General: The functional intent of this specification is to allow cost effective application of manufacturers standard products while maintain the integrity and reliability of the control functions. A BC as specified above is generally fully featured and customizable whereas the AAC/ASC refers to a more cost-effective unit designed for lower-end applications. Specific requirements indicated below are required for the respective application. Manufacturer may apply the most cost-effective unit that meets the requirement of that application.
- B. Standalone Capability: Each Control Unit shall be capable of performing the required sequence of operation for the associated equipment. All physical point data and calculated values required to accomplish the sequence of operation shall originate within the associated CU with only the exceptions enumerated below. Refer to Item 2.01 above for physical limitations of standalone functionality. Listed below are functional point data and calculated values that shall be allowed to be obtained from or stored by other CUs or SDs via LAN.
- C. Where associated control functions involve functions from different categories identified below, the requirements for the most restrictive category shall be met.
- D. Application Category 0 (Distributed monitoring)
 - 1. Applications in this category include the following:
 - a. Monitoring of variables that are not used in a control loop, sequence logic, or safety.
 - 2. Points on BCs, AACs, and ASCs may be used in these applications as well as SDs and/or general-purpose I/O modules.
 - 3. Where these points are trended, contractor shall verify and document that the network bandwidth is acceptable for such trends and is still capable of acceptable and timely control function.
- E. Application Category 1 (Application Specific Controller):
 - 1. Applications in this category include the following:
 - a. Fan Coil Units
 - b. Airflow Control Boxes (VAV and Constant Volume Terminal Units)
 - c. Misc. Heaters
 - d. Unitary equipment <15 tons (Package Terminal AC Units, Package Terminal Heat Pumps, Split-System AC Units, Split-System Heat Pumps, Water-Source Heat Pumps)
 - e. Induction Units
 - f. Variable Speed Drive (VSD) controllers not requiring safety shutdowns of the controlled device.
 - 2. ASCs may be used in these applications.
 - 3. Standalone Capability: Provide capability to execute control functions for the application for a given setpoint or mode, which shall generally be occupied mode control. Only the following data (as applicable) may be acquired from other controllers via LANs. In the event of a loss of communications with any other controller, or any fault in any system hardware that interrupts the acquisition of any of these values, the ASC shall use the last value obtained before the fault occurred. If such fault has not been corrected after the specified default delay time, specified default value(s) shall then be substituted until such fault has been corrected.
 - a. Physical/Virtual PointDefault Value
 - b. Scheduling PeriodNormal
 - c. Morning Warm-UpOff (cold discharge air)
 - d. Load ShedOff (no shedding)
 - e. Summer/WinterWinter
 - f. [Trend DataN/A]
 - g. [Smoke Pressurization ModeNormal Mode]
 - 4. Mounting:

- a. ASCs that control equipment located above accessible ceilings shall be mounted on the equipment in an accessible enclosure that does not hinder maintenance of mechanical equipment and shall be rated for plenum use.
 - b. ASCs that control equipment mounted in a mechanical room may either be mounted in, on the equipment, or on the wall of the mechanical room at an adjacent, accessible location.
 - c. ASCs that control equipment located in occupied spaces or outside shall either be mounted within the equipment enclosure (responsibility for physical fit remains with the contractor) or in a nearby mechanical/utility room in which case it shall be enclosed in a NEMA 1, locking enclosure.
 - d. Section 23 09 53 contractor may furnish ASCs to the terminal unit manufacturer for factory mounting.
 5. Programmability: Operator shall be able to modify all setpoints (temperature and airflow), scheduling parameters associated with the unit, tuning and set up parameters, interstage timing parameters, and mode settings. Application-specific block control algorithms may be used to meet the sequence of operations. The ability to customize the control algorithm is not required unless specifically indicated otherwise.
 6. LAN Restrictions: Limit the number of nodes on the network to the maximum recommended by the manufacturer.
- F. Application Category 2 (General Purpose Terminal Controller)
1. Applications in this category include the following:
 - a. Unitary Equipment $\geq$ 15 tons (Air Conditioners, Heat Pumps, Packaged Heating/Cooling Units, and the like)
 - b. Small, Constant Volume Single Zone Air Handling Units
 - c. Constant Volume Pump Start/Stop
 - d. Misc. Equipment (Exhaust Fan) Start/Stop
 - e. Misc. Monitoring (not directly associated with a control sequence and where trending is not critical)
 - f. Steam Converter Control
 2. BCs may be used in these applications.
 3. ASC's may be used in these applications provided the ASC meets all requirements specified below. This category requires a general-purpose ASC to which application-specific control algorithms can be attached.
 4. Standalone Capability: Only the following data (as applicable) may be acquired from other ASCs via LANs. In the event of a loss of communications with any other ASCs, or any fault in any system hardware that interrupts the acquisition of any of these values, the AAC/ASC shall use the last value obtained before the fault occurred. If such fault has not been corrected after the specified default delay time, specified default value(s) shall then be substituted until such fault has been corrected.
 - a. Physical/Virtual PointDefault Delay TimeDefault Value
 - b. Outside Air Temperature3 minutes80°F
 - c. Outside Air Humidity3 minutes60%RH
 - d. Outside Air Enthalpy3 minutes30 Btu/lb
 - e. Trend DataN/A
 - f. Cooling/Heating Requests3 minutesNone
 - g. Smoke Pressurization Mode3 minutesNormal Mode
 - h. Smoke Exhaust Command3 minutesNormal Mode
 5. Mounting:
 - a. ASCs that control equipment located above accessible ceilings shall be mounted on the equipment so as not to hinder mechanical maintenance and shall be rated for plenum use.
 - b. ASCs that control equipment located in occupied spaces or outside shall either be mounted within the equipment enclosure (responsibility for physical fit remains with

- the contractor) or in a nearby mechanical/utility room in which case it shall be enclosed in a NEMA 1, locking enclosure.
6. Programmability: Operator shall be able to modify all setpoints (temperature and airflow), scheduling parameters associated with the unit, tuning and set up parameters, interstage timing parameters, and mode settings. Operator shall be able to address and configure spare inputs for monitoring. [Operator shall be able to address and configure spare outputs for simple single loop control actions or event initiated actions.] Application-specific block control algorithms shall be used to meet the sequence of operations. The ability to customize the control algorithm is not required unless specifically indicated otherwise.
 7. LAN Restrictions: Limit the number of nodes servicing any one of these applications on the AAC/ASC LAN to 32.
- G. Application Category 3 (Advanced Application Controller)
1. Applications in this category include the following:
 - a. Large Constant Volume Air Handlers
 - b. VAV Air Handlers generally >5,000 and <10,000cfm
 - c. Dual Duct Air Handlers generally >5000 and < 10,000 cfm
 - d. Multizone Air Handlers
 - e. Self-Contained VAV Units
 2. BCs may be used in these applications.
 3. AAC's may be used in these applications provided:
 - a. The AAC's meets all requirements specified below.
 - b. All control functions and physical I/O associated with a given unit resides in one AAC.
 - c. Input A/D is 10-bit. Exception: 8-bit input A/D can be used when matched with high accuracy sensors, the range of which meets the resolution requirements specified for the applicable sensor in Section 23 09 51.
 - d. Pulsed inputs required for the application can be monitored and accumulated effectively.
 4. Standalone Capability: Only the following data (as applicable) may be acquired from other AACs via LANs. In the event of a loss of communications with any other AACs, or any fault in any system hardware that interrupts the acquisition of any of these values, the AAC shall use the last value obtained before the fault occurred. If such fault has not been corrected after the specified default delay time, specified default value(s) shall then be substituted until such fault has been corrected.
 - a. physical/virtual pointdefault delay timedefault value
 - b. Outside Air Temperature3 minutes80°F
 - c. Outside Air Humidity3 minutes60%RH
 - d. Outside Air Enthalpy3 minutes30 Btu/lb
 - e. Enable Local OperationLast Value
 - f. Cooling/Heating Requests3 minutesNone
 - g. Smoke Pressurization Mode3 minutesNormal Mode
 - h. Smoke Exhaust Command3 minutesNormal Mode
 5. Mounting:
 - a. AACs that control equipment located above accessible ceilings shall be mounted on the equipment so as not to hinder mechanical maintenance and shall be rated for plenum use.
 - b. AACs that control equipment located in occupied spaces or outside shall either be mounted within the equipment enclosure (responsibility for physical fit remains with the contractor) or in a near by mechanical/utility room in which case it shall be enclosed in a NEMA 1, locking enclosure.
 6. Programmability: Operator shall be able to modify all setpoints (temperature and airflow), scheduling parameters associated with the unit, tuning and set up parameters, interstage timing parameters, and mode settings. Operator shall be able to address and configure spare inputs for monitoring. Operator shall be able to program custom DDC control

algorithms and specify trending parameters, which will be retained in memory in the event of a loss of communications. Application-specific block control algorithms may be used provided they meet the sequence of operations. The control algorithms shall be completely customizable.

7. LAN Restrictions: Each LAN which participates in the transfer of data between the CU and the local operator workstation shall be subject to the following criteria:
 - a. Limit the number of nodes servicing any one of these applications on the AAC/ASC LAN to 16.
 - b. The Building Controller LAN shall be subject only to manufacturer's published LAN limitations.

H. Application Category 4

1. Applications in this category include the following:
 - a. Central Cooling Plant
 - b. Central Heating Plant
 - c. Cooling Towers
 - d. Sequenced or Variable Speed Pump Control
 - e. Local Chiller Control (unit specific)
 - f. Local Free Cooling Heat Exchanger Control
 - g. Air Handlers over 10,000 cfm or serving critical areas
2. BCs shall be used in these applications.

3.04 CONTROL UNIT REQUIREMENTS

- A. Refer to Section 23 09 50 for requirements pertaining to control unit quantity and location.

END OF SECTION

THIS PAGE INTENTIONALLY LEFT BLANK

SECTION 23 09 54
BAS COMMUNICATION DEVICES

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. Network Integration Devices

1.02 RELATED DOCUMENTS:

- A. Section 23 09 50 - Building Automation System (BAS) General
- B. Section 23 09 51 - BAS Basic Materials, Interface Devices, and Sensors
- C. Section 23 09 53 - BAS Field Panels
- D. Section 23 09 55 - BAS Software
- E. Section 23 09 58 - Sequences of Operation
- F. Section 23 09 59 - BAS Commissioning

1.03 DESCRIPTION OF WORK

- A. Contractor shall provide all interface devices and software to provide an integrated system connecting BCs, AACs, ASCs and Gateways to the State network.

PART 2 - PRODUCTS

2.01 NETWORK CONNECTION

- A. State WAN: Refer Section 23 09 50 Part 1.11.C.1 - Building Automation System (BAS) General for description of System Architecture.
- B. The following BIBBs must be supported on the Local Supervisory LAN using Ethernet either directly or through a gateway:
 - 1. BACnet Data Sharing Objects (DS-):
 - a. Read Property (RP-A) Initiate
 - b. Read Property (RP-B) Execute
 - c. Read Property Multiple (RPM-A) Initiate
 - d. Read Property Multiple (RPM-B) Execute
 - e. Write Property (WP-A) Initiate
 - f. Write Property (WP-B) Execute
 - g. Write Property Multiple (WPM-A) Initiate
 - h. Write Property Multiple (WPM-B) Execute
 - i. COV Unsubscribed (COVU-A) Initiate
 - j. COV Unsubscribed (COVU-B) Execute
 - 2. BACnet Alarm and Event Object (AE-)
 - a. Confirmed Event Notification (N-B) Initiate
 - b. Unconfirmed Event Notification (N-B) Initiate
- C. Refer to Section 23 09 55 Part III for the BACnet Object naming convention.

2.02 BACNET GATEWAYS

- A. Gateways shall be provided to link non-BACnet control products to the BACnet inter-network. All of the functionality described in this section is to be provided by using the BACnet capabilities. Each Gateway shall have the ability to expand the number of BACnet objects of each type supported by 20% to accommodate future system changes.
- B. Each Gateway shall provide values for all points on the non-BACnet side of the Gateway to BACnet devices as if the values were originating from BACnet objects. The Gateway shall also provide a way for BACnet devices to modify (write) all points specified by the AOC using standard BACnet services. All points are required to be writable for each site.
- C. The Gateway shall implement BACnet schedule objects and permit both read and write access to the schedules from the BC.

- D. Each Gateway shall provide a way to collect and archive or trend (time, value) data pairs.
- E. Each Gateway and any devices that the Gateway represents which have time-of-day information shall respond to workstation requests to synchronize the date and time. Each Gateway and any devices that the Gateway represents shall support dynamic device binding and dynamic object binding.
- F. All points in the system shall be made network visible through the use of standard BACnet objects or through proprietary BACnet extensions that the workstation also supports. All points shall be writable using standard BACnet services.
- G. All devices have a Device Object instance number that is unique throughout the entire inter-network. All BACnet devices shall be configured with a Device Object instance number that is based on the format specified (shown in decimal notation). This includes all physical devices as well as any logical BACnet devices that are physically represented by Gateways.
- H. All BACnet Interoperability Building Blocks (BIBBs) are required to be supported for each true BACnet device or Gateway. The Gateway shall support all BIBBs defined in the BACnet Gateway's device profile as defined in the BACnet standard.

2.03 CONTROLLER LOCAL AREA NETWORK INTERFACE DEVICES (LANID)

- A. The LANID shall be a microprocessor-based communications device which acts as a gateway/router between the Primary Controlling LAN and the Secondary Controlling LAN. It provides an operator interface. These may be provided within a BC or as a separate device.
- B. The LANID shall perform information translation between the Primary Controlling LAN and the Secondary Controlling LAN, supervise communications on a polling Secondary Controlling LAN, and be applicable to systems in which the same functionality is not provided in the BC. In systems where the LANID is a separate device, it shall contain its own microprocessor, RAM, battery, real-time clock, communication ports, and power supply as specified for a BC in Section 23 09 53. Each LANID shall be mounted in a lockable enclosure.
- C. Each LANID shall support interrogation, full control, and all utilities associated with all BCs on the Primary Controlling LAN, all AACs and ASCs connected to all Secondary Controlling LANs under the Primary Controlling LAN, and all points connected to those PCUs and SCUs.
- D. Upon loss of power to a LANID, the battery shall provide for minimum 100-hour backup of all programs and data in RAM. The battery shall be sealed and self-charging.
- E. The LANID shall be transparent to control functions and shall not be required to control information routing on the Primary Controlling LANControlling LANControlling LANControlling LANControlling LAN
- F. All BACnet Interoperability Building Blocks (BIBBs) are required to be supported for each true BACnet device or Gateway. The Gateway shall support all BIBBs defined in the BACnet Gateway's device profile as defined in the BACnet standard.

2.04 LOCAL SUPERVISORY LAN GATEWAYS/ROUTERS

- A. The gateway/router shall be a microprocessor-based communications device that acts as a gateway/router between the Supervisory LAN CSSs or OWS and the Controlling LAN.
- B. The gateway/router shall perform information translation between the Controlling LAN and the Local Supervisory LAN, and shall use BACnet over IP. When BACnet is used, refer to the requirements of the BACnet Gateways specified herein.
- C. The gateway/router shall contain its own microprocessor, RAM, battery, real-time clock, communication ports, and power supply as specified for a BC in Section 23 09 53. Each gateway/router shall be mounted in a lockable enclosure.
- D. The gateway/router shall allow centralized overall system supervision, operator interface, management report generation, alarm annunciation, acquisition of trend data, and communication with control units. It shall allow system operators to perform the following functions from the CSS, and OWSs:
 - 1. Configure systems.

2. Monitor and supervise control of all points.
 3. Change control setpoints.
 4. Override input values.
 5. Override output values
 6. Enter programmed start/stop time schedules.
 7. View and acknowledge alarms and messages.
 8. Receive, store and display trend logs and management reports.
 9. Upload/Download programs, databases, etc. as specified.
- E. Upon loss of power to the gateway/router, the battery shall provide for minimum 100 hour backup of all programs and data in RAM. The battery shall be sealed and self-charging.
- F. The gateway/router shall be transparent to control functions and shall not be required to control information routing on the Controlling LAN

2.05 CHILLER CONTROLS INTERFACE DEVICE (CID)

- A. The CID shall be a microprocessor-based communications device that acts as a gateway between the control protocol and the applicable chiller controller.
- B. The CID shall contain its own microprocessor, RAM, battery, communication ports and, power supply.
- C. Each CID shall support full bi-directional communications translation as more fully specified in Section 23 09 55.
- D. See drawings for required list of mapped points.

PART 3 - EXECUTION

3.01 INSPECTION:

- A. Examine areas and conditions under which control systems are to be installed. Do not proceed with work until unsatisfactory conditions have been corrected in manner acceptable to Installer.

3.02 INSTALLATION OF CONTROL SYSTEMS:

- A. General: Install systems and materials in accordance with manufacturer's instructions, roughing-in drawings and details shown on drawings.
- B. Contractor shall provide all interface devices and software to provide an integrated system.
- C. Contractor shall closely coordinate with the State, or designated representative, to establish IP addresses and communications to assure proper operation of the building control system on the State (DE) network.

END OF SECTION

THIS PAGE INTENTIONALLY LEFT BLANK

SECTION 23 09 55
BAS SOFTWARE AND PROGRAMMING

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. System Software
- B. Programming Description
- C. Control Algorithms
- D. Energy Management Applications
- E. Password Protection
- F. Alarm Reporting
- G. Trending
- H. Data Acquisition and Storage
- I. Point Structuring
- J. Dynamic Color Graphics

1.02 RELATED DOCUMENTS:

- A. Section 23 09 50 - Building Automation System (BAS) General
- B. Section 23 09 51 - BAS Basic Materials, Interface Devices, and Sensors
- C. Section 23 09 53 - BAS Field Panels
- D. Section 23 09 54 - BAS Communications Devices
- E. Section 23 09 58 - Sequences of Operation
- F. Section 23 09 59 - BAS Commissioning

1.03 DESCRIPTION OF WORK:

- A. Fully configure systems and furnish and install all software, programming and dynamic color graphics for a complete and fully functioning system as specified.
- B. Refer to Section 23 09 50 - Building Automation System (BAS) for general requirements
- C. Refer to 23 09 58 - Sequence of Operation for specific sequences of operation for controlled equipment.

1.04 LICENSING

- A. Include licensing for all software packages at all required workstations.
- B. All operator interface, programming environment, networking, database management and any other software used by the Contractor to install the system or needed to operate the system to its full capabilities shall be licensed and provided to the State.
- C. All BAS software should be available on CSS(s) provided, and on all Portable Operator Terminals. All software keys to provide all rights shall be installed on CSS. At least 2 sets of media (CD or DVD) shall be provided with backup software and configurations for all software provided, so that the State may reinstall any software as necessary
- D. Provide licensing and original software media for each device. Include all BAS software licenses and all required third party software licenses.
- E. Upgrade all software packages to the release (version) in effect at the end of the Warranty Period.
- F. Refer to Section 23 09 50 - Building Automation System (BAS) General for further requirements.

PART 2 - PRODUCTS

2.01 SYSTEM SOFTWARE-GENERAL

- A. **Functionality and Completeness:** The Contractor shall furnish and install all software and programming necessary to provide a complete and functioning system as specified. The Contractor shall include all software and programming not specifically itemized in these Specifications, which is necessary to implement, maintain, operate, and diagnose the system in compliance with these Specifications.
- B. **Configuration:** The software shall support the system as a distributed processing network configuration.

2.02 CONTROLLER SOFTWARE

- A. **BC Software Residency:** Each BC as defined below shall be capable of controlling and monitoring of all points physically connected to it. All software including the following shall reside and execute at the BC:
 - 1. Real-Time Operating System software
 - 2. Real-Time Clock/Calendar and network time synchronization
 - 3. BC diagnostic software
 - 4. LAN Communication software/firmware
 - 5. Direct Digital Control software
 - 6. Alarm Processing and Buffering software
 - 7. Energy Management software
 - 8. Data Trending, Reporting, and Buffering software
 - 9. I/O (physical and virtual) database
 - 10. Remote Communications software
- B. **AAC/ASC Software Residency:** Each AAC/ASC as defined below shall be capable of controlling and monitoring of all points physically connected to it. As a minimum, software including the following shall reside and execute at the AAC/ASC. Other software to support other required functions of the AAC/ASC may reside at the BC or LAN interface device (specified in Section 23 09 54) with the restrictions/exceptions per application provided in Section 23 09 53:
 - 1. Real-Time Operating System software
 - 2. AAC/ASC diagnostic software
 - 3. LAN Communications software
 - 4. Control software applicable to the unit it serves that will support a single mode of operation
 - 5. I/O (physical and virtual) database to support one mode of operation
- C. **Standalone Capability:** BC shall continue to perform all functions independent of a failure in other BC/AAC/ASC, CSS, or other communication links to other BCs/AACs/ASCs or CSSs. Trends and runtime totalization shall be retained in memory. Runtime totalization shall be available on all digital input points that monitor electric motor status. Refer also to Section 23 09 53 for other aspects of standalone functionality.
- D. **Operating System:** Controllers shall include a real-time operating system resident in ROM. This software shall execute independently from any other devices in the system. It shall support all specified functions. It shall provide a command prioritization scheme to allow functional override of control functions. Refer also to Section 23 09 53 for other aspects of the controller's operating system.
- E. **Network Communications:** Each controller shall include software/firmware that supports the networking of CUs on a common communications trunk that forms the respective LAN. Network support shall include the following:
 - 1. Controller communication software shall include error detection, correction, and re-transmission to ensure data integrity.

2. Operator/System communication software shall facilitate communications between other BCs, all subordinate AACs/ASCs, Gateways and LAN Interface Devices or CSS.
Software shall allow point interrogation, adjustment, addition/deletion, and programming while the controller is online and functioning without disruption to unaffected points. The software architecture shall allow networked controllers to share selected physical and virtual point information throughout the entire system.
- F. Diagnostic Software: Controller software shall include diagnostic software that checks memory and communications and reports any malfunctions.
- G. Alarm/Messaging Software: Controller software shall support alarm/message processing and buffering software as more fully specified below.
- H. Application Programs: CUs shall support and execute application programs as more fully specified below:
 1. All Direct Digital Control software, Energy Management Control software, and functional block application programming software templates shall be provided in a 'ready-to-use' state, and shall not require (but shall allow) user programming.
- I. Security: Controller software shall support multiple level privileges access restriction as more fully specified below.
- J. Direct Digital Control: Controller shall support application of Direct Digital Control Logic. All logic modules shall be provided pre-programmed with written documentation to support their application. Provide the following logic modules as a minimum:
 1. Proportional-Integral-Derivative (PID) control with analog, PWM and floating output
 2. Two Position control (Hi or Low crossing with deadband)
 3. Single-Pole Double-Throw relay
 4. Delay Timer (delay-on-make, delay-on-break, and interval)
 5. Hi/Low Selection
 6. Reset or Scaling Module
 7. Logical Operators (AND, OR, NOT, XOR)
- K. Psychrometric Parameters: Controller software shall provide preprogrammed functions to calculate and present psychrometric parameters (given temperature and relative humidity) including the following as a minimum: Enthalpy, Wet Bulb Temperature.
- L. Updating/Storing Application Data: Site-specific programming residing in volatile memory shall be uploadable/downloadable from an OWS or CSS using BACnet services connected locally or through the network. Initiation of an upload or download shall include all of the following methods: Manual, Scheduled, and Automatic upon detection of a loss or change.
- M. Restart: System software shall provide for orderly shutdown upon loss of power and automatic restart upon power restoration. Volatile memory shall be retained; outputs shall go to programmed fail-safe (open, closed, or last) position. Equipment restart shall include a user definable time delay on each piece of equipment to stagger the restart. Loss of power shall be alarmed at operator interface indicating date and time.
- N. Time Synchronization: Automatic time synchronization shall be provided using BACnet services. Operators shall be able to set the time and date in any device on the network that supports time-of-day functionality. The operator shall be able to select to set the time and date for an individual device, devices on a single network, or all devices simultaneously.
- O. Misc. Calculations: System software shall automate calculation of psychrometric functions, calendar functions, kWh/kW, and flow determination and totalization from pulsed or analog inputs, curve-fitting, look-up table, input/output scaling, time averaging of inputs and A/D conversion coefficients.

2.03 APPLICATION PROGRAMMING DESCRIPTION

- A. The application software shall be user programmable.

- B. This specification generally requires a programming convention that is logical, easy to learn, use, and diagnose. General approaches to application programming shall be provided by one, or a combination, of the following conventions:
 - 1. Point Definition: Provide templates customized for point type, to support input of individual point information. Use standard BACnet Objects as applicable.
 - 2. Graphical Block Programming: Manipulation of graphic icon 'blocks', each of which represents a subroutine, in a functional/logical manner forming a control logic diagram. Blocks shall allow entry of adjustable settings and parameters via pop-up windows. Provide a utility that shall allow the graphic logic diagrams to be directly compiled into application programs. Logic diagrams shall be viewable either off-line, or on-line with real-time block output values.
 - 3. Functional Application Programming: Pre-programmed application specific programs that allow/require limited customization via 'fill-in-the-blanks' edit fields. Typical values would be setpoints gains, associated point names, alarm limits, etc.
- C. Provide a means for testing and/or debugging the control programs both off-line and on-line.

2.04 ENERGY MANAGEMENT APPLICATIONS

- A. System shall have the ability to perform all of the following energy management routines via preprogrammed function blocks or template programs. As a minimum provide the following whether or not required in the software:
 - 1. Time-of-Day Scheduling
 - 2. Calendar-Based Scheduling
 - 3. Holiday Scheduling
 - 4. Temporary Schedule Overrides
 - 5. Optimal Start / Optimal Stop based on space temperature offset, outdoor air temperature, and building heating and cooling capacitance factors as a minimum
 - 6. Night Setback and Morning Recovery Control, with ventilation only during occupancy
 - 7. Economizer Control (enthalpy or dry-bulb)
 - 8. Peak Demand Limiting / Load Shedding
 - 9. Dead Band Control
- B. All programs shall be executed automatically without the need for operator intervention, and shall be flexible enough to allow operator customization. Programs shall be applied to building equipment as described in Section 23 09 58 - Sequence of Operation.

2.05 ACCESS PRIVILEGES

- A. Multiple-level access privileges shall be provided. A minimum of four (4) levels of access shall be supported.
- B. The highest level of access, Administrator Level access, shall allow the BAS administrator to perform application, database, and user management functions.
- C. Each login credentials shall be assigned to a pre-defined level of access. Alternately, a comprehensive list of accessibility/functionality items shall be provided, to be enabled or disabled for each user according to the level of access granted.
- D. Operators shall be able to perform only those commands available for the access level assigned to their login credentials.
- E. Login credentials are stored in the BC's local database. A minimum of 20 user names shall be supported and programmed per the State's direction.
- F. Login credentials can be looked up using the Lightweight Directory Access (LDAP) through the BAS server.
- G. Strong password shall be used on all login credentials.
- H. User-definable, automatic log-off timers from 1 to 60 minutes shall be provided to prevent users from inadvertently leaving interface device unattended.

- I. At system handover, all default and Contractor created login credentials for the system shall be provided to the State and all temporary login credentials shall be removed.

2.06 ALARM AND EVENT MANAGEMENT REPORTING

- A. Alarm management shall be provided to monitor, buffer, and direct alarms and messages to operator devices and memory files. Each BC shall perform distributed, independent alarm analysis and filtering to minimize operator interruptions due to non-critical alarms, minimize network traffic, and prevent alarms from being lost. At no time shall a BCs ability to report alarms be affected by either operator activity at an OWS or local handheld device, or by communications with other panels on the network.
 1. Alarm Descriptor: Each alarm or point change shall include that point's English language description, and the time and date of occurrence. In addition to the alarm's descriptor and the time and date, the user shall be able to print, display and store an alarm message to more fully describe the alarm condition or direct operator response.
 2. Alarm Prioritization: The software shall allow users to define the handling and routing of each alarm by their assignment to discrete priority levels. A minimum of five (5) priority levels shall be provided - Level 1 Life Safety (i.e. smoke detector), Level 2 Critical (i.e. controller failure), Level 3 Abnormal (i.e. out-of-range temperature), Level 4 Energy Waste (i.e. fighting valves), Level 5 Maintenance Message (i.e. runtime monitor, filter status). For each priority level, users shall have the ability to enable or disable an audible tone whenever an alarm is reported and whenever an alarm returns to normal condition. Users shall have the ability to manually inhibit alarm reporting for each individual alarm and for each priority level. Contractor shall coordinate with the State on establishing alarm priority definitions.
 3. Alarm Report Routing: Each alarm priority level shall be associated with a unique user-defined list of operator devices including any combination of local or remote workstations, printers and workstation disk files. All alarms associated with a given priority level shall be routed to all operator devices on the user-defined list and/or email to designated State email address (mailbox resource) associated with that priority level. For each priority level, alarms shall be automatically routed to a default operator device in the event that alarms are unable to be routed to any operator device assigned to the priority level.
 4. Auto-Dial Alarm Routing: For alarm priority levels that include a mobile device as one of the listed reporting destinations, the BC shall initiate a call to report the alarm, and shall terminate the call after alarm reporting is complete. System shall be capable of multiple retries and buffer alarms until a connection is made. If no connection is made, system shall attempt connection to an alternate mobile device. System shall also be able to dial multiple mobile devices upon alarm activation.
 5. Alarm Acknowledgment: For alarm priority levels that are directed to a OWS, an indication of alarm receipt shall be displayed immediately regardless of the application is in use at the OWS, and shall remain on the screen until acknowledged by a user having a privilege that allows alarm acknowledgment. Upon acknowledgment, the complete alarm message string (including date, time, and user name of acknowledging operator) shall be stored in a selected file on the BC or CSS.
- B. It shall be possible for any operator to receive a summary of all alarms regardless of acknowledgement status; for which a particular recipient is enrolled for notification; based on current event state; based on the particular BACnet event algorithm (e.g., change of value, change of state, out of range, and so on); alarm priority; and notification class.
- C. BACnet Alarming Services: All alarms and events shall be implemented using standard BACnet event detection and notification mechanisms. The workstation shall receive BACnet alarm and event notifications from any gateway or BACnet controller in the system and display them to an operator. Either intrinsic reporting or algorithmic change reporting may be used but the intrinsic reporting method is preferred. The workstation shall also log alarms and events, provide a way for an operator with sufficient privilege to acknowledge alarms, and log acknowledgements of alarms. It shall be possible for an operator to receive, at any time, a summary of all alarms that

are currently in effect at any site whether or not they have been acknowledged. Operators shall also be able to view and change alarm limits for any alarm at the appropriate access level.

- D. Alarm Historical Database: The database shall store all alarms and events object occurrences in an ODBC or an OLE database-compliant relational database. Provide a commercially available ODBC driver or OLE database data provider, which would allow applications to access the data using standard Microsoft Windows data access services.

2.07 TRENDING

- A. The software shall display historical data in both a tabular and graphical format. The requirements of this trending shall include the following:
 - 1. Provide trends for all physical points, virtual points and calculated variables.
 - 2. BACnet Trend Objects are preferred but where not possible trend data shall be stored in relational database format as specified in herein under Data Acquisition and Storage.
 - 3. In the graphical format, the trend shall plot at least 4 different values for a given time period superimposed on the same graph. The 4 values shall be distinguishable by using unique colors. In printed form the 4 lines shall be distinguishable by different line symbology. Displayed trend graphs shall indicate the engineering units for each trended value.
 - 4. The sample rate and data selection shall be selectable by the operator.
 - 5. The trended value range shall be selectable by the operator.
 - 6. Where trended values on one table/graph are COV, software shall automatically fill the trend samples between COV entries.
- B. Control Loop Performance Trends: Controllers incorporating PID control loops shall also provide high resolution sampling in less than six second increments for verification of control loop performance.
- C. Data Buffering and Archiving: Trend data shall be buffered at the BC, and uploaded to hard disk storage when archival is desired. All archived trends shall be transmitted to the CSS. Uploads shall occur based upon a user-defined interval, manual command, or automatically when the trend buffers become full.
- D. Time Synchronization: Provide a time master that is installed and configured to synchronize the clocks of all BACnet devices supporting time synchronization. Synchronization shall be done using Coordinated Universal Time (UTC). All trend sample times shall be able to be synchronized. The frequency of time synchronization message transmission shall be selectable by the operator.

2.08 DYNAMIC PLOTTING

- A. Provide a utility to dynamically plot in real-time at least four (4) values on a given 2-dimensional dynamic plot/graph with at least two Y-axes. At least five (5) dynamic plots shall be allowed simultaneously.

2.09 DATA ACQUISITION AND STORAGE

- A. All points included in the typical equipment point list must be represented in a common, open or accessible format. All points should be provided as BACnet standard analog, binary, schedule, or trend objects when possible. Naming conventions for these points and network addressing are discussed in the 'Point Naming Conventions' paragraph below.
- B. Non-BACnet data from the BAS shall be stored in relational database format. The format and the naming convention used for storing the database files shall remain consistent across the database and across time. The relational structure shall allow for storage of any additional data points, which are added to the BAS in future. The metadata/schema or formal descriptions of the tables, columns, domains, and constraints shall be provided for each database.
- C. The database shall allow applications to access the data while the database is running. The database shall not require shutting down in order to provide read-write access to the data. Data shall be able to be read from the database without interrupting the continuous storage of trend data being carried by the BAS.

- D. The database shall be ODBC or OLE database compliant. Provide a commercially-available ODBC driver or OLE database data provider, which would allow applications to access the data using standard Microsoft Windows data access services.

2.10 TOTALIZATION

- A. The software shall support totalizing analog, digital, and pulsed inputs and be capable of accumulating, storing, and converting these totals to engineering units used in the documents. These values shall generally be accessible to the Operator Interfaces to support management-reporting functions.
- B. Totalization of electricity use/demand shall allow application of totals to different rate periods, which shall be user definable.
- C. When specified to provide electrical or utility Use/Demand, the Contractor shall obtain from the local utility all information required to obtain meter data, including k factors, conversion constants, and the like.

2.11 EQUIPMENT SCHEDULING

- A. Provide a graphic utility for user-friendly operator interface to adjust equipment-operating schedules.
- B. All schedules shall be implemented using BACnet objects and messages. All building systems with date and time scheduling requirements shall have schedules represented by the BACnet Schedule object. All operators shall be able to view the entries for a schedule. Operators with sufficient privilege shall be able to modify schedule entries from any BACnet workstation.
- C. Scheduling feature shall include multiple seven-day master schedules, plus holiday schedule, each with start time and stop time. Master schedules shall be individually editable for each day and holiday.
- D. Scheduling feature shall allow for each individual equipment unit to be assigned to one of the master schedules.
- E. Timed override feature shall allow an operator to temporarily change the state of scheduled equipment. An override command shall be selectable to apply to an individual unit, all units assigned to a given master schedule, or to all units in a building. Timed override shall terminate at the end of an operator selectable time, or at the end of the scheduled occupied/unoccupied period, whichever comes first. A privilege level that does not allow assignment of master schedules shall allow a timed override feature.
- F. A yearly calendar feature shall allow assignment of holidays, and automatic reset of system real time clocks for transitions between daylight savings time and standard time.

2.12 POINT STRUCTURING AND NAMING

- A. General: The intent of this section is to require a consistent means of naming points across all State facilities. Contractor shall configure the systems from the perspective of the Enterprise, not solely the local project. The following requirement establishes a standard for naming points and addressing Buildings, Networks, Devices, Instances, and the like. The convention is tailored towards the BACnet-based format and as such, the interface shall always use this naming convention. true BACnet systems shall also use this naming convention. For non-BACnet systems, the naming convention shall be implemented as much as practical, and any deviations from this naming convention shall be approved by the State. The Contractor shall contact the State to determine the Building number and abbreviation.
- B. Point Summary Table
 - 1. The term 'Point' is a generic description for the class of object represented by analog and binary inputs, outputs, and values in accordance with ASHARE 135 standard.
 - 2. With each schematic, Contractor shall provide a Point Summary Table listing:
 - a. Building number and abbreviation
 - b. System type
 - c. Equipment type

- d. Point suffix
- e. Full point name (see Point Naming Convention paragraph)
- f. Point description
- g. Ethernet backbone network number
- h. Network number
- i. Device ID
- j. Device MAC address
- k. Object ID (object type, instance number)
- l. Engineering units.
3. Additional fields for non-BACnet systems shall be appended to each row. Point Summary Table shall be provided in both hard copy and in electronic format (ODBC-compliant).
4. Point Summary Table shall also illustrate Network Variables/BACnet Data Links Bindings.
5. The Contractor shall coordinate with the State's representative and compile and submit a proposed Point Summary Table for review prior to any object programming or project startup.
6. The Point Summary Table shall be kept current throughout the duration of the project by the Contractor as the Master List of all points for the project. Project closeout documents shall include an up-to-date accurate Point Summary Table. The Contractor shall deliver to the State the final Point Summary Table prior to Substantial Completion of the system. The Point Summary Table shall be used as a reference and guide during the commissioning process.
7. The Point Summary Table shall contain all data fields on a single row per point. The Point Summary Table is to have a single master source for all point information in the building that is easily sorted and kept up-to-date. Although a relational database of Device ID-to-point information would be more efficient, the single line format is required as a single master table that will reflect all point information for the building. The point description shall be an easily understandable English-language description of the point.
8. Point Summary Table Example
9. Row Headers and Examples
10. (Transpose for a single point per row format)

Campus	RK
Building Number	006
Building Association	ZZ = no association (default to ZZ)
System Type	Cooling
Equipment Type	Chiller
Point Suffix	CHLR1KW
*Point Name (Object Name)	CA0006ZZ.COOLING.CHILLER.CHLR1KW
*Point Description (Object Description)	Chiller 1 kW
Ethernet Network Number	600
Network Number	610
Device ID	1024006
Device MAC address	24
Object Type	AI
Instance Number	4
Engineering Units	KW
Network Variable?	True
Server Device	1024006
Client Devices	1028006
Included with Functional	

- C. *Represents information that shall reside in the relevant BACnet property for the object
- D. Point Naming Convention
1. All point names shall adhere to the format as established below. Said objects shall include all physical I/O points, calculated points used for standard reports, and all application program parameters. For each BAS object, a specific and unique BACnet object name shall be required.
 2. For each point, four (4) distinct descriptors shall be linked to form each unique object name: Building, System, Equipment, and Point. Use alphanumeric characters. Space and special characters are not allowed. Each of the four descriptors must be bound by a period to form the entire object name. Reference the paragraphs below for an example of these descriptors.
 3. The State shall designate the Building descriptor. The System descriptor shall further define the object in terms of air handling, cooling, heating, or other system. The Equipment descriptor shall define the equipment category; e.g., Chiller, Air Handler, or other equipment. The Point descriptor shall define the hardware or software type or function associated with the equipment; e.g., supply temperature, water pressure, alarm, mixed air temperature setpoint, etc. and shall contain any numbering conventions for multiples of equipment; e.g., CHLR1KW, CHLR2KW, BLR2AL (Boiler 2 Alarm), HWP1ST (Hot Water Pump 1 Status).
 4. A consistent object (point) naming convention shall be utilized to facilitate familiarity and operational ease across the BAS network. Inter-facility consistency shall be maintained to ensure transparent operability to the greatest degree possible. The table below details the object naming convention and general format of the descriptor string.
 5. BACnet Object Name Requirements

Descriptors		Comment
Campus, Building Number & Building Association	RK0006ZZ AZ0134ZZ	The Master Building List also has the correct abbreviations for each building.
System	AIRHANDLING - EXHAUST - HEATING - COOLING - UTILITY - ENDUSE - MISC	Boilers and ancillary equipment Chillers and ancillary equipment Main electrical and gas meters Specific building loads by type
Equipment	BOILERS - CHILLERS - FACILITY - TOWERS - WEATHER	Non-specific boiler system points - Non-specific chiller system points
Point Suffix	See Input/Output point summary table for conventions	

6. Examples: Within each object name, the descriptors shall be bound by a period. Within each descriptor, words shall not be separated by dashes, spaces, or other separators as follows:
 - a. RK0006ZZ.COOLING.CHILLERS.CHWP1ST
 - b. RK0006ZZ.HEATING.BOILERS.BLR1CFH
- E. Device Addressing Convention:
1. BACnet network numbers and Device Object IDs shall be unique throughout the network.
 2. All assignment of network numbers and Device Object IDs shall be coordinated with the State.

3. Each Network number shall be unique throughout all facilities and shall be assigned in the following manner unless specified otherwise:
 - a. BBBFF, where: BBB = 1-655 assigned to each building, FF = 00 for building backbone network, 1-35 indicating floors or separate systems in the building.
4. Each Device Object Identifier property shall be unique throughout the system and shall be assigned in the following manner unless specified otherwise:
 - a. XXFFBBB, where: XX = number 0 to 40, FF = 00 for building backbone network, 1-35 indicating floors or separate systems in the building. BBB = 1-655 assigned to each building.
5. The BAS Contractor shall coordinate with designated State representative to ensure that no duplicate Device Object IDs occur.
6. Alternative Device ID schemes or cross project Device ID duplication if allowed shall be approved before project commencement by the State.

2.13 OPERATOR INTERFACE GRAPHIC SOFTWARE

- A. Graphic software shall facilitate user-friendly interface to all aspects of the System Software specified above. The intent of this specification is to require a graphic package that provides for intuitive operation of the systems without extensive training and experience. It shall facilitate logical and simple system interrogation, modification, configuration, and diagnosis.
- B. Graphic software shall support multiple simultaneous screens to be displayed and resizable in a web-based environment. All functions excepting text entry functions shall be executable with a mouse.
- C. Graphic software shall display current operating mode (i.e. warm-up, dehumidification, et al) for equipment with multiple modes of operation.
- D. Graphic software shall provide for multitasking such that other application can be used while the operator is accessing the BAS. Software shall provide the ability to alarm graphically even when operator is in another software package.
- E. The software shall be compatible to the current and current minus one versions of Microsoft Windows operating system. The software shall allow for the State's creation of user-defined, color graphic displays of geographic maps, building plans, floor plans, and mechanical and electrical system schematics. These graphics shall be capable of displaying all point information from the database including any attributes associated with each point (i.e., engineering units, etc.). In addition, operators shall be able to command equipment or change setpoints from a graphic through the use of a pointing device; e.g. mouse and touch screen.
- F. Screen Penetration: The operator interface shall allow users to access the various system graphic screens via a graphical penetration scheme by using the pointing device to select from menus or 'button' icons. Each graphic screen shall be capable of having a unique list of other graphic screens that are directly linked through the selection of a menu item or button icon.
- G. Dynamic Data Displays: Dynamic physical point values shall automatically updated at a minimum frequency of 6 updates per minute without operator intervention. Point value fields shall be displayed with a color code depicting normal, abnormal, override and alarm conditions.
- H. Point Override Feature: Each displayed point shall be individually enabled/disabled to allow pointing device driven override of digital points or changing of analog points. Such overrides or changes shall occur in the control unit, not just in the BAS software. The graphic point override feature shall be subject to privilege level protection. Points that are overridden shall be reported as an alarm, and shall be displayed in a coded color. The alarm message shall include the operator's login name. A list of points that are currently in an override state shall be available through menu selection and include the time/date of the override along with the operator's login name that initiated that override.
- I. Dynamic Symbols: Provide a selection of standard symbols that change in appearance based on the value of an associated point.
 1. Analog symbol: Provide a symbol that represents the value of an analog point as the length of a line or linear bar.

2. Digital symbol: Provide symbols such as switches, pilot lights, rotating fan wheels, etc. to represent the value of digital input and output points.
3. Point Status Color: Graphic presentations shall indicate different colors for different point statuses. (For instance, green = normal, red = alarm, gray (or '???') for non-response.
- J. Graphics Development Package: Graphic development and generation software shall be provided to allow the user to add, modify, or delete system graphic displays.
 1. The Contractor shall provide libraries of pre-engineered screens and symbols depicting standard air handling unit components (e.g. fans, cooling coils, filters, dampers, etc.), mechanical system components (e.g., pumps, chillers, cooling towers, boilers, etc.), complete mechanical systems (e.g. constant volume-terminal reheat, VAV, etc.) and electrical symbols.
 2. The Graphic Development Package shall use a pointing device to allow the user to perform the following:
 - a. Define symbols
 - b. Position items on graphic screens
 - c. Attach physical or virtual points to a graphic
 - d. Define background screens
 - e. Define connecting lines and curves
 - f. Locate, orient and size descriptive text
 - g. Define and display colors for all elements
 - h. Establish correlation between symbols or text and associated system points or other displays
 - i. Create hot spots or link triggers to other graphic displays or other functions in the software
- K. Graphic images shall reside on the CSS.
- L. The software shall be capable of initiating communication between the BC and the CSS:
 1. Upon user command, to perform all specified functions.
 2. In accordance with user-programmed time schedules to report alarms and upload trend and report data to the CSS.
- M. The software shall automatically terminate the communication when all specified functions are completed.

PART 3 - EXECUTION

3.01 SYSTEM CONFIGURATION

- A. Contractor shall thoroughly and completely configure BAS system software, supplemental software, network communications, BC and CSS, if necessary .

3.02 SITE-SPECIFIC APPLICATION PROGRAMMING

- A. Provide all database creation and site-specific application control programming as required by these Specifications, national and local standards and for a fully functioning system. Contractor shall provide all initial site-specific application programming and thoroughly document programming. Generally meet the intent of the written sequences of operation. It is the Contractor's responsibility to request clarification on sequence issues that require such clarification.
- B. All site-specific programming shall be fully documented and submitted for review and approval, both prior to downloading into the panel, at the completion of functional performance testing, and at the end of the warranty period.
- C. All programming, graphics and data files must be maintained in a logical system of directories with self-explanatory file names. All files developed for the project will be the property of the State and shall remain on the BC and CSS at the completion of the project.

3.03 PRIVILEGE LEVELS SETUP

- A. Set up the following privilege levels to include the specified capabilities:

1. Level 1: (State's BAS Administrator)
 - a. Level 2 capabilities
 - b. Configure system software
 - c. Modify graphic software
 - d. View, add, change and delete user login credentials and privilege levels
 - e. All unrestricted system capabilities including all network management functions.
 2. Level 1a (Contractor Technician)
 - a. Level 2 capabilities
 - b. Configure system software
 - c. Modify graphic software
 3. Level 2: (Maintenance Manager)
 - a. Level 3 capabilities
 - b. Modify control unit programs
 4. Level 3: (Senior BAS Technician)
 - a. Level 4 capabilities
 - b. Override output points
 - c. Change setpoints
 - d. Change equipment schedules
 5. Level 4: (Junior BAS Technician and Trainee)
 - a. Level 5 capabilities
 - b. Acknowledge alarms
 - c. Temporarily override equipment schedules
 6. Level 5: (Read Only)
 - a. Display all graphic data
 - b. Trend point data
- B. Contractor shall assist:
1. State's BAS Administrator with assigning user login credentials and privilege levels, configure system software and modify graphic software.
 2. Maintenance Manager with modifying control unit programs.

3.04 POINT PARAMETERS

- A. Provide the following minimum programming for each analog input:
1. Name
 2. Address
 3. Scanning frequency or COV threshold
 4. Engineering units
 5. Offset calibration and scaling factor for engineering units
 6. High and low alarm values and alarm differentials for return to normal condition
 7. High and low value reporting limits (reasonableness values), which shall prevent control logic from using shorted or open circuit values.
 8. Default value to be used when the actual measured value is not reporting. This is required only for points that are transferred across the primary and/or secondary controlling networks and used in control programs residing in control units other than the one in which the point resides. Events causing the default value to be used shall include failure of the control unit in which the point resides, or failure of any network over which the point value is transferred.
 9. Selectable averaging function that shall average the measured value over a user selected number of scans for reporting.
- B. Provide the following minimum programming for each analog output:
1. Name
 2. Address
 3. Output updating frequency
 4. Engineering units

5. Offset calibration and scaling factor for engineering units
 6. Output Range
 7. Default value to be used when the normal controlling value is not reporting.
- C. Provide the following minimum programming for each digital input:
1. Name
 2. Address
 3. Engineering units (on/off, open/closed, freeze/normal, etc.)
 4. Debounce time delay
 5. Message and alarm reporting as specified
 6. Reporting of each change of state, and memory storage of the time of the last change of state
 7. Totalization of on-time (for all motorized equipment status points), and accumulated number of off-to-on transitions.
- D. Provide the following minimum programming for each digital output:
1. Name
 2. Address
 3. Output updating frequency
 4. Engineering units (on/off, open/closed, freeze/normal, etc.)
 5. Direct or Reverse action selection
 6. Minimum on-time
 7. Minimum off-time
 8. Status association with a DI and failure alarming (as applicable)
 9. Reporting of each change of state, and memory storage of the time of the last change of state.
 10. Totalization of on-time (for all motorized equipment status points), and accumulated number of off-to-on transitions.
 11. Default value to be used when the normal controlling value is not reporting.

3.05 TRENDS

- A. Contractor shall establish and store trend logs. Trend logs shall be prepared for each physical input and output point, and all dynamic virtual points such as setpoints subject to a reset schedule, intermediate setpoint values for cascaded control loops, and the like as directed by the State.
- B. The State will analyze trend logs of the system operating parameters to evaluate normal system functionality. Contractor shall establish these trends and ensure they are being stored properly.
1. Data shall include a single row of field headings and the data thereafter shall be contiguous. Each record shall include a date and time field or single date stamp. Recorded parameters for a given piece of equipment or component shall be trended at the same intervals and be presented in a maximum of two separate 2-dimensional formats with time being the row heading and field name being the column heading.
- C. Sample times indicated as COV ($\pm$) or change-of-value mean that the changed parameter only needs to be recorded after the value changes by the amount listed. When output to the trending file, the latest recorded value shall be listed with any given time increment record. The samples shall be filled with the latest values also if the points include different time intervals. If the BAS does not have the capability to record based on COV, the parameter shall be recorded based on the interval common to the unit.
- D. Trending intervals or COV thresholds shall be dictated by the State upon system start-up.
- E. The Contractor shall demonstrate functional trends as specified for a period of 30 days after successful system demonstration before Substantial Completion of the system.

3.06 TREND GRAPHS

- A. Prepare controller and graphic software to display graphical format trends. Trended values and intervals shall be the same as those specified.
- B. Lines shall be labeled and shall be distinguishable from each other by using either different line types, or different line colors.
- C. Indicate engineering units of the y-axis values; e.g. degrees F., inches w.g., Btu/lb, percent open, etc.
- D. The y-axis scale shall be chosen so that all trended values are in a readable range. Do not mix trended values on one graph if their unit ranges are incompatible.
- E. Trend outside air temperature, humidity, and enthalpy during each period in which any other points are trended.
- F. All points trended for one subsystem (e.g. air handling unit, chilled water system, etc.) shall be trended during the same trend period.
- G. Each graph shall be clearly labeled with the subsystem title, date, and times.

3.07 ALARMS

- A. Override Alarms: Any point that is overridden through the override feature of the graphic software shall be reported as a Level 3 alarm.
- B. Analog Input Alarms: For each analog input, program an alarm message for reporting whenever the analog value is outside of the programmed alarm limits. Report a 'Return-to-Normal' message after the analog value returns to the normal range, using a programmed alarm differential. The alarm limits shall be individually selected by the Contractor based on the following criteria:
 - 1. Space temperature, except as otherwise stated in sequence of operation: Level 3
 - a. Low alarm: 64°F
 - b. Low return-to-normal: 68°F
 - c. High alarm: 85°F
 - d. High return-to-normal: 80°F
 - 2. Controlled media temperature other than space temperature (e.g. AHU discharge air temperature, steam converter leaving water temperature, condenser water supply, chilled water supply, etc.): Level 3 (If controlled media temperature setpoint is reset, alarm setpoints shall be programmed to follow setpoint)
 - a. Low alarm: 3°F below setpoint
 - b. Low return-to-normal: 2°F below setpoint
 - c. High alarm: 3°F above setpoint
 - d. High return-to-normal: 2°F above setpoint.
 - 3. AHU mixed air temperature: Level 4
 - a. Low alarm: 45°F
 - b. Low return-to-normal: 46°F
 - c. High alarm: 90°F
 - d. High return-to-normal: 89°F
 - 4. Duct Pressure:
 - a. Low alarm: 0.5"w.g. below setpoint
 - b. Low return-to-normal: 0.25"w.g. below setpoint
 - c. High alarm: 0.5"w.g. above setpoint
 - d. High return-to-normal: 0.25"w.g. above setpoint
 - 5. Space humidity:
 - a. Low alarm: 35%
 - b. Low return-to-normal: 40%
 - c. High alarm: 75%
 - d. High return-to-normal: 70%

- C. HOA Switch Tampering Alarms: The Sequences of Operation are based on the presumption that motor starter Hand-Off-Auto (HOA) switches are in the 'Auto' position. [If a motorized equipment unit starts without a prior start command from the FMS, (as sensed by status sensing device), then FMS shall perform the remaining sequence as specified.] BAS shall also enunciate the following Level 5 alarm message if status indicates a unit is operational when the run command is not present:
 - 1. DEVICE XXXX FAILURE: Status is indicated on the device even though it has been commanded to stop. Check the HOA switch, control relay, status sensing device, contactors, and other components involved in starting the unit. Acknowledge this alarm when the problem has been corrected.
- D. Maintenance Alarms: Enunciate Level 5 alarms when runtime accumulation exceeds a value specified by the operator
 - 1. DEVICE XXXX REQUIRES MAINTENANCE. Runtime has exceeded specified value since last reset.
- E. See requirements for additional equipment-specific alarms specified in Section 23 09 59 - Sequences of Operation.

3.08 GRAPHIC SCREENS

- A. Floor Plan Screens: The contract document drawings will be made available to the Contractor in AutoCAD (current version) format upon request. These drawings may be used only for developing backgrounds for specified graphic screens; however the State does not guarantee the suitability of these drawings for the Contractor's purpose.
 - 1. Provide graphic floor plan screens for each [floor] [wing] [tower] [other] of the building. Indicate the location of all equipment that is not located on the equipment room screens. Indicate the location of temperature sensors associated with each temperature-controlled zone (i.e., VAV terminals, fan-coils, single-zone AHUs, etc.) on the floor plan screens. [Zone background color shall change based on the temperature offset from setpoint]. Display the space temperature point adjacent to each temperature sensor symbol. Use a distinct line symbol to demarcate each terminal unit zone boundary. Use distinct colors to demarcate each air handling unit zone. [Mechanical floor plan drawings will be made available to the contractor upon request for the purpose of determining zone boundaries.] Indicate room numbers as provided by the State. Provide a drawing link from each space temperature sensor symbol and equipment symbol shown on the graphic floor plan screens to each corresponding equipment schematic graphic screen.
 - 2. Provide graphic floor plan screens for each mechanical equipment room and a plan screen of the roof. Indicate the location of each item of mechanical equipment. Provide a drawing link from each equipment symbol shown on the graphic plan view screen to each corresponding mechanical system schematic graphic screen.
 - 3. If multiple floor plans are necessary to show all areas, provide a graphic building key plan. Use elevation views and/or plan views as necessary to graphically indicate the location of all of the larger scale floor plans. Link graphic building key plan to larger scale partial floor plans. Provide links from each larger scale graphic floor plan screen to the building key plan and to each of the other graphic floor plan screens.
 - 4. Provide a graphic site plan with links to and from each building plan.
- B. System Schematic Screens: Provide graphic system schematic screen for each subsystem controlled with each I/O point in the project appearing on at least one graphic screen. System graphics shall include flow diagrams with status, setpoints, current analog input and output values, operator commands, etc. as applicable. General layout of the system shall be schematically correct. Input/output devices shall be shown in their schematically correct locations. Include appropriate engineering units for each displayed point value. Verbose names (English language descriptors) shall be included for each point on all graphics; this may be accomplished by the use of a hover box when the operator moves the cursor over the displayed point. Indicate all adjustable setpoints on the applicable system schematic graphic screen or, if space does not allow, on a supplemental linked-setpoint screen.

1. Provide graphic screens for each air handling system. Indicate outside air temperature and enthalpy, and mode of operation as applicable (i.e., occupied, unoccupied, warm-up, cool-down). Link screens for air handlers to the heating system and cooling system graphics. Link screens for supply and exhaust systems if they are not combined onto one screen.
 2. Provide a graphic screen for each zone. Provide links to graphic system schematic screens of air handling units that serve the corresponding zone.
 3. Provide a cooling system graphic screen showing all points associated with the chillers, cooling towers and pumps. Indicate outside air dry-bulb temperature and calculated wet-bulb temperature. Link screens for chilled water and condenser water systems if they cannot fit onto one cooling plant graphic screen.
 4. Link screens for heating and cooling system graphics to utility history reports showing current and monthly electric uses, demands, peak values, and other pertinent values.
- C. Bar Chart Screens: On each graphic Bar Chart Screen, provide drawing links to the graphic air handling unit schematic screens.
1. Provide a graphic chilled water valve screen showing the analog output signal of all chilled water valves in a bar chart format, with signals expressed as percentage of fully open valve (percentage of full cooling). Indicate the discharge air temperature and setpoint of each air handling unit, cooling system chilled water supply and return temperatures and the outside air temperature and humidity on this graphic. Provide drawing links between the graphic cooling plant screen and this graphic screen.
 2. Provide a graphic heating water valve screen showing the analog output signal of all air handling unit heating water valves in a bar chart format, with signals expressed as percentage of fully open valve (percentage of full heating). Indicate the temperature of the controlled medium (such as AHU discharge air temperature or zone hot water supply temperature) and the associated setpoint and the outside air temperature and humidity.
- D. Alarms: Each programmed alarm shall appear on at least one graphic screen. In general, alarms shall be displayed on the graphic system schematic screen for the system that the alarm is associated with (for example, chiller alarm shall be shown on graphic cooling system schematic screen). For all graphic screens, display analog values that are in a 'high alarm' condition in a red color, 'low alarm' condition in a blue color. Indicate digital values that are in alarm condition in a red color.

END OF SECTION 23 09 55

**SECTION 23 09 58
SEQUENCE OF OPERATION**

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. Air Handling Units
- B. Terminal Units
- C. Exhaust Fans

1.02 RELATED DOCUMENTS:

- A. Section 23 09 50 - Building Automation System (BAS) General
- B. Section 23 09 51 - BAS Basic Materials, Interface Devices, and Sensors
- C. Section 23 09 53 - BAS Field Panels
- D. Section 23 09 54 - BAS Communications Devices
- E. Section 23 09 55 - BAS Software
- F. Section 23 09 59 - BAS Commissioning

1.03 SYSTEM DESCRIPTION

- A. The systems to be controlled under work of this section basically comprise (describe the scope of the project). The systems being controlled are (describe the configuration of and the type of systems included in the project).
- B. This Section defines the manner and method by which controls function.

1.04 SUBMITTALS

- A. Refer to Section 23 09 50 and Division 1 for requirements for control shop drawings, product data, User Manual, etc.
- B. Programming Manual: Provide BAS system programming manual as well as documentation of site-specific programming prior to the start of Acceptance Phase.

1.05 PROJECT RECORD DOCUMENTS

- A. Within two weeks of the completion of commissioning, provide record documents to represent the final control configuration with actual setpoints and tuning parameters as existed at acceptance.
- B. Record documents shall be modified control drawings with the actual installed information. Drawings shall be delivered in both reproducible hard copy and electronic format in AutoCAD (current version) drawing files. Provide all supporting files, blocks, fonts, etc. required by the drawings.
- C. Provide final points list as described above.
- D. Provide final detailed wiring diagrams with all wire numbers and termination points indicated.
- E. Accurately record final sequences and control logic made after submission of shop drawings.

PART 2 - EXECUTION

2.01 GENERAL

- A. Sequences specified herein indicate the functional intent of the systems operation and may not fully detail every aspect of the programming that may be required to obtain the indicated operation. Contractor shall provide all programming necessary to obtain the sequences/system operation indicated.
- B. When an air handling unit is not in operation, control devices shall remain in their "off" positions. "Off" positions may differ from the "normal" (meaning failed) position. Except as specified otherwise, "off" and "normal" positions of control devices shall be as follows:
- C.

Device	"Off Position"	"Normal Position"
Heating coil valves	closed	open
Cooling coil valves	closed	closed
Outside air damper	closed	closed
Return air damper	open	open
Exhaust/relief air damper	closed	closed
Var. Freq. Drive	off	Min. speed

- D.
- E. Except as specified otherwise, throttling ranges, proportional bands, and cycle differentials shall be centered on the associated setpoint. All modulating feedback control loops shall include the capability of having proportional, integral, and derivative action. Unless the loop is specified "proportional only" or "P+I", Contractor shall apply appropriate elements of integral and derivative gain to each control loop which shall result in stable operation, minimum settling time, and shall maintain the primary variable within the specified maximum allowable variance.
- F. Scheduling Terminology: When air handlers are scheduled throughout the day, the following defines the terminology used (Designer coordinate with The State regarding actual occupancy schedules and initial setpoints):
1. Occupied Period: Period of time when the building is in use and occupied. Unless indicated otherwise, this period is defined as X:XX AM - X:XX PM weekdays and X:XX AM to 12:00PM (noon) Saturdays. Exclude all national holidays. Generally systems will be fully operational throughout this period and ventilation air shall be continuously introduced. Space temperature setpoints will generally be in the "normal" range of 69-77°F.
 2. Unoccupied period: Period of time when the building or zone is not in use and unoccupied. Ventilation air shall not be introduced.
 3. Preoccupancy Period: Time prior to the Occupied period when the systems are returning the space temperatures from setback to "normal" or occupied setpoints (warm-up and cool-down). Ventilation air shall not be introduced unless outside air conditions permit free-cooling. Time period shall be determined by an optimum start strategy unless otherwise specified.
 4. Setback Period: Setback will typically coincide start with the end of the occupied period and end with the start of the preoccupancy period, however it shall be provided with its own schedule. Generally systems will be off except to maintain a "setback" temperature.
- G. Where any sequence or occupancy schedule calls for more than one motorized unit to start simultaneously, the BAS start commands shall be staggered by 5 second (adj.) intervals to minimize inrush current.
- H. Alarm messages specified throughout the sequences are assigned to discrete priority levels. Priority levels dictate the handling and destination of alarm reports, and are defined in Section 23 09 55 - ATC System Software and Programming.
- I. Wherever a value is indicated as adjustable (adj.), it shall be modifiable, with the proper privilege level, from the operator interface or via a function block menu. For these points, it is unacceptable to have to modify programming statements to change the setpoint.
- J. When a power failure is detected in any phase, the BAS start commands shall be retracted immediately from all electrically powered units served by the failed power source. If the associated primary control unit (PCU) is powered by normal or emergency power, it may monitor its own power source as an indication of power status. If the PCU is powered by uninterruptable power supply (UPS), or if PCU is not capable of monitoring its own power for use in sequences, Contractor shall provide at least one voltage monitor (three phase when applicable) per building. When the BAS detects that power has been restored, all equipment for which the BAS start command had been retracted shall be automatically restarted on staggered 5 second intervals to minimize inrush current. When loss of equipment status

coincides with a power failure, system shall not alarm individual equipment failures. Instead, only a single Level 2 alarm shall be enunciated as follows:

1. BUILDING XXXX POWER FAILURE: Notify electric shop. Acknowledge alarm when power is restored.
- K. Where reset action is specified in a sequence of operation, but a reset schedule is not indicated on the drawings, one of the following methods shall be employed:
1. Contractor shall determine a fixed reset schedule which shall result in stable operation and shall maintain the primary variable within the specified maximum allowable variance.
 2. A floating reset algorithm shall be used which increments the secondary variable setpoint (setpoint of control loop being reset) on a periodic basis to maintain primary variable setpoint. The recalculation time and reset increment shall be chosen to maintain the primary variable within the specified maximum allowable variance.
 3. Primary variable shall control the devices directly using a PID feedback control loop without resetting the secondary variable. However, the control devices shall still modulate as necessary to maintain upper and lower limits on the secondary variable. Proportional band, integral gain, and derivative term shall be selected to maintain the primary variable within the specified maximum allowable tolerance while minimizing overshoot and settling time. Contractor shall gain prior approval for implementing this method of reset.
- L. Where a supply air temperature or duct pressure setpoint is specified to be reset by the space temperature of the zones calling for the most cooling/heating, the following method shall be employed:
1. A floating reset algorithm shall be used which increments the secondary variable (e.g., supply air temperature or duct pressure) setpoint on a periodic basis to maintain primary variable (e.g. space temperature) setpoint. The reset increment shall be determined by the quantity of "need heat" or "need cool" requests from individual SCU's. A SCU's "need heat" virtual point shall activate whenever the zone's space temperature falls below the currently applicable (occupied or unoccupied) heating setpoint throttling range. A SCU's "need cool" virtual point shall activate whenever the zone's space temperature rises above the currently applicable (occupied, unoccupied, or economy) cooling setpoint throttling range. The recalculation time and reset increment shall be chosen to maintain the primary variable within the specified maximum allowable variance while minimizing overshoot and settling time. Reset range maximum and minimum values shall limit the setpoint range.
- M. Where "prove operation" of a device (generally controlled by a digital output) is indicated in the sequence, it shall require that the BAS shall, after an adjustable time delay after the device is commanded to operate (feedback delay) , confirm that the device is operational via the status input. If the status point does not confirm operation after the time delay or anytime thereafter for an adjustable time delay (debounce delay) while the device is commanded to run, an alarm shall be enunciated audibly and via an alarm message at the operator interface and print at the alarm printers. A descriptive message shall be attached to the alarm message indicating the nature of the alarm and actions to be taken. Contractor shall provide messages to meet this intent. [Upon failure of equipment with redundant backup, run command shall be removed from equipment and the device shall be locked out until the alarm is manually acknowledged. Upon failure of equipment without redundant backup, run command shall remain energized and the alarm shall be latched until reset by an operator. BAS shall provide for adjustable maximum rates of change for increasing and decreasing output from the following analog output points:
1. Speed control of variable speed drives
 2. Chiller supply water temperature setpoint reset
 3. Chiller demand limit
 4. Travel rate of tower isolation and chiller isolation valves
- N. Wherever a value is indicated to be dependent on another value (i.e.: setpoint plus 5°F) BAS shall use that equation to determine the value. Simply providing a virtual point that the operator must set is unacceptable. In this case three virtual points shall be provided. One to store the parameter (5°F), one to store the setpoint, and one to store the value which is the result of the equation.

2.02 AIR HANDLING UNITS - GENERAL

- A. Logic Strategies: The BAS shall fully control the air handlers. Generally the BAS shall energize the AH (start the fans and activate control loops) as dictated for each air handle. The following indicates when and how the BAS shall energize the AHs and control various common aspects of them. The following "logic strategies" shall be included by reference with each air handler with any specific clarifications required:
1. Scheduled Occupancy: BAS shall determine the occupancy periods (occupied, unoccupied, preoccupancy, and setback) as defined above. The following details the common control aspects related to the scheduled occupancy.
 - a. Occupied Period: BAS shall energize the AH during all occupied periods. Note that the beginning of the occupancy period shall be set sufficiently before the actual start of occupancy to obtain the required building component of ventilation per ASHREA 62. Specific times shall be as directed by the A/E. Minimum OA flow setpoint shall be as scheduled on the drawings. "Normal" setpoints shall apply.
 - b. Unoccupied Period: Minimum OA flow shall be 0 CFM or the minimum OA damper position shall be 0%. If during the unoccupied period there is a request for occupancy override, the occupancy mode shall become active for an adjustable period. The unoccupied period and the preoccupancy period will typically overlap.
 - c. Setback Period: BAS shall deenergize the unit except as required to maintain a setback temperature as indicated in the individual sequences with a 5°F cycle differential. Generally, where setback temperatures apply in multiple zones, the worst zone shall control the system. Setback setpoints generally apply except during preoccupancy [and night purge]. If during the unoccupied period there is a request for occupancy override, the occupancy mode shall become active for an adjustable period.
 - d. Preoccupancy: BAS shall energize the AH continuously during the preoccupancy period. Minimum OA flow shall be 0 CFM or the minimum OA damper position shall be 0%. "Normal" setpoints shall apply. Preoccupancy duration shall be one of the following as specified by reference:
 - 1) Fixed: The duration of the preoccupancy period shall be fixed as scheduled by the operator.
 - 2) Optimum: The duration of the morning warm-up period shall vary according to outside air temperature and space temperature such that the space temperature rises to occupied period heating setpoint at the beginning of, but not before, the scheduled occupied period. The duration of the cool-down period shall vary according to outside air temperature and space temperature such that the space temperature falls to the occupied period cooling setpoint at the beginning of, but not before, the scheduled occupied period.
 2. Minimum OA Control: BAS shall maintain minimum ventilation during the occupied period. The following strategies may apply:
 - a. Balanced Position: During the occupied period, applicable mixing and OA dampers shall never be positioned less than the position set for the required minimum OA ventilation rate. If the air handler has a single OA damper that is capable of economizer, the minimum position output shall be determined by the balancer. If the AH has a two position minimum OA damper, that position shall be fully open to its balanced position. This logic strategy is only applicable to constant volume Ahs.
 - b. Reset Balanced Position: During the occupied period, applicable mixing and OA dampers shall never be positioned less than the minimum position. Minimum position shall be reset between limits of a position delivering system exhaust make-up air CFM and the design minimum position delivering design minimum CFM to maintain a CO2 setpoint of 900 ppm (adj.). Loop shall be a "sample and bump" or dynamic proportional only loop tuned for the slow response. The balancer shall determine the minimum position outputs at both extreme points. This logic strategy is only applicable to constant volume AHs.

- c. Damper Controlled Fixed: During the occupied period, applicable mixing dampers shall be modulated to maintain an OA flow rate of no less than the MVR as dictated in the design and required by ASHRAE 62. Setpoint flow rates shall be provided by the A/E. Flow rate shall be determined in any of the following ways as specified for the particular AH:
 - 1) Measured directly by an OA flow station
 - 2) As determined by CO2 mixing equations using the SA, OA, and RA CO2 sensors
 - d. Damper Controlled Reset: During the occupied period, applicable mixing dampers shall be modulated to maintain an OA flow rate setpoint. Setpoint shall be reset between limits of system exhaust make-up air CFM and the design minimum CFM to maintain an RA CO2 setpoint of 900 ppm (adj.). Loop shall be a "sample and bump" or dynamic proportional only loop tuned for the slow response. Setpoint flow rates shall be provided by the A/E. Flow rate shall be determined in any of the following ways as specified for the particular AH:
 - 1) Measured directly by an OA flow station
 - 2) As determined by CO2 mixing equations using the SA, OA, RA, and/or Space CO2 sensors
 - 3. Sequenced Heating and Cooling: BAS shall control the heating and cooling coils and air side economizer as detailed for the particular AH. Program logic shall directly prohibit the heating and cooling valves as well as the heating valve and economizer damper to be open (or above minimum) simultaneously. This does not apply to cooling and reheat valves that are used simultaneously for dehumidification.
 - 4. Freeze Safety: Upon operation of a freezestat, unit shall be deenergized with the exception of the heating loops. Typically supply and return fans where applicable shall be deenergized via a hardwired interlock, and an indication of the operation shall be sensed by the BAS. BAS shall enunciate appropriate alarm and remove and lock out the start command. OA dampers shall close and heating loops shall remain active.
 - 5. Smoke Safety: Upon indication of smoke by a smoke detector, FAC shall deenergize the AH. Smoke detector shall notify the fire alarm system and BAS, shut down the fans, and close the smoke dampers via hard-wired interlock.
 - 6. High or Low Pressure Safety: Upon activation of a high or low pressure safety switch, AH shall be deenergized, fans shall be deenergized via a hard wired interlock [, and an indication of the operation shall be sensed by the BAS. BAS shall enunciate appropriate alarm and remove and lock out the start command], [which shall initiate "fan failure" alarms].
 - 7. Vibration Safety (Applicable To Units >50,000 cfm): Upon activation of a vibration safety switch, respective fan shall be deenergized, fan shall be deenergized via a hard wired interlock and an indication of the operation shall be sensed by the BAS]. BAS shall enunciate appropriate alarm and remove and lock out the start command.
- B. The detailed "logic strategies" above shall be required by reference to them in each of the individual sequences specified below.

2.03 AIR HANDLING UNIT DIAGNOSTICS - GENERAL

- A. Diagnostic Strategies: In addition to the standard alarm limits specified for all sensed variables the BAS monitor and diagnose anomalies in the operation of the air handlers. The following "diagnostic strategies" shall be included by reference with each air handler with any specific clarifications required:
- 1. Run Time Limit: BAS shall accumulate the runtime of the status of associated rotating equipment and enunciate a level 5 alarm to indicate that the unit is in need of service.
 - 2. Filter Monitoring: BAS shall monitor the differential pressure transmitter across the filter bank(s). A level 5 alarm shall be reported when pressure drop exceeds the transmitter's setting.

3. Start Monitoring: BAS shall accumulate the starts of cycling equipment. BAS shall further enunciate a level 5 alarm when the number of starts exceeds the specified value within the specified time period. (ie: more than 3 starts in a 30 min period)
4. Cooling Capacity Shortage: BAS shall monitor the output to the valve. If the output exceeds 99% open for 1 hour continuously, enunciate the following alarm
 - a. Lack of Capacity: The cooling valve of XXX has been commanded to the full open position for an extended time period. Ensure that the setpoint for the control loop is at a reasonable value and that flow to the coil has not been obstructed as in a plugged strainer, throttled balancing valve, debris in the control valve, etc.
5. Economizer Anomaly: If mixed air temperature is less than low limit mixed air temperature °F or greater than 85; or if the outside air temperature is between 55°F and 65°F and the mixed air temperature is more than 2°F different from the outside air temperature for more than 30 minutes continuously, enunciate the following alarm at level 3 and 4 priority:
 - a. ENERGY WASTE: An unexpected mixed air temperature indicates a possible problem with the economizer damper controls. Please check for faulty dampers or controls.
6. Fighting Thermal Zones: BAS shall monitor the mode of multiple terminal zones within a thermal zone and enunciate the following level 3 alarm if some are in heating mode, and others are in cooling mode:
 - a. FIGHTING TERMINAL UNITS: Simultaneous heating and cooling exists in XXX. Coordinate the setpoints.
7. Fighting Humidity Zones: BAS shall monitor the mode of multiple terminal zones within a humidity zone and enunciate the following level 3 alarm if some are in heating mode, and others are in cooling mode:
 - a. FIGHTING TERMINAL UNITS: simultaneous humidification and dehumidification exists in XXX. Coordinate the setpoints.
8. Unstable Control: BAS shall monitor the output to the actuator. BAS shall calculate the average change in output per second over a 30-min. period. The average change in output signal shall be calculated as follows:
$$\frac{(\text{Abs}(\text{Current Output}(\%) - \text{Last Output}(\%)))}{(\text{Scan Interval(s)})} \div (\text{\# of Scans in 30 min})$$
 The program shall execute the check once every 14 hours (start the 30-min. interval change accumulation, after 30 min. perform the check and clear the sum). BAS shall enunciate the following alarm if the average rate of change exceeds 1%/sec or one half of the maximum rate of change programmed for the point.
 - a. Unstable Control: The control loop on XXX appears to be unstable. Establish a plot of the valve output to validate this. If the damper is hunting unacceptably, tune the loop.

2.04 CENTRAL PLANT EQUIPMENT - MONITORING AND MANAGEMENT

- A. General: The BAS shall monitor various aspects of the heating and cooling systems and calculate parameters as specified below to facilitate plant operations and management.
- B. Trending: The BAS shall continuously monitor, calculate and display the following parameters at the intervals indicated. These values shall be stored and reported per the trending requirements defined in Section 23 09 55.
- C. Parameters to be trended:
 1. Load on the secondary systems in MBH per the following equation:
$$(\text{Return Temp} - \text{Supply Temp}) * (\text{GPM}) / .5$$
 This shows cooling as a positive heat load and heating as a negative heat load. Note that multipliers on this value to accommodate the BAS processors are acceptable as long as they are clearly indicated. This value shall be trended and stored every two hours.
 2. All temperature sensors at 1 hour intervals
 3. All relative humidity sensors at 1 hour intervals
 4. All pressure sensors at 1 hour intervals
 5. All run requests and statuses on a change in value

6. All analog loop outputs on 1 hour intervals
7. Calculated enthalpies in 2 hour intervals
8. Summed cooling and heating requests on 2 hour intervals

END OF SECTION 23 09 58

THIS PAGE INTENTIONALLY LEFT BLANK

SECTION 23 09 59
BAS SYSTEM COMMISSIONING

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. BAS and equipment testing and start-up
- B. Validation of proper and thorough installation of BAS and equipment
- C. Functional testing of control systems
- D. Documentation of tests, procedures, and installations
- E. Coordination of BAS training
- F. Documentation of BAS Operation and Maintenance materials

1.02 RELATED SECTIONS:

- A. Section 23 09 50 - BAS General Requirements
- B. Section 23 09 51 - BAS Basic Materials and Devices
- C. Section 23 09 53 - BAS Field Panels
- D. Section 23 09 54 - BAS Communication Devices
- E. Section 23 09 55 - BAS Software and Programming
- F. Section 23 09 58 - Sequence of Operation

1.03 GENERAL DESCRIPTION

- A. This section defines responsibilities of the Controls Contractor to commission the BAS.

1.04 CONTRACTOR RESPONSIBILITIES

- A. Completely install and thoroughly inspect, startup, test, adjust, balance, and document all systems and equipment.
- B. Assist Commissioning Authority in performing verification and performance testing. This will generally include the following:
 - 1. Attend Commissioning (Cx) progress and coordination meetings.
 - 2. Prepare and submit required draft forms and systems information.
 - 3. Establish trend logs of system operation as specified herein.
 - 4. Demonstrate system operation.
 - 5. Manipulate systems and equipment to facilitate testing.
 - 6. Provide instrumentation necessary for verification and performance testing.
 - 7. Manipulate control systems to facilitate verification and performance testing.
 - 8. Train State's Representatives as specified in Part III of this section.
- C. Provide a BAS Technician to work at the direction of Commissioning Authority for software optimization assistance for a minimum of [80] hours. Refer to Part 3 for a description of the software optimization.

1.05 SEQUENCING

- A. The following list outlines the general sequence of events for submittals and commissioning:
 - 1. Submit product data and shop drawings, and receive approval.
 - 2. Submit BAS logic documentation, and receive approval.
 - 3. Submit Start-Up Checklists and manufacturer's start-up procedures for all equipment provided by the BAS Contractor.
 - 4. Install BAS.
 - 5. Submit BAS Start-Up Test Agenda and Schedule for review.
 - 6. Receive BAS start up Test Agenda/schedule approval.
 - 7. Submit Training Plan.
 - 8. Simulate sequencing and debug program off-line to the extent practical.

9. Place systems under BAS control where applicable during a scheduled outage.
10. Perform BAS start up where applicable during a scheduled outage.
11. Prepare and initiate trend log data storage and format trend graphs.
12. Submit completed BAS Start-Up Reports and initial draft of the O&M Manuals.
13. Receive BAS Start Up Report approval and approval to schedule Demonstrations and Commissioning.
14. Demonstrate systems to Commissioning Authority and The State.
15. Submit Trend Logs in format specified.
16. Receive demonstration approval and approval to schedule Acceptance Period.
17. Train The State on BAS operation and maintenance.
18. Substantial Completion.
19. Begin Acceptance Phase.
20. Two week Operational Test.
21. Perform Functional Performance Testing.
22. Receive Acceptance Period approval, which is Functional Completion for the BAS.
23. Train The State on final sequences and modes of operation.
24. Install framed control drawings. (See Section 23 09 50/1.09/G)
25. Provide Level 1 password access to the State.
26. Revise and re-submit record drawings and O&M Manuals.
27. Substantial Completion.
28. Begin Warranty Phase.
29. Schedule and begin Opposite Season acceptance period.
30. Receive Opposite Season acceptance period approval.
31. Submit as-built drawings and O&M Manuals.
32. Update framed control drawings. (See Section 23 09 50/1.09/G)
33. Complete State personnel Training.
34. End-of-Warranty date/period.

PART 2 - PRODUCTS

2.01 INSTRUMENTATION

- A. Instrumentation required to verify readings and test the system and equipment performance shall be provided by Contractor and made available to Commissioning Authority. Generally, no testing equipment will be required beyond that required to perform Contractors work under these Contract Documents. All equipment used for testing and calibration shall be NIST/NBS traceable and calibrated within the preceding 6-month period. Certificates of calibration shall be submitted.

2.02 TAB & COMMISSIONING PORTABLE OPERATORS TERMINAL

- A. For new projects, Contractor shall provide a portable operators terminal or hand held device to facilitate Testing, Adjusting, and Balancing (TAB) and calibration. This device shall support all functions and allow querying and editing of all parameters required for proper calibration and start up.
- B. Connections shall be provided local to the device being calibrated. For instance, for VAV boxes, connection of the operator's terminal shall be either at the sensor or at the terminal box. Otherwise a wireless system shall be provided to facilitate this local functionality.

PART 3 - EXECUTION

3.01 BAS START-UP TESTING, ADJUSTING, CALIBRATION

- A. Work and/or systems installed under this Division shall be fully functioning prior to Demonstration and Acceptance Phase. Contractor shall start, test, adjust, and calibrate all work and/or systems under this Contract, as described below:
 1. Inspect the installation of all devices. Review the manufacturer's installation instructions and validate that the device is installed in accordance with them.

2. Verify proper electrical voltages and amperages, and verify that all circuits are free from faults.
3. Verify integrity/safety of all electrical connections.
4. For the following control settings, initially use the control setting that was used by existing control system, unless otherwise indicated. For AHUs that use a throttled outside air damper position when minimum outside air is required, contractor shall mark existing minimum outside air damper position to allow replication by new controls.
5. Coordinate with TAB subcontractor to obtain control settings that are determined from balancing procedures. Record the following control settings as obtained from TAB contractor, and note any TAB deficiencies in the BAS Start-Up Report:
 - a. Optimum duct static pressure setpoints for VAV air handling units.
 - b. Minimum outside air damper settings for air handling units.
 - c. Optimum differential pressure setpoints for variable speed pumping systems.
 - d. Calibration parameters for flow control devices such as VAV boxes and flow measuring stations.
 - 1) BAS contractor shall provide hand-held device as a minimum to the TAB and CA to facilitate calibration. Connection for any given device shall be local to it (i.e. at the VAV box or at the thermostat). Hand-held device or portable operator's terminal shall allow querying and editing of parameters required for proper calibration and start-up.
6. Test, calibrate, and set all digital and analog sensing and actuating devices. Calibrate each instrumentation device by making a comparison between the BAS display and the reading at the device, using an instrument traceable to the National Bureau of Standards, which shall be at least twice as accurate as the device to be calibrated (e.g., if field device is +/-0.5% accurate, test equipment shall be +/-0.25% accurate over same range). Record the measured value and displayed value for each device in the BAS Start Up Report.
7. Check and set zero and span adjustments for all transducers and transmitters.
8. For dampers and valves:
 - a. Check for adequate installation including free travel throughout range and adequate seal.
 - b. Where loops are sequenced, check for proper control without overlap.
9. For actuators:
 - a. Check to insure that device seals tightly when the appropriate signal is applied to the operator.
 - b. Check for appropriate fail position, and that the stroke and range is as required.
 - c. For pneumatic operators, adjust the operator spring compression as required to achieve close-off. If positioner or volume booster is installed on the operator, calibrate per manufacturer's procedure to achieve spring range indicated. Check split-range positioners to verify proper operation. Record settings for each device in the BAS Pre-Commissioning Report.
 - d. For sequenced electronic actuators, calibrate per manufacturer's instructions to required ranges.
10. Check each digital control point by making a comparison between the control command at the CU and the status of the controlled device. Check each digital input point by making a comparison of the state of the sensing device and the Operator Interface display. Record the results for each device in the BAS Start-Up Report.
11. For outputs to reset other manufacturer's devices (for example, VSDs) and for feedback from them, calibrate ranges to establish proper parameters. Coordinate with representative of the respective manufacturer and obtain their approval of the installation.
12. Verify proper sequences by using the approved checklists to record results and submit with BAS Start-Up Report. Verify proper sequence and operation of all specified functions.
13. Verify that all safety devices trip at appropriate conditions. Adjust setpoints accordingly.

14. Tune all control loops to obtain the fastest stable response without hunting, offset or overshoot. Record tuning parameters and response test results for each control loop in the BAS Start Up Report. Except from a startup, maximum allowable variance from set point for controlled variables under normal load fluctuations shall be as follows. Within 3 minutes of any upset (for which the system has the capability to respond) in the control loop, tolerances shall be maintained (exceptions noted):
 - a. Duct air temperature: $\pm 1^{\circ}\text{F}$.
 - b. Space Temperature: $\pm 2^{\circ}\text{F}$
 - c. Chilled Water: $\pm 1^{\circ}\text{F}$
 - d. Hot water temperature: $\pm 3^{\circ}\text{F}$.
 - e. Condenser water temperature: $\pm 3^{\circ}\text{F}$.
 - f. Duct pressure: $\pm 0.25''$ w.g.
 - g. Water pressure: ± 1 psid
 - h. Duct or space Humidity: $\pm 5\%$
 - i. Air flow control: $\pm 5\%$ of setpoint velocity. [For fume hoods $\pm 10\%$ on full sash travel (from min to max in 3 seconds) within 3 seconds. Refer to Section 15995 for fume hood acceptance requirements.] [For minimum OA flow loops being reset from CO₂, response to upset max time is one hour.]
 - j. Space Pressurization (on active control systems): $\pm 0.05''$ wg with no door or window movements.
15. For interface and DDC control panels:
 - a. Ensure devices are properly installed with adequate clearance for maintenance and with clear labels in accordance with the record drawings.
 - b. Ensure that terminations are safe, secure and labeled in accordance with the record drawings.
 - c. Check power supplies for proper voltage ranges and loading.
 - d. Ensure that wiring and tubing are run in a neat and workman-like manner, either bound or enclosed in trough.
 - e. Check for adequate signal strength on communication networks.
 - f. Check for standalone performance of controllers by disconnecting the controller from the LAN. Verify the event is annunciated at Operator Interfaces. Verify that the controlling LAN reconfigures as specified in the event of a LAN disconnection.
 - g. Ensure that all outputs and devices fail to their proper positions/states.
 - h. Ensure that buffered and/or volatile information is held through power outage.
 - i. With all system and communications operating normally, sample and record update/annunciation times for critical alarms fed from the panel to the Operator Interface.
 - j. Check for adequate grounding of all DDC panels and devices.
16. For Operator Interfaces:
 - a. Verify that all elements on the graphics are functional and are properly bound to physical devices and/or virtual points, and that hot links or page jumps are functional and logical.
 - b. Output all specified BAS reports for review and approval.
 - c. Verify that the alarm printing and logging is functional and per requirements.
 - d. Verify that trends are archiving to disk and provide a sample to the [Commissioning Authority and] State for review.
 - e. Verify that paging/dial-out alarm annunciation is functional.
 - f. Verify the functionality of remote Operator Interfaces and that a robust connection can be established consistently.
 - g. Verify that required third party software applications required with the bid are installed and are functional.
17. Start-up and check out control air compressors, air drying, and filtering systems in accordance with the appropriate section and with manufacturer's instructions.
18. Verify proper interface with fire alarm system.

- B. Submit Start-Up Test Report: Report shall be completed, submitted, and approved prior to Substantial Completion.

3.02 SENSOR CHECKOUT AND CALIBRATION

- A. General Checkout: Verify that all sensor locations are appropriate and are away from causes of erratic operation. Verify that sensors with shielded cable are grounded only at one end. For sensor pairs that are used to determine a temperature or pressure difference, make sure they are reading within 0.2°F of each other for temperature and within a tolerance equal to 2% of the reading of each other for pressure. Tolerances for critical applications may be tighter.
- B. Calibration: Calibrate all sensors using one of the following procedures:
1. Sensors Without Transmitters - Standard Application: Make a reading with a calibrated test instrument within 6 inches of the site sensor at various points across the range. Verify that the sensor reading (via the permanent thermostat, gage or BAS) is within the tolerances specified for the sensor. If not, adjust offset and range, or replace sensor. Where sensors are subject to wide variations in the sensed variable, calibrate sensor within the highest and lowest 20% of the expected range.
 2. Sensors With Transmitters - Standard Application: Disconnect sensor. Connect a signal generator in place of sensor. Connect ammeter in series between transmitter and BAS control panel. Using manufacturer's resistance-temperature data, simulate minimum desired temperature. Adjust transmitter potentiometer zero until the ammeter reads 4 mA. Repeat for the maximum temperature matching 20 mA to the potentiometer span or maximum and verify at the OI. Record all values and recalibrate controller as necessary to conform to tolerances. Reconnect sensor. Make a reading with a calibrated test instrument within 6 inches of the site sensor. Verify that the sensor reading (via the permanent thermostat, gage or BAS) is within the tolerances specified. If not, replace sensor and repeat. For pressure sensors, perform a similar process with a suitable signal generator.
- C. Sensor Tolerance: Sensors shall be within the tolerances specified for the device. Refer to Section 23 09 51.

3.03 COIL VALVE LEAK CHECK

- A. Verify proper close-off of the valves. Ensure the valve seats properly by simulating the maximum anticipated pressure difference across the circuit. Calibrate air temperature sensors on each side of coil to be within 0.5°F of each other. Via the Operator Interface, command the valve to close. Energize fans. After 5 minutes observe air temperature difference across coil. If a temperature difference is indicated, and the piping surface temperature entering the coil is within 3°F of the water supply temp, leakage is probably occurring. If it appears that it is occurring, close the isolation valves to the coil to ensure the conditions change. If they do, this validates the valve is not closing. Remedy the condition by adjusting the stroke and range, increasing the actuator size/torque, replacing the seat, or replacing the valve as applicable.

3.04 VALVE STROKE SETUP AND CHECK

- A. For all valve and actuator positions checked, verify the actual position against the Operator Interface readout.
- B. Set pumps to normal operating mode. Command valve closed, verify that valve is closed, and adjust output zero signal as required. Command valve open, verify position is full open and adjust output signal as required. Command the valve to various few intermediate positions. If actual valve position doesn't reasonably correspond, replace actuator or add pilot positioner (for pneumatics).

3.05 BAS DEMONSTRATION

- A. Demonstrate the operation of the BAS hardware, software, and all related components and systems to the satisfaction of the Commissioning Authority and State. Schedule the demonstration with the State's representative 1 week in advance. Demonstration shall not be scheduled until all hardware and software submittals, and the Start-Up Test Report are approved. If the Work fails to be demonstrated to conform with Contract specifications, so as to

require scheduling of additional site visits by the Commissioning Authority for re-demonstration, Contractor shall reimburse The State for costs of subsequent Commissioning Authority site visits.

- B. The Contractor shall supply all personnel and equipment for the demonstration, including, but not limited to, instruments, ladders, etc. Contractor-supplied personnel must be competent with and knowledgeable of all project-specific hardware, software, and the HVAC systems. All training documentation and submittals shall be at the job site.
- C. Demonstration shall typically involve small representative samples of systems/equipment randomly selected by the State and CA.
- D. The system shall be demonstrated following the same procedures used in the Start-Up Test by using the approved Commissioning Checklists. Demonstration shall include, but not necessarily be limited to, the following:
 - 1. Demonstrate that required software is installed on BAS workstations. Demonstrate that graphic screens, alarms, trends, and reports are installed as submitted and approved.
 - 2. Demonstrate that points specified and shown can be interrogated and/or commanded (as applicable) from all workstations, as specified.
 - 3. Demonstrate that remote dial-up communication abilities are in accordance with these Specifications.
 - 4. Demonstrate correct calibration of input/output devices using the same methods specified for the Start-Up Tests. A maximum of 10 percent of I/O points shall be selected at random by the Commissioning Authority and/or State for demonstration. Upon failure of any device to meet the specified end-to-end accuracy, an additional 10 percent of I/O points shall be selected at random by Commissioning Authority for demonstration. This process shall be repeated until 100 percent of randomly selected I/O points have been demonstrated to meet specified end-to-end accuracy.
 - 5. Demonstrate that all DDC and other software programs exist at respective field panels. The Direct Digital Control (DDC) programming and point database shall be as submitted and approved.
 - 6. Demonstrate that all DDC programs accomplish the specified sequences of operation.
 - 7. Demonstrate that the panels automatically recover from power failures, as specified.
 - 8. Demonstrate that the stand-alone operation of panels meets the requirements of these Specifications. Demonstrate that the panels' response to LAN communication failures meets the requirements of these Specifications.
 - 9. Identify access to equipment selected by Commissioning Authority. Demonstrate that access is sufficient to perform required maintenance.
 - 10. Demonstrate that required trend graphs and trend logs are set up per the requirements. Provide a sample of the data archive. Indicate the file names and locations.
- E. BAS Demonstration shall be completed and approved prior to Substantial Completion.
- F. Any tests successfully completed during the demonstration will be recorded as passed for the functional performance testing and will not have to be retested.

3.06 BAS ACCEPTANCE PERIOD

- A. After approval of the BAS Demonstration and prior to Contract Close Out Acceptance Phase shall commence. Acceptance Period shall not be scheduled until all HVAC systems are in operation and have been accepted, all required cleaning and lubrication has been completed (i.e., filters changed, piping flushed, strainers cleaned, and the like), and TAB report has been submitted and approved. Acceptance Period and its approval will be performed on a system-by-system basis if mutually agreed upon by the Contractor and the State of Delaware.
- B. Operational Test: At the beginning of the Acceptance Phase, the system shall operate properly for two weeks without malfunction, without alarm caused by control action or device failure, and with smooth and stable control of systems and equipment in conformance with these specifications. At the end of the two weeks, contractor shall forward the trend logs to the Commissioning Authority for review. Commissioning Authority shall determine if the system is

ready for functional performance testing and document any problems requiring contractor attention.

1. If the systems are not ready for functional performance testing, Contractor shall correct problems and provide notification to the State's representative that all problems have been corrected. The Acceptance Period shall be restarted at a mutually scheduled time for an additional one-week period. This process shall be repeated until Commissioning Authority issues notice that the BAS is ready for functional performance testing.
- C. During the Acceptance Period, the contractor shall maintain a hard copy log of all alarms generated by the BAS. For each alarm received, Contractor shall diagnose the cause of the alarm, and shall list on the log for each alarm, the diagnosed cause of the alarm, and the corrective action taken. If in the Contractor's opinion, the cause of the alarm is not the responsibility of the Contractor, Contractor shall immediately notify the State's representative.

3.07 TREND LOGS

- A. Contractor shall configure and analyze all trends required under Section 23 09 55.

3.08 TREND GRAPHS

- A. Trend graphs as specified in Section 23 09 55 shall generally be used during the Acceptance Phase to facilitate and document testing. Prepare controller and workstation software to display graphical format trends during the Acceptance Period. Trend graphs shall demonstrate compliance with contract documents.
- B. Each graph shall be clearly labeled with HVAC subsystem title, date, and times.

3.09 WARRANTY PHASE BAS OPPOSITE SEASON TRENDING AND TESTING:

- A. Trending: throughout the Warranty Phase, trend logs shall be maintained as required for the Acceptance Period. Contractor shall forward archive trend logs to the Commissioning Authority/ State for review upon Commissioning Authority/ State's request. Commissioning Authority/ The State will review these and notify contractor of any warranty work required.
- B. Opposite Season Testing: Within 6 months of completion of the Acceptance Phase, Commissioning Authority/ The State shall schedule and conduct Opposite Season functional performance testing. Contractor shall participate in this testing and remedy any deficiencies identified.

3.10 SOFTWARE OPTIMIZATION ASSISTANCE

- A. The Contractor shall provide the services of a BAS Technician as specified above at the project site to be at the disposal of the Commissioning Authority. The purpose of this requirement is to make changes, enhancements and additions to control unit and/or workstation software that have been identified by the Commissioning Authority during the construction and commissioning of the project and that are beyond the specified Contract requirements. The cost for this service shall be included with the bid. Requests for assistance shall be for contiguous or non-contiguous 8-hour days, unless otherwise mutually agreed upon by Contractor, Commissioning Authority, and State. The State's representative shall notify contractor 2 days in advance of each day of requested assistance.
- B. The BAS Technician provided shall be thoroughly trained in the programming and operation of the controller and workstation software. If the BAS Technician provided cannot perform every software task requested by the Commissioning Authority in a timely fashion, contractor shall provide additional qualified personnel at the project site as requested by the Commissioning Authority, to meet the total specified requirement on-site.

3.11 BAS OPERATOR TRAINING AND O&M MANUALS

- A. Provide up to 4 complete sets of the approved Operations and Maintenance (O&M) Manuals (hard copy and one electronic copy) to be used for training.
- B. Contractor shall submit a Training Plan for the scope of training for which they are responsible. Training Plan shall be forwarded to the Division 23 Contractor who will compile, organize, format, and forward to the Engineer for review.

- C. On-Site Training: Provide services of controls contractor's qualified technical personnel for [five] 8-hour days to instruct State's personnel in operation and maintenance of BAS. Instruction shall be in classroom setting at the project site for appropriate portions of the training. Training may be in non-contiguous days at the request of the State. The State's representative shall notify contractor 1 week in advance of each day of requested training. The Contractor's designated training personnel shall meet with the Engineer and State's representative for the purpose of discussing and fine-tuning the training agenda prior to the first training session.

Training agenda shall generally be as follows:

1. Basic Operator Workstation (OWS) Training - For all potential users of the OWS:
 - a. Brief walk-through of building, including identification of all controlled equipment and condensed demonstration of controller portable and built-in operator interface device display capabilities.
 - b. Brief overview of the various parts of the O&M Manuals, including hardware and software programming and operating publications, catalog data, controls installation drawings, and DDC programming documentation.
 - c. Demonstration of workstation login/logout procedures, password setup, and exception reporting.
 - d. Demonstration of workstation menu penetration and broad overview of the various workstation features.
 - e. Overview of systems installed.
 - f. Present all site-specific point naming conventions and points lists, open protocol information, configuration databases, back-up sequences, upload/download procedures, and other information as necessary to maintain the integrity of the BAS.
 - g. Overview of alarm features.
 - h. Overview of trend features.
 - i. Overview of workstation reports.
2. BAS Hardware Training - For Maintenance and Control Technicians
 - a. Review of installed components and how to install/replace, maintain, commission, and diagnose them
3. BAS Technician Training
 - a. Introduction to controller programming and overview of the programming application interface.
 - b. General review of sequence of operation and control logic for the project site, including standalone and fail-safe modes of operation.
 - c. Uploading/Downloading and backing up programs.
 - d. Network administration.
 - e. Review of setpoint optimization and fine-tuning concepts.
4. Advanced Training: Advanced Training shall be provided for one (1) individual and be provided at an off-site training facility containing installations of the proposed system. Contractor shall pay training registration and materials fee and the State shall pay all employee expenses (travel, per diem, salary).
 - a. Contractor shall provide the standard, advanced training offering on all Control Programming Applications.
 - b. Contractor shall provide the standard, advanced training offering on Advanced Installation, Configuration, Maintenance, and Network Administration.
 - c. For Echelon-based systems, advanced training shall include a Lon systems integration course.

END OF SECTION

SECTION 23 09 69
VARIABLE FREQUENCY CONTROLLERS

PART 1 - GENERAL

1.01 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.02 SUMMARY

- A. This Section includes solid-state, PWM, VFCs for speed control of three-phase motors.

1.03 DEFINITIONS

- A. BMS: Building management system.
- B. IGBT: Integrated gate bipolar transistor.
- C. LAN: Local area network.
- D. PID: Control action, proportional plus integral plus derivative.
- E. PWM: Pulse-width modulated.
- F. VFC: Variable frequency controller.

1.04 SUBMITTALS

- A. Product Data: For each type of VFC, provide dimensions; mounting arrangements; location for conduit entries; shipping and operating weights; and manufacturer's technical data on features, performance, electrical ratings, characteristics, and finishes.
- B. Shop Drawings (for each VFC):
 - 1. Include dimensioned plans, elevations, sections, and details, including required clearances and service space around equipment. Show tabulations of installed devices, equipment features, and ratings. Include the following:
 - a. Each installed unit's type and details.
 - b. Nameplate legends.
 - c. Short-circuit current ratings of integrated unit.
 - d. UL listing for series rating of overcurrent protective devices in combination controllers.
 - 2. Wiring Diagrams: Power, signal, and control wiring for VFC. Provide schematic wiring diagram for each type of VFC.
- C. Coordination Drawings: Floor plans showing dimensioned layout, required working clearances, and required area above and around VFCs where pipe and ducts are prohibited. Show VFC layout and relationships between electrical components and adjacent structural and mechanical elements. Show support locations, type of support, and weight on each support. Indicate field measurements.
- D. Qualification Data: For testing agency and manufacturer.
- E. Field Test Reports: Written reports specified in Part 3.
- F. Manufacturer's field service report.
- G. Operation and Maintenance Data: For VFCs, all installed devices, and components to include in emergency, operation, and maintenance manuals. In addition to items specified in Division 1 Section "Operation and Maintenance Data," include the following:
 - 1. Routine maintenance requirements for VFCs and all installed components.
 - 2. Manufacturer's written instructions for testing and adjusting overcurrent protective devices.
- H. Load-Current and Overload-Relay Heater List: Compile after motors have been installed and arrange to demonstrate that selection of heaters suits actual motor nameplate full-load currents.

- I. Load-Current and List of Settings of Adjustable Overload Relays: Compile after motors have been installed and arrange to demonstrate that dip switch settings for motor running overload protection suit actual motor to be protected.

1.05 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Maintain, within 100 miles of Project site, a service center capable of providing training, parts, and emergency maintenance and repairs.
- B. Testing Agency Qualifications: An independent testing agency, acceptable to authorities having jurisdiction, with the experience and capability to conduct the testing indicated, as documented according to ASTM E 548.
- C. Source Limitations: Obtain VFCs of a single type through one source from a single manufacturer.
- D. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.
- E. Comply with NFPA 70.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. Store VFCs indoors in clean, dry space with uniform temperature to prevent condensation. Protect VFCs from exposure to dirt, fumes, water, corrosive substances, and physical damage.

1.07 COORDINATION

- A. Coordinate layout and installation of VFCs with other construction including conduit, piping, equipment, and adjacent surfaces. Maintain required workspace clearances and required clearances for equipment access doors and panels.
- B. Coordinate features of VFCs, installed units, and accessory devices with pilot devices and control circuits to which they connect.
- C. Coordinate features, accessories, and functions of each VFC and each installed unit with ratings and characteristics of supply circuit, motor, required control sequence, and duty cycle of motor and load.

1.08 EXTRA MATERIALS

- A. Furnish extra materials described below that match products installed and that are packaged with protective covering for storage and identified with labels describing contents:
 1. Spare Fuses: Furnish one spare for every five installed, but not less than one set of three of each type and rating
 2. Indicating Lights: Two of each type installed.

PART 2 - PRODUCTS

2.01 MANUFACTURERS

- A. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
- B. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 1. ABB Power Distribution, Inc.; ABB Control, Inc. Subsidiary.
 2. Yaskawa, Inc.
 3. Danfoss

2.02 VARIABLE FREQUENCY CONTROLLERS

- A. Unit and options shall be UL508 Listed as a complete assembly.
- B. Unit shall be listed for minimum 100 KA SCCR without the need for external input fuses.
- C. Microprocessor based Bypass Controller - Manual or automatic (selectable) transfer to line power via contactors. A keypad to control the bypass controller is to be mounted on the

enclosure door. The bypass keypad shall include a one line diagram and status LEDs to indicate the mode of operation and "External Fault" conditions. When in the "Normal" mode, the bypass contactor is open and the drive output contactor is closed. In the "Test" position, both contactors are open, in the "Bypass" position, the drive output contactor is open, and the bypass contactor is closed. Start/stop via customer supplied maintained contact shall be 24V or 115V compatible and shall function in both the "Normal" and "Bypass" modes. The voltage tolerance of the bypass power supply shall be $\pm 35\%$ to eliminate the problem of contactor coil burnout. The design shall include single-phase protection in both the AFD and bypass modes.

- D. Customer Interlock Terminal Strip – provide a separate terminal strip for connection of freeze, fire, smoke contacts, and external start command. Include fireman's override and damper control circuit as standard. All external safety interlocks shall remain fully functional whether the system is in Hand, Auto, or Bypass modes.
- E. Automatic bypass operation shall be selectable in the standard microprocessor based bypass design.
- F. Door / cover interlocked circuit breaker disconnect switch which will disconnect all input power from the drive and all internally mounted options. The disconnect handle shall be through the door, and be padlockable in the "Off" position.
- G. Fast acting semi-conductor fuses exclusive to the AFD – fast acting semi-conductor fuses allow the AFD to disconnect from the line prior to clearing upstream branch circuit protection, maintaining bypass capability. Bypass designs which have no such fuses, or that incorporate fuses common to both the AFD and the bypass will not be accepted. In such designs, a fuse clearing failure would render the bypass unusable.
- H. Class 10 or 20 (selectable) electronic motor overload protection shall be included in the microprocessor bypass to protect the motor in bypass mode.
- I. 3% DC line reactor
- J. Input AC Line Reactor
- K. The following operating information displays shall be standard on the AFD digital display. All applicable operating values shall be capable of being displayed in engineering (user) units. A minimum of two operating values from the list below shall be capable of being displayed at all times. The display shall be in complete English words (alpha-numeric codes are not acceptable):
 - 1. Output Frequency
 - 2. Motor Speed (RPM, %, or Engineering units)
 - 3. Motor Current
 - 4. Calculated Motor Torque
 - 5. Calculated Motor Power (kW)
 - 6. DC Bus Voltage
 - 7. Output Voltage
 - 8. Heatsink Temperature (0F)
 - 9. Analog Input Values
 - 10. Analog Output Value
 - 11. Keypad Reference Values
 - 12. Elapsed Time Meter (resettable)
 - 13. kWh meter (resettable)
 - 14. mWh meter
 - 15. Digital input status
 - 16. Digital output status
- L. Communications: Provide an ethernet interface allowing VFC to be used with an external system within a multidrop LAN configuration. Interface shall allow all parameter settings of VFC to be programmed via a BACNet IP BMS. Provide capability for VFC to retain these settings within the nonvolatile memory.

2.03 ENCLOSURES

- A. Enclosure: NEMA 250 Type I, with hinged full front access.

2.04 FACTORY FINISHES

- A. Finish: Manufacturer's standard paint applied to factory-assembled and -tested VFCs before shipping.

PART 3 - EXECUTION

3.01 EXAMINATION

- A. Examine areas, surfaces, and substrates to receive VFCs for compliance with requirements, installation tolerances, and other conditions affecting performance.
- B. Examine roughing-in for conduit systems to verify actual locations of conduit connections before VFC installation.
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

3.02 INSTALLATION

- A. Anchor each VFC assembly to steel-channel sills arranged and sized according to manufacturer's written instructions. Attach by bolting. Level and grout sills flush with VFC mounting surface.
- B. Controller Fuses: Install fuses in each fusible switch. Comply with requirements in Division 26 Section "Fuses."

3.03 IDENTIFICATION

- A. Identify VFCs, components, and control wiring according to Division 15 Section "Mechanical identification."
- B. Operating Instructions: Frame printed operating instructions for VFCs, including control sequences and emergency procedures. Fabricate frame of finished metal, and cover instructions with clear acrylic plastic. Mount on front of VFC units.

3.04 FIELD QUALITY CONTROL

- A. Manufacturer's Field Service: Engage a factory-authorized service representative to inspect field-assembled components and equipment installation, including pretesting and adjusting VFCs.
- B. Test Reports: Prepare a written report to record the following:
 - 1. Test procedures used.
 - 2. Test results that comply with requirements.
 - 3. Test results that do not comply with requirements and corrective action taken to achieve compliance with requirements.

3.05 STARTUP SERVICE

- A. Engage a factory-authorized service representative to perform startup service.
- B. Complete installation and startup checks according to manufacturer's written instructions.

3.06 CLEANING

- A. Clean VFCs internally, on completion of installation, according to manufacturer's written instructions. Vacuum dirt and debris; do not use compressed air to assist in cleaning.

3.07 DEMONSTRATION

- A. Engage a factory-authorized service representative to train Owner's maintenance personnel to adjust, operate, and maintain VFCs.

END OF SECTION

SECTION 23 11 23
FACILITY NATURAL-GAS PIPING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Pipe, pipe fittings, valves, and connections for natural gas piping systems.

1.02 REFERENCE STANDARDS

- A. ASME B16.3 - Malleable Iron Threaded Fittings: Classes 150 and 300; 2021.
- B. ASME B31.1 - Power Piping; 2024.
- C. ASTM A47/A47M - Standard Specification for Ferritic Malleable Iron Castings; 1999, with Editorial Revision (2022).
- D. ASTM A53/A53M - Standard Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless; 2024.
- E. ASTM A234/A234M - Standard Specification for Piping Fittings of Wrought Carbon Steel and Alloy Steel for Moderate and High Temperature Service; 2024.
- F. AWWA C606 - Grooved and Shouldered Joints; 2022.

1.03 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.

PART 2 PRODUCTS

2.01 NATURAL GAS PIPING, ABOVE GRADE

- A. Steel Pipe: ASTM A53/A53M, Grade B, Type F, Schedule 40 black.
 - 1. Fittings: ASME B16.3, malleable iron, or ASTM A234/A234M, wrought steel welding type.
 - 2. Joints: Threaded or welded to ASME B31.1.

2.02 FLANGES, UNIONS, AND COUPLINGS

- A. Unions for Pipe Sizes 3 Inches and Under:
 - 1. Ferrous Pipe: Class 150 malleable iron threaded unions.
- B. Flanges for Pipe Size Over 1 Inch:
 - 1. Ferrous Pipe: Class 150 malleable iron threaded or forged steel slip-on flanges; preformed neoprene gaskets.
- C. Mechanical Couplings for Grooved and Shouldered Joints: Two or more curved housing segments with continuous key to engage pipe groove, circular C-profile gasket, and bolts to secure and compress gasket.
 - 1. Dimensions and Testing: In accordance with AWWA C606.
 - 2. Housing Material: Provide ASTM A47/A47M malleable iron, ductile iron, or _____
 - 3. Bolts and Nuts: Hot dipped galvanized or zinc-electroplated steel.
 - 4. When pipe is field grooved, provide coupling manufacturer's grooving tools.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that excavations are to required grade, dry, and not over-excavated.

3.02 INSTALLATION

- A. Install in accordance with manufacturer's instructions.

END OF SECTION

THIS PAGE INTENTIONALLY LEFT BLANK

**SECTION 23 31 00
HVAC DUCTS AND CASINGS**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Metal ducts.
- B. Flexible ducts.
- C. Air plenums and casings

1.02 RELATED REQUIREMENTS

- A. Section 23 01 30.51 - HVAC Air-Distribution System Cleaning: Post install duct cleaning.
- B. Section 23 05 48 - Vibration and Seismic Controls for HVAC.
- C. Section 23 07 13 - Duct Insulation: External insulation and duct liner.
- D. Section 23 0593 - Testing, Adjusting, and Balancing for HVAC.

1.03 REFERENCE STANDARDS

- A. ASTM A653/A653M - Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process; 2023.
- B. NFPA 90A - Standard for the Installation of Air-Conditioning and Ventilating Systems; 2024.
- C. NFPA 90B - Standard for the Installation of Warm Air Heating and Air-Conditioning Systems; 2015.
- D. NFPA 96 - Standard for Ventilation Control and Fire Protection of Commercial Cooking Operations; 2024.
- E. SMACNA (DCS) - HVAC Duct Construction Standards Metal and Flexible; 2005.
- F. SMACNA (LEAK) - HVAC Air Duct Leakage Test Manual; 2012, 2nd Edition.
- G. UL 181 - Standard for Factory-Made Air Ducts and Air Connectors; current edition, including all revisions.

1.04 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements for submittal procedures.
- B. Product Data: Provide data for duct materials.
- C. Shop Drawings: Indicate duct fitting types, gauges, sizes, welds, and configuration.
- D. Test Reports: Indicate pressure tests performed. Include date, section tested, test pressure, and leakage rate per appropriate seal class, following SMACNA (LEAK).
- E. Project Record Documents: Record actual locations of ducts and duct fittings. Record changes in fitting location and type. Show additional fittings used.

1.05 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing the type of products specified in this section, with minimum three years of documented experience, and approved by manufacturer.

1.06 REGULATORY REQUIREMENTS

- A. Construct ductwork to NFPA 90A, NFPA 90B, and NFPA 96 standards.

1.07 FIELD CONDITIONS

- A. Do not install duct sealants when temperatures are less than those recommended by sealant manufacturers.
- B. Maintain temperatures within acceptable range during and after installation of duct sealants.

PART 2 PRODUCTS

2.01 GENERAL REQUIREMENTS

- A. Provide UL Class 1 ductwork, fittings, hangers, supports, and appurtenances in accordance with NFPA 90A and SMACNA (DCS) guidelines unless stated otherwise.
- B. Provide metal duct unless otherwise indicated. Fibrous glass duct can be substituted at the Contractor's option.
- C. Acoustical Treatment: Provide sound-absorbing liners and sectional silencers for metal-based ducts in compliance with Section 23 33 19.
- D. Duct Shape and Material in accordance with Allowed Static Pressure Range:
 - 1. Rectangular: Plus or minus 1/2 in-wc of galvanized steel.
- E. Duct Sealing and Leakage in accordance with Static Pressure Class:
- F. Duct Fabrication Requirements:
 - 1. Duct and Fitting Fabrication and Support: SMACNA (DCS) including specifics for continuously welded round and oval duct fittings.
 - 2. Use reinforced and sealed sheet-metal materials at recommended gauges for indicated operating pressures or pressure class.
 - 3. Construct tee's, bends, and elbows with radius of not less than 1-1/2 times width of duct on centerline. Where not possible and where rectangular elbows must be used, provide air foil turning vanes of perforated metal with glass fiber insulation.
 - 4. Provide turning vanes of perforated metal with glass fiber insulation when acoustical lining is indicated.
 - 5. Increase duct sizes gradually, not exceeding 15 degrees divergence wherever possible; maximum 30 degrees divergence upstream of equipment and 45 degrees convergence downstream.
 - 6. Provide turning vanes of perforated metal with glass fiber insulation when an acoustical lining is required.
 - 7. Where ducts are connected to exterior wall louvers and duct outlet is smaller than louver frame, provide blank-out panels sealing louver area around duct. Use same material as duct, painted black on exterior side; seal to louver frame and duct.
- G. All Ducts: Galvanized steel, or Manufactured Non-Metallic Ductwork.
- H. Grease Exhaust: 1 inch w.g. pressure class, un-galvanized steel.

2.02 MATERIALS

- A. Joint Sealers and Sealants: Non-hardening, water resistant, mildew and mold resistant.

2.03 METAL DUCTS

- A. Material Requirements:
 - 1. Galvanized Steel: Hot-dipped galvanized steel sheet, ASTM A653/A653M FS Type B, with G60/Z180 coating.
- B. Rectangular Metal Duct:
 - 1. Rectangular Double Wall Insulated: Rectangular spiral lock seam duct with galvanized steel outer wall, perforated galvanized steel inner wall; fitting with the solid inner wall.
 - a. Insulation:
 - 1) Thickness: 1 inch.
 - 2) Material: Air.
- C. Round Metal Ducts:
 - 1. Round Connection System: Interlocking duct connection system in accordance with SMACNA (DCS).

2.04 FLEXIBLE DUCTS

- A. Flexible Air Ducts:

1. UL 181, Class 1, multiple layers of aluminum laminate supported by helically wound spring steel wire.
2. Pressure Rating: From 10 in-wc positive to 1 in-wc negative.
3. Maximum Velocity: 4,000 fpm.
4. Temperature Range: Minus 20 to 210 degrees F.

2.05 AIR PLENUMS AND CASINGS

- A. Fabricate in accordance with SMACNA (DCS) for indicated operating pressures indicated.
- B. Minimum Fabrication Requirements:
 1. Fabricate acoustic plenum or casing with reinforcing turned inward.
 2. Provide 16 gauge, 0.059 inch sheet steel back facing and 22 gauge, 0.029 inch perforated sheet steel front facing with 3/32 inch diameter holes on 5/32 inch centers.
 3. Construct panels 3 inches thick packed with 4.5 pcf minimum glass fiber insulation media, on inverted channels of 16 gauge, 0.059 inch sheet steel.
 4. Mount floor mounted plenum or casings on 4 inch high concrete curbs. At floor, rivet panels on 8 inch centers to angles. Where floors are acoustically insulated, provide liner of galvanized 18 gauge, 0.052 inch expanded metal mesh supported at 12 inch centers, turned up 12 inches at sides with sheet metal shields.
- C. Access Doors:
 1. Install hinged access doors where indicated or required for access to equipment for cleaning and inspection.
 2. Reinforce door frames with steel angles tied to horizontal and vertical plenum supporting angles.
 3. Provide clear wire glass observation ports, minimum 6 by 6 inch size.

PART 3 EXECUTION

3.01 INSTALLATION

- A. Install, support, and seal ducts in accordance with SMACNA (DCS).
- B. Install products following the manufacturer's instructions.
- C. During construction, provide temporary closures of metal or taped polyethylene on open ductwork to prevent construction dust from entering the ductwork system.
- D. Duct sizes indicated are inside precise dimensions. For lined ducts, maintain sizes inside lining.
- E. Provide openings in ductwork as indicated to accommodate thermometers and controllers. Provide pilot tube openings as indicated for testing of systems, complete with metal can with spring device or screw to insure against air leakage. For openings, insulate ductwork and install insulation material inside a metal ring.
- F. Locate ducts with sufficient space around equipment to allow normal operating and maintenance activities.
- G. Use crimp joints with or without bead for joining round duct sizes 8 inch and smaller with a crimp in the direction of airflow.
- H. Use double nuts and lock washers on threaded rod supports.
- I. Connect terminal units to supply ducts directly or with one foot maximum length of flexible duct. Do not use a flexible duct to change direction.
- J. At exterior wall louvers, seal duct to louver frame and install blank-out panels.

3.02 CLEANING

- A. Clean thoroughly each duct system as indicated within Section 23 01 30.51.
- B. Clean the duct system and force air at high velocity through the duct to remove accumulated dust. Clean half the system at a time to obtain sufficient air. Protect equipment that could be harmed by excessive dirt with temporary filters or bypass during cleaning.

3.03 PRESSURE TESTING

- A. Prior to the balancing of the duct system by the AABC certified balancing contractor all ductwork shall be tested by the mechanical contractor for duct leakage in accordance with SMACNA Standards and AABC Standards Chapter 23. Duct leakage shall not exceed 1% for a duration of (10) ten minutes. Test pressures shall be as per SMACNA, however, not less than the following:
 - 1. Low Pressure Duct:
 - a. 25% above system operating pressure, but not less than 2" w.c. (500 Pa).
 - 2. High Pressure Supply Duct:
 - a. 25% above system operating pressure, but not less than 6" w.c. (1500 Pa).
 - 3. High Pressure Exhaust Duct:
 - a. 25% above system operating pressure, but not less than 8" w.c. (2000 Pa).
- B. Insulation materials shall not be applied until systems have been witnessed to meet the above testing requirements.
- C. The testing and balancing contractor shall witness and certify all duct pressure tests.
- D. Additional leak testing requirements:
 - 1. Disassemble, reassemble, and seal segments of duct systems to accommodate leakage testing and for compliance with test requirements.
 - 2. If static pressure classes are not indicated, test system at maximum system design pressure. Do not pressurize systems above maximum design operating pressure.
 - 3. Provide seven (7) days advance notice for testing.

3.04 SCHEDULES

- A. Ductwork Pressure Class:
 - 1. Supply (Heating Systems): 2 inch (500 Pa)
 - 2. Supply (System with Cooling Coils): 2 inch.
 - 3. Return Ductwork: 1 inch.
 - 4. General Exhaust: 1 inch.
 - 5. Outside Air Intake: 1 inch.
 - 6. Combustion Air: 1 inch (250 Pa)

END OF SECTION

SECTION 23 34 23
HVAC POWER VENTILATORS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Laboratory-fume exhaust fans.

1.02 RELATED REQUIREMENTS

- A. Section 23 05 13 - Common Motor Requirements for HVAC Equipment.
- B. Section 23 31 00 - HVAC Ducts and Casings.
- C. Section 26 05 83 - Wiring Connections: Electrical characteristics and wiring connections.

1.03 REFERENCE STANDARDS

- A. AMCA (DIR) - (Directory of) Products Licensed Under AMCA International Certified Ratings Program; 2015.
- B. AMCA 99 - Standards Handbook; 2025.
- C. AMCA 210 - Laboratory Methods of Testing Fans for Certified Aerodynamic Performance Rating; 2025.
- D. AMCA 211 - Certified Ratings Program Product Rating Manual for Fan Air Performance; 2022, with Editorial Revision (2023).
- E. AMCA 260 - Laboratory Methods of Testing Induced Flow Fans for Rating; 2020.
- F. AMCA 300 - Reverberation Room Methods of Sound Testing of Fans; 2024.
- G. AMCA 311 - Certified Ratings Program Product Rating Manual for Fan Sound Performance; 2016.
- H. ANSI Z9.5 - Laboratory Ventilation; 2022.
- I. NEMA EN 10250 - Enclosures for Electrical Equipment (1000 Volts Maximum); 2024.
- J. UL 705 - Power Ventilators; Current Edition, Including All Revisions.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Sequencing: Ensure that utility connections are completed in an orderly and expeditious manner.

1.05 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements for submittal procedures.
- B. Product Data: Provide data on fans and accessories, including fan curves with specified operating point plotted, power, rpm, sound power levels at rated capacity, and electrical characteristics and connection requirements.
- C. Manufacturer's Instructions: Indicate installation instructions.
- D. Maintenance Data: Include instructions for lubrication, motor and drive replacement, spare parts list, and wiring diagrams.
- E. Maintenance Materials: Furnish the following for State of Delaware OMB - Division of Facilities Management's use in maintenance of project.
 - 1. See Section 01 60 00 - Product Requirements, for additional provisions.
 - 2. Extra Fan Belts: One set for each individual fan.

1.06 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing the type of products specified in this section, with minimum three years of documented experience.

1.07 FIELD CONDITIONS

- A. Permanent ventilators may be used for ventilation during construction only after ductwork is clean, filters are in place, bearings have been lubricated, and fan has been test run under observation.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Basis of Design; Greenheck: www.greenheck.com; See drawing schedule.
- B. Loren Cook Company: www.lorencook.com/#sle.
- C. PennBarry: www.pennbarry.com/#sle.
- D. Substitutions: See Section 01 60 00 - Product Requirements.

2.02 LABORATORY FUME-EXHAUST FANS

- A. General Requirements:
 - 1. Fan Type: Base-mounted, constant stack-velocity discharge laboratory exhaust.
 - 2. Minimum air discharge velocity of 3,000 fpm in compliance with ANSI Z9.5.
 - 3. Provide fan-assembly manufactured to sustain structural integrity without external guy-wires or supplemental supports at wind speeds up to 125 mph.
 - 4. Fan performance tested in accordance with AMCA 210, AMCA 260, and AMCA 300.
 - 5. Fan performance ratings certified in accordance with AMCA 211 and AMCA 311.
 - 6. Explosion Resistant Construction: Provide fan classified as Spark B with motor and drive-assembly outside of contaminated airstream in compliance with AMCA 99.
- B. Application:
 - 1. Dedicated Fume Hood Exhaust:
 - a. Fan Type: Belt-driven, single-speed motor with epoxy-based protective coating.
 - b. Exhaust Capacity: Select fan to handle full exhaust airflow rate, system static pressure loss with 15 percent load-capacity factor, and minimum discharge plume height of 10 feet above roof level.
- C. Fan Section Requirements:
 - 1. Impeller:
 - a. Non-overloading, backward-inclined centrifugal.
 - b. Material: Aluminum.
 - 2. Fan Shaft:
 - a. Ground and polished steel with anticorrosive coating.
 - b. First critical speed at least 25 percent over maximum cataloged operating speed.
 - c. Enclosed over OSHA recommended safety-yellow painted guards.
 - 3. Bearings:
 - a. 100 percent factory tested surface-mounted bearings outside of the airstream.
 - b. Operate during a minimum L10 service life in excess of 100,000 hours at maximum cataloged operating speed.
 - 4. Belt-drive Assembly:
 - a. Belts, pulleys, and keys oversized for a minimum of 150 percent of driven horsepower.
 - b. Belts: Static-free and oil resistant.
 - c. Fully machined cast iron type, keyed and securely attached to the wheel and motor shafts.
 - d. Motor pulley adjustable for final system balancing, readily accessible for maintenance.
 - 5. Housing:
 - a. Construct of heavy gauge aluminum with standard factory finish.
 - b. Mounting Base:
 - c. Construct drive frame assembly of heavy gauge steel, mounted on vibration isolators.

- d. Provide breather tube for fresh air motor cooling and wiring.
- e. Minimum Assembly Height: 120 inches above the roof surface.
- 6. Isolation Damper:
 - a. With parallel blade damper, constructed of matching materials and finish.
 - b. Provided by manufacturer, bolted to access drawer or panel for easy removal from contaminated airstream.
 - c. With two-position damper actuator:
 - 1) Provided by manufacturer.
 - 2) Operate interlocked with fan starter.
 - 3) With integral auxiliary switches to monitor blade position status.
 - 4) Rated for NEMA EN 10250, Type 4 (IP66) environment within protective weather-housing out of contaminated airstream, connected through linkages.
- 7. Fan Discharge Outlet-Nozzle:
- 8. Fan Inlet Flow Sensor: Provide factory-mounted pitot tube-based differential pressure sensor probe ready for connection into differential pressure-based flow transmitter.
 - a. Transmitter Housing: Provide NEMA EN 10250, Type 4 enclosure.
- D. Roof Curbs:
 - 1. 12 inch high flanged, self-flashing of matching material and finish with continuously welded seams.
 - 2. Provide integral formed steel support framework with curb cap guides.

PART 3 EXECUTION

3.01 INSTALLATION

- A. Install in accordance with manufacturer's instructions.
- B. Provide sheaves required for final air balance.
- C. Install backdraft dampers on inlet to roof and wall exhausters.

END OF SECTION

THIS PAGE INTENTIONALLY LEFT BLANK

**SECTION 23 36 00
AIR TERMINAL UNITS**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Variable volume terminal units.

1.02 RELATED REQUIREMENTS

- A. Section 23 05 48 - Vibration and Seismic Controls for HVAC.
- B. Section 23 21 13 - Hydronic Piping: Connections to heating coils.
- C. Section 23 21 14 - Hydronic Specialties: Connections to heating coils.
- D. Section 23 31 00 - HVAC Ducts and Casings.
- E. Section 23 33 00 - Air Duct Accessories.
- F. Section 23 82 00 - Convection Heating and Cooling Units: Air coils.

1.03 REFERENCE STANDARDS

- A. ASTM A492 - Standard Specification for Stainless Steel Rope Wire; 1995 (Reapproved 2013).
- B. ASTM A603 - Standard Specification for Zinc-Coated Steel Structural Wire Rope; 1998 (Reapproved 2014).
- C. NFPA 90A - Standard for the Installation of Air-Conditioning and Ventilating Systems; 2024.
- D. SMACNA (SRM) - Seismic Restraint Manual Guidelines for Mechanical Systems; Sheet Metal and Air Conditioning Contractors' National Association; 2008.
- E. UL 181 - Standard for Factory-Made Air Ducts and Air Connectors; current edition, including all revisions.

1.04 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements for submittal procedures.
- B. Product Data: Provide data indicating configuration, general assembly, and materials used in fabrication. Include catalog performance ratings that indicate airflow, static pressure, and NC designation. Include electrical characteristics and connection requirements.
- C. Shop Drawings: Indicate configuration, general assembly, and materials used in fabrication, and electrical characteristics and connection requirements.
 - 1. Include schedules listing discharge and radiated sound power level for each of the second through sixth-octave bands at inlet static pressures of 1 to 4 in-wc.
- D. Manufacturer's Installation Instructions: Indicate support and hanging details, installation instructions, recommendations, and service clearances required.
- E. Project Record Documents: Record actual locations of units and locations of access doors required for access of valving.
- F. Operation and Maintenance Data: Include manufacturer's descriptive literature, operating instructions, maintenance and repair data, and parts lists. Include directions for resetting constant-volume regulators.
- G. Warranty: Submit manufacturer warranty and ensure forms have been completed in State of Delaware OMB - Division of Facilities Management's name and registered with manufacturer.

1.05 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing the type of products specified in this section, with minimum three years of documented experience.
- B. Products Requiring Electrical Connection: Listed and classified by Underwriters Laboratories Inc. as suitable for the purpose specified and indicated.

1.06 WARRANTY

- A. See Section 01 78 00 - Closeout Submittals for additional warranty requirements.
- B. Provide five year manufacturer warranty for air terminal units.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Basis of Design; Metalaire: <https://www.metalair.com/>; See drawing schedule.
- B. Price: <https://www.priceindustries.com/>.
- C. Daikin Applied: www.daikinapplied.com.
- D. Substitutions: See Section 01 60 00 - Product Requirements.

2.02 SINGLE DUCT VARIABLE VOLUME UNITS

- A. Basic Assembly:
 - 1. Casings: Minimum 22 gage, 0.0299 inch galvanized steel.
 - 2. Lining: Minimum 3/4 inch thick neoprene or vinyl coated fibrous glass insulation, 1.5 lb/cu ft density, meeting NFPA 90A requirements and UL 181 erosion requirements. Face lining with mylar film.
 - 3. Plenum Air Inlets: Round stub connections for duct attachment.
 - 4. Plenum Air Outlets: S slip and drive connections.
- B. Basic Unit:
 - 1. Configuration: Air volume damper assembly inside unit casing. Locate control components inside protective metal shroud.
 - 2. Volume Damper: Construct of galvanized steel with peripheral gasket and self lubricating bearings; maximum damper leakage: 2 percent of design air flow at 1 inches rated inlet static pressure.
 - 3. Mount damper operator to position damper normally open.
- C. Round Outlet: Discharge collar matching inlet size.
- D. Hot Water Heating Coil:
 - 1. Construction: 1/2 inch copper tube mechanically expanded into aluminum plate fins, leak tested under water to 200 psig pressure, factory installed.
 - 2. See drawing schedule for capacity
 - 3. Provide 2-row heating coils.
- E. Automatic Damper Operator:
 - 1. Electric Actuator: 24 volt with high limit.

PART 3 EXECUTION

3.01 INSTALLATION

- A. Install in accordance with manufacturer's instructions.
- B. Install the inlets of air terminal units and air flow sensors a minimum of four duct diameters from elbows, transitions, and duct takeoffs.
- C. Provide ceiling access doors or locate units above easily removable ceiling components.
- D. Support units individually from structure with wire rope complying with ASTM A492 and ASTM A603 in accordance with SMACNA (SRM). See Section 23 0548.
- E. Do not support from ductwork.
- F. Connect to ductwork in accordance with Section 23 31 00.
- G. Install heating coils in accordance with Section 23 82 00.

3.02 ADJUSTING

- A. Reset volume with damper operator attached to assembly allowing flow range modulation from 100 percent of design flow to minimum flow identified on drawings.

END OF SECTION

THIS PAGE INTENTIONALLY LEFT BLANK

SECTION 23 74 13
PACKAGED OUTDOOR CENTRAL-STATION AIR-HANDLING UNITS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Packaged roof top unit.
- B. Unit controls.

1.02 RELATED REQUIREMENTS

- A. Section 23 40 00 - HVAC Air Cleaning Devices.
- B. Section 26 05 83 - Wiring Connections: Electrical characteristics and wiring connections.

1.03 REFERENCE STANDARDS

- A. AHRI 270 (SI/I-P) - Sound Performance Rating of Outdoor Unitary Equipment; 2025.
- B. ASHRAE Std 135 - BACnet - A Data Communication Protocol for Building Automation and Control Networks; 2024, with Errata (2025).
- C. IEEE 802.11 - IEEE Standard for Information Technology--Telecommunications and Information Exchange between Systems Local and Metropolitan Area Networks--Specific Requirements Part 11: Wireless LAN Medium Access Control (MAC) and Physical Layer (PHY) Specifications; 2024, with Amendment (2025).
- D. NFPA 90A - Standard for the Installation of Air-Conditioning and Ventilating Systems; 2024.

1.04 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements for submittal procedures.
- B. Product Data: Provide capacity and dimensions of manufactured products and assemblies required for this project. Indicate electrical service with electrical characteristics and connection requirements, and duct connections.
- C. Shop Drawings: Indicate capacity and dimensions of manufactured products and assemblies required for this project. Indicate electrical service with electrical characteristics and connection requirements, and duct connections.
- D. Controls Documentation: This equipment is to be integrated into an existing BAS. All of the BACnet points available shall be provided with the unit submittal. These points shall be defined as read/write or read only points. This documentation will also be provided to the Controls subcontractor for integration purposes.
- E. Operation and Maintenance Data: Include manufacturer's descriptive literature, operating instructions, installation instructions, maintenance and repair data, and parts listing.
- F. Warranty: Submit manufacturer's warranty and ensure forms have been filled out in State of Delaware OMB - Division of Facilities Management's name and registered with manufacturer.

1.05 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing the type of products specified in this section, with minimum three years of documented experience.
- B. Products Requiring Electrical Connection: Listed and classified by Underwriters Laboratories Inc. as suitable for the purpose specified and indicated.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. Protect units from physical damage by storing off site until roof mounting curbs are in place, ready for immediate installation of units.

1.07 WARRANTY

- A. See Section 01 78 00 - Closeout Submittals for additional warranty requirements.
- B. Provide a five year warranty to include coverage for refrigeration compressors.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Basis of Design : Valent: www.valentair.com
- B. Daikin Applied: www.daikinapplied.com
- C. Engineered Air: www.engineeredair.com
- D. Substitutions: See Section 01 60 00 - Product Requirements.

2.02 MANUFACTURED UNITS

- A. General: Roof mounted units having gas burner and electric refrigeration. This particular unit shall be mounted at grade on a custom curb and shall be fitted with a short cycle air flow damper.
- B. Description: Self-contained, packaged, factory assembled and prewired, consisting of cabinet and frame, supply fan, heat exchanger and burner, hot gas re-heat coil, controls, air filters, refrigerant cooling coil and compressor, condenser coil and condenser fan.
- C. Refrigerant: Use only refrigerants that have ozone depletion potential (ODP) of zero and global warming potential (GWP) no greater than that allowed by federal code.
- D. Disconnect Switch: Factory mount disconnect switch in control panel.

2.03 FABRICATION

- A. Cabinet: Steel with baked enamel finish, including access doors with piano hinges and locking handle. Structural members shall be minimum 18 gage, 0.0478 inch, with access doors or panels of minimum 20 gage, 0.0359 inch.
- B. Insulation: 1 inch thick neoprene coated glass fiber with edges protected from erosion.
- C. Heat Exchangers: Stainless steel, of welded construction.
- D. Supply Fan: Forward curved centrifugal type, resiliently mounted with V-belt drive, adjustable variable pitch motor pulley, and rubber isolated hinge mounted high efficiency motor. Isolate complete fan assembly. Refer to Section 22 05 48.
- E. Air Filters:
 - 1. 2 inch thick glass fiber disposable media in metal frames.
- F. Roof Mounting Curb: 14 inches high galvanized steel, channel frame with gaskets, nailer strips.

2.04 COOLING SYSTEM

- A. Refrigerant type: R-454B.
- B. Capable of operating from 0 - 150 degrees F (-18 - 66 degrees C) without installation of additional controls.
- C. Compressors:
 - 1. Two stage Scroll compressor on 3 thru 5 ton units for increased part load efficiency. Single stage scroll compressors on all other models.
 - 2. Resiliently mounted on rubber mounts for vibration isolation.
 - 3. Overload Protected
 - 4. Internal excessive current and temperature protection
 - 5. Isolated from condenser and evaporator fan air streams
 - 6. Refrigerant cooled
- D. TXV with removable element head on each circuit
- E. High pressure switch on each circuit
- F. Freezestat on each circuit
- G. High capacity filter driers on each circuit

- H. Crankcase heater on each compressor
- I. Low pressure switch on each circuit

2.05 COIL CONSTRUCTION

- A. Condensing/evaporator coil general construction:
 - 1. Aluminum Rippled and Lanced fins.
 - 2. Copper tube construction.
 - 3. Aluminum fins mechanically bonded to copper tubes.
 - 4. All coils are high pressure leak tested at manufacturing facility.
- B. Evaporator Coils:
 - 1. With balanced port thermal expansion valves, freeze protection on each compressor circuit, pressure and leak tested to 500 psi.
 - 2. Evaporator coil shall be of the split face type with each compressor circuit on coil divided across face of coil and active through full depth of coil.
- C. Condenser Coils:
 - 1. Units to utilize formed condenser coils.

2.06 BURNER

- A. Gas Burner: Induced draft type burner with adjustable combustion air supply, pressure regulator, gas valves, manual shut-off, intermittent spark or glow coil ignition, flame sensing device, and automatic 100 percent shut-off pilot.
- B. Gas Burner Safety Controls: Energize ignition, limit time for establishment of flame, prevent opening of gas valve until pilot flame is proven, stop gas flow on ignition failure, energize blower motor, and after airflow proven and slight delay, allow gas valve to open.
- C. High Limit Control: Temperature sensor with fixed stop at maximum permissible setting, de-energize burner on excessive bonnet temperature and energize burner when temperature drops to lower safe value.
- D. Field Installed Accessories:
 - 1. Provide Combustion Air Intake Extensions

2.07 OPERATING CONTROLS

- A. Temperature transmitter located in supply air shall signal electronic logic panel to control mixing dampers and cooling in sequence. Mixing section shall operate as first stage of cooling and revert to minimum outside air above approximately 75 degrees F as determined by enthalpy of return and outdoor air.
- B. Control cooling by cycling compressors, cylinder unloading, and hot gas bypass.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that roof is ready to receive work and opening dimensions are as indicated on shop drawings.
- B. Verify that proper power supply is available.

3.02 INSTALLATION

- A. Install in accordance with manufacturer's instructions.
- B. Mount units on factory built roof mounting curb providing watertight enclosure to protect ductwork and utility services. Install roof mounting curb level.

3.03 SYSTEM STARTUP

- A. A certified manufacturer's representative shall prepare and start equipment. This representative shall verify the controls points with the controls subcontractor, that the unit is operating on the proper manufacturer's sequence of operation, and make any adjustments for proper operation.

- B. The certified manufacturer's representative shall fill out a start-up check list and submit the completed list to the Architect / Engineer for review.

3.04 CLOSEOUT ACTIVITIES

- A. Demonstrate operation to State of Delaware OMB - Division of Facilities Management's maintenance personnel.
- B. Prior to Demonstration this equipment shall be tested for a period of 1 week minimum. At the end of the test period the certified manufacturer's representative shall return to the job site and examine the unit's performance. This visit shall be coordinated with the design engineer and owner representative. Both the design engineer and owner must witness this performance test as part of the closeout activities.
- C. Change of season adjustments: The owners representative shall be responsible to make unit adjustments 6 months after Demonstration has been performed. These adjustments shall be witnessed by the owner's representative and another start-up checklist shall be filled out and sent to the engineer.

END OF SECTION

SECTION 26 05 05
SELECTIVE DEMOLITION FOR ELECTRICAL

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Electrical demolition.

1.02 RELATED REQUIREMENTS

- A. Section 01 70 00 - Execution and Closeout Requirements: Additional requirements for alterations work.
- B. Section 01 74 19 - Construction Waste Management and Disposal: Handling and disposal of construction waste, including requirements for Universal Waste Diversion.
- C. Section 07 84 00 - Firestopping.
- D. Section 26 05 53 - Identification for Electrical Systems.

PART 2 PRODUCTS

2.01 MATERIALS AND EQUIPMENT

- A. Materials and equipment for patching and extending work: As specified in individual sections.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify field measurements and circuiting arrangements are as indicated.
- B. Verify that abandoned wiring and equipment serve only abandoned facilities.
- C. Demolition drawings are based on casual field observation and existing record documents. Contractor shall be responsible for field-verification of existing conditions prior to beginning work.
- D. Report discrepancies to State of Delaware OMB - Division of Facilities Management before disturbing existing installation.
- E. Beginning of demolition means installer accepts existing conditions.

3.02 PREPARATION

- A. Prior to performing work on electrical circuits, Contractor shall positively identify power sources, turn circuit breakers or switches to "off" and lock out and/or tag out circuits as required.
- B. Contractor shall coordinate all electrical demolition work with State of Delaware OMB - Division of Facilities Management as well as all other trades involved in Project.
- C. Contractor shall keep work area clean and orderly.
- D. All electrical demolition work shall be performed in a safe and orderly manner and in accordance with all State of Delaware OMB - Division of Facilities Management regulations, local codes, OSHA, International Building Code and National Electrical Code; all being most recent editions adopted by Authoriti(es) Having Jurisdiction, including all applicable amendments and supplements.
- E. All electrical demolition work shall be scheduled and coordinated with State of Delaware OMB - Division of Facilities Management such that disruption of areas involved is kept to minimum.
- F. All power shutdowns affecting areas not within scope of Project shall be coordinated with State of Delaware OMB - Division of Facilities Management. Accidental interruptions to services shall be repaired immediately by Contractor at no additional cost to State of Delaware OMB - Division of Facilities Management.
- G. Disconnect electrical systems in walls, floors, and ceilings to be removed.
- H. Coordinate utility service outages with utility company.

- I. Provide temporary wiring and connections to maintain existing systems in service during construction. When work must be performed on energized equipment or circuits, use personnel experienced in such operations.
- J. Existing Fire Alarm System: Maintain existing system in service until new system is accepted. Disable system only to make switchovers and connections. Minimize outage duration.
 - 1. Notify State of Delaware OMB - Division of Facilities Management before partially or completely disabling system.
 - 2. Notify local fire service.
 - 3. Make notifications at least 24 hours in advance.
 - 4. Make temporary connections to maintain service in areas adjacent to work area.

3.03 DEMOLITION AND EXTENSION OF EXISTING ELECTRICAL WORK

- A. Perform work for removal and disposal of equipment and materials containing toxic substances regulated under the Federal Toxic Substances Control Act (TSCA) in accordance with applicable federal, state, and local regulations. Applicable equipment and materials include, but are not limited to:
 - 1. PCB-containing electrical equipment, including transformers, capacitors, and switches.
 - 2. PCB- and DEHP-containing lighting ballasts.
 - 3. Mercury-containing lamps and tubes, including fluorescent lamps, high intensity discharge (HID), arc lamps, ultra-violet, high pressure sodium, mercury vapor, ignitron tubes, neon, and incandescent.
- B. Unless otherwise noted, all electrical items indicated for demolition shall be removed including all associated wiring, controls and accessible conduit and boxes traced back to source. Where removal causes power interruption of electrical items to remain, rewire existing circuits as required to maintain continuity.
- C. Conduit and boxes becoming inactive that are inaccessible shall be abandoned in place with open ends filled with firestopping expandable foam in accordance with Section 07 84 00.
- D. Openings in conduit and boxes remaining active shall be capped with appropriate fittings.
- E. Unless otherwise noted, circuit breakers becoming inactive shall have operating mechanisms placed in "off" (de-energized) position and be labeled as "SPARE" in accordance with Section 26 05 53.
- F. Contractor shall update panel schedules for all panelboards affected by Project in accordance with Section 26 05 53.
- G. Remove, relocate, and extend existing installations to accommodate new construction.
- H. All circuits abandoned or not used shall be located, identified, disconnected and removed back to source.
- I. Remove abandoned wiring to source of supply.
- J. Remove exposed abandoned conduit, including abandoned conduit above accessible ceiling finishes. Cut conduit flush with walls and floors, fill open ends with firestopping expandable foam in accordance with Section 07 84 00 and patch surfaces.
- K. Remove existing abandoned wiring and conduit designated as obsolete by State of Delaware OMB - Division of Facilities Management authorities.
- L. Disconnect abandoned outlets and remove devices. Remove abandoned outlets if conduit servicing them is abandoned and removed. Provide blank cover for abandoned outlets that are not removed.
- M. Disconnect and remove abandoned panelboards and distribution equipment.
- N. Disconnect and remove electrical devices and equipment serving utilization equipment that has been removed.
- O. Disconnect and remove abandoned luminaires. Remove brackets, stems, hangers, and other accessories.

- P. Remove abandoned support channel associated with demolished electrical equipment.
- Q. Existing branch circuits or circuits of other systems passing through Project area that interferes with new construction shall be relocated as required. All relocation of existing circuits shall be coordinated with State of Delaware OMB - Division of Facilities Management and with all other affected trades before proceeding with new construction.
- R. Contractor shall be responsible for temporary removal and re-installation of existing ceiling tiles and/or other ceiling access equipment as required to accommodate electrical demolition and/or extension work. Contractor shall be responsible for repair and/or replacement of all ceiling tiles and/or access equipment damaged as result of work. Contractor shall inspect existing conditions prior to commencement of work and provide written report of existing damage to State of Delaware OMB - Division of Facilities Management.
- S. Contractor shall be responsible for repair, patching and painting of all holes, dents, cracks, penetrations, etc. or other damage left in surfaces and/or structures after electrical demolition and/or extension work. Surfaces and/or structures to be restored shall include ceilings, walls, floors, columns, roofs, etc. Patching and painting shall restore surfaces and/or structures to original designs and/or finishes, including all fire-resistant and watertight ratings. All openings to building exteriors and through roofs shall be sealed watertight.
- T. Repair adjacent construction and finishes damaged during demolition and extension work.
- U. Damage caused by Contractor to areas outside area of demolition shall be repaired to original condition by Contractor at no additional cost to State of Delaware OMB - Division of Facilities Management.
- V. Maintain access to existing electrical installations that remain active. Modify installation or provide access panel as appropriate.
- W. Extend existing installations using materials and methods compatible with existing electrical installations, or as specified.
- X. All demolished materials not to be turned over to State of Delaware OMB - Division of Facilities Management shall be removed from site daily. Salvaged materials shall be stored for re-use.

3.04 CLEANING AND REPAIR

- A. See Section 01 74 19 - Construction Waste Management and Disposal for additional requirements.
- B. Clean and repair existing materials and equipment that remain or that are to be reused.

END OF SECTION

THIS PAGE INTENTIONALLY LEFT BLANK

SECTION 26 05 19
LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Wire and cable for 600 volts and less.
- B. Single conductor building wire.
- C. Metal-clad cable.
- D. Wiring connectors.
- E. Electrical tape.
- F. Heat shrink tubing.
- G. Oxide inhibiting compound.
- H. Wire pulling lubricant.
- I. Cable ties.
- J. Firestop sleeves.

1.02 RELATED REQUIREMENTS

- A. Section 07 84 00 - Firestopping.
- B. Section 26 05 05 - Selective Demolition for Electrical: Disconnection, removal, and/or extension of existing electrical conductors and cables.
- C. Section 26 05 26 - Grounding and Bonding for Electrical Systems: Additional requirements for grounding conductors and grounding connectors.
- D. Section 26 05 53 - Identification for Electrical Systems: Identification products and requirements.
- E. Section 28 46 00 - Fire Detection and Alarm: Fire alarm system conductors and cables.

1.03 REFERENCE STANDARDS

- A. ASTM B3 - Standard Specification for Soft or Annealed Copper Wire; 2013 (Reapproved 2018).
- B. ASTM B8 - Standard Specification for Concentric-Lay-Stranded Copper Conductors, Hard, Medium-Hard, or Soft; 2023.
- C. ASTM B33 - Standard Specification for Tin-Coated Soft or Annealed Copper Wire for Electrical Purposes; 2010, with Editorial Revision (2020).
- D. ASTM B787/B787M - Standard Specification for 19 Wire Combination Unilay-Stranded Copper Conductors for Subsequent Insulation; 2004 (Reapproved 2020).
- E. ASTM D3005 - Standard Specification for Low-Temperature Resistant Vinyl Chloride Plastic Pressure-Sensitive Electrical Insulating Tape; 2017.
- F. ASTM D4388 - Standard Specification for Nonmetallic Semi-Conducting and Electrically Insulating Rubber Tapes; 2020.
- G. NECA 1 - Standard for Good Workmanship in Electrical Construction; 2023.
- H. NECA 120 - Standard for Installing Armored Cable (AC) and Type Metal-Clad (MC) Cable; 2018.
- I. NEMA WC 70 - Power Cables Rated 2000 Volts or Less for the Distribution of Electrical Energy; 2021.
- J. NETA ATS - Standard for Acceptance Testing Specifications for Electrical Power Equipment And Systems; 2025.
- K. NFPA 70 - National Electrical Code; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.

- L. UL 44 - Thermoset-Insulated Wires and Cables; Current Edition, Including All Revisions.
- M. UL 83 - Thermoplastic-Insulated Wires and Cables; Current Edition, Including All Revisions.
- N. UL 267 - Outline of Investigation for Wire-Pulling Compounds; Current Edition, Including All Revisions.
- O. UL 486A-486B - Wire Connectors; Current Edition, Including All Revisions.
- P. UL 486C - Splicing Wire Connectors; Current Edition, Including All Revisions.
- Q. UL 486D - Sealed Wire Connector Systems; Current Edition, Including All Revisions.
- R. UL 510 - Polyvinyl Chloride, Polyethylene, and Rubber Insulating Tape; Current Edition, Including All Revisions.
- S. UL 1569 - Metal-Clad Cables; Current Edition, Including All Revisions.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Coordinate sizes of raceways, boxes, and equipment enclosures installed under other sections with the actual conductors to be installed, including adjustments for conductor sizes increased for voltage drop.
 - 2. Coordinate with electrical equipment installed under other sections to provide terminations suitable for use with the conductors to be installed.
 - 3. Notify DEDC, LLC of any conflicts with or deviations from Contract Documents. Obtain direction before proceeding with work.

1.05 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide manufacturer's standard catalog pages and data sheets for conductors and cables, including detailed information on materials, construction, ratings, listings, and available sizes, configurations, and stranding.
- C. Project Record Documents: Record actual installed circuiting arrangements. Record actual routing for underground circuits.
- D. Maintenance Materials: Furnish the following for State of Delaware OMB - Division of Facilities Management's use in maintenance of project.
 - 1. See Section 01 60 00 - Product Requirements, for additional provisions.

1.06 QUALITY ASSURANCE

- A. Comply with requirements of NFPA 70.
- B. Maintain at the project site a copy of each referenced document that prescribes execution requirements.
- C. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum three years documented experience.
- D. Product Listing Organization Qualifications: An organization recognized by OSHA as a Nationally Recognized Testing Laboratory (NRTL) and acceptable to authorities having jurisdiction.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. Receive, inspect, handle, and store conductors and cables in accordance with manufacturer's instructions.

1.08 FIELD CONDITIONS

- A. Do not install or otherwise handle thermoplastic-insulated conductors at temperatures lower than 14 degrees F, unless otherwise permitted by manufacturer's instructions. When installation below this temperature is unavoidable, notify DEDC, LLC and obtain direction before proceeding with work.

PART 2 PRODUCTS

2.01 CONDUCTOR AND CABLE APPLICATIONS

- A. Do not use conductors and cables for applications other than as permitted by NFPA 70 and product listing.
- B. Provide single conductor building wire installed in suitable raceway unless otherwise indicated, permitted, or required.
- C. Nonmetallic-sheathed cable is not permitted.
- D. Underground feeder and branch-circuit cable is not permitted.
- E. Service entrance cable is not permitted.
- F. Armored cable is not permitted.
- G. Metal-clad cable is permitted only as follows:
 - 1. Where not otherwise restricted, may be used:
 - a. Where concealed above accessible ceilings for final connections from junction boxes to luminaires.
 - 1) Maximum Length: 6 feet.
 - b. Where concealed in hollow stud walls and above accessible ceilings for branch circuits up to 20 A.
 - 2. In addition to other applicable restrictions, may not be used:
 - a. Unless approved by State of Delaware OMB - Division of Facilities Management.
 - b. Where not approved for use by the authority having jurisdiction.
 - c. Where exposed to view.
 - d. Where exposed to damage.
 - e. For damp, wet, or corrosive locations.
- H. Manufactured wiring systems are not permitted.
- I. Conductor & Cable Applications Summary:
 - 1. Concealed Dry Interior Locations: Use only building wire in raceway or metal clad cable (as permitted above).
 - 2. Exposed Dry Interior Locations: Use only building wire in raceway.
 - 3. Above Accessible Ceilings or in Hollow Stud Walls: Use only building wire in raceway or metal clad cable (as permitted above).
 - 4. Wet or Damp Interior Locations: Use only building wire in raceway.
 - 5. Exterior Locations: Use only building wire in raceway.

2.02 CONDUCTOR AND CABLE GENERAL REQUIREMENTS

- A. Provide products that comply with requirements of NFPA 70.
- B. Provide products listed, classified, and labeled as suitable for the purpose intended.
- C. Unless specifically indicated to be excluded, provide all required conduit, boxes, wiring, connectors, etc. as required for a complete operating system.
- D. Comply with NEMA WC 70.
- E. Thermoplastic-Insulated Conductors and Cables: Listed and labeled as complying with UL 83.
- F. Thermoset-Insulated Conductors and Cables: Listed and labeled as complying with UL 44.
- G. Conductors for Grounding and Bonding: Also comply with Section 26 05 26.
- H. Conductors and Cables Installed Exposed in Spaces Used for Environmental Air (only where specifically permitted): Plenum rated, listed and labeled as suitable for use in return air plenums.
- I. Provide products with insulation and temperature ratings as required per equipment installation instructions where such ratings differ from those indicated herein.
- J. Conductor Material:

1. Provide copper conductors only. Aluminum conductors are not acceptable for this project. Conductor sizes indicated are based on copper.
 2. Copper Conductors: Soft drawn annealed, 98 percent conductivity, uncoated copper conductors complying with ASTM B3, ASTM B8, or ASTM B787/B787M unless otherwise indicated.
 3. Tinned Copper Conductors: Comply with ASTM B33.
- K. Minimum Conductor Size:
1. Branch Circuits: 12 AWG.
 - a. Exceptions: Size homerun branch circuit conductors from power source to first outlet in accordance with the following maximum circuit limits, using center of load served as basis for computing circuit lengths:
 - 1) 20 A, 120 V circuits longer than 75 feet: 10 AWG, for voltage drop.
 - 2) 20 A, 120 V circuits longer than 150 feet: 8 AWG, for voltage drop.
 - 3) 20A, 240V circuits longer than 150 feet: 10 AWG, for voltage drop.
 2. Control Circuits: 14 AWG.
- L. Where conductor size is not indicated, size to comply with NFPA 70 but not less than applicable minimum size requirements specified.
- M. Conductor Color Coding:
1. Color code conductors as indicated unless otherwise required by the authority having jurisdiction. Maintain consistent color coding throughout project.
 2. Color Coding Method: Integrally colored insulation.
 - a. Conductors size 4 AWG and larger may have black insulation color coded using vinyl color coding electrical tape.
 3. Color Code:
 - a. 240/120 V High-Leg Delta, 3 Phase, 4 Wire System:
 - 1) Phase A: Black.
 - 2) Phase B (High-Leg): Orange.
 - 3) Phase C: Blue.
 - 4) Neutral/Grounded: White.
 - b. Equipment Ground, All Systems: Green.
 - c. Travelers for 3-Way and 4-Way Switching: Pink.
 - d. For control circuits, comply with manufacturer's recommended color code.

2.03 SINGLE CONDUCTOR BUILDING WIRE

- A. Manufacturers:
1. Copper Building Wire:
 - a. Cerro Wire LLC: www.cerrowire.com/#sle.
 - b. Encore Wire Corporation: www.encorewire.com/#sle.
 - c. General Cable Technologies Corporation: www.generalcable.com/#sle.
 - d. Service Wire Co: www.servicewire.com/#sle.
 - e. Southwire Company: www.southwire.com/#sle.
 - f. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Description: Single conductor insulated wire.
- C. Conductor Stranding:
1. Feeders and Branch Circuits:
 - a. Size 10 AWG and Smaller: Solid.
 - b. Size 8 AWG and Larger: Stranded.
 2. Control Circuits: Stranded.
- D. Insulation Voltage Rating: 600 V.
- E. Insulation:
1. Copper Building Wire: Type THHN/THWN-2, except as indicated below.

- a. Motor Circuits Installed Between Variable Frequency Drive (VFD) Outputs and Motors Served: Type XHHW-2.

2.04 METAL-CLAD CABLE

- A. Manufacturers:
 - 1. AFC Cable Systems Inc: www.afcweb.com/#sle.
 - 2. Encore Wire Corporation: www.encorewire.com/#sle.
 - 3. Service Wire Co: www.servicewire.com/#sle.
 - 4. Southwire Company: www.southwire.com/#sle.
 - 5. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Description: NFPA 70, Type MC cable listed and labeled as complying with UL 1569, and listed for use in classified firestop systems to be used.
- C. Conductor Stranding:
 - 1. Size 10 AWG and Smaller: Solid.
 - 2. Size 8 AWG and Larger: Stranded.
- D. Insulation Voltage Rating: 600 V.
- E. Insulation: Type THHN/THWN-2.
- F. Provide dedicated neutral conductor for each phase conductor for all single-phase 2-wire circuits requiring a neutral.
- G. Grounding: Full-size integral green insulated copper equipment grounding conductor.
- H. Armor: Aluminum or steel, interlocked tape.

2.05 WIRING CONNECTORS

- A. Description: Wiring connectors appropriate for the application, suitable for use with the conductors to be connected, and listed as complying with UL 486A-486B or UL 486C as applicable.
- B. Connectors for Grounding and Bonding: Comply with Section 26 05 26.
- C. Wiring Connectors for Splices and Taps:
 - 1. Copper Conductors Size 8 AWG and Smaller: Use twist-on insulated spring connectors.
 - 2. Copper Conductors Size 6 AWG and Larger: Use mechanical connectors or compression connectors. Tape uninsulated conductors and connector with electrical tape or insulate with heat shrink tubing to 150 percent of insulation rating of conductor.
- D. Wiring Connectors for Non-Motor Terminations:
 - 1. Provide terminal lugs for connecting conductors to equipment furnished with terminations designed for terminal lugs.
 - 2. Provide compression adapters for connecting conductors to equipment furnished with mechanical lugs when only compression connectors are specified.
 - 3. Where over-sized conductors are larger than the equipment terminations can accommodate, provide connectors suitable for reducing to appropriate size, but not less than required for the rating of the overcurrent protective device.
 - 4. Copper Conductors Size 8 AWG and Larger: Use mechanical connectors or compression connectors where connectors are required.
 - 5. Stranded Conductors Size 10 AWG and Smaller: Use crimped terminals for connections to terminal screws.
 - 6. Conductors for Control Circuits: Use crimped terminals where connectors are required.
- E. Wiring Connectors for Motor Terminations: Use motor lead disconnects with slip-on insulating boot, pin and silicone gel. Boot sealant shall be used with all insulating boots.
- F. Do not use insulation-piercing or insulation-displacement connectors designed for use with conductors without stripping insulation.
- G. Do not use push-in wire connectors as a substitute for twist-on insulated spring connectors.

- H. Twist-on Insulated Spring Connectors: Rated 600 V, 221 degrees F for standard applications and 302 degrees F for high temperature applications; pre-filled with sealant and listed as complying with UL 486D for damp and wet locations.
 - 1. Manufacturers:
 - a. 3M: www.3m.com/#sle.
 - b. Ideal Industries, Inc: www.idealindustries.com/#sle.
 - c. NSI Industries LLC: www.nsiindustries.com/#sle.
 - d. Substitutions: See Section 01 60 00 - Product Requirements.
- I. Mechanical Connectors: Provide bolted type or set-screw type.
 - 1. Manufacturers:
 - a. Burndy LLC: www.burndy.com.
 - b. nVent ILSCO: www.ilsco.com/#sle.
 - c. Thomas & Betts Corporation; Blackburn Products: www.tnb.com/#sle.
 - d. Polaris: www.polarisconnectors.com.
 - e. Substitutions: See Section 01 60 00 - Product Requirements.
- J. Compression Connectors: Provide circumferential type or hex type crimp configuration.
 - 1. Manufacturers:
 - a. Burndy LLC: www.burndy.com.
 - b. nVent ILSCO: www.ilsco.com/#sle.
 - c. Thomas & Betts Corporation; Blackburn Products: www.tnb.com/#sle.
 - d. Substitutions: See Section 01 60 00 - Product Requirements.
- K. Crimped Terminals: Nylon-insulated, with insulation grip and terminal configuration suitable for connection to be made.
 - 1. Manufacturers:
 - a. Burndy LLC: www.burndy.com.
 - b. IlSCO: www.ilsco.com/#sle.
 - c. Thomas & Betts Corporation; Sta-Kon Products: www.tnb.com/#sle.
 - d. Substitutions: See Section 01 60 00 - Product Requirements.
- L. Motor Lead Disconnects: Color-keyed compression-type with slip-on insulating boot, pin, silicone gel and boot sealant.
 - 1. Manufacturers:
 - a. 3M: www.3m.com/#sle.
 - b. SPS Industrial: www.spsindustrial.com/#sle.
 - c. Thomas & Betts Corporation: www.tnb.com/#sle.
 - 1) Motor Lead Disconnects: M2D Series.
 - 2) Boot Sealant: MDBOOT-SEAL.
 - d. Substitutions: See Section 01 60 00 - Product Requirements.

2.06 ACCESSORIES

- A. Electrical Tape:
 - 1. Manufacturers:
 - a. 3M: www.3m.com/#sle.
 - b. Plymouth Rubber Europa: www.plymouthrubber.com/#sle.
 - c. Hellerman Tyton: www.hellermentyton.com/#sle.
 - d. Duck Brand: <https://www.duckbrand.com/#sle>
 - e. Substitutions: See Section 01 60 00 - Product Requirements.
 - 2. Vinyl Color Coding Electrical Tape: Integrally colored to match color code indicated; listed as complying with UL 510; minimum thickness of 7 mil; resistant to abrasion, corrosion, and sunlight; suitable for continuous temperature environment up to 221 degrees F.
 - 3. Vinyl Insulating Electrical Tape: Complying with ASTM D3005 and listed as complying with UL 510; minimum thickness of 7 mil; resistant to abrasion, corrosion, and sunlight;

- conformable for application down to 0 degrees F and suitable for continuous temperature environment up to 221 degrees F.
4. Rubber Splicing Electrical Tape: Ethylene Propylene Rubber (EPR) tape, complying with ASTM D4388; minimum thickness of 30 mil; suitable for continuous temperature environment up to 194 degrees F and short-term 266 degrees F overload service.
 5. Electrical Filler Tape: Rubber-based insulating moldable putty, minimum thickness of 125 mil; suitable for continuous temperature environment up to 176 degrees F.
 6. Moisture Sealing Electrical Tape: Insulating mastic compound laminated to flexible, all-weather vinyl backing; minimum thickness of 90 mil.
- B. Heat Shrink Tubing: Heavy-wall, split-resistant, with factory-applied adhesive; rated 600 V; suitable for direct burial applications; listed as complying with UL 486D.
1. Manufacturers:
 - a. 3M: www.3m.com/#sle.
 - b. Burndy LLC: www.burndy.com/#sle.
 - c. Thomas & Betts Corporation: www.tnb.com/#sle.
 - d. Substitutions: See Section 01 60 00 - Product Requirements.
- C. Oxide Inhibiting Compound: Listed; suitable for use with the conductors or cables to be installed.
1. Manufacturers:
 - a. Burndy LLC: www.burndy.com/#sle.
 - b. Ideal Industries, Inc: www.idealindustries.com/#sle.
 - c. IlSCO: www.ilsco.com/#sle.
 - d. Substitutions: See Section 01 60 00 - Product Requirements.
- D. Wire Pulling Lubricant:
1. Manufacturers:
 - a. 3M: www.3m.com/#sle.
 - b. American Polywater Corporation: www.polywater.com/#sle.
 - c. Ideal Industries, Inc: www.idealindustries.com/#sle.
 - d. Substitutions: See Section 01 60 00 - Product Requirements.
 2. Listed and labeled as complying with UL 267.
 3. Suitable for use with conductors/cables and associated insulation/jackets to be installed.
 4. Suitable for use at installation temperature.
 5. Products:
 - a. American Polywater Corporation; Polywater J Cable Pulling Lubricant: www.polywater.com/#sle.
 - b. American Polywater Corporation; Polywater LZ Cable Pulling Lubricant: www.polywater.com/#sle.
 - c. Substitutions: See Section 01 60 00 - Product Requirements.
- E. Cable Ties: Material and tensile strength rating suitable for application.
1. Manufacturers:
 - a. Burndy LLC: www.burndy.com/#sle.
 - b. Cable Ties Unlimited: www.cabletiesunlimited.com/#sle.
 - c. Cable Ties Plus: www.cabletiesplus.com/#sle.
 - d. Substitutions: See Section 01 60 00 - Product Requirements.
- F. Firestop Sleeves: Listed; provide as required to preserve fire resistance rating of building elements.
1. Products:
 - a. HoldRite, a brand of Reliance Worldwide Corporation; HydroFlame Pro Series/HydroFlame Custom Built: www.holdrite.com/#sle.
 - b. Hilti: www.hilti.com/#sle.
 - c. STI Firestop: www.stifirestop.com/#sle.

- d. Substitutions: See Section 01 60 00 - Product Requirements.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that interior of building has been protected from weather.
- B. Verify that work likely to damage wire and cable has been completed.
- C. Verify that raceways, boxes, and equipment enclosures are installed and are properly sized to accommodate conductors and cables in accordance with NFPA 70.
- D. Verify that raceway installation is complete and supported.
- E. Verify that field measurements are as indicated.
- F. Verify that conditions are satisfactory for installation prior to starting work.

3.02 PREPARATION

- A. Clean raceways thoroughly to remove foreign materials before installing conductors and cables.

3.03 INSTALLATION

- A. Circuiting Requirements:
 - 1. Unless dimensioned, circuit routing indicated is diagrammatic.
 - 2. When circuit destination is indicated without specific routing, determine exact routing required.
 - 3. Arrange circuiting to minimize splices.
 - 4. Include circuit lengths required to install connected devices within 10 ft of location indicated.
 - 5. Maintain separation of Class 1, Class 2, and Class 3 remote-control, signaling, and power-limited circuits in accordance with NFPA 70.
 - 6. Maintain separation of wiring for emergency systems in accordance with NFPA 70.
 - 7. Circuiting Adjustments: Unless otherwise indicated, when branch circuits are indicated as separate, combining them together in a single raceway is permitted, under the following conditions:
 - a. Provide no more than six current-carrying conductors in a single raceway. Dedicated neutral conductors are considered current-carrying conductors.
 - b. Increase size of conductors as required to account for ampacity derating.
 - c. Size raceways, boxes, etc. to accommodate conductors.
 - 8. Common Neutrals: Unless otherwise indicated, sharing of neutral/grounded conductors among single phase branch circuits is not permitted. Provide dedicated neutral/grounded conductor for each individual branch circuit.
- B. Install products in accordance with manufacturer's instructions.
- C. Perform work in accordance with NECA 1 (general workmanship).
- D. Install metal-clad cable (Type MC) in accordance with NECA 120.
- E. Installation in Raceway:
 - 1. Swab/clean interiors of new and existing conduits before pulling new conductors.
 - 2. Remove existing conductors and cables from raceway before pulling in new (where applicable).
 - 3. Tape ends of conductors and cables to prevent infiltration of moisture and other contaminants.
 - 4. Use cable pullers to pull conductors through conduits.
 - 5. Pull all conductors and cables together into raceway at same time.
 - 6. Do not damage conductors and cables or exceed manufacturer's recommended maximum pulling tension and sidewall pressure.

7. Use suitable wire pulling lubricant where necessary, except when lubricant is not recommended by the manufacturer.
- F. Paralleled Conductors: Install conductors of the same length and terminate in the same manner.
- G. Secure and support conductors and cables in accordance with NFPA 70 using suitable supports and methods approved by the authority having jurisdiction. Provide independent support from building structure. Do not provide support from raceways, piping, ductwork, or other systems.
 1. Installation Above Suspended Ceilings: Do not provide support from ceiling support system. Do not provide support from ceiling grid or allow conductors and cables to lay on ceiling tiles. Support at 6 foot maximum intervals using type MC cable supports designed and listed for the purpose.
 2. Installation in Vertical Raceways: Provide supports where vertical rise exceeds permissible limits.
- H. Terminate cables using suitable fittings.
 1. Metal-Clad Cable (Type MC):
 - a. Fittings used for connecting type MC cable to boxes, cabinets or other equipment shall be listed and identified for such use. Snap-in connectors or internal box clamps shall not be permitted. All connectors shall be locknut type, designed to secure type MC cable to boxes or enclosures.
 - b. Cut cable armor only using specialized tools to prevent damaging conductors or insulation. Do not use hacksaw or wire cutters to cut armor.
 - c. Do not use direct-bearing set-screw type fittings for cables with aluminum armor.
 - d. Provide plastic anti-short bushings on ends of all type MC cable.
- I. Install conductors with a minimum of 12 inches of slack at each outlet.
- J. Neatly train and bundle conductors inside boxes, wireways, panelboards and other equipment enclosures.
- K. Group or otherwise identify neutral/grounded conductors with associated ungrounded conductors inside enclosures in accordance with NFPA 70.
- L. Make wiring connections using specified wiring connectors.
 1. Make splices and taps only in accessible boxes. Do not pull splices into raceways or make splices in conduit bodies or wiring gutters.
 2. Remove appropriate amount of conductor insulation for making connections without cutting, nicking or damaging conductors.
 3. Do not remove conductor strands to facilitate insertion into connector.
 4. Clean contact surfaces on conductors and connectors to suitable remove corrosion, oxides, and other contaminants. Do not use wire brush on plated connector surfaces.
 5. Mechanical Connectors: Secure connections according to manufacturer's recommended torque settings.
 6. Compression Connectors: Secure connections using manufacturer's recommended tools and dies.
- M. Insulate splices and taps that are made with uninsulated connectors using methods suitable for the application, with insulation and mechanical strength at least equivalent to unspliced conductors.
 1. Dry Locations: Use insulating covers specifically designed for the connectors, electrical tape, or heat shrink tubing.
 - a. For taped connections, first apply adequate amount of rubber splicing electrical tape or electrical filler tape, followed by outer covering of vinyl insulating electrical tape.
 2. Damp Locations: Use insulating covers specifically designed for the connectors, electrical tape, or heat shrink tubing.

- a. For connections with insulating covers, apply outer covering of moisture sealing electrical tape.
 - b. For taped connections, follow same procedure as for dry locations but apply outer covering of moisture sealing electrical tape.
- 3. Wet Locations: Use heat shrink tubing.
- N. Insulate ends of spare conductors using vinyl insulating electrical tape.
- O. Field-Applied Color Coding: Where vinyl color coding electrical tape is used in lieu of integrally colored insulation as permitted in Part 2 under "Color Coding", apply half overlapping turns of tape at each termination and at each location conductors are accessible.
- P. Identify conductors and cables in accordance with Section 26 05 53.
- Q. Color Code Legend: Provide identification label identifying color code for ungrounded and grounded conductors at each piece of feeder or branch-circuit distribution equipment.
- R. Install firestopping to preserve fire resistance rating of partitions and other elements, using materials and methods specified in Section 07 84 00.
- S. Unless specifically indicated to be excluded, provide final connections to all equipment and devices, including those furnished by others, as required for a complete operating system.
- T. Protect exposed cable from damage.
- U. Clean conductor surfaces before installing lugs and connectors.
- V. Make splices, taps, and terminations to carry full ampacity of conductors with no perceptible temperature rise.

3.04 FIELD QUALITY CONTROL

- A. See Section 01 40 00 - Quality Requirements, for additional requirements.
- B. Perform field inspection and testing in accordance with Section 01 40 00 - Quality Requirements.
- C. Inspect and test in accordance with NETA ATS, except Section 4.
- D. Perform inspections and tests listed in NETA ATS, Section 7.3.2. The insulation resistance test is required for all conductors. The resistance test for parallel conductors listed as optional is not required.
 - 1. Disconnect surge protective devices (SPDs) prior to performing any high potential testing. Replace SPDs damaged by performing high potential testing with SPDs connected.
- E. Correct deficiencies and replace damaged or defective conductors and cables.

END OF SECTION

SECTION 26 05 26
GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Grounding and bonding requirements.
- B. Conductors for grounding and bonding.
- C. Connectors for grounding and bonding.
- D. Ground bars.
- E. Ground rod electrodes.
- F. Ground enhancement material.

1.02 RELATED REQUIREMENTS

- A. Section 26 05 19 - Low-Voltage Electrical Power Conductors and Cables: Additional requirements for conductors for grounding and bonding, including conductor color coding.
 - 1. Includes oxide inhibiting compound.
- B. Section 26 05 53 - Identification for Electrical Systems: Identification products and requirements.

1.03 REFERENCE STANDARDS

- A. IEEE 81 - IEEE Guide for Measuring Earth Resistivity, Ground Impedance, and Earth Surface Potentials of a Grounding System; 2012.
- B. NECA 1 - Standard for Good Workmanship in Electrical Construction; 2023.
- C. NEMA GR 1 - Grounding Rod Electrodes and Grounding Rod Electrode Couplings; 2022.
- D. NETA ATS - Standard for Acceptance Testing Specifications for Electrical Power Equipment And Systems; 2025.
- E. NFPA 70 - National Electrical Code; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- F. UL 467 - Grounding and Bonding Equipment; Current Edition, Including All Revisions.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Verify exact locations of underground metal water service pipe entrances to building.
 - 2. Notify DEDC, LLC of any conflicts with or deviations from Contract Documents. Obtain direction before proceeding with work.
- B. Sequencing:
 - 1. Do not install ground rod electrodes until final backfill and compaction is complete.

1.05 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements for submittals procedures.
- B. Product Data: Provide manufacturer's standard catalog pages and data sheets for grounding and bonding system components.
- C. Field quality control test reports.
- D. Project Record Documents: Record actual locations of grounding electrode system components and connections.

1.06 QUALITY ASSURANCE

- A. Comply with requirements of NFPA 70.
- B. Maintain at the project site a copy of each referenced document that prescribes execution requirements.

- C. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum three years documented experience.
- D. Product Listing Organization Qualifications: An organization recognized by OSHA as a Nationally Recognized Testing Laboratory (NRTL) and acceptable to authorities having jurisdiction.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. Receive, inspect, handle, and store products in accordance with manufacturer's instructions.

PART 2 PRODUCTS

2.01 GROUNDING AND BONDING REQUIREMENTS

- A. Existing Work: Where existing grounding and bonding system components are indicated to be reused, they may be reused only where they are free from corrosion, integrity and continuity are verified, and where acceptable to the authority having jurisdiction.
- B. Do not use products for applications other than as permitted by NFPA 70 and product listing.
- C. Unless specifically indicated to be excluded, provide all required components, conductors, connectors, conduit, boxes, fittings, supports, accessories, etc. as necessary for a complete grounding and bonding system.
- D. Where conductor size is not indicated, size to comply with NFPA 70 but not less than applicable minimum size requirements specified.
- E. Grounding System Resistance:
 - 1. Achieve specified grounding system resistance under normally dry conditions unless otherwise approved by DEDC, LLC. Precipitation within the previous 48 hours does not constitute normally dry conditions.
 - 2. Grounding Electrode System: Not greater than 5 ohms to ground, when tested according to IEEE 81 using "fall-of-potential" method.
 - 3. Between Grounding Electrode System and Major Electrical Equipment Frames, System Neutral, and Derived Neutral Points: Not greater than 0.5 ohms, when tested using "point-to-point" methods.
- F. Grounding Electrode System:
 - 1. Provide connection to required and supplemental grounding electrodes indicated to form grounding electrode system.
 - a. Provide continuous grounding electrode conductors without splice or joint.
 - b. Install grounding electrode conductors in raceway where exposed to physical damage. Bond grounding electrode conductor to metallic raceways at each end with bonding jumper.
 - 2. Metal Underground Water Pipe(s):
 - a. Provide connection to underground metal domestic and fire protection (where present) water service pipe(s) that are in direct contact with earth for at least 10 feet at an accessible location not more than 5 feet from the point of entrance to the building.
 - b. Provide bonding jumper(s) around insulating joints/pipes as required to make pipe electrically continuous.
 - c. Provide bonding jumper around water meter of sufficient length to permit removal of meter without disconnecting jumper.
 - 3. Ground Rod Electrode(s):
 - a. Provide two electrodes unless otherwise indicated or required.
 - b. Space electrodes not less than 10 feet from each other and any other ground electrode.
 - c. Where location is not indicated, locate electrode(s) at least 5 feet outside building perimeter foundation as near as possible to electrical service entrance; where possible, locate in softscape (uncovered) area.

- d. Provide ground enhancement material around electrode if required to achieve specified grounding electrode system resistance.
4. Provide additional ground electrode(s) as required to achieve specified grounding electrode system resistance.
5. Ground Bar: Provide ground bar, separate from service equipment enclosure, for common connection point of grounding electrode system bonding jumpers as permitted in NFPA 70. Connect grounding electrode conductor provided for service-supplied system grounding to this ground bar
 - a. Ground Bar Size: minimum 1/4 by 2 by 12 inches with 18 mounting holes (9 sets of 2) suitable for connection with 2-bolt long barrel compression lugs unless otherwise indicated or required.
 - b. Where ground bar location is not indicated, locate in accessible location as near as possible to service disconnect enclosure.
 - c. Ground Bar Mounting Height: 18 inches above finished floor unless otherwise indicated.
- G. Service-Supplied System Grounding:
 1. For each service disconnect, provide grounding electrode conductor to connect neutral (grounded) service conductor to grounding electrode system. Unless otherwise indicated, make connection at neutral (grounded) bus in service disconnect enclosure.
 2. For each service disconnect, provide main bonding jumper to connect neutral (grounded) bus to equipment ground bus where not factory-installed. Do not make any other connections between neutral (grounded) conductors and ground on load side of service disconnect.
- H. Bonding and Equipment Grounding:
 1. Provide bonding for equipment grounding conductors, equipment ground busses, metallic equipment enclosures, metallic raceways and boxes, device grounding terminals, and other normally non-current-carrying conductive materials enclosing electrical conductors/equipment or likely to become energized as indicated and in accordance with NFPA 70.
 2. Provide green insulated copper equipment grounding conductor in each feeder and branch circuit raceway. Do not use raceways as sole equipment grounding conductor.
 3. Where circuit conductor sizes are increased for voltage drop, increase size of equipment grounding conductor proportionally in accordance with NFPA 70.
 4. Unless otherwise indicated, connect wiring device grounding terminal to branch circuit equipment grounding conductor and to outlet box with bonding jumper.
 5. Terminate branch circuit equipment grounding conductors on solidly bonded equipment ground bus only. Do not terminate on neutral (grounded) or isolated/insulated ground bus.
 6. Provide bonding jumper across expansion or expansion/deflection fittings provided to accommodate conduit movement.
 7. Provide bonding for interior metal piping systems in accordance with NFPA 70. This includes, but is not limited to:
 - a. Metal water piping where not already effectively bonded to metal underground water pipe used as grounding electrode.
 - b. Metal gas piping. NOTE: Contractor shall ensure that interior metal gas piping is electrically isolated from underground metal gas piping in order to prevent underground gas piping from inadvertently becoming a grounding electrode, as is prohibited by NFPA 70.
 8. Provide bonding for interior metal air ducts.
- I. Communications Systems Grounding and Bonding:
 1. Provide bonding jumper (in raceway if subject to damage) from ground bar at service equipment to each communications equipment headend location and leave slack conductor for termination by others.
 - a. Bonding Jumper Size: 6 AWG, unless otherwise indicated or required.

- b. Raceway Size: 3/4 inch trade size unless otherwise indicated or required.

2.02 GROUNDING AND BONDING COMPONENTS

- A. General Requirements:
1. Provide products listed, classified, and labeled as suitable for the purpose intended.
 2. Provide products listed and labeled as complying with UL 467 where applicable.
- B. Conductors for Grounding and Bonding, in Addition to Requirements of Section 26 05 26:
1. Use insulated copper conductors unless otherwise indicated.
 - a. Exceptions:
 - 1) Use bare copper conductors where installed underground in direct contact with earth.
 2. Factory Pre-fabricated Bonding Jumpers: Furnished with factory-installed ferrules; size braided cables to provide equivalent gauge of specified conductors.
- C. Connectors for Grounding and Bonding:
1. Description: Connectors appropriate for the application and suitable for the conductors and items to be connected; listed and labeled as complying with UL 467.
 2. Unless otherwise indicated, use exothermic welded connections or compression connectors for underground, concealed and other inaccessible connections.
 3. Unless otherwise indicated, use mechanical connectors or compression connectors for accessible connections.
 4. Manufacturers - Mechanical and Compression Connectors:
 - a. allG Fabrication: www.allgfab.com/#sle.
 - b. Burndy LLC: www.burndy.com/#sle.
 - c. Harger Lightning & Grounding: www.harger.com/#sle.
 - d. nVent ERICO: www.nvent.com/#sle.
 - e. Thomas & Betts Corporation: www.tnb.com/#sle.
 - f. Substitutions: See Section 01 60 00 - Product Requirements.
 5. Manufacturers - Exothermic Welded Connections:
 - a. Burndy LLC: www.burndy.com/#sle.
 - b. nVent ERICO; Cadweld: www.nvent.com/#sle.
 - c. thermOweld, subsidiary of Continental Industries; division of Burndy LLC: www.thermoweld.com/#sle.
 - d. Substitutions: See Section 01 60 00 - Product Requirements.
- D. Ground Bars:
1. Description: Copper rectangular ground bars with mounting brackets and insulators.
 2. Size: As indicated above unless otherwise indicated or required.
 3. Holes for Connections: As indicated above or as required for connections to be made.
 4. Manufacturers:
 - a. allG Fabrication: www.allgfab.com/#sle.
 - b. Harger Lightning & Grounding: www.harger.com/#sle.
 - c. nVent ERICO: www.nvent.com/#sle.
 - d. thermOweld, subsidiary of Continental Industries; division of Burndy LLC: www.thermoweld.com/#sle.
 - e. Substitutions: See Section 01 60 00 - Product Requirements.
- E. Ground Rod Electrodes:
1. Comply with NEMA GR 1.
 2. Material: Copper-bonded (copper-clad) steel.
 3. Size: 3/4 inch diameter by 10 feet length, unless otherwise indicated.
 4. Where rod lengths of greater than 10 feet are indicated or otherwise required, sectionalized ground rods may be used.
 5. Manufacturers:
 - a. allG Fabrication: www.allgfab.com/#sle.

- b. Galvan Industries, Inc: www.galvanelectrical.com/#sle.
 - c. Harger Lightning & Grounding: www.harger.com/#sle.
 - d. nVent ERICO: www.nvent.com/#sle.
 - e. Substitutions: See Section 01 60 00 - Product Requirements.
- F. Ground Enhancement Material:
 - 1. Description: Factory-mixed conductive material designed for permanent and maintenance-free improvement of grounding effectiveness by lowering resistivity.
 - 2. Resistivity: Not more than 20 ohm-cm in final installed form.
 - 3. Manufacturers:
 - a. Harger Lightning & Grounding: www.harger.com/#sle.
 - b. nVent ERICO; GEM: www.nvent.com/#sle.
 - c. thermOweld, subsidiary of Continental Industries; division of Burndy LLC: www.thermoweld.com/#sle.
 - d. Substitutions: See Section 01 60 00 - Product Requirements.
- G. Oxide Inhibiting Compound: Comply with Section 26 05 19.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that work likely to damage grounding and bonding system components has been completed.
- B. Verify that field measurements are as indicated.
- C. Verify that conditions are satisfactory for installation prior to starting work.
- D. Verify existing conditions prior to starting work.

3.02 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.
- B. Perform work in accordance with NECA 1 (general workmanship).
- C. Ground Rod Electrodes: Unless otherwise indicated, install ground rod electrodes vertically. Where encountered rock prohibits vertical installation, install at 45 degree angle or bury horizontally in trench at least 30 inches (750 mm) deep in accordance with NFPA 70.
 - 1. Outdoor Installations: Unless otherwise indicated, install with top of rod 6 inches below finished grade.
- D. Make grounding and bonding connections using specified connectors.
 - 1. Remove appropriate amount of conductor insulation for making connections without cutting, nicking or damaging conductors. Do not remove conductor strands to facilitate insertion into connector.
 - 2. Remove nonconductive paint, enamel, or similar coating at threads, contact points, and contact surfaces.
 - 3. Exothermic Welds: Make connections using molds and weld material suitable for the items to be connected in accordance with manufacturer's recommendations.
 - 4. Mechanical Connectors: Secure connections according to manufacturer's recommended torque settings.
 - 5. Compression Connectors: Secure connections using manufacturer's recommended tools and dies.
- E. Equipment Grounding Conductors: Provide separate, green insulated copper equipment grounding conductor within each feeder and branch circuit raceway. Terminate each end on suitable lug, bus or bushing.
- F. Identify grounding and bonding system components in accordance with Section 26 05 53.

3.03 FIELD QUALITY CONTROL

- A. See Section 01 40 00 - Quality Requirements, for additional requirements.

- B. Inspect and test in accordance with NETA ATS except Section 4.
- C. Perform inspections and tests listed in NETA ATS, Section 7.13.
- D. Perform ground electrode resistance tests under normally dry conditions. Precipitation within the previous 48 hours does not constitute normally dry conditions.
- E. Investigate and correct deficiencies where measured ground resistances do not comply with specified requirements.
- F. Submit detailed reports indicating inspection and testing results and corrective actions taken.

END OF SECTION

SECTION 26 05 29
HANGERS AND SUPPORTS FOR ELECTRICAL SYSTEMS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Support and attachment requirements and components for equipment, conduit, cable, boxes, and other electrical work.

1.02 RELATED REQUIREMENTS

- A. Section 03 30 00 - Cast-in-Place Concrete: Concrete equipment pads.
- B. Section 26 05 33.13 - Conduit for Electrical Systems: Additional support and attachment requirements for conduits.
- C. Section 26 05 33.16 - Boxes for Electrical Systems: Additional support and attachment requirements for boxes.
- D. Section 26 51 00 - Interior Lighting: Additional support and attachment requirements for interior luminaires.

1.03 REFERENCE STANDARDS

- A. ASTM A123/A123M - Standard Specification for Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products; 2024.
- B. ASTM A153/A153M - Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware; 2023.
- C. ASTM B633 - Standard Specification for Electrodeposited Coatings of Zinc on Iron and Steel; 2023.
- D. MFMA-4 - Metal Framing Standards Publication; 2004.
- E. NECA 1 - Standard for Good Workmanship in Electrical Construction; 2023.
- F. NFPA 70 - National Electrical Code; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Coordinate sizes and arrangement of supports and bases with actual equipment and components to be installed.
 - 2. Coordinate work to provide additional framing and materials required for installation.
 - 3. Coordinate compatibility of support and attachment components with mounting surfaces at installed locations.
 - 4. Coordinate arrangement of supports with ductwork, piping, equipment and other potential conflicts.
 - 5. Notify DEDC, LLC of conflicts with or deviations from Contract Documents. Obtain direction before proceeding with work.
- B. Sequencing:
 - 1. Do not install products on or provide attachment to concrete surfaces until concrete has cured; see Section 03 30 00.

1.05 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements for submittal procedures.
- B. Product Data: Provide manufacturer's standard catalog pages and data sheets for channel/strut framing systems and post-installed concrete/masonry anchors.
- C. Shop Drawings: Include details for fabricated hangers and supports where materials or methods other than those indicated are proposed for substitution.

1.06 QUALITY ASSURANCE

- A. Maintain at project site one copy of each referenced document that prescribes execution requirements.
- B. Product Listing Organization Qualifications: Organization recognized by OSHA as Nationally Recognized Testing Laboratory (NRTL) and acceptable to authorities having jurisdiction.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. Receive, inspect, handle, and store products in accordance with manufacturer's instructions.

PART 2 PRODUCTS

2.01 SUPPORT AND ATTACHMENT COMPONENTS

- A. General Requirements:
 - 1. Comply with the following. Where requirements differ, comply with most stringent.
 - a. NFPA 70.
 - b. Applicable building code.
 - c. Requirements of authorities having jurisdiction.
 - 2. Provide required hangers, supports, anchors, fasteners, fittings, accessories, and hardware as necessary for complete installation of electrical work.
 - 3. Provide products listed, classified, and labeled as suitable for purpose intended, where applicable.
 - 4. Where support and attachment component types and sizes are not indicated, select in accordance with manufacturer's application criteria as required for the load to be supported with a minimum safety factor of five times the applied force. Include consideration for vibration, equipment operation, and shock loads where applicable.
 - 5. Do not use products for applications other than as permitted by NFPA 70 and product listing.
 - 6. Do not use wire, chain, perforated pipe strap, or wood for permanent supports unless specifically indicated or permitted.
 - 7. Steel Components: Use corrosion-resistant materials suitable for environment where installed.
 - a. Indoor Dry Locations: Use zinc-plated steel or approved equivalent unless otherwise indicated.
 - b. Outdoor and Damp or Wet Indoor Locations: Use galvanized steel, stainless steel, or approved equivalent unless otherwise indicated.
 - c. Zinc-Plated Steel: Electroplated in accordance with ASTM B633.
 - d. Galvanized Steel: Hot-dip galvanized after fabrication in accordance with ASTM A123/A123M or ASTM A153/A153M.
- B. Conduit and Cable Supports: Straps and clamps suitable for conduit or cable to be supported.
 - 1. Manufacturers:
 - a. ABB: www.electrification.us.abb.com/#sle.
 - b. Eaton Corporation: www.eaton.com/#sle.
 - c. Emerson Electric Co; O-Z/Gedney: www.emerson.com/#sle.
 - d. HoldRite, a brand of Reliance Worldwide Corporation: www.holdrite.com/#sle.
 - e. Substitutions: See Section 01 60 00 - Product Requirements.
 - 2. Conduit Straps: One-hole or two-hole type; steel or malleable iron.
 - 3. Conduit Clamps: Bolted type unless otherwise indicated.
 - 4. Products:
 - a. Gripple, Inc; Universal Bracket: www.gripple.com/#sle.
 - b. Gripple, Inc; Fast Trak: www.gripple.com/#sle.
 - c. Gripple, Inc; Universal Clamp (Threaded): www.gripple.com/#sle.
 - d. Gripple, Inc; Low Profile Bracket Kits: www.gripple.com/#sle.
 - e. Substitutions: See Section 01 60 00 - Product Requirements.
- C. Outlet Box Supports: Hangers and brackets suitable for boxes to be supported.

1. Manufacturers:
 - a. ABB: www.electrification.us.abb.com/#sle.
 - b. Eaton Corporation: www.eaton.com/#sle.
 - c. Emerson Electric Co; O-Z/Gedney: www.emerson.com/#sle.
 - d. HoldRite, a brand of Reliance Worldwide Corporation: www.holdrite.com/#sle.
 - e. Substitutions: See Section 01 60 00 - Product Requirements.
- D. Metal Channel/Strut Framing Systems:
 1. Manufacturers:
 - a. ABB: www.electrification.us.abb.com/#sle.
 - b. Atkore International Inc; Unistrut: www.unistrut.us/#sle.
 - c. Eaton Corporation: www.eaton.com/#sle.
 - d. Elgen Manufacturing Company, Inc: www.elgenmfg.com/#sle.
 - e. Substitutions: See Section 01 60 00 - Product Requirements.
 - f. Source Limitations: Furnish channel/strut and associated fittings, accessories, and hardware produced by single manufacturer.
 2. Description: Factory-fabricated, continuous-slot, metal channel/strut and associated fittings, accessories, and hardware required for field assembly of supports.
 3. Comply with MFMA-4.
 4. Channel Material:
 - a. Indoor Dry Locations: Use galvanized steel.
 - b. Outdoor and Damp or Wet Indoor Locations: Use galvanized steel.
 5. Minimum Channel Thickness: Steel sheet, 12 gauge, 0.1046 inch.
 6. Minimum Channel Dimensions: 1-5/8 inch wide by 13/16 inch high.
- E. Hanger Rods: Threaded, zinc-plated steel unless otherwise indicated.
 1. Minimum Size, Unless Otherwise Indicated or Required:
 - a. Equipment Supports: 1/2-inch diameter.
 - b. Single Conduit up to 1-inch (27 mm) Trade Size: 1/4-inch diameter.
 - c. Single Conduit Larger than 1-inch (27 mm) Trade Size: 3/8-inch diameter.
 - d. Trapeze Support for Multiple Conduits: 3/8-inch diameter.
 - e. Outlet Boxes: 1/4-inch diameter.
 - f. Luminaires: 1/4-inch diameter.
- F. Anchors and Fasteners:
 1. Manufacturers - Mechanical Anchors:
 - a. Dewalt: anchors.dewalt.com/#sle.
 - b. Hilti, Inc: www.hilti.com/#sle.
 - c. ITW Red Head, a division of Illinois Tool Works, Inc: www.itwredhead.com/#sle.
 - d. Simpson Strong-Tie Company Inc: www.strongtie.com/#sle.
 - e. Substitutions: See Section 01 60 00 - Product Requirements.
 2. Unless otherwise indicated and where not otherwise restricted, use anchor and fastener types indicated for specified applications.
 3. Concrete: Use preset concrete inserts, expansion anchors, or screw anchors.
 4. Solid or Grout-Filled Masonry: Use expansion anchors or screw anchors.
 5. Hollow Masonry: Use toggle bolts.
 6. Hollow Stud Walls: Use toggle bolts.
 7. Steel: Use beam clamps, machine bolts, or welded threaded studs.
 8. Sheet Metal: Use sheet metal screws.
 9. Wood: Use wood screws.
 10. Plastic and lead anchors are not permitted.
 11. Post-Installed Concrete and Masonry Anchors: Evaluated and recognized by ICC Evaluation Service, LLC (ICC-ES) for compliance with applicable building code.

2.02 MATERIALS

- A. Hangers, Supports, Anchors, and Fasteners - General: Corrosion-resistant materials of size and type adequate to carry the loads of equipment and conduit, including weight of wire in conduit.
- B. Supports: Fabricated of structural steel or formed steel members; galvanized.
- C. Anchors and Fasteners:

	Drop in Sleeve Anchors	Expansion Machine Bolt Anchors	Lag Shield Anchors	Nail-in Anchors	Toggle Bolts	Hollow Wall Anchors	Power Driven Studs
Brick	X	X	X	X			X
Concrete	X	X	X	X			X
Concrete Block	X		X	X	X		
Cinder Block		X			X	X	
Stone	X	X		X			X
Marble	X		X				
Building Tile		X			X	X	
Ceramic Tile		X			X		
Terrazzo		X		X			
Terra Cotta		X			X	X	
Plaster					X	X	
Drywall				X	X		
Slate		X			X		
Steel							X

ANCHOR HARDWARE TABLE

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field measurements are as indicated.
- B. Verify that mounting surfaces are ready to receive support and attachment components.
- C. Verify that conditions are satisfactory for installation prior to starting work.

3.02 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.
- B. Install hangers and supports in accordance with NECA 1.
- C. Install anchors and fasteners in accordance with ICC Evaluation Services, LLC (ICC-ES) evaluation report conditions of use where applicable.
- D. Provide independent support from building structure. Do not provide support from piping, ductwork, or other systems.
- E. Unless specifically indicated or approved by DEDC, LLC, do not provide support from suspended ceiling support system or ceiling grid.
- F. Unless specifically indicated or approved by DEDC, LLC, do not provide support from roof deck.
- G. Do not penetrate or otherwise notch or cut structural members without approval of Structural Engineer.

- H. Equipment Support and Attachment:
 - 1. Use metal, fabricated supports or supports assembled from metal channel/strut to support equipment as required.
 - 2. Use metal channel/strut secured to studs to support equipment surface mounted on hollow stud walls when wall strength is not sufficient to resist pull-out.
 - 3. Use metal channel/strut to support surface-mounted equipment in wet or damp locations to provide space between equipment and mounting surface.
 - 4. Securely fasten floor-mounted equipment. Do not install equipment such that it relies on its own weight for support.
- I. Conduit Support and Attachment: See Section 26 05 33.13 for additional requirements.
- J. Box Support and Attachment: See Section 26 05 33.16 for additional requirements.
- K. Interior Luminaire Support and Attachment: See Section 26 51 00 for additional requirements.
- L. Secure fasteners in accordance with manufacturer's recommended torque settings.
- M. Remove temporary supports.
- N. Identify independent electrical component support wires above accessible ceilings with color distinguishable from ceiling support wires in accordance with NFPA 70.

3.03 FIELD QUALITY CONTROL

- A. See Section 01 40 00 - Quality Requirements for additional requirements.
- B. Inspect support and attachment components for damage and defects.
- C. Repair cuts and abrasions in galvanized finishes using zinc-rich paint recommended by manufacturer. Replace components that exhibit signs of corrosion.
- D. Correct deficiencies and replace damaged or defective support and attachment components.
- E. Install hangers and supports as required to adequately and securely support electrical system components, in a neat and workmanlike manner, as specified in NECA 1.
 - 1. Do not fasten supports to pipes, ducts, mechanical equipment, or conduit.
 - 2. Do not drill or cut structural members.
- F. Rigidly weld support members or use hexagon-head bolts to present neat appearance with adequate strength and rigidity. Use spring lock washers under all nuts.
- G. Install surface-mounted cabinets and panelboards with minimum of four anchors.
- H. In wet and damp locations use steel channel supports to stand cabinets and panelboards 1-5/8" off wall.
- I. Use sheet metal channel to bridge studs above and below cabinets and panelboards recessed in hollow partitions.

THIS PAGE INTENTIONALLY LEFT BLANK

SECTION 26 05 33.13
CONDUIT FOR ELECTRICAL SYSTEMS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Galvanized steel rigid metal conduit (RMC).
- B. Flexible metal conduit (FMC).
- C. Liquidtight flexible metal conduit (LFMC).
- D. Galvanized steel electrical metallic tubing (EMT).
- E. Conduit fittings and conduit bodies.

1.02 RELATED REQUIREMENTS

- A. Section 07 84 00 - Firestopping.
- B. Section 26 05 19 - Low-Voltage Electrical Power Conductors and Cables: Metal clad cable (Type MC), including uses permitted.
- C. Section 26 05 26 - Grounding and Bonding for Electrical Systems.
 - 1. Includes additional requirements for fittings for grounding and bonding.
- D. Section 26 05 29 - Hangers and Supports for Electrical Systems.
- E. Section 26 05 33.16 - Boxes for Electrical Systems.
- F. Section 26 05 53 - Identification for Electrical Systems: Identification products and requirements.

1.03 REFERENCE STANDARDS

- A. ANSI C80.1 - American National Standard for Electrical Rigid Steel Conduit (ERSC); 2020.
- B. ANSI C80.3 - American National Standard for Electrical Metallic Tubing -- Steel (EMT-S); 2020.
- C. NECA 1 - Standard for Good Workmanship in Electrical Construction; 2023.
- D. NECA 101 - Standard for Installing Steel Conduits (Rigid, IMC, EMT); 2020.
- E. NEMA FB 1 - Fittings, Cast Metal Boxes, and Conduit Bodies for Conduit, Electrical Metallic Tubing, and Cable; 2014.
- F. NFPA 70 - National Electrical Code; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- G. UL 1 - Flexible Metal Conduit; Current Edition, Including All Revisions.
- H. UL 6 - Electrical Rigid Metal Conduit-Steel; Current Edition, Including All Revisions.
- I. UL 360 - Liquid-Tight Flexible Metal Conduit; Current Edition, Including All Revisions.
- J. UL 514B - Conduit, Tubing, and Cable Fittings; Current Edition, Including All Revisions.
- K. UL 797 - Electrical Metallic Tubing-Steel; Current Edition, Including All Revisions.
- L. UL 2419 - Outline of Investigation for Electrically Conductive Corrosion Resistant Compounds; Current Edition, Including All Revisions.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Coordinate minimum sizes of conduits with actual type and quantity of conductors to be installed, including adjustments for conductor sizes increased for voltage drop.
 - 2. Coordinate arrangement of conduits with structural members, ductwork, piping, equipment, and other potential conflicts.
 - 3. Verify exact conduit termination locations required for boxes, enclosures, and equipment.
 - 4. Notify DEDC, LLC of conflicts with or deviations from Contract Documents. Obtain direction before proceeding with work.

- B. Sequencing:
 - 1. Do not begin installation of conductors and cables until installation of conduit between termination points is complete.

1.05 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements for submittals procedures.
- B. Product Data: Provide manufacturer's standard catalog pages and data sheets for conduits and fittings.
- C. Project Record Documents: Record actual routing for conduits 2 inch (53 mm) trade size and larger.

1.06 QUALITY ASSURANCE

- A. Documents at Project Site: Maintain at project site one copy of manufacturer's instructions and shop drawings.
- B. Product Listing Organization Qualifications: Organization recognized by OSHA as Nationally Recognized Testing Laboratory (NRTL) and acceptable to authorities having jurisdiction.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. See Section 01 74 19 - Construction Waste Management and Disposal for packaging waste requirements.
- B. Receive, inspect, handle, and store conduit and fittings in accordance with manufacturer's instructions.
- C. Accept conduit on site. Inspect for damage.
- D. Protect conduit from corrosion and entrance of debris by storing above grade. Provide appropriate covering.

PART 2 PRODUCTS

2.01 CONDUIT APPLICATIONS

- A. Do not use conduit and associated fittings for applications other than as permitted by NFPA 70, manufacturer's instructions, and product listing.
- B. Unless otherwise indicated and where not otherwise restricted, use conduit types indicated for specified applications. Where more than one listed application applies, comply with most restrictive requirements. Where conduit type for particular application is not specified, use galvanized steel rigid metal conduit.
- C. Concealed Within Masonry Walls: Use electrical metallic tubing (EMT).
- D. Concealed Within Hollow Stud Walls: Use electrical metallic tubing (EMT).
- E. Concealed Above Accessible Ceilings: Use electrical metallic tubing (EMT).
- F. Interior, Damp or Wet Locations: Use galvanized steel rigid metal conduit (RMC).
- G. Exposed, Interior (including unfinished spaces), Not Subject to Physical Damage: Use electrical metallic tubing (EMT).
- H. Exposed, Interior (including unfinished spaces), Subject to Physical Damage: Use galvanized steel rigid metal conduit.
 - 1. Locations subject to physical damage include, but are not limited to:
 - a. Where exposed below 8 feet, except within electrical and communication rooms or closets.
 - b. Where exposed below 20 feet in warehouse areas.
- I. Exposed, Exterior: Use galvanized steel rigid metal conduit.
- J. Concealed, Exterior, Not Embedded in Concrete or in Contact With Earth: Use galvanized steel rigid metal conduit.

- K. Flexible Connections to Luminaires Above Accessible Ceilings: Use flexible metal conduit (FMC).
 - 1. Maximum Length: 6 feet.
- L. Flexible Connections to Vibrating Equipment:
 - 1. Dry Locations: Use flexible metal conduit (FMC).
 - 2. Damp, Wet, or Corrosive Locations: Use liquidtight flexible metal conduit (LFMC).
 - 3. Maximum Length: 18 inches unless otherwise indicated.
 - 4. Vibrating equipment includes, but is not limited to:
 - a. Transformers.
 - b. Motors.
- M. Other Applications where Flexible Connections to Equipment are Required:
 - 1. Dry Locations: Use flexible metal conduit (FMC).
 - 2. Damp, Wet, or Corrosive Locations: Use liquidtight flexible metal conduit (LFMC).
 - 3. Maximum Length: 18 inches unless otherwise indicated.
- N. Fished in Existing Walls, Where Necessary: Use flexible metal conduit.

2.02 CONDUIT - GENERAL REQUIREMENTS

- A. Comply with NFPA 70.
- B. Existing Work: Where existing conduits are indicated to be reused, they may be reused only where they comply with specified requirements, are free from corrosion, and integrity is verified by pulling mandrel through them.
- C. Fittings for Grounding and Bonding: See Section 26 05 26 for additional requirements.
- D. Provide conduit, fittings, supports, and accessories required for complete raceway system.
- E. Provide products listed, classified, and labeled as suitable for purpose intended.
- F. Minimum Conduit Size, Unless Otherwise Indicated:
 - 1. Branch Circuits: 3/4-inch trade size.
 - 2. Branch Circuit Homeruns: 3/4-inch trade size.
 - 3. Control Circuits: 1/2-inch trade size.
 - 4. Flexible Connections to Luminaires: 3/8-inch trade size.
- G. Where conduit size is not indicated, size to comply with NFPA 70 but not less than applicable minimum size requirements specified.

2.03 GALVANIZED STEEL RIGID METAL CONDUIT (RMC)

- A. Manufacturers:
 - 1. Allied Tube & Conduit, a division of Atkore International: www.alliedeg.com/#sle.
 - 2. Nucor Tubular Products: www.nucortubular.com/#sle.
 - 3. Rymco USA: www.rymcousa.com/#sle.
 - 4. Western Tube, a division of Zekelman Industries: www.westerntube.com/#sle.
 - 5. Wheatland Tube, a division of Zekelman Industries: www.wheatland.com/#sle.
 - 6. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Description: NFPA 70, Type RMC galvanized steel rigid metal conduit complying with ANSI C80.1 and listed and labeled as complying with UL 6.
- C. Fittings:
 - 1. Manufacturers:
 - a. ABB; T&B: www.electrification.us.abb.com/#sle.
 - b. Allied Tube & Conduit, a division of Atkore International: www.alliedeg.us/#sle.
 - c. Bridgeport Fittings Inc: www.bptfittings.com/#sle.
 - d. Emerson Electric Co; O-Z/Gedney: www.emerson.com/#sle.
 - e. Substitutions: See Section 01 60 00 - Product Requirements.
 - 2. Nonhazardous Locations: Use fittings complying with NEMA FB 1 and listed and labeled as complying with UL 514B or UL 6.

3. Material: Use steel or malleable iron.
 - a. Do not use die cast zinc fittings.
4. Connectors and Couplings: Use threaded type fittings only. Threadless fittings, including set screw and compression/gland types, are not permitted.

2.04 FLEXIBLE METAL CONDUIT (FMC)

- A. Manufacturers:
 1. AFC Cable Systems, Inc: www.afcweb.com/#sle.
 2. Electri-Flex Company: www.electriflex.com/#sle.
 3. International Metal Hose: www.metalhose.com/#sle.
 4. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Description: NFPA 70, Type FMC standard-wall steel flexible metal conduit listed and labeled as complying with UL 1, and listed for use in classified firestop systems.
- C. Fittings:
 1. Manufacturers:
 - a. ABB; T&B: www.electrification.us.abb.com/#sle.
 - b. Bridgeport Fittings, LLC: www.bptfittings.com/#sle.
 - c. Emerson Electric Co; O-Z/Gedney: www.emerson.com/#sle.
 - d. Substitutions: See Section 01 60 00 - Product Requirements.
 2. Description: Fittings complying with NEMA FB 1 and listed and labeled as complying with UL 514B.
 3. Material: Use steel or malleable iron.
 - a. Do not use die cast zinc fittings.

2.05 LIQUIDTIGHT FLEXIBLE METAL CONDUIT (LFMC)

- A. Manufacturers:
 1. AFC Cable Systems, Inc: www.afcweb.com/#sle.
 2. Electri-Flex Company: www.electriflex.com/#sle.
 3. International Metal Hose: www.metalhose.com/#sle.
 4. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Description: NFPA 70, Type LFMC polyvinyl chloride (PVC) jacketed steel flexible metal conduit listed and labeled as complying with UL 360.
- C. Fittings:
 1. Manufacturers:
 - a. ABB; T&B: www.electrification.us.abb.com/#sle.
 - b. Bridgeport Fittings, LLC: www.bptfittings.com/#sle.
 - c. Emerson Electric Co; O-Z/Gedney: www.emerson.com/#sle.
 - d. Substitutions: See Section 01 60 00 - Product Requirements.
 2. Description: Fittings complying with NEMA FB 1 and listed and labeled as complying with UL 514B.
 3. Material: Use steel or malleable iron.
 - a. Do not use die cast zinc fittings.

2.06 GALVANIZED STEEL ELECTRICAL METALLIC TUBING (EMT)

- A. Manufacturers:
 1. Allied Tube & Conduit: www.alliedeg.com.
 2. Nucor Tubular Products: www.nucortubular/#sle.
 3. Rymco USA: www.rymcousa.com/#sle.
 4. Western Tube, a division of Zekelman Industries: www.westerntube.com/#sle.
 5. Wheatland Tube Company: www.wheatland.com/#sle.
 6. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Description: NFPA 70, Type EMT galvanized steel electrical metallic tubing complying with ANSI C80.3 and listed and labeled as complying with UL 797.

- C. Fittings:
 - 1. Manufacturers:
 - a. ABB; T&B: www.electrification.us.abb.com/#sle.
 - b. Allied Tube & Conduit, a division of Atkore International: www.alliedeg.us/#sle.
 - c. Bridgeport Fittings, LLC: www.bptfittings.com/#sle.
 - d. Emerson Electric Co; O-Z/Gedney: www.emerson.com/#sle.
 - e. Substitutions: See Section 01 60 00 - Product Requirements.
 - 2. Description: Fittings complying with NEMA FB 1 and listed and labeled as complying with UL 514B.
 - 3. Material: Use steel or malleable iron.
 - a. Do not use die cast zinc fittings.
 - 4. Connectors and Couplings: Use compression (gland) type.
 - a. Do not use indenter type connectors and couplings.
 - b. Do not use set-screw type connectors and couplings.

2.07 ACCESSORIES

- A. Conduit Joint Compound: Corrosion-resistant, electrically conductive compound listed as complying with UL 2419; suitable for use with conduit to be installed.
- B. Pull Strings: Use nylon or polyester tape with average breaking strength of not less than 1,250 lbf.
- C. Foam Conduit Sealant:
 - 1. Removable, two-part, closed-cell foam, specifically designed for sealing conduit openings against water, moisture, gases, and dust.
 - 2. Suitable for use with conductors/cables and associated insulation/jackets to be installed.
 - 3. Rated to hold minimum of 10 ft water head pressure.
 - 4. Products:
 - a. American Polywater Corporation; Polywater AFT Foam Duct Sealant: www.polywater.com/#sle.
 - b. American Polywater Corporation; Polywater FST Foam Duct Sealant: www.polywater.com/#sle.
 - c. Substitutions: See Section 01 60 00 - Product Requirements.
- D. Sealing Systems for Concrete Penetrations:
 - 1. Sleeves: Provide water stop ring or cement coating that bonds to concrete to prevent water infiltration.
 - 2. Rate for minimum of 40 psig; suitable for sealing around conduits to be installed.
 - 3. Products:
 - a. American Polywater Corporation; PZVR Cement-Coated Concrete Wall Sleeves: www.polywater-haufftechnik.com/#sle.
 - b. American Polywater Corporation; PHSD Mechanical Seals: www.polywater-haufftechnik.com/#sle.
 - c. American Polywater Corporation; PHSI 150 Varia Double Wall Inserts: www.polywater-haufftechnik.com/#sle.
 - d. American Polywater Corporation; PGKD Modular Seals: www.polywater-haufftechnik.com/#sle.
 - e. Substitutions: See Section 01 60 00 - Product Requirements.
- E. Firestop Sleeves: Listed; provide as required to preserve fire resistance rating of building elements.
 - 1. Products:
 - a. HoldRite, a brand of Reliance Worldwide Corporation; HydroFlame Pro Series/HydroFlame Custom Built: www.holdrite.com/#sle.
 - b. Substitutions: See Section 01 60 00 - Product Requirements.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field measurements are as indicated.
- B. Verify that mounting surfaces are ready to receive conduits.
- C. Verify that conditions are satisfactory for installation prior to starting work.

3.02 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.
- B. All conduit penetrations into equipment enclosures shall be made by the Electrical Contractor.
- C. Install conduit securely in a neat and workmanlike manner in accordance with NECA 1.
- D. Galvanized Steel Rigid Metal Conduit (RMC): Install in accordance with NECA 101.
- E. Conduit Routing:
 - 1. Unless dimensioned, conduit routing indicated is diagrammatic.
 - 2. When conduit destination is indicated without specific routing, determine exact routing required.
 - 3. Conceal all conduits within finished walls, ceilings and floors unless specifically indicated to be exposed.
 - 4. Conduits in the following areas may be exposed, unless otherwise indicated:
 - a. Electrical rooms.
 - b. Mechanical equipment rooms.
 - c. Within joists in areas with no ceiling.
 - 5. Unless otherwise approved, do not route exposed conduits:
 - a. Across floors.
 - b. Across roofs.
 - c. Across top of parapet walls.
 - d. Across building exterior surfaces.
 - 6. Arrange conduit to maintain adequate headroom, clearances, and access.
 - 7. Arrange conduit to provide no more than the equivalent of four 90 degree bends between pull points. Use conduit bodies to make sharp changes in direction, as around beams. Use hydraulic one-shot bender to fabricate bends in metal conduit larger than 2 inch size.
 - 8. Arrange conduit to provide no more than 150 feet between pull points.
 - 9. Route conduits above water and drain piping where possible.
 - 10. Arrange conduit to prevent moisture traps. Provide drain fittings at low points and at sealing fittings where moisture may collect.
 - 11. Maintain minimum clearance of 6 inches between conduits and piping for other systems.
 - 12. Maintain minimum clearance of 12 inches between conduits and hot surfaces. This includes, but is not limited to:
 - a. Heaters.
 - b. Hot water piping.
 - c. Flues.
 - 13. Group parallel conduits in same area on common rack.
- F. Conduit Support:
 - 1. Secure and support conduits in accordance with NFPA 70 using suitable supports and methods approved by authorities having jurisdiction; see Section 26 05 29.
 - 2. Provide independent support from building structure. Do not provide support from piping, ductwork, or other systems.
 - 3. Installation Above Suspended Ceilings: Do not provide support from ceiling support system. Do not provide support from ceiling grid or allow conduits to lay on ceiling tiles.
 - 4. Use conduit strap to support single surface-mounted conduit.
 - a. Use clamp back spacer with conduit strap for damp and wet locations to provide space between conduit and mounting surface.

5. Use metal channel/strut with accessory conduit clamps to support multiple parallel surface-mounted conduits.
 6. Use conduit clamp to support single conduit from beam clamp or threaded rod.
 7. Use trapeze hangers assembled from threaded rods and metal channel/strut with accessory conduit clamps to support multiple parallel suspended conduits.
 8. Use of spring steel conduit clips for support of conduits is not permitted.
 9. Use of wire for support of conduits is not permitted. Remove all wire used for temporary supports.
 10. Use of perforated pipe straps for support of conduits is not permitted.
 11. Where conduit support intervals specified in NFPA 70 and NECA standards differ, comply with most stringent requirements.
- G. Connections and Terminations:
1. Use fittings compatible with conduit used and suitable for location.
 2. Use approved zinc-rich paint or conduit joint compound on field-cut threads of galvanized steel conduits prior to making connections.
 3. Where two threaded conduits must be joined and neither can be rotated, use three-piece couplings or split couplings. Do not use running threads.
 4. Use suitable adapters where required to transition from one type of conduit to another.
 5. Provide drip loops for liquidtight flexible conduit connections to prevent drainage of liquid into connectors.
 6. Terminate threaded conduits in boxes and enclosures using threaded hubs or double lock nuts for dry locations and raintight hubs for wet locations.
 7. Provide insulating bushings, insulated throats, or listed metal fittings with smooth, rounded edges at conduit terminations to protect conductors.
 8. Bring conduit to shoulders of fittings. Secure joints and connections tightly to provide maximum mechanical strength and electrical continuity. Use bonding bushings or wedges at connections subject to vibration.
- H. Penetrations:
1. Do not penetrate or otherwise notch or cut structural members, including footings and grade beams, without approval of Structural Engineer.
 2. All penetrations through floors or walls shall be core-drilled. Use of jack hammers shall not be permitted. Maximum hole diameters shall not exceed 6 inches. All holes shall be spaced at least 18 inches apart in all directions. Re-use of existing penetrations shall be permitted.
 3. Prior to any core drilling through floors or walls, the Electrical Contractor shall visually survey both sides to determine if any pipes, ducts or electrical utilities exist that may present obstacles. The Electrical Contractor shall also identify locations of existing concrete slab reinforcement or in-slab utilities using a pachometer, x-ray or similar device. All core-drilled penetrations shall be a minimum of 3 inches away from existing concrete slab reinforcement or in-slab utilities.
 4. Make penetrations perpendicular to surfaces unless otherwise indicated.
 5. Provide steel sleeves for penetrations as indicated or as required to facilitate installation. Set sleeves flush with exposed surfaces unless otherwise indicated or required.
 6. Provide suitable sealing system where conduits penetrate exterior wall below grade.
 7. Where conduits penetrate waterproof membrane, seal as required to maintain integrity of membrane.
 8. Provide metal escutcheon plates for conduit penetrations exposed to public view.
 9. Install firestopping to preserve fire resistance rating of partitions and other elements, using materials and methods specified in Section 07 84 00.
- I. Stub-Up Connections for Equipment: Extend conductors to equipment with rigid metal conduit (RMC). Flexible metal conduit (FMC) or liquidtight flexible metal conduit (LFMC) may be used 6 inches above the floor.

- J. Conduit Movement Provisions: Where conduits are subject to movement, provide expansion and expansion/deflection fittings or approved flexible connections to prevent damage to enclosed conductors or connected equipment. This includes, but is not limited to:
 - 1. Where conduits cross structural joints intended for expansion, contraction, or deflection.
- K. Conduit Sealing:
 - 1. Use foam conduit sealant to prevent entry of moisture and gases. This includes, but is not limited to:
 - a. Where conduits enter building from outside.
 - b. Where service conduits enter building from underground distribution system.
 - c. Where conduits enter building from underground.
 - d. Where conduits may transport moisture to contact live parts.
 - 2. Where conduits cross barriers between areas of potential substantial temperature differential, use foam conduit sealant at accessible point near penetration to prevent condensation. This includes, but is not limited to:
 - a. Where conduits pass from outdoors into conditioned interior spaces.
 - b. Where conduits pass from unconditioned interior spaces into conditioned interior spaces.
- L. Provide pull string in each empty conduit and in conduits where conductors and cables are to be installed by others. Leave minimum slack of 12 inches at each end.
- M. Provide grounding and bonding of conduit in accordance with Section 26 05 26.
- N. Identify conduits; see Section 26 05 53.

3.03 FIELD QUALITY CONTROL

- A. See Section 01 40 00 - Quality Requirements for additional requirements.
- B. Repair cuts and abrasions in galvanized finishes using zinc-rich paint recommended by manufacturer. Replace components that exhibit signs of corrosion.
- C. Correct deficiencies and replace damaged or defective conduits.

3.04 CLEANING

- A. Clean interior of conduits to remove moisture and foreign matter.

3.05 PROTECTION

- A. Immediately after installation of conduit, use suitable manufactured plugs to provide protection from entry of moisture and foreign material and do not remove until ready for installation of conductors.
- B. Arrange supports to prevent misalignment during wiring installation.
- C. Cut conduit square using saw or pipecutter; de-burr cut ends.

END OF SECTION

SECTION 26 05 33.16
BOXES FOR ELECTRICAL SYSTEMS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Outlet and device boxes up to 100 cubic inches, including those used as junction and pull boxes.
- B. Cabinets and enclosures, including junction and pull boxes larger than 100 cubic inches.

1.02 RELATED REQUIREMENTS

- A. Section 07 84 00 - Firestopping.
- B. Section 26 05 26 - Grounding and Bonding for Electrical Systems.
- C. Section 26 05 29 - Hangers and Supports for Electrical Systems.
- D. Section 26 05 33.13 - Conduit for Electrical Systems:
 - 1. Conduit bodies and other fittings.
 - 2. Additional requirements for locating boxes to limit conduit length and/or number of bends between pulling points.
- E. Section 26 05 53 - Identification for Electrical Systems: Identification products and requirements.
- F. Section 26 27 26 - Wiring Devices:
 - 1. Wall plates.
 - 2. Additional requirements for locating boxes for wiring devices.
- G. Section 27 10 00 - Structured Cabling for Voice and Data (DTI): Additional requirements for communications systems outlet boxes.

1.03 REFERENCE STANDARDS

- A. NECA 1 - Standard for Good Workmanship in Electrical Construction; 2023.
- B. NECA 130 - Standard for Installing and Maintaining Wiring Devices; 2016.
- C. NEMA EN 10250 - Enclosures for Electrical Equipment (1000 Volts Maximum); 2024.
- D. NEMA FB 1 - Fittings, Cast Metal Boxes, and Conduit Bodies for Conduit, Electrical Metallic Tubing, and Cable; 2014.
- E. NEMA OS 1 - Sheet-Steel Outlet Boxes, Device Boxes, Covers, and Box Supports; 2013 (Reaffirmed 2020).
- F. NFPA 70 - National Electrical Code; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- G. UL 50 - Enclosures for Electrical Equipment, Non-Environmental Considerations; Current Edition, Including All Revisions.
- H. UL 50E - Enclosures for Electrical Equipment, Environmental Considerations; Current Edition, Including All Revisions.
- I. UL 508A - Industrial Control Panels; Current Edition, Including All Revisions.
- J. UL 514A - Metallic Outlet Boxes; Current Edition, Including All Revisions.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Coordinate the work with other trades to avoid placement of ductwork, piping, equipment, or other potential obstructions within the dedicated equipment spaces and working clearances for electrical equipment required by NFPA 70.
 - 2. Coordinate arrangement of electrical equipment with the dimensions and clearance requirements of the actual equipment to be installed.

3. Coordinate minimum sizes of boxes with the actual installed arrangement of conductors, clamps, support fittings, and devices, calculated according to NFPA 70.
4. Coordinate minimum sizes of pull boxes with the actual installed arrangement of connected conduits, calculated according to NFPA 70.
5. Coordinate the placement of boxes with millwork, furniture, devices, equipment, etc. installed under other sections or by others.
6. Coordinate the work with other trades to preserve insulation integrity.
7. Coordinate the work with other trades to provide walls suitable for installation of flush-mounted boxes where indicated.
8. Notify DEDC, LLC of any conflicts with or deviations from Contract Documents. Obtain direction before proceeding with work.

1.05 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide manufacturer's standard catalog pages and data sheets for outlet and device boxes and junction and pull boxes.
- C. Project Record Documents: Record actual locations for pull boxes.
- D. Maintenance Materials: Furnish the following for State of Delaware OMB - Division of Facilities Management's use in maintenance of project.
 1. See Section 01 60 00 - Product Requirements, for additional provisions.

1.06 QUALITY ASSURANCE

- A. Comply with requirements of NFPA 70.
- B. Maintain at the project site a copy of each referenced document that prescribes execution requirements.
- C. Product Listing Organization Qualifications: An organization recognized by OSHA as a Nationally Recognized Testing Laboratory (NRTL) and acceptable to authorities having jurisdiction.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. Receive, inspect, handle, and store products in accordance with manufacturer's instructions.

PART 2 PRODUCTS

2.01 BOXES

- A. General Requirements:
 1. Do not use boxes and associated accessories for applications other than as permitted by NFPA 70 and product listing.
 2. Provide all boxes, fittings, supports, and accessories required for a complete raceway system and to accommodate devices and equipment to be installed.
 3. Provide products listed, classified, and labeled as suitable for the purpose intended.
 4. Where box size is not indicated, size to comply with NFPA 70 but not less than applicable minimum size requirements specified.
 5. Provide grounding terminals within boxes where equipment grounding conductors terminate.
- B. Outlet and Device Boxes Up to 100 cubic inches, Including Those Used as Junction and Pull Boxes:
 1. Use sheet-steel boxes for concealed interior dry locations unless otherwise indicated or required.
 2. Use cast iron boxes or cast aluminum boxes for exposed interior dry locations, and for interior and exterior damp or wet locations unless otherwise indicated or required; furnish with compatible weatherproof gasketed covers.
 3. Use cast iron boxes or cast aluminum boxes where exposed galvanized steel rigid metal conduit is used.

4. Use suitable concrete type boxes where flush-mounted in concrete.
5. Use suitable masonry type boxes where flush-mounted in masonry walls.
6. Use raised covers suitable for the type of wall construction and device configuration where required.
7. Use shallow boxes where required by the type of wall construction.
8. Do not use "through-wall" boxes designed for access from both sides of wall.
9. Sheet-Steel Boxes: Comply with NEMA OS 1, and list and label as complying with UL 514A.
10. Cast Metal Boxes: Comply with NEMA FB 1, and list and label as complying with UL 514A; furnish with threaded hubs.
11. Boxes for Supporting Luminaires and Ceiling Fans: Listed as suitable for the type and weight of load to be supported; furnished with fixture stud to accommodate mounting of luminaire where required.
12. Boxes for Ganged Devices: Use multigang boxes of single-piece construction. Do not use field-connected gangable boxes unless specifically indicated or permitted.
13. Minimum Box Size, Unless Otherwise Indicated:
 - a. Junction Boxes: 4 inch square by 2-1/8 inch deep (100 by 54 mm) trade size.
 - b. Wiring Devices: 4 inch square by 2-1/8 inch deep (100 by 54 mm) trade size.
 - c. Communications Systems Outlets: 4 inch square by 2-1/8 inch (100 by 54 mm) trade size.
 - d. Ceiling Outlets: 4 inch octagonal or square by 2-1/8 inch deep (100 by 54 mm) trade size.
14. Wall Plates: Comply with Section 26 27 26.
15. Manufacturers:
 - a. Cooper Crouse-Hinds, a division of Eaton Corporation: www.cooperindustries.com/#sle.
 - b. Hubbell Incorporated; Bell Products: www.hubbell-rtb.com/#.
 - c. Hubbell Incorporated; RACO Products: www.hubbell-rtb.com/#sle.
 - d. O-Z/Gedney, a brand of Emerson Electric Co: www.emerson.com/#sle.
 - e. Thomas & Betts Corporation; Steel City Products: www.tnb.com/#sle.
 - f. Substitutions: See Section 01 60 00 - Product Requirements.
- C. Cabinets and Enclosures, Including Junction and Pull Boxes Larger Than 100 cubic inches:
 1. Comply with NEMA EN 10250, and list and label as complying with UL 50 and UL 50E, or UL 508A.
 2. NEMA EN 10250 Environment Type, Unless Otherwise Indicated:
 - a. Indoor Clean, Dry Locations: Type 1, painted steel.
 - b. Outdoor Locations: Type 3R, painted steel.
 3. Junction and Pull Boxes Larger Than 100 cubic inches:
 - a. Provide screw-cover or hinged-cover enclosures unless otherwise indicated.
 4. Finish for Painted Steel Enclosures: Manufacturer's standard grey unless otherwise indicated.
 5. Manufacturers:
 - a. Cooper B-Line, a division of Eaton Corporation: www.cooperindustries.com/#sle.
 - b. Hoffman, a brand of Pentair Technical Products: www.hoffmanonline.com/#sle.
 - c. Hubbell Incorporated; Wiegmann Products: www.hubbell-wiegmann.com/#sle.
 - d. Substitutions: See Section 01 60 00 - Product Requirements.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field measurements are as indicated.
- B. Verify that mounting surfaces are ready to receive boxes.
- C. Verify that conditions are satisfactory for installation prior to starting work.

3.02 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.
- B. Install boxes in accordance with NECA 1 (general workmanship) and, where applicable, NECA 130, including mounting heights specified in those standards where mounting heights are not indicated.
- C. Arrange equipment to provide minimum clearances in accordance with manufacturer's instructions and NFPA 70.
- D. Unless otherwise indicated, provide separate boxes for line voltage and low voltage systems.
- E. Flush-mount boxes in finished areas unless specifically indicated to be surface-mounted.
- F. Unless otherwise indicated, boxes may be surface-mounted where exposed conduits are indicated or permitted.
- G. Box Locations:
 - 1. Locate boxes to be accessible.
 - 2. Unless dimensioned, box locations indicated are approximate.
 - 3. Locate and orient boxes as required for devices installed under other sections or by others.
 - a. Switches, Receptacles, and Other Wiring Devices: Comply with Section 26 27 26.
 - b. Communications Systems Outlets: Comply with Section 27 10 00.
 - 4. Locate boxes so that wall plates do not span different building finishes.
 - 5. Locate boxes so that wall plates do not cross masonry joints.
 - 6. Unless otherwise indicated, where multiple outlet boxes are installed at the same location at different mounting heights, install along a common vertical center line.
 - 7. Do not install flush-mounted boxes on opposite sides of walls back-to-back. Provide minimum 6 inches horizontal separation unless otherwise indicated:
 - a. Acoustic-Rated Walls: Do not install flush-mounted boxes on opposite sides of walls back-to-back; provide minimum 24 inches horizontal separation.
 - b. Fire Resistance Rated Walls: Install flush-mounted boxes such that the required fire resistance will not be reduced.
 - 1) Do not install flush-mounted boxes on opposite sides of walls back-to-back; provide minimum 24 inches separation where wall is constructed with individual noncommunicating stud cavities or protect both boxes with listed putty pads.
 - 2) Do not install flush-mounted boxes with area larger than 16 square inches or such that the total aggregate area of openings exceeds 100 square inches for any 100 square feet of wall area.
 - 8. Locate junction and pull boxes as indicated, as required to facilitate installation of conductors, and to limit conduit length and/or number of bends between pulling points in accordance with Section 26 05 33.13.
 - 9. Locate junction and pull boxes in the following areas, unless otherwise indicated:
 - a. Concealed above accessible suspended ceilings.
 - b. Within joists in areas with no ceiling.
 - c. Electrical rooms.
 - d. Mechanical equipment rooms.
- H. Box Supports:
 - 1. Secure and support boxes in accordance with NFPA 70 and Section 26 05 29 using suitable supports and methods approved by the authority having jurisdiction.
 - 2. Provide independent support from building structure except for cast metal boxes (other than boxes used for fixture support) supported by threaded conduit connections in accordance with NFPA 70. Do not provide support from piping, ductwork, or other systems.
 - 3. Installation Above Suspended Ceilings: Do not provide support from ceiling grid or ceiling support system.

4. Use far-side support to secure flush-mounted boxes supported from single stud in hollow stud walls. Repair or replace supports for boxes that permit excessive movement.
- I. Install boxes plumb and level.
- J. Flush-Mounted Boxes:
 1. Install boxes in noncombustible materials such as concrete, tile, gypsum, plaster, etc. so that front edge of box or associated raised cover is not set back from finished surface more than 1/4 inch or does not project beyond finished surface.
 2. Install boxes in combustible materials such as wood so that front edge of box or associated raised cover is flush with finished surface.
 3. Repair rough openings around boxes in noncombustible materials such as concrete, tile, gypsum, plaster, etc. so that there are no gaps or open spaces greater than 1/8 inch at the edge of the box.
- K. Install boxes as required to preserve insulation integrity.
- L. Install permanent barrier between ganged wiring devices when voltage between adjacent devices exceeds 300 V.
- M. Install firestopping to preserve fire resistance rating of partitions and other elements, using materials and methods specified in Section 07 84 00.
- N. Close unused box openings.
- O. Install blank wall plates on junction boxes and on outlet boxes with no devices or equipment installed or designated for future use.
- P. Provide grounding and bonding of boxes, enclosures and cabinets in accordance with Section 26 05 26.
- Q. Identify boxes in accordance with Section 26 05 53.
- R. Install in locations as shown on Drawings, and as required for splices, taps, wire pulling, equipment connections, and as required by NFPA 70.
- S. Set wall mounted boxes at elevations to accommodate mounting heights indicated.
- T. Electrical boxes are shown on Drawings in approximate locations unless dimensioned.
 1. Adjust box locations up to 10 feet if required to accommodate intended purpose.
- U. Maintain headroom and present neat mechanical appearance.
- V. Inaccessible Ceiling Areas: Install outlet and junction boxes no more than 6 inches from ceiling access panel or from removable recessed luminaire.
- W. Coordinate mounting heights and locations of outlets mounted above counters, benches, and backsplashes.
- X. Locate outlet boxes to allow luminaires to be positioned as shown on reflected ceiling plan.
- Y. Align adjacent wall mounted outlet boxes for switches, thermostats, and similar devices.
- Z. Locate flush mounting boxes in masonry walls to require cutting of masonry unit corner only. Coordinate masonry cutting to achieve neat opening.
- AA. Secure flush mounting box to interior wall and partition studs. Accurately position to allow for surface finish thickness.
- BB. Use gang boxes with plaster rings for single device outlets unless otherwise indicated.

3.03 ADJUSTING

- A. Adjust flush-mounting outlets to make front flush with finished wall material.
- B. Install knockout closures in unused box openings.

3.04 CLEANING

- A. Clean interior of boxes to remove dirt, debris, plaster and other foreign material.
- B. Clean exposed surfaces and restore finish.

3.05 PROTECTION

- A. Immediately after installation, protect boxes from entry of moisture and foreign material until ready for installation of conductors.

END OF SECTION

SECTION 26 05 53
IDENTIFICATION FOR ELECTRICAL SYSTEMS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Electrical identification requirements.
- B. Identification nameplates and labels.
- C. Wire and cable markers.
- D. Voltage markers.
- E. Floor marking tape.
- F. Warning signs and labels.

1.02 RELATED REQUIREMENTS

- A. Section 26 05 19 - Low-Voltage Electrical Power Conductors and Cables: Color coding for power conductors and cables 600 V and less; vinyl color coding electrical tape.
- B. Section 26 05 73 - Power System Studies: Arc flash hazard warning labels.
- C. Section 26 27 26 - Wiring Devices - Lutron: Device and wallplate finishes; factory pre-marked wallplates.

1.03 REFERENCE STANDARDS

- A. ANSI Z535.2 - American National Standard for Environmental and Facility Safety Signs; 2023.
- B. ANSI Z535.4 - American National Standard for Product Safety Signs and Labels; 2023.
- C. NFPA 70 - National Electrical Code; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- D. NFPA 70E - Standard for Electrical Safety in the Workplace; 2024.
- E. UL 969 - Marking and Labeling Systems; Current Edition, Including All Revisions.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Verify final designations for equipment, systems, and components to be identified prior to fabrication of identification products.
- B. Sequencing:
 - 1. Do not conceal items to be identified, in locations such as above suspended ceilings, until identification products have been installed.
 - 2. Do not install identification products until final surface finishes and painting are complete.

1.05 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements for submittals procedures.
- B. Product Data: Provide manufacturer's standard catalog pages and data sheets for each product.
- C. Shop Drawings: Provide schedule of items to be identified indicating proposed designations, materials, legends, and formats.

1.06 QUALITY ASSURANCE

- A. Comply with requirements of NFPA 70.

1.07 FIELD CONDITIONS

- A. Do not install adhesive products when ambient temperature is lower than recommended by manufacturer.

PART 2 PRODUCTS

2.01 IDENTIFICATION REQUIREMENTS

- A. Identification for Equipment:
 - 1. Use identification nameplate or identification label to identify each piece of electrical distribution and control equipment and associated sections, compartments, and components.
 - a. Panelboards:
 - 1) Identify ampere rating.
 - 2) Identify voltage and phase.
 - 3) Identify power source and circuit number. Include location when not within sight of equipment.
 - 4) Identify main overcurrent protective device. Use identification label for panelboards with a door.
 - 5) Use typewritten circuit directory to identify load(s) served for panelboards with a door. Identify spares and spaces using pencil.
 - b. Enclosed switches and motor controllers:
 - 1) Identify voltage and phase.
 - 2) Identify power source and circuit number. Include location when not within sight of equipment.
 - 3) Identify load(s) served. Include location when not within sight of equipment.
 - 2. Service Equipment:
 - a. Use identification nameplate or identification label to identify each service disconnecting means.
 - 3. Use identification nameplate or identification label to identify panelboards utilizing a high leg delta system in accordance with NFPA 70.
 - 4. Use identification nameplate or identification label to identify disconnect location for equipment with remote disconnecting means.
 - 5. Use identification label on inside of door at each fused switch to identify required NEMA fuse class and size.
 - 6. Use identification label to identify overcurrent protective devices for branch circuits serving fire alarm circuits. Identify with text "FIRE ALARM CIRCUIT".
 - 7. Use floor marking tape to identify required equipment working clearances where indicated or where required by the authority having jurisdiction.
 - 8. Available Fault Current Documentation: Use identification label or identification nameplate to identify the available fault current and date calculations were performed at locations requiring documentation by NFPA 70 including but not limited to the following.
 - a. Service equipment.
 - 9. Arc Flash Hazard Warning Labels: Comply with Section 26 05 73.
 - 10. Use warning signs to identify electrical hazards for entrances to all rooms and other guarded locations that contain exposed live parts operating at 600 V nominal or less with the word message "DANGER; Electrical hazard; Authorized personnel only" or approved equivalent.
 - 11. Use warning labels to identify electrical hazards for equipment where multiple power sources are present with the word message "DANGER; Hazardous voltage; Multiple power sources may be present; Disconnect all electric power including remote disconnects before servicing" or approved equivalent.
- B. Identification for Conductors and Cables:
 - 1. Color Coding for Power Conductors 600 V and Less: Comply with Section 26 05 19.
 - 2. Use identification label to identify color code for ungrounded and grounded power conductors inside door or enclosure at each piece of feeder or branch-circuit distribution equipment.
 - 3. Use wire and cable markers to identify circuit number or other designation indicated for power, control, and instrumentation conductors and cables at the following locations:

- a. At each source and load connection.
- b. Within boxes when more than one circuit is present.
- c. Within equipment enclosures when conductors and cables enter or leave the enclosure.
4. Use wire and cable markers to identify connected grounding electrode system components for grounding electrode conductors.
- C. Identification for Raceways:
 1. Use voltage markers, color-coded bands, or factory-painted conduits to identify systems other than normal power system for accessible conduits.
 - a. Maximum Intervals: 20 feet.
 - b. Color-Coded Bands: Use field-painting or vinyl color coding electrical tape to mark bands 3 inches wide.
 - 1) Vinyl Color Coding Electrical Tape: Comply with Section 26 05 19.
 - c. Color Code:
 - 1) Fire Alarm System: Red.
 2. Use identification labels or plastic marker tags to identify circuits enclosed for accessible conduits at wall penetrations, at floor penetrations, and at equipment terminations when source is not within sight.
 3. Use identification labels or plastic marker tags to identify spare conduits at each end. Identify purpose and termination location.
- D. Identification for Boxes:
 1. Use identification labels to identify highest voltage present.
 2. Use voltage markers or color coded boxes to identify systems other than normal power system.
 - a. Color-Coded Boxes: Field-painted with the same color code used for raceways.
 - 1) Fire Alarm System: Red.
 3. Use identification labels to identify circuits enclosed.
 - a. Identify circuits via power source and circuit numbers.
 - 1) Include voltage and phase for other than 120 V, single phase circuits.
- E. Identification for Devices:
 1. Wiring Device and Wallplate Finishes: Comply with Section 26 27 26.
 2. Use identification label to identify fire alarm system devices.
 - a. For devices concealed above suspended ceilings, provide additional identification on ceiling tile below device location.
 3. Use identification label to identify serving branch circuit for all receptacles.
 - a. For receptacles with weatherproof covers, provide identification on inside surface of weatherproof cover.
 4. Use identification label to identify load controlled for wall-mounted control devices.
- F. Identification for Luminaires:
 1. Use permanent red dot on luminaire frame to identify luminaires connected to emergency power system or with integral emergency battery units.

2.02 IDENTIFICATION NAMEPLATES AND LABELS

- A. Identification Nameplates:
 1. Manufacturers:
 - a. Brimar Industries, Inc: www.brimar.com/#sle.
 - b. Kolbi Pipe Marker Co: www.kolbipipemarkers.com/#sle.
 - c. Seton Identification Products: www.seton.com/#sle.
 - d. Substitutions: See Section 01 60 00 - Product Requirements.
 2. Materials:
 - a. Indoor Clean, Dry Locations: Use plastic nameplates.
 - b. Outdoor Locations: Use plastic nameplates suitable for exterior use.

3. Plastic Nameplates: Two-layer or three-layer laminated acrylic or electrically non-conductive phenolic with beveled edges; minimum thickness of 1/16 inch; engraved text.
 - a. Exception: Provide minimum thickness of 1/8 inch when any dimension is greater than 4 inches.
 4. Mounting Holes for Mechanical Fasteners: Two, centered on sides for sizes up to 1 inch high; Four, located at corners for larger sizes.
- B. Identification Labels:
1. Manufacturers:
 - a. Brady Corporation: www.bradyid.com/#sle.
 - b. Brother International Corporation: www.brother-usa.com/#sle.
 - c. Panduit Corp: www.panduit.com/#sle.
 - d. Substitutions: See Section 01 60 00 - Product Requirements.
 2. Materials: Use self-adhesive laminated plastic labels; UV, chemical, water, heat, and abrasion resistant.
 - a. Use only for indoor locations.
 3. Text: Use factory pre-printed or machine-printed text. Do not use handwritten text unless otherwise indicated.
- C. Format for Equipment Identification:
1. Minimum Size: 1.5 inches by 4 inches.
 2. Legend:
 - a. System designation where applicable:
 - 1) Fire Alarm System: Identify with text "FIRE ALARM".
 - b. Equipment designation or other approved description.
 - c. Voltage and phase (single-phase or 3-phase).
 - d. Power source and circuit number.
 - e. Other information as indicated.
 3. Text: All capitalized unless otherwise indicated.
 4. Minimum Text Height:
 - a. System Designation: 1 inch.
 - b. Equipment Designation: 1/4 inch.
 - c. Other Information: 1/4 inch.
 - d. Exception: Provide minimum text height of 1 inch for equipment located more than 10 feet above floor or working platform.
 5. Color:
 - a. Normal Power System: Black text on white background.
 - b. Fire Alarm System: White text on red background.
- D. Format for General Information and Operating Instructions:
1. Minimum Size: 2 inches by 4 inches.
 2. Legend: Include information or instructions indicated or as required for proper and safe operation and maintenance.
 3. Text: All capitalized unless otherwise indicated.
 4. Minimum Text Height: 1/4 inch.
 5. Color: White text on blue background unless otherwise indicated.
 - a. Exceptions:
 - 1) Provide white text on red background for general information or operational instructions for fire alarm systems.
- E. Format for Caution and Warning Messages:
1. Minimum Size: 2 inches by 4 inches.
 2. Legend: Include information or instructions indicated or as required for proper and safe operation and maintenance.
 3. Text: All capitalized unless otherwise indicated.
 4. Minimum Text Height: 1/2 inch.

5. Color: Black text on yellow background unless otherwise indicated.
- F. Format for Receptacle Identification:
 1. Minimum Size: 3/8 inch by 1.5 inches.
 2. Legend: Power source and circuit number or other designation indicated.
 3. Text: All capitalized unless otherwise indicated.
 4. Minimum Text Height: 3/16 inch.
 5. Color: Black text on clear background.
- G. Format for Control Device Identification (toggle switches, motor starters, etc.):
 1. Minimum Size: 3/8 inch by 1.5 inches.
 2. Legend: Load controlled, power source and circuit number or other designation indicated.
 3. Text: All capitalized unless otherwise indicated.
 4. Minimum Text Height: 3/16 inch.
 5. Color: Black text on clear background.
- H. Format for Fire Alarm Device Identification:
 1. Minimum Size: 3/8 inch by 1.5 inches.
 2. Legend: Designation indicated and device zone or address.
 3. Text: All capitalized unless otherwise indicated.
 4. Minimum Text Height: 3/16 inch.
 5. Color: White text on red background.

2.03 WIRE AND CABLE MARKERS

- A. Manufacturers:
 1. Brady Corporation: www.bradyid.com/#sle.
 2. HellermannTyton: www.hellermannntyton.com/#sle.
 3. Panduit Corp: www.panduit.com/#sle.
 4. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Markers for Conductors and Cables: Use heat-shrink sleeve type markers suitable for the conductor or cable to be identified.
 1. Do not use self-adhesive type markers.
- C. Markers for Conductor and Cable Bundles: Use plastic marker tags secured by nylon cable ties.
- D. Legend: Power source and circuit number or other designation indicated.
- E. Text: Use factory pre-printed or machine-printed text, all capitalized unless otherwise indicated.
 1. Do not use handwritten text.
- F. Minimum Text Height: 1/8 inch.
- G. Color: Black text on white background unless otherwise indicated.

2.04 VOLTAGE MARKERS

- A. Manufacturers:
 1. Brady Corporation: www.bradyid.com/#sle.
 2. Brimar Industries, Inc: www.brimar.com/#sle.
 3. Seton Identification Products: www.seton.com/#sle.
 4. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Markers for Conduits: Use factory pre-printed self-adhesive vinyl, self-adhesive vinyl cloth, or vinyl snap-around type markers.
- C. Markers for Boxes and Equipment Enclosures: Use factory pre-printed self-adhesive vinyl or self-adhesive vinyl cloth type markers.
- D. Minimum Size:
 1. Markers for Conduits: As recommended by manufacturer for conduit size to be identified.
 2. Markers for Pull Boxes: 1 1/8 by 4 1/2 inches.

3. Markers for Junction Boxes: 1/2 by 2 1/4 inches.
- E. Legend:
 1. Markers for System Identification:
 - a. Other Systems: Type of service.
- F. Color: Black text on orange background unless otherwise indicated.

2.05 FLOOR MARKING TAPE

- A. Manufacturers:
 1. Brady Corporation: www.bradyid.com/#sle.
 2. Brimar Industries, Inc: www.brimar.com/#sle.
 3. Insite Solutions, LLC: www.stop-painting.com/#sle.
 4. Seton Identification Products: www.seton.com/#sle.
 5. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Floor Marking Tape for Equipment Working Clearance Identification: Self-adhesive vinyl or polyester tape with overlamine, 3 inches wide, with alternating black and white stripes.

2.06 WARNING SIGNS AND LABELS

- A. Manufacturers:
 1. Brimar Industries, Inc: www.brimar.com/#sle.
 2. Clarion Safety Systems, LLC: www.clarionsafety.com/#sle.
 3. Insite Solutions, LLC: www.stop-painting.com/#sle.
 4. Seton Identification Products: www.seton.com/#sle.
 5. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Comply with ANSI Z535.2 or ANSI Z535.4 as applicable.
- C. Warning Signs:
 1. Materials:
 - a. Indoor Dry, Clean Locations: Use factory pre-printed rigid plastic or self-adhesive vinyl signs.
 - b. Outdoor Locations: Use factory pre-printed rigid aluminum signs.
 2. Rigid Signs: Provide four mounting holes at corners for mechanical fasteners.
 3. Minimum Size: 7 by 10 inches unless otherwise indicated.
- D. Warning Labels:
 1. Materials: Use factory pre-printed or machine-printed self-adhesive polyester or self-adhesive vinyl labels; UV, chemical, water, heat, and abrasion resistant; produced using materials recognized to UL 969.
 - a. Do not use labels designed to be completed using handwritten text.
 2. Machine-Printed Labels: Use thermal transfer process printing machines and accessories recommended by label manufacturer.
 3. Minimum Size: 2 by 4 inches unless otherwise indicated.

PART 3 EXECUTION

3.01 PREPARATION

- A. Clean surfaces to receive adhesive products according to manufacturer's instructions.

3.02 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.
- B. Install identification products to be plainly visible for examination, adjustment, servicing, and maintenance. Unless otherwise indicated, locate products as follows:
 1. Surface-Mounted Equipment: Enclosure front.
 2. Flush-Mounted Equipment: Enclosure front.
 3. Free-Standing Equipment: Enclosure front; also enclosure rear for equipment with rear access.

4. Elevated Equipment: Legible from the floor or working platform.
 5. Interior Components: Legible from the point of access.
 6. Conduits: Legible from the floor.
 7. Boxes: Outside face of cover.
 8. Conductors and Cables: Legible from the point of access.
 9. Devices: Outside face of cover.
- C. Install identification products centered, level, and parallel with lines of item being identified.
- D. Secure nameplates to exterior surfaces of enclosures using stainless steel screws or epoxy cement and to interior surfaces using self-adhesive backing or epoxy cement.
- E. Install self-adhesive labels and markers to achieve maximum adhesion, with no bubbles or wrinkles and edges properly sealed.
- F. Secure rigid signs using stainless steel screws.

3.03 FIELD QUALITY CONTROL

- A. See Section 01 40 00 - Quality Requirements, for additional requirements.
- B. Replace self-adhesive labels and markers that exhibit bubbles, wrinkles, curling or other signs of improper adhesion.

END OF SECTION

THIS PAGE INTENTIONALLY LEFT BLANK

**SECTION 26 05 73
POWER SYSTEM STUDIES**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Short-circuit study.
- B. Protective device coordination study.
- C. Arc flash and shock risk assessment.
 - 1. Includes arc flash hazard warning labels.
- D. Criteria for the selection and adjustment of equipment and associated protective devices not specified in this section, as determined by studies to be performed.

1.02 RELATED REQUIREMENTS

- A. Section 26 05 53 - Identification for Electrical Systems: Additional requirements for arc flash hazard warning labels.
- B. Section 26 24 16 - Panelboards.
- C. Section 26 28 13 - Fuses.
- D. Section 26 28 16.16 - Enclosed Switches.
- E. Section 26 29 13 - Enclosed Controllers.

1.03 REFERENCE STANDARDS

- A. ANSI Z535.4 - American National Standard for Product Safety Signs and Labels; 2023.
- B. IEEE 141 - IEEE Recommended Practice for Electric Power Distribution for Industrial Plants; 1993 (Reaffirmed 1999).
- C. IEEE 242 - IEEE Recommended Practice for Protection and Coordination of Industrial and Commercial Power Systems; 2001, with Errata (2003).
- D. IEEE 399 - IEEE Recommended Practice for Industrial and Commercial Power Systems Analysis; 1997.
- E. IEEE 551 - IEEE Recommended Practice for Calculating Short-Circuit Currents in Industrial and Commercial Power Systems; 2006.
- F. IEEE 1584 - IEEE Guide for Performing Arc-Flash Hazard Calculations; 2018, with Errata (2019).
- G. NEMA MG 00001 - Motors and Generators; 2024.
- H. NETA ATS - Standard for Acceptance Testing Specifications for Electrical Power Equipment And Systems; 2025.
- I. NFPA 70 - National Electrical Code; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- J. NFPA 70E - Standard for Electrical Safety in the Workplace; 2024.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Coordinate the work to provide equipment and associated protective devices complying with criteria for selection and adjustment, as determined by studies to be performed.
 - 2. Notify DEDC, LLC of any conflicts with or deviations from Contract Documents. Obtain direction before proceeding with work.
- B. Pre-Study Meeting: Conduct meeting with Owner to discuss system operating modes and conditions to be considered in studies.
- C. Sequencing:
 - 1. Submit study reports prior to or concurrent with product submittals.

2. Do not order equipment until matching study reports and product submittals have both been evaluated by DEDC, LLC.
 3. Verify naming convention for equipment identification prior to creation of final drawings, reports, and arc flash hazard warning labels (where applicable).
- D. Scheduling:
1. Arrange access to existing facility for data collection with State of Delaware OMB - Division of Facilities Management.
 2. Where work of this section involves interruption of existing electrical service, arrange service interruption with State of Delaware OMB - Division of Facilities Management.

1.05 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Study preparer's qualifications.
- C. Field testing agency's qualifications.
- D. Study reports, stamped or sealed and signed by study preparer.
- E. Product Data: In addition to submittal requirements specified in other sections, include manufacturer's standard catalog pages and data sheets for equipment and protective devices indicating information relevant to studies.
 1. Include characteristic time-current trip curves for protective devices.
 2. Identify modifications made in accordance with studies that:
 - a. Can be made at no additional cost to State of Delaware OMB - Division of Facilities Management.
 - b. As submitted will involve a change to the contract sum.
- F. Arc Flash Hazard Warning Label Samples: One of each type and legend specified.
- G. Field quality control reports.
- H. Certification that field adjustable protective devices have been set in accordance with requirements of studies.
- I. Project Record Documents: Revise studies as required to reflect as-built conditions.
 1. Include hard copies with operation and maintenance data submittals.
 2. Include computer software files used to prepare studies with file name(s) cross-referenced to specific pieces of equipment and systems.

1.06 POWER SYSTEM STUDIES

- A. Scope of Studies:
 1. Perform analysis of new electrical distribution system as indicated on drawings.
 2. Except where study descriptions below indicate exclusions, analyze system at each bus from primary protective devices of utility source down to each piece of equipment involved, including parts of system affecting calculations being performed (e.g. fault current contribution from motors).
 3. Include in analysis alternate sources and operating modes (including known future configurations) to determine worst case conditions.
 - a. Known Operating Modes:
 - 1) Utility as source.
- B. General Study Requirements:
 1. Comply with NFPA 70.
 2. Perform studies utilizing computer software complying with specified requirements; manual calculations are not permitted.
- C. Data Collection:
 1. Compile information on project-specific characteristics of actual installed equipment, protective devices, feeders, etc. as necessary to develop single-line diagram of electrical distribution system and associated input data for use in system modeling.

- a. Utility Source Data: Include primary voltage, maximum and minimum three-phase and line-to-ground fault currents, impedance, X/R ratio, and primary protective device information.
 - 1) Obtain up-to-date information from Utility Company.
 - 2) Utility Company: As indicated on drawings.
 - b. Motors: Include manufacturer/model, type (e.g. induction, synchronous), horsepower rating, voltage rating, full load amps, and locked rotor current or NEMA MG 00001 code letter designation.
 - c. Transformers: Include primary and secondary voltage ratings, kVA rating, winding configuration, percent impedance, and X/R ratio.
 - d. Protective Devices:
 - 1) Circuit Breakers: Include manufacturer/model, type (e.g. thermal magnetic, electronic trip), frame size, trip rating, voltage rating, interrupting rating, available field-adjustable trip response settings, and features (e.g. zone selective interlocking).
 - 2) Fuses: Include manufacturer/model, type/class (e.g. Class J), size/rating, and speed (e.g. time delay, fast acting).
 - e. Protective Relays: Include manufacturer/model, type, settings, current/potential transformer ratio, and associated protective device.
 - f. Conductors: Include feeder size, material (e.g. copper, aluminum), insulation type, voltage rating, number per phase, raceway type, and actual length.
- D. Short-Circuit Study:
- 1. Comply with IEEE 551 and applicable portions of IEEE 141, IEEE 242, and IEEE 399.
 - 2. For purposes of determining equipment short circuit current ratings, consider conditions that may result in maximum available fault current, including but not limited to:
 - a. Maximum utility fault currents.
 - b. Maximum motor contribution.
 - c. Known operating modes (e.g. utility as source, generator as source, utility/generator in parallel, bus tie breaker open/close positions).
 - 3. For each bus location, calculate the maximum available three-phase bolted symmetrical and asymmetrical fault currents. For grounded systems, also calculate the maximum available line-to-ground bolted fault currents.
- E. Protective Device Coordination Study:
- 1. Comply with applicable portions of IEEE 242 and IEEE 399.
 - 2. Analyze alternate scenarios considering known operating modes (e.g. utility as source, generator as source, utility/generator in parallel, bus tie breaker open/close positions).
 - 3. Analyze protective devices and associated settings for suitable margins between time-current curves to achieve best possible coordination while providing adequate protection for equipment and conductors.
- F. Arc Flash and Shock Risk Assessment:
- 1. Comply with NFPA 70E.
 - 2. Perform incident energy and arc flash boundary calculations in accordance with IEEE 1584 (as referenced in NFPA 70E Annex D), where applicable.
 - a. Where reasonable, study preparer may assume a maximum clearing time of two seconds in accordance with IEEE 1584, provided that the conditions are such that a worker's egress from an arc flash event would not be inhibited.
 - b. For single-phase systems, study preparer to perform calculations assuming three-phase system in accordance with IEEE 1584 using single phase bolted fault current, yielding conservative results.
 - 3. Analyze alternate scenarios considering conditions that may result in maximum incident energy, including but not limited to:
 - a. Maximum and minimum utility fault currents.
 - b. Maximum and minimum motor contribution.

- c. Known operating modes (e.g. utility as source, generator as source, utility/generator in parallel, bus tie breaker open/close positions).
- G. Study Reports:
 - 1. General Requirements:
 - a. Identify date of study and study preparer.
 - b. Identify study methodology and software product(s) used.
 - c. Identify scope of studies, assumptions made, implications of possible alternate scenarios, and any exclusions from studies.
 - d. Identify base used for per unit values.
 - e. Include single-line diagram and associated input data used for studies; identify buses on single-line diagram as referenced in reports, and indicate bus voltage.
 - f. Include conclusions and recommendations.
 - 2. Short-Circuit Study:
 - a. For each scenario, identify at each bus location:
 - 1) Calculated maximum available symmetrical and asymmetrical fault currents (both three-phase and line-to-ground where applicable).
 - 2) Fault point X/R ratio.
 - 3) Associated equipment short circuit current ratings.
 - b. Identify locations where the available fault current exceeds the equipment short circuit current rating, along with recommendations.
 - 3. Protective Device Coordination Study:
 - a. For each scenario, include time-current coordination curves plotted on log-log scale graphs.
 - b. For each graph include (where applicable):
 - 1) Partial single-line diagram identifying the portion of the system illustrated.
 - 2) Protective Devices: Time-current curves with applicable tolerance bands for each protective device in series back to the source, plotted up to the maximum available fault current at the associated bus.
 - 3) Conductors: Damage curves.
 - 4) Transformers: Inrush points and damage curves.
 - 5) Motors: Full load current, starting curves, and damage curves.
 - c. For each protective device, identify fixed and adjustable characteristics with available ranges and recommended settings.
 - 1) Include fuse ratings.
 - 2) Protective Relays: Include current/potential transformer ratios, tap, time dial, and instantaneous pickup.
 - d. Identify cases where either full selective coordination or adequate protection is not achieved, along with recommendations.
 - 4. Arc Flash and Shock Risk Assessment:
 - a. For the worst case for each scenario, identify at each bus location:
 - 1) Calculated incident energy and associated working distance.
 - 2) Calculated arc flash boundary.
 - 3) Bolted fault current.
 - 4) Arcing fault current.
 - 5) Clearing time.
 - 6) Arc gap distance.
 - b. For purposes of producing arc flash hazard warning labels, summarize the maximum incident energy and associated data reflecting the worst case condition of all scenarios at each bus location.
 - c. Include recommendations for reducing the incident energy at locations where the calculated maximum incident energy exceeds 8 calories per sq cm.

1.07 QUALITY ASSURANCE

- A. Study Preparer Qualifications: Professional electrical engineer licensed in Delaware and with minimum five years experience in preparation of studies of similar type and complexity using specified computer software.
 - 1. Study preparer may be employed by manufacturer of electrical distribution equipment.
 - 2. Study preparer may be employed by field testing agency.
 - 3. Study Preparers:
 - a. Pioneer Power Group: www.pioneerpwr.com/#sle.
 - b. High Voltage Maintenance Corporation: www.hvmcorp.com/#sle.
 - c. SEAM Group: www.seamgroup.com/#sle.
 - d. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Field Testing Agency Qualifications: Independent testing organization specializing in testing, analysis, and maintenance of electrical systems with minimum five years experience; NETA Accredited Company.
 - 1. Field Supervisor: Certified electrical testing technician; NETA ETT Level III.
- C. Computer Software for Study Preparation: Use the latest edition of commercially available software utilizing specified methodologies.
 - 1. Products:
 - a. EasyPower LLC: www.easypower.com/#sle.
 - b. ETAP/Operation Technology, Inc: www.etap.com/#sle.
 - c. Power Analytics Corporation: www.poweranalytics.com/#sle.
 - d. SKM Systems Analysis, Inc: www.skm.com/#sle.
 - e. Substitutions: See Section 01 60 00 - Product Requirements.

PART 2 PRODUCTS

2.01 ARC FLASH HAZARD WARNING LABELS

- A. Provide warning labels complying with ANSI Z535.4 to identify arc flash hazards for each work location analyzed by the arc flash and shock risk assessment.
 - 1. Materials: Comply with Section 26 05 53.
 - 2. Minimum Size: 4 by 6 inches.
 - 3. Legend: Provide custom legend in accordance with NFPA 70E based on equipment-specific data as determined by arc flash and shock risk assessment.
 - a. Include orange header that reads "WARNING" unless otherwise indicated.
 - b. Include the text "Arc Flash and Shock Hazard; Appropriate PPE Required" or approved equivalent.
 - c. Include the following information:
 - 1) Arc flash boundary.
 - 2) Available incident energy and corresponding working distance.
 - 3) Site-specific PPE (personnel protective equipment) requirements.
 - 4) Nominal system voltage.
 - 5) Limited approach boundary.
 - 6) Restricted approach boundary.
 - 7) Equipment identification.
 - 8) Study preparer, report reference, and date calculations were performed.

PART 3 EXECUTION

3.01 INSTALLATION

- A. Install arc flash warning labels in accordance with Section 26 05 53.

3.02 FIELD QUALITY CONTROL

- A. See Section 01 40 00 - Quality Requirements, for additional requirements.
- B. Provide the services of field testing agency or equipment manufacturer's representative to perform inspection, testing, and adjusting.

- C. Inspect and test in accordance with NETA ATS, except Section 4.
- D. Adjust equipment and protective devices for compliance with studies and recommended settings.
- E. Notify DEDC, LLC of any conflicts with or deviations from studies. Obtain direction before proceeding.
- F. Submit detailed reports indicating inspection and testing results, and final adjusted settings.

3.03 CLOSEOUT ACTIVITIES

- A. See Section 01 78 00 - Closeout Submittals, for closeout submittals.
- B. See Section 01 79 00 - Demonstration and Training, for additional requirements.
- C. Training: Include as part of the base bid training for State of Delaware OMB - Division of Facilities Management's personnel on electrical safety pertaining to arc flash and shock hazards.
 - 1. Use site-specific arc flash and shock risk assessment report as training reference, supplemented with additional training materials as required.
 - 2. Provide minimum of four hours of training.
 - 3. Instructor: Representative of entity performing study.
 - 4. Location: At project site.

END OF SECTION

**SECTION 26 05 83
WIRING CONNECTIONS**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Electrical connections to equipment.

1.02 RELATED REQUIREMENTS

- A. Section 26 05 19 - Low-Voltage Electrical Power Conductors and Cables.
- B. Section 26 05 33.13 - Conduit for Electrical Systems.
- C. Section 26 05 33.16 - Boxes for Electrical Systems.
- D. Section 26 28 16.16 - Enclosed Switches.
- E. Section 26 29 13 - Enclosed Controllers.

1.03 REFERENCE STANDARDS

- A. NFPA 70 - National Electrical Code; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Obtain and review shop drawings, product data, manufacturer's wiring diagrams, and manufacturer's instructions for equipment furnished under other sections.
 - 2. Determine connection locations and requirements.
- B. Sequencing:
 - 1. Install rough-in of electrical connections before installation of equipment is required.
 - 2. Make electrical connections before required start-up of equipment.

1.05 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.

1.06 QUALITY ASSURANCE

- A. Comply with requirements of NFPA 70.
- B. Products: Listed, classified, and labeled as suitable for the purpose intended.
- C. Product Listing Organization Qualifications: An organization recognized by OSHA as a Nationally Recognized Testing Laboratory (NRTL) and acceptable to authorities having jurisdiction.

PART 2 PRODUCTS

2.01 MATERIALS

- A. Disconnect Switches: As specified in Section 26 28 16.16.
- B. Enclosed Controllers: As specified in Section 26 29 13.
- C. Flexible Conduit: As specified in Section 26 05 33.13.
- D. Wire and Cable: As specified in Section 26 05 19.
- E. Boxes: As specified in Section 26 05 33.16.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that equipment is ready for electrical connection, wiring, and energization.

3.02 ELECTRICAL CONNECTIONS

- A. Make electrical connections in accordance with equipment manufacturer's instructions.

- B. Make conduit connections to equipment using flexible conduit. Use liquidtight flexible conduit with watertight connectors in damp or wet locations.
- C. Connect heat producing equipment using wire and cable with insulation suitable for temperatures encountered.
- D. Install disconnect switches, controllers, control stations, and control devices to complete equipment wiring requirements.
- E. Install terminal block jumpers to complete equipment wiring requirements.
- F. Install interconnecting conduit and wiring between devices and equipment to complete equipment wiring requirements.

END OF SECTION

**SECTION 26 27 26
WIRING DEVICES**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Wall switches.
- B. Wall dimmers.
- C. Receptacles.
- D. Wall plates and covers.
- E. Floor box service fittings.

1.02 RELATED REQUIREMENTS

- A. Section 26 05 26 - Grounding and Bonding for Electrical Systems.
- B. Section 26 05 33.16 - Boxes for Electrical Systems.
- C. Section 26 05 53 - Identification for Electrical Systems: Identification products and requirements.
- D. Section 26 09 23 - Lighting Control Devices: Devices for automatic control of lighting, including digital load controllers.

1.03 REFERENCE STANDARDS

- A. NECA 1 - Standard for Good Workmanship in Electrical Construction; 2023.
- B. NECA 130 - Standard for Installing and Maintaining Wiring Devices; 2016.
- C. NEMA WD 1 - General Color Requirements for Wiring Devices; 1999 (Reaffirmed 2020).
- D. NEMA WD 6 - Wiring Devices - Dimensional Specifications; 2021.
- E. NFPA 70 - National Electrical Code; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- F. UL 20 - General-Use Snap Switches; Current Edition, Including All Revisions.
- G. UL 498 - Attachment Plugs and Receptacles; Current Edition, Including All Revisions.
- H. UL 514D - Cover Plates for Flush-Mounted Wiring Devices; Current Edition, Including All Revisions.
- I. UL 943 - Ground-Fault Circuit-Interrupters; Current Edition, Including All Revisions.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Coordinate the placement of outlet boxes with millwork, furniture, equipment, etc. installed under other sections or by others.
 - 2. Coordinate wiring device ratings and configurations with the electrical requirements of actual equipment to be installed.
 - 3. Coordinate the placement of outlet boxes for wall switches with actual installed door swings.
 - 4. Coordinate the installation and preparation of uneven surfaces, such as split face block, to provide suitable surface for installation of wiring devices.
 - 5. Notify DEDC, LLC of any conflicts or deviations from Contract Documents to obtain direction prior to proceeding with work.
- B. Sequencing:
 - 1. Do not install wiring devices until final surface finishes and painting are complete.

1.05 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.

- B. Product Data: Provide manufacturer's catalog information showing dimensions, colors, and configurations.
- C. Field Quality Control Test Reports.
- D. Operation and Maintenance Data:
 - 1. Wall Dimmers: Include information on operation and setting of presets.
 - 2. GFCI Receptacles: Include information on status indicators.
- E. Project Record Documents: Record actual installed locations of wiring devices.
- F. Maintenance Materials: Furnish the following for State of Delaware OMB - Division of Facilities Management's use in maintenance of project.
 - 1. See Section 01 60 00 - Product Requirements, for additional provisions.
 - 2. Extra Wall Plates: Two of each style, size, and finish.
 - 3. Extra Flush Floor Service Fittings: Two of each type.

1.06 QUALITY ASSURANCE

- A. Comply with requirements of NFPA 70.
- B. Maintain at the project site a copy of each referenced document that prescribes execution requirements.
- C. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum three years documented experience.
- D. Products: Listed, classified, and labeled as suitable for the purpose intended.
- E. Product Listing Organization Qualifications: An organization recognized by OSHA as a Nationally Recognized Testing Laboratory (NRTL) and acceptable to authorities having jurisdiction.

1.07 DELIVERY, STORAGE, AND PROTECTION

- A. Store in a clean, dry space in original manufacturer's packaging until ready for installation.

PART 2 PRODUCTS

2.01 WIRING DEVICES - GENERAL REQUIREMENTS

- A. Provide wiring devices suitable for intended use with ratings adequate for load served.
- B. Except where explicitly permitted, substitution of combination switch-and-receptacle devices for separate switches and receptacles is not permitted.
- C. Wiring Device Applications:
 - 1. Receptacles Installed Outdoors or in Damp or Wet Locations: Use weather-resistant GFCI receptacles with weatherproof covers.
 - 2. Provide GFCI protection for:
 - a. Receptacles installed within 6 feet of sinks.
 - b. Receptacles installed in kitchens.
 - c. Receptacles serving electric drinking fountains.
 - 3. Single Receptacles Installed on Individual Branch Circuits: Provide receptacle ampere rating equal to branch circuit rating.
 - 4. Flush Floor Service Fittings in Carpeted Floors: Use carpet flanges.
- D. Wiring Device Finishes:
 - 1. Provide wiring device finishes as described below, unless otherwise indicated.
 - a. Wiring Devices Installed in Finished Spaces: White with white nylon wall plate.
 - b. Wiring Devices Installed in Unfinished Spaces: White with raised galvanized steel wall plate.
 - c. Wiring Devices Installed in Wet or Damp Locations: White with weatherproof cover.
 - d. Flush Floor Box Service Fittings: White wiring devices with brass cover and ring/flange.

2.02 WALL SWITCHES

- A. Manufacturers:
 - 1. Eaton Corporation: www.eaton.com/#sle.
 - 2. Hubbell Incorporated: www.hubbell.com/#sle.
 - 3. Leviton Manufacturing Company, Inc: www.leviton.com/#sle.
 - 4. Pass & Seymour, a brand of Legrand North America, Inc: www.legrand.us/#sle.
 - 5. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Wall Switches - General Requirements: AC only, quiet operating, general-use snap switches with silver alloy contacts, complying with NEMA WD 1 and NEMA WD 6, and listed as complying with UL 20; types as indicated on the drawings.
 - 1. Wiring Provisions: Terminal screws for side wiring and screw actuated binding clamp for back wiring with separate ground terminal screw.
- C. Standard Wall Switches: Industrial specification grade, 20 A, 120/277 V with standard toggle type switch actuator and maintained contacts; single pole single throw as indicated on the drawings.
 - 1. Accessories:
 - a. Lockable Toggle Guard: Provide permanent padlockable toggle guard where indicated on drawings.
- D. Low-Voltage Wall Switches: Provide low-voltage on/off switches suitable for use with digital load controllers furnished under Section 26 09 23 - Lighting Control Devices.
 - 1. Manufacturers: Same as digital load controllers.
 - 2. Characteristics: As indicated on drawings.

2.03 WALL DIMMERS

- A. Low-Voltage Wall Dimmers: Provide low-voltage dimming switches suitable for use with digital load controllers furnished under Section 26 09 23 - Lighting Control Devices.
 - 1. Manufacturers: Same as digital load controllers.
 - 2. Characteristics: As indicated on drawings.

2.04 RECEPTACLES

- A. Manufacturers:
 - 1. Eaton Corporation: www.eaton.com/#sle.
 - 2. Hubbell Incorporated: www.hubbell.com/#sle.
 - 3. Leviton Manufacturing Company, Inc: www.leviton.com/#sle.
 - 4. Pass & Seymour, a brand of Legrand North America, Inc: www.legrand.us/#sle.
 - 5. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Receptacles - General Requirements: Self-grounding, complying with NEMA WD 1 and NEMA WD 6, and listed as complying with UL 498; types as indicated on the drawings.
 - 1. Wiring Provisions: Terminal screws for side wiring or screw actuated binding clamp for back wiring with separate ground terminal screw.
 - 2. NEMA configurations specified are according to NEMA WD 6.
- C. Convenience Receptacles:
 - 1. Tamper Resistant Convenience Receptacles: Industrial specification grade, 20A, 125V, NEMA 5-20R, listed and labeled as tamper resistant type; single or duplex as indicated on the drawings.
 - 2. Automatically Controlled Tamper Resistant Convenience Receptacles: Industrial specification grade, 20A, 125V, NEMA 5-20R, single controlled face split-wired (where duplex); controlled receptacle marking on device face per NFPA 70; listed and labeled as tamper resistant type; single or duplex as indicated on the drawings.
- D. GFCI Receptacles:

1. GFCI Receptacles - General Requirements: Self-testing, with feed-through protection and light to indicate ground fault tripped condition and loss of protection; listed as complying with UL 943, class A.
2. Tamper Resistant and Weather Resistant GFCI Receptacles: Industrial specification grade, duplex, 20A, 125V, NEMA 5-20R, rectangular decorator style, listed and labeled as tamper resistant type and as weather resistant type complying with UL 498 Supplement SD suitable for installation in damp or wet locations.

2.05 WALL PLATES AND COVERS

- A. Manufacturers:
 1. Eaton Corporation: www.eaton.com/#sle.
 2. Hubbell Incorporated: www.hubbell-wiring.com/#sle.
 3. Leviton Manufacturing Company, Inc: www.leviton.com/#sle.
 4. Pass & Seymour, a brand of Legrand North America, Inc: www.legrand.us/#sle.
 5. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Wall Plates: Comply with UL 514D.
 1. Configuration: One piece cover as required for quantity and types of corresponding wiring devices.
 2. Size: Standard.
 3. Screws: Metal with slotted heads finished to match wall plate finish.
- C. Nylon Wall Plates: Smooth finish, high-impact thermoplastic.
- D. Raised Galvanized Steel Wall Plates: Rounded corners and edges, with corrosion resistant screws.
- E. Weatherproof Receptacle Covers for Wet or Damp Locations: Gasketed, cast aluminum, with hinged lockable cover and corrosion-resistant screws; listed as suitable for use in wet locations while in use with attachment plugs connected and identified as extra-duty type.

2.06 FLOOR BOX SERVICE FITTINGS

- A. Manufacturers:
 1. Hubbell Incorporated: www.hubbell.com/#sle.
 2. Thomas & Betts Corporation: www.tnb.com/#sle.
 3. Wiremold, a brand of Legrand North America, Inc: www.legrand.us/#sle.
 4. Substitutions: See Section 01 60 00 - Product Requirements.
- B. Description: Service fittings compatible for use with existing floor boxes with components, adapters and trims as required for complete installation.
- C. Flush Floor Service Fittings:
 1. Single Service Flush Convenience Receptacles:
 - a. Cover: Rectangular.
 - b. Configuration: One standard convenience duplex receptacle(s) with duplex flap opening(s).
 2. Accessories:
 - a. Carpet Flanges: Finish to match covers; configuration as required to accommodate specified covers.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field measurements are as indicated.
- B. Verify that outlet boxes are installed in proper locations and at proper mounting heights and are properly sized to accommodate devices and conductors in accordance with NFPA 70.
- C. Verify that wall openings are neatly cut and will be completely covered by wall plates.
- D. Verify that final surface finishes are complete, including painting.

- E. Verify that branch circuit wiring installation is completed, tested, and ready for connection to wiring devices.
- F. Verify that conditions are satisfactory for installation prior to starting work.

3.02 PREPARATION

- A. Provide extension rings to bring outlet boxes flush with finished surface.
- B. Clean dirt, debris, plaster, and other foreign materials from outlet boxes.

3.03 INSTALLATION

- A. Perform work in accordance with NECA 1 (general workmanship) and, where applicable, NECA 130, including mounting heights specified in those standards unless otherwise indicated.
- B. Coordinate locations of outlet boxes provided under Section 26 05 33.16 as required for installation of wiring devices provided under this section.
 - 1. Mounting Heights: Unless otherwise indicated, as follows:
 - a. Wall Switches: 48 inches above finished floor.
 - b. Wall Dimmers: 48 inches above finished floor.
 - c. Receptacles: 18 inches above finished floor or 6 inches above counter.
 - 2. Orient outlet boxes for vertical installation of wiring devices unless otherwise indicated.
 - 3. Where multiple receptacles, wall switches, or wall dimmers are installed at the same location and at the same mounting height, gang devices together under a common wall plate.
 - 4. Locate wall switches on strike side of door with edge of wall plate 3 inches from edge of door frame. Where locations are indicated otherwise, notify DEDC, LLC to obtain direction prior to proceeding with work.
- C. Install wiring devices in accordance with manufacturer's instructions.
- D. Install permanent barrier between ganged wiring devices when voltage between adjacent devices exceeds 300 V.
- E. Where required, connect wiring devices using pigtails not less than 6 inches long. Do not connect more than one conductor to wiring device terminals.
- F. Connect wiring devices by wrapping conductor clockwise 3/4 turn around screw terminal and tightening to proper torque specified by the manufacturer. Where present, do not use push-in pressure terminals that do not rely on screw-actuated binding.
- G. Unless otherwise indicated, connect wiring device grounding terminal to branch circuit equipment grounding conductor and to outlet box with bonding jumper.
- H. Provide GFCI receptacles with integral GFCI protection at each location indicated. Do not use feed-through wiring to protect downstream devices.
- I. Where split-wired duplex receptacles are indicated, remove tabs connecting top and bottom receptacles.
- J. Install wiring devices plumb, secure and level with mounting yoke held rigidly in place.
- K. Install wall switches with OFF position down.
- L. Install vertically mounted receptacles with grounding pole on top and horizontally mounted receptacles with grounding pole on left.
- M. Install wall plates to fit completely flush to wall with no gaps and rough opening completely covered without strain on wall plate. Repair or reinstall improperly installed outlet boxes or improperly sized rough openings. Do not use oversized wall plates in lieu of meeting this requirement.
- N. Install blank wall plates on junction boxes and on outlet boxes with no wiring devices installed or designated for future use.
- O. Identify wiring devices in accordance with Section 26 05 53.

- P. Install raised galvanized steel cover plates on outlet boxes and junction boxes in unfinished areas, above accessible ceilings, and on surface mounted switches & receptacles.

3.04 FIELD QUALITY CONTROL

- A. See Section 01 40 00 - Quality Requirements, for additional requirements.
- B. Inspect each wiring device for damage and defects.
- C. Operate each wall switch and wall dimmer with circuit energized to verify proper operation.
- D. Test each receptacle to verify operation and proper polarity.
- E. Test each GFCI receptacle for proper tripping operation according to manufacturer's instructions.
- F. Correct wiring deficiencies and replace damaged or defective wiring devices.

3.05 ADJUSTING

- A. Adjust devices and wall plates to be flush and level.

3.06 CLEANING

- A. Clean exposed surfaces to remove dirt, paint, or other foreign material and restore to match original factory finish.

END OF SECTION

SECTION 26 28 13 FUSES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Fuses.

1.02 RELATED REQUIREMENTS

- A. Section 26 28 16.16 - Enclosed Switches: Fusible switches.

1.03 REFERENCE STANDARDS

- A. NEMA FU 1 - Low Voltage Cartridge Fuses; 2012.
- B. NFPA 70 - National Electrical Code; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- C. UL 248-1 - Low-Voltage Fuses - Part 1: General Requirements; Current Edition, Including All Revisions.
- D. UL 248-12 - Low-Voltage Fuses - Part 12: Class R Fuses; Current Edition, Including All Revisions.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Coordinate fuse clips furnished in equipment provided under other sections for compatibility with indicated fuses.
 - a. Fusible Enclosed Switches: See Section 26 28 16.16.
 - 2. Coordinate fuse requirements according to manufacturer's recommendations and nameplate data for actual equipment to be installed.
 - 3. Notify DEDC, LLC of any conflicts with or deviations from Contract Documents. Obtain direction before proceeding with work.

1.05 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide manufacturer's standard data sheets including voltage and current ratings, interrupting ratings, time-current curves, and current limitation curves.
- C. Maintenance Materials: Furnish the following for State of Delaware OMB - Division of Facilities Management's use in maintenance of project.
 - 1. See Section 01 60 00 - Product Requirements, for additional provisions.
 - 2. Extra Fuses: One set(s) of three for each type and size installed.
 - 3. Fuse Pullers: One set(s) compatible with each type and size installed.

1.06 QUALITY ASSURANCE

- A. Comply with requirements of NFPA 70.
- B. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum three years documented experience.
- C. Product Listing Organization Qualifications: An organization recognized by OSHA as a Nationally Recognized Testing Laboratory (NRTL) and acceptable to authorities having jurisdiction.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Bussmann, a division of Eaton Corporation: www.cooperindustries.com/#sle.
- B. Littelfuse, Inc: www.littelfuse.com/#sle.
- C. Mersen: ep-us.mersen.com/#sle.

- D. Substitutions: See Section 01 60 00 - Product Requirements.

2.02 APPLICATIONS

- A. Individual Motor Branch Circuits: Class RK1, time-delay.

2.03 FUSES

- A. Provide products listed, classified, and labeled as suitable for the purpose intended.
- B. Unless specifically indicated to be excluded, provide fuses for all fusible equipment as required for a complete operating system.
- C. Provide fuses of the same type, rating, and manufacturer within the same switch.
- D. Comply with UL 248-1.
- E. Unless otherwise indicated, provide cartridge type fuses complying with NEMA FU 1, Class and ratings as indicated.
- F. Voltage Rating: Suitable for circuit voltage.
- G. Class R Fuses: Comply with UL 248-12.
- H. Provide the following accessories where indicated or where required to complete installation:
 - 1. Fuseholders: Compatible with indicated fuses.
 - 2. Fuse Reducers: For adapting indicated fuses to permit installation in switch designed for fuses with larger ampere ratings.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that fuse ratings are consistent with circuit voltage and manufacturer's recommendations and nameplate data for equipment.
- B. Verify that conditions are satisfactory for installation prior to starting work.

3.02 INSTALLATION

- A. Do not install fuses until circuits are ready to be energized.
- B. Install fuses with label oriented such that manufacturer, type, and size are easily read.

END OF SECTION

**SECTION 26 29 13
ENCLOSED CONTROLLERS**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Enclosed NEMA controllers for low-voltage (600 V and less) applications:
 - 1. Magnetic motor starters.
 - 2. Motor-starting switches without overload protection.
- B. Overcurrent protective devices for motor controllers, including overload relays.
- C. Control accessories:
 - 1. Auxiliary contacts.
 - 2. Pilot devices.
 - 3. Control power transformers.
 - 4. Control terminal blocks.

1.02 RELATED REQUIREMENTS

- A. Section 26 05 26 - Grounding and Bonding for Electrical Systems.
- B. Section 26 05 29 - Hangers and Supports for Electrical Systems.
- C. Section 26 05 53 - Identification for Electrical Systems: Identification products and requirements.
- D. Section 26 05 73 - Power System Studies: Additional criteria for the selection and adjustment of equipment and associated protective devices specified in this section.

1.03 REFERENCE STANDARDS

- A. NECA 1 - Standard for Good Workmanship in Electrical Construction; 2023.
- B. NEMA EN 10250 - Enclosures for Electrical Equipment (1000 Volts Maximum); 2024.
- C. NEMA IA 10030 - Industrial Control and Systems: Enclosures; 2024.
- D. NEMA IA 10039 - Control Circuit and Pilot Devices; 2025.
- E. NEMA ICS 2 - Industrial Control and Systems Controllers, Contactors and Overload Relays Rated 600 Volts; 2008 (Reaffirmed 2020).
- F. NETA ATS - Standard for Acceptance Testing Specifications for Electrical Power Equipment And Systems; 2025.
- G. NFPA 70 - National Electrical Code; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- H. UL 489 - Molded-Case Circuit Breakers, Molded-Case Switches and Circuit Breaker Enclosures; Current Edition, Including All Revisions.
- I. UL 60947-1 - Low-Voltage Switchgear and Controlgear - Part 1: General Rules; Current Edition, Including All Revisions.
- J. UL 60947-4-1 - Low-Voltage Switchgear and Controlgear - Part 4-1: Contactors and Motor-starters - Electromechanical Contactors and Motor-starters; Current Edition, Including All Revisions.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Coordinate the work with other trades to avoid placement of ductwork, piping, equipment, or other potential obstructions within the dedicated equipment spaces and working clearances required by NFPA 70.
 - 2. Coordinate the work to provide motor controllers and associated overload relays suitable for use with the actual motors to be installed.

3. Coordinate the work to provide controllers and associated wiring suitable for interface with control devices to be installed.
4. Coordinate arrangement of electrical equipment with the dimensions and clearance requirements of the actual equipment to be installed.
5. Verify with manufacturer that conductor terminations are suitable for use with the conductors to be installed.
6. Notify DEDC, LLC of any conflicts with or deviations from Contract Documents. Obtain direction before proceeding with work.

1.05 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide manufacturer's standard catalog pages and data sheets for motor controllers, enclosures, overcurrent protective devices, and other installed components and accessories.
 1. Include characteristic trip curves for each type and rating of overcurrent protective device upon request.
- C. Shop Drawings: Indicate dimensions, voltage, controller sizes, short circuit current ratings, conduit entry locations, conductor terminal information, and installed features and accessories.
 1. Include wiring diagrams showing all factory and field connections.
 2. Include documentation demonstrating selective coordination upon request.
- D. Field Quality Control Test Reports.
- E. Project Record Documents: Record actual installed locations of controllers and final equipment settings.
 1. Include nameplate data of actual installed motors and associated overload relay selections and settings.
 2. Motor Circuit Protectors: Include magnetic instantaneous trip settings.
- F. Maintenance Materials: Furnish the following for State of Delaware OMB - Division of Facilities Management's use in maintenance of project.
 1. See Section 01 60 00 - Product Requirements, for additional provisions.
 2. Electronic Trip Circuit Breakers: Provide one portable test set.
 3. Indicating Lights: Two of each different type.

1.06 QUALITY ASSURANCE

- A. Comply with requirements of NFPA 70.
- B. Maintain at the project site a copy of each referenced document that prescribes execution requirements.
- C. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum three years documented experience.
- D. Product Listing Organization Qualifications: An organization recognized by OSHA as a Nationally Recognized Testing Laboratory (NRTL) and acceptable to authorities having jurisdiction.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. Store in a clean, dry space. Maintain factory wrapping or provide an additional heavy canvas or heavy plastic cover to protect units from dirt, water, construction debris, and traffic.
- B. Handle carefully in accordance with manufacturer's written instructions to avoid damage to internal components, enclosure, and finish.

1.08 FIELD CONDITIONS

- A. Maintain field conditions within required service conditions during and after installation.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. ABB: www.electrification.us.abb.com/#sle.
- B. Eaton Corporation: www.eaton.com/#sle.
- C. Schneider Electric: www.se.com/#sle.
- D. Siemens Industry, Inc: www.new.siemens.com/#sle.
- E. Substitutions: See Section 01 60 00 - Product Requirements.
- F. Source Limitations: Provide enclosed motor controllers and associated components produced by same manufacturer as other electrical distribution equipment used for project and obtained from single supplier.
 - 1. Motor-starting switches without overload protection may be produced by same manufacturer as wiring devices used for project.

2.02 ENCLOSED CONTROLLERS

- A. Provide enclosed controller assemblies consisting of all required components, control power transformers, instrumentation and control wiring, accessories, etc. as necessary for a complete operating system.
- B. Provide products listed, classified, and labeled as suitable for the purpose intended.
- C. Description: Enclosed controllers complying with NEMA ICS 2, and listed and labeled as complying with UL 60947-1 and UL 60947-4-1; ratings, configurations and features as indicated on the drawings.
- D. Service Conditions:
 - 1. Provide controllers and associated components suitable for operation under the following service conditions without derating:
 - a. Altitude:
 - 1) Class 1 Km Equipment (devices utilizing power semiconductors, e.g. variable frequency controllers): Less than 3,300 feet.
 - 2) Class 2 Km Equipment (electromagnetic and manual devices): Less than 6,600 feet.
 - b. Ambient Temperature: Between 32 degrees F and 104 degrees F.
 - 2. Provide controllers and associated components suitable for operation at indicated ratings under the service conditions at the installed location.
- E. Short Circuit Current Rating:
 - 1. Provide controllers with listed short circuit current rating not less than the available fault current at the installed location as determined by short circuit study performed in accordance with Section 26 05 73.
 - 2. Listed series ratings are not acceptable.
- F. Selectivity: Where the requirement for selectivity is indicated, furnish products as required to achieve selective coordination.
- G. Conductor Terminations: Suitable for use with the conductors to be installed.
- H. Enclosures:
 - 1. Comply with NEMA IA 10030.
 - 2. Environment Type per NEMA EN 10250: Unless otherwise indicated, as specified for the following installation locations:
 - a. Indoor Clean, Dry Locations: Type 1 or Type 12.
 - 3. Finish: Manufacturer's standard unless otherwise indicated.
- I. Magnetic Motor Starters: Combination type unless otherwise indicated.
 - 1. Combination Magnetic Motor Starters: NEMA ICS 2, Class A combination motor controllers with magnetic contactor(s), externally operable disconnect and overload relay(s).

2. Configuration: Full-voltage non-reversing unless otherwise indicated.
3. Minimum Starter Size: NEMA Size 0.
4. Use of non-standard starter sizes smaller than specified standard NEMA sizes is not permitted.
5. Disconnects: Circuit breaker type.
 - a. Circuit Breakers: Motor circuit protectors (magnetic-only) unless otherwise indicated or required.
 - b. Provide externally operable handle with means for locking in the OFF position. Provide safety interlock to prevent opening the cover with the disconnect in the ON position with capability of overriding interlock for testing purposes.
6. Overload Relays: Solid-state type unless otherwise indicated.
7. Pilot Devices Required:
 - a. Furnish local pilot devices for each unit as specified below unless otherwise indicated on drawings.
 - b. Single-Speed, Non-Reversing Starters:
 - 1) Selector Switches: HAND/OFF/AUTO.
 - 2) Indicating Lights: Red ON, Green OFF.
- J. Motor-Starting Switches: Horsepower-rated switches without overload protection; toggle operator.
 1. Provide means for locking operator in the OFF position.

2.03 OVERCURRENT PROTECTIVE DEVICES

- A. Overload Relays:
 1. Provide overload relays and, where applicable, associated current elements/heaters, selected according to actual installed motor nameplate data, in accordance with manufacturer's recommendations and NFPA 70; include consideration for motor service factor and ambient temperature correction, where applicable.
 2. Inverse-Time Trip Class Rating: Class 20 unless otherwise indicated or required.
 3. Trip-free operation.
 4. Visible trip indication.
 5. Resettable.
 - a. Employ manual reset unless otherwise indicated.
 6. Solid-State Overload Relays:
 - a. Schneider Electric (Square D) Motor Logic.
 - b. Selectable inverse-time trip class rating; available ratings of class 10 and 20.
 - c. Adjustable full load current; range of 3 to 1.
 - d. Phase loss protection.
 - e. Phase imbalance protection.
 - f. Ambient temperature insensitive.
 - g. Thermal memory.
 - h. Trip test function.
 - i. Provide isolated alarm contact.
- B. Circuit Breakers:
 1. Motor Circuit Protectors:
 - a. Description: Instantaneous-trip circuit breakers furnished with magnetic instantaneous tripping elements for short circuit protection, but not with thermal inverse time tripping elements for overload protection; UL 489 recognized only for use as part of a listed combination motor controller with overload protection; ratings, configurations, and features as indicated on the drawings.
 - b. Provide field-adjustable magnetic instantaneous trip setting.
 - c. Provide the following features and accessories where indicated or where required to complete installation:
 - 1) Pad-Lock Provision: For locking circuit breaker handle in OFF position.

2.04 CONTROL ACCESSORIES

- A. Auxiliary Contacts:
 - 1. Comply with NEMA IA 10039.
 - 2. Provide number and type of contacts indicated or required to perform necessary functions, including holding (seal-in) circuit and interlocking, plus one normally open (NO) and one normally closed (NC) spare contact for each magnetic motor starter, minimum.
- B. Pilot Devices:
 - 1. Comply with NEMA IA 10039; heavy-duty type.
 - 2. Selector Switches: Unless otherwise indicated, provide maintained, non-illuminated type with knob operator; number of switch positions as indicated or as required.
 - 3. Indicating Lights: Push-to-test type unless otherwise indicated.
 - 4. Provide LED lamp source for indicating lights and illuminated devices.
- C. Control Power Transformers:
 - 1. Size to accommodate burden of contactor coil(s) and all connected auxiliary devices.
 - 2. Include primary and secondary fuses.
- D. Control Terminal Blocks: Include 25 percent spare terminals.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field measurements are as indicated.
- B. Verify that ratings of enclosed controllers are consistent with the indicated requirements.
- C. Verify that mounting surfaces are ready to receive enclosed controllers.
- D. Verify that conditions are satisfactory for installation prior to starting work.

3.02 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.
- B. Install controllers in accordance with NECA 1 (general workmanship).
- C. Arrange equipment to provide minimum clearances in accordance with manufacturer's instructions and NFPA 70.
- D. Provide required support and attachment in accordance with Section 26 05 29.
- E. Install enclosed controllers plumb and level.
- F. Provide grounding and bonding in accordance with Section 26 05 26.
- G. Install all field-installed devices, components, and accessories.
- H. Set field-adjustable controllers and associated components according to installed motor requirements, in accordance with manufacturer's recommendations and NFPA 70.
- I. Set field-adjustable circuit breaker tripping function settings as determined by overcurrent protective device coordination study performed in accordance with Section 26 05 73.
- J. Identify enclosed controllers in accordance with Section 26 05 53.

3.03 FIELD QUALITY CONTROL

- A. See Section 01 40 00 - Quality Requirements, for additional requirements.
- B. Provide services of a manufacturer's authorized representative to observe installation and assist in inspection and testing. Include manufacturer's reports with submittals.
- C. Inspect and test in accordance with NETA ATS, except Section 4.
- D. Motor Starters: Perform inspections and tests listed in NETA ATS, Section 7.16.1.1. Tests listed as optional are not required.
- E. Molded Case Circuit Breakers: Perform inspections and tests listed in NETA ATS, Section 7.6.1.1. Tests listed as optional are not required.

- F. Correct deficiencies and replace damaged or defective enclosed controllers or associated components.
- G. Submit detailed reports indicating inspection and testing results and corrective actions taken.

3.04 ADJUSTING

- A. Adjust tightness of mechanical and electrical connections to manufacturer's recommended torque settings. Where manufacturer's torque values are not indicated, use those specified in UL 486A and UL 486B.

3.05 CLEANING

- A. Clean dirt and debris from controller enclosures and components according to manufacturer's instructions.
- B. Repair scratched or marred exterior surfaces to match original factory finish.

3.06 CLOSEOUT ACTIVITIES

- A. See Section 01 78 00 - Closeout Submittals, for closeout submittals.
- B. See Section 01 79 00 - Demonstration and Training, for additional requirements.
- C. Demonstration: Demonstrate proper operation of controllers to State of Delaware OMB - Division of Facilities Management, and correct deficiencies or make adjustments as directed.
- D. Training: Train State of Delaware OMB - Division of Facilities Management's personnel on operation, adjustment, and maintenance of enclosed controllers and associated devices.
 - 1. Use operation and maintenance manual as training reference, supplemented with additional training materials as required.
 - 2. Provide minimum of two hours of training.
 - 3. Instructor: Manufacturer's authorized representative.
 - 4. Location: At project site.

3.07 PROTECTION

- A. Protect installed enclosed controllers from subsequent construction operations.

END OF SECTION

SECTION 26 43 00
SURGE PROTECTIVE DEVICES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Surge protective devices for service entrance locations.

1.02 RELATED REQUIREMENTS

- A. Section 26 05 26 - Grounding and Bonding for Electrical Systems.
- B. Section 26 24 13 - Switchboards.
- C. Section 26 24 16 - Panelboards.

1.03 ABBREVIATIONS AND ACRONYMS

- A. EMI/RFI: Electromagnetic Interference/Radio Frequency Interference.
- B. SPD: Surge Protective Device.

1.04 REFERENCE STANDARDS

- A. MIL-STD-220 - Method of Insertion Loss Measurement; 2009c (Validated 2024).
- B. NECA 1 - Standard for Good Workmanship in Electrical Construction; 2023.
- C. NEMA EN 10250 - Enclosures for Electrical Equipment (1000 Volts Maximum); 2024.
- D. NETA ATS - Standard for Acceptance Testing Specifications for Electrical Power Equipment And Systems; 2025.
- E. NFPA 70 - National Electrical Code; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- F. UL 1283 - Standard for Electromagnetic Interference Filters; Current Edition, Including All Revisions.
- G. UL 1449 - Standard for Surge Protective Devices; Current Edition, Including All Revisions.

1.05 ADMINISTRATIVE REQUIREMENTS

- A. Coordination: Coordinate size and location of overcurrent device compatible with the actual surge protective device and location to be installed. Notify DEDC, LLC of any conflicts or deviations from Contract Documents to obtain direction prior to ordering equipment.

1.06 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements, for submittal procedures.
- B. Product Data: Include detailed component information, voltage, surge current ratings, repetitive surge current capacity, voltage protection rating (VPR) for all protection modes, maximum continuous operating voltage (MCOV), nominal discharge current (I-n), short circuit current rating (SCCR), connection means including any required external overcurrent protection, enclosure ratings, outline and support point dimensions, weight, service condition requirements, and installed features.
 - 1. SPDs with EMI/RFI filter: Include noise attenuation performance.
- C. Shop Drawings: Include wiring diagrams showing all factory and field connections with wire and circuit breaker/fuse sizes.
- D. Certificates: Manufacturer's documentation of listing for compliance with the following standards:
 - 1. UL 1449.
 - 2. UL 1283 (for Type 2 SPDs).
- E. Field Quality Control Test Reports.

- F. Warranty: Submit sample of manufacturer's warranty and documentation of final executed warranty completed in State of Delaware OMB - Division of Facilities Management's name and registered with manufacturer.

1.07 QUALITY ASSURANCE

- A. Comply with requirements of NFPA 70.
- B. Maintain at the project site a copy of each referenced document that prescribes execution requirements.
- C. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum three years documented experience.
- D. Product Listing Organization Qualifications: An organization recognized by OSHA as a Nationally Recognized Testing Laboratory (NRTL) and acceptable to authorities having jurisdiction.

1.08 DELIVERY, STORAGE, AND PROTECTION

- A. Store in a clean, dry space in accordance with manufacturer's written instructions.

1.09 FIELD CONDITIONS

- A. Maintain field conditions within manufacturer's required service conditions during and after installation.

1.10 WARRANTY

- A. See Section 01 78 00 - Closeout Submittals, for additional warranty requirements.
- B. Manufacturer's Warranty: Provide minimum five year warranty from date of substantial completion covering repair or replacement of surge protective devices showing evidence of failure due to defective materials or workmanship.
- C. Exclude surge protective devices from any clause limiting warranty responsibility for acts of nature, including lightning, stated elsewhere.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Factory-installed, Internally Mounted Surge Protective Devices:
 - 1. Same as manufacturer of equipment containing surge protective device, to provide complete listed assembly including SPD.
- B. Substitutions: See Section 01 60 00 - Product Requirements.

2.02 SURGE PROTECTIVE DEVICES - GENERAL REQUIREMENTS

- A. Description: Factory-assembled surge protective devices (SPDs) for 60 Hz service; listed, classified, and labeled as suitable for the purpose intended; system voltage as indicated on the drawings.
- B. Unless otherwise indicated, provide factory-installed, internally-mounted SPDs.
- C. List and label as complying with UL 1449, Type 1 when connected on line side of service disconnect overcurrent device and Type 1 or 2 when connected on load side of service disconnect overcurrent device.
- D. Protected Modes:
 - 1. High Leg Delta Systems: L-N, L-G, N-G, L-L.
- E. UL 1449 Voltage Protection Ratings (VPRs):
 - 1. 240/120V System Voltage: Not more than 1,000 V for L-N, L-G, and N-G modes and 1,200 V for L-L mode.
- F. UL 1449 Maximum Continuous Operating Voltage (MCOV): Not less than 115% of nominal system voltage.

- G. Enclosure Environment Type per NEMA EN 10250: Unless otherwise indicated, as specified for the following installation locations:
 - 1. Indoor clean, dry locations: Type 1.
- H. Equipment Containing Factory-installed, Internally Mounted SPDs: Listed and labeled as a complete assembly including SPD.
 - 1. Panelboards: See Section 26 24 16.

2.03 SURGE PROTECTIVE DEVICES FOR SERVICE ENTRANCE LOCATIONS

- A. Surge Protective Device:
 - 1. Protection Circuits: Field-replaceable modular or non-modular.
 - 2. Surge Current Rating: Not less than 120 kA per mode/240 kA per phase.
 - 3. Repetitive Surge Current Capacity: Not less than 5,000 impulses.
 - 4. UL 1449 Nominal Discharge Current (I-n): 20 kA.
 - 5. UL 1449 Short Circuit Current Rating (SCCR): Not less than the short circuit current rating of the equipment the SPD is connected to.
 - 6. EMI/RFI Filtering: Provide EMI/RFI filter to attenuate electrical noise; listed as complying with UL 1283 for Type 2 SPDs (UL 1283 listing not available for Type 1 SPDs).
 - a. Noise Attenuation: Not less than 40 dB at 100 kHz using MIL-STD-220 insertion loss test method.
 - 7. Diagnostics:
 - a. Protection Status Monitoring: Provide indicator lights to report the protection for each phase.
 - b. Alarm Notification: Provide indicator light and audible alarm to report alarm condition. Provide button to manually silence audible alarm.
 - c. Remote Status Monitoring: Provide Form C dry type contacts (normally open and normally closed) for remote annunciation of status.
 - d. Surge Counter: Provide surge event counter with manual reset button, surge count retention upon power loss, and six digit LCD display that indicates quantity of surge events.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field measurements are as indicated.
- B. Verify that the service voltage and configuration marked on the SPD are consistent with the service voltage and configuration at the location to be installed.
- C. Verify system grounding and bonding is in accordance with Section 26 05 26, including bonding of neutral and ground for service entrance and separately derived systems where applicable. Do not energize SPD until deficiencies have been corrected.
- D. Verify that conditions are satisfactory for installation prior to starting work.

3.02 INSTALLATION

- A. Perform work in accordance with NECA 1 (general workmanship).
- B. Do not energize SPD until bonding of neutral and ground for service entrance and separately derived systems is complete in accordance with Section 26 05 26 where applicable. Replace SPDs damaged by improper or missing neutral-ground bond.
- C. Disconnect SPD prior to performing any high potential testing. Replace SPDs damaged by performing high potential testing with SPD connected.

3.03 FIELD QUALITY CONTROL

- A. See Section 01 40 00 - Quality Requirements, for additional requirements.
- B. Inspect and test in accordance with NETA ATS, except Section 4.
- C. Perform inspections and tests listed in NETA ATS Section 7.19.1.

- D. Procure services of a qualified manufacturer's representative to observe installation and assist in inspection, testing, and adjusting. Include manufacturer's reports with field quality control submittals.

3.04 CLEANING

- A. Repair scratched or marred exterior surfaces to match original factory finish.

END OF SECTION